

ADDENDUM NO. 2

TO: PLANS AND SPECIFICATIONS FOR STATE OF MISSOURI

**Parking Lot Repairs
Fulton Treatment Center
Fulton, Missouri
PROJECT NO. H2501-01**

Bid Date is: 1:30 PM, Thursday, July 2, 2026 (NOT CHANGED)

Bidders are hereby informed that the Construction Plans and/or Specifications are modified as follows:

BID FORM CHANGES:

1. None

SPECIFICATION CHANGES:

1. None

DRAWING CHANGES:

1. C-201 – REVISED Keynote 1 to state: Cold Mill 2-inches deep, seal visible cracks in milled surface, and overlay 3.5-inches surface course pavement in accordance with Detail A/C-300. Match existing crown of roadway to prevent ponding. Maintain minimum of 1% slope on all new pavement.
2. C-202 – REVISED Keynote 1 to state: Cold Mill 2-inches deep, seal visible cracks in milled surface, and overlay 3.5-inches surface course pavement in accordance with Detail A/C-300. Match existing crown of roadway to prevent ponding. Maintain minimum of 1% slope on all new pavement.
3. C-300 – REPLACE sheet in its entirety.

GENERAL COMMENTS:

1. The Pre-Bid Meeting was held June 12, 2026, followed by a walk-through of the site. The Pre-Bid Meeting sign-in sheet is attached.
2. Bidders needing additional site inspection should contact **Devon Woodruff** at 573.508.4023 to schedule a date and time.
3. Please contact April Howser, Contract Specialist, at 573-690-9874 or april.howser@oa.mo.gov, for questions about bidding procedures and MBE/WBE/SDVE goals and submittal requirements.
4. The deadline for technical questions was by **Noon on June 24, 2026**.
5. Changes to, or clarification of, the bid documents are only made as issued in the addenda.
6. All correspondence with respect to this project must include the State of Missouri project number as indicated above.
7. Current Planholders list available online at: [H2501-01 Parking Lot Repairs - Fulton Treatment Center :: State of Missouri Office of Administration](#) Prospective Bidders contact American Document Solutions, 1400 Forum Blvd Suite 1C, Columbia MO 65201, 573-446-7768 to order official plans and specifications.


8. All bids shall be submitted on the bid form without additional terms and conditions, modifications, or stipulations. Each space on the bid form shall be properly filled including a bid amount for the alternates. Failure to do so will result in rejection of the bid.
9. MBE/WBE/SDVE participation requirements can be found in DIVISION 00. The MBE/WBE/SDVE participation goals are 10%/10%/3%, respectively. Only certified firms as of the bid opening date can be used to satisfy the MBE/WBE/SDVE participation goals for this project. If a bidder is unable to meet a participation goal, a Good Faith Effort Determination Form must be completed. Failure to complete this process will result in rejection of the bid.

ATTACHMENTS:


1. Revised Plan Sheets - C-300

June 25, 2026

END ADDENDUM NO. 2

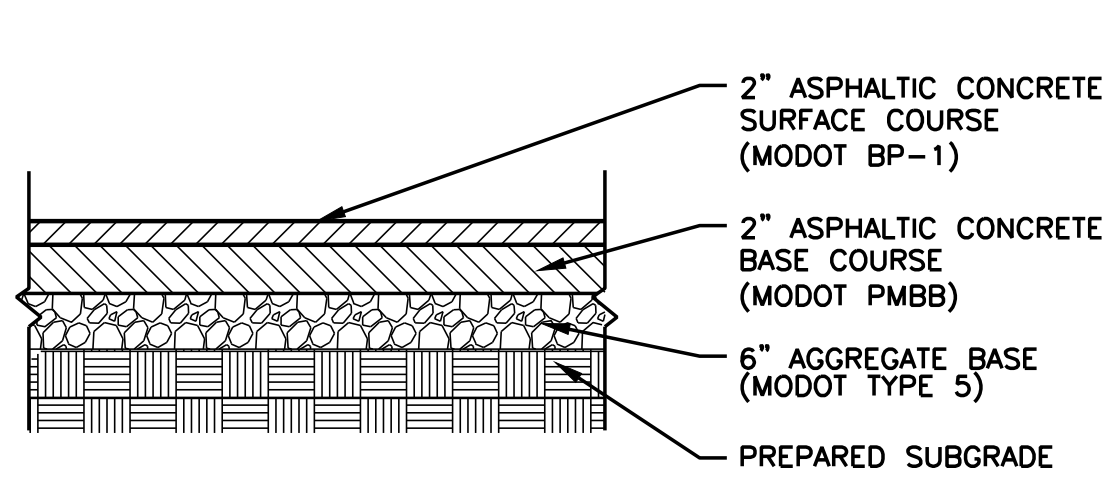


A ASPHALT PAVEMENT
NOT TO SCALE

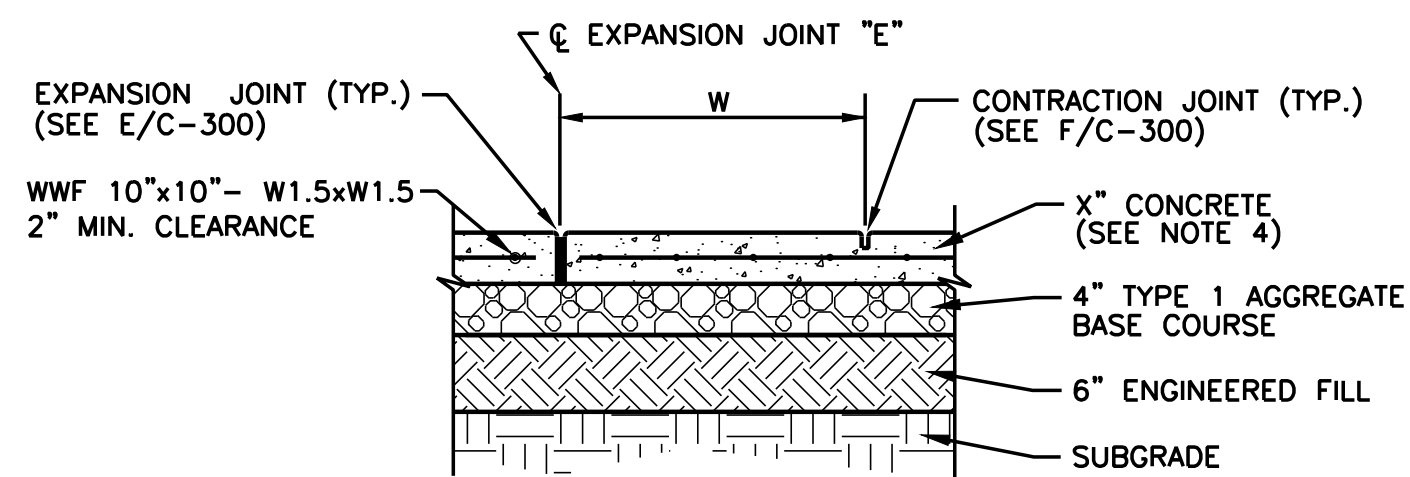

- NOTES:**
1. W=WIDTH VARIES - SEE PLANS
 2. EXPANSION JOINT SHALL BE PLACED THROUGH THE FULL DEPTH OF THE PAVEMENT.
 3. SAWCUT JOINTS WITHIN 16 HOURS OF PLACEMENT.
 4. USE 5" THICK CONCRETE FOR SIDEWALKS.
USE 8" THICK CONCRETE FOR ALTERNATE CONCRETE PAD.

B TYPICAL CONCRETE DETAIL
NOT TO SCALE

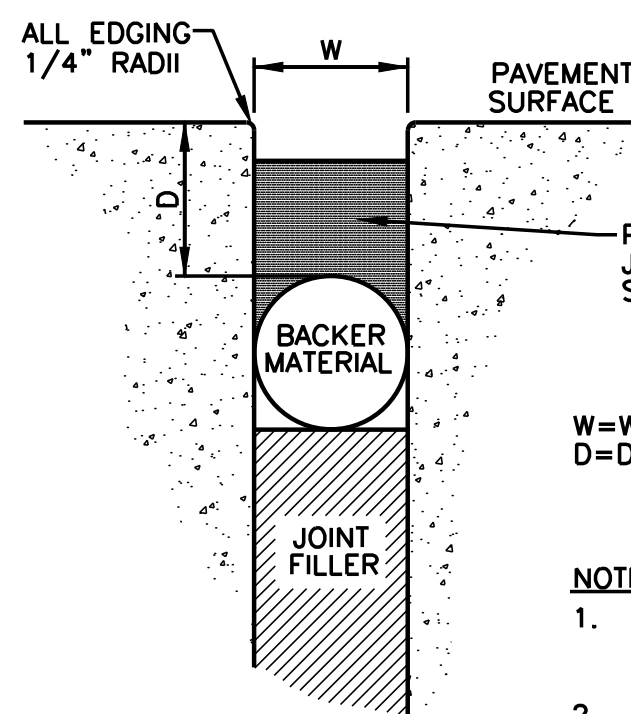


TABLE

JOINT SPACING FT.	WIDTH, (IN.)	
	MIN.	MAX.
<25	1/2	5/8
25-50	3/4	7/8
>50	1.0	1-1/8

W=WIDTH OF SEALANT RESERVOIR (SEE TABLE).
D=DEPTH OF SEALANT (1.0 TO 1.5 X W).


- NOTES:**
1. TOP OF SEALANT SHALL BE 1/8" TO 1/4" BELOW TOP OF PAVEMENT.
 2. EXPANSION JOINT DEPTH SHALL BE EQUAL TO SLAB THICKNESS.
 3. EXPANSION JOINT FILLER MATERIAL CAN ALSO HAVE A PERFORATED TOP FOR EASY REMOVAL. FILL TOP OF REMOVED STRIP WITH JOINT SEALER.

E EXPANSION JOINT
NOT TO SCALE

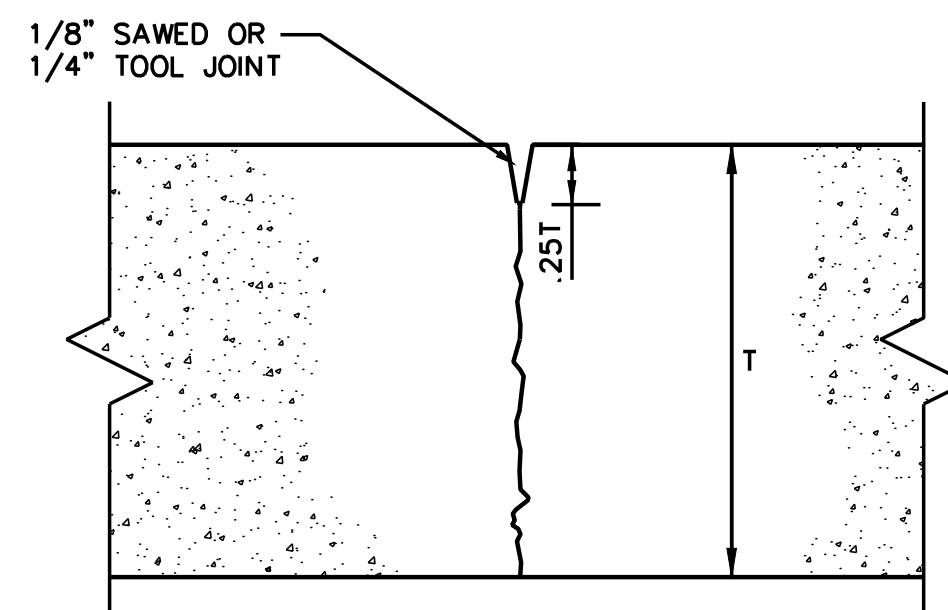


- NOTES:**
1. "T" DENOTES CONCRETE THICKNESS (SEE PAVEMENT SECTIONS)
 2. PLACE CONTRACTION JOINTS MAXIMUM OF 1.5X PAVEMENT THICKNESS.
 3. SAWCUT JOINTS WITHIN 12 HOURS OF PLACEMENT.
 4. ALL JOINTS TO BE SEALED PER SEALANT MANUFACTURERS' INSTRUCTIONS.

F CONTRACTION JOINT
NOT TO SCALE

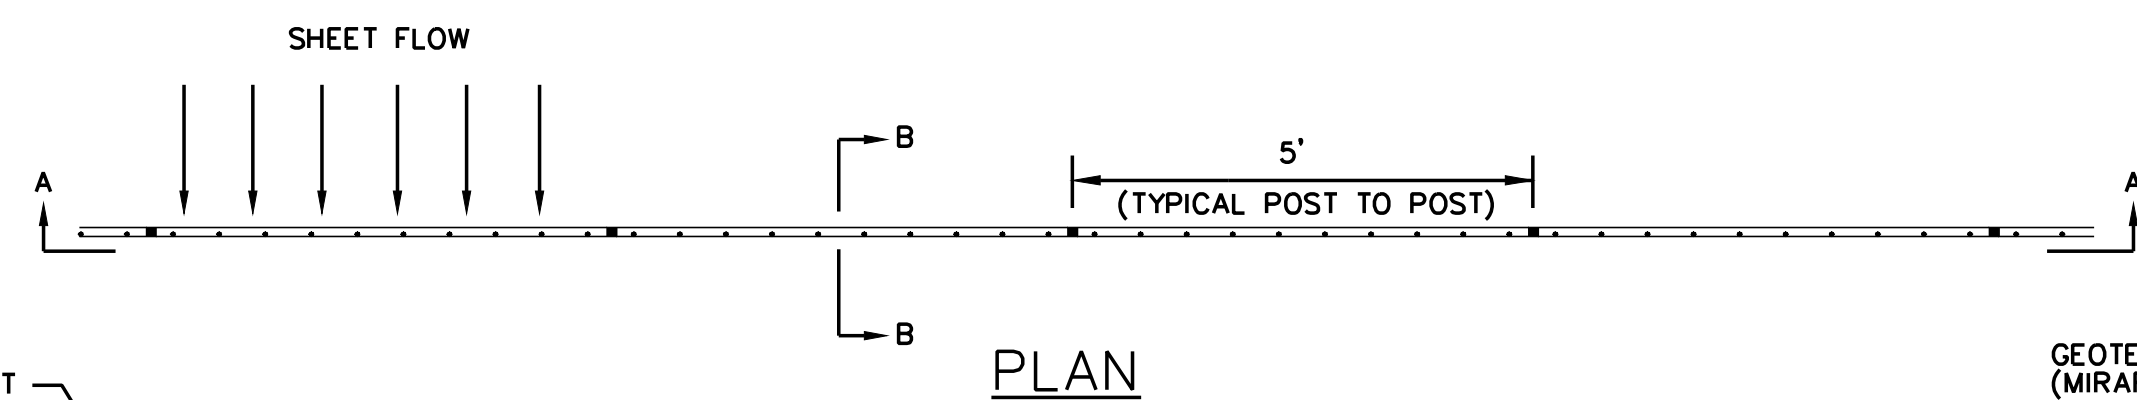

PLAN

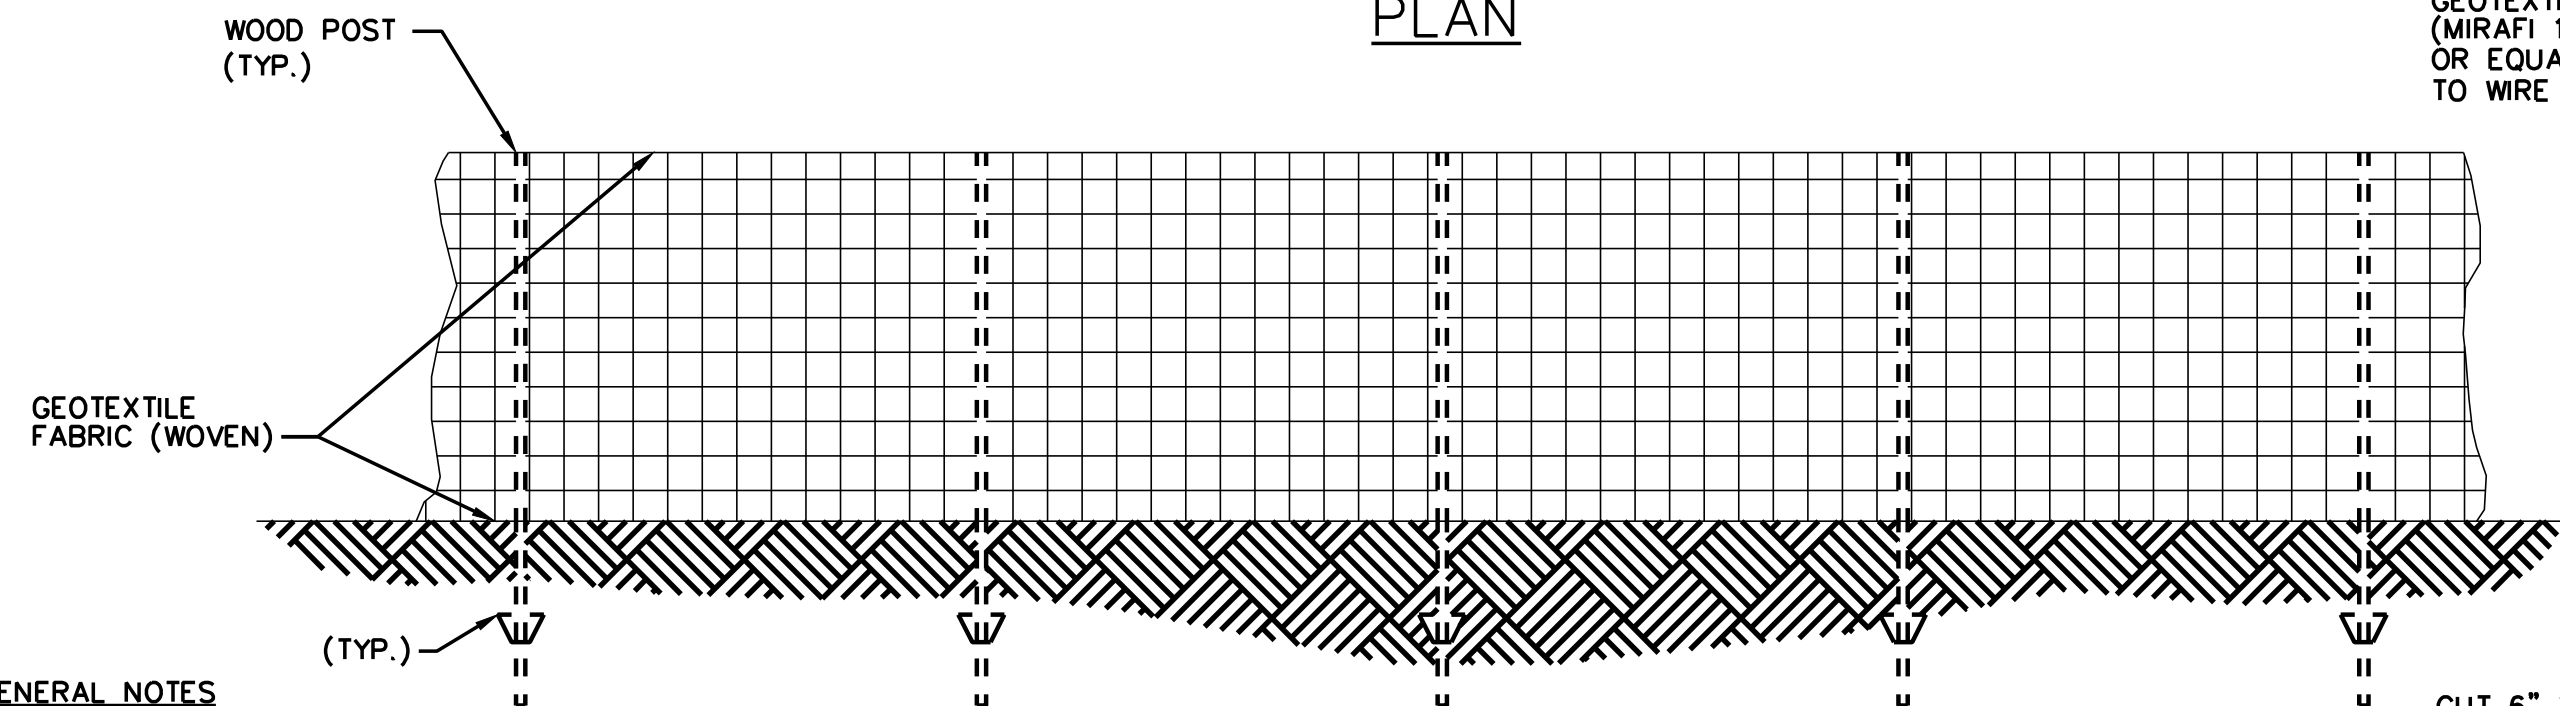


GENERAL NOTES



1. DO NOT SCALE DRAWING. FOLLOW DIMENSIONS.
2. SILTATION CONTROL DEVICES TO REMAIN IN PLACE UNTIL 70% VEGETATIVE GROWTH ENSURES NO FURTHER EROSION OF THE SOIL.
3. SILTATION FENCES SHALL BE INSPECTED PERIODICALLY FOR DAMAGE AND FOR THE AMOUNT OF SEDIMENTATION WHICH HAS ACCUMULATED. REMOVAL OF SEDIMENT WILL BE REQUIRED WHEN IT REACHES 1/2 OF THE HEIGHT OF THE SILTATION FENCE.
4. ATTACHMENT OF GEOTEXTILE FABRIC TO BE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATION.

SECTION A-A

I SILT FENCE
NOT TO SCALE

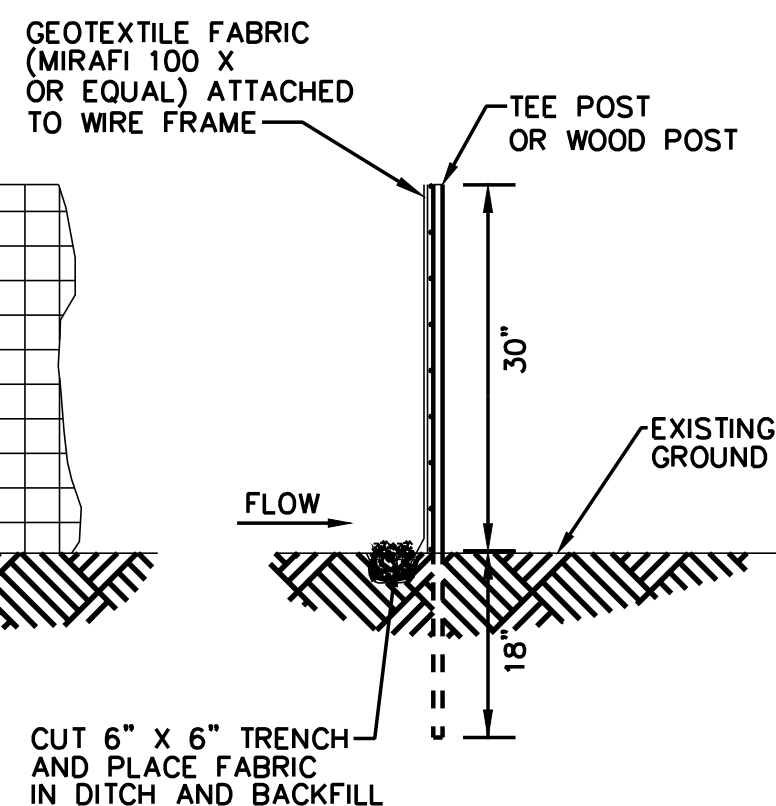


SECTION B-B

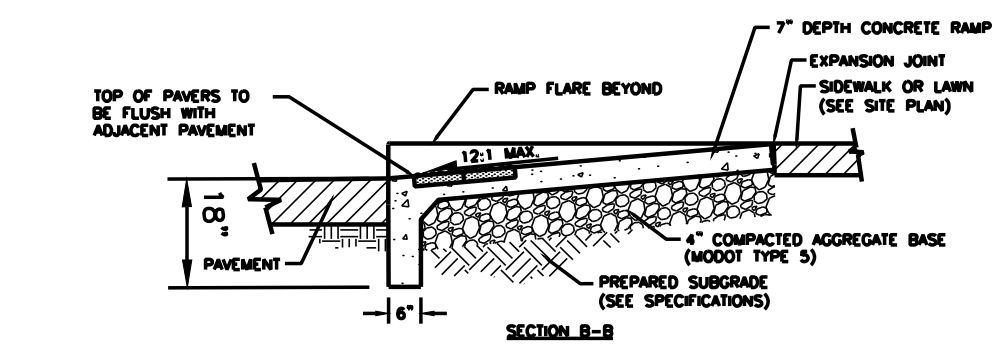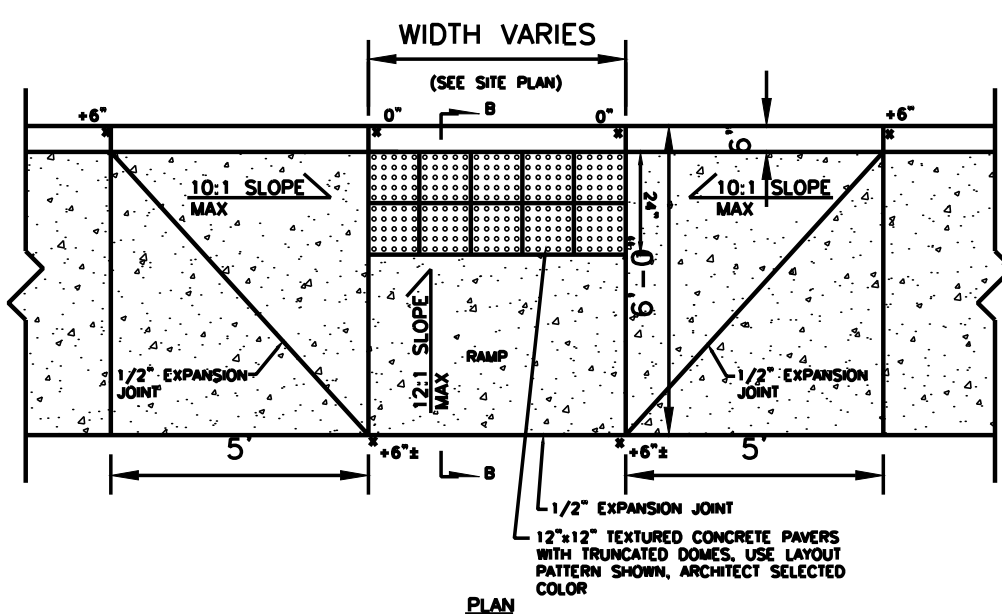

J SIDEWALK RAMP
NOT TO SCALE


C UTILITY TRENCH - UNDER PAVEMENT
NOT TO SCALE

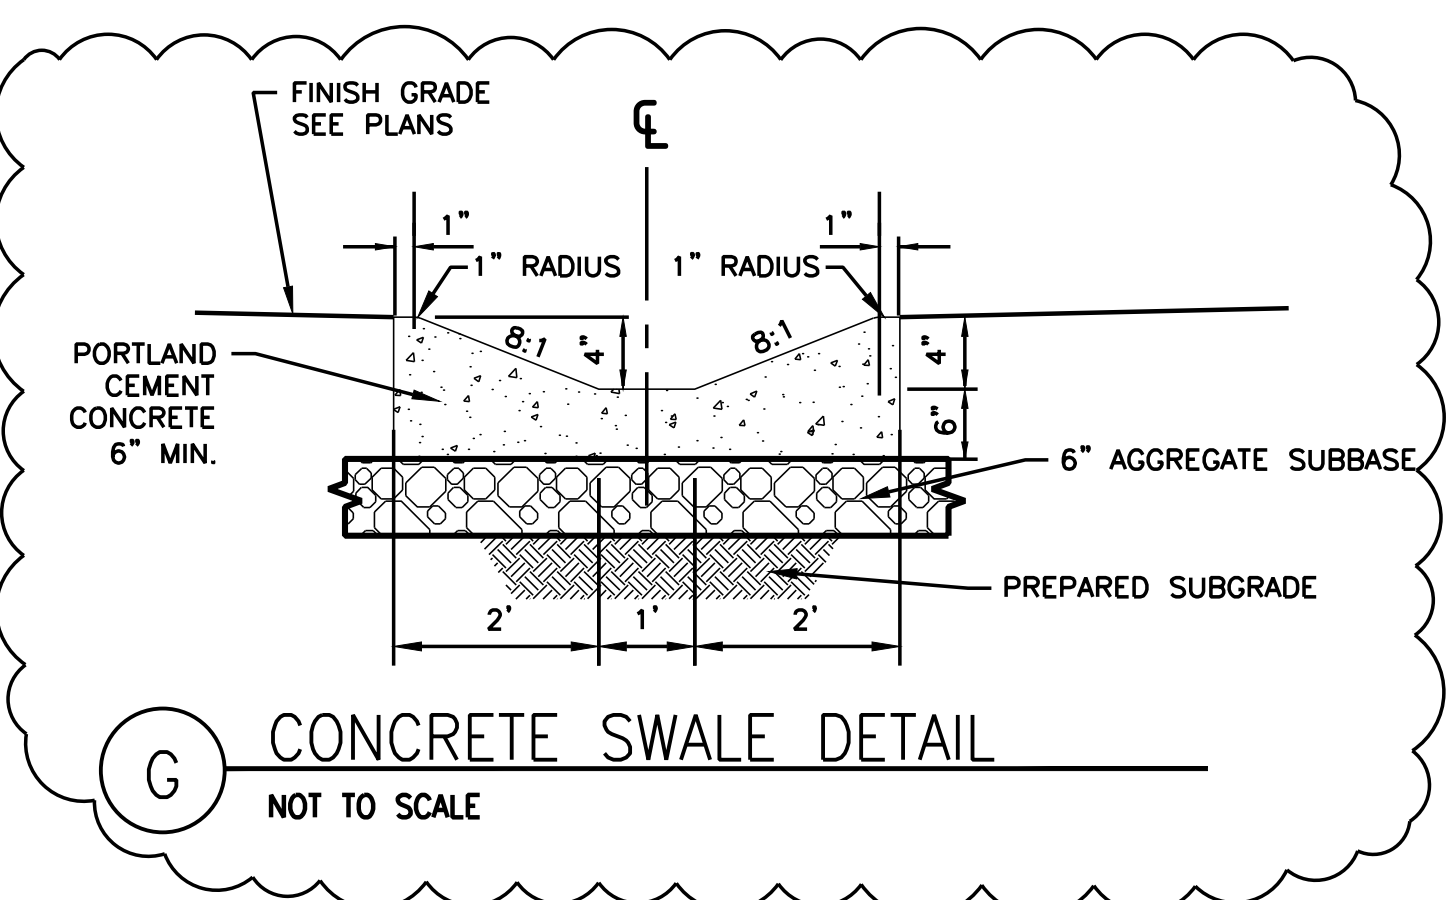


G CONCRETE SWALE DETAIL
NOT TO SCALE

- NOTES:**
1. SELECT GRANULAR BACKFILL SHALL CONSIST OF CRUSHED LIMESTONE AND SCREENINGS. COMPACT BACKFILL TO 95% MAXIMUM DENSITY AS DETERMINED BY THE MODIFIED PROCTOR COMPACTION TEST. (ASTM D 1557)
 2. CONTRACTOR SHALL BE RESPONSIBLE FOR SHORING AND BENCHING TRENCH EXCAVATIONS IN ACCORDANCE WITH ALL LOCAL, STATE, FEDERAL AND OSHA REQUIREMENTS.

D UTILITY TRENCH - UNDER LAWN
NOT TO SCALE

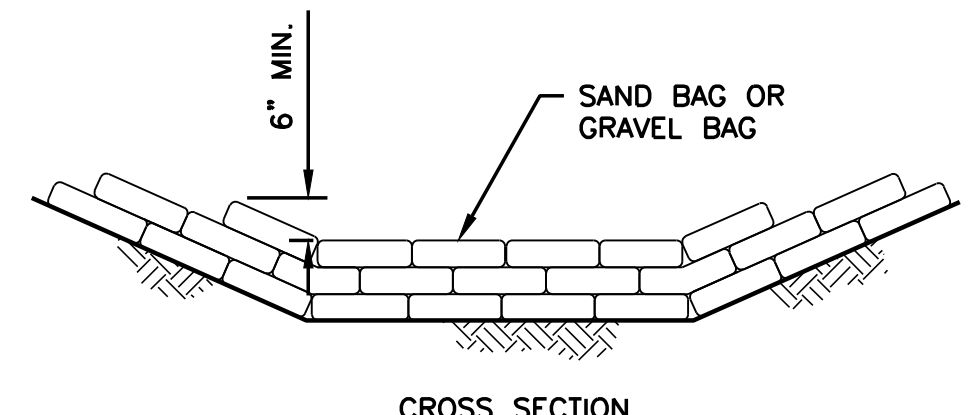


CROSS SECTION

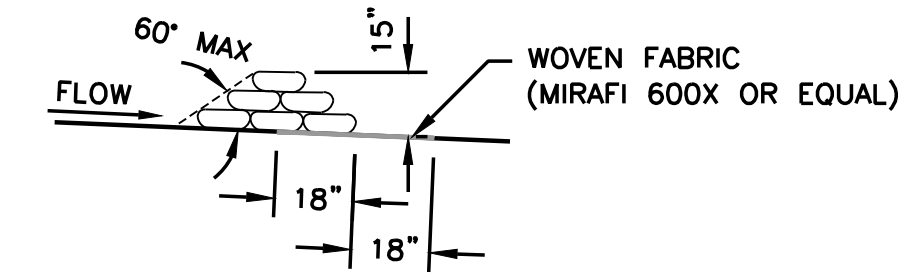

PROFILE

H CHECK DAM
NOT TO SCALE

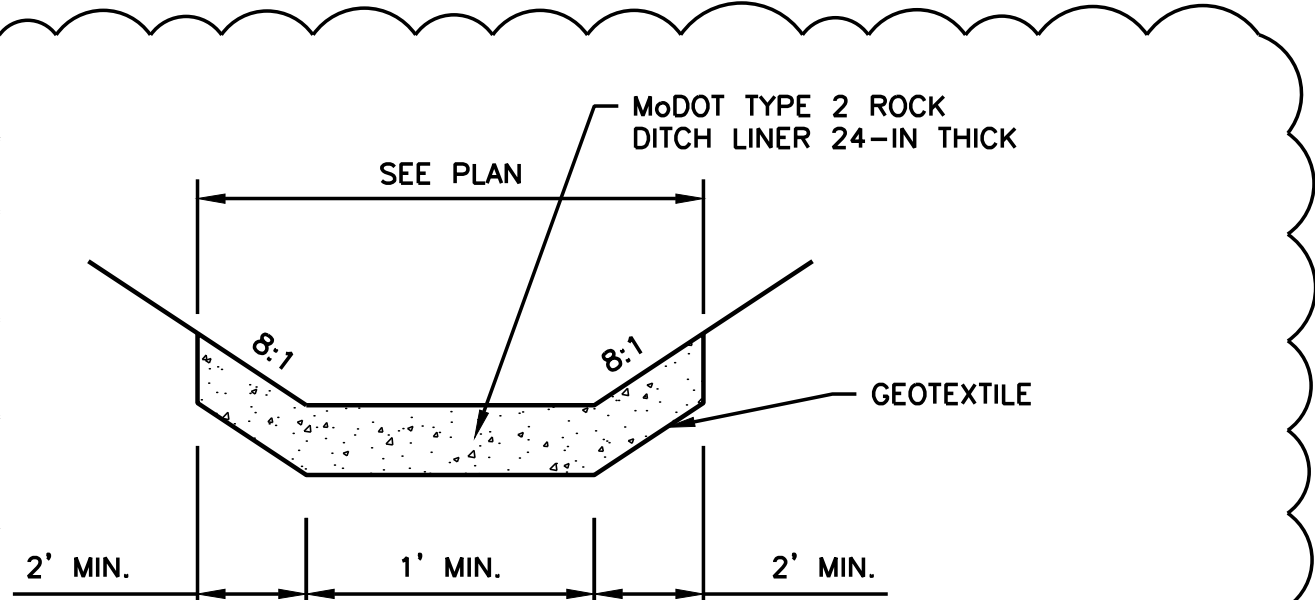

I ROCK OUTLET SECTION
NOT TO SCALE

GENERAL NOTES

1. ROCK OUTLET SECTION SHALL CONSIST OF MODOT TYPE 2 ROCK BLANKET.
2. ROCK BLANKET SHALL BE INSTALLED PER MODOT STANDARD PLAN 609.40.
3. ROCK BLANKET SHALL CONSIST OF RIP-RAP WITH 60% BEING LARGER THAN 1 FT³ IN ACCORDANCE WITH MODOT STANDARD SPECIFICATION 611.30.



5220 Oakland Avenue
St. Louis, MO 63110
314.863.5570



OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES
MANAGEMENT,
DESIGN AND CONSTRUCTION

DEPARTMENT OF
SOCIAL SERVICES
DIVISION OF YOUTH
SERVICES

PARKING LOT REPAIRS

FULTON
TREATMENT CENTER
1650 STATE ROUTE O
FULTON, MISSOURI 65251

PROJECT # H2501-01
SITE # 7708
FACILITY # 8877708001

REVISION: ADDENDUM 2
DATE: 06/24/2026
REVISION: _____
DATE: _____
REVISION: _____
DATE: _____
ISSUE DATE: 02/16/2026

CAD DWG FILE: R7246 PLANSET
DRAWN BY: AT
CHECKED BY: MW
DESIGNED BY: MW

SHEET TITLE:
SITE CIVIL DETAILS

SHEET NUMBER:

C-300

10 OF 10 SHEETS
02/16/2026