

ADDENDUM NO. 1

TO: PLANS AND SPECIFICATIONS FOR STATE OF MISSOURI

**Sewer Renovations Track-Lagoon
Finger Lakes State Park
Columbia, Missouri
PROJECT NO.: X2334-01**

Bid Opening Date: 1:30 PM, Nov 7, 2024 (Not Changed)

Bidders are hereby informed of the following:

SPECIFICATION CHANGES:

1. **Section 007300 Supplementary Conditions**, revise as follow:

2.0 CONTACTS:

Construction Representative: Carl Haley
Division of Facilities Management, Design and Construction
301 West High Street, Room 730
Jefferson City, MO 65101
Telephone: 573-526-0473
Email: Carl.Haley@oa.mo.gov

DRAWING CHANGES:

1. **Sheet E101, General Note** – Revise to State:

“ALL NEW ELECTRIC INSTALLATION SHALL BE COORDINATED WITH BOONE ELECTRIC BY CONTRACTOR”

GENERAL:

1. The Pre-Bid Meeting was held on October, 24 2024 at 2:00 PM. The Pre-Bid Meeting sign-in sheet is attached
2. Site Inspection occurred immediately after the formal Pre-Bid Meeting at Finger Lakes State Park.
3. Bidders needing an additional site inspection should contact Derek Mutter at (573) 443-5315 derek.mutter@dnr.mo.gov.
4. Please contact April Howser, Contract Specialist, at (573) 751-0053 for questions regarding bidding procedures and MBE/WBE/SDVE goals and submittal requirements.
5. The deadline for technical questions is November 1, 2024 at noon.
6. Changes to, or clarification of, the bid documents are only made as issued in the addenda.
7. Current Plan Holders list is available online at: [X2334-01 Sewer Renovations - Track Lagoon](#)

[Finger Lakes State Park: Plan Holders: State of Missouri Office of Administration \(oafmdcplanroom.com\)](http://oafmdcplanroom.com)

8. Prospective Bidders contact American Document Solutions, 1400 Forum Blvd Suite 1C, Columbia MO 65201, 573-446-7768 to order official plans and specifications.
9. All bids shall be submitted on the bid form without additional terms and conditions, modifications, or stipulations. Each space on the bid form shall be properly filled. Failure to do so will result in rejections of the bid.
10. MBE/WBE/SDVE participation requirements can be found in DIVISION 00. The MBE/WBE/SDVE participation goals are 0% / 0% / 3% respectively. Only certified firms as of the bid opening date can be used to satisfy the MBE/WBE/SDVE participation goals for this project. If a bidder is unable to meet a participation goal, a Good Faith Effort Determination Form must be completed. Failure to complete this process will result in rejection of the bid.

ATTACHMENTS:

1. Pre-Bid Meeting Sign-In Sheet
2. Sheet E101

October 25, 2024

END OF ADDENDUM NO. 1

Superintendent

**Pre-Bid Meeting Attendance Sheet
Sewer Renovations – Track Lagoon
Finger Lakes State Park
Columbia, MO 65202**

**Project No. X2334-01
October 24, 2024 at 2:00PM**


Name & Title	Company Name Type of Contracting	MBE/WBE/ SDVE Status	Phone	E-Mail Address
Phillip Akin Project Manager	OA-FMDC		(573) 301-1423	Phillip.akin@oa.mo.gov
Carl Haley Construction Administrator	OA-FMDC		(573) 526-0473	Carl.Haley@oa.mo.gov
Melanic Smith Dep. Regional Director	DNR-Missouri State Parks		(660) 888-1474	Melanie.robinson-smith@dnr.mo.gov
Derek Mutter Park Superintendent	DNR-Missouri State Parks		(573) 443-5315	Derek.mutter@dnr.mo.gov
Clint Barnett Project Manager	DNR-Missouri State Parks		(573) 645-8497	Clinton.barnett@dnr.mo.gov

**Pre-Bid Meeting Attendance Sheet
Sewer Renovations – Track Lagoon
Finger Lakes State Park
Columbia, MO 65202**

**Project No. X2334-01
October 24, 2024 at 2:00PM**

Name & Title	Company Name Type of Contracting	MBE/WBE/ SDVE Status	Phone	E-Mail Address
Jesse Stephens Designer	Crockett		(573) 447-0292	<u>JStephens@crockettengineering.com</u>
Charles Saunders	Brown and Root		(573) 721-3564	<u>Charles.saunders@brownandroot.com</u>
Kevin Rouse	Bio-Gard Inc.		(573) 442-5315	<u>kevin@bio-gard.com</u>
Kyle Ford	Dotson & Gibbs. Inc.		(573) 985-3700	<u>D-ginc@yahoo.com</u>
Michael Russell	Clean Infusion		(573) 489-2710	<u>MRussell@cleaninfusion.com</u>
Darrin Shoemaker Owner	Shuco Construction		(573) 554-5924	<u>Darrinshoemaker1970@gmail.com</u>
Noah Frank	Tri-Smith Construction		(573) 447-0292	<u>TSCMissouri@gmail.com</u>

- LEGEND OF LABELS**
- (A) INSTALL 4" PVC CONDUIT FROM EXISTING TRANSFORMER LOCATION TO NEW TRANSFORMER LOCATION. BORE IN PVC CONDUIT WHERE SHOWN. COORDINATE INSTALLATION WITH BOONE ELECTRIC COOPERATIVE.
 - (B) INSTALL CONDUIT FROM NEW TRANSFORMER AND PANEL LOCATION TO CONTROL PANEL LOCATION. SEE RISER DIAGRAM BELOW FOR CONDUIT AND WIRING REQUIREMENTS.
 - (C) INSTALL TRAFFIC RATED QUARTZITE PULL BOXES WHERE SHOWN.

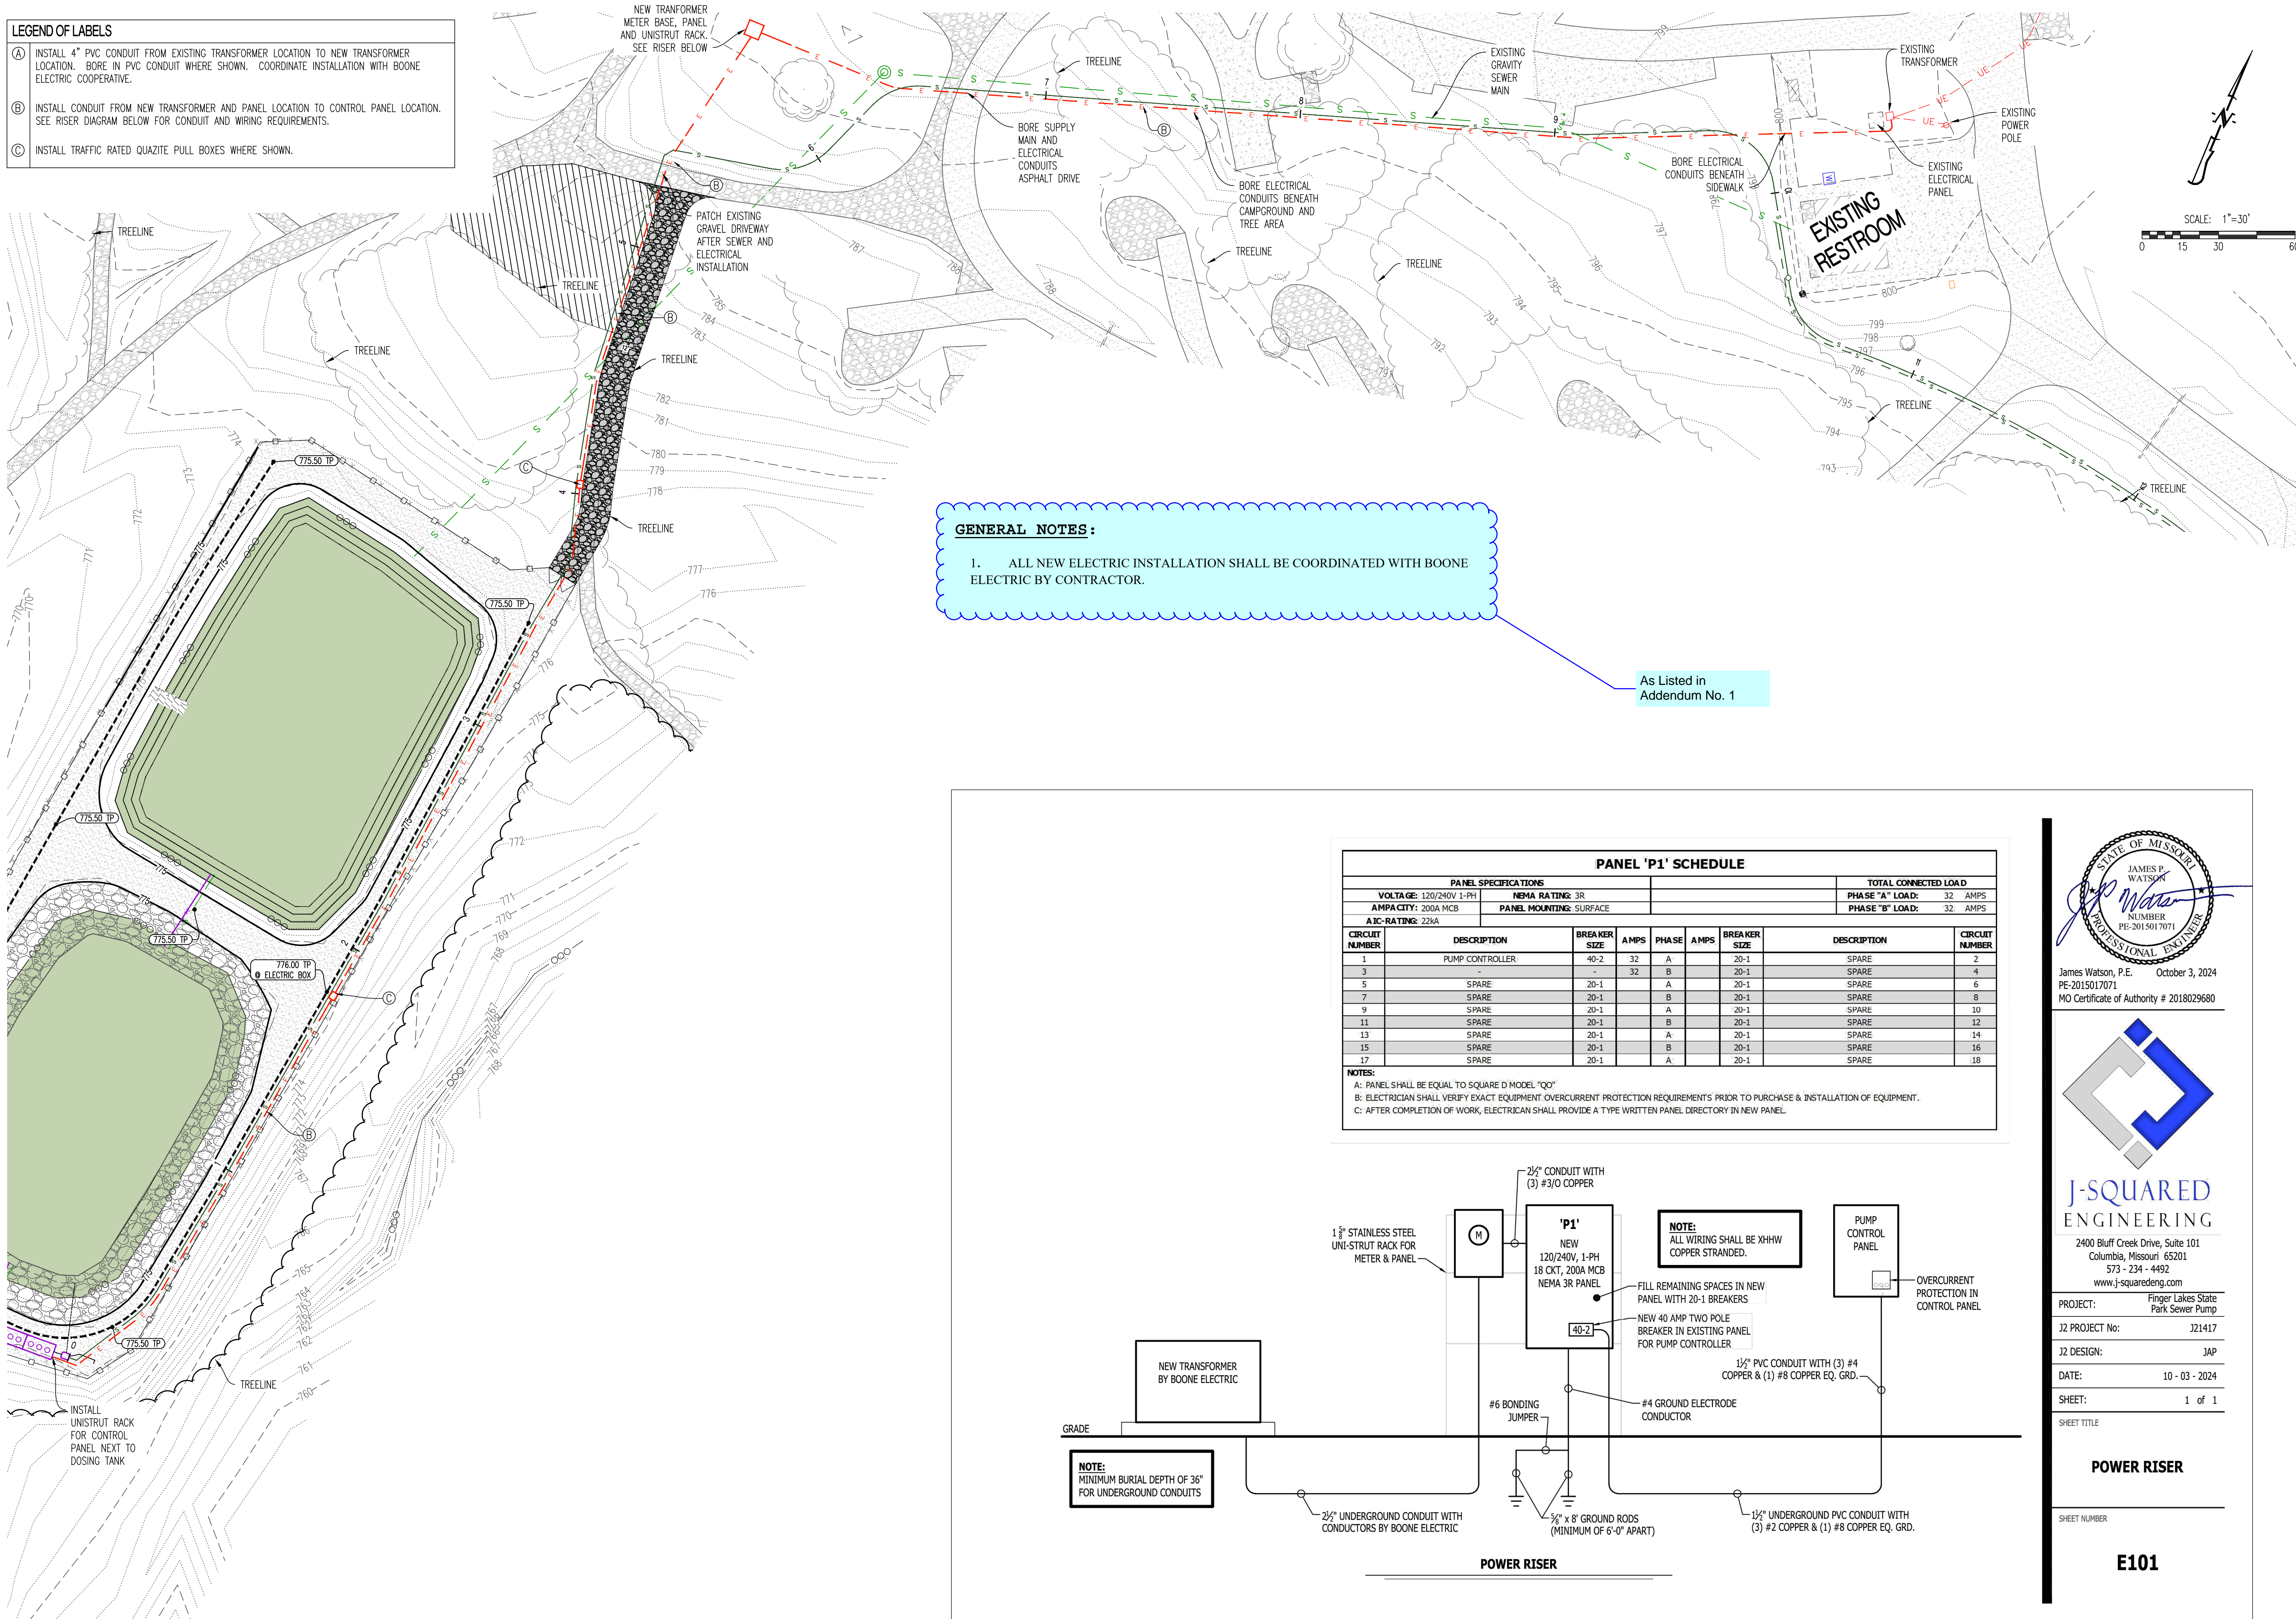

GENERAL NOTES:


- ALL NEW ELECTRIC INSTALLATION SHALL BE COORDINATED WITH BOONE ELECTRIC BY CONTRACTOR.

As Listed in Addendum No. 1


PANEL 'P1' SCHEDULE

PANEL SPECIFICATIONS		NEMA RATING: 3R		TOTAL CONNECTED LOAD			
VOLTAGE: 120/240V 1-PH		PANEL MOUNTING: SURFACE		PHASE 'A' LOAD: 32 AMPS			
AMPACITY: 200A MCB				PHASE 'B' LOAD: 32 AMPS			
AIC-RATING: 22KA							
CIRCUIT NUMBER	DESCRIPTION	BREAKER SIZE	AMPS	PHASE	BREAKER SIZE	DESCRIPTION	CIRCUIT NUMBER
1	PUMP CONTROLLER	40-2	32	A	20-1	SPARE	2
3			32	B	20-1	SPARE	4
5	SPARE	20-1		A	20-1	SPARE	6
7	SPARE	20-1		B	20-1	SPARE	8
9	SPARE	20-1		A	20-1	SPARE	10
11	SPARE	20-1		B	20-1	SPARE	12
13	SPARE	20-1		A	20-1	SPARE	14
15	SPARE	20-1		B	20-1	SPARE	16
17	SPARE	20-1		A	20-1	SPARE	18

NOTES:
 A: PANEL SHALL BE EQUAL TO SQUARE D MODEL "QO"
 B: ELECTRICIAN SHALL VERIFY EXACT EQUIPMENT OVERCURRENT PROTECTION REQUIREMENTS PRIOR TO PURCHASE & INSTALLATION OF EQUIPMENT.
 C: AFTER COMPLETION OF WORK, ELECTRICIAN SHALL PROVIDE A TYPE WRITTEN PANEL DIRECTORY IN NEW PANEL.

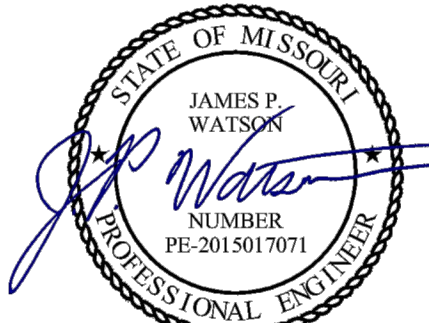

James Watson, P.E. October 3, 2024
 PE-2015017071
 MO Certificate of Authority # 2018029680

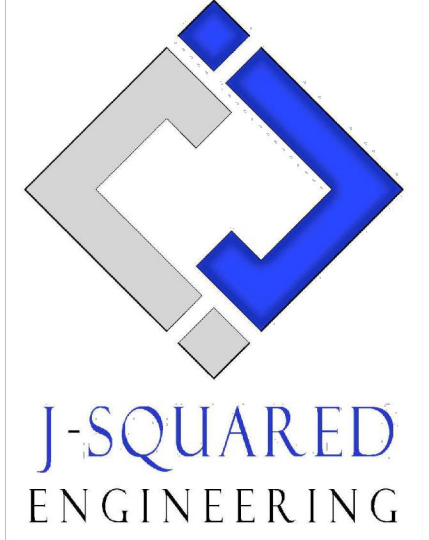

J-SQUARED ENGINEERING
 2400 Bluff Creek Drive, Suite 101
 Columbia, Missouri 65201
 573 - 234 - 4492
 www.j-squaredeng.com
 PROJECT: Finger Lakes State Park Sewer Pump
 J2 PROJECT No: J21417
 J2 DESIGN: JAP
 DATE: 10 - 03 - 2024
 SHEET: 1 of 1
 SHEET TITLE

POWER RISER
E101

STATE OF MISSOURI
 MICHAEL L. PARSON,
 GOVERNOR



JESSE RAY STEPHENS
 MO LICENSE: 201000995

CROCKETT ENGINEERING CONSULTANTS
 1000 W. Nifong Blvd., Bldg. 1
 Columbia, Missouri 65203
 (573) 447-0292
 www.crockettengineering.com
 Crockett Engineering Consultants, LLC
 Missouri Certificate of Authority #200015101

OFFICE OF ADMINISTRATION
 DIVISION OF FACILITIES
 MANAGEMENT,
 DESIGN AND CONSTRUCTION

DEPARTMENT OF
 NATURAL RESOURCES
 MISSOURI STATE PARKS

SEWER RENOVATIONS
 TRACK LAAGOON

FINGER LAKES STATE PARK
 1505 PEABODY ROAD
 COLUMBIA, MO 65202

PROJECT # X2334-01
 SITE # 5108
 ASSET # 7815108005

REVISION: _____
 DATE: _____
 REVISION: _____
 DATE: _____
 REVISION: _____
 DATE: _____
 ISSUE DATE: 10/02/2024

CAD DWG FILE: C-SIT-E-101
 DRAWN BY: JRS
 CHECKED BY: ATG
 DESIGNED BY: JRS

SHEET TITLE:
 ELECTRICAL PLAN

SHEET NUMBER:

E-101