

# PROJECT MANUAL

## *Replace Fluid Cooler, Wheeler Hall & Administration Building*

### *Missouri School For The Deaf*

#### *Fulton, Missouri*

Designed By: State of Missouri, Office of  
Administration, Division of Facilities  
Management, Design and Construction  
301 W High St, Jefferson City

Date Issued: March 24, 2023

Project No.: E2304-01

STATE *of* MISSOURI

---

OFFICE *of* ADMINISTRATION  
Facilities Management, Design & Construction

---

**TABLE OF CONTENTS**

SECTION	TITLE	NUMBER OF PAGES
---------	-------	-----------------

**DIVISION 00 – PROCUREMENT AND CONTRACTING INFORMATION**

**000000 INTRODUCTORY INFORMATION**

000101	Project Manual Cover	1
000110	Table of Contents	2
000115	List of Drawings	1

<b>001116</b>	<b>INVITATION FOR BID (IFB) plus Missouri Buys instructions and special notice</b>	3
---------------	--	---

**002113 INSTRUCTIONS TO BIDDERS (Includes MBE/WBE/SDVE Information)** 8

003144	MBE/WBE/SDVE Directory	1
--------	------------------------	---

**\*\*The following documents may be found on MissouriBUYS at <https://missouribuys.mo.gov/>\*\***

**004000 PROCUREMENT FORMS & SUPPLEMENTS**

004113	Bid Form	*
004336	Proposed Subcontractors Form	*
004337	MBE/WBE/SDVE Compliance Evaluation Form	*
004338	MBE/WBE/SDVE Eligibility Determination Form for Joint Ventures	*
004339	MBE/WBE/SDVE Good Faith Effort (GFE) Determination Forms	*
004340	SDVE Business Form	*
004541	Affidavit of Work Authorization	*
004545	Anti-Discrimination Against Israel Act Certification form	*

**005000 CONTRACTING FORMS AND SUPPLEMENTS**

005213	Construction Contract	3
005414	Affidavit for Affirmative Action	1
006113	Performance and Payment Bond	2
006325	Product Substitution Request	2
006519.16	Final Receipt of Payment and Release Form	1
006519.18	MBE/WBE/SDVE Progress Report	2
006519.21	Affidavit of Compliance with Prevailing Wage Law	1

**007000 CONDITIONS OF THE CONTRACT**

007213	General Conditions	20
007300	Supplementary Conditions	1
007346	Wage Rate	4

**DIVISION 1 - GENERAL REQUIREMENTS**

011000	Summary of Work	2
012100	Allowances	2
012300	Alternates	1
012600	Contract Modification Procedures	2
013100	Coordination	4
013115	Project Management Communications	4
013200	Schedule – Bar Chart	4
013300	Submittals	6
013513.13	Site Security and Health Requirements (DESE)	10
015000	Construction Facilities and Temporary Controls	7
017400	Cleaning	2
017900	Demonstration and Training	4

**TECHNICAL SPECIFICATIONS INDEX:**

230523.12	Ball Valves for HVAC Piping	4
230523.13	Butterfly Valves for HVAC Piping	4
230529	Hangers and Supports for HVAC Piping and Equipment	6
232113	Hydronic Piping	6
236500	Cooling Towers	8
260519	Low-Voltage Electrical Power Conductors and Cables	2

260529	Hangers and Supports for Electrical Systems	4
260533	Raceways and Boxes for Electrical Systems	8
262923	Variable-Frequency Motor Controllers	8

## SECTION 000115 – LIST OF DRAWINGS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

#### 1.2 SUMMARY

- A. This Section provides a comprehensive list of the drawings that comprise the Bid Documents for this project.

### PART 2 - PRODUCTS (NOT APPLICABLE)

### PART 3 - EXECUTION

#### 3.1 LIST OF DRAWINGS

- A. The following list of drawings is a part of the Bid Documents:

	<u>TITLE</u>	<u>SHEET #</u>	<u>DATE</u>	<u>CAD #</u>
1.	Coversheet	G-001	3/23/2023	G-001
2.	Replace Fluid Cooler Mechanical Plan	M-101	3/23/2023	M-101
3.	Replace Fluid Cooler Electrical Plan	E-101	3/23/2023	E-101
4.	Device Schedules & Controls	ME-601	3/23/2023	ME-601

**END OF SECTION 000115**

## SECTION 001116 - INVITATION FOR BID

### 1.0 OWNER:

- A. The State of Missouri  
Office of Administration,  
Division of Facilities Management, Design and Construction  
Jefferson City, Missouri

### 2.0 PROJECT TITLE AND NUMBER:

- A. Replace Fluid Cooler, Wheeler Hall & Administration Building  
Missouri School For The Deaf  
Fulton, Missouri  
**Project No.: E2304-01**

### 3.0 BIDS WILL BE RECEIVED:

- A. Until: 1:30 PM, Thursday, May 11, 2023
- B. **Only electronic bids on MissouriBUYS shall be accepted: <https://missouribuys.mo.gov>. Bidder must be registered to bid.**

### 4.0 DESCRIPTION:

- A. Scope: The Project consists of removing and replacing a 106 ton fluid cooler for the water source heat pump system in Wheeler Hall.
- B. MBE/WBE/SDVE Goals: MBE 0%, WBE 0%, and SDVE 3%. **NOTE: Only MBE/WBE firms certified by the State of Missouri Office of Equal Opportunity as of the date of bid opening, or SDVE(s) meeting the requirements of Section 34.074, RSMo and 1 CSR 30-5.010, can be used to satisfy the MBE/WBE/SDVE participation goals for this project.**
- C. **\*\*NOTE:** Bidders are provided new Good Faith Effort (GFE) forms on MissouriBUYS.

### 5.0 PRE-BID MEETING:

- A. Place/Time: 10:30 AM, Monday, April, 24, 2023, at MO School for the Deaf Maintenance Building Conference Area.
- B. Access to State of Missouri property requires presentation of a photo ID by all persons

### 6.0 HOW TO GET PLANS & SPECIFICATIONS:

- A. View Only Electronic bid sets are available at no cost or paper bid sets for a deposit of \$30.00 from American Document Solutions (ADS). **MAKE CHECKS PAYABLE TO: American Document Solutions.** Mail to: American Document Solutions, 1400 Forum Blvd., Suite 7A, Columbia, Missouri 65203. Phone 573-446-7768, Fax 573-355-5433, <https://www.adsplanroom.net>. NOTE: Prime contractors will be allowed a maximum of two bid sets at the deposit rate shown above. Other requesters will be allowed only one bid set at this rate. Additional bid sets or parts thereof may be obtained by any bidder at the cost of printing and shipping by request to American Document Solutions at the address shown above. **Bidder must secure at least one bid set to become a planholder.**
- B. **Refunds: Return plans and specifications in unmarked condition within 15 working days of bid opening to American Document Solutions, 1400 Forum Blvd., Suite 7A, Columbia, Missouri 65203. Phone 573-446-7768, Fax 573-355-5433. Deposits for plans not returned within 15 working days shall be forfeited.**
- C. Information for upcoming bids, including downloadable plans, specifications, Invitation for Bid, bid tabulation, award, addenda, and access to the ADS planholders list, is available on the Division of Facilities Management, Design and Construction's web site: <https://oa.mo.gov/facilities/bid-opportunities/bid-listing-electronic-plans>.

### 7.0 POINT OF CONTACT:

- A. Designer: State of Missouri, Office of Administration, Division of Facilities Management, Design and Construction, Tracie Siebeneck, 573-751-7831, email: [tracie.siebeneck@oa.mo.gov](mailto:tracie.siebeneck@oa.mo.gov)
- B. Project Manager: Shannon Thompson, 573-526-3166, email: [Shannon.Thompson@oa.mo.gov](mailto:Shannon.Thompson@oa.mo.gov)

### 8.0 GENERAL INFORMATION:

- A. The State reserves the right to reject any and all bids and to waive all informalities in bids. No bid may be withdrawn for a period of 20 working days subsequent to the specified bid opening time. The contractor shall pay not less than the prevailing hourly rate of wages for work of a similar character in the locality in which the work is performed, as determined by the Missouri Department of Labor and Industrial Relations and as set out in the detailed plans and specifications.
- B. Bid results will be available at <https://oa.mo.gov/facilities/bid-opportunities/bid-listing-electronic-plans> after it is verified that at least one bid is awardable and affordable.

## Very Important MissouriBUYS Instructions to Help Submit a Bid Correctly

- A. The bidder shall submit his or her bid and all supporting documentation on MissouriBUYS eProcurement System. No hard copy bids shall be accepted. Go to <https://missouribuys.mo.gov> and register. The bidder must register and complete a profile fully with all required documents submitted prior to submitting a bid.
- B. Once registered, log in.
1. Under "Solicitation" select "View Current Solicitations."
  2. Under "Filter by Agency" select "OA-FMDC-Contracts Chapter 8", then click "Filter Solicitation" button.
  3. Select "Active Solicitations" tab.
  4. To see the Solicitation Summary, click on the Project Number and the summary will open. Click each heading to open detailed information.
- C. Here are simplified instructions for uploading the bid to MissouriBUYS:
1. Find the solicitation by completing Steps 1 through 4 above.
  2. Select the three dots under "Actions." Select "Add New Response."
  3. When the Quote box opens, give the response a title and select "OK."
  4. The detailed solicitation will open. Select "Check All" for the Original Solicitation Documents, open each document, and select "Accept." If this step is not completed, a bid cannot be uploaded. Scroll to the bottom of the page and select "Add Attachments." If you do not see this command, not all documents have been opened and accepted.
  5. The Supplier Attachments box will open. Select "Add Attachment" again.
  6. The Upload Documents box will open. Read the instructions for uploading. Disregard the "Confidential" check box.
  7. Browse and attach up to 5 files at a time. Scroll to bottom of box and select "Upload." The Supplier Attachments box will open. Repeat Steps 5 through 7 if more than 5 files are to be uploaded.
  8. When the Supplier Attachments box opens again and uploading is complete, select "Done." A message should appear that the upload is successful. If it does not, go to the Bidder Response tab and select "Submit."
  9. The detailed solicitation will open. At the bottom select "Close."
- D. Any time a bidder wants to modify the bid, he or she will have to submit a new one. FMDC will open the last response the bidder submits. The bidder may revise and submit the bid up to the close of the solicitation (bid date and time). Be sure to allow for uploading time so that the bid is successfully uploaded prior to the 1:30 PM deadline; we can only accept the bid if it is uploaded before the deadline.
- E. If you want to verify that you are uploading documents correctly, please contact Paul Girouard: 573-751-4797, [paul.girouard@oa.mo.gov](mailto:paul.girouard@oa.mo.gov) ; April Howser: 573-751-0053, [April.Howser@oa.mo.gov](mailto:April.Howser@oa.mo.gov) ; or Mandy Roberson: 573-522-0074, [Mandy.Roberson@oa.mo.gov](mailto:Mandy.Roberson@oa.mo.gov).
- F. If you are experiencing login issues, please contact Web Procure Support (Proactis) at 866-889-8533 anytime from 7:00 AM to 7:00 PM Central Time, Monday through Friday. If you try using a userid or password several times that is incorrect, the system will lock you out. Web Procure Support is the only option to unlock you! If you forget your userid or password, Web Procure Support will provide a temporary userid or password. Also, if it has been a while since your last successful login and you receive an "inactive" message, contact Web Procure (Proactis). If you are having a registration issue, you may contact Cathy Holliday at 573-751-3491 or by email: [cathy.holliday@oa.mo.gov](mailto:cathy.holliday@oa.mo.gov).

## IMPORTANT REMINDER REGARDING REQUIREMENT FOR OEO CERTIFICATION

A. SECTION 002113 – INSTRUCTIONS TO  
BIDDERS: Article 15.0, Section D1:

**As of July 1, 2020**, all MBE, WBE, and MBE/WBE contractors, subcontractors, and suppliers must be certified by the State of Missouri, Office of Equal Opportunity. No certifications from other Missouri certifying agencies will be accepted.

## **SECTION 002113 – INSTRUCTIONS TO BIDDERS**

### **1.0 - SPECIAL NOTICE TO BIDDERS**

- A. If awarded a contract, the Bidder's employees, and the employees of all subcontractors, who perform the work on the project must adhere to requirements in Section 013513 – Site Security and Health Requirements as applicable per Agency.
- B. The Bidder's prices shall include all city, state, and federal sales, excise, and similar taxes that may lawfully be assessed in connection with the performance of work, and the purchased of materials to be incorporated in the work. THIS PROJECT IS NOT TAX EXEMPT.

### **2.0 - BID DOCUMENTS**

- A. The number of sets obtainable by any one (1) party may be limited in accordance with available supply.
- B. For the convenience of contractors, sub-contractors and suppliers, copies of construction documents are on file at the office of the Director, Division of Facilities Management, Design and Construction and on the Division's web site - <https://oa.mo.gov/facilities/bid-opportunities/bid-listing-electronic-plans>.

### **3.0 - BIDDERS' OBLIGATIONS**

- A. Bidders must carefully examine the entire site of the work and shall make all reasonable and necessary investigations to inform themselves thoroughly as to the facilities available as well as to all the difficulties involved in the completion of all work in accordance with the specifications and the plans. Bidders are also required to examine all maps, plans and data mentioned in the specifications. No plea of ignorance concerning observable existing conditions or difficulties that may be encountered in the execution of the work under this contract will be accepted as an excuse for any failure or omission on the part of the contractor to fulfill in every detail all of the requirements of the contract, nor accepted as a basis for any claims for extra compensation.
- B. Under no circumstances will contractors give their plans and specifications to another contractor. Any bid received from a contractor whose name does not appear on the list of plan holders may be subject to rejection.

### **4.0 - INTERPRETATIONS**

- A. No bidder shall be entitled to rely on oral interpretations as to the meaning of the plans and specifications or the acceptability of alternate products, materials, form or type of construction. Every request for interpretation shall be made in writing and submitted with all supporting documents not less than five (5) working days before opening of bids. Every interpretation made to a bidder will be in the form of an addendum and will be sent as promptly as is practicable to all persons to whom plans and specifications have been issued. All such addenda shall become part of the contract documents.
- B. Approval for an "acceptable substitution" issued in the form of an addendum as per Paragraph 4A above, and as per Article 3.1 of the General Conditions; ACCEPTABLE SUBSTITUTIONS shall constitute approval for use in the project of the product.
- C. An "acceptable substitution" requested after the award of bid shall be approved if proven to the satisfaction of the Owner and the Designer as per Article 3.1, that the product is acceptable in design, strength, durability, usefulness, and convenience for the purpose intended. Approval of the substitution after award is at the sole discretion of the Owner.
- D. A request for "Acceptable Substitutions" shall be made on the Section 006325 Substitution Request Form. The request shall be sent directly to the project Designer. A copy of said request should also be mailed to the Owner, Division of Facilities Management, Design and Construction, Post Office Box 809, Jefferson City, Missouri 65102.



## **5.0 - BIDS AND BIDDING PROCEDURE**

- A. Bidders shall submit all submission forms and accompanying documents listed in SECTION 004113 – BID FORM, Article 5.0, ATTACHMENTS TO BID by the stated time or their bid will be rejected for being non-responsive.

Depending on the specific project requirements, **the following is a GENERIC list** of all possible bid forms that may be due with bid submittals and times when they may be due. Please check for specific project requirements on the proposal form (Section 004113). ***Not all of the following bid forms may be required to be submitted.***

### **Bid Submittal – due before stated date and time of bid opening (see IFB):**

004113	Bid Form (all pages are always required)
004322	Unit Prices Form
004336	Proposed Subcontractors Form
004337	MBE/WBE/SDVE Compliance Evaluation Form
004338	MBE/WBE/SDVE Eligibility Determination for Joint Ventures
004339	MBE/WBE/SDVE GFE Determination
004340	SDVE Business Form
004541	Affidavit of Work Authorization
004545	Anti-Discrimination Against Israel Act Certification form

- B. All bids shall be submitted without additional terms and conditions, modification or reservation on the bid forms with each space properly filled. Bids not on these forms will be rejected.
- C. All bids shall be accompanied by a bid bond executed by the bidder and a duly authorized surety company, certified check, cashier's check or bank draft made payable to the Division of Facilities Management, Design and Construction, State of Missouri, in the amount indicated on the bid form, Section 004113. Failure of the contractor to submit the full amount required shall be sufficient cause to reject his bid. The bidder agrees that the proceeds of the check, draft or bond shall become the property of the State of Missouri, if for any reason the bidder withdraws his bid after closing, or if on notification of award refuses or is unable to execute tendered contract, provide an acceptable performance and payment bond, provide evidence of required insurance coverage and/or provide required copies of affirmative action plans within ten (10) working days after such tender.
- D. The check or draft submitted by the successful bidder will be returned after the receipt of an acceptable performance and payment bond and execution of the formal contract. Checks or drafts of all other bidders will be returned within a reasonable time after it is determined that the bid represented by same will receive no further consideration by the State of Missouri. Bid bonds will only be returned upon request.

## **6.0 - SIGNING OF BIDS**

- A. A bid from an individual shall be signed as noted on the Bid Form.
- B. A bid from a partnership or joint venture shall require only one signature of a partner, an officer of the joint venture authorized to bind the venture or an attorney-in-fact. If the bid is signed by an officer of a joint venture or an attorney-in-fact, a document evidencing the individual's authority to execute contracts should be included with the bid form.
- C. A bid from a limited liability company (LLC) shall be signed by a manager or a managing member of the LLC.
- D. A bid from a corporation shall have the correct corporate name thereon and the signature of an authorized officer of the corporation manually written. Title of office held by the person signing for the corporation shall appear, along with typed name of said individual. Corporate license number shall be provided and, if a corporation organized in a state other than Missouri, a Certificate of Authority to do business in the State of Missouri shall be attached. In addition, for corporate proposals, the President or Vice-President should sign as the bidder. If the signator is other than the corporate president or vice president, the bidder must provide satisfactory evidence that the signator has the legal authority to bind the corporation.

- E. A bid should contain the full and correct legal name of the Bidder. If the Bidder is an entity registered with the Missouri Secretary of State, the Bidder's name on the bid form should appear as shown in the Secretary of State's records.
- F. The Bidder should include its corporate license number on the Bid Form and, if the corporation is organized in a state other than Missouri, a Certificate of Authority to do business in the State of Missouri shall be attached to the bid form.

#### **7.0 - RECEIVING BID SUBMITTALS**

- A. It is the bidder's sole responsibility to assure receipt by Owner of bid submittals by the date and time specified in the Invitation for Bid. Bids received after the date and time specified shall not be considered by the Owner.
- B. Bids must be submitted through the MissouriBUYS statewide eProcurement system (<https://www.missouribuys.mo.gov/>) in accordance with the instructions for that system. The Owner shall only accept bids submitted through MissouriBUYS. Bids received by the Owner through any other means, including hard copies, shall not be considered and will be discarded by the Owner unopened.
- C. To respond to an Invitation for Bid, the Bidder must first register with MissouriBUYS by going through the MissouriBUYS Home Page (<https://www.missouribuys.mo.gov/>), clicking the "Register" button at the top of the page, and completing the Vendor Registration. Once registered, the Bidder accesses its account by clicking the "Login" button at the top of the MissouriBUYS Home Page. Enter your USERID and PASSWORD, which the Bidder will select. Under Solicitations, select "View Current Solicitations." A new screen will open. Under "Filter by Agency" select "OA-FMDC-Contracts Chapter 8." Under "Filter by Opp. No." type in the State Project Number. Select "Submit." Above the dark blue bar, select "Other Active Opportunities." To see the Solicitation Summary, single click the Opp. No. (Project Number) and the summary will open. Single quick click each blue bar to open detailed information. The Bidder must read and accept the Original Solicitation Documents and complete all identified requirements. The Bidder should download and save all of the Original Solicitation Documents on its computer so that the Bidder can prepare its response to these documents. The Bidder should upload its completed response to the downloaded documents as an attachment to the electronic solicitation response.
- D. Step-by-step instructions for how a registered vendor responds to a solicitation electronically are provided in Section 001116 – Invitation For Bid.
- E. The Bidder shall submit its bid on the forms provided by the Owner on MissouriBUYS with each space fully and properly completed, including all amounts required for alternate bids, unit prices, cost accounting data, etc. The Owner may reject bids that are not on the Owner's forms or that do not contain all requested information.
- F. No Contractor shall stipulate in his bid any conditions not contained in the specifications or standard bid form contained in the contract documents. To do so may subject the Contractor's bid to rejection.
- G. The completed forms shall be without interlineations, alterations or erasures.

#### **8.0 - MODIFICATION AND WITHDRAWAL OF BIDS**

- A. Bidder may withdraw his bid at any time prior to scheduled closing time for receipt of bids, but no bidder may withdraw his bid for a period of twenty (20) working days after the scheduled closing time for receipt of bids.
- B. The Bidder shall modify his or her original bid by submitting a revised bid on MissouriBUYS.

#### **9.0 - AWARD OF CONTRACT**

- A. The Owner reserves the right to reject any and/or all bids and further to waive all informalities in bidding when deemed in the best interest of the State of Missouri.
- B. The Owner reserves the right to let other contracts in connection with the work, including but not by way of limitation, contracts for the furnishing and installation of furniture, equipment, machines, appliances and other apparatus.

- C. The Owner shall award a contract to the lowest, responsive, responsible Bidder in accordance with Section 8.250, RSMo. No contract will be awarded to any Bidder who has had a contract with the Owner terminated within the preceding twelve months for material breach of contract or who has been suspended or debarred by the Owner.
- D. Award of alternates, if any, will be made in numerical order unless all bids received are such that the order of acceptance of alternates does not affect the determination of the lowest, responsive, responsible bidder.
- E. No bid shall be considered binding upon the Owner until the written contract has been properly executed, a satisfactory bond has been furnished, evidence of required insurance coverage, submittal of executed Section 004541, Affidavit of Work Authorization form, documentation evidencing enrollment and participation in a federal work authorization program has been received and an affirmative action plan submitted. Failure to execute and return the contract and associated documents within the prescribed period of time shall be treated, at the option of the Owner, as a breach of bidder's obligation and the Owner shall be under no further obligation to bidder.
- F. If the successful bidder is doing business in the State of Missouri under a fictitious name, he shall furnish to Owner, attached to the Bid Form, a properly certified copy of the certificate of Registration of Fictitious Name from the State of Missouri, and such certificate shall remain on file with the Owner.
- G. Any successful bidder which is a corporation organized in a state other than Missouri shall furnish to the Owner, attached to the Bid Form, a properly certified copy of its current Certificate of Authority to do business in the State of Missouri, such certificate to remain on file with the Owner. No contract will be awarded by the Owner unless such certificate is furnished by the bidder.
- H. Any successful bidder which is a corporation organized in the State of Missouri shall furnish at its own cost to the Owner, if requested, a Certificate of Good Standing issued by the Secretary of State, such certificate to remain on file with the Owner.
- I. Transient employers subject to Sections 285.230 and 285.234, RSMo, (out-of-state employers who temporarily transact any business in the State of Missouri) may be required to file a bond with the Missouri Department of Revenue. No contract will be awarded by the Owner unless the successful bidder certifies that he has complied with all applicable provisions of Section 285.230-234.
- J. Sections 285.525 and 285.530, RSMo, require business entities to enroll and participate in a federal work authorization program in order to be eligible to receive award of any state contract in excess of \$5,000. Bidders should submit with their bid an Affidavit of Work Authorization (Section 004541) along with appropriate documentation evidencing such enrollment and participation. Section-004541, Affidavit of Work Authorization is located on the MissouriBUYS solicitation for this project. Bidders must also submit an E-Verify Memorandum before the Owner may award a contract to the Bidder. Information regarding an E-Verify is located at <https://www.uscis.gov/e-verify/>. The contractor shall be responsible for ensuring that all subcontractors and suppliers associated with this contract enroll in E-Verify.

#### **10.0 - CONTRACT SECURITY**

- A. The successful bidder shall furnish a performance/payment bond as set forth in General Conditions Article 6.1 on a condition prior to the State executing the contract and issuing a notice to proceed.

#### **11.0 - LIST OF SUBCONTRACTORS**

- A. If required by "Section 004113 – Bid Form," each bidder must submit as part of their bid a list of subcontractors to be used in performing the work (Section 004336). The list must specify the name of the single designated subcontractor, for each category of work listed in "Section 004336 - Proposed Subcontractors Form." If work within a category will be performed by more than one subcontractor, the bidder must provide the name of each subcontractor and specify the exact portion of the work to be done by each. Failure to list the Bidder's firm, or a subcontractor for each category of work identified on the Bid Form or the listing of more than one subcontractor for any category without designating the portion of work to be performed by each shall be cause for rejection of the bid. If the bidder intends to perform any of the designated subcontract work with the use of his own employees, the bidder shall make that fact clear, by listing his own firm for the subject category. **If any category of work is left vacant, the bid shall be rejected.**

## **12.0 - WORKING DAYS**

- A. Contract duration time is stated in working days and will use the following definition in determining the actual calendar date for contract completion:
  - 1. Working days are defined as all calendar days except Saturdays, Sundays and the following State of Missouri observed holidays: New Year's Day, Martin Luther King, Jr. Day, Lincoln Day, Washington's Birthday, Truman Day, Memorial Day, Juneteenth, Independence Day, Labor Day, Columbus Day, Veterans Day, Thanksgiving Day and Christmas Day.

## **13.0 - AMERICAN AND MISSOURI - MADE PRODUCTS AND FIRMS**

- A. By signing the bid form and submitting a bid on this project, the Bidder certifies that it will use American and Missouri products as set forth in Article 1.7 of the General Conditions. Bidders are advised to review those requirements carefully prior to bidding.
- B. A preference shall be given to Missouri firms, corporations or individuals, or firms, corporations or individuals that maintain Missouri offices or places of business, when the quality of performance promised is equal or better and the price quoted is the same or less.
- C. Pursuant to Section 34.076, RSMo, a contractor or Bidder domiciled outside the boundaries of the State of Missouri shall be required, in order to be successful, to submit a bid the same percent less than the lowest bid submitted by a responsible contractor or Bidder domiciled in Missouri as would be required for such a Missouri domiciled contractor or Bidder to succeed over the bidding contractor or Bidder domiciled outside Missouri on a like contract or bid being let in the person's domiciliary state and, further, the contractor or Bidder domiciled outside the boundaries of Missouri shall be required to submit an audited financial statement as would be required of a Missouri domiciled contractor or Bidder on a like contract or bid being let in the domiciliary state of that contractor or Bidder.

## **14.0 – ANTI-DISCRIMINATION AGAINST ISRAEL ACT CERTIFICATION:**

- A. Pursuant to section 34.600, RSMo, if the Bidder meets the section 34.600, RSMo, definition of a “company” and the Bidder has ten or more employees, the Bidder must certify in writing that the Bidder is not currently engaged in a boycott of goods or services from the State of Israel as defined in section 34.600, RSMo, and shall not engage in a boycott of goods or services from the State of Israel, if awarded a contract, for the duration of the contract. The Bidder is requested to complete and submit the applicable portion of Section 004545 - Anti-Discrimination Against Israel Act Certification with their Bid Form. The applicable portion of the exhibit must be submitted prior to execution of a contract by the Owner and issuance of Notice to Proceed. If the exhibit is not submitted, the Owner shall rescind its Intent to Award and move to the next lowest, responsive, responsible bidder.

## **15.0 - MBE/WBE/SDVE INSTRUCTIONS**

- A. Definitions:
  - 1. “**MBE**” means a Minority Business Enterprise.
  - 2. “**MINORITY**” has the same meaning as set forth in 1 C.S.R. 10-17.010.
  - 3. “**MINORITY BUSINESS ENTERPRISE**” has the same meaning as set forth in section 37.020, RSMo.
  - 4. “**WBE**” means a Women’s Business Enterprise.
  - 5. “**WOMEN’S BUSINESS ENTERPRISE**” has the same meaning as set forth in section 37.020, RSMo.
  - 6. “**SDVE**” means a Service-Disabled Veterans Enterprise.
  - 7. “**SERVICE-DISABLED VETERAN**” has the same meaning as set forth in section 34.074, RSMo.
  - 8. “**SERVICE-DISABLED VETERAN ENTERPRISE**” has the same meaning as “Service-Disabled Veteran Business” set forth in section 34.074, RSMo.

B. MBE/WBE/SDVE General Requirements:

1. For all bids greater than \$100,000, the Bidder shall obtain MBE, WBE and SDVE participation in an amount equal to or greater than the percentage goals set forth in the Invitation for Bid and the Bid Form, unless the Bidder is granted a Good Faith Effort waiver by the Director of the Division, as set forth below. If the Bidder does not meet the MBE, WBE and SDVE goals, or make a good faith effort to do so, the Bidder shall be non-responsive, and its bid shall be rejected.
2. The Bidder should submit with its bid all of the information requested in the MBE/WBE/SDVE Compliance Evaluation Form for every MBE, WBE, or SDVE subcontractor or material supplier the Bidder intends to use for the contract work. The Bidder is required to submit all appropriate MBE/WBE/SDVE documentation before the stated time and date set forth in the Invitation for Bid. If the Bidder fails to provide such information by the specified date and time, the Owner shall reject the bid.
3. The Director reserves the right to request additional information from a Bidder to clarify the Bidder's proposed MBE, WBE, and/or SDVE participation. The Bidder shall submit the clarifying information requested by the Owner within two (2) Working Days of receiving the request for clarification.
4. Pursuant to section 34.074, RSMo, a Bidder that is a SDVE doing business as Missouri firm, corporation, or individual, or that maintains a Missouri office or place of business, shall receive a three-point bonus preference in the contract award evaluation process. The bonus preference will be calculated and applied by reducing the bid amount of the eligible SDVE by three percent of the apparent low responsive bidder's bid. Based on this calculation, if the eligible SDVE's evaluation is less than the apparent low responsive bidder's bid, the eligible SDVE's bid becomes the apparent low responsive bid. This reduction is for evaluation purposes only, and will have no impact on the actual amount(s) of the bid or the amount(s) of any contract awarded. In order to be eligible for the SDVE preference, the Bidder must complete and submit with its bid the Missouri Service Disabled Veteran Business Form, and any information required by the form. The form is available on the MissouriBUYS solicitation for this project.

C. Computation of MBE/WBE/SDVE Goal Participation:

1. A Bidder who is a MBE, WBE, or SDVE may count 100% of the contract towards the MBE, WBE or SDVE goal, less any amounts awarded to another MBE, WBE or SDVE. (NOTE: A MBE firm that bids as general contractor must obtain WBE and SDVE participation; a WBE firm that bids as a general contractor must obtain MBE and SDVE participation; and a SDVE firm that bids as general contractor must obtain MBE and WBE participation.) In order for the remaining contract amount to be counted towards the MBE, WBE or SDVE goal, the Bidder must complete the MBE/WBE/SDVE Compliance Evaluation Form (Section 004337) identifying itself as an MBE, WBE or SDVE.
2. The total dollar value of the work granted to a certified MBE, WBE or SDVE by the Bidder shall be counted towards the applicable goal.
3. Expenditures for materials and supplies obtained from a certified MBE, WBE, or SDVE supplier or manufacturer may be counted towards the MBE, WBE and SDVE goals, if the MBE, WBE, or SDVE assumes the actual and contractual responsibility for the provision of the materials and supplies.
4. The total dollar value of the work granted to a second or subsequent tier subcontractor or a supplier may be counted towards a Bidder's MBE, WBE and SDVE goals, if the MBE, WBE, or SDVE properly assumes the actual and contractual responsibility for the work.
5. The total dollar value of work granted to a certified joint venture equal to the percentage of the ownership and control of the MBE, WBE, or SDVE partner in the joint venture may be counted towards the MBE/WBE/SDVE goals.
6. Only expenditures to a MBE, WBE, or SDVE that performs a commercially useful function in the work may be counted towards the MBE, WBE and SDVE goals. A MBE, WBE, or SDVE performs a commercially useful function when it is responsible for executing a distinct element of the work and carrying out its responsibilities by actually performing, managing and supervising the work or providing supplies or manufactured materials.

D. Certification of MBE/WBE/SDVE Subcontractors:

1. In order to be counted towards the goals, an MBE or WBE must be certified by the State of Missouri Office of Equal Opportunity and an SDVE must be certified by the State of Missouri, Office of Administration, Division of Purchasing and Material Management or by the Department of Veterans Affairs.
2. The Bidder may determine the certification status of a proposed MBE or WBE subcontractor or supplier by referring to the Office of Equal Opportunity (OEO)'s online MBE/WBE directory (<https://apps1.mo.gov/MWBCertifiedFirms/>). The Bidder may determine the eligibility of a SDVE subcontractor or supplier by referring to the Division of Purchasing and Materials Management's online SDVE directory (<https://oa.mo.gov/sites/default/files/sdvelisting.pdf>) or the Department of Veterans Affairs' directory (<https://vetbiz.va.gov/basic-search/>).
3. Additional information, clarifications, etc., regarding the listings in the directories may be obtained by calling the Division at (573)751-3339 and asking to speak to the Contract Specialist of record as shown in the Supplementary Conditions (Section 007300).

E. Waiver of MBE/WBE/SDVE Participation:

1. If a Bidder has made a good faith effort to secure the required MBE, WBE and/or SDVE participation and has failed, the Bidder shall submit with its bid the information requested in MBE/WBE/SDVE Good Faith Effort (GFE) Determination form. The GFE forms are located on the MissouriBUYS solicitation for this project. The Director will determine if the Bidder made a good faith effort to meet the applicable goals. If the Director determines that the Bidder did not make a good faith effort, the bid shall be rejected as being nonresponsive to the bid requirements. Bidders who demonstrate that they have made a good faith effort to include MBE, WBE, and/or SDVE participation will be determined to be responsive to the applicable participation goals, regardless of the percent of actual participation obtained, if the bid is otherwise acceptable.
2. In determining whether a Bidder has made a good faith effort to obtain MBE, WBE and/or SDVE participation, the Director may evaluate the factors set forth in 1 CSR 30-5.010(6)(C) and the following:
  - a. The amount of actual participation obtained;
  - b. How and when the Bidder contacted potential MBE, WBE, and SDVE subcontractors and suppliers;
  - c. The documentation provided by the Bidder to support its contacts, including whether the Bidder provided the names, addresses, phone numbers, and dates of contact for MBE/WBE/SDVE firms contacted for specific categories of work;
  - d. If project information, including plans and specifications, were provided to MBE/WBE/SDVE subcontractors;
  - e. Whether the Bidder made any attempts to follow-up with MBE, WBE or SDVE firms prior to bid;
  - f. Amount of bids received from any of the subcontractors and/or suppliers that the Bidder contacted;
  - g. The Bidder's stated reasons for rejecting any bids;
3. If no bidder has obtained any participation in a particular category (MBE/WBE/SDVE) or made a good faith effort to do so, the Director may waive that goal rather than rebid.

F. Contractor MBE/WBE/SDVE Obligations

1. If awarded a contract, the Bidder will be contractually required to subcontract with or obtain materials from the MBE, WBE, and SDVE firms listed in its bid, in amounts equal to or greater than the dollar amount bid, unless the amount is modified in writing by the Owner.
2. If the Contractor fails to meet or maintain the participation requirements contained in the Contractor's bid, the Contractor must satisfactorily explain to the Director why it cannot comply with the requirement and why failing meeting the requirement was beyond the Contractor's control. If the Director finds the Contractor's explanation unsatisfactory, the Director may take any appropriate action including, but not limited to:
  - a. Declaring the Contractor ineligible to participate in any contracts with the Division for up to twelve (12) months (suspension); and/or
  - b. Declaring the Contractor be non-responsive to the Invitation for Bid, or in breach of contract and rejecting the bid or terminating the contract.
3. If the Contractor replaces an MBE, WBE, or SDVE during the course of this contract, the Contractor shall replace it with another MBE, WBE, or SDVE or make a good faith effort to do so. All MBE, WBE and SDVE substitutions must be approved by the Director.
4. The Contractor shall provide the Owner with regular reports on its progress in meeting its MBE/WBE/SDVE obligations. At a minimum, the Contractor shall report the dollar-value of work completed by each MBE, WBE, or SDVE during the preceding month and the cumulative total of work completed by each MBE, WBE or SDVE to date with each monthly application for payment. The Contractor shall also make a final report, which shall include the total dollar-value of work completed by each MBE, WBE, and SDVE during the entire contract.

**STATE OF MISSOURI**  
**DIVISION OF FACILITIES MANAGEMENT,**  
**DESIGN AND CONSTRUCTION**  
***MBE/WBE/SDVE DIRECTORIES***

---

---

The MBE/WBE Directory for goods and services is maintained by the Office of Equal Opportunity (OEO) and is located at the following web address:

<https://apps1.mo.gov/MWBCertifiedFirms/>

The SERVICE DISABLED VETERAN ENTERPRISE (SDVE) Directories may be accessed at the following web addresses:

<https://purch.oa.mo.gov/media/pdf/listing-certified-missouri-service-disabled-veteran-business-enterprises-sdves>

<https://veterans.certify.sba.gov/#search>





# State of Missouri Construction Contract

**THIS AGREEMENT** is made (DATE) by and between:

## *Contractor Name and Address*

hereinafter called the "Contractor,"

and the **State of Missouri**, hereinafter called the "**Owner**", represented by the Office of Administration, Division of Facilities Management, Design and Construction.

WITNESSETH, that the Contractor and the Owner, for the consideration stated herein agree as follows:

## **ARTICLE 1. STATEMENT OF WORK**

The Contractor shall furnish all labor and materials and perform all work required for furnishing and installing all labor, materials, equipment and transportation and everything necessarily inferred from the general nature and tendency of the plans and specifications for the proper execution of the work for:

**Project Name:**                    **Replace Fluid Cooler, Wheeler Hall & Administration Building  
Missouri School For The Deaf  
Fulton, Missouri**

**Project Number:**                **E2304-01**

in strict accordance with the Contract Documents as enumerated in Article 7, all of which are made a part hereof.

## **ARTICLE 2. TIME OF COMPLETION**

The contract performance time is **180 working days** from the transmittal date of this agreement. The contract completion date is **MONTH, DAY, YEAR**. This time includes ten (10) working days for the Contractor to receive, sign and return the contract form along with required bonding and insurance certificates. Failure of the Contractor to provide correct bonding and insurance within the ten (10) working days shall not be grounds for a time extension. Receipt of proper bonding and insurance is a condition precedent to the formation of the contract and if not timely received, may result in forfeiture of the Contractor's bid security. Work may not commence until the Owner issues a written Notice to Proceed and must commence within seven (7) working days thereafter.

## **ARTICLE 3. LIQUIDATED DAMAGES**

Whenever time is mentioned in this contract, time shall be and is of the essence of this contract. The Owner would suffer a loss should the Contractor fail to have the work embraced in this contract fully completed on or before the time above specified. **THEREFORE**, the parties hereto realize in order to adjust satisfactorily the damages on account of such failure that it might be impossible to compute accurately or estimate the amount of such loss or damages which the Owner would sustain by reason of failure to complete fully said work within the time required by this contract. The Contractor hereby covenants and agrees to pay the Owner, as and for **liquidated damages, the sum of \$500** per day for each and every day, Sunday and legal holidays excepted, during which the work remains incomplete and unfinished. Any sum which may be due the Owner for such damages shall be deducted and retained by the Owner from any balance which may be due the Contractor when said work shall have been finished and accepted. But such provisions shall not release the Bond of the Contractor from liability according to its terms. In case of failure to complete, the Owner will be under no obligation to show or prove any actual or specific loss or damage.

**ARTICLE 4. CONTRACT SUM**

The Owner shall pay the Contractor for the prompt, faithful and efficient performance of the conditions and undertakings of this contract, subject to additions, and deductions as provided herein, in current funds the sum of:

Base Bid: \$  
Alternate No. 1: \$

**TOTAL CONTRACT AMOUNT: (\$CONTRACT AMOUNT)**

**ARTICLE 5. PREVAILING WAGE RATE**

**MISSOURI PREVAILING WAGE LAW (Sections 290.210 to 290.340, RSMo):** The Contractor shall pay not less than the specified hourly rate of wages, as set out in the wage order attached to and made part of the specifications for work under this contract, to all workers performing work under the contract, in accordance with sections 290.210 to 290.340, RSMo. The Contractor shall forfeit a penalty to the Owner of one hundred dollars per day (or portion of a day) for each worker that is paid less than the specified rates for any work done under the contract by the Contractor or by any subcontractor, in accordance with section 290.250, RSMo.

**DAVIS-BACON ACT:** If this Project is financed in whole or in part from Federal funds (as indicated in the Instructions to Bidders or other bid or contract documents for this Project), then this contract shall be subject to all applicable federal labor statutes, rules and regulations, including provisions of the Davis-Bacon Act, 40 U.S.C. §3141 et seq., and the “Federal Labor Standards Provisions,” as further set forth in Section 007333 – Supplementary General Conditions for Federally Funded/Assisted Construction Projects, which is incorporated into the contract by reference. Where the Missouri Prevailing Wage Law and the Davis-Bacon Act require payment of different wages for work performed under this contract, the Contractor and all Subcontractors shall pay the greater of the wages required under either law, on a classification by classification basis.

**ARTICLE 6. MINORITY/WOMEN/SERVICE DISABLED VETERAN BUSINESS ENTERPRISE PARTICIPATION**

The Contractor has been granted a waiver of the 10% MBE and 10% WBE and 3% SDVE participation goals. The Contractor agrees to secure the MBE/WBE/SDVE participation amounts for this project as follows: (OR)

The Contractor has met the MBE/WBE/SDVE participation goals and agrees to secure the MBE/WBE/SDVE participation amounts for this project as follows:

MBE/WBE/SDVE Firm: Subcontract Amt:\$  
MBE/WBE/SDVE Firm: Subcontract Amt:\$  
MBE/WBE/SDVE Firm: Subcontract Amt:\$  
  
Total \$

MBE/WBE/SDVE assignments identified above shall not be changed without a contract change signed by the Owner.

The Director of the Division of Facilities Management, Design and Construction or his Designee shall be the final authority to resolve disputes and disagreements between the Contractor and the MBE/WBE/SDVE firms listed above when such disputes impact the subcontract amounts shown above.

**ARTICLE 7. CONTRACT DOCUMENTS**

The following documents are hereby incorporated into this contract by reference (all division/section numbers and titles are as utilized in the Project Manual published by the Owner for this Project):

- 1. Division 0 – Procurement and Contracting Information, including, but not limited to:
  - a. Invitation for Bid (Section 001116)
  - b. Instructions to Bidders (Section 002113)
  - c. Supplementary Instructions to Bidders (if applicable) (Section 002213)
  - d. The following documents as completed and executed by the Contractor and accepted by the Owner, if applicable:
    - i. Bid Form (Section 004113)
    - ii. Unit Prices (Section 004322)

- iii. Proposed Contractors Form (Section 004336)
- iv. MBE, WBE, SDVE Compliance Evaluation Form(s) (Section 004337)
- v. MBE, WBE, SDVE Eligibility Determination Form for Joint Ventures (Section 004338)
- vi. MBE, WBE, SDVE Good Faith Effort (GFE) Determination Form (Section 004339)
- vii. Missouri Service Disabled Veteran Business Form (Section 004340)
- viii. Affidavit of Work Authorization (Section 004541)
- ix. Affidavit for Affirmative Action (Section 005414)
- e. Performance and Payment Bond, completed and executed by the Contractor and surety (Section 006113)
- f. General Conditions (Section 007213)
- g. Supplementary Conditions (Section 007300)
- h. Supplementary General Conditions for Federally Funded/Assisted Construction Projects (Section 007333)
- i. Wage Rate(s) (Section 007346)
- 2. Division 1 – General Requirements
- 3. All Drawings identified in the Project Manual
- 4. All Technical Specifications included in the Project Manual
- 5. Addenda, if applicable

**ARTICLE 8 – CERTIFICATION**

By signing this contract, the Contractor hereby re-certifies compliance with all legal requirements set forth in Section 6.0, Bidder’s Certifications of the Bid Form.

Further, if the Contractor provides any “personal information” as defined in §105.1500, RSMo concerning an entity exempt from federal income tax under Section 501(c) of the Internal Revenue Code of 1986, as amended, the Contractor understands and agrees that it is voluntarily choosing to enter into a state contract and providing such information for that purpose. The state will treat such personal information in accord with §105.1500, RSMo.

By signature below, the parties hereby execute this contract document.

**APPROVED:**

\_\_\_\_\_  
 Brian Yansen, Director  
 Division of Facilities Management,  
 Design and Construction

\_\_\_\_\_  
 Contractor’s Authorized Signature

I, Corporate Secretary, certify that I am Secretary of the corporation named above and that (CONTRACTOR NAME), who signed said contract on behalf of the corporation, was then (TITLE) of said corporation and that said contract was duly signed for and in behalf of the corporation by authority of its governing body, and is within the scope of its corporate powers.

\_\_\_\_\_  
*Corporate Secretary*



STATE OF MISSOURI  
 OFFICE OF ADMINISTRATION  
 DIVISION OF FACILITIES MANAGEMENT, DESIGN AND CONSTRUCTION  
**AFFIDAVIT FOR AFFIRMATIVE ACTION**

PROJECT NUMBER
----------------

NAME
------

First being duly sworn on oath states: that

he/she is the  sole proprietor  partner  officer or  manager or managing member of

NAME
------

a  sole proprietorship  partnership  
 limited liability company (LLC)

or  corporation, and as such, said proprietor, partner, or officer is duly authorized to make this

affidavit on behalf of said sole proprietorship, partnership, or corporation; that under the contract known as

PROJECT TITLE
---------------

Less than 50 persons in the aggregate will be employed and therefore, the applicable Affirmative Action requirements as set forth in Article 1.4 of the General Conditions of the State of Missouri have been met.

PRINT NAME & SIGNATURE
------------------------

DATE
------

--

**NOTARY INFORMATION**

NOTARY PUBLIC EMBOSSER SEAL
-----------------------------

STATE OF
----------

COUNTY (OR CITY OF ST. LOUIS)
-------------------------------

USE RUBBER STAMP IN CLEAR AREA BELOW
--------------------------------------

SUBSCRIBED AND SWORN BEFORE ME, THIS
--------------------------------------

DAY OF
NOTARY PUBLIC SIGNATURE

YEAR
MY COMMISSION EXPIRES

NOTARY PUBLIC NAME (TYPED OR PRINTED)
---------------------------------------

**SECTION 006113 - PERFORMANCE AND PAYMENT BOND FORM**

KNOW ALL MEN BY THESE PRESENTS, THAT we \_\_\_\_\_

as principal, and \_\_\_\_\_

\_\_\_\_\_ as Surety, are held and firmly bound unto the

STATE OF MISSOURI. in the sum of \_\_\_\_\_ Dollars (\$ \_\_\_\_\_ )

for payment whereof the Principal and Surety bind themselves, their heirs, executors, administrators and successors, jointly and severally, firmly by these presents.

WHEREAS, the Principal has, by means of a written agreement dated the \_\_\_\_\_

day of \_\_\_\_\_, 20\_\_\_\_\_, enter into a contract with the State of Missouri for

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

(Insert Project Title and Number)

NOW, THEREFORE, if the Principal shall faithfully perform and fulfill all the undertakings, covenants, terms, conditions and agreements of said contract during the original term of said contract and any extensions thereof that may be granted by the State of Missouri, with or without notice to the Surety and during the life of any guaranty required under the contract; and shall also faithfully perform and fulfill all undertakings, covenants, terms, conditions and agreements of any and all duly authorized modifications of said contract that may hereafter be made with or without notice to the Surety; and shall also promptly make payment for materials incorporated, consumed or used in connection with the work set forth in the contract referred to above, and all insurance premiums, both compensation and all other kinds of insurance, on said work, and for all labor performed on such work, whether by subcontractor or otherwise, at not less than the prevailing hourly rate of wages for work of a similar character (exclusive of maintenance work) in the locality in which the work is performed and not less than the prevailing hourly rate of wages for legal holiday and overtime work (exclusive of maintenance work) in the locality in which the work is performed both as determined by the Department of Labor and Industrial Relations or determined by the Court of Appeal, as provided for in said contract and in any and all duly authorized modifications of said contract that may be hereafter made, with or without notice to the Surety, then, this obligation shall be void and of no effect, but it is expressly understood that if the Principal should make default in or should fail to strictly, faithfully and efficiently do, perform and comply with any or more of the covenants, agreements, stipulations, conditions, requirements or undertakings, as specified in or by the terms of said contract, and with the time therein named, then this obligation shall be valid and binding upon each of the parties hereto and this bond shall remain in full force and effect; and the same may be sued on at the instance of any material man, laborer, mechanic, subcontractor, individual, or otherwise to whom such payment is due, in the name of the State of Missouri, to the use of any such person.

AND, IT IS FURTHER specifically provided that any modifications which may hereinafter be made in the terms of the contract or in the work to be done under it or the giving by the Owner of any extension of the time for the performance of the contract or any other forbearance on the part of either the Owner or the Principal to the other, shall not in any way release the Principal and the Surety, or either or any of them, their heirs, executors, administrators and successors, from their liability hereunder, notice to the Surety of any such extension, modifications or forbearance being hereby waived.

IN WITNESS WHEREOF, the above bounden parties have executed the within instrument this \_\_\_\_\_ day of \_\_\_\_\_, 20 \_\_\_\_.

**AS APPLICABLE:**

**AN INDIVIDUAL**

Name: \_\_\_\_\_

Signature: \_\_\_\_\_

**A PARTNERSHIP**

Name of Partner: \_\_\_\_\_

Signature of Partner: \_\_\_\_\_

Name of Partner: \_\_\_\_\_

Signature of Partner: \_\_\_\_\_

**CORPORATION**

Firm Name: \_\_\_\_\_

Signature of President: \_\_\_\_\_

**SURETY**

Surety Name: \_\_\_\_\_

Attorney-in-Fact: \_\_\_\_\_

Address of Attorney-in-Fact: \_\_\_\_\_

Telephone Number of Attorney-in-Fact: \_\_\_\_\_

Signature Attorney-in-Fact: \_\_\_\_\_

**NOTE:** Surety shall attach Power of Attorney



STATE OF MISSOURI  
 OFFICE OF ADMINISTRATION  
 DIVISION OF FACILITIES MANAGEMENT, DESIGN AND CONSTRUCTION  
**PRODUCT SUBSTITUTION REQUEST**

PROJECT NUMBER

PROJECT TITLE AND LOCATION

CHECK APPROPRIATE BOX

**SUBSTITUTION PRIOR TO BID OPENING**  
 (Minimum of (5) working days prior to receipt of Bids as per Article 4 – Instructions to Bidders)

**SUBSTITUTION FOLLOWING AWARD**  
 (Maximum of (20) working days from Notice to Proceed as per Article 3 – General Conditions)

FROM: BIDDER/CONTRACTOR (PRINT COMPANY NAME)

TO: ARCHITECT/ENGINEER (PRINT COMPANY NAME)

Bidder/Contractor hereby requests acceptance of the following product or systems as a substitution in accordance with provisions of Division One of the Bidding Documents:

SPECIFIED PRODUCT OR SYSTEM

SPECIFICATION SECTION NO.

SUPPORTING DATA

Product data for proposed substitution is attached (include description of product, standards, performance, and test data)

Sample                       Sample will be sent, if requested

**QUALITY COMPARISON**

	SPECIFIED PRODUCT	SUBSTITUTION REQUEST
NAME, BRAND		
CATALOG NO.		
MANUFACTURER		
VENDOR		

**PREVIOUS INSTALLATIONS**

PROJECT	ARCHITECT/ENGINEER	DATE INSTALLED
LOCATION		

**SIGNIFICANT VARIATIONS FROM SPECIFIED PRODUCT**

---



---



---



---



---



---



---



---



---



---

**REASON FOR SUBSTITUTION**

---



---



---



---



---

**DOES PROPOSED SUBSTITUTION AFFECT OTHER PARTS OF WORK?**

YES       NO

IF YES, EXPLAIN

---



---



---



---



---

**SUBSTITUTION REQUIRES DIMENSIONAL REVISION OR REDESIGN OF STRUCTURE OR A/E WORK**

YES       NO

**BIDDER'S/CONTRACTOR'S STATEMENT OF CONFORMANCE OF PROPOSED SUBSTITUTION TO CONTRACT REQUIREMENT:**

We have investigated the proposed substitution. We believe that it is equal or superior in all respects to specified product, except as stated above; that it will provide the same Warranty as specified product; that we have included complete implications of the substitution; that we will pay redesign and other costs caused by the substitution which subsequently become apparent; and that we will pay costs to modify other parts of the Work as may be needed, to make all parts of the Work complete and functioning as a result of the substitution.

BIDDER/CONTRACTOR

DATE

**REVIEW AND ACTION**

Resubmit Substitution Request with the following additional information:

---

Substitution is accepted.

Substitution is accepted with the following comments:

---

Substitution is not accepted.

ARCHITECT/ENGINEER

DATE





PROJECT NUMBER
----------------

KNOW ALL MEN BY THESE PRESENT THAT:                    hereinafter called "Subcontractor" who heretofore entered into an agreement with                    hereinafter called "Contractor", for the performance of work and/or furnishing of material for the construction of the project entitled

(PROJECT TITLE, PROJECT LOCATION, AND PROJECT NUMBER)

at

(ADDRESS OF PROJECT)

for the State of Missouri (Owner) which said subcontract is by this reference incorporated herein, in consideration of such final payment by Contractor.

DOES HEREBY:

1. ACKNOWLEDGE that they have been **PAID IN FULL** all sums due for work and materials contracted or done by their Subcontractors, Material Vendors, Equipment and Fixture Suppliers, Agents and Employees, or otherwise in the performance of the Work called for by the aforesaid Contract and all modifications or extras or additions thereto, for the construction of said project or otherwise.
2. RELEASE and fully, finally, and forever discharge the Owner from any and all suits, actions, claims, and demands for payment for work performed or materials supplied by Subcontractor in accordance with the requirements of the above referenced Contract.
1. REPRESENT that all of their Employees, Subcontractors, Material Vendors, Equipment and Fixture Suppliers, and everyone else has been **paid in full** all sums due them, or any of them, in connection with performance of said Work, or anything done or omitted by them, or any of them in connection with the construction of said improvements, or otherwise.

DATED this                    day of                    , 20                    .

NAME OF SUBCONTRACTOR

BY (TYPED OR PRINTED NAME)

SIGNATURE

TITLE

ORIGINAL: FILE/Closeout Documents



STATE OF MISSOURI  
 OFFICE OF ADMINISTRATION  
 DIVISION OF FACILITIES MANAGEMENT,  
 DESIGN AND CONSTRUCTION

**MBE/WBE/SDVE PROGRESS REPORT**

Remit with **ALL** Progress and Final Payments

(Please check appropriate box) CONSULTANT CONSTRUCTION

PAY APP NO.	PROJECT NUMBER
CHECK IF FINAL <input checked="" type="checkbox"/> <b>FINAL</b>	DATE

PROJECT TITLE

PROJECT LOCATION

FIRM

ORIGINAL CONTRACT SUM (Same as Line Item 1. on Form A of Application for Payment)  
 \$

TOTAL CONTRACT SUM TO DATE (Same as Line Item 3. on Form A of Application for Payment)  
 \$

THE TOTAL MBE/WBE/SDVE PARTICIPATION DOLLAR AMOUNT OF THIS PROJECT AS INDICATED IN THE ORIGINAL CONTRACT: \$

SELECT MBE, WBE, SDVE	TOTAL AMOUNT OF SUBCONTRACT	\$ AMOUNT PAID-TO-DATE (include approved contract changes)	CONSULTANT/SUBCONSULTANT OR CONTRACTOR/SUBCONTRACTOR/SUPPLIER COMPANY NAME
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	

## **INSTRUCTIONS FOR MBE/WBE/SDVE PROGRESS REPORT**

### **CONTRACTOR OR CONSULTANT TO FILL OUT AND REMIT WITH EACH PAY APPLICATION:**

The MBE/WBE/SDVE Progress Report for the project is issued with the contract comprising values reported in the consultant's Proposal or on the successful contractor's Section 004337 Compliance Evaluation Forms.

At Initial Pay Application fill in the following:

1. Pay App No. Start with 1.
2. Fill in the Project Number and Date.
3. Enter Project Title, Project Location, and Firm.
4. Fill in the "Original Contract Sum" and "Total Contract Sum To Date" (Reference applicable Line Items on Form A of Application for Payment).
5. Indicate the Total Participation Dollar Amount from the Original Contract.
6. Select MBE, WBE, or SDVE for each Consultant/Subconsultant or Contractor/Subcontractor/Supplier.
7. Enter the "Total Amount of Subcontract", "\$ Amount (Paid-To-Date)", and Company Name.

For all subsequent Pay Applications fill in the following:

1. Pay App No.
2. If Final Pay App, check box.
3. Fill in the Project Number and Date.
4. Enter Project Title, Project Location, and Firm
5. At each Pay App fill in the "Original Contract Sum" and "Total Contract Sum To Date" (reference applicable Line Items on Form A of Application for Payment).
6. Indicate the Total Participation Dollar Amount from the Original Contract.
7. Select MBE, WBE, or SDVE for each Consultant/Subconsultant or Contractor/Subcontractor/Supplier
8. Enter the "Total Amount of Subcontract", "\$ Amount (Paid-To-Date)", and Company Name.



STATE OF MISSOURI  
 OFFICE OF ADMINISTRATION  
 DIVISION OF FACILITIES MANAGEMENT, DESIGN AND CONSTRUCTION  
**AFFIDAVIT – COMPLIANCE WITH PREVAILING WAGE LAW**

PROJECT NUMBER
----------------

Before me, the undersigned Notary Public, in and for the County of \_\_\_\_\_

State of \_\_\_\_\_ personally came and appeared \_\_\_\_\_

(NAME)

\_\_\_\_\_ of the \_\_\_\_\_

(POSITION) (NAME OF THE COMPANY)

(a corporation) (a partnership) (a proprietorship) and after being duly sworn did depose and say that all provisions and requirements set out in Chapter 290, Sections 290.210 through and including 290.340, Missouri Revised Statutes, pertaining to the payment of wages to workmen employed on public works project have been fully satisfied and there has been no exception to the full and completed compliance with said provisions and requirements and with Wage Determination No: \_\_\_\_\_ issued by the Department of Labor and Industrial Relations, State of Missouri on the \_\_\_\_\_ day of \_\_\_\_\_ 20 \_\_\_\_ in carrying out the contract and working in connection with \_\_\_\_\_

(NAME OF PROJECT)

Located at \_\_\_\_\_ in \_\_\_\_\_ County

(NAME OF THE INSTITUTION)

Missouri, and completed on the \_\_\_\_\_ day of \_\_\_\_\_ 20 \_\_\_\_

SIGNATURE

**NOTARY INFORMATION**

NOTARY PUBLIC EMBOSSER OR BLACK INK RUBBER STAMP SEAL	STATE	COUNTY (OR CITY OF ST. LOUIS)
	SUBSCRIBED AND SWORN BEFORE ME, THIS	
	DAY OF	YEAR
	NOTARY PUBLIC SIGNATURE	MY COMMISSION EXPIRES
NOTARY PUBLIC NAME (TYPED OR PRINTED)		<b>USE RUBBER STAMP IN CLEAR AREA BELOW</b>

FILE: Closeout Documents

# GENERAL CONDITIONS

## INDEX

### ARTICLE:

#### 1. General Provisions

- 1.1. Definitions
- 1.2. Drawings and Specifications
- 1.3. Compliance with Laws, Permits, Regulations and Inspections
- 1.4. Nondiscrimination in Employment
- 1.5. Anti-Kickback
- 1.6. Patents and Royalties
- 1.7. Preference for American and Missouri Products and Services
- 1.8. Communications
- 1.9. Separate Contracts and Cooperation
- 1.10. Assignment of Contract
- 1.11. Indemnification
- 1.12. Disputes and Disagreements

#### 2. Owner/Designer Responsibilities

#### 3. Contractor Responsibilities

- 3.1. Acceptable Substitutions
- 3.2. Submittals
- 3.3. As-Built Drawings
- 3.4. Guaranty and Warranties
- 3.5. Operation and Maintenance Manuals
- 3.6. Other Contractor Responsibilities
- 3.7. Subcontracts

#### 4. Changes in the Work

- 4.1. Changes in the Work
- 4.2. Changes in Completion Time

#### 5. Construction and Completion

- 5.1. Construction Commencement
- 5.2. Project Construction
- 5.3. Project Completion
- 5.4. Payments

#### 6. Bond and Insurance

#### 6.1. Bond

#### 6.2. Insurance

#### 7. Termination or Suspension of Contract

#### 7.1. For Site Conditions

#### 7.2. For Cause

#### 7.3. For Convenience

## SECTION 007213 - GENERAL CONDITIONS

- A. These General Conditions apply to each section of these specifications. The Contractor is subject to the provisions contained herein.
- B. The General Conditions are intended to define the relationship of the Owner, the Designer and the Contractor thereby establishing certain rules and provisions governing the operation and performance of the work so that the work may be performed in a safe, orderly, expeditious and workmanlike manner.

## ARTICLE 1 – GENERAL PROVISIONS

### ARTICLE 1.1 - DEFINITIONS

As used in these contract documents, the following terms shall have the meanings and refer to the parties designated in these definitions.

1. **"COMMISSIONER"**: The Commissioner of the Office of Administration.
2. **"CONSTRUCTION DOCUMENTS"**: The "Construction Documents" shall consist of the Project Manual, Drawings and Addenda.
3. **"CONSTRUCTION REPRESENTATIVE:"** Whenever the term "Construction Representative" is used, it shall mean the Owner's Representative at the work site.
4. **"CONTRACTOR"**: Party or parties who have entered into a contract with the Owner to furnish work under these specifications and drawings.
5. **"DESIGNER"**: When the term "Designer" is used herein, it shall refer to the Architect, Engineer, or Consultant of Record specified and defined in Paragraph 2.0 of the Supplemental Conditions, or his duly authorized representative. The Designer may be either a consultant or state employee.
6. **"DIRECTOR"**: Whenever the term "Director" is used, it shall mean the Director of the Division of Facilities Management, Design and Construction or his Designee, representing the Office of Administration, State of Missouri. The Director is the agent of the Owner.
7. **"DIVISION"**: Shall mean the Division of Facilities Management, Design and Construction, State of Missouri.

8. **"INCIDENTAL JOB BURDENS"**: Shall mean those expenses relating to the cost of work, incurred either in the home office or on the job-site, which are necessary in the course of doing business but are incidental to the job. Such costs include office supplies and equipment, postage, courier services, telephone expenses including long distance, water and ice and other similar expenses.
9. **"JOINT VENTURE"**: An association of two (2) or more businesses to carry out a single business enterprise for profit for which purpose they combine their property, capital, efforts, skills and knowledge.
10. **"OWNER"**: Whenever the term "Owner" is used, it shall mean the State of Missouri.
11. **"PROJECT"**: Wherever the term "Project" is used, it shall mean the work required to be completed by the construction contract.
12. **"PROJECT MANUAL"**: The "Project Manual" shall consist of Introductory Information, Invitation for Bid, Instructions to Bidders, Bid Documents, Additional Information, Standard Forms, General Conditions, Supplemental General Conditions, General Requirements and Technical Specifications.
13. **"SUBCONTRACTOR"**: Party or parties who contract under, or for the performance of part or this entire Contract between the Owner and Contractor. The subcontract may or may not be direct with the Contractor.
14. **"WORK"**: Labor, material, supplies, plant and equipment required to perform and complete the service agreed to by the Contractor in a safe, expeditious, orderly and workmanlike manner so that the project shall be complete and finished in the best manner known to each respective trade.
15. **"WORKING DAYS"**: are all calendar days except Saturdays, Sundays and the following holidays: New Year's Day, Martin Luther King, Jr. Day, Lincoln Day, Washington's Birthday (observed), Truman Day, Memorial Day, Juneteenth, Independence Day, Labor Day, Columbus Day, Veterans Day (observed), Thanksgiving Day, Christmas Day.

### ARTICLE 1.2 DRAWINGS AND SPECIFICATIONS

- A. In case of discrepancy between drawings and specifications, specifications shall govern. Should discrepancies in architectural drawings, structural drawings and mechanical drawings occur,

architectural drawings shall govern and, in case of conflict between structural and mechanical drawings, structural drawings shall govern.

- B. Specifications are separated into titled divisions for convenience of reference only and to facilitate letting of contracts and subcontracts. The Contractor is responsible for establishing the scope of work for subcontractors, which may cross titled divisions. Neither the Owner nor Designer will establish limits and jurisdiction of subcontracts.
- C. Figured dimensions take precedence over scaled measurements and details over smaller scale general drawings. In the event of conflict between any of the documents contained within the contract, the documents shall take precedence and be controlling in the following sequence: addenda, supplementary general conditions, general conditions, division 1 specifications, technical division specifications, drawings, bid form and instructions to bidders.
- D. Anything shown on drawings and not mentioned in these specifications or vice versa, as well as any incidental work which is obviously necessary to complete the project within the limits established by the drawings and specifications, although not shown on or described therein, shall be performed by the Contractor at no additional cost as a part of his contract.
- E. Upon encountering conditions differing materially from those indicated in the contract documents, the Contractor shall promptly notify the Designer and Construction Representative in writing before such conditions are disturbed. The Designer shall promptly investigate said conditions and report to the Owner, with a recommended course of action. If conditions do materially differ and cause an increase or decrease in contract cost or time required for completion of any portion of the work, a contract change will be initiated as outlined in Article 4 of these General Conditions.
- E. Only work included in the contract documents is authorized, and the Contractor shall do no work other than that described therein or in accordance with appropriately authorized and approved contract changes.

#### **ARTICLE 1.3 - COMPLIANCE WITH LAWS, PERMITS, REGULATIONS AND INSPECTIONS**

- A. Since the Owner is the State of Missouri, municipal or political subdivisions, zoning ordinances, construction codes (other than licensing of trades), and other like ordinances are not applicable to construction on Owner's property, and Contractor will not be required to submit drawings and specifications to any municipal or political subdivision, authority, obtain

construction permits or any other licenses (other than licensing of trades) or permits from or submit to inspections by any municipality or political subdivision relating to the construction for this project. All permits or licenses required by municipality or political subdivision for operation on property not belonging to Owner shall be obtained by and paid for by Contractor. Each Contractor shall comply with all applicable laws, ordinances, rules and regulations that pertain to the work of this contract.

- B. Contractors, subcontractors and their employees engaged in the businesses of electrical, mechanical, plumbing, carpentry, sprinkler system work, and other construction related trades shall be licensed to perform such work by the municipal or political subdivision where the project is located, if such licensure is required by local code. Local codes shall dictate the level (master, journeyman, and apprentice) and the number, type and ratio of licensed tradesmen required for this project within the jurisdiction of such municipal or political subdivision.
- C. Equipment and controls manufacturers and their authorized service and installation technicians that do not maintain an office within the jurisdiction of the municipal or political subdivision but are a listed or specified contractor or subcontractor on this project are exempt from Paragraph 1.3 B above.
- D. The Contractor shall post a copy of the wage determination issued for the project and included as a part of the contract documents, in a prominent and easily accessible location at the site of construction for the duration of the project.
- E. Any contractor or subcontractor to such contractor at any tier signing a contract to work on this project shall provide a ten-hour Occupational Safety and Health Administration (OSHA) construction safety program for their on-site employees which includes a course in construction safety and health approved by OSHA or a similar program approved by the Department of Labor and Industrial Relations which is at least as stringent as an approved OSHA program. The contractor shall forfeit as a penalty to the public body on whose behalf the contract is made or awarded, two thousand five hundred dollars plus one hundred dollars for each employee employed by the contractor or subcontractor, for each calendar day, or portion thereof, such employee is employed without the required training.

#### **ARTICLE 1.4 - NONDISCRIMINATION IN EMPLOYMENT**

- A. The Contractor and his subcontractors will not discriminate against individuals based on race,

color, religion, national origin, sex, disability, or age, but may use restrictions which relate to bona fide occupational qualifications. Specifically, the Contractor and his subcontractors shall not discriminate:

1. Against recipients of service on the basis of race, color, religion, national origin, sex, disability or age.
2. Against any employee or applicant, for employment on the basis of race, color, religion, national origin, sex or otherwise qualified disability status.
3. Against any applicant for employment or employee on the basis of age, where such applicant or employee is between ages 40 and 70 and where such Contractor employs at least 20 persons.
4. Against any applicant for employment or employee on the basis of that person's status as a disabled or Vietnam-era veteran.

The Contractor and his Subcontractors will take affirmative action to insure applicants for employment and employees are treated equally without regard to race, color, religion, national origin, sex, disability, or age. Such action shall include, but not be limited to, the following: employment, upgrading, demotion and transfer; recruitment or recruitment advertising; and selection for training, including apprenticeship. The Contractor and his Subcontractors will give written notice of their commitments under this clause to any labor union with which they have bargaining or other agreements.

- B. The Contractor and his subcontractors shall develop, implement, maintain and submit in writing to the Owner an affirmative action program if at least fifty (50) persons in the aggregate are employed under this contract. If less than fifty (50) persons in the aggregate are to be employed under this contract, the Contractor shall submit, in lieu of the written affirmative action program, a properly executed Affidavit for Affirmative Action in the form included in the contract specifications. For the purpose of this section, an "affirmative action program" means positive action to influence all employment practices (including, but not limited to, recruiting, hiring, promoting and training) in providing equal employment opportunity regardless of race, color, sex, national origin, religion, age (where the person affected is between age 40 and 70), disabled and Vietnam-era veteran status, and disability. Such "affirmative action program" shall include:

1. A written policy statement committing the total organization to affirmative action and

assigning management responsibilities and procedures for evaluation and dissemination;

2. The identification of a person designated to handle affirmative action;
3. The establishment of non-discriminatory selection standards, objective measures to analyze recruitment, an upward mobility system, a wage and salary structure, and standards applicable to lay-off, recall, discharge, demotion and discipline;
4. The exclusion of discrimination from all collective bargaining agreements; and
5. Performance of an internal audit of the reporting system to monitor execution and to provide for future planning.

In the enforcement of this non-discrimination clause, the Owner may use any reasonable procedures available, including, but not limited to: requests, reports, site visits and inspection of relevant documents of contractors and subcontractors.

- C. In the event of the Contractor's or his subcontractor's noncompliance with any provisions of this Article of the Contract, the Owner may cancel this contract in whole or in part or require the Contractor to terminate his contract with the subcontractor.

#### **ARTICLE 1.5 - ANTI-KICKBACK**

No employee of the division, shall have or acquire any pecuniary interest, whether direct or indirect, in this contract or in any part hereof. No officer, employee, designer, attorney, or administrator of or for the Owner who is authorized in such capacity and on behalf of the Owner to exercise any legislative, executive, supervisory or other similar functions in connection with the construction of the project, shall have or acquire any pecuniary interest, whether direct or indirect, in this contract, any material supply contract, subcontract, insurance contract, or any other contract pertaining to the project.

#### **ARTICLE 1.6 - PATENTS AND ROYALTIES**

- A. The Contractor shall hold and save the Owner and its officers, agents, servants and employees harmless from liabilities of any nature or kind, including cost and expenses, for, or on account of, any patented or unpatented invention, process, article or appliance manufactured or used in the performance of this contract, including its use by the Owner, unless otherwise specifically stipulated in the contract documents.
- B. If the Contractor uses any design, device or materials covered by letters, patent or copyright,



the Contractor shall provide for such use by suitable agreement with the Owner of such patented or copyrighted design, device or material. It is mutually agreed and understood, without exception, that the contract prices shall include all royalties or costs arising from the use of such design, device or materials, in any way involved in the work. The Contractor and/or his sureties shall indemnify and save harmless the Owner of the project from any and all claims for infringement by reason of the use of such patented or copyrighted design, device or materials or any trademark or copyright in connection with work agreed to be performed under this contract and shall indemnify the Owner for any cost, expense or damage it may be obliged to pay by reason of such infringement at any time during the prosecution of the work or after completion of the work.

#### **ARTICLE 1.7 - PREFERENCE FOR AMERICAN AND MISSOURI PRODUCTS AND SERVICES**

- A. By virtue of statutory authority a preference will be given to Missouri labor and to products of mines, forests and quarries of the state of Missouri when they are found in marketable quantities in the state, and all such materials shall be of the best quality and suitable character that can be obtained at reasonable market prices, all as provided for in Section 8.280, Missouri Revised Statutes and Cumulative Supplements.
- B. Furthermore, pursuant to Section 34.076 Missouri Revised Statutes and Cumulative Supplements, a preference shall be given to those persons doing business as Missouri firms, corporations, or individuals, or which maintain Missouri offices or places of business, when the quality of performance promised is equal or better and the price quoted is the same or less. In addition, in order for a non-domiciliary bidder to be successful, his bid must be that same percentage lower than a domiciliary Missouri bidder's bid, as would be required for a Missouri bidder to successfully bid in the non-domiciliary state.
- C. In accordance with the Missouri Domestic Products Procurement Act Section 34.350 RSMo and Cumulative Supplements any manufactured goods or commodities used or supplied in the performance of this contract or any subcontract thereto shall be manufactured, assembled or produced in the United States, unless the specified products are not manufactured, assembled or produced in the United States in sufficient quantities to meet the agency's requirements or cannot be manufactured, assembled or produced in the United States within the necessary time in sufficient quantities to meet the contract requirements, or if obtaining the specified products manufactured, assembled or produced in the

United States would increase the cost of this contract for purchase of the product by more than ten percent.

#### **ARTICLE 1.8 - COMMUNICATIONS**

- A. All notices, requests, instructions, approvals and claims must be in writing and shall be delivered to the Designer and copied to the Construction Representative for the project except as required by Article 1.12 Disputes and Disagreements, or as otherwise specified by the Owner in writing as stated in Section 012600. Any such notice shall be deemed to have been given as of the time of actual receipt.
- B. The Contractor shall attend on-site progress and coordination meetings, as scheduled by the Construction Representative, no less than once a month.
- C. The Contractor shall ensure that major subcontractors and suppliers shall attend monthly progress meetings as necessary to coordinate the work, and as specifically requested by the Construction Representative.

#### **ARTICLE 1.9 - SEPARATE CONTRACTS AND COOPERATION**

- A. The Owner reserves the right to let other contracts in connection with this work. The Contractor shall afford other contractors reasonable opportunity for the introduction and storage of their materials and the execution of their work and shall properly connect and coordinate his work with theirs.
- B. The Contractor shall consult the drawings for all other contractors in connection with this work. Any work conflicting with the above shall be brought to the attention of the Owner's Representative before the work is performed. If the Contractor fails to do this, and constructs any work which interferes with the work of another contractor, the Contractor shall remove any part so conflicting and rebuild same, as directed by the Owner's Representative at no additional cost to the Owner.
- C. Each contractor shall be required to coordinate his work with other contractors so as to afford others reasonable opportunity for execution of their work. No contractor shall delay any other contractor by neglecting to perform contract work at the proper time. If any contractor causes delay to another, they shall be liable directly to that contractor for such delay in addition to any liquidated damages which might be due the Owner.
- D. Should the Contractor or project associated subcontractors refuse to cooperate with the instructions and reasonable requests of other Contractors or other subcontractors in the overall

coordinating of the work, the Owner may take such appropriate action and issue directions, as required, to avoid unnecessary and unwarranted delays.

- E. Each Contractor shall be responsible for damage done to Owner's or other Contractor's property by him/her or workers in his employ through their fault or negligence.
- F. Should a Contractor sustain any damage through any act or omission of any other Contractor having a contract with the Owner, the Contractor so damaged shall have no claim or cause of action against the Owner for such damage, but shall have a claim or cause of action against the other Contractor to recover any and all damages sustained by reason of the acts or omissions of such Contractor. The phrase "acts or omissions" as used in this section shall be defined to include, but not be limited to, any unreasonable delay on the part of any such contractors.

#### **ARTICLE 1.10 - ASSIGNMENT OF CONTRACT**

- A. No assignment by Contractor of any amount or any part of this contract or of the funds to be received there under will be recognized unless such assignment has had the written approval of the Director and the surety has been given due notice of such assignment and has furnished written consent thereto. In addition to the usual recitals in assignment contracts, the following language must be set forth: "It is agreed that the funds to be paid to the assignee under this assignment are subject to performance by the Contractor of this contract and to claims or liens for services rendered or materials supplied for the performance of the work called for in said contract in favor of all persons, firms or corporations rendering such services or supplying such materials."

#### **ARTICLE 1.11 - INDEMNIFICATION**

- A. Contractor agrees to indemnify and save harmless Owner and its respective commissioners, officers, officials, agents, consultants and employees and Designer, their agents, servants and employees, from and against any and all liability for damage arising from injuries to persons or damage to property occasioned by any acts or omissions of Contractor, any subcontractors, agents, servants or employees, including any and all expense, legal or otherwise, which may be incurred by Owner or Designer, its agents, servants or employees, in defense of any claim, action or suit.
- B. The obligations of the Contractor under this paragraph shall not extend to the liability of the Designer, his agents or employees, arising out of (1) the preparation or approval of maps, drawings, opinions, reports, surveys, contract changes, design or specifications, or (2) giving of or the failure to

give directions or instructions by the Designer, his agents or employees as required by this contract documents provided such giving or failure to give is the primary cause of the injury or damage.

#### **ARTICLE 1.12 - DISPUTES AND DISAGREEMENTS**

It is hereby expressly agreed and understood that in case any controversy or difference of opinion arises during construction, best efforts will be given to resolution at the field level. Should those efforts be unsuccessful, the Contractor has the right to appeal in writing, the decision of the Director's Designee to the Director at Room 730 Truman Building, P.O. Box 809, Jefferson City, Missouri 65102. The decision of the Director shall be final and binding on all parties.

#### **ARTICLE 2 -- OWNER/DESIGNER RESPONSIBILITIES**

- A. The Owner shall give all orders and directions contemplated under this contract relative to the execution of the work. During progress of work the Owner will be represented at the project site by the Construction Representative and/or Designer, whose responsibilities are to see that this contract is properly fulfilled.
- B. The Owner shall at all times have access to the work whenever it is in preparation or progress. The Contractors shall provide proper facilities for such access and for inspection and supervision.
- C. All materials and workmanship used in the work shall be subject to the inspection of the Designer and Construction Representative, and any work which is deemed defective shall be removed, rebuilt or made good immediately upon notice. The cost of such correction shall be borne by the Contractor. Contractor shall not be entitled to an extension of the contract completion date in order to remedy defective work. All rejected materials shall be immediately removed from the site of the work.
- D. If the Contractor fails to proceed at once with the correction of rejected defective materials or workmanship, the Owner may, by separate contract or otherwise, have the defects remedied or rejected. Materials removed from the site and charge the cost of the same against any monies which may be due the Contractor, without prejudice to any other rights or remedies of the Owner.
- E. Failure or neglect on the part of Owner to observe faulty work, or work done which is not in accordance with the drawings and specifications shall not relieve the Contractor from responsibility

for correcting such work without additional compensation.

- F. The Owner shall have the right to direct the Contractor to uncover any completed work.
  - 1. If the Contractor fails to adequately notify the Construction Representative and/or Designer of an inspection as required by the Contract Documents, the Contractor shall, upon written request, uncover the work. The Contractor shall bear all costs associated with uncovering and again covering the work exposed.
  - 2. If the Contractor is directed to uncover work, which was not otherwise required by the Contract Documents to be inspected, and the work is found to be defective in any respect, no compensation shall be allowed for this work. If, however, such work is found to meet the requirements of this contract, the actual cost of labor and material necessarily involved in the examination and replacement plus 10% shall be allowed the Contractor.
- G. The Designer shall give all orders and directions contemplated under this contract relative to the scope of the work and shall give the initial interpretation of the contract documents.
- H. The Owner may file a written notice to the Contractor to dismiss immediately any subcontractors, project managers, superintendents, foremen, workers, watchmen or other employees whom the Owner may deem incompetent, careless or a hindrance to proper or timely execution of the work. The Contractor shall comply with such notice as promptly as practicable without detriment to the work or its progress.
- I. If in the Owner's judgment it becomes necessary at any time to accelerate work, when ordered by the Owner in writing, the Contractor shall redirect resources to such work items and execute such portions of the work as may be required to complete the work within the current approved contract schedule.

### **ARTICLE 3 -- CONTRACTOR RESPONSIBILITIES**

The Contractor shall register and utilize the Owner's eBuilder digital project management system for submission of documents described in the following sections. This includes but is not limited to submittals as required by designer, payment applications, Request for Information (RFI), construction change orders, Request for Proposals (RFP), Designer Supplemental Instructions (DSI), etc.

### **ARTICLE 3.1 -- ACCEPTABLE SUBSTITUTIONS**

- A. The Contractor may request use of any article, device, product, material, fixture, form or type of construction which in the judgment of the Owner and Designer is equal in all respects to that named. Standard products of manufacturers other than those specified will be accepted when, prior to the ordering or use thereof, it is proven to the satisfaction of the Owner and Designer that they are equal in design, strength, durability, usefulness and convenience for the purpose intended.
- B. Any changes required in the details and dimensions indicated on the drawings for the substitution of products other than those specified shall be properly made at the expense of the Contractor requesting the substitution or change.
- C. The Contractor shall submit a request for such substitutions in writing to the Owner and Designer within twenty (20) working days after the date of the "Notice to Proceed." Thereafter no consideration will be given to alternate forms of accomplishing the work. This Article does not preclude the Owner from exercising the provisions of Article 4 hereof.
- D. Any request for substitution by the Contractor shall be submitted in accordance with SECTION 002113 - INSTRUCTIONS TO BIDDERS.
- E. When a material has been approved, no change in brand or make will be permitted unless:
  - 1. Written verification is received from the manufacturer stating they cannot make delivery on the date previously agreed, or
  - 2. Material delivered fails to comply with contract requirements.

### **ARTICLE 3.2 -- SUBMITTALS**

- A. The Contractor's submittals must be submitted with such promptness as to allow for review and approval so as not to cause delay in the work. The Contractor shall coordinate preparation and processing of submittals with performance of construction activities.

Coordinate each submittal with fabrication, = purchasing, testing, delivery, other submittals, and related activities that require sequential activity.

Submit four (4) copies to the Designer and additional copies as required for the subcontractors and material suppliers. Also provide copies to meet the requirements for maintenance manuals.

- B. All subcontractors' shop drawings and schedules shall be submitted by the Contractor and shall bear evidence that Contractor has received, reviewed, and approved them. Any shop drawings and

schedules submitted without this evidence will be returned to the Contractor for resubmission.

- C. The Contractor shall include with the shop drawing, a letter indicating any and all deviations from the drawings and/or specifications. Failure to notify the Designer of such deviations will be grounds for subsequent rejection of the related work or materials. If, in the opinion of the Designer, the deviations are not acceptable, the Contractor will be required to furnish the item as specified and indicated on the drawings.
- D. The Designer shall check shop drawings and schedules with reasonable promptness and approve them only if they conform to the design concept of the project and comply with the information given in the contract documents. The approval shall not relieve the Contractor from the responsibility to comply with the drawings and specifications, unless the Contractor has called the Designer's attention to the deviation, in writing, at the time of submission and the Designer has knowingly approved thereof. An approval of any such modification will be given only under the following conditions:
  - 1. It is in the best interest of the Owner
  - 2. It does not increase the contract sum and/or completion time
  - 3. It does not deviate from the design intent
  - 4. It is without prejudice to any and all rights under the surety bond.
- E. No extension of time will be granted because of the Contractor's failure to submit shop drawings and schedules in ample time to allow for review, possible resubmission, and approval. Fabrication of work shall not commence until the Contractor has received approval. The Contractor shall furnish prints of approved shop drawings and schedules to all subcontractors whose work is in any way related to the work under this contract. Only prints bearing this approval will be allowed on the site of construction
- F. The Contractor shall maintain a complete file on-site of approved shop drawings available for use by the Construction Representative.

### **ARTICLE 3.3 – AS-BUILT DRAWINGS**

- A. The Contractor shall update a complete set of the construction drawings, shop drawings and schedules of all work monthly by marking changes, and at the completion of their work (prior to submission of request for final payment) note all changes and turn the set over to the Construction Representative. The updates shall show all addenda, all field changes that were made to adapt to field conditions, changes resulting from contract

changes or supplemental instructions, and all locations of structures, buried installations of piping, conduit, and utility services. All buried and concealed items both inside and outside shall be accurately located as to depth and referenced to permanent features such as interior or exterior wall faces and dimensions shall be given in a neat and legible manner in a contrasting colored pencil or ink. If approved by the Designer, an electronic file format may be provided.

### **ARTICLE 3.4 – GUARANTY AND WARRANTIES**

#### **A. General Guaranty**

- 1. Neither the final certificate of payment nor any provision in the contract documents nor partial use or occupancy of the premises by the Owner shall constitute an acceptance of work not done in accordance with contract requirements.
- 2. The Contractor or surety shall remedy any defects in the work and pay for any damage to property resulting there from which shall appear within a period of one (1) year from the date of substantial completion unless a longer period is otherwise specified or a differing guaranty period has been established in the substantial completion certificate. The Owner will give notice of observed defects with reasonable promptness.
- 3. In case of default on the part of the Contractor in fulfilling this part of this contract, the Owner may correct the work or repair the damage and the cost and expense incurred in such event shall be paid by or recoverable from the Contractor or surety.
- 4. The work will be free from defects not inherent in the quality required or permitted, and that the Work will conform to the requirements of the Contract Documents. Work not conforming to these requirements, including substitutions not properly approved and authorized, may be considered defective. The Contractor's guaranty excludes remedy for damage or defect caused by abuse, modifications not executed by the Contractor, improper or insufficient maintenance, improper operation, or normal wear and tear under normal usage. If required by the Owner, the Contractor shall furnish satisfactory evidence as to the kind and quality of materials and equipment

#### **B. Extended Warranty**

Manufacturer's certificates of warranty shall be obtained for all major equipment. Warranty shall be obtained for at least one year. Where a longer

period is offered at no additional cost or called for in the specific equipment specifications, the longer period shall govern.

### **ARTICLE 3.5 -- OPERATION AND MAINTENANCE MANUALS**

A. Immediately after equipment submittals are approved and no later than ten (10) working days prior to the substantial completion inspection, the Contractor shall provide to the Designer three (3) copies of operating instructions and service manuals, containing the following:

1. Start-up and Shut-down Procedures: Provide a step-by-step write up of all major equipment. When manufacturer's printed start-up, trouble shooting and shut-down procedures are available; they may be incorporated into the operating manual for reference.
2. Operating Instructions: Written operating instructions shall be included for the efficient and safe operation of all equipment.
3. Equipment List: List of all major equipment as installed shall be prepared to include model number, capacities, flow rate, name place data, shop drawings and air and water balance reports.
4. Service Instructions: Provide the following information for all pieces of equipment.
  - a. Recommended spare parts including catalog number and name of local supplier or factory representative.
  - b. Belt sizes, types, and lengths.
  - c. Wiring diagrams.
5. Manufacturer's Certificate of Warranty as described in Article 3.4.
6. Prior to the final payment, furnish to the Designer three (4) copies of parts catalogs for each piece of equipment furnished by him/her on the project with the components identified by number for replacement ordering.

B. Submission of operating instructions shall be done in the following manner.

1. Manuals shall be in quadruplicate, and all materials shall be bound into volumes of standard 8½" x 11" hard binders. Large drawings too bulky to be folded into 8½" x 11" shall be separately bound or folded and in envelopes, cross referenced and indexed with the manuals.
2. The manuals shall identify project name, project number, and include the name and

address of the Contractor, subcontractors and manufacturers who were involved with the activity described in that particular manual.

3. Internally subdivide the binder contents with permanent page dividers, logically organized with tab titles clearly printed under reinforced laminated plastic tabs.
4. Contents: Prepare a Table of Contents for each volume, with each product or system description identified.

### **ARTICLE 3.6 – OTHER CONTRACTOR RESPONSIBILITIES**

- A. The Contractor shall keep on site, during progress of the work, a competent superintendent satisfactory to the Construction Representative. The superintendent shall represent the Contractor and all agreements made by the superintendent shall be binding. The superintendent shall carefully study and compare all drawings, specifications and other instructions and shall promptly notify the Construction Representative and Designer, in writing, any error, inconsistency or omission which may be discovered. The superintendent shall coordinate all work on the project. Any change of the superintendent shall be approved by the Construction Representative.
- B. Contractor shall, at all times, enforce strict discipline and good order among his employees, and shall not employ on the work any unfit person or anyone not skilled in the work assigned to him/her.
- C. The Contractor shall supply sufficient labor, material, plant and equipment and pay when due any laborer, subcontractor or supplier for supplies furnished and otherwise prosecute the work with diligence to prevent work stoppage and insure completion thereof within the time specified.
- D. The Contractor and each of his subcontractors shall submit to the Construction Representative, through the Designer such schedules of quantities and costs, progress schedules, payrolls, reports, estimates, records and other data as the Owner may request concerning work performed or to be performed under this contract.
- E. The Contractor, subcontractors, and material suppliers shall upon written request, give the Owner access to all time cards, material invoices, payrolls, estimates, profit and loss statements, and all other direct or indirect costs related to this work.
- F. The Contractor shall be responsible for laying out all contract work such as layout of architectural, structural, mechanical and electrical work, which shall be coordinated with layouts of subcontractors

for general construction work. The Contractor is also responsible for unloading, uncrating and handling of all materials and equipment to be erected or placed by him/her, whether furnished by Contractor or others. No extra charges or compensation will be allowed as a result of failure to verify dimensions before ordering materials or fabricating items.

- G. The Contractor must notify the Construction Representative at least one working day before placing concrete or burying underground utilities, pipelines, etc.
- H. Contractors shall prearrange time with the Construction Representative for the interruption of any facility operation. Unless otherwise specified in these documents, all connections, alterations or relocations as well as all other portions of the work will be performed during normal working hours.
- I. The Contractor shall coordinate all work so there will not be prolonged interruptions of existing equipment operation. Any existing plumbing, heating, ventilating, air conditioning or electrical disconnections necessary for the project, which affect portions of this construction or building or any other building must be scheduled with the Construction Representative to minimize or avoid any disruption of facility operations. In no case, unless previously approved in writing by the Construction Representative, shall utilities be left disconnected at the end of a work day or over a weekend. Any interruption of utilities either intentionally or accidentally shall not relieve the Contractor responsible for the interruption from the responsibility to repair and restore the utility to normal service. Repairs and restoration shall be made before the workers responsible for the repair and restoration leave the job.
- J. Contractors shall limit operations and storage of materials to the area within the project, except as necessary to connect to existing utilities, and shall not encroach on neighboring property. The Contractor shall be responsible for repair of their damage to property on or off the project site occurring during construction of project. All such repairs shall be made to the satisfaction of the property owner.
- K. Unless otherwise permitted, all materials shall be new and both workmanship and materials shall be of the best quality.
- L. Unless otherwise provided and stipulated within these specifications, the Contractor shall furnish, construct, and/or install and pay for materials, devices, mechanisms, equipment, all necessary personnel, utilities including, but not limited to water, heat, light and electric power, transportation

services, applicable taxes of every nature, and all other facilities necessary for the proper execution and completion of the work.

- M. Contractor shall carefully examine the plans and drawings and shall be responsible for the proper fitting of his material, equipment and apparatus into the building.
- N. The Contractor or subcontractors shall not overload, or permit others to overload, any part of any structure during the performance of this contract.
- O. All temporary shoring, bracing, etc., required for the removal of existing work and/or for the installation of new work shall be included in this contract. The Contractor shall make good, at no cost to the Owner, any damage caused by improper support or failure of shoring in any respect. Each Contractor shall be responsible for shoring required to protect his work or adjacent property and improvements of Owner and shall be responsible for shoring or for giving written notice to adjacent property owners. Shoring shall be removed only after completion of permanent supports.
- P. The Contractor shall provide at the proper time such material as is required for support of the work. If openings are required, whether shown on drawings or not, the Contractor shall see that they are properly constructed.
- Q. During the performance of work the Contractor shall be responsible for providing and maintaining warning signs, lights, signal devices, barricades, guard rails, fences and other devices appropriately located on site which will give proper and understandable warning to all persons of danger of entry onto land, structure or equipment.
- R. The Contractor shall be responsible for protection, including weather protection, and proper maintenance of all equipment and materials.
- S. The Contractor shall be responsible for care of the finished work and shall protect same from damage or defacement until substantial completion by the Owner. If the work is damaged by any cause, the Contractor shall immediately begin to make repairs in accordance with the drawings and specifications. Contractor shall be liable for all damage or loss unless attributable to the acts or omissions of the Owner or Designer. Any claim for reimbursement shall be submitted in accordance with Article 4. After substantial completion the Contractor will only be responsible for damage resulting from acts or omissions of the Contractor or subcontractors through final warranty.
- T. In the event the Contractor encounters an unforeseen hazardous material, the Contractor

shall immediately stop work in the area affected and report the condition to the Owner and Designer in writing. The Contractor shall not be required, pursuant to Article 4, to perform, any work relating to hazardous materials.

- U. In an emergency affecting safety of persons or property, the Contractor shall act, at the Contractor's discretion, to prevent threatened damage, injury or loss. Additional compensation or extension of time claimed by the Contractor on account of an emergency shall be determined as provided in Article 4.
- V. Before commencing work, Contractors shall confer with the Construction Representative and facility representative and review any facility rules and regulations which may affect the conduct of the work.
- W. Project signs will only be erected on major projects and only as described in the specifications. If no sign is specified, none shall be erected.

#### **ARTICLE 3.7 -- SUBCONTRACTS**

- A. Subcontractor assignments as identified in the bid form shall not be changed without written approval of the Owner. The Owner will not approve changes of a listed subcontractor unless the Contractor documents, to the satisfaction of the Owner that the subcontractor cannot or will not perform the work as specified.
- B. The Contractor is fully responsible to the Owner for the acts and omissions of all subcontractors and of persons either directly or indirectly employed by them.
- C. Every subcontractor shall be bound by the applicable terms and provisions of these contract documents, but no contractual relationship shall exist between any subcontractor and the Owner unless the right of the Contractor to proceed with the work is suspended or this contract is terminated as herein provided, and the Owner in writing elects to assume the subcontract.
- D. The Contractor shall upon receipt of "Notice to Proceed" and prior to submission of the first payment request, notify the Designer and Construction Representative in writing of the names of any subcontractors to be used in addition to those identified in the bid form and all major material suppliers proposed for all parts of the work.

#### **ARTICLE 4 -- CHANGES IN THE WORK**

##### **4.1 CHANGES IN THE WORK**

- A. The Construction Representative, without giving notice to the surety and without invalidating this contract, may order extra work or make changes by

altering, adding to or deducting from the work, this contract sum being adjusted accordingly. All such work shall be executed under the conditions of the original contract. A claim for extension of time caused by any change must be adjusted at the time of ordering such change. No future request for time will be considered.

- B. Each Contract Change shall include all costs required to perform the work including all labor, material, equipment, overheads and profit, delay, disruptions, or other miscellaneous expenses. No subsequent requests for additional compensation including claims for delay, disruption, or reduced efficiency as a result of each change will be considered. Values from the Schedule of Values will not be binding as a basis for additions to or deductions from the contract price.
- C. The amount of any adjustment in this contract price for authorized changes shall be agreed upon before such changes become effective and shall be determined, through submission of a request for proposal, as follows:
  - 1. By an acceptable fixed price proposal from the Contractor. Breakdowns shall include all takeoff sheets of each Contractor and subcontractor. Breakdown shall include a listing of each item of material with unit prices and number of hours of labor for each task. Labor costs per hour shall be included with labor burden identified, which shall be not less than the prevailing wage rate, etc. Overhead and profit shall be shown separately for each subcontractor and the Contractor.
  - 2. By a cost-plus-fixed-fee (time and material) basis with maximum price, total cost not to exceed said maximum. Breakdown shall include a listing of each item of material with unit prices and number of hours of labor for each task. Labor costs per hour shall be included with labor burden identified, which shall be not less than the prevailing wage rate, etc. Overhead and profit shall be shown separately for each subcontractor and the Contractor.
  - 3. By unit prices contained in Contractor's original bid form and incorporated in the construction contract.
- D. Overhead and Profit on Contract Changes shall be applied as follows:

- 1. The overhead and profit charge by the Contractor and all subcontractors shall be considered to include, but is not limited to: incidental job burdens, small truck (under 1 ton) expense, mileage, small hand tools,

warranty costs, company benefits and general office overhead. Project supervision including field supervision and job site office expense shall be considered a part of overhead and profit unless a compensable time extension is granted.

2. The percentages for overhead and profit charged on Contract Changes shall be negotiated, and may vary according to the nature, extent, and complexity of the work involved. However, the overhead and profit for the Contractor or subcontractor actually performing the work shall not exceed 14%. When one or more tiers of subcontractors are used, in no event shall any Contractor or subcontractor receive as overhead and profit more than 3% of the cost of the work performed by any of his subcontractors. In no case shall the total overhead and profit paid by the Owner on any Contract Changes exceed twenty percent (20%) of the cost of materials, labor and equipment (exclusive of Contractor or any Subcontractor overhead and profit) necessary to put the contract change work in place.
  3. The Contractor will be allowed to add the cost of bonding and insurance to their cost of work. This bonding and insurance cost shall not exceed 2% and shall be allowed on the total cost of the added work, including overhead and profit.
  4. On proposals covering both increases and decreases in the amount of this contract, the application of overhead and profit shall be on the net change in the cost of the work.
  5. The percentage for overhead and profit to be credited to the Owner on Contract Changes that are solely decreases in the quantity of work or materials shall be negotiated, and may vary according to the nature, extent and complexity of the work involved, but in no case shall be less than ten percent (10%). If the percentage for overhead and profit charged for work added by Contract Changes for this contract has been negotiated to less than 10%, the negotiated rate shall then apply to credits as well.
- E. No claim for an addition to this contract sum shall be valid unless authorized as aforesaid in writing by the Owner. In the event that none of the foregoing methods are agreed upon, the Owner may order the Contractor to perform work on a time and material basis. The cost of such work shall be determined by the Contractor's actual labor and material cost to perform the work plus overhead and profit as outlined herein. The

Designer and Construction Representative shall approve the Contractor's daily time and material invoices for the work involved.

- F. If the Contractor claims that any instructions involve extra cost under this contract, the Contractor shall give the Owner's Representative written notice thereof within a reasonable time after the receipt of such instructions, and in any event before proceeding to execute the work. No such claim shall be valid unless so made and authorized by the Owner, in writing.
- G. In an emergency affecting the safety of life or of the structure or of adjoining property, the Contractor, without special instruction or authorization from the Construction Representative, is hereby permitted to act at their discretion to prevent such threatened loss or injury. The Contractor shall submit a claim for compensation for such emergency work in writing to the Owner's Representative.

#### **ARTICLE 4.2 – CHANGES IN COMPLETION TIME**

- A. Extension of the number of work days stipulated in the Contract for completion of the work with compensation may be made when:
  1. The contractor documents that proposed Changes in the work, as provided in Article 4.1, extends construction activities critical to contract completion date, OR
  2. The Owner suspends all work for convenience of the Owner as provided in Article 7.3, OR
  3. An Owner caused delay extends construction activities critical to contract completion (except as provided elsewhere in these General Conditions). The Contractor is to review the work activities yet to begin and evaluate the possibility of rescheduling the work to minimize the overall project delay.
- B. Extension of the number of work days stipulated in the Contract for completion of the work without compensation may be made when:
  1. Weather-related delays occur, subject to provisions for the inclusion of a specified number of "bad weather" days when provided for in Section 012100-Allowances, OR
  2. Labor strikes or acts of God occur, OR
  3. The work of the Contractor is delayed on account of conditions which were beyond the control of the Contractor, subcontractors or suppliers, and were not the result of their fault or negligence.
- C. No time extension or compensation will be provided for delays caused by or within the control



of the Contractor, subcontractors or suppliers and for concurrent delays caused by the Owner.

- D. The Contractor shall notify the Owner promptly of any occurrence or conditions which in the Contractor's opinion results in a need for an extension of time. The notice shall be in writing and shall include all necessary supporting materials with details of any resultant costs and be submitted in time to permit full investigation and evaluation of the Contractor's claim. The Owner shall promptly acknowledge the Contractor's notice and, after recommendation from the Owner's Representative and/or Designer, shall provide a decision to the Contractor. Failure on the part of the Contractor to provide such notice and to detail the costs shall constitute a waiver by the Contractor of any claim. Requests for extensions of time shall be for working days only.

## **ARTICLE 5 - CONSTRUCTION AND COMPLETION**

### **ARTICLE 5.1 – CONSTRUCTION COMMENCEMENT**

- A. Upon receipt of the "Intent to Award" letter, the Contractor must submit the following properly executed instruments to the Owner:
1. Contract;
  2. Performance/payment bond as described in Article 6.1;
  3. Certificates of Insurance, or the actual policies themselves, showing that the Contractor has obtained the insurance coverage required by Article 6.2.
  4. Written Affirmative Action Plans as required in Article 1.4.

Above referenced items must be received by the Owner within ten (10) working days after the effective date of the contract. If not received, the Owner may treat the failure to timely submit them as a refusal by the Contractor to accept a contract for this work and may retain as liquidated damages the Contractor's bid bond, cashier's check or certified check as provided in the Instructions to Bidders. Upon receipt the Owner will issue a "Notice to Proceed" with the work to the Contractor.

- B. Within the time frame noted in Section 013200 - Schedules, following receipt of the "Notice to Proceed", the Contractor shall submit to the Owner a progress schedule and schedule of values, showing activities through the end of the contract period. Should the Contractor not receive written notification from the Owner of the disapproval of the schedule of values within fifteen (15) working

days, the Contractor may consider it approved for purpose of determining when the first monthly Application and Certification for Payment may be submitted.

- C. The Contractor may commence work upon receipt of the Division of Facilities Management, Design and Construction's "Notice to Proceed" letter. Contractor shall prosecute the work with faithfulness and energy, and shall complete the entire work on or before the completion time stated in the contract documents or pay to the Owner the damages resulting from the failure to timely complete the work as set out within Article 5.4.

### **ARTICLE 5.2 -- PROJECT CONSTRUCTION**

- A. Each Contractor shall submit for the Owner's approval, in reproducible form, a progress schedule showing the rate of progress and the order of the work proposed to carry on various phases of the project. The schedule shall be in conformance with the requirements outlined in Section 013200 – Schedules.
- B. Contractor shall employ and supply a sufficient force of workers, material, and equipment and shall pay when due, any worker, subcontractor or supplier and otherwise prosecute the work with such diligence so as to maintain the rate of progress indicated on the progress schedule, prevent work stoppage, and insure completion of the project within the time specified.

### **ARTICLE 5.3 -- PROJECT COMPLETION**

- A. Substantial Completion. A Project is substantially complete when construction is essentially complete and work items remaining to be completed can be done without interfering with the Owner's ability to use the Project for its intended purpose.
1. Once the Contractor has reached what they believe is Substantial Completion, the Contractor shall notify the Designer and the Construction Representative of the following:
    - a. That work is essentially complete with the exception of certain listed work items. The list shall be referred to as the "Contractor's Punch."
    - b. That all Operation and Maintenance Manuals have been assembled and submitted in accordance with Article 3.5A.
    - c. That the Work is ready for inspection by the Designer and Construction Representative. The Owner shall be entitled to a minimum of ten working

days notice before the inspection shall be performed.

2. If the work is acceptable, the Owner shall issue a Certificate of Substantial Completion, which shall set forth the responsibilities of the Owner and the Contractor for utilities, security, maintenance, damage to the work and risk of loss. The Certificate shall also identify those remaining items of work to be performed by the Contractor. All such work items shall be complete within 30 working days of the date of the Certificate, unless the Certificate specifies a different time. If the Contractor shall be required to perform tests that must be delayed due to climatic conditions, it is understood that such tests and affected equipment will be identified on the Certificate and shall be accomplished by the Contractor at the earliest possible date. Performance of the tests may not be required before Substantial Completion can be issued. The date of the issuance of the Certificate of Substantial Completion shall determine whether or not the work was completed within the contract time and whether or not Liquidated Damages are due.
  3. If the work is not acceptable, and the Owner does not issue a Certificate of Substantial Completion, the Owner shall be entitled to charge the Contractor with the Designer's and Owner's costs of re-inspection, including time and travel.
- B. Partial Occupancy. Contractor agrees that the Owner shall be permitted to occupy and use any completed or partially completed portions of the Project, when such occupancy and use is in the Owner's best interest. Owner shall notify Contractor of its desire and intention to take Partial Occupancy as soon as possible but at least ten (10) working days before the Owner intends to occupy. If the Contractor believes that the portion of the work the Owner intends to occupy is not ready for occupancy, the Contractor shall notify the Owner immediately. The Designer shall inspect the work in accordance with the procedures above. If the Contractor claims increased cost of the project or delay in completion as a result of the occupancy, he shall notify the Owner immediately but in all cases before occupancy occurs.
- C. Final Completion. The Project is finally complete when the Certificate of Substantial Completion has been issued and all work items identified therein as incomplete have been completed, and when all administrative items required by the contract have been completed. Final Completion entitles the Contractor to payment of the outstanding balance of the contract amount including all change orders

and retainage. Within five (5) working days of the date of the Certificate of Substantial Completion, the Contractor shall identify the cost to complete any outstanding items of work. The Designer shall review the Contractor's estimate and either approve it or provide an independent estimate for all such items. If the Contractor fails to complete the remaining items within the time specified in the Certificate, the Owner may terminate the contract and go to the surety for project completion in accordance with Article 7.2 or release the contract balance to the Contractor less 150% of the approved estimate to complete the outstanding items. Upon completion of the outstanding items, when a final cost has been established, any monies remaining shall be paid to the Contractor. Failure to complete items of work does not relieve the Contractor from the obligation to complete the administrative requirements of the contract, such as the provisions of Article 5.3 FAILURE TO COMPLETE ALL ITEMS OF WORK UNDER THE CONTRACT SHALL BE CONSIDERED A DEFAULT AND BE GROUNDS FOR CONTRACT TERMINATION AND DEBARMENT.

- D. Liquidated Damages. Contractor agrees that the Owner may deduct from the contract price and retain as liquidated damages, and not as penalty or forfeiture, the sum stipulated in this contract for each work day after the Contract Completion Day on which work is not Substantially Complete. Assessment of Liquidated Damages shall not relieve the Contractor or the surety of any responsibility or obligation under the Contract. In addition, the Owner may, without prejudice to any other rights, claims, or remedies the Owner may have including the right to Liquidated Damages, charge the Contractor for all additional expenses incurred by the Owner and/or Designer as the result of the extended contract period through Final Completion. Additional Expenses shall include but not be limited to the costs of additional inspections.
- E. Early Completion. The Contractor has the right to finish the work before the contract completion date; however, the Owner assumes no liability for any hindrances to the Contractor unless Owner caused delays result in a time extension to the contract completion date. The Contractor shall not be entitled to any claims for lost efficiencies or for delay if a Certificate of Substantial Completion is given on or before the Contract Completion Date.

#### **ARTICLE 5.4 -- PAYMENT TO CONTRACTOR**

- A. Payments on account of this contract will be made monthly in proportion to the work which has been completed. Request for payment must be submitted on the Owner's forms. No other pay request will

be processed. Supporting breakdowns must be in the same format as Owner's forms and must provide the same level of detail. The Designer will, within 5 working days from receipt of the contractor's request for payment either issue a Certificate for Payment to the Owner, for such amount as the Designer determines is properly due, or notify the Contractor in writing of reasons for withholding a Certificate. The Owner shall make payment within 30 calendar days after the "Application and Certification for Payment" has been received and certified by the Designer. The following items are to be attached to the contractor's pay request:

1. Updated construction schedule
  2. Certified payrolls consisting of name, occupation and craft, number of hours worked and actual wages paid for each individual employee, of the Contractor and all subcontractors working on the project
- B. The Owner shall retain 5 percent of the amount of each such payment application, except as allowed by Article 5.4, until final completion and acceptance of all work covered by this contract.
- C. Each payment made to Contractor shall be on account of the total amount payable to Contractor and all material and work covered by paid partial payment shall thereupon become the sole property of Owner. This provision shall not be construed as relieving Contractor from sole responsibility for care and protection of materials and work upon which payments have been made or restoration of any damaged work or as a waiver of the right of Owner to require fulfillment of all terms of this contract.
- D. Materials delivered to the work site and not incorporated in the work will be allowed in the Application and Certification for Payment on the basis of one hundred (100%) percent of value, subject to the 5% retainage providing that they are suitably stored on the site or in an approved warehouse in accordance with the following requirements:
1. Material has previously been approved through submittal and acceptance of shop drawings conforming to requirements of Article 3.2 of General Conditions.
  2. Delivery is made in accordance with the time frame on the approved schedule.
  3. Materials, equipment, etc., are properly stored and protected from damage and deterioration and remain so - if not, previously approved amounts will be deleted from subsequent pay applications.

4. The payment request is accompanied by a breakdown identifying the material equipment, etc. in sufficient detail to establish quantity and value.
- E. The Contractor shall be allowed to include in the Application and Certification for Payment, one hundred (100%) of the value, subject to retainage, of major equipment and material stored off the site if all of the following conditions are met:
1. The request for consideration of payment for materials stored off site is made at least 15 working days prior to submittal of the Application for Payment including such material. Only materials inspected will be considered for inclusion on Application for Payment requests.
  2. Materials stored in one location off site are valued in excess of \$25,000.
  3. That a Certificate of Insurance is provided indicating adequate protection from loss, theft conversion or damage for materials stored off site. This Certificate shall show the State of Missouri as an additional insured for this loss.
  4. The materials are stored in a facility approved and inspected, by the Construction Representative.
  5. Contractor shall be responsible for, Owner costs to inspect out of state facilities, and any delays in the completion of the work caused by damage to the material or for any other failure of the Contractor to have access to this material for the execution of the work.
- F. The Owner shall determine the amount, quality and acceptability of the work and materials which are to be paid for under this contract. In the event any questions shall arise between the parties, relative to this contract or specifications, determination or decision of the Owner or the Construction Representative and the Designer shall be a condition precedent to the right of the Contractor to receive any money or payment for work under this contract affected in any manner or to any extent by such question.
- G. Payments Withheld: The Owner may withhold or nullify in whole or part any certificate to such extent as may be necessary to protect the Owner from loss on account of:
1. Defective work not remedied. When a notice of noncompliance is issued on an item or items, corrective action shall be undertaken immediately. Until corrective action is completed, no monies will be paid and no additional time will be allowed for the item or

items. The cost of corrective action(s) shall be borne by the Contractor.

2. A reasonable doubt that this contract can be completed for the unpaid balance.
3. Failure of the Contractor to update as-built drawings monthly for review by the Construction Representative.
4. Failure of the Contractor to update the construction schedule.

When the Construction Representative is satisfied the Contractor has remedied above deficiencies, payment shall be released.

H. Final Payment: Upon receipt of written notice from the Contractor to the Designer and Project Representative that the work is ready for final inspection and acceptance, the Designer and Project Representative, with the Contractor, shall promptly make such inspection. If the work is acceptable and the contract fully performed, the Construction Representative shall complete a final acceptance report and the Contractor will be directed to submit a final Application and Certification for Payment. If the Owner approves the same, the entire balance shall be due and payable, with the exception of deductions as provided for under Article 5.4.

1. Where the specifications provide for the performance by the Contractor of (certain tests for the purpose of balancing and checking the air conditioning and heating equipment and the Contractor shall have furnished and installed all such equipment in accordance with the specifications, but said test cannot then be made because of climatic conditions, such test shall may be considered as required under the provisions of the specifications, Section 013300 and this contract may be substantial Full payment will not be made until the tests have been made and the equipment and system is finally accepted. If the tests are not completed when scheduled, the Owner may deduct 150% of the value of the tests from the final payment.
2. The final payment shall not become due until the Contractor delivers to the Construction Representative:
  - a) A complete file of releases, on the standard form included in the contract documents as "Final Receipt of Payment and Release Form", from subcontractors and material suppliers evidencing payment in full for services, equipment and materials, as the case may require, if the Owner approves, or a consent from

the Surety to final payment accepting liability for any unpaid amounts.

- b) An Affidavit of Compliance with Prevailing Wage Law, in the form as included in this contract specifications, properly executed by each subcontractor, and the Contractor
  - c) Certified copies of all payrolls
  - d) As-built drawings
3. If any claim remains unsatisfied after all payments are made, the Contractor shall refund to the Owner all monies that the latter may be compelled to pay in discharging such a claim including all costs and a reasonable attorney's fee.
  4. Missouri statute requires prompt payment from the Owner to the Contractor within thirty calendar days and from the Contractor to his subcontractors within fifteen calendar days. Failure to make payments within the required time frame entitles the receiving party to charge interest at the rate of one and one half percent per month calculated from the expiration of the statutory time period until paid.
  5. The value of all unused unit price allowances and/or 150% of the value of the outstanding work items, and/or liquidated damages may be deducted from the final pay request without executing a Contract Change. Any unit price items which exceed the number of units in the contract may be added by Contract Change.

## ARTICLE 6 -- INSURANCE AND BONDS

### ARTICLE 6.1 -- BOND

- A. Contractor shall furnish a performance/payment bond in an amount equal to 100% of the contract price to guarantee faithful performance of the contract and 100% of the contract price to guarantee the payment of all persons performing labor on the project and furnishing materials in connection therewith under this contract as set forth in the standard form of performance and payment bond included in the contract documents. The surety on such bond shall be issued by a surety company authorized by the Missouri Department of Insurance to do business in the state of Missouri.
- B. All Performance/Payment Bonds furnished in response to this provision shall be provided by a bonding company with a rating of B+ or higher as established by A.M. Best Company, Inc. in their most recent publication.

**ARTICLE 6.2 – INSURANCE**

- A. The successful Contractor shall procure and maintain for the duration of the contract issued a policy or policies of insurance for the protection of both the Contractor and the Owner and their respective officers, officials, agents, consultants and employees. The Owner requires certification of insurance coverage from the Contractor prior to commencing work.
- B. Minimum Scope and Extent of Coverage
  - 1. General Liability
 

Commercial General Liability, ISO coverage form number or equivalent CG 00 01 ("occurrence" basis), or I-SO coverage form number CG 00 02, or ISO equivalent.

If ISO equivalent or manuscript general liability coverage forms are used, minimum coverage will be as follows: Premises/Operations; Independent Contractors; Products/Completed Operations; personal Injury; Broad Form Property Damage including Completed Operations; Broad Form Contractual Liability Coverage to include Contractor's obligations under Article 1.11 Indemnification and any other Special Hazards required by the work of the contract.
  - 2. Automobile Liability
 

Business Automobile Liability Insurance, ISO Coverage form number or equivalent CA 00 01 covering automobile liability, code 1 "ANY AUTO".
  - 3. Workers' Compensation and Employer's Liability
 

Statutory Workers' Compensation Insurance for Missouri and standard Employer's Liability Insurance, or the authorization to self-insure for such liability from the Missouri Division of Workers' Compensation.
  - 4. Builder's Risk or Installation Floater Insurance
 

Insurance upon the work and all materials, equipment, supplies, temporary structures and similar items which may be incident to the performance of the work and located at or adjacent to the site, against loss or damage from fire and such other casualties as are included in extended coverage in broad "All Risk" form, including coverage for Flood and Earthquake, in an amount not less than the replacement cost of the work or this contract price, whichever is greater, with loss payable to Contractor and Owner as their respective interests may appear.

Contractor shall maintain sufficient insurance to cover the full value of the work and materials as the work progresses, and shall furnish Owner copies of all endorsements. If Builder's Risk Reporting- Form of Endorsement is used, Contractor shall make all reports as required therein so as to keep in force an amount of insurance which will equal the replacement cost of the work, materials, equipment, supplies, temporary structures, and other property covered thereby; and if, as a result of Contractor's failure to make any such report, the amount of insurance so recoverable shall be less than such replacement cost, Contractor's interest in the proceeds of such insurance, if any, shall be subordinated to Owner's interest to the end that Owner may receive full reimbursement for its loss.

- C. Minimum Limits of Insurance
  - 1. General Liability
 

Contractor	
\$2,000,000	combined single limit per occurrence for bodily injury, personal injury, and property damage
\$2,000,000	annual aggregate
  - 2. Automobile Liability
 

\$2,000,000	combined single limit per occurrence for bodily injury and property damage
-------------	--
  - 3. Workers' Compensation and Employers Liability
 

Workers' Compensation limits as required by applicable State Statutes (generally unlimited) and minimum of \$1,000,000 limit per accident for Employer's Liability.

General Liability and Automobile Liability insurance may be arranged under individual policies for the full limits required or by a combination of underlying policies with the balance provided by a form-following Excess or Umbrella Liability policy.
- D. Deductibles and Self-Insured Retentions
 

All deductibles, co-payment clauses, and self-insured retentions must be declared to and approved by the Owner. The Owner reserves the right to request the reduction or elimination of unacceptable deductibles or self-insured retentions, as they would apply to the Owner, and their respective officers, officials, agents, consultants and employees. Alternatively, the Owner may request Contractor to procure a bond guaranteeing

payment of losses and related investigations, claims administration, and defense expenses.

E. Other Insurance Provisions and Requirements

The respective insurance policies and coverage, as specified below, must contain, or be endorsed to contain the following conditions or provisions:

1. General Liability

The Owner, and its respective commissioners, officers, officials, agents, consultants and employees shall be endorsed as additional insured's by ISO form CG 20 26 Additional Insured - Designated Person or Organization. As additional insured's, they shall be covered as to work performed by or on behalf of the Contractor or as to liability which arises out of Contractor's activities or resulting from the performance of services or the delivery of goods called for by the Contract.

Contractor's insurance coverage shall be primary with respect to all additional insured's. Insurance of self-insurance programs maintained by the designated additional -insured's shall be excess of the Contractor's insurance and shall not contribute with it.

Additionally, the Contractor and Contractor's general liability insurer shall agree to waive all rights of subrogation against the Owner and any of their respective officers, officials, agents, consultants or employees for claims, losses, or expenses which arise out of Contractor's activities or result from the performance of services or the delivery of goods called for by the Contract.

Contractor's failure to comply with the terms and conditions of these insurance policies shall not affect or abridge coverage for the Owner, or for any of their officers, officials, agents, consultants or employees.

2. Automobile Insurance

The Owner, and their respective officers, officials, agents, consultants and employees shall be endorsed as additional insured's by ISO form CG 20 26 - Additional Insured Designated Person or Organization. As additional insured's, they shall be covered as to work performed by or on behalf of the Contractor or as to liability which arises out of Contractor's activities or resulting from the performance of services or the delivery of goods called for by the Contract.

Contractor's insurance coverage shall be primary with respect to all additional insured's. Insurance or self-insurance

programs maintained by the designated additional insured's shall be in excess of the Contractor's insurance and shall not contribute with it.

Additionally, the Contractor and Contractor's automobile insurer shall agree to waive all rights of subrogation against the Owner and any of their respective officers, officials, agents, consultants or employees for claims, losses, or expenses which arise out of Contractor's activities or result from the performance of services or the delivery of goods called for by the Contract.

Contractor's failure to comply with the terms and conditions of these insurance policies shall not affect or abridge coverage for the Owner or for any of its officers, officials, agents, consultants or employees.

3. Workers' Compensation/Employer's Liability

Contractor's workers' compensation insurance shall be endorsed with NCCI form WC 00 03 01 A - Alternative Employer Endorsement. The Alternative Employer Endorsement shall designate the Owner as "alternate employers."

4. All Coverages

Each insurance policy required by this section of the Contract shall contain a stipulation, endorsed if necessary, that the Owner will receive a minimum of a thirty (30) calendar day advance notice of any policy cancellation. Ten (10) calendar days advance notice is required for policy cancellation due to non-payment of premium.

F. Insurer Qualifications and Acceptability

Insurance required hereunder shall be issued by an A.M. Best, "B+" rated, Class IX insurance company approved to conduct insurance business in the state of Missouri.

G. Verification of Insurance Coverage

Prior to Owner issuing a Notice to Proceed, the Contractor shall furnish the Owner with Certificate(s) of Insurance and with any applicable original endorsements evidencing the required insurance coverage. The insurance certificates and endorsements are to be signed by a person authorized by that insurer to bind coverage on its behalf. All certificates and endorsements received by the Owner are subject to review and approval by the Owner. The Owner reserves the right to require certified copies of all required policies at any time. If the scope of this contract will exceed one (1) year - or, if any of Contractor's applicable insurance coverage expires prior to completion of the work or services required under this contract -

the Contractor will provide a renewal or replacement certificate before continuing work or services hereunder. If the Contractor fails to provide documentation of required insurance coverage, the Owner may issue a stop work order and no additional contract completion time and/or compensation shall be granted as a result thereof.

## **ARTICLE 7 – SUSPENSION OR TERMINATION OF CONTRACT**

### **ARTICLE 7.1 - FOR SITE CONDITIONS**

When conditions at the site of the proposed work are considered by the Owner to be unsatisfactory for prosecution of the work, the Contractor may be ordered in writing to suspend the work or any part thereof until reasonable conditions exist. When such suspension is not due to fault or negligence of the Contractor, time allowed for completion of such suspended work will be extended by a period of time equal to that lost due to delay occasioned by ordered suspension. This will be a no cost time extension.

### **ARTICLE 7.2 - FOR CAUSE**

#### **A. Termination or Suspension for Cause:**

1. If the Contractor shall file for bankruptcy, or should make a general assignment for the benefit of the creditors, or if a receiver should be appointed on account of insolvency, or if the contractor should persistently or repeatedly refuse or fail to supply enough properly skilled workers or proper materials, or if the contractor should fail to make prompt payment to subcontractors or for material or labor, or persistently disregard laws, ordinances or the instructions of the Owner, or otherwise be guilty of a substantial violation of any provision of this contract, then the Owner may serve notice on the Contractor and the surety setting forth the violations and demanding compliance with this contract. Unless within ten (10) consecutive calendar days after serving such notice, such violations shall cease and satisfactory arrangements for correction be made, the Owner may suspend the Contractor's right to proceed with the work or terminate this contract.
2. In the event the Owner suspends Contractor's right to proceed with the work or terminates the contract, the Owner may demand that the Contractor's surety take over and complete the work on this contract, after the surety submits a written proposal to the Owner and receives written approval and upon the surety's failure or refusal to do so within ten (10) consecutive

calendar days after demand therefore, the Owner may take over the work and prosecute the same to completion by bid or negotiated contract, or the Owner may elect to take possession of and utilize in completing the work such materials, supplies, appliances and plant as may be on the site of the work, and all subcontractors, if the Owner elects, shall be bound to perform their contracts.

- B. The Contractor and its surety shall be and remain liable to the Owner for any excess cost or damages occasioned to the Owner as a result of the actions above set forth.
- C. The Contractor in the event of such suspension or termination shall not be entitled to receive any further payments under this contract until the work is wholly finished. Then if the unpaid balance under this contract shall exceed all expenses of the Owner as certified by the Director, such excess shall be paid to the Contractor; but, if such expenses shall exceed the unpaid balance as certified by the Director, the Contractor and their surety shall be liable for and shall pay the difference and any damages to the Owner.
- D. In exercising Owner's right to secure completion of the work under any of the provisions hereof, the Director shall have the right to exercise Owner's sole discretion as to the manner, methods and reasonableness of costs of completing the work.
- E. The rights of the Owner to suspend or terminate as herein provided shall be cumulative and not exclusive and shall be in addition to any other remedy provided by law.
- F. The Contractor in the event of such suspension or termination may be declared ineligible for Owner contracts for a minimal period of twelve (12) months. Further, no contract will be awarded to any Contractor who lists in their bid form any subcontractor whose prior performance has contributed, as determined by the Owner, to a breach of a contract. In order to be considered for state-awarded contracts after this period, the Contractor/subcontractor will be required to forward acceptance reports to the Owner regarding successful completion of non-state projects during the intervening twelve (12) months from the date of default. No contracts will be awarded to a subcontractor/Contractor until the ability to perform responsibly in the private sector has been proven to the Owner.

### **ARTICLE 7.3 -- FOR CONVENIENCE**

- A. The Owner may terminate or suspend the Contract or any portion of the Work without cause at any time, and at the Owner's convenience. Notification of a termination or suspension shall be in writing

and shall be given to the Contractor and their surety. If the Contract is suspended, the notice will contain the anticipated duration of the suspension or the conditions under which work will be permitted to resume. If appropriate, the Contractor will be requested to demobilize and re-mobilize and will be reimbursed time and costs associated with the suspension.

B. Upon receipt of notification, the Contractor shall:

1. Cease operations when directed.
2. Take actions to protect the work and any stored materials.
3. Place no further subcontracts or orders for material, supplies, services or facilities except as may be necessary to complete the portion of the Contract that has not been terminated. No claim for payment of materials or supplies ordered after the termination date shall be considered.
4. Terminate all existing subcontracts, rentals, material, and equipment orders.

5. Settle all outstanding liabilities arising from termination with subcontractors and suppliers.

6. Transfer title and deliver to the Owner, work in progress, completed work, supplies and other material produced or acquire for the work terminated, and completed or partially completed plans, drawings information and other property that, if the Contract had been completed, would be required to be furnished to the Owner.

C. For termination without cause and at the Owner's convenience, in addition to payment for work completed prior to date of termination, the Contractor may be entitled to payment of other documented costs directly associated with the early termination of the contract. Payment for anticipated profit and unapplied overhead will not be allowed.



**SECTION 007300 - SUPPLEMENTARY CONDITIONS**

**1.0 GENERAL:**

A. These Supplementary General Conditions clarify, add, delete, or otherwise modify standard terms and conditions of DIVISION 0, BIDDING AND CONTRACTING REQUIREMENTS.

**2.0 CONTACTS:**

Designer: Tracie Siebeneck  
State of Missouri, Office of Administration, Division of Facilities Management, Design and Construction  
301 W High St  
Jefferson City  
Telephone: 573-751-7831  
Email: [tracie.siebeneck@oa.mo.gov](mailto:tracie.siebeneck@oa.mo.gov)

Construction Representative: Ken Stevens  
Division of Facilities Management, Design and Construction  
709 Missouri Blvd (Upper Level)  
Jefferson City, MO 65109  
Telephone: 573-526-5768  
Email: [ken.stevens@oa.mo.gov](mailto:ken.stevens@oa.mo.gov)

Project Manager: Shannon Thompson  
Division of Facilities Management, Design and Construction  
301 West High Street, Room 730  
Jefferson City, Missouri 65101  
Telephone: 573-526-3166  
Email: [Shannon.Thompson@oa.mo.gov](mailto:Shannon.Thompson@oa.mo.gov)

Contract Specialist: Mandy Roberson  
Division of Facilities Management, Design and Construction  
301 West High Street, Room 730  
Jefferson City, Missouri 65101  
Telephone: 573-522-0074  
Email: [mandy.roberson@oa.mo.gov](mailto:mandy.roberson@oa.mo.gov)

**3.0 NOTICE: ALL BID MATERIALS ARE DUE AT THE TIME OF BID SUBMITTAL. THERE IS NO SECOND SUBMITTAL FOR THIS PROJECT.**

**4.0 FURNISHING CONSTRUCTION DOCUMENTS:**

- A. The Owner will furnish the Contractor with approximately 5 complete sets of drawings and specifications at no charge.
- B. The Owner will furnish the Contractor with approximately 5 sets of explanatory or change drawings at no charge.
- C. The Contractor may make copies of the documents as needed with no additional cost to the Owner.

**5.0 SAFETY REQUIREMENTS**

Contractor and subcontractors at any tier shall comply with RSMo 292.675 and Article 1.3, E, of Section 007213, General Conditions.

**FOR DESE PROJECTS:**


**9.0 LEAD AND ASBESTOS CERTIFICATION REQUIREMENTS:**

From SECTION 007213 – GENERAL CONDITIONS, Article 5.4.H.2, ADD receipt of Certification from Contractor meeting the requirements set forth in SECTION 013513.16 – SITE SECURITY AND HEALTH REQUIREMENTS, 3.4., NO ASBESTOS AND NO LEAD CERTIFICATION.

# Missouri

## Division of Labor Standards

### WAGE AND HOUR SECTION

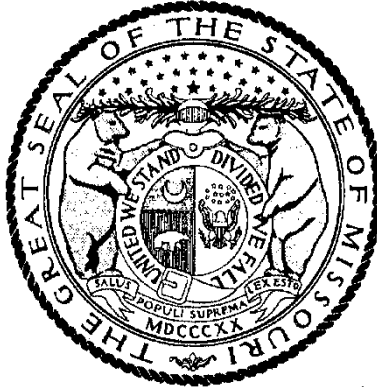

MICHAEL L. PARSON, Governor

# Annual Wage Order No. 29

Section 014  
**CALLAWAY COUNTY**

In accordance with Section 290.262 RSMo 2000, within thirty (30) days after a certified copy of this Annual Wage Order has been filed with the Secretary of State as indicated below, any person who may be affected by this Annual Wage Order may object by filing an objection in triplicate with the Labor and Industrial Relations Commission, P.O. Box 599, Jefferson City, MO 65102-0599. Such objections must set forth in writing the specific grounds of objection. Each objection shall certify that a copy has been furnished to the Division of Labor Standards, P.O. Box 449, Jefferson City, MO 65102-0449 pursuant to 8 CSR 20-5.010(1). A certified copy of the Annual Wage Order has been filed with the Secretary of State of Missouri.

Original Signed by \_\_\_\_\_

Todd Smith, Director  
Division of Labor Standards

Filed With Secretary of State: \_\_\_\_\_ **March 10, 2022**

Last Date Objections May Be Filed: **April 11, 2022**

Prepared by Missouri Department of Labor and Industrial Relations

OCCUPATIONAL TITLE	**Prevailing Hourly Rate
Asbestos Worker	\$65.68
Boilermaker	\$28.75*
Bricklayer	\$51.92
Carpenter	\$53.73
Lather	
Linoleum Layer	
Millwright	
Pile Driver	
Cement Mason	\$28.75*
Plasterer	
Communications Technician	\$54.19
Electrician (Inside Wireman)	\$54.38
Electrician Outside Lineman	\$74.58
Lineman Operator	
Lineman - Tree Trimmer	
Groundman	
Groundman - Tree Trimmer	
Elevator Constructor	\$28.75*
Glazier	\$28.75*
Ironworker	\$28.75*
Laborer	\$42.61
General Laborer	
First Semi-Skilled	
Second Semi-Skilled	
Mason	\$28.75*
Marble Mason	
Marble Finisher	
Terrazzo Worker	
Terrazzo Finisher	
Tile Setter	
Tile Finisher	
Operating Engineer	\$28.75*
Group I	
Group II	
Group III	
Group III-A	
Group IV	
Group V	
Painter	\$28.75*
Plumber	\$74.79
Pipe Fitter	
Roofer	\$51.23
Sheet Metal Worker	\$52.86
Sprinkler Fitter	\$62.60
Truck Driver	\$28.75*
Truck Control Service Driver	
Group I	
Group II	
Group III	
Group IV	

\*The Division of Labor Standards received fewer than 1,000 reportable hours for this occupational title. The public works contracting minimum wage is established for this occupational title using data provided by Missouri Economic Research and Information Center.

\*\*The Prevailing Hourly Rate includes any applicable fringe benefit amounts for each occupational title as defined in Section 290.210 RSMo.

Heavy Construction Rates for  
CALLAWAY County

OCCUPATIONAL TITLE	**Prevailing Hourly Rate
Carpenter	\$28.75*
Millwright	
Pile Driver	
Electrician (Outside Lineman)	\$74.58
Lineman Operator	
Lineman - Tree Trimmer	
Groundman	
Groundman - Tree Trimmer	
Laborer	\$52.70
General Laborer	
Skilled Laborer	
Operating Engineer	\$61.66
Group I	
Group II	
Group III	
Group IV	
Truck Driver	\$28.75*
Truck Control Service Driver	
Group I	
Group II	
Group III	
Group IV	

Use Heavy Construction Rates on Highway and Heavy construction in accordance with the classifications of construction work established in 8 CSR 30-3.040(3).

Use Building Construction Rates on Building construction in accordance with the classifications of construction work established in 8 CSR 30-3.040(2).

If a worker is performing work on a heavy construction project within an occupational title that is not listed on the Heavy Construction Rate Sheet, use the rate for that occupational title as shown on the Building Construction Rate Sheet.

\*The Division of Labor Standards received fewer than 1,000 reportable hours for this occupational title. The public works contracting minimum wage is established for this occupational title using data provided by Missouri Economic Research and Information Center.

\*\*The Prevailing Hourly Rate includes any applicable fringe benefit amounts for each occupational title as defined in Section 290.210 RSMo.

# OVERTIME and HOLIDAYS

## OVERTIME

For all work performed on a Sunday or a holiday, not less than twice (2x) the prevailing hourly rate of wages for work of a similar character in the locality in which the work is performed or the public works contracting minimum wage, whichever is applicable, shall be paid to all workers employed by or on behalf of any public body engaged in the construction of public works, exclusive of maintenance work.

For all overtime work performed, not less than one and one-half (1½) the prevailing hourly rate of wages for work of a similar character in the locality in which the work is performed or the public works contracting minimum wage, whichever is applicable, shall be paid to all workers employed by or on behalf of any public body engaged in the construction of public works, exclusive of maintenance work or contractual obligation. For purposes of this subdivision, "**overtime work**" shall include work that exceeds ten hours in one day and work in excess of forty hours in one calendar week; and

A thirty-minute lunch period on each calendar day shall be allowed for each worker on a public works project, provided that such time shall not be considered as time worked.

## HOLIDAYS

January first;  
The last Monday in May;  
July fourth;  
The first Monday in September;  
November eleventh;  
The fourth Thursday in November; and  
December twenty-fifth;

If any holiday falls on a Sunday, the following Monday shall be considered a holiday.

## **SECTION 011000 – SUMMARY OF WORK**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and Division 1 Specification Sections apply to this Section.

#### **1.2 WORK COVERED BY CONTRACT DOCUMENTS**

- A. The Project consists of replacing fluid cooler and all associated controls.
  - 1. Project Location: 505 East 5<sup>th</sup> Street, Fulton, MO 65251.
  - 2. Owner: State of Missouri, Office of Administration, Division of Facilities Management, Design and Construction, Harry S Truman State Office Building, Post Office Box 809, 301 West High Street, Jefferson City, Missouri 65102.
- B. Contract Documents, dated 3/23/2023 were prepared for the Project by Project Design Unit, Division of Facilities Management, Design and Construction, Harry S. Truman State Office Building Post Office Box 809, 301 West High Street, Jefferson City, Missouri 65102.
- C. The Work consists of removing and replacing a 106 ton fluid cooler for the water source heat pump system in Wheeler Hall.
  - 1. The Work includes removing existing fluid cooler and all associated pipes, power, and controls.
  - 2. The Work includes installing stainless steel fluid cooler, pipes from ground penetration to equipment, variable frequency drive for the fan motor, contactors for the pump motor, and all associated conduit and feeders from tunnel junction box to motors.
  - 3. The Work includes control components including wiring, sensors, and integration into existing building automation system.
- D. The Work will be constructed under a single prime contract.

#### **1.3 WORK SEQUENCE**

- A. The Work will be conducted in one phase.

#### **1.4 CONTRACTOR USE OF PREMISES**

- A. Use of the Site: Limit use of the premises to work in areas indicated. Confine operations to areas within contract limits indicated. Do not disturb portions of the site beyond the areas in which the Work is indicated.
  - 1. Owner Occupancy: Allow for Owner occupancy and use by the public.
  - 2. Driveways and Entrances: Keep driveways and entrances serving the premises clear and available to the Owner, the Owner's employees, and emergency vehicles at all times. Do not use these areas for parking or storage of materials. Schedule deliveries to minimize space and time requirements for storage of materials and equipment on-site.

- B. Use of the Existing Building: Maintain the existing building in a weathertight condition throughout the construction period. Repair damage cause by construction operations. Take all precautions necessary to protect the building and its occupants during the construction period..

## **1.5 OCCUPANCY REQUIREMENTS**

- A. Full Owner Occupancy: The Owner will occupy the site and existing building during the entire construction period. Cooperate with the Owner during construction operations to minimize conflicts and facilitate owner usage. Perform the Work so as not to interfere with the Owner's operations.

## **PART 2 - PRODUCTS (Not Applicable)**

## **PART 3 - EXECUTION (Not Applicable)**

**END OF SECTION 011000**

## **SECTION 012100 – ALLOWANCES**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes administrative and procedural requirements governing allowances.
- B. Types of allowances include the following:
  - 1. Weather allowances.
- C. Related Sections include the following:
  - 1. Division 1 Section "Contract Modification Procedures" for procedures for submitting and handling Change Orders for allowances.

#### **1.3 WEATHER ALLOWANCE**

- A. Included within the completion period for this project are a specified number of “bad weather” days (see Schedule of Allowances).
- B. The Contractor’s progress schedule shall clearly indicate the bad weather day allowance as an “activity” or “activities”. In the event weather conditions preclude performance of critical work activities for 50% or more of the Contractor’s scheduled workday, that day shall be declared unavailable for work due to weather (a “bad weather” day) and charged against the above allowance. Critical work activities will be determined by review of the Contractor’s current progress schedule.
- C. The Contractor’s Representative and the Construction Representative shall agree monthly on the number of “bad weather” days to be charged against the allowance. This determination will be documented in writing and be signed by the Contractor and the Construction Representatives. If there is a failure to agree on all or part of the “bad weather” days for a particular month, that disagreement shall be noted on this written document and signed by each party’s representative. Failure of the Contractor’s representative to sign the “bad weather” day documentation after it is presented, with or without the notes of disagreement, shall constitute agreement with the “bad weather” day determination contained in that document.
- D. There will be no modification to the time of contract performance due solely to the failure to deplete the “bad weather” day allowance.
- E. Once this allowance is depleted, a no cost Change Order time extension will be executed for “bad weather” days, as defined above, encountered during the remainder of the Project.



**PART 2 - PRODUCTS (Not Used)**

**PART 3 - EXECUTION**

**3.1 SCHEDULE OF ALLOWANCES**

- A. Weather Allowance: Included within the completion period for this Project 5 “bad weather” days.

**END OF SECTION 012100**

## **SECTION 012300 - ALTERNATES**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions, Bid Form and other Division 1 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes administrative and procedural requirements governing Alternates.

#### **1.3 DEFINITIONS**

- A. Definition: An alternate is an amount proposed by bidders and stated on the Bid Form for certain work defined in the Bidding Requirements that may be added to the Base Bid amount if the Owner decides to accept a corresponding change in either the amount of construction to be completed, or in the products, materials, equipment, systems, or installation methods described in the Contract Documents..
  - 1. The cost for each alternate is the net addition to the Contract Sum to incorporate the Alternate into the Work. No other adjustments are made to the Contract Sum.
- B. No additional time will be allowed for alternate work unless the number of work days is so stated on the bid form.

#### **1.4 PROCEDURES**

- A. Coordination: Modify or adjust affected adjacent Work as necessary to completely and fully integrate the Alternate Work into the Project.
  - 1. Include as part of each alternate, miscellaneous devices, accessory objects, and similar items incidental to or required for a complete installation whether or not mentioned as part of the Alternate.
- B. Notification: The award of the Contract will indicate whether alternates have been accepted or rejected.
- C. Execute accepted alternates under the same conditions as other Work of this Contract.
- D. Schedule: A "Schedule of Alternates" is included at the end of this Section. Specification Sections referenced in the Schedule contain requirements for materials necessary to achieve the Work described under each alternate.

### **PART 2 - PRODUCTS (Not Applicable)**

### **PART 3 - EXECUTION**

#### **3.1 SCHEDULE OF ALTERNATES**

- A. Alternate No. 1: *Provide fluid cooler FC-1 with type 304 stainless steel, full circuit coil.*

### **END OF SECTION 012300**

## **SECTION 012600 – CONTRACT MODIFICATION PROCEDURES**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section specifies administrative and procedural requirements for handling and processing Contract Modifications.
- B. Related Sections include the following:
  - 1. Division 1, Section 012100 "Allowances" for procedural requirements for handling and processing Allowances.
  - 2. Division 1, Section 013115 "Project Management Communications" for administrative requirements for communications.
  - 3. Division 0, Section 007213, Article 3.1 "Acceptable Substitutions" for administrative procedures for handling Requests for Substitutions made after Contract award.
  - 4. Division 0, Section 007213, Article 4.0 "Changes in the Work" for Change Order requirements.

#### **1.3 REQUESTS FOR INFORMATION**

- A. In the event that the Contractor or Subcontractor, at any tier, determines that some portion of the Drawings, Specifications, or other Contract Documents requires clarification or interpretation, the Contractor shall submit a "Request for Information" (RFI) in writing to the Designer. A RFI may only be submitted by the Contractor and shall only be submitted on the RFI forms provided by the Owner. The Contractor shall clearly and concisely set forth the issue for which clarification or interpretation is sought and why a response is needed. In the RFI, the Contractor shall set forth an interpretation or understanding of the requirement along with reasons why such an understanding was reached.
- B. Responses to RFI shall be issued within ten (10) working days of receipt of the Request from the Contractor unless the Designer determines that a longer time is necessary to provide an adequate response. If a longer time is determined necessary by the Designer, the Designer will, within five (5) working days of receipt of the request, notify the Contractor of the anticipated response time. If the Contractor submits a RFI on a time sensitive activity on the current project schedule, the Contractor shall not be entitled to any time extension due to the time it takes the Designer to respond to the request provided that the Designer responds within the ten (10) working days set forth above.
- C. Responses from the Designer will not change any requirement of the Contract Documents. In the event the Contractor believes that a response to a RFI will cause a change to the requirements of the Contract Document, the Contractor shall give written notice to the Designer requesting a Change Order for the work. Failure to give such written notice within ten (10) working days, shall waive the Contractor's right to seek additional time or cost under Article 4, "Changes in the Work" of the General Conditions.

#### **1.4 MINOR CHANGES IN THE WORK**

- A. Designer will issue supplemental instructions authorizing Minor Changes in the Work, not involving adjustment to the Contract Amount or the Contract Time, on "Designer's Supplemental Instructions" (DSI).

#### **1.5 PROPOSAL REQUESTS**

- A. The Designer or Owner Representative will issue a detailed description of proposed Changes in the Work that may require adjustment to the Contract Amount or the Contract Time. The proposed Change Description will be issued using the "Request for Proposal" (RFP) form. If necessary, the description will include supplemental or revised Drawings and Specifications.
  - 1. Proposal Requests issued by the Designer or Owner Representative are for information only. Do not consider them instructions either to stop work in progress or to execute the proposed change.
  - 2. Within ten (10) working days after receipt of Proposal Request, submit a proposal for the cost adjustments to the Contract Amount and the Contract Time necessary to execute the Change. The Contractor shall submit his proposal on the appropriate Change Order Detailed Breakdown form. Subcontractors may use the appropriate Change Order Detailed Breakdown form or submit their proposal on their letterhead provided the same level of detail is included. All proposals shall include:
    - a. A detailed breakdown of costs per Article 4.1 of the General Conditions.
    - b. If requesting additional time per Article 4.2 of the General Conditions, include an updated Contractor's Construction Schedule that indicates the effect of the Change including, but not limited to, changes in activity duration, start and finish times, and activity relationship.

#### **1.6 CHANGE ORDER PROCEDURES**

- A. On Owner's approval of a Proposal Request, the Designer or Owner Representative will issue a Change Order for signatures of Owner and Contractor on the "Change Order" form.

#### **PART 2 - PRODUCTS (Not Used)**

#### **PART 3 - EXECUTION (Not Used)**

#### **END OF SECTION 012600**

## **SECTION 013100 – COORDINATION**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes administrative provisions for coordinating construction operations on Projects including, but not limited to, the following:
  - 1. Coordination Drawings.
  - 2. Administrative and supervisory personnel.
  - 3. Project meetings.
- B. Each Contractor shall participate in coordination requirements. Certain areas of responsibility will be assigned to a specific Contractor.
- C. Related Sections include the following:
  - 1. Division 1, Section 013200 "Schedules" for preparing and submitting Contractor's Construction Schedule.
  - 2. Articles 1.8.B and 1.8.C of Section 007213 "General Conditions" for coordinating meetings onsite.
  - 3. Article 5.4.H of Section 007213 "General Conditions" for coordinating Closeout of the Contract.

#### **1.3 COORDINATION**

- A. Coordination: Coordinate construction operations included in different Sections of the Specifications to ensure efficient and orderly installation of each part of the Work. Coordinate construction operations included in different Sections, which depend on each other for proper installation, connection, and operation.
- B. Coordination: Each Contractor shall coordinate its construction operations with those of other contractors and entities to ensure efficient and orderly installation of each part of the Work. Each Contractor shall coordinate its operations with operations included in different Sections that depend on each other for proper installation, connection, and operation.
  - 1. Schedule construction operations in sequence required to obtain the best results where installation of one part of the Work depends on installation of other components, before or after its own installation.
  - 2. Coordinate installation of different components with other Contractors to ensure maximum accessibility for required maintenance, service, and repair.
  - 3. Make adequate provisions to accommodate items scheduled for later installation.
  - 4. Where availability of space is limited, coordinate installation of different components to ensure maximum performance and accessibility for required

maintenance, service, and repair of all components including mechanical and electrical.

- C. Prepare memoranda for distribution to each party involved outlining special procedures required for coordination. Include such items as required notices, reports, and list of attendees at meetings.
  - 1. Prepare similar memoranda for Owner and separate Contractors if coordination of their Work is required.
  
- D. Administrative Procedures: Coordinate scheduling and timing of required administrative procedures with other construction activities and activities of other Contractors to avoid conflicts and to ensure orderly progress of the Work. Such administrative activities include, but are not limited to, the following:
  - 1. Preparation of Contractor's Construction Schedule.
  - 2. Preparation of the Schedule of Values.
  - 3. Installation and removal of temporary facilities and controls.
  - 4. Delivery and processing of submittals.
  - 5. Progress meetings.
  - 6. Preinstallation conferences.
  - 7. Startup and adjustment of systems.
  - 8. Project Closeout activities.
  
- E. Conservation: Coordinate construction activities to ensure that operations are carried out with consideration given to conservation of energy, water, and materials.
  - 1. Salvage materials and equipment involved in performance of, but not actually incorporated into, the Work. Refer to other Sections for disposition of salvaged materials that are designated as Owner's property.

#### **1.4 SUBMITTALS**

- A. Coordination Drawings: Prepare Coordination Drawings if limited space availability necessitates maximum utilization of space for efficient installation of different components or if coordination is required for installation of products and materials fabricated by separate entities.
  
- B. Key Personnel Names: Within fifteen (15) work days of starting construction operations, submit a list of key personnel assignments including superintendent and other personnel in attendance at Project site. Identify individuals and their duties and responsibilities; list addresses and telephone numbers including home and office telephone numbers. Provide names, addresses, and telephone numbers of individuals assigned as standbys in the absence of individuals assigned to Project.
  - 1. Post copies of list in Project meeting room, in temporary field office, and by each temporary telephone. Keep list current at all times.

#### **1.5 PROJECT MEETINGS**

- A. The Owner's Construction Representative will schedule a Pre-Construction Meeting prior to beginning of construction. The date, time, and exact place of this meeting will be determined after Contract Award and notification of all interested parties. The

Contractor shall arrange to have the Job Superintendent and all prime Subcontractors present at the meeting. During the Pre-Construction Meeting, the construction procedures and information necessary for submitting payment requests will be discussed and materials distributed along with any other pertinent information.

1. Minutes: Designer will record and distribute meeting minutes.
- B. Progress Meetings: The Owner's Construction Representative will conduct Monthly Progress Meetings as stated in Articles 1.8.B and 1.8.C of Section 007213 "General Conditions".
1. Minutes: Designer will record and distribute to Contractor the meeting minutes.
- C. Preinstallation Conferences: Contractor shall conduct a preinstallation conference at Project site before each construction activity that requires coordination with other construction.
1. Attendees: Installer and representatives of Manufacturers and Fabricators involved in or affected by the installation and its coordination or integration with other materials and installations that have preceded or will follow, shall attend the meeting. Advise Designer and Construction Representative of scheduled meeting dates.
  2. Agenda: Review progress of other construction activities and preparations for the particular activity under consideration including requirements for the following:
    - a. Contract Documents
    - b. Options
    - c. Related RFIs
    - d. Related Change Orders
    - e. Purchases
    - f. Deliveries
    - g. Submittals
    - h. Possible conflicts
    - i. Compatibility problems
    - j. Time schedules
    - k. Weather limitations
    - l. Manufacturer's written recommendations
    - m. Warranty requirements
    - n. Compatibility of materials
    - o. Acceptability of substrates
    - p. Temporary facilities and controls
    - q. Space and access limitations
    - r. Regulations of authorities having jurisdiction
    - s. Testing and inspecting requirements
    - t. Installation procedures

- u. Coordination with other Work
  - v. Required performance results
  - w. Protection of adjacent Work
  - x. Protection of construction and personnel
3. Contractor shall record significant conference discussions, agreements, and disagreements including required corrective measures and actions.
  4. Reporting: Distribute minutes of the meeting to each party present and to parties who should have been present.
  5. Do not proceed with installation if the conference cannot be successfully concluded. Initiate whatever actions are necessary to resolve impediments to performance of the Work and reconvene the conference at earliest feasible date.
  6. Revise paragraph below if Project requires holding progress meetings at different intervals. Insert special intervals such as "every third Tuesday" to suit special circumstances.
  7. Project name
  8. Name and address of Contractor
  9. Name and address of Designer
  10. RFI number including RFIs that were dropped and not submitted
  11. RFI description
  12. Date the RFI was submitted
  13. Date Designer's response was received
  14. Identification of related DSI or Proposal Request, as appropriate

**PART 2 - PRODUCTS (Not Used)**

**PART 3 - EXECUTION (Not Used)**

**END OF SECTION 013100**



## **SECTION 013115 - PROJECT MANAGEMENT COMMUNICATIONS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.
- B. Division 1, Section 013300 - Submittals
- C. Division 1, Section 012600 – Contract Modification Procedures

#### **1.2 SUMMARY**

- A. Project Management Communications: The Contractor shall use the Internet web based project management communications tool, E-Builder® ASP software, and protocols included in that software during this project. The use of project management communications as herein described does not replace or change any contractual responsibilities of the participants.
  - 1. Project management communications is available through E-Builder® as provided by "e-Builder®" in the form and manner required by the Owner.
  - 2. The project communications database is on-line and fully functional. User registration, electronic and computer equipment, and Internet connections are the responsibility of each project participant. The sharing of user accounts is prohibited
- B. Support: E-Builder® will provide on-going support through on-line help files.
- C. Copyrights and Ownership: Nothing in this specification or the subsequent communications supersedes the parties' obligations and rights for copyright or document ownership as established by the Contract Documents. The use of CAD files, processes or design information distributed in this system is intended only for the project specified herein.
- D. Purpose: The intent of using E-Builder® is to improve project work efforts by promoting timely initial communications and responses. Secondly, to reduce the number of paper documents while providing improved record keeping by creation of electronic document files
- E. Authorized Users: Access to the web site will be by individuals who are authorized users.

1. Individuals shall complete the E-Builder New Company/User Request Form located at the following web site: <https://oa.mo.gov/facilities/vendor-links/contractor-forms>. Completed forms shall be emailed to the following email address: [OA.FMDCE-BuilderSupport@oa.mo.gov](mailto:OA.FMDCE-BuilderSupport@oa.mo.gov).
  2. Authorized users will be contacted directly and assigned a temporary user password.
  3. Individuals shall be responsible for the proper use of their passwords and access to data as agents of the company in which they are employed.
- F. Administrative Users: Administrative users have access and control of user licenses and all posted items. DO NOT POST PRIVATE OR YOUR COMPANY CONFIDENTIAL ITEMS IN THE DATABASE! Improper or abusive language toward any party or repeated posting of items intended to deceive or disrupt the work of the project will not be tolerated and will result in deletion of the offensive items and revocation of user license at the sole discretion of the Administrative User(s).
- G. Communications: The use of fax, email and courier communication for this project is discouraged in favor of using E-Builder® to send messages. Communication functions are as follows:
1. Document Integrity and Revisions:
    - a. Documents, comments, drawings and other records posted to the system shall remain for the project record. The authorship time and date shall be recorded for each document submitted to the system. Submitting a new document or record with a unique ID, authorship, and time stamp shall be the method used to make modifications or corrections.
    - b. The system shall make it easy to identify revised or superseded documents and their predecessors.
    - c. Server or Client side software enhancements during the life of the project shall not alter or restrict the content of data published by the system. System upgrades shall not affect access to older documents or software.
  2. Document Security:
    - a. The system shall provide a method for communication of documents. Documents shall allow security group assignment to respect the contractual parties communication except for Administrative Users. DO NOT POST PRIVATE OR YOUR COMPANY CONFIDENTIAL ITEMS IN THE DATABASE!
  3. Document Integration:
    - a. Documents of various types shall be logically related to one another and discoverable. For example, requests for information, daily field reports, supplemental sketches and photographs shall be capable of reference as related records.
  4. Reporting:
    - a. The system shall be capable of generating reports for work in progress, and logs for each document type. Summary reports generated by the system shall be available for team members.

5. Notifications and Distribution:
    - a. Document distribution to project members shall be accomplished both within the extranet system and via email as appropriate. Project document distribution to parties outside of the project communication system shall be accomplished by secure email of outgoing documents and attachments, readable by a standard email client.
  6. Required Document Types:
    - a. RFI, Request for Information.
    - b. Submittals, including record numbering by drawing and specification section.
    - c. Transmittals, including record of documents and materials delivered in hard copy.
    - d. Meeting Minutes.
    - e. Application for Payments (Draft or Pencil).
    - f. Review Comments.
    - g. Field Reports.
    - h. Construction Photographs.
    - i. Drawings.
    - j. Supplemental Sketches.
    - k. Schedules.
    - l. Specifications.
    - m. Request for Proposals
    - n. Designer's Supplemental Instructions
    - o. Punch Lists
- H. Record Keeping: Except for paper documents, which require original signatures and large format documents (greater than 8½ x 11 inches), all other 8½ x 11 inches documents shall be submitted by transmission in electronic form to the E-Builder® web site by licensed users.
- a. The Owner and his representatives, the Designer and his consultants, and the Contractor and his Sub Contractors and suppliers at every tier shall respond to documents received in electronic form on the web site, and consider them as if received in paper document form.
  - b. The Owner and his representatives, the Designer and his consultants, and the Contractor and his Sub Contractors and suppliers at every tier reserves the right to and shall reply or respond by transmissions in electronic form on the web site to documents actually received in paper document form.
  - c. The Owner and his representatives, the Designer and his consultants, and the Contractor and his Sub Contractors and suppliers at every tier reserves the right to and shall copy any paper document into electronic form and make same available on the web site.
- I. Minimum Equipment and Internet Connection: In addition to other requirements specified in this Section, the Owner and his representatives, the Construction Manager and his representatives, the Architect and his consultants, and the Contractor and his

sub-contractors and suppliers at every tier required to have a user license(s) shall be responsible for the following:

1. Providing suitable computer systems for each licensed user at the users normal work location<sup>1</sup> with high-speed Internet access, i.e. DSL, local cable company's Internet connection, or T1 connection.
2. Each of the above referenced computer systems shall have the following minimum system<sup>2</sup> and software requirements:
  - a. Desktop configuration (Laptop configurations are similar and should be equal to or exceed desktop system.)
    - 1) Operating System: Windows XP or newer
    - 2) Internet Browser: Internet Explorer 6.01SP2+ (Recommend IE7.0+)
    - 3) Minimum Recommend Connection Speed: 256K or above
    - 4) Processor Speed: 1 Gigahertz and above
    - 5) RAM: 512 mb
    - 6) Operating system and software shall be properly licensed.
    - 7) Internet Explorer version 7 (current version is a free distribution for download). This specification is not intended to restrict the host server or client computers provided that industry standard HTTP clients may access the published content.
    - 8) Adobe Acrobat Reader (current version is a free distribution for download).
    - 9) Users should have the standard Microsoft Office Suite (current version must be purchased) or the equivalent.

## **PART 2 - PRODUCTS (Not Applicable)**

## **PART 3 - EXECUTION (Not Applicable.)**

## **END OF SECTION 013115**

---

<sup>1</sup> The normal work location is the place where the user is assigned for more than one-half of his time working on this project.

<sup>2</sup> The minimum system herein will not be sufficient for many tasks and may not be able to process all documents and files stored in the E-Builder® Documents area.

## **SECTION 013200 – SCHEDULE – BAR CHART**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes requirements for a Bar Chart Schedule for the project construction activities, schedule of submittals, and schedule for testing.

### **PART 2 - PRODUCTS – (Not Applicable)**

### **PART 3 - EXECUTION**

#### **3.1 SUBMITTAL PROCEDURES**

- A. The Contractor shall submit to the Designer, within ten (10) working days following the Notice to Proceed, a Progress Schedule including Schedule of Values showing the rate of progress the Contractor agrees to maintain and the order in which he proposed to carry out the various phases of Work. No payments shall be made to the Contractor until the Progress Schedule has been approved by the Owner.
  - 1. The Schedule of Values must have the following line items included with the value of the item as indicated below:
    - a. O&M's (Owner's Manual)
      - 1) \$1,000,000.00 (One million) and under – 2% of the total contract amount
      - 2) Over \$1,000,000.00 (One million) – 1% of the total contract amount
    - b. Close Out Documents
      - 1) \$1,000,000.00 (One million) and under – 2% of the total contract amount
      - 2) Over \$1,000,000.00 (One million) – 1% of the total contract amount
    - c. General Conditions
      - 1) No more than 10%
- B. The Contractor shall submit an updated Schedule for presentation at each Monthly Progress Meeting. The Schedule shall be updated by the Contractor as necessary to reflect the current Schedule and its relationship to the original Schedule. The updated Schedule shall reflect any changes in the logic, sequence, durations, or completion date. Payments to the Contractor shall be suspended if the Progress Schedule is not adequately updated to reflect actual conditions.

- C. The Contractor shall submit Progress Schedules to Subcontractors to permit coordinating their Progress Schedules to the general construction Work. The Contractor shall coordinate preparation and processing of Schedules and reports with performance of other construction activities.

### 3.2 CONSTRUCTION PROGRESS SCHEDULE – BAR CHART SCHEDULE

- A. Bar-Chart Schedule: The Contractor shall prepare a comprehensive, fully developed, horizontal bar chart-type Contractor’s Construction Schedule. The Contractor for general construction shall prepare the Construction Schedule for the entire Project. The Schedule shall show the percentage of work to be completed at any time, anticipated monthly payments by Owner, as well as significant dates (such as completion of excavation, concrete foundation work, underground lines, superstructure, rough-ins, enclosure, hanging of fixtures, etc.) which shall serve as check points to determine compliance with the approved Schedule. The Schedule shall also include an activity for the number of “bad” weather days specified in Section 012100 – Allowances.
  - 1. The Contractor shall provide a separate time bar for each significant construction activity. Provide a continuous vertical line to identify the first working day of each week.
    - a. If practical, use the same Schedule of Values breakdown for schedule time bars.
  - 2. The Contractor shall provide a base activity time bar showing duration for each construction activity. Each bar is to indicate start and completion dates for the activity. The Contractor is to place a contrasting bar below each original schedule activity time for indicating actual progress and planned remaining duration for the activity.
  - 3. The Contractor shall prepare the Schedule on a minimal number of separate sheets to readily show the data for the entire construction period.
  - 4. Secure time commitments for performing critical elements of the Work from parties involved. Coordinate each element on schedule with other construction activities. Include minor elements involved in the overall sequence of the Work. Show each activity in proper sequence. Indicate graphically the sequences necessary for completion of related portions of the Work.
  - 5. Coordinate the Contractor’s Construction Schedule with the Schedule of Values, list of subcontracts, Submittal Schedule, progress reports, payment requests, and other required schedules and reports.
  - 6. Indicate the Intent to Award and the Contract Substantial Completion dates on the schedule.
- B. Phasing: Provide notations on the schedule to show how the sequence of the Work is affected by the following:
  - 1. Requirement for Phased completion
  - 2. Work by separate Contractors
  - 3. Work by the Owner
  - 4. Pre-purchased materials
  - 5. Coordination with existing construction
  - 6. Limitations of continued occupancies

7. Un-interruptible services
  8. Partial Occupancy prior to Substantial Completion
  9. Site restrictions
  10. Provisions for future construction
  11. Seasonal variations
  12. Environmental control
- C. Work Stages: Use crosshatched bars to indicate important stages of construction for each major portion of the Work. Such stages include, but are not necessarily limited to, the following:
1. Subcontract awards
  2. Submittals
  3. Purchases
  4. Mockups
  5. Fabrication
  6. Sample testing
  7. Deliveries
  8. Installation
  9. Testing
  10. Adjusting
  11. Curing
  12. Startup and placement into final use and operation
- D. Area Separations: Provide a separate time bar to identify each major area of construction for each major portion of the Work. For the purposes of this Article, a “major area” is a story of construction, a separate building, or a similar significant construction element.
1. Indicate where each construction activity within a major area must be sequenced or integrated with other construction activities to provide for the following:
    - a. Structural completion.
    - b. Permanent space enclosure
    - c. Completion of mechanical installation
    - d. Completion of the electrical portion of the Work
    - e. Substantial Completion

### **3.3 SCHEDULE OF SUBMITTALS**

- A. Upon acceptance of the Construction Progress Schedule, prepare and submit a complete schedule of submittals. Coordinate the submittal schedule with Section 013300 SUBMITTALS, the approved Construction Progress Schedule, list of subcontracts, Schedule of Values and the list of products.
- B. Prepare the schedule in chronological order. Provide the following information

1. Scheduled date for the first submittal
  2. Related Section number
  3. Submittal category
  4. Name of the Subcontractor
  5. Description of the part of the Work covered
  6. Scheduled date for resubmittal
  7. Scheduled date for the Designer's final release or approval
- C. Distribution: Following the Designer's response to the initial submittal schedule, print and distribute copies to the Designer, Owner, subcontractors, and other parties required to comply with submittal dates indicated.
1. Post copies in the Project meeting room and temporary field office.
  2. When revisions are made, distribute to the same parties and post in the same locations. Delete parties from distribution when they have completed their assigned part of the Work and are no longer involved in construction activities.
- D. Schedule Updating: Revise the schedule after each meeting or other activity where revisions have been recognized or made. Issue the updated schedule concurrently with the report of each meeting.

### **3.4 SCHEDULE OF INSPECTIONS AND TESTS**

- A. Prepare a schedule of inspections, tests, and similar services required by the Contract Documents. Submit the schedule with (15) days of the date established for commencement of the Contract Work. The Contractor is to notify the testing agency at least (5) working days in advance of the required tests unless otherwise specified.
- B. Form: This schedule shall be in tabular form and shall include, but not be limited to, the following:
1. Specification Section number
  2. Description of the test
  3. Identification of applicable standards
  4. Identification of test methods
  5. Number of tests required
  6. Time schedule or time span for tests
  7. Entity responsible for performing tests
  8. Requirements for taking samples
  9. Unique characteristics of each service
- C. Distribution: Distribute the schedule to the Owner, Architect, and each party involved in performance of portions of the Work where inspections and tests are required.

**END OF SECTION 013200**



## **SECTION 013300 – SUBMITTALS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.
- B. Division 1, Section 013115 “Project Management Communications” for administrative requirements for communications.

#### **1.2 SUMMARY**

- A. This Section includes administrative and procedural requirements for submittals required for performance of the Work including the following:
  - 1. Shop Drawings
  - 2. Product Data
  - 3. Samples
  - 4. Quality Assurance Submittals
  - 5. Construction Photographs
  - 6. Operating and Maintenance Manuals
  - 7. Warranties
- B. Administrative Submittals: Refer to General and Supplementary Conditions other applicable Division 1 Sections and other Contract Documents for requirements for administrative submittals. Such submittals include, but are not limited to, the following:
  - 1. Construction Progress Schedule including Schedule of Values
  - 2. Performance and Payment Bonds
  - 3. Insurance Certificates
  - 4. Applications for Payment
  - 5. Certified Payroll Reports
  - 6. Partial and Final Receipt of Payment and Release Forms
  - 7. Affidavit – Compliance with Prevailing Wage Law
  - 8. Record Drawings
  - 9. Notifications, Permits, etc.
- C. The Contractor is obliged and responsible to check all shop drawings and schedules to assure compliance with contract plans and specifications. The Contractor is responsible for the content of the shop drawings and coordination with other contract work. Shop drawings and schedules shall indicate, in detail, all parts of an Item or Work including erection and setting instructions and integration with the Work of other trades.
- D. The Contractor shall at all times make a copy, of all approved submittals, available on site to the Construction Representative.

### **1.3 SUBMITTAL PROCEDURES**

- A. The Contractor shall comply with the General and Supplementary Conditions and other applicable sections of the Contract Documents. The Contractor shall submit, with such promptness as to cause no delay in his work or in that of any other contractors, all required submittals indicated in Part 3.1 of this section and elsewhere in the Contract Documents. Coordinate preparation and processing of submittals with performance of construction activities. Transmit each submittal sufficiently in advance of performance of related construction activities to avoid delay.
  - 1. Coordinate each submittal with fabrication, purchasing, testing, delivery, other submittals, and related activities that require sequential activity.
  - 2. Coordinate transmittal of different types of submittals for related elements of the Work so processing will not be delayed by the need to review submittals concurrently for coordination.
    - a. The Designer reserves the right to withhold action on a submittal requiring coordination with other submittals until all related submittals are received.
  
- B. Each drawing and/or series of drawings submitted must be accompanied by a letter of transmittal giving a list of the titles and numbers of the drawings. Each series shall be numbered consecutively for ready reference and each drawing shall be marked with the following information:
  - 1. Date of Submission
  - 2. Name of Project
  - 3. Location
  - 4. Section Number of Specification
  - 5. State Project Number
  - 6. Name of Submitting Contractor
  - 7. Name of Subcontractor
  - 8. Indicate if Item is submitted as specified or as a substitution

### **1.4 SHOP DRAWINGS**

- A. Comply with the General Conditions, Article 3.2.
  
- B. The Contractor shall submit newly prepared information drawn accurately to scale. Highlight, encircle, or otherwise indicate deviations from the Contract Documents. Do not reproduce Contract Documents or copy standard information as the basis of Shop Drawings. Standard information prepared without specific reference to the Project is not a Shop Drawing.
  
- C. Shop Drawings include fabrication and installation drawings, setting diagrams, schedules, patterns, templates, and similar drawings including the following information:
  - 1. Dimensions
  - 2. Identification of products and materials included by sheet and detail number
  - 3. Compliance with specified standards
  - 4. Notation of coordination requirements

5. Notation of dimensions established by field measurement
6. Sheet Size: Except for templates, patterns and similar full-size Drawings, submit Shop Drawings on sheets at least 8½"x11" but no larger than 36"x48".

## **1.5 PRODUCT DATA**

- A. The Contractor shall comply with the General Conditions, Article 3.2.
- B. The Contractor shall collect Product Data into a single submittal for each element of construction or system. Product Data includes printed information, such as manufacturer's installation instructions, catalog cuts, standard color charts, roughing-in diagrams and templates, standard wiring diagrams, and performance curves.
  1. Mark each copy to show applicable choices and options. Where printed Product Data includes information on several products that are not required, mark copies to indicate the applicable information including the following information:
    - a. Manufacturer's printed recommendations
    - b. Compliance with Trade Association standards
    - c. Compliance with recognized Testing Agency standards
    - d. Application of Testing Agency labels and seals
    - e. Notation of dimensions verified by field measurement
    - f. Notation of coordination requirements
  2. Do not submit Product Data until compliance with requirements of the Contract Documents has been confirmed.

## **1.6 SAMPLES**

- A. The Contractor shall comply with the General Conditions, Article 3.2.
- B. The Contractor shall submit full-size, fully fabricated samples, cured and finished as specified, and physically identical with the material or product proposed. Samples include partial sections of manufactured or fabricated components, cuts or containers of materials, color range sets, and swatches showing color, texture, and pattern.
  1. The Contractor shall mount or display samples in the manner to facilitate review of qualities indicated. Prepare samples to match the Designer's sample including the following:
    - a. Specification Section number and reference
    - b. Generic description of the Sample
    - c. Sample source
    - d. Product name or name of the Manufacturer
    - e. Compliance with recognized standards
    - f. Availability and delivery time
  2. The Contractor shall submit samples for review of size, kind, color, pattern, and texture. Submit samples for a final check of these characteristics with other elements and a comparison of these characteristics between the final submittal and the actual component as delivered and installed.

- a. Where variation in color, pattern, texture, or other characteristic is inherent in the material or product represented, submit at least three (3) multiple units that show approximate limits of the variations.
  - b. Refer to other Specification Sections for requirements for samples that illustrate workmanship, fabrication techniques, details of assembly, connections, operation, and similar construction characteristics.
  - c. Refer to other Sections for samples to be returned to the Contractor for incorporation in the Work. Such samples must be undamaged at time of use. On the transmittal, indicate special requests regarding disposition of sample submittals.
  - d. Samples not incorporated into the Work, or otherwise designated as the Owner's property, are the property of the Contractor and shall be removed from the site prior to Substantial Completion.
3. Field samples are full-size examples erected onsite to illustrate finishes, coatings, or finish materials and to establish the Project standard.
- a. The Contractor shall comply with submittal requirements to the fullest extent possible. The Contractor shall process transmittal forms to provide a record of activity.

## **1.7 QUALITY ASSURANCE DOCUMENTS**

- A. The Contractor shall comply with the General Conditions, Article 3.2
- B. The Contractor shall submit quality control submittals including design data, certifications, manufacturer's instructions, manufacturer's field reports, and other quality-control submittals as required under other Sections of the Specifications.
- C. Certifications: Where other Sections of the Specifications require certification that a product, material, or installation complies with specified requirements, submit a notarized certification from the Manufacturer certifying compliance with specified requirements.
  1. Signature: Certification shall be signed by an officer of the Manufacturer or other individual authorized to contractually bind the Company.
- D. Inspection and Test Reports: The Contractor shall submit the required inspection and test reports from independent testing agencies as specified in this Section and in other Sections of the Contract Documents.
- E. Construction Photographs: The Contractor shall submit record construction photographs as specified in this Section and in other Sections of the Contract Documents.
  1. The Contractor shall submit digital photographs. The Construction Administrator shall determine the quantity and naming convention at the preconstruction meeting.
  2. The Contractor shall identify each photograph with project name, location, number, date, time, and orientation.
  3. The Contractor shall submit progress photographs monthly unless specified otherwise. Photographs shall be taken one (1) week prior to submitting.
  4. The Contractor shall take four (4) site photographs from differing directions and a minimum of five (5) interior photographs indicating the relative progress of the Work.

## **1.8 OPERATING AND MAINTENANCE MANUALS AND WARRANTIES**

- A. The Contractor shall submit all required manufacturer's operating instructions, maintenance/service manuals, and warranties in accordance with the General Conditions, Article 3.5, and Supplementary Conditions along with this and other Sections of the Contract Documents.

## **PART 2 - PRODUCTS (Not Applicable)**

## **PART 3 - EXECUTION**

### **3.1 REQUIRED SUBMITTALS**

- A. Contractor shall submit the following information for materials and equipment to be provided under this contract.

**END OF SECTION 013300**

SPEC SECTION	TITLE	CATEGORY
013200	Schedules	Construction Schedule
013200	Schedules	Schedule of Values
013200	Schedules	List of Subcontractors
013200	Schedules	Major Material Suppliers
230523.12	BALL VALVES FOR HVAC PIPING	Product Data
230523.13	BUTTERFLY VALVES FOR HVAC PIPING	Product Data
230529	HANGERS AND SUPPORTS FOR HVAC PIPING AND EQUIPMENT	Shop Drawings
M-101	HVAC PIPING INSULATION	Product Data
236500	COOLING TOWERS	Product Data
236500	COOLING TOWERS	Shop Drawings
236500	COOLING TOWERS	Certification
236500	COOLING TOWERS	Test Report
236500	COOLING TOWERS	Warranty
236500	COOLING TOWERS	Operation / Maintenance Manual
262923	VARIABLE-FREQUENCY MOTOR CONTROLLERS	Product Data
262923	VARIABLE-FREQUENCY MOTOR CONTROLLERS	Shop Drawings
262923	VARIABLE-FREQUENCY MOTOR CONTROLLERS	Warranty
262923	VARIABLE-FREQUENCY MOTOR CONTROLLERS	Operation / Maintenance Manual

## **SECTION 013513.13 – SITE SECURITY AND HEALTH REQUIREMENTS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUBMITTALS**

- A. List of required submittals:
  - 1. Materials Safety Data Sheets for all hazardous materials to be brought onsite.
  - 2. Schedule of proposed shutdowns, if applicable.
  - 3. A list of the names of all employees who will submit fingerprints for a background check, and the signed privacy documents identified below for each employee.
  - 4. “No Asbestos and No Lead” certification.
  - 5. Drug testing program and certification.

### **PART 2 - PRODUCTS (Not Applicable)**

### **PART 3 - EXECUTION**

#### **3.1 ACCESS TO THE SITE**

- A. The Contractor shall arrange with Facility Representatives to establish procedures for the controlled entry of workers and materials into the work areas at the Facility.
- B. The Contractor shall establish regular working hours with Facility Representatives. The Contractor must report changes in working hours or overtime to Facility Representatives and obtain approval twenty-four (24) hours ahead of time. The Contractor shall report emergency overtime to Facility Representatives as soon as it is evident that overtime is needed. The Contractor must obtain approval from Facility Representatives for all work performed after dark.
- C. The Contractor shall provide the name and phone number of the Contractor’s employee or agent who is in charge onsite; this individual must be able to be contacted in case of emergency. The Contractor must be able to furnish names and address of all employees upon request.

#### **3.2 RULES OF THE FACILITY**

- A. No alcohol, drugs, guns, or other weapons are permitted anywhere at the Facility (i.e., inside or outside buildings, or anywhere on school grounds); violators will be referred to local law enforcement for prosecution.
- B. No tobacco or smoking products may be used anywhere at the Facility.

- C. Sexual harassment, offensive or fraternizing behavior, or foul language around or towards students or staff will not be tolerated. Violations by workers will result in one warning from the Facility Representative. Subsequent infractions will require permanent ejection of offending worker(s) from the jobsite, with no change to the contract schedule or additional cost to the State.
- D. The Contractor shall consider the safety of the Facility's students at all times, and shall maintain excavations, scaffolding/ladders, equipment, tools, and materials in as safe a manner as possible during and after working hours.
- E. Vehicles should be locked and parked in areas designated by the Facility Representative.
- F. Neither the Owner nor DESE assumes responsibility for the Contractor's vehicles, equipment, tools, or materials.
- G. The Contractor shall coordinate and communicate planned daily work activities with the Facility Representative at least two (2) working days in advance. This will allow time for the Facility Representative to consider temporarily relocating special education students whose health could be adversely affected by loud noises, chemical odors, temperature extremes, etc.

### **3.3 SECURITY CLEARANCES AND RESTRICTIONS**

#### **A. FMDC CONTRACTOR BACKGROUND AND ID BADGE PROCESS**

1. All employees of an OA/FMDC contractor (or subcontractor performing work under an OA/FMDC contract) are required to submit a fingerprint check through the Missouri State Highway Patrol (MSHP) and the FBI enabling OA/FMDC to obtain state and national criminal background checks on the employees, unless stated otherwise in the Contractor's contract.
2. FMDC reserves the right to prohibit any employee of the Contractor from performing work in or on the premises of any facility owned, operated, or utilized by the State of Missouri for any reason.
3. The Contractor shall ensure all of its employees submit fingerprints to the Missouri State Highway Patrol and pay for the cost of such background checks. The Contractor shall submit to FMDC via email to [FMDCSecurity@oa.mo.gov](mailto:FMDCSecurity@oa.mo.gov) a list of the names of the Contractor's employees who will be fingerprinted and a signed OA/FMDC Authorization for Release of Information Confidentiality Oath for each employee. All employees of the Contractor approved by FMDC to work at a State facility must obtain a contractor ID badge from FMDC prior to beginning work on-site, unless the Director of FMDC, at the Director's discretion, waives the requirement for a contractor ID badge. The Contractor and its employees must comply with the process for background checks and contractor ID badges found on FMDC's website at: <https://oa.mo.gov/facilities/facilities-operations/security-information/fmdc-contractor-background-and-id-badge>
4. Fingerprints and Authorization for Release of Information Confidentiality Oath form are valid for one (1) year and must be renewed annually. Changing or adding locations may result in additional required documentation. Certain employees may be required to be fingerprinted more frequently. OA/FMDC reserves the right to request additional background checks at any time for any reason.



5. The Contractor shall notify FMDC via email to [FMDCSecurity@oa.mo.gov](mailto:FMDCSecurity@oa.mo.gov) within 48 hours of anyone severing employment with their company.

### **3.4 FIRE PROTECTION, SAFETY, AND HEALTH CONTROLS**

- A. The Contractor shall take all necessary precautions to guard against and eliminate possible fire hazards.
  1. Onsite burning is prohibited.
  2. The Contractor shall store all flammable or hazardous materials in proper containers located outside the buildings or offsite, if possible.
  3. The Contractor shall provide and maintain, in good order, during construction fire extinguishers as required by the National Fire Protection Association. In areas of flammable liquids, asphalt, or electrical hazards, 15-pound carbon dioxide or 20-pound dry chemical extinguishers shall be provided.
- B. The Contractor shall not obstruct streets or walks without permission from the Owner's Construction Representative and Facility Representatives.
- C. The Contractor's personnel shall not exceed the speed limit of 15 mph while at the Facility unless otherwise posted.
- D. The Contractor shall take all necessary, reasonable measures to reduce air and water pollution by any material or equipment used during construction. The Contractor shall keep volatile wastes in covered containers, and shall not dispose of volatile wastes or oils in storm or sanitary drains.
- E. The Contractor shall keep the project site neat, orderly, and in a safe condition at all times. The Contractor shall immediately remove all hazardous waste, and shall not allow rubbish to accumulate. The Contractor shall provide onsite containers for collection of rubbish and shall dispose of it at frequent intervals during the progress of the Work.
- F. Fire exits, alarm systems, and sprinkler systems shall remain fully operational at all times, unless written approval is received from the Owner's Construction Representative and the appropriate Facility Representative at least twenty-four (24) hours in advance. The Contractor shall submit a written time schedule for any proposed shutdowns.
- G. For all hazardous materials brought onsite, Material Safety Data Sheets shall be on site and readily available upon request at least a day before delivery.
- H. The Contractor's workers shall not be under the influence of any intoxicating substances while on the Facility premises.

### **3.5 NO ASBESTOS AND NO LEAD CERTIFICATION REQUIREMENTS**

- A. No asbestos containing material (> 1.0% asbestos by dry weight) or lead containing material (> 0.06% or 600ppm/10,000ppm lead by dry weight) shall be included in any project submittals or physically installed during construction work on this project.
- B. USEPA regulations exclude local education agencies (i.e., DESE MSB, MSD, & SSSH) from the requirements of inspection, sampling, and analysis of homogenous areas that have been newly constructed or repaired/replaced in special education school buildings; where

an Architect or Project Engineer responsible for the construction, or an Accredited Inspector, provides a signed statement that no asbestos (or lead) was specified, or used, as a building material (or system component) in any project construction documents, or physically installed as part of the project work. It is recommended that the Contractor research each material/component used on the job to verify that it contains no asbestos or lead (i.e., look at manufacturer's cut-sheet specifications, Material Safety Data Sheets, DOT shipping classification, or even contact the manufacturer for their verification); then, the Contractor should write on each project submittal: "To the best of my knowledge, items covered by this submittal contain no asbestos or lead containing material".

C. Contractor Certification Requirement

1. Prior to final payment, the Contractor shall submit a signed letter on company letterhead certifying that, to the best of its knowledge, no asbestos or lead containing materials were used or installed during the work. The Contractor shall address the letter to the Service Level Manager/ Designated Person for FMDC, at P.O. Box 809, Jefferson City, MO 65102, and (if applicable) to the Architect or Project Engineer. The letter shall reference the Site/Facility Name, Project Number, Project Title, and shall include the following statement:

"The Contractor certifies, to the best of its knowledge, that no asbestos containing material (> 1.0% asbestos by dry weight) or lead containing material (> 0.06% or 600ppm/10,000ppm lead by dry weight) was included in any project submittals or physically installed during construction work on this project. Contractor agrees to pay all costs incurred by the Owner discovering, abating, and/or restoring any component or portion of the work that is later found to include an asbestos or lead containing material in excess of these limitations."

D. Architect or Project Engineer Certification

1. As part of the final as-built/close-out document submittal requirements, it is requested that the Project Architect or Engineer (or Accredited Inspector as a last resort) responsible for design and submittal approval, submit a signed letter on company letterhead that references the Site/Facility Name, Project Number, Project Title, and includes the following statement:

"As the Designer, or Accredited Inspector, I certify, to the best of my knowledge, that no asbestos containing material (> 1.0% asbestos by dry weight) or lead containing material (> 0.06%, or, 600ppm/10,000ppm lead by dry weight) was specified in the construction documents, or approved for installation by the Contractor during construction work, on this project."

**3.6 DRUG & ALCOHOL TESTING PROGRAM CONTRACTUAL REQUIREMENT - (1 CSR 30-7.010)**

**A. BASIS AND LEGAL REQUIREMENTS**

1. In an effort to create safe and healthy schools and workplaces, the State of Missouri requires that Contractors and Subcontractors shall maintain and enforce a written substance abuse testing program for public works construction projects on public and charter elementary and secondary education construction projects that are subject to the control of the State of Missouri. This policy is not intended to be a substitute for the Contractor's or Subcontractor's complete written substance abuse policy. These requirements shall be the minimum requirements for complying with Section 161.371, RSMo, and may be supplemented at the discretion of the Contractor or Subcontractor.

2. The State of Missouri has a vital interest in protecting the safety of students and maintaining safe, healthful, and efficient working conditions for both the state and its' Contractors' and Subcontractors' employees; and has determined that the educational and work environment is safer and more productive without the presence of illegal or inappropriate drugs, alcohol, or other substances in the body or on state property on which any state elementary or secondary school is located or being constructed or improved.
3. The use of illegal drugs, on or off duty, is inconsistent with law-abiding behavior expected of all persons. The use of illegal drugs, or abuse of alcohol or prescription drugs, may impair the ability of employees to perform tasks that are critical to proper work performance. The result is an increase in accidents and failures that pose a serious threat to the safety of all students, employees, visitors and the general public. Impaired employees also tend to be less productive, less reliable and prone to greater absenteeism, resulting in the potential for increased cost and delays in the timely completion of contracts.

## **B. CONTRACTUAL REQUIREMENTS**

1. Each contract entered into for the performance of work on any public and charter elementary or secondary project subject to the control of the State of Missouri shall require that each Contractor and each Subcontractor have in place a drug and alcohol testing program consistent with this rule. These contractual requirements shall apply to Contractor and Subcontractor employees on public and charter elementary and secondary education construction projects that are subject to the control of the State of Missouri, including workers, new hires, replacements, and supervisory personnel. The Contractor and all Subcontractors shall comply with this contractual requirement. The State of Missouri shall determine, in its sole discretion, when this contractual requirement shall be applicable; and in such instances, any bid submitted in response to a request for proposal shall comply with this contractual requirement.
2. In order to be eligible to perform work on public and charter elementary and secondary education construction projects that are subject to the control by the State of Missouri, a Contractor must have and enforce a written drug and alcohol testing program incorporating the following testing requirements, terms and conditions applicable to all its employees, prospective employees and Subcontractors. Neither employee nor prospective employee of a Contractor or Subcontractor shall be permitted to work on public and charter elementary and secondary education construction projects that are subject to this rule unless such employee submits to testing as required by the contractual requirement required by this rule.
3. Each Contractor and Subcontractor subject to this rule shall train its' supervisory employees in methods that will allow them to recognize the signs and symptoms of substance abuse and to take action provided by this contractual requirement in a manner consistent with generally accepted safety training procedures.
4. Each Contractor and Subcontractor subject to this rule is responsible for the cost of developing, implementing, and enforcing its drug and alcohol testing program, including the cost of drug and alcohol testing of its employees provided by the contractual requirement required by this rule.
5. Each Contractor shall furnish a copy of its drug and alcohol testing program and certify that it and its' Subcontractors are in compliance with the provisions of this rule to the State of Missouri at the time it submits a bid for any contract with the State of Missouri for work on public and charter elementary and secondary

education construction projects that are subject to the control of the State of Missouri. Additionally, each Subcontractor shall furnish a copy of its substance abuse testing program to the Contractor prior to commencement of work on public and charter elementary and secondary education construction projects that are subject to this contractual requirement. The Contractor may reject a Subcontractor's program as noncompliant with the contractual requirement required by this rule.

### **C. TESTING REQUIREMENTS**

1. **PRE-ENGAGEMENT TESTING:** Testing for all substances other than alcohol as described in this rule shall be conducted by each Contractor and Subcontractor for its employees or prospective employees within 120 days prior to any employee's appearance on a public and charter elementary and secondary education construction project that is subject to this contractual requirement. Contractors' or Subcontractors' employees that can provide certification of a previous drug test occurring within 120 days or employees that have been subject during the preceding consecutive two (2) years to a random and periodic selection program that meets the standards as set forth in this rule and, if the employee actually has been tested, that indicates a negative result for each of the substances listed herein, may be exempted from pre-engagement testing provided by this rule. If the employee was not employed by the Contractor or Subcontractor that is his or her current employer at the time of the previous test, the employee may be exempted from pre-engagement testing only upon certification of the non-negative test directly from the administrator of the testing program that conducted the previous test.
2. **RANDOM TESTING:** All employees of the Contractor and Subcontractor shall be subject to random testing by the Contractor or Subcontractor. For employees holding a commercial driver license, the annualized drug and alcohol testing rate shall comply with 49 CFR Part 382, as may be amended from time to time and similar applicable regulations of the Federal Highway Administration. All other employees of the Contractor or Subcontractor shall be subject to testing for all substances other than alcohol at the random annualized selection rate of fifty (50) percent of the Contractor's or Subcontractor's employees. Employees selected for random testing shall report in a timely manner to the drug and alcohol testing laboratory or collection site where directed for drug and/or alcohol testing.
3. **PERIODIC TESTING:** All employees working on public and charter elementary and secondary education construction projects that are subject to this rule shall be subject to periodic and random testing for all substances other than alcohol on at least a biannual basis. Employees subject to periodic testing shall report in a timely manner as directed to the drug and alcohol testing laboratory or collection site for drug testing.
4. **REASONABLE SUSPICION TESTING:** All employees of the Contractor and Subcontractor on public and charter elementary and secondary education construction projects that are subject to this rule shall be subject to a drug and alcohol test when an employee is acting in an abnormal manner that leads a supervisory employee of the Contractor or Subcontractor to have reasonable suspicion that the employee is under the influence of alcohol or controlled substances. Reasonable suspicion means suspicion based on specific personal observations by the supervisory employee concerning the appearance, behavior, speech or breath odor of the employee.

5. **POST-ACCIDENT/INCIDENT TESTING:** All employees of Contractors and Subcontractors on public and charter elementary and secondary education construction projects who are subject to this rule shall be subject to a drug and alcohol test following an on-the-job injury requiring medical treatment or following a serious or potentially serious incident, including near misses, during which safety precautions were violated, persons were or could have been injured, unsafe instructions or orders were given, vehicles, equipment, or property was damaged, careless acts were performed, or when prescribed personal protective or safety equipment was not worn. Employees involved or who may have contributed to the incident, shall be subject to a drug and alcohol test. If it is impossible or impractical, because of the physical condition of the person involved in the accident to be subjected to drug and alcohol testing; and if in subsequent medical treatment, that person's blood or other bodily fluid will be drawn, then that blood or other bodily fluids may be analyzed for drugs and alcohol.

#### **D. SUBSTANCE ABUSE TESTING PROTOCOLS**

1. A Contractor or Subcontractor subject to the provisions of this rule shall perform pre-engagement, random, periodic, reasonable suspicion, and post-accident/incident testing in the following manner:
  - a. Drug Testing
    - 1) All urine samples collected under this program shall be analyzed by a laboratory certified by the National Institute on Drug Abuse/Substance Abuse and Mental Health Service Administration of the U.S. Department of Health and Human Services and shall include an initial Enzyme Multiplied Immunoassay Screening Test (EMIT) and, when necessary, confirmed by a Gas Chromatography /Mass Spectrometry (GC/MS) confirmation test. All samples confirmed by the laboratory as non-negative shall be interpreted as positive or negative by a Medical Review Officer licensed by the American Association of Medical Review Officers, American College of Occupational and Environmental Medicine, Medical Review Officer Certification Council, or American Society of Addiction Medicine.
  - b. Alcohol Testing
    - 1) The initial screening tests for alcohol shall be performed by using either a saliva test or a DOT approved breathalyzer.
    - 2) Alcohol confirmatory tests shall be performed by either a blood alcohol test or a DOT approved breathalyzer.
2. Testing for the presence of drugs or alcohol in an employee's system and the handling of test specimens shall be conducted in accordance with guidelines for laboratory testing procedures and chain-of-custody procedures established by the Substance Abuse and Mental Health Service Administration of the U.S. Department of Health and Human Services.
3. The program shall require notification to the employer and employee of the results of any non-negative drug and alcohol test and the Division of Facilities Management, Design and Construction shall be notified of the action taken to protect the safety of students as a result of such positive test, provided that no requirement of individual confidentiality of test results provided by federal law or regulation or state statute shall be violated in providing such notifications.

**E. THRESHOLD LIMITS**

1. All samples collected shall be analyzed by a laboratory certified by the Substance Abuse and Mental Health Service Administration of the U.S. Department of Health and Human Services, and shall include an initial Enzyme Multiplied Immunoassay Screening Test (EMIT) and, when necessary, confirmed by a Gas Chromatography/Mass Spectrometry (GC/MS) Confirmation Test. Said testing must screen, at a minimum, for the substances and levels of such substances provided by 49 CFR Part 40 and for alcohol as provided by 49 CFR Part 382, as may be amended from time to time. The levels that shall be deemed to result in a negative test result shall be defined by 49 CFR Part 40 and 49 CFR Part 382, as may be amended from time to time; provided that if such regulations shall no longer define substances and testing levels in the future, testing as required by this rule shall screen for the following substances that shall not exceed the following levels in order to be deemed a negative test result:

(EMIT) Confirmed Initial Level (ng/ml)	Cut-Off Level (ng/ml)	(GC/MS) Confirmation Test
Drugs tested -----		
*Amphetamines	500	250
Barbiturates	300	200
Benzodiazepines	300	200
Cocaine Metabolite	150	100
Cannabinoids (Marijuana THC)	50	15
Methadone	300	200
Opiates:		
Codeine/Morphine	2000	2000
Heroin Metabolite	10	10
Phencyclidine (PCP)	25	25
Propoxyphene	300	200
Breath/Blood Alcohol Content (BAC)	.04%	.04%
Removal from jobsite (BAC)	.0200-.0399%	.0200%-.0399%

\*Note – includes Amphetamines, Methamphetamines and Ecstasy (MDMA).

**F. REFUSAL TO SUBMIT TO TESTING/CONFIRMED POSITIVE RESULTS**

1. Any employee of a Contractor or Subcontractor performing any duties or work that are subject to this rule who refuses to submit to testing or receives a confirmed positive test result for any of the substances indicated in Section E shall be required to immediately leave the construction site and be prohibited from returning to any construction site subject to control of the State of Missouri until evidence is provided of the completion of the reinstatement procedures as set forth in section G.
2. Determination for Violation of Policy
  - a. A confirmed positive drug or alcohol test.
  - b. Failure to contact the Medical Review Officer as directed.
  - c. Failure to report as directed for random testing.

- d. The use, possession, sale or distribution of alcohol or a controlled illegal or unauthorized substance, or the presence of any employee with such ingested substances for non-medical reasons on a public and charter elementary and secondary education construction project subject to the control of the State of Missouri.
- e. Working, reporting to work, being on a public and charter elementary and secondary education construction project that is subject to the control of the State of Missouri, or in a state or employer owned, leased or rented vehicle, while under the influence of alcohol (0.04% BAC or greater).
- f. Switching, adulterating or attempting to tamper with any sample submitted for drug or alcohol testing or otherwise interfering or attempting to interfere with the testing process.
- g. Refusal to submit a specimen for testing shall be deemed to be a positive test result and shall be subject to the same consequences as specimens tested and confirmed as positive.
- h. The use of a controlled substance by an individual other than the individual for whom the controlled substance was prescribed or the abuse of a controlled substance by the individual for whom it was prescribed.

#### **G. REINSTATEMENT PROCEDURES**

- 1. An employee receiving a confirmed positive test result for any of the substances indicated in Section 5 may return to work on a public and charter elementary and secondary education construction project that is subject to the control of the State of Missouri only after the following conditions have been satisfied:
  - a. Evidence is submitted to the Contractor or Subcontractor that the employee has completed or is actively participating in an approved drug/alcohol assessment, treatment, and/or counseling program. The costs of this assessment, treatment or program need not be borne by the Contractor or Subcontractor.
  - b. Evidence is submitted of the employee passing of a drug and alcohol test that meets the requirements of Sections E and F of this rule. The costs of this subsequent retesting need not be borne by the Contractor or Subcontractor.
  - c. The employee shall be subject to additional random drug and alcohol testing on a monthly basis while on any public and charter elementary and secondary education construction project that is subject to the control of the State of Missouri. The costs of this additional testing, treatment or program need not be borne by the Contractor or Subcontractor.
  - d. An employee known by the Contractor or Subcontractor to have previously had a positive test result who receives a second or subsequent confirmed positive test result in connection with subsequent testing required by this Section H of this rule shall be removed by the Contractor or Subcontractor from all public and charter elementary and secondary education construction projects that are subject to the control of the State of Missouri. The employee shall not return to work on any public and charter elementary and secondary education construction project subject to this rule until that the employee has completed an approved drug/alcohol assessment, treatment, and/or counseling program; and until after evidence is

submitted of the employee passing of a drug and alcohol test that meets the requirements of sections E and F of this rule and that indicates a blood alcohol concentration of less than 0.02 percent.

#### **H. COMPLIANCE DETERMINATION**

1. The State of Missouri may audit any substance abuse testing program implemented pursuant to this contractual requirement to verify compliance, upon at least 24 hours notice by the State to the Contractor of its intent to audit. The State shall have free access to all relevant records of the Contractor and its Subcontractors for this purpose.
2. Any portion of this program that is in violation of applicable federal or state law or regulation shall be deemed unenforceable.

#### **3.7 DISRUPTION OF UTILITIES**

- A. The Contractor shall give a minimum of 72 hours written notice to the Construction Representative and Facility Representative before disconnecting electric, gas, water, fire protection, or sewer service to any building.
- B. The contractor shall give a minimum of 72 hours written notice to the Construction Representative and Facility Representative before closing any access drives and shall make temporary access available if possible. The contractor shall not obstruct streets, walks, or parking.

**END OF SECTION 01 35 13.13**



## **SECTION 015000 – CONSTRUCTION FACILITIES AND TEMPORARY CONTROLS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes requirements for construction facilities and temporary controls including temporary utilities, support facilities, security, and protection.
- B. Temporary utilities include, but are not limited to, the following:
  - 1. Water service and distribution
  - 2. Temporary electric power and light
  - 3. Temporary heat
  - 4. Ventilation
  - 5. Telephone service
  - 6. Sanitary facilities, including drinking water
  - 7. Storm and sanitary sewer
- C. Support facilities include, but are not limited to, the following:
  - 1. Field offices and storage sheds
  - 2. Temporary roads and paving
  - 3. Dewatering facilities and drains
  - 4. Temporary enclosures
  - 5. Hoists and temporary elevator use
  - 6. Temporary project identification signs and bulletin boards
  - 7. Waste disposal services
  - 8. Rodent and pest control
  - 9. Construction aids and miscellaneous services and facilities
- D. Security and protection facilities include, but are not limited to, to following:
  - 1. Temporary fire protection
  - 2. Barricades, warning signs, and lights
  - 3. Sidewalk bridge or enclosure fence for the site
  - 4. Environmental protection

#### **1.3 SUBMITTALS**

- A. Temporary Utilities: Submit reports of tests, inspections, meter readings, and similar procedures performed on temporary utilities.

- B. Implementation and Termination Schedule: Within (15) days of the date established for commencement of the Work, submit a schedule indicating implementation and termination of each temporary utility.

#### **1.4 QUALITY ASSURANCE**

- A. Regulations: Comply with industry standards and applicable laws and regulations including, but not limited to, the following:
  - 1. Building code requirements
  - 2. Health and safety regulations
  - 3. Utility company regulations
  - 4. Police, fire department, and rescue squad rules
  - 5. Environmental protection regulations
- B. Standards: Comply with NFPA 241 “Standard for Safeguarding Construction, Alterations, and Demolition Operations”. ANSI A10 Series standards for “Safety Requirements for Construction and Demolition”, and NECA Electrical Design Library “Temporary Electrical Facilities”.
  - 1. Electrical Service: Comply with NEMA, NECA, and UL standards and regulations for temporary electric service. Install service in compliance with NFPA 70 “National Electric Code”.
- C. Inspections: Arrange for authorities having jurisdiction to inspect and test each temporary utility before use. Obtain required certifications and permits.

#### **1.5 PROJECT CONDITIONS**

- A. Temporary Utilities: Prepare a schedule indicating dates for implementation and termination of each temporary utility. At the earliest feasible time, when acceptable to the Owner, change over from use of temporary service to use of permanent service.
- B. Conditions of Use: Keep temporary services and facilities clean and neat in appearance. Operate in a safe and efficient manner. Relocate temporary services and facilities as the Work progresses. Do not overload facilities or permit them to interfere with progress. Take necessary fire-prevention measures. Do not allow hazardous, dangerous, or unsanitary conditions, or public nuisances to develop or persist onsite.

### **PART 2 - PRODUCTS**

#### **2.1 MATERIALS**

- A. General: Provide new materials. If acceptable to the Designer, the Contractor may use undamaged, previously used materials in serviceable condition. Provide materials suitable for use intended.
- B. Lumber and Plywood: Comply with requirements in Division 6 Section “Rough Carpentry”.
  - 1. For job-built temporary office, shops, and sheds within the construction area, provide UL-labeled, fire-treated lumber and plywood for framing, sheathing, and siding.

2. For signs and directory boards, provide exterior-type, Grade B-B high-density concrete form overlay plywood of sized and thicknesses indicated.
  3. For fences and vision barriers, provide minimum 3/9" (9.5mm) thick exterior plywood.
  4. For safety barriers, sidewalk bridges, and similar uses, provide minimum 5/8" (16mm) thick exterior plywood.
- C. Gypsum Wallboard: Provide gypsum wallboard on interior walls of temporary offices.
- D. Roofing Materials: Provide UL Class A standard-weight asphalt shingles or UL Class C mineral-surfaced roll roofing on roofs of job-built temporary office, shops, and shed.
- E. Paint: Comply with requirements of Division 9 Section "Painting".
1. For job-built temporary offices, shops, sheds, fences, and other exposed lumber and plywood, provide exterior-grade acrylic-latex emulsion over exterior primer.
  2. For sign panels and applying graphics, provide exterior-grade alkyd gloss enamel over exterior primer.
  3. For interior walls of temporary offices, provide two (2) quarts interior latex-flat wall paint.
- F. Tarpaulins: Provide waterproof, fire-resistant, UL-labeled tarpaulins with flame-spread rating of (15) or less. For temporary enclosures, provide translucent, nylon-reinforced laminated polyethylene or polyvinyl chloride, fire-retardant tarpaulins.
- G. Water: Provide potable water approved by local health authorities.
- H. Open-Mesh Fencing: Provide 0.120" (3mm) thick, galvanized 2" (50mm) chainlink fabric fencing 6' (2m) high with galvanized steel pipe posts, 1½" (38mm) ID for line posts and 2½" (64mm) ID for corner posts.

## 2.2 EQUIPMENT

- A. General: Provide new equipment. If acceptable to the Designer, the Contractor may use undamaged, previously used equipment in serviceable condition. Provide equipment suitable for use intended.
- B. Water Hoses: Provide ¾" (19mm), heavy-duty, abrasion-resistant, flexible rubber hoses 100' (30m) long, with pressure rating greater than the maximum pressure of the water distribution system. Provide adjustable shutoff nozzles at hose discharge.
- C. Electrical Outlets: Provide properly configured, NEMA-polarized outlets to prevent insertion of 110 to 120V plugs into higher voltage outlets. Provide receptacle outlets equipped with ground-fault circuit interrupters, reset button, and pilot light for connection of power tools and equipment.
- D. Electrical Power Cords: Provide grounded extension cords. Use hard-service cords where exposed to abrasion and traffic. Provide waterproof connectors to connect separate lengths of electric cords if single lengths will not reach areas where construction activities are in progress. Do not exceed safe length-voltage rating.

- E. Lamps and Light Fixtures: Provide general service incandescent lamps of wattage required for adequate illumination. Provide guard cages or tempered-glass enclosures where exposed to breakage. Provide exterior fixture where exposed to moisture.
- F. Heating Units: Provide temporary heating units that have been tested and labeled by UL, FM, or another recognized trade association related to the type of fuel being consumed.
- G. Temporary Offices: Provide prefabricated or mobile units or similar job-built construction with lockable entrances, operable windows, and serviceable finishes. Provide heated and air-conditioned units on foundations adequate for normal loading.
- H. Temporary Toilet Units: Provide self-contained, single-occupant toilet units of the chemical, aerated re-circulation, or combustion type. Provide units properly vented and fully enclosed with a glass-fiber-reinforced polyester shell or similar nonabsorbent material.
- I. Fire Extinguishers: Provide hand-carried, portable, UL-rated, Class A fire extinguishers for temporary offices and similar spaces. In other locations, provide hand-carried, portable, UL-rated, Class ABC, dry-chemical extinguishers, or a combination of extinguishers of NFPA-recommended classes for the exposures.
  - 1. Comply with NFPA 10 and NFPA 241 for classification, extinguishing agent, and size required by location and class of fire exposure.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Use qualified personnel for installation of temporary facilities. Locate facilities where they will serve the Project adequately and result in minimum interference with performance of the Work. Relocate and modify facilities as required.
- B. Provide each Facility ready for use when needed to avoid delay. Maintain and modify as required. Do not remove until facilities are no longer needed or are replaced by authorized use of completed permanent facilities.

### **3.2 TEMPORARY UTILITY INSTALLATION**

- A. General: Engage the appropriate local utility company to install temporary service or connect to existing service. Where company provides only part of the service, provide the remainder with matching, compatible materials and equipment. Comply with company recommendations.
  - 1. Arrange with company and existing users for a time when service can be interrupted, if necessary, to make connections for temporary services.
  - 2. Provide adequate capacity at each stage of construction. Prior to temporary utility availability, provide trucked-in services.
  - 3. Obtain easements to bring temporary utilities to the site where the Owner's easements cannot be used for that purpose.
  - 4. Use Charges: Cost or use charges for temporary facilities are not chargeable to the Owner or Designer. Neither the Owner nor Designer will accept cost or use charges as a basis of claims for Change Order.

- B. Temporary Water Service: The Owner will provide water for construction purposes from the existing building system. All required temporary extensions shall be provided and removed by the Contractor. Connection points and methods of connection shall be designated and approved by the Construction Representative.
- C. Temporary Electric Power Service: The Owner will provide electric power for construction lighting and power tools. Contractors using such services shall pay all costs of temporary services, circuits, outlet, extensions, etc.
- D. Temporary Heating and Cooling: The normal heating and/or cooling system of the building shall be maintained in operation during the construction. Should the Contractor find it necessary to interrupt the normal HVAC service to spaces, which have not been vacated for construction, such interruptions shall be pre-scheduled with the Construction Representative.
- E. Temporary Toilets: Use of the Owner's existing toilet facilities will be permitted, so long as facilities are cleaned and maintained in a condition acceptable to the Owner. All construction personnel will be allowed access only to those specific facilities designed by the Construction Representative. At substantial completion, restore these facilities to the condition prevalent at the time of initial use.
- F. Drinking-Water Facilities: The Owner will provide drinking water facilities within the building. All construction personnel will be allowed access only to those specific facilities designated by the Construction Representative.
- G. Provide earthen embankments and similar barriers in and around excavations and subgrade construction, sufficient to prevent flooding by runoff of storm water from heavy rains.

### **3.3 SUPPORT FACILITIES INSTALLATION**

- A. General: Locate field offices, storage sheds, and other temporary construction and support facilities for easy access.
  - 1. Maintain support facilities until near Substantial Completion. Remove prior to Substantial Completion. Personnel remaining after Substantial Completion will be permitted to use permanent facilities, under conditions acceptable to the Owner.
- B. Field Offices: Provide insulated, weathertight temporary offices of sufficient size to accommodate required office personnel at the Project site. Keep the office clean and orderly for use for small progress meetings. Furnish and equip office as follows:
  - 1. Furnish with a desk and chairs, a 4-drawer file cabinet, plan table, plan rack, and a 6-shelf bookcase.
  - 2. Equip with a water cooler and private toilet complete with water closet, lavatory, and medicine cabinet unit with a mirror.
- C. Storage Facilities: The Owner will provide storage onsite as designated by the Facility Representative or the Construction Representative. Areas for use by the Contractor for storage will be identified at the Pre-Bid Meeting. The Contractor shall provide his own security as he finds necessary.
- D. Construction Parking: Parking at the site will be provided in the areas designated at the Pre-Construction Meeting.

- E. Collection and Disposal of Waste: Collect waste from construction areas and elsewhere daily. Comply with requirements of NFPA 241 for removal of combustible waste material and debris. Enforce requirements strictly. Do not hold materials more than seven (7) days during normal weather or three (3) days when the temperature is expected to rise above 80°F (27°C). Handle hazardous, dangerous, or unsanitary waste materials separately from other waste by containerizing properly. Dispose of material lawfully.

### **3.4 SECURITY AND PROTECTION FACILITIES INSTALLATION**

- A. Except for use of permanent fire protection as soon as available, do not change over from use of temporary security and protection facilities to permanent facilities until Substantial Completion, or longer, as requested by the Designer.
- B. Barricades, Warning Signs, and Lights: Comply with standards and code requirements for erection of structurally adequate barricades. Paint with appropriate colors, graphics, and warning signs to inform personnel and the public of the hazard being protected against. Where appropriate and needed, provide lighting including flashing red or amber lights.
- C. Environmental Protection: Provide protection, operate temporary facilities, and conduct construction in ways and by methods that comply with environmental regulations and minimize the possibility that air, waterways, and subsoil might be contaminated or polluted or that other undesirable effects might result. Avoid use of tools and equipment that produce harmful noise. Restrict use of noisemaking tools and equipment to hours that will minimize complaints from persons or firms near the site.

### **3.5 OPERATION, TERMINATION AND REMOVAL**

- A. Supervision: Enforce strict discipline in use of temporary facilities. Limit availability of temporary facilities to essential and intended uses to minimize waste and abuse.
- B. Maintenance: Maintain facilities in good operating condition until removal. Protect from damage by freezing temperatures and similar elements.
  - 1. Maintain operation of temporary enclosures, heating, cooling, humidity control, ventilation, and similar facilities on a 24-hour basis where required to achieve indicated results and to avoid possibility of damage.
  - 2. Protection: Prevent water-filled piping from freezing. Maintain markers for underground lines. Protect from damage during excavation operations.
- C. Termination and Removal: Unless the Designer requests that it be maintained longer, remove each temporary facility when the need has ended, when replaced by authorized use of a permanent facility, or no later than Substantial Completion. Complete or, if necessary, restore permanent construction that may have been delayed because of interference with the temporary facility. Repair damaged Work, clean exposed surfaces, and replace construction that cannot be satisfactorily repaired.
  - 1. Materials and facilities that constitute temporary facilities are the Contractor's property. The Owner reserves the right to take possession of project identification signs.
  - 2. At Substantial Completion, clean and renovate permanent facilities used during the construction period including, but not limited to, the following:
    - a. Replace air filters and clean inside of ductwork and housing.

- b. Replace significantly worn parts and parts subject to unusual operating conditions.
- c. Replace lamps burned out or noticeably dimmed by hours of use.

**END OF SECTION 015000**

## **SECTION 017400 – CLEANING**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes administrative and procedural requirements for cleaning during the Project.
- B. Environmental Requirements: Conduct cleaning and waste-disposal operations in compliance with local laws and ordinances. Comply fully with federal and local environmental and anti-pollution regulations.
  - 1. Do not dispose of volatile wastes such as mineral spirits, oil, or paint thinner in storm or sanitary drains.
  - 2. Burning or burying of debris, rubbish, or other waste material on the premises is not permitted.

### **PART 2 - PRODUCTS**

#### **2.1 MATERIALS**

- A. Cleaning Agents: Use cleaning materials and agents recommended by the manufacturer or fabricator for the surface to be cleaned. Do not use cleaning agents that are potentially hazardous to health or property or that might damage finished surfaces.

### **PART 3 - EXECUTION**

#### **3.1 PROGRESS CLEANING**

- A. General
  - 1. Retain all stored items in an orderly arrangement allowing maximum access, not impeding drainage or traffic, and providing the required protection of materials.
  - 2. Do not allow the accumulation of scrap, debris, waste material, and other items not required for construction of this Work.
  - 3. At least twice each month, and more often if necessary, completely remove all scrap, debris, and waste material from the jobsite.
  - 4. Provide adequate storage for all items awaiting removal from the jobsite, observing all requirements for fire protection and protection of the ecology.
- B. Site
  - 1. Daily, inspect the site and pick up all scrap, debris, and waste material. Remove all such items to the place designated for their storage.
  - 2. Weekly, inspect all arrangements of materials stored onsite. Re-stack, tidy, or otherwise service all material arrangements.



3. Maintain the site in a neat and orderly condition at all times.

### **3.2 FINAL CLEANING**

- A. General: Provide final cleaning operations when indicated. Employ experienced workers or professional cleaners for final cleaning. Clean each surface or unit of Work to the condition expected from a commercial building cleaning and maintenance program. Comply with manufacturer's instructions.
- B. Complete the following cleaning operations before requesting inspection for certification of Substantial Completion for the entire Project or a portion of the Project.
  1. Clean the Project Site, yard and grounds, in areas disturbed by construction activities including landscape development areas, of rubbish, waste material, litter, and foreign substances.
  2. Sweep paved areas broom clean. Rake grounds that are neither planted nor paved to a smooth, even-textured surface.
  3. Remove petrochemical spills, stains, and other foreign deposits.
  4. Remove tools, construction equipment, machinery, and surplus material from the site.
  5. Clean exposed exterior and interior hard-surfaced finishes to a dirt-free condition, free of stains, films, and similar foreign substances. Avoid disturbing natural weathering of exterior surfaces. Restore reflective surfaces to their original condition.
  6. Remove labels that are not permanent labels.
  7. Touch up and otherwise repair and restore marred, exposed finishes and surfaces. Replace finishes and surfaces that cannot be satisfactorily repaired or restored or that already show evidence of repair or restoration.
    - a. Do not paint over "UL" and similar labels, including mechanical and electrical nameplates.
  8. Wipe surfaces of mechanical and electrical equipment. Remove excess lubrication, paint and mortar droppings, and other foreign substances.
  9. Leave the Project clean and ready for occupancy.
- C. Removal of Protection: Remove temporary protection and facilities installed during construction to protect previously completed installations during the remainder of the construction period.
- D. Compliances: Comply with governing regulations and safety standards for cleaning operations. Remove waste materials from the site and dispose of lawfully.
  1. Where extra materials of value remain after Final Acceptance by the Owner, they become the Owner's property.

**END OF SECTION 017400**

## **SECTION 017900 - DEMONSTRATION AND TRAINING**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section includes administrative and procedural requirements for instructing Owner's personnel, including the following:
  - 1. Demonstration of operation of systems, subsystems, and equipment.
  - 2. Training in operation and maintenance of systems, subsystems, and equipment.

#### **1.3 INFORMATIONAL SUBMITTALS**

- A. Instruction Program: Submit outline of instructional program for demonstration and training, including a list of training modules and a schedule of proposed dates, times, length of instruction time, and instructors' names for each training module. Include learning objective and outline for each training module.
- B. Attendance Record: For each training module, submit list of participants and length of instruction time.

#### **1.4 QUALITY ASSURANCE**

- A. Instructor Qualifications: A factory-authorized service representative experienced in operation and maintenance procedures and training.
- B. Preinstruction Conference: Conduct conference at Project site to comply with requirements in Section 013100 "Coordination". Review methods and procedures related to demonstration and training including, but not limited to, the following:
  - 1. Inspect and discuss locations and other facilities required for instruction.
  - 2. Review and finalize instruction schedule and verify availability of educational materials, instructors' personnel, audiovisual equipment, and facilities needed to avoid delays.
  - 3. Review required content of instruction.
  - 4. For instruction that must occur outside, review weather and forecasted weather conditions and procedures to follow if conditions are unfavorable.

#### **1.5 COORDINATION**

- A. Coordinate instruction schedule with Owner's operations. Adjust schedule as required to minimize disrupting Owner's operations and to ensure availability of Owner's personnel.

- B. Coordinate instructors, including providing notification of dates, times, length of instruction time, and course content.
- C. Coordinate content of training modules with content of approved emergency, operation, and maintenance manuals. Do not submit instruction program until operation and maintenance data has been reviewed and approved by Engineer.

## **PART 2 - PRODUCTS**

### **2.1 INSTRUCTION PROGRAM**

- A. Program Structure: Develop an instruction program that includes individual training modules for each system and for equipment not part of a system, as required by individual Specification Sections.
- B. Training Modules: Develop a learning objective and teaching outline for each module. Include a description of specific skills and knowledge that participant is expected to master. For each module, include instruction for the following as applicable to the system, equipment, or component:
  - 1. Documentation: Review the following items in detail:
    - a. Emergency manuals.
    - b. Operations manuals.
    - c. Maintenance manuals.
    - d. Project record documents.
    - e. Identification systems.
    - f. Warranties and bonds.
    - g. Maintenance service agreements and similar continuing commitments.
  - 2. Emergencies: Include the following, as applicable:
    - a. Instructions on meaning of warnings, trouble indications, and error messages.
    - b. Instructions on stopping.
    - c. Shutdown instructions for each type of emergency.
    - d. Operating instructions for conditions outside of normal operating limits.
    - e. Sequences for electric or electronic systems.
    - f. Special operating instructions and procedures.
  - 3. Operations: Include the following, as applicable:
    - a. Startup procedures.
    - b. Equipment or system break-in procedures.
    - c. Routine and normal operating instructions.
    - d. Regulation and control procedures.
    - e. Control sequences.
    - f. Safety procedures.
    - g. Instructions on stopping.
    - h. Normal shutdown instructions.
    - i. Operating procedures for emergencies.

- j. Operating procedures for system, subsystem, or equipment failure.
  - k. Seasonal and weekend operating instructions.
  - l. Required sequences for electric or electronic systems.
  - m. Special operating instructions and procedures.
4. Adjustments: Include the following:
- a. Alignments.
  - b. Checking adjustments.
  - c. Noise and vibration adjustments.
  - d. Economy and efficiency adjustments.
5. Troubleshooting: Include the following:
- a. Diagnostic instructions.
  - b. Test and inspection procedures.
6. Maintenance: Include the following:
- a. Inspection procedures.
  - b. Types of cleaning agents to be used and methods of cleaning.
  - c. List of cleaning agents and methods of cleaning detrimental to product.
  - d. Procedures for routine cleaning
  - e. Procedures for preventive maintenance.
  - f. Procedures for routine maintenance.
  - g. Instruction on use of special tools.
7. Repairs: Include the following:
- a. Diagnosis instructions.
  - b. Repair instructions.
  - c. Disassembly; component removal, repair, and replacement; and reassembly instructions.
  - d. Instructions for identifying parts and components.
  - e. Review of spare parts needed for operation and maintenance.

## **PART 3 - EXECUTION**

### **3.1 PREPARATION**

- A. Assemble educational materials necessary for instruction, including documentation and training module. Assemble training modules into a training manual organized in coordination with requirements in Section 007213 "General Conditions".
- B. Set up instructional equipment at instruction location.

### **3.2 INSTRUCTION**

- A. Engage qualified instructors to instruct Owner's personnel to adjust, operate, and maintain systems, subsystems, and equipment not part of a system.

1. Owner will furnish Contractor with names and positions of participants.
- B. Scheduling: Provide instruction at mutually agreed on times. For equipment that requires seasonal operation, provide similar instruction at start of each season.
1. Schedule training with Owner with at least seven days' advance notice.
- C. Training Location and Reference Material: Conduct training on-site in the completed and fully operational facility using the actual equipment in-place. Conduct training using final operation and maintenance data submittals.
- D. Cleanup: Collect used and leftover educational materials and remove from Project site. Remove instructional equipment. Restore systems and equipment to condition existing before initial training use.

**END OF SECTION 017900**

## **SECTION 230523.12 - BALL VALVES FOR HVAC PIPING**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section Includes:
  - 1. Brass ball valves.
  - 2. Bronze ball valves.

#### **1.3 DEFINITIONS**

- A. CWP: Cold working pressure.
- B. SWP: Steam working pressure.

#### **1.4 ACTION SUBMITTALS**

- A. Product Data: For each type of valve.

#### **1.5 DELIVERY, STORAGE, AND HANDLING**

- A. Prepare valves for shipping as follows:
  - 1. Protect internal parts against rust and corrosion.
  - 2. Protect threads, flange faces, and weld ends.
  - 3. Set ball valves open to minimize exposure of functional surfaces.
- B. Use the following precautions during storage:
  - 1. Maintain valve end protection.
  - 2. Store valves indoors and maintain at higher-than-ambient-dew-point temperature. If outdoor storage is necessary, store valves off the ground in watertight enclosures.

## **PART 2 - PRODUCTS**

### **2.1 GENERAL REQUIREMENTS FOR VALVES**

- A. Source Limitations for Valves: Obtain each type of valve from single source from single manufacturer.
- B. ASME Compliance:
  - 1. ASME B1.20.1 for threads for threaded-end valves.
  - 2. ASME B16.1 for flanges on iron valves.
  - 3. ASME B16.5 for flanges on steel valves.
  - 4. ASME B16.10 and ASME B16.34 for ferrous valve dimensions and design criteria.
  - 5. ASME B16.18 for solder-joint connections.
  - 6. ASME B31.1 for power piping valves.
  - 7. ASME B31.9 for building services piping valves.
- C. Bronze valves shall be made with dezincification-resistant materials. Bronze valves made with copper alloy (brass) containing more than 15 percent zinc are not permitted.
- D. Refer to HVAC valve schedule articles for applications of valves.
- E. Valve Pressure-Temperature Ratings: Not less than indicated and as required for system pressures and temperatures.
- F. Valve Sizes: Same as upstream piping unless otherwise indicated.
- G. Valve Actuator Types:
  - 1. Handlever: For quarter-turn valves smaller than NPS 4.
- H. Valves in Insulated Piping:
  - 1. Include 2-inch stem extensions.
  - 2. Extended operating handle of nonthermal-conductive material, and protective sleeves that allow operation of valves without breaking the vapor seals or disturbing insulation.
  - 3. Memory stops that are fully adjustable after insulation is applied.

### **2.2 BRASS BALL VALVES**

- A. Two-Piece Brass Ball Valves with Full Port and Stainless-Steel Trim:
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the
  - 2. following:
    - a. Crane Co.; Crane Valve Group; Crane Valves.
    - b. Crane Co.; Crane Valve Group; Jenkins Valves.
    - c. Flow-Tek, Inc.; a subsidiary of Bray International, Inc.
    - d. Hammond Valve.
    - e. Jamesbury; a subsidiary of Metso Automation.
    - f. Kitz Corporation.
    - g. Marwin Valve; a division of Richards Industries.

- h. Milwaukee Valve Company.
  - i. RuB Inc.
3. Description:
- a. Standard: MSS SP-110.
  - b. SWP Rating: 150 psig.
  - c. CWP Rating: 600 psig.
  - d. Body Design: Two piece.
  - e. Body Material: Forged brass.
  - f. Ends: Flanged, solder joint, or threaded.
  - g. Seats: PTFE or TFE.
  - h. Stem: Stainless steel.
  - i. Ball: Stainless steel, vented.
  - j. Port: Full.

## 2.3 BRONZE BALL VALVES

- A. Two-Piece Bronze Ball Valves with Full Port and Stainless-Steel Trim:
- 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Conbraco Industries, Inc.; Apollo Valves.
    - b. Crane Co.; Crane Valve Group; Crane Valves.
    - c. Hammond Valve.
    - d. Lance Valves; a division of Advanced Thermal Systems, Inc.
    - e. Milwaukee Valve Company.
    - f. NIBCO INC.
    - g. Watts Regulator Co.; a division of Watts Water Technologies, Inc.
  - 2. Description:
    - a. Standard: MSS SP-110.
    - b. SWP Rating: 150 psig.
    - c. CWP Rating: 600 psig.
    - d. Body Design: Two piece.
    - e. Body Material: Bronze.
    - f. Ends: Threaded.
    - g. Seats: PTFE.
    - h. Stem: Stainless steel.
    - i. Ball: Stainless steel, vented.
    - j. Port: Full.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine valve interior for cleanliness, freedom from foreign matter, and corrosion. Remove special packing materials, such as blocks, used to prevent disc movement during shipping and handling.



- B. Operate valves in positions from fully open to fully closed. Examine guides and seats made accessible by such operations.
- C. Examine threads on valve and mating pipe for form and cleanliness.
- D. Examine mating flange faces for conditions that might cause leakage. Check bolting for proper size, length, and material. Verify that gasket is of proper size, that its material composition is suitable for service, and that it is free from defects and damage.
- E. Do not attempt to repair defective valves; replace with new valves.

### **3.2 VALVE INSTALLATION**

- A. Install valves with unions or flanges at each piece of equipment arranged to allow service, maintenance, and equipment removal without system shutdown.
- B. Locate valves for easy access and provide separate support where necessary.
- C. Install valves in horizontal piping with stem at or above center of pipe.
- D. Install valves in position to allow full stem movement.

### **3.3 GENERAL REQUIREMENTS FOR VALVE APPLICATIONS**

- A. If valves with specified SWP classes or CWP ratings are unavailable, the same types of valves with higher SWP classes or CWP ratings may be substituted.
- B. Select valves with the following end connections:
  - 1. For Copper Tubing, NPS 2 and Smaller: Threaded ends except where solder-joint valve-end option is indicated in valve schedules below.
  - 2. For Copper Tubing, NPS 2-1/2 to NPS 4: Flanged ends except where threaded valve-end option is indicated in valve schedules below.

### **3.4 MAKE UP WATER VALVE SCHEDULE**

- A. Pipe NPS 2 and Smaller: Two piece, full port, brass or bronze with stainless-steel trim.
  - 1. Valves may be provided with solder-joint ends instead of threaded ends.

**END OF SECTION 230523.12**

## **SECTION 230523.13 - BUTTERFLY VALVES FOR HVAC PIPING**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section Includes:
  - 1. Iron, single-flange butterfly valves.

#### **1.3 DEFINITIONS**

- A. CWP: Cold working pressure.
- B. EPDM: Ethylene propylene copolymer rubber.
- C. NBR: Acrylonitrile-butadiene, Buna-N, or nitrile rubber.
- D. SWP: Steam working pressure.

#### **1.4 ACTION SUBMITTALS**

- A. Product Data: For each type of valve.

#### **1.5 DELIVERY, STORAGE, AND HANDLING**

- A. Prepare valves for shipping as follows:
  - 1. Protect internal parts against rust and corrosion.
  - 2. Protect threads, flange faces, grooves, and weld ends.
  - 3. Set butterfly valves closed or slightly open.
- B. Use the following precautions during storage:
  - 1. Maintain valve end protection.
  - 2. Store valves indoors and maintain at higher-than-ambient-dew-point temperature. If outdoor storage is necessary, store valves off the ground in watertight enclosures.
- C. Use sling to handle large valves; rig sling to avoid damage to exposed parts. Do not use handwheels or stems as lifting or rigging points.

## **PART 2 - PRODUCTS**

### **2.1 GENERAL REQUIREMENTS FOR VALVES**

- A. Source Limitations for Valves: Obtain each type of valve from single source from single manufacturer.
- B. ASME Compliance:
  - 1. ASME B16.1 for flanges on iron valves.
  - 2. ASME B16.5 for pipe flanges and flanged fittings, NPS 1/2 through NPS 24.
  - 3. ASME B16.10 and ASME B16.34 for ferrous valve dimensions and design criteria.
  - 4. ASME B31.1 for power piping valves.
  - 5. ASME B31.9 for building services piping valves.
- C. AWWA Compliance: Comply with AWWA C606 for grooved-end connections.
- D. Valve Pressure-Temperature Ratings: Not less than indicated and as required for system pressures and temperatures.
- E. Valve Sizes: Same as upstream piping unless otherwise indicated.
- F. Valve Actuator Types:
  - 1. Handlever: For valves NPS 6 and smaller.
- G. Valves in Insulated Piping: With 2-inch stem extensions with extended necks.

### **2.2 IRON, SINGLE-FLANGE BUTTERFLY VALVES**

- A. Iron, Single-Flange Butterfly Valves with Stainless-Steel Disc:
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. ABZ Valve and Controls; a division of ABZ Manufacturing, Inc.
    - b. Bray Controls; a division of Bray International.
    - c. Conbraco Industries, Inc.; Apollo Valves.
    - d. Cooper Cameron Valves; a division of Cooper Cameron Corp.
    - e. Crane Co.; Crane Valve Group; Jenkins Valves.
    - f. Crane Co.; Crane Valve Group; Stockham Division.
    - g. DeZurik Water Controls.
    - h. Hammond Valve.
    - i. Kitz Corporation.
    - j. Milwaukee Valve Company.
    - k. Mueller Steam Specialty; a division of SPX Corporation.
    - l. NIBCO INC.
    - m. Norriseal; a Dover Corporation company.
    - n. Red-White Valve Corporation.
    - o. Spence Strainers International; a division of CIRCOR International.
    - p. Sure Flow Equipment Inc.
    - q. Watts Regulator Co.; a division of Watts Water Technologies, Inc.

2. Description:
  - a. Standard: MSS SP-67, Type I.
  - b. CWP Rating: 150 psig.
  - c. Body Design: Lug type; suitable for bidirectional dead-end service at rated pressure without use of downstream flange.
  - d. Body Material: ASTM A 126, cast iron or ASTM A 536, ductile iron.
  - e. Seat: NBR.
  - f. Stem: One- or two-piece stainless steel.
  - g. Disc: Stainless steel.

## **PART 3 - EXECUTION**

### **3.1 EXAMINATION**

- A. Examine valve interior for cleanliness, freedom from foreign matter, and corrosion. Remove special packing materials, such as blocks, used to prevent disc movement during shipping and handling.
- B. Operate valves in positions from fully open to fully closed. Examine guides and seats made accessible by such operations.
- C. Examine mating flange faces for damage. Check bolting for proper size, length, and material. Verify that gasket is of proper size, that its material composition is suitable for service, and that it is free from defects and damage.
- D. Do not attempt to repair defective valves; replace with new valves.

### **3.2 VALVE INSTALLATION**

- A. Install valves with unions or flanges at each piece of equipment arranged to allow service, maintenance, and equipment removal without system shutdown.
- B. Locate valves for easy access and provide separate support where necessary.
- C. Install valves in horizontal piping with stem at or above center of pipe.
- D. Install valves in position to allow full stem movement.

### **3.3 ADJUSTING**

- A. Adjust or replace valve packing after piping systems have been tested and put into service but before final adjusting and balancing. Replace valves if persistent leaking occurs.

### **3.4 CONDENSER-WATER VALVE SCHEDULE**

- A. Pipe NPS 2-1/2 and Larger:

1. Iron, Single-Flange Butterfly Valves, NPS 2-1/2 to NPS 12: 200 CWP, EPDM or NBR seat, aluminum-bronze or stainless-steel disc.

**END OF SECTION 230523.13**

## **SECTION 230529 - HANGERS AND SUPPORTS FOR HVAC PIPING AND EQUIPMENT**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section Includes:
  - 1. Metal pipe hangers and supports.
  - 2. Metal framing systems.
  - 3. Thermal-hanger shield inserts.
  - 4. Fastener systems.

#### **1.3 DEFINITIONS**

- A. MSS: Manufacturers Standardization Society of the Valve and Fittings Industry Inc.

#### **1.4 PERFORMANCE REQUIREMENTS**

- A. Structural Performance: Hangers and supports for HVAC piping and equipment shall withstand the effects of gravity loads and stresses within limits and under conditions indicated according to ASCE/SEI 7.
  - 1. Design supports for multiple pipes, including pipe stands, capable of supporting combined weight of supported systems, system contents, and test water.

#### **1.5 ACTION SUBMITTALS**

- A. Shop Drawings: Show fabrication and installation details and include calculations for the following; include Product Data for components:
  - 1. Trapeze pipe hangers.
  - 2. Metal framing systems.
  - 3. Pipe stands.

#### **1.6 QUALITY ASSURANCE**

- A. Structural Steel Welding Qualifications: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."

- B. Pipe Welding Qualifications: Qualify procedures and operators according to ASME Boiler and Pressure Vessel Code.

## **PART 2 - PRODUCTS**

### **2.1 METAL PIPE HANGERS AND SUPPORTS**

#### A. Carbon-Steel Pipe Hangers and Supports:

1. Description: MSS SP-58, Types 1 through 58, factory-fabricated components.
2. Galvanized Metallic Coatings: hot dipped.
3. Nonmetallic Coatings: Plastic coating, jacket, or liner.
4. Padded Hangers: Hanger with fiberglass or other pipe insulation pad or cushion to support bearing surface of piping.
5. Hanger Rods: Continuous-thread rod, nuts, and washer made of carbon steel or stainless steel.

#### B. Stainless-Steel Pipe Hangers and Supports:

1. Description: MSS SP-58, Types 1 through 58, factory-fabricated components.
2. Padded Hangers: Hanger with fiberglass or other pipe insulation pad or cushion to support bearing surface of piping.
3. Hanger Rods: Continuous-thread rod, nuts, and washer made of stainless steel.

### **2.2 METAL FRAMING SYSTEMS**

#### A. MFMA Manufacturer Metal Framing Systems:

1. Description: Shop- or field-fabricated pipe-support assembly for supporting multiple parallel pipes.
2. Standard: MFMA-4.
3. Channels: Continuous slotted steel channel with inturned lips.
4. Channel Nuts: Formed or stamped steel nuts or other devices designed to fit into channel slot and, when tightened, prevent slipping along channel.
5. Hanger Rods: Continuous-thread rod, nuts, and washer made of carbon steel or stainless steel.
6. Metallic Coating: Hot-dipped galvanized per ASTM A123 or A153.
7. Paint Coating: Rust inhibiting thermoset acrylic enamel.

### **2.3 THERMAL-HANGER SHIELD INSERTS**

- A. Insulation-Insert Material for Cold Piping: ASTM C 552, Type II cellular glass with 100-psig or ASTM C 591, Type VI, Grade 1 polyisocyanurate with 125-psig minimum compressive strength and vapor barrier.
- B. For Trapeze or Clamped Systems: Insert and shield shall cover entire circumference of pipe.
- C. For Clevis or Band Hangers: Insert and shield shall cover lower 180 degrees of pipe.

- D. Insert Length: Extend 2 inches beyond sheet metal shield for piping operating below ambient air temperature.

## **2.4 FASTENER SYSTEMS**

- A. Powder-Actuated Fasteners: Threaded-steel stud, for use in hardened portland cement concrete with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.
- B. Mechanical-Expansion Anchors: Insert-wedge-type, [**zinc-coated**] [**stainless-**] steel anchors, for use in hardened portland cement concrete; with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.

## **2.5 MISCELLANEOUS MATERIALS**

- A. Structural Steel: ASTM A 36/A 36M, carbon-steel plates, shapes, and bars; black and galvanized.
- B. Grout: ASTM C 1107, factory-mixed and -packaged, dry, hydraulic-cement, nonshrink and nonmetallic grout; suitable for interior and exterior applications.
  - 1. Properties: Nonstaining, noncorrosive, and nongaseous.
  - 2. Design Mix: 5000-psi, 28-day compressive strength.

# **PART 3 - EXECUTION**

## **3.1 HANGER AND SUPPORT INSTALLATION**

- A. Metal Pipe-Hanger Installation: Comply with MSS SP-69 and MSS SP-89. Install hangers, supports, clamps, and attachments as required to properly support piping from concrete equipment pad.
- B. Metal Framing System Installation: Arrange for grouping of parallel runs of piping, and support together on field-assembled metal framing systems.
- C. Thermal-Hanger Shield Installation: Install in pipe hanger or shield for insulated piping.
- D. Fastener System Installation:
  - 1. Install powder-actuated fasteners for use in lightweight concrete or concrete slabs less than 4 inches thick in concrete after concrete is placed and completely cured. Use operators that are licensed by powder-actuated tool manufacturer. Install fasteners according to powder-actuated tool manufacturer's operating manual.
  - 2. Install mechanical-expansion anchors in concrete after concrete is placed and completely cured. Install fasteners according to manufacturer's written instructions.
- E. Install hangers and supports complete with necessary attachments, inserts, bolts, rods, nuts, washers, and other accessories.



- F. Install hangers and supports to allow controlled thermal movement of piping systems, to permit freedom of movement between pipe anchors, and to facilitate action of expansion joints, expansion loops, expansion bends, and similar units.
- G. Install lateral bracing with pipe hangers and supports to prevent swaying.
- H. Load Distribution: Install hangers and supports so that piping live and dead loads and stresses from movement will not be transmitted to connected equipment.
- I. Pipe Slopes: Install hangers and supports to provide indicated pipe slopes and to not exceed maximum pipe deflections allowed by ASME B31.9 for building services piping.
- J. Insulated Piping:
  - 1. Attach clamps and spacers to piping.
    - a. Piping Operating above Ambient Air Temperature: Clamp may project through insulation.
    - b. Piping Operating below Ambient Air Temperature: Use thermal-hanger shield insert with clamp sized to match OD of insert.
    - c. Do not exceed pipe stress limits allowed by ASME B31.9 for building services piping.
  - 2. Install MSS SP-58, Type 40, protective shields on cold piping with vapor barrier. Shields shall span an arc of 180 degrees.
    - a. Option: Thermal-hanger shield inserts may be used. Include steel weight-distribution plate for pipe NPS 4 and larger if pipe is installed on rollers.
  - 3. Shield Dimensions for Pipe: Not less than the following:
    - a. NPS 1/4 to NPS 3-1/2: 12 inches long and 0.048 inch thick.
    - b. NPS 4: 12 inches long and 0.06 inch thick.
  - 4. Thermal-Hanger Shields: Install with insulation same thickness as piping insulation.

### **3.2 METAL FABRICATIONS**

- A. Cut, drill, and fit miscellaneous metal fabrications for pipe hangers.
- B. Fit exposed connections together to form hairline joints. Field weld connections that cannot be shop welded or joined with brackets because of shipping size limitations.
- C. Field Welding: Comply with AWS D1.1/D1.1M procedures for shielded, metal arc welding; appearance and quality of welds; and methods used in correcting welding work; and with the following:
  - 1. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals.
  - 2. Obtain fusion without undercut or overlap.
  - 3. Remove welding flux immediately.

4. Finish welds at exposed connections so no roughness shows after finishing and so contours of welded surfaces match adjacent contours.

### **3.3 ADJUSTING**

- A. Hanger Adjustments: Adjust hangers to distribute loads equally on attachments and to achieve indicated slope of pipe.
- B. Trim excess length of continuous-thread hanger and support rods to 1-1/2 inches.

### **3.4 PAINTING**

- A. Touchup: Clean field welds and abraded areas of shop paint. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting. Comply with SSPC-PA 1 requirements for touching up field-painted surfaces.
  1. Apply paint by brush or spray to provide a minimum dry film thickness of 2.0 mils.
- B. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A 780.

### **3.5 HANGER AND SUPPORT SCHEDULE**

- A. Comply with MSS SP-69 for pipe-hanger selections and applications that are not specified in piping system Sections.
- B. Use hangers and supports with galvanized metallic coatings for piping and equipment that will not have field-applied finish.
- C. Use nonmetallic coatings on attachments for electrolytic protection where attachments are in direct contact with copper tubing.
- D. Use padded hangers for piping that is subject to scratching.
- E. Use thermal-hanger shield inserts for insulated piping and tubing.
- F. Saddles and Shields: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
  1. Steel-Pipe-Covering Protection Saddles (MSS Type 39): To fill interior voids with insulation that matches adjoining insulation.
  2. Protection Shields (MSS Type 40): Of length recommended in writing by manufacturer to prevent crushing insulation.
  3. Thermal-Hanger Shield Inserts: For supporting insulated pipe.
- G. Comply with MFMA-103 for metal framing system selections and applications that are not specified in piping system Sections.

- H. Use powder-actuated fasteners or mechanical-expansion anchors where required in concrete construction.

**END OF SECTION 230529**

## **SECTION 232113 - HYDRONIC PIPING**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section includes pipe and fitting materials and joining methods for the following:
  - 1. Condenser-water piping.
  - 2. Makeup-water piping.
  - 3. Blowdown-drain piping.
  - 4. Air-Control Devices

### **PART 2 - PRODUCTS**

#### **2.1 COPPER TUBE AND FITTINGS**

- A. Drawn-Temper Copper Tubing: ASTM B 88, Type M.
- B. Wrought-Copper Unions: ASME B16.22.

#### **2.2 PLASTIC PIPE AND FITTINGS**

- A. PVC Plastic Pipe: ASTM D 1785, with wall thickness as indicated in "Piping Applications" Article.
  - 1. PVC Plastic Pipe Fittings: Socket-type pipe fittings, ASTM D 2466 for Schedule 40 pipe; ASTM D 2467 for Schedule 80 pipe.

#### **2.3 JOINING MATERIALS**

- A. Pipe-Flange Gasket Materials: Suitable for chemical and thermal conditions of piping system contents.
  - 1. ASME B16.21, nonmetallic, flat, asbestos free, 1/8-inch maximum thickness unless otherwise indicated.
    - a. Full-Face Type: For flat-face, Class 125, cast-iron and cast-bronze flanges.
    - b. Narrow-Face Type: For raised-face, Class 250, cast-iron and steel flanges.

- B. Flange Bolts and Nuts: ASME B18.2.1, carbon steel, unless otherwise indicated.
- C. Plastic, Pipe-Flange Gasket, Bolts, and Nuts: Type and material recommended by piping system manufacturer unless otherwise indicated.
- D. Solder Filler Metals: ASTM B 32, lead-free alloys. Include water-flushable flux according to ASTM B 813.
- E. Brazing Filler Metals: AWS A5.8/A5.8M, BCuP Series, copper-phosphorus alloys for joining copper with copper; or BAg-1, silver alloy for joining copper with bronze or steel.
- F. Solvent Cements for Joining Plastic Piping:
  - 1. PVC Piping: ASTM D 2564. Include primer according to ASTM F 656.
    - a. PVC solvent cement shall have a VOC content of 510 g/L or less.
    - b. Adhesive primer shall have a VOC content of 550 g/L or less.
    - c. Solvent cement and adhesive primer shall comply with the testing and product requirements of the California Department of Public Health's (formerly, the California Health Services') "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers."
- G. Gasket Material: Thickness, material, and type suitable for fluid to be handled and working temperatures and pressures.

## 2.4 TRANSITION FITTINGS

- A. Plastic-to-Metal Transition Fittings:
  - 1. One-piece fitting with one threaded brass or copper insert and one solvent-cement-joint end of material and wall thickness to match plastic pipe material.
- B. Plastic-to-Metal Transition Unions:
  - 1. Brass or copper end, solvent-cement-joint end of material and wall thickness to match plastic pipe material, rubber gasket, and threaded union.

## 2.5 DIELECTRIC FITTINGS

- A. General Requirements: Assembly of copper alloy and ferrous materials with separating nonconductive insulating material. Include end connections compatible with pipes to be joined.
- B. Dielectric Unions:
  - 1. Description:
    - a. Standard: ASSE 1079.
    - b. End Connections: Solder-joint copper alloy and threaded ferrous.

## **2.6 AIR-CONTROL DEVICES**

- A. Automatic Air Vents:
  - 1. Body: Bronze or cast iron.
  - 2. Internal Parts: Nonferrous.
  - 3. Operator: Noncorrosive metal float.
  - 4. Inlet Connection: NPS 1/2.
  - 5. Discharge Connection: NPS 1/4.
  - 6. CWP Rating: 150 psig.
  
- B. Maximum Operating Temperature: 240 deg F.

## **PART 3 - EXECUTION**

### **3.1 PIPING APPLICATIONS**

- A. Condenser-water piping, aboveground, NPS 2-1/2 and larger, shall be the following:
  - 1. Schedule 40 PVC plastic pipe and fittings and solvent-welded joints.
  
- B. Makeup-water piping installed aboveground shall be the following:
  - 1. Type M, drawn-temper copper tubing, wrought-copper fittings, and soldered joints.
  
- C. Blowdown-Drain Piping: Same materials and joining methods as for piping specified for the service in which blowdown drain is installed.

### **3.2 PIPING INSTALLATIONS**

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems. Install piping as indicated unless deviations to layout are approved on Coordination Drawings.
  
- B. Install piping at right angles or parallel to building walls. Diagonal runs are.
  
- C. Install piping to permit valve servicing.
  
- D. Install piping free of sags and bends.
  
- E. Install fittings for changes in direction and branch connections.
  
- F. Install piping to allow application of insulation where applicable.
  
- G. Select system components with pressure rating equal to or greater than system operating pressure.
  
- H. Install groups of pipes parallel to each other, spaced to permit applying insulation and servicing of valves.

- I. Install unions in piping, NPS 2 and smaller, adjacent to valves, at final connections of equipment, and elsewhere as indicated.
- J. Install flanges in piping, NPS 2-1/2 and larger, at final connections of equipment and elsewhere as indicated.

### **3.3 DIELECTRIC FITTING INSTALLATION**

- A. Install dielectric fittings in piping at connections of dissimilar metal piping and tubing.

### **3.4 HANGERS AND SUPPORTS**

- A. Comply with requirements in Section 230529 "Hangers and Supports for HVAC Piping and Equipment" for hanger, support, and anchor devices. Comply with the following requirements for maximum spacing of supports.
- B. Install supports for drawn-temper copper piping with the following maximum spacing:
  - 1. Maximum span, 5 feet.
- C. Plastic Piping Hanger Spacing: Space hangers according to pipe manufacturer's written instructions for service conditions. Avoid point loading. Space and install hangers with the fewest practical rigid anchor points.

### **3.5 PIPE JOINT CONSTRUCTION**

- A. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.
- B. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.
- C. Soldered Joints: Apply ASTM B 813, water-flushable flux, unless otherwise indicated, to tube end. Construct joints according to ASTM B 828 or CDA's "Copper Tube Handbook," using lead-free solder alloy complying with ASTM B 32.
- D. Brazed Joints: Construct joints according to AWS's "Brazing Handbook," "Pipe and Tube" Chapter, using copper-phosphorus brazing filler metal complying with AWS A5.8/A5.8M.
- E. Flanged Joints: Select appropriate gasket material, size, type, and thickness for service application. Install gasket concentrically positioned. Use suitable lubricants on bolt threads.
- F. Plastic Piping Solvent-Cemented Joints: Clean and dry joining surfaces. Join pipe and fittings according to the following:
  - 1. Comply with ASTM F 402 for safe-handling practice of cleaners, primers, and solvent cements.
  - 2. PVC Pressure Piping: Join ASTM D 1785 schedule number, PVC pipe and PVC socket fittings according to ASTM D 2672. Join other-than-schedule number PVC pipe and socket fittings according to ASTM D 2855.

### **3.6 TERMINAL EQUIPMENT CONNECTIONS**

- A. Sizes for supply and return piping connections shall be the same as or larger than equipment connections.
- B. Install control valves in accessible locations close to connected equipment.

### **3.7 CHEMICAL TREATMENT**

- A. Reference plans for cleaning and chemical treatment information.

### **3.8 FIELD QUALITY CONTROL**

- A. Prepare hydronic piping according to ASME B31.9 and as follows:
  - 1. Leave joints, including welds, uninsulated and exposed for examination during test.
  - 2. Provide temporary restraints for expansion joints that cannot sustain reactions due to test pressure. If temporary restraints are impractical, isolate expansion joints from testing.
  - 3. Flush hydronic piping systems with clean water; then remove and clean or replace strainer screens.
  - 4. Isolate equipment from piping. If a valve is used to isolate equipment, its closure shall be capable of sealing against test pressure without damage to valve. Install blinds in flanged joints to isolate equipment.
  - 5. Install safety valve, set at a pressure no more than one-third higher than test pressure, to protect against damage by expanding liquid or other source of overpressure during test.
- B. Perform the following tests on hydronic piping:
  - 1. Use ambient temperature water as a testing medium unless there is risk of damage due to freezing.
  - 2. While filling system, use vents installed at high points of system to release air. Use drains installed at low points for complete draining of test liquid.
  - 3. Isolate expansion tanks and determine that hydronic system is full of water.
  - 4. Subject piping system to hydrostatic test pressure that is not less than 1.5 times the system's working pressure. Test pressure shall not exceed maximum pressure for any vessel, pump, valve, or other component in system under test. Verify that stress due to pressure at bottom of vertical runs does not exceed 90 percent of specified minimum yield strength or 1.7 times the "SE" value in Appendix A in ASME B31.9, "Building Services Piping."
  - 5. After hydrostatic test pressure has been applied for at least 10 minutes, examine piping, joints, and connections for leakage. Eliminate leaks by tightening, repairing, or replacing components, and repeat hydrostatic test until there are no leaks.
  - 6. Prepare written report of testing.
- C. Perform the following before operating the system:
  - 1. Open manual valves fully.
  - 2. Inspect pumps for proper rotation.
  - 3. Set makeup pressure-reducing valves for required system pressure.



4. Inspect air vents at high points of system and determine if all are installed and operating freely (automatic type), or bleed air completely (manual type).
5. Set temperature controls so all coils are calling for full flow.
6. Inspect and set operating temperatures of fluid cooler to specified values.
7. Verify lubrication of motors and bearings.

**END OF SECTION 232113**

## **SECTION 236500 - COOLING TOWERS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section Includes:
  - 1. Closed-circuit, forced-draft, counterflow cooling towers.

#### **1.3 PERFORMANCE REQUIREMENTS**

- A. Structural Performance: Cooling tower support structure shall withstand the effects of gravity loads under conditions indicated according to SEI/ASCE 7.

#### **1.4 ACTION SUBMITTALS**

- A. Product Data: For each type of product indicated. Include rated capacities, pressure drop, fan performance data, rating curves with selected points indicated, furnished specialties, and accessories.
  - 1. Maximum flow rate.
  - 2. Minimum flow rate.
  - 3. Drift loss as percent of design flow rate.
  - 4. Sound power levels in eight octave bands for operation with fans off, fans at minimum, and design speed.
  - 5. Performance curves for the following:
    - a. Varying entering-water temperatures from design to minimum.
    - b. Varying ambient wet-bulb temperatures from design to minimum.
    - c. Varying water flow rates from design to minimum.
    - d. Varying fan operation.
  - 6. Fan airflow, brake horsepower, and drive losses.
  - 7. Pump flow rate, head, brake horsepower, and efficiency.
  - 8. Motor amperage, efficiency, and power factor at 100, 75, 50, and 25 percent of nameplate horsepower.
  - 9. Electrical power requirements for each cooling tower component requiring power.
- B. Shop Drawings: Complete set of manufacturer's prints of cooling tower assemblies, control panels, sections and elevations, and unit isolation. Include the following:

1. Assembled unit dimensions.
2. Weight and load distribution.
3. Required clearances for maintenance and operation.
4. Sizes and locations of piping and wiring connections.
5. Wiring Diagrams: For power, signal, and control wiring.

## **1.5 INFORMATIONAL SUBMITTALS**

- A. Certificates: For certification required in "Quality Assurance" Article.
- B. Source quality-control reports.
- C. Field quality-control reports.
- D. Startup service reports.
- E. Warranty: Sample of special warranty.

## **1.6 CLOSEOUT SUBMITTALS**

- A. Operation and Maintenance Data: For each cooling tower to include in emergency, operation, and maintenance manuals.

## **1.7 QUALITY ASSURANCE**

- A. Testing Agency Qualifications: Certified by CTI.
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- C. ASHRAE/IESNA 90.1 Compliance: Applicable requirements in ASHRAE/IESNA 90.1, Section 6 - "Heating, Ventilating, and Air-Conditioning."
- D. ASME Compliance: Fabricate and label heat-exchanger coils to comply with ASME Boiler and Pressure Vessel Code: Section VIII, Division 1.
- E. CTI Certification: Cooling tower thermal performance according to CTI STD 201, "Certification Standard for Commercial Water-Cooling Towers Thermal Performance."
- F. FMG approval and listing in the latest edition of FMG's "Approval Guide."

## **1.8 COORDINATION**

- A. Coordinate sizes and locations of concrete bases with actual equipment provided.

## **1.9 WARRANTY**

- A. Warranty: One-year warranty after start-up, or eighteen months from date of shipment, whichever occurs first. Warranty to include coverage for defects in material and workmanship.
- B. Fans, fan shafts, bearings, sheaves, gearboxes, drive shafts, couplings, and mechanical equipment support must be warranted against defects in materials and workmanship for a period of five (5) years or seven (7), if motor space heater is properly wired.

## **PART 2 - PRODUCTS**

### **2.1 CLOSED-CIRCUIT, FORCED-DRAFT, COUNTERFLOW COOLING TOWERS**

- A. Manufactures: The scheduled manufacturer is the Basis of Design. The Contractor is responsible for all costs, schedule impacts, and construction coordination, including design costs and regulatory agency approvals, related to using a specified alternate product other than the Basis of Design.
  - 1. Basis of Design: Baltimore Aircoil Company.
  - 2. EVAPCO, Inc.
  - 3. SPX Cooling Technologies
- B. Cooling tower designed to resist wind load of 30 lbf/sq. ft.
- C. Casing and Frame:
  - 1. Casing and Frame Material: Stainless steel.
  - 2. Fasteners: Stainless steel.
  - 3. Joints and Seams: Sealed watertight.
  - 4. Welded Connections: Continuous and watertight.
- D. Collection Basin:
  - 1. Material: Stainless steel.
  - 2. Strainer: Removable stainless-steel strainer with openings smaller than nozzle orifices.
  - 3. Overflow and drain connections.
  - 4. Makeup water connection.
- E. Mechanically Operated, Collection Basin Water-Level Control: Manufacturer's standard adjustable, mechanical float assembly and valve with high and low water level alarm float switches with auxiliary contact for integration into Building Automation System.
- F. Water Distribution Piping: Main header and lateral branch piping designed for even distribution over fill throughout the flow range without the need for balancing valves and for connecting individual, removable, nonclogging, 360 degree pattern spray nozzles.
  - 1. Pipe Material: PVC.
  - 2. Spray Nozzle Material: Plastic with snap in rubber grommets.
  - 3. Piping Supports: Corrosion-resistant hangers and supports designed to resist movement during operation and shipment.

- G. Recirculating Piping: PVC.
- H. Spray Pump: Close-coupled, end-suction, single-stage, bronze-fitted centrifugal pump; with suction strainer and flow balancing valve, and mechanical seal suitable for outdoor service.
  - 1. Motor Enclosure: Totally enclosed fan cooled (TEFC).
  - 2. Energy Efficiency: NEMA Premium Efficient.
- I. Heat-Exchanger Coils:
  - 1. **BASE BID:** Tube and Tube Sheet Materials: Prime-coated steel tube and sheet with outer surface of tube and sheet hot-dip galvanized after fabrication.
  - 2. **ALTERNATE 1:** Tube and Tube Sheet Materials: Stainless-steel tube and sheet.
  - 3. Heat-Exchanger Arrangement: Serpentine tubes encased in steel framework and sloped for complete drainage of fluid by gravity.
  - 4. ASME Compliance: Designed, manufactured, and tested according to ASME Boiler and Pressure Vessel Code: Section VIII, Division 1, and bearing ASME "U" stamp; and sloped for complete drainage of fluid by gravity.
  - 5. Field Piping Connections: Supply, and return suitable for mating to ASME B16.5, Class 150 flange.
- J. Drift Eliminator:
  - 1. Material: PVC; with maximum flame-spread index of 25 according to ASTM E 84.
  - 2. UV Treatment: Inhibitors to protect against damage caused by UV radiation.
  - 3. Configuration: Multipass, designed and tested to reduce water carryover to achieve performance indicated.
- K. Multi blade, axial fan or centrifugal Fan: Double-width, double-inlet, forward-curved blades, and statically and dynamically balanced at the factory after assembly.
  - 1. Number of Fans: Each cooling tower cell shall have a single fan or multiple fans connected to a common shaft.
  - 2. Fan Wheel and Housing Materials: Galvanized steel.
  - 3. Hail Guard: hot dipped galvanized steel rod and wire.
  - 4. Fan Shaft: Steel, coated to resist corrosion.
  - 5. Protective Enclosure: Removable, galvanized-steel, wire-mesh screens complying with OSHA regulations.
  - 6. Fan Shaft Bearings: Self-aligning, grease-lubricated ball or roller bearings with moisture-proof seals and premium, moisture-resistant grease suitable for temperatures between minus 20 and plus 300 deg F. Bearings designed for an L-10 life of 50,000 hours.
  - 7. Bearings Grease Fittings: Extended lubrication lines to an easily accessible location.
- L. Belt Drive:
  - 1. Belt-Drive Service Factor: 1.5 based on motor nameplate horsepower.
  - 2. Sheaves: Fan and motor shafts shall have taper-lock sheaves fabricated from corrosion-resistant materials.

3. Belt Material: Oil resistant, nonstatic conducting, and constructed of neoprene polyester cord.
  4. Belt-Drive Guard: Comply with OSHA regulations.
- M. Fan Motor:
1. Motor Enclosure: Totally enclosed air over (TEAO).
  2. Energy Efficiency: NEMA Premium Efficient.
  3. Service Factor: 1.15.
  4. Insulation: Class H.
  5. Variable-Speed Motors: Inverter-duty rated per NEMA MG-1, Section IV, "Performance Standard Applying to All Machines," Part 31, "Definite-Purpose, Inverter-Fed, Polyphase Motors."
  6. Motor Base: Adjustable, or other suitable provision for adjusting belt tension.
- N. Control Package: Factory installed and wired, and functionally tested at factory before shipment.
1. Cooling tower shall have hardware to enable BMS to remotely monitor and display the following:
    - a. Collection basin high- and low-water-level alarms..
- O. Personnel Access Components:
1. Doors: Large enough for personnel to access cooling tower internal components from both cooling tower end walls. Doors shall be operable from both sides of the door.
  2. Internal Ladder with handrails and safety cage: Aluminum, galvanized- or stainless-steel, fixed ladders with ladder extensions to access external platforms and top of cooling tower. Comply with 29 CFR 1910.27.
- P. Capacities and Characteristics: Reference schedule sheet ME-601.

## **2.2 SOURCE QUALITY CONTROL**

- A. Verification of Performance: Test and certify cooling tower performance according to CTI STD 201, "Certification Standard for Commercial Water-Cooling Towers Thermal Performance."
- B. Factory pressure test heat exchangers after fabrication and prove to be free of leaks.

## **PART 3 - EXECUTION**

### **3.1 EXAMINATION**

- A. Before cooling tower installation, examine roughing-in for tower support, anchor-bolt sizes and locations, piping, and electrical connections to verify actual locations, sizes, and other conditions affecting tower performance, maintenance, and operation.
  1. Cooling tower locations indicated on Drawings are approximate. Determine exact locations before roughing-in for piping and electrical connections.

- B. Proceed with installation only after unsatisfactory conditions have been corrected.

### **3.2 INSTALLATION**

- A. Install cooling tower on existing cast-in-place concrete equipment base.
- B. Maintain manufacturer's recommended clearances for service and maintenance.
- C. Loose Components: Install electrical components, devices, and accessories that are not factory mounted.

### **3.3 CONNECTIONS**

- A. Piping installation requirements are specified in other Sections. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Install piping adjacent to cooling towers to allow service and maintenance.
- C. Provide drain piping with valve at cooling tower drain connections and at low points in piping.
- D. Connect cooling tower overflows and drains, and piping drains to existing drain system.
- E. Domestic Water Piping: Connect to water-level control with shutoff valve and union, flange, or mechanical coupling at each connection.
- F. Supply and Return Piping: Connect to entering cooling tower connections with shutoff valve, and drain connection with valve. Connect to leaving cooling tower connection with shutoff valve. Make connections to cooling tower with a flange.

### **3.4 FIELD QUALITY CONTROL**

- A. Manufacturer's Field Service: Engage a factory-authorized service representative to perform field tests and inspections.
- B. Perform tests and inspections.
  - 1. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect components, assemblies, and equipment installations, including connections, and to assist in testing.
- C. Tests and Inspections: Comply with ASME PTC 23, "ASME Performance Test Codes - Code on Atmospheric Water Cooling Equipment or CTI ATC 105, "Acceptance Test Code for Water Cooling Towers."
- D. Cooling towers will be considered defective if they do not pass tests and inspections.
- E. Prepare test and inspection reports.

### 3.5 STARTUP SERVICE

- A. Engage a factory-authorized service representative to perform startup service.
- B. Inspect field-assembled components, equipment installation, and piping and electrical connections for proper assemblies, installations, and connections.
- C. Obtain performance data from manufacturer.
  - 1. Complete installation and startup checks according to manufacturer's written instructions and perform the following:
    - a. Clean entire unit including basins.
    - b. Verify that accessories are properly installed.
    - c. Verify clearances for airflow and for cooling tower servicing.
    - d. Check for vibration isolation and structural support.
    - e. Lubricate bearings.
    - f. Verify fan rotation for correct direction and for vibration or binding and correct problems.
    - g. Adjust belts to proper alignment and tension.
    - h. Operate variable-speed fans through entire operating range and check for harmonic vibration imbalance. Set motor controller to skip speeds resulting in abnormal vibration.
    - i. Check vibration switch setting. Verify operation.
    - j. Verify water level in tower basin. Fill to proper startup level. Check makeup water-level control and valve.
    - k. Verify operation of basin heater and control.
    - l. Verify that cooling tower air discharge is not recirculating air into tower or HVAC air intakes. Recommend corrective action.
    - m. Replace defective and malfunctioning units.
- D. Start cooling tower and associated water pumps. Follow manufacturer's written starting procedures.
- E. Prepare a written startup report that records the results of tests and inspections.
- F. **BASE BID:** Coordinate with Owner's water treatment services company Walter Lewis Fluid Technologies, 217-223-2017, Roger Smith or Dennis Gier to provide the chemicals and instructions required to passivate the galvanized steel coil.

### 3.6 ADJUSTING

- A. Adjust water-level control for proper operating level.

### 3.7 DEMONSTRATION

- A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, and maintain cooling towers. Reference section 017900 Demonstration and Training for additional requirements.



**END OF SECTION 236500**

## **SECTION 260519 - LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES**

### **PART 1 - GENERAL**

#### **1.1 SUMMARY**

- A. Section Includes:
  - 1. Building wires and cables rated 600 V and less.
  - 2. Connectors, splices, and terminations rated 600 V and less.

#### **1.2 QUALITY ASSURANCE**

- A. Testing Agency Qualifications: Member company of NETA or an NRTL.
  - 1. Testing Agency's Field Supervisor: Certified by NETA to supervise on-site testing.

### **PART 2 - PRODUCTS**

#### **2.1 CONDUCTORS AND CABLES**

- A. Copper Conductors: Comply with NEMA WC 70/ICEA S-95-658.
- B. Conductor Insulation: Comply with NEMA WC 70/ICEA S-95-658 for Type THW-2, Type THHN/THWN-2, Type XHHW-2, Type UF, Type USE, and Type SOOW.

#### **2.2 CONNECTORS AND SPLICES**

- A. Description: Factory-fabricated connectors and splices of size, ampacity rating, material, type, and class for application and service indicated.

#### **2.3 SYSTEM DESCRIPTION**

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Comply with NFPA 70.

### **PART 3 - EXECUTION**

#### **3.1 CONDUCTOR MATERIAL APPLICATIONS**

- A. Feeders: Copper. Solid for No. 10 AWG and smaller; stranded for No. 8 AWG and larger.

- B. Branch Circuits: Copper. Solid for No. 10 AWG and smaller; stranded for No. 8 AWG and larger.

### **3.2 CONDUCTOR INSULATION AND MULTICONDUCTOR CABLE APPLICATIONS AND WIRING METHODS**

- A. Service Entrance: Type THHN/THWN-2, single conductors in raceway or Type XHHW-2, single conductors in raceway.
- B. Feeders and Branch Circuits: Type THHN/THWN, single conductors in raceway.
- C. Class 1 Control Circuits: Type THHN-THWN, in raceway.
- D. Class 2 Control Circuits: Power-limited cable, concealed in building finishes.

### **3.3 INSTALLATION OF CONDUCTORS AND CABLES**

- A. Conceal cables in finished walls, ceilings, and floors unless otherwise indicated.
- B. Use manufacturer-approved pulling compound or lubricant where necessary; compound used must not deteriorate conductor or insulation. Do not exceed manufacturer's recommended maximum pulling tensions and sidewall pressure values.
- C. Use pulling means, including fish tape, cable, rope, and basket-weave wire/cable grips that will not damage cables or raceway.
- D. Install exposed cables parallel and perpendicular to surfaces of exposed structural members, and follow surface contours where possible.
- E. Support cables according to Section 260529 "Hangers and Supports for Electrical Systems."

### **3.4 CONNECTIONS**

- A. Tighten electrical connectors and terminals according to manufacturer's published torque-tightening values. If manufacturer's torque values are not indicated, use those specified in UL 486A-486B.
- B. Make splices, terminations, and taps that are compatible with conductor material and that possess equivalent or better mechanical strength and insulation ratings than unspliced conductors.
- C. Wiring at Outlets: Install conductor at each outlet, with at least 6 inches of slack.

**END OF SECTION 260519**

## **SECTION 260529 - HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section Includes:
  - 1. Hangers and supports for electrical equipment and systems.

### **PART 2 - PRODUCTS**

#### **2.1 PERFORMANCE REQUIREMENTS**

- A. Surface-Burning Characteristics: Comply with ASTM E 84; testing by a qualified testing agency. Identify products with appropriate markings of applicable testing agency.
  - 1. Flame Rating: Class 1.
  - 2. Self-extinguishing according to ASTM D 635.

#### **2.2 SUPPORT, ANCHORAGE, AND ATTACHMENT COMPONENTS**

- A. Steel Slotted Support Systems: Comply with MFMA-4 factory-fabricated components for field assembly.
  - 1. Material: Galvanized steel.
  - 2. Metallic Coatings: Hot-dip galvanized after fabrication and applied according to MFMA-4.
  - 3. Nonmetallic Coatings: Manufacturer's standard PVC, polyurethane, or polyester coating applied according to MFMA-4.
  - 4. Protect finishes on exposed surfaces from damage by applying a strippable, temporary protective covering before shipping.
  - 5. Channel Dimensions: Selected for applicable load criteria.
- B. Aluminum Slotted Support Systems: Comply with MFMA-4 factory-fabricated components for field assembly.
  - 1. Nonmetallic Coatings: Manufacturer's standard PVC, polyurethane, or polyester coating applied according to MFMA-4.
  - 2. Protect finishes on exposed surfaces from damage by applying a strippable, temporary protective covering before shipping.
  - 3. Channel Dimensions: Selected for applicable load criteria.

- C. Conduit and Cable Support Devices: Steel hangers, clamps, and associated fittings, designed for types and sizes of raceway or cable to be supported.
- D. Support for Conductors in Vertical Conduit: Factory-fabricated assembly consisting of threaded body and insulating wedging plug or plugs for nonarmored electrical conductors or cables in riser conduits. Plugs shall have number, size, and shape of conductor gripping pieces as required to suit individual conductors or cables supported. Body shall be made of malleable iron.
- E. Structural Steel for Fabricated Supports and Restraints: ASTM A 36/A 36M steel plates, shapes, and bars; black and galvanized.
- F. Mounting, Anchoring, and Attachment Components: Items for fastening electrical items or their supports to building surfaces include the following:
  - 1. Powder-Actuated Fasteners: Threaded-steel stud, for use in hardened portland cement concrete, steel, or wood, with tension, shear, and pullout capacities appropriate for supported loads and building materials where used.
  - 2. Mechanical-Expansion Anchors: Insert-wedge-type, zinc-coated steel or stainless steel, for use in hardened portland cement concrete, with tension, shear, and pullout capacities appropriate for supported loads and building materials where used.
  - 3. Concrete Inserts: Steel or malleable-iron, slotted support system units are similar to MSS Type 18 units and comply with MFMA-4 or MSS SP-58.
  - 4. Clamps for Attachment to Steel Structural Elements: MSS SP-58 units are suitable for attached structural element.
  - 5. Through Bolts: Structural type, hex head, and high strength. Comply with ASTM A 325.
  - 6. Toggle Bolts: All-steel or Stainless-steel springhead type.
  - 7. Hanger Rods: Threaded steel.

### **2.3 FABRICATED METAL EQUIPMENT SUPPORT ASSEMBLIES**

- A. Description: Welded or bolted structural-steel shapes, shop or field fabricated to fit dimensions of supported equipment.
  - 1. Material: Galvanized steel.
  - 2. Metallic Coatings: Hot-dip galvanized after fabrication and applied according to MFMA-4.
  - 3. Nonmetallic Coatings: Manufacturer's standard PVC, polyurethane, or polyester coating applied according to MFMA-4.
  - 4. Protect finishes on exposed surfaces from damage by applying a strippable, temporary protective covering before shipping.

## **PART 3 - EXECUTION**

### **3.1 APPLICATION**

- A. Comply with NECA 1 and NECA 101 for application of hangers and supports for electrical equipment and systems unless requirements in this Section are stricter.
- B. Comply with requirements for raceways and boxes specified in Section 260533 "Raceways and Boxes for Electrical Systems."
- C. Maximum Support Spacing and Minimum Hanger Rod Size for Raceway: Space supports for EMTs, IMCs, and RMCs as required by NFPA 70. Minimum rod size shall be 1/4 inch in diameter.
- D. Multiple Raceways or Cables: Install trapeze-type supports fabricated with steel slotted or other support system, sized so capacity can be increased by at least 25 percent in future without exceeding specified design load limits.
  - 1. Secure raceways and cables to these supports with single-bolt conduit clamps.
- E. Spring-steel clamps designed for supporting single conduits without bolts may be used for 1-1/2-inch and smaller raceways serving branch circuits and communication systems above suspended ceilings and for fastening raceways to trapeze supports.

### **3.2 SUPPORT INSTALLATION**

- A. Comply with NECA 1 and NECA 101 for installation requirements except as specified in this article.
- B. Raceway Support Methods: In addition to methods described in NECA 1, EMTs, IMCs, and RMCs may be supported by openings through structure members, according to NFPA 70.
- C. Strength of Support Assemblies: Where not indicated, select sizes of components so strength will be adequate to carry present and future static loads within specified loading limits. Minimum static design load used for strength determination shall be weight of supported components plus 200 lb.
- D. Mounting and Anchorage of Surface-Mounted Equipment and Components: Anchor and fasten electrical items and their supports to building structural elements by the following methods unless otherwise indicated by code:
  - 1. To Wood: Fasten with lag screws or through bolts.
  - 2. To New Concrete: Bolt to concrete inserts.
  - 3. To Masonry: Approved toggle-type bolts on hollow masonry units and expansion anchor fasteners on solid masonry units.
  - 4. To Existing Concrete: Expansion anchor fasteners.
  - 5. Instead of expansion anchors, powder-actuated driven threaded studs provided with lock washers and nuts may be used in existing standard-weight concrete 4 inches thick or

greater. Do not use for anchorage to lightweight-aggregate concrete or for slabs less than 4 inches thick.

6. To Steel: Beam clamps (MSS SP-58, Type 19, 21, 23, 25, or 27), complying with MSS SP-69.
  7. To Light Steel: Sheet metal screws.
  8. Items Mounted on Hollow Walls and Nonstructural Building Surfaces: Mount cabinets, panelboards, disconnect switches, control enclosures, pull and junction boxes, transformers, and other devices on slotted-channel racks attached to substrate.
- E. Drill holes for expansion anchors in concrete at locations and to depths that avoid the need for reinforcing bars.

### **3.3 INSTALLATION OF FABRICATED METAL SUPPORTS**

- A. Cut, fit, and place miscellaneous metal supports accurately in location, alignment, and elevation to support and anchor electrical materials and equipment.
- B. Field Welding: Comply with AWS D1.1/D1.1M.

### **3.4 PAINTING**

- A. Touchup: Clean field welds and abraded areas of shop paint. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting. Comply with SSPC-PA 1 requirements for touching up field-painted surfaces.
  1. Apply paint by brush or spray to provide a minimum dry film thickness of 2.0 mils.
- B. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A 780.

**END OF SECTION 260529**

## **SECTION 260533 - RACEWAYS AND BOXES FOR ELECTRICAL SYSTEMS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section Includes:
  - 1. Metal conduits, tubing, and fittings.
  - 2. Metal wireways and auxiliary gutters.
  - 3. Boxes, enclosures, and cabinets.
  - 4. Handholes and boxes for exterior underground cabling.

#### **1.3 DEFINITIONS**

- A. ARC: Aluminum rigid conduit.
- B. GRC: Galvanized rigid steel conduit.
- C. IMC: Intermediate metal conduit.

### **PART 2 - PRODUCTS**

#### **2.1 METAL CONDUITS, TUBING, AND FITTINGS**

- A. Listing and Labeling: Metal conduits, tubing, and fittings shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. GRC: Comply with ANSI C80.1 and UL 6.
- C. ARC: Comply with ANSI C80.5 and UL 6A.
- D. IMC: Comply with ANSI C80.6 and UL 1242.
- E. PVC-Coated Steel Conduit: PVC-coated rigid steel conduit IMC.
  - 1. Comply with NEMA RN 1.
  - 2. Coating Thickness: 0.040 inch, minimum.
- F. EMT: Comply with ANSI C80.3 and UL 797.



- G. FMC: Comply with UL 1; zinc-coated steel or aluminum.
- H. LFMC: Flexible steel conduit with PVC jacket and complying with UL 360.
- I. Fittings for Metal Conduit: Comply with NEMA FB 1 and UL 514B.
  - 1. Conduit Fittings for Hazardous (Classified) Locations: Comply with UL 886 and NFPA 70.
  - 2. Fittings for EMT:
    - a. Material: Steel or die cast.
    - b. Type: Setscrew or compression.
  - 3. Expansion Fittings: PVC or steel to match conduit type, complying with UL 651, rated for environmental conditions where installed, and including flexible external bonding jumper.
  - 4. Coating for Fittings for PVC-Coated Conduit: Minimum thickness of 0.040 inch, with overlapping sleeves protecting threaded joints.
- J. Joint Compound for IMC, GRC, or ARC: Approved, as defined in NFPA 70, by authorities having jurisdiction for use in conduit assemblies, and compounded for use to lubricate and protect threaded conduit joints from corrosion and to enhance their conductivity.

## **2.2 METAL WIREWAYS AND AUXILIARY GUTTERS**

- A. Description: Sheet metal, complying with UL 870 and NEMA 250, Type 1 unless otherwise indicated, and sized according to NFPA 70.
  - 1. Metal wireways installed outdoors shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Fittings and Accessories: Include covers, couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, and other fittings to match and mate with wireways as required for complete system.
- C. Wireway Covers: Screw-cover type.
- D. Finish: Manufacturer's standard enamel finish.

## **2.3 BOXES, ENCLOSURES, AND CABINETS**

- A. General Requirements for Boxes, Enclosures, and Cabinets: Boxes, enclosures, and cabinets installed in wet locations shall be listed for use in wet locations.
- B. Sheet Metal Outlet and Device Boxes: Comply with NEMA OS 1 and UL 514A.
- C. Cast-Metal Outlet and Device Boxes: Comply with NEMA FB 1, cast aluminum with gasketed cover.

- D. Cast-Metal Access, Pull, and Junction Boxes: Comply with NEMA FB 1 and UL 1773, cast aluminum with gasketed cover.
- E. Hinged-Cover Enclosures: Comply with UL 50 and NEMA 250, Type 3R with continuous-hinge cover with flush latch unless otherwise indicated.
  - 1. Metal Enclosures: Steel, finished inside and out with manufacturer's standard enamel.
  - 2. Interior Panels: Steel; all sides finished with manufacturer's standard enamel.
- F. Cabinets:
  - 1. NEMA 250, Type 4 galvanized-steel box with removable interior panel and removable front, finished inside and out with manufacturer's standard enamel.
  - 2. Hinged door in front cover with flush latch and concealed hinge.
  - 3. Key latch to match panelboards.
  - 4. Metal barriers to separate wiring of different systems and voltage.
  - 5. Accessory feet where required for freestanding equipment.
  - 6. Nonmetallic cabinets shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

## **2.4 HANDHOLES AND BOXES FOR EXTERIOR UNDERGROUND WIRING**

- A. General Requirements for Handholes and Boxes:
  - 1. Boxes and handholes for use in underground systems shall be designed and identified as defined in NFPA 70, for intended location and application.
  - 2. Boxes installed in wet areas shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Polymer-Concrete Handholes and Boxes with Polymer-Concrete Cover: Molded of sand and aggregate, bound together with polymer resin, and reinforced with steel, fiberglass, or a combination of the two.
  - 1. Standard: Comply with SCTE 77.
  - 2. Configuration: Designed for flush burial with integral closed bottom unless otherwise indicated.
  - 3. Cover: Weatherproof, secured by tamper-resistant locking devices and having structural load rating consistent with enclosure and handhole location.
  - 4. Cover Finish: Nonskid finish shall have a minimum coefficient of friction of 0.50.
  - 5. Cover Legend: Molded lettering, "ELECTRIC."
  - 6. Conduit Entrance Provisions: Conduit-terminating fittings shall mate with entering ducts for secure, fixed installation in enclosure wall.
- C. Fiberglass Handholes and Boxes: Molded of fiberglass-reinforced polyester resin, with frame and covers of hot-dip galvanized-steel diamond plate.
  - 1. Standard: Comply with SCTE 77.
  - 2. Color of Frame and Cover: Green.
  - 3. Configuration: Designed for flush burial with integral closed bottom unless otherwise indicated.
  - 4. Cover: Weatherproof, secured by tamper-resistant locking devices and having structural load rating consistent with enclosure and handhole location.

5. Cover Finish: Nonskid finish shall have a minimum coefficient of friction of 0.50.
6. Cover Legend: Molded lettering, "ELECTRIC."
7. Conduit Entrance Provisions: Conduit-terminating fittings shall mate with entering ducts for secure, fixed installation in enclosure wall.

## **2.5 SOURCE QUALITY CONTROL FOR UNDERGROUND ENCLOSURES**

- A. Handhole and Pull-Box Prototype Test: Test prototypes of handholes and boxes for compliance with SCTE 77. Strength tests shall be for specified tier ratings of products supplied.
  1. Tests of materials shall be performed by an independent testing agency.
  2. Strength tests of complete boxes and covers shall be by either an independent testing agency or manufacturer. A qualified registered professional engineer shall certify tests by manufacturer.
  3. Testing machine pressure gages shall have current calibration certification complying with ISO 9000 and ISO 10012 and traceable to NIST standards.

## **PART 3 - EXECUTION**

### **3.1 RACEWAY APPLICATION**

- A. Outdoors: Apply raceway products as specified below unless otherwise indicated:
  1. Exposed Conduit: GRC.
  2. Concealed Conduit, Aboveground: GRC.
  3. Underground Conduit: RNC, Type EPC-80-PVC.
  4. Connection to Vibrating Equipment (Including Transformers and Hydraulic, Pneumatic, Electric Solenoid, or Motor-Driven Equipment): LFMC.
  5. Boxes and Enclosures, Aboveground: NEMA 250, Type 4.
- B. Indoors: Apply raceway products as specified below unless otherwise indicated:
  1. Exposed, Not Subject to Physical Damage: EMT.
  2. All other exposed areas: RMC.
  3. Concealed in Ceilings and Interior Walls and Partitions: EMT.
  4. Connection to Vibrating Equipment (Including Transformers and Hydraulic, Pneumatic, Electric Solenoid, or Motor-Driven Equipment): FMC, except use LFMC in damp or wet locations.
  5. Damp or Wet Locations: RMC.
  6. Boxes and Enclosures: NEMA 250, Type 1, except use as noted on drawings.
- C. Minimum Raceway Size: 3/4-inch trade size.
- D. Raceway Fittings: Compatible with raceways and suitable for use and location.
  1. Rigid and Intermediate Steel Conduit: Use threaded rigid steel conduit fittings unless otherwise indicated. Comply with NEMA FB 2.10.

2. EMT: Use setscrew or compression, steel or cast-metal fittings. Comply with NEMA FB 2.10.
  3. Flexible Conduit: Use only fittings listed for use with flexible conduit. Comply with NEMA FB 2.20.
- E. Install nonferrous conduit or tubing for circuits operating above 60 Hz. Where aluminum raceways are installed for such circuits and pass through concrete, install in nonmetallic sleeve.
  - F. Do not install aluminum conduits, boxes, or fittings in contact with concrete or earth.
  - G. Install surface raceways only where indicated on Drawings.
  - H. Do not install nonmetallic conduit where ambient temperature exceeds 120 deg F.

### **3.2 INSTALLATION**

- A. Comply with NECA 1 and NECA 101 for installation requirements except where requirements on Drawings or in this article are stricter. Comply with NECA 102 for aluminum conduits. Comply with NFPA 70 limitations for types of raceways allowed in specific occupancies and number of floors.
- B. Keep raceways at least 6 inches away from parallel runs of flues and steam or hot-water pipes. Install horizontal raceway runs above water and steam piping.
- C. Complete raceway installation before starting conductor installation.
- D. Comply with requirements in Section 260529 "Hangers and Supports for Electrical Systems" for hangers and supports.
- E. Arrange stub-ups so curved portions of bends are not visible above finished slab.
- F. Install no more than the equivalent of three 90-degree bends in any conduit run except for control wiring conduits, for which fewer bends are allowed. Support within 12 inches of changes in direction.
- G. Conceal conduit and EMT within finished walls, ceilings, and floors unless otherwise indicated. Install conduits parallel or perpendicular to building lines.
- H. Support conduit within 12 inches of enclosures to which attached.
- I. Threaded Conduit Joints, Exposed to Wet, Damp, Corrosive, or Outdoor Conditions: Apply listed compound to threads of raceway and fittings before making up joints. Follow compound manufacturer's written instructions.
- J. Coat field-cut threads on PVC-coated raceway with a corrosion-preventing conductive compound prior to assembly.
- K. Raceway Terminations at Locations Subject to Moisture or Vibration: Use insulating bushings to protect conductors including conductors smaller than No. 4 AWG.

- L. Terminate threaded conduits into threaded hubs or with locknuts on inside and outside of boxes or cabinets. Install bushings on conduits up to 1-1/4-inch trade size and insulated throat metal bushings on 1-1/2-inch trade size and larger conduits terminated with locknuts. Install insulated throat metal grounding bushings on service conduits.
- M. Install raceways square to the enclosure and terminate at enclosures with locknuts. Install locknuts hand tight plus 1/4 turn more.
- N. Do not rely on locknuts to penetrate nonconductive coatings on enclosures. Remove coatings in the locknut area prior to assembling conduit to enclosure to assure a continuous ground path.
- O. Cut conduit perpendicular to the length. For conduits 2-inch trade size and larger, use roll cutter or a guide to make cut straight and perpendicular to the length.
- P. Install pull wires in empty raceways. Use polypropylene or monofilament plastic line with not less than 200-lb tensile strength. Leave at least 12 inches of slack at each end of pull wire. Cap underground raceways designated as spare above grade alongside raceways in use.
- Q. Surface Raceways:
  - 1. Install surface raceway with a minimum 2-inch radius control at bend points.
  - 2. Secure surface raceway with screws or other anchor-type devices at intervals not exceeding 48 inches and with no less than two supports per straight raceway section. Support surface raceway according to manufacturer's written instructions. Tape and glue are not acceptable support methods.
- R. Install raceway sealing fittings at accessible locations according to NFPA 70 and fill them with listed sealing compound. For concealed raceways, install each fitting in a flush steel box with a blank cover plate having a finish similar to that of adjacent plates or surfaces. Install raceway sealing fittings according to NFPA 70.
- S. Install devices to seal raceway interiors at accessible locations. Locate seals so no fittings or boxes are between the seal and the following changes of environments. Seal the interior of all raceways at the following points:
  - 1. Where conduits pass from warm to cold locations, such as boundaries of refrigerated spaces.
  - 2. Where an underground service raceway enters a building or structure.
  - 3. Where otherwise required by NFPA 70.
- T. Comply with manufacturer's written instructions for solvent welding RNC and fittings.
- U. Expansion-Joint Fittings:
  - 1. Install in each run of aboveground RNC that is located where environmental temperature change may exceed 30 deg F and that has straight-run length that exceeds 25 feet. Install in each run of aboveground RMC conduit that is located where environmental temperature change may exceed 100 deg F and that has straight-run length that exceeds 100 feet.
  - 2. Install type and quantity of fittings that accommodate temperature change listed for each of the following locations:

- a. Outdoor Locations Not Exposed to Direct Sunlight: 125 deg F temperature change.
  - b. Outdoor Locations Exposed to Direct Sunlight: 155 deg F temperature change.
  - c. Indoor Spaces Connected with Outdoors without Physical Separation: 125 deg F temperature change.
3. Install fitting(s) that provide expansion and contraction for at least 0.00041 inch per foot of length of straight run per deg F of temperature change for PVC conduits. Install fitting(s) that provide expansion and contraction for at least 0.000078 inch per foot of length of straight run per deg F of temperature change for metal conduits.
  4. Install expansion fittings at all locations where conduits cross building or structure expansion joints.
  5. Install each expansion-joint fitting with position, mounting, and piston setting selected according to manufacturer's written instructions for conditions at specific location at time of installation. Install conduit supports to allow for expansion movement.
- V. Flexible Conduit Connections: Comply with NEMA RV 3. Use a maximum of 72 inches of flexible conduit for equipment subject to vibration, noise transmission, or movement; and for transformers and motors.
1. Use LFMC in damp or wet locations subject to severe physical damage.
  2. Use LFMC or LFNC in damp or wet locations not subject to severe physical damage.
- W. Mount boxes at heights indicated on Drawings. If mounting heights of boxes are not individually indicated, give priority to ADA requirements. Install boxes with height measured to bottom of box unless otherwise indicated.
- X. Support boxes of three gangs or more from more than one side by spanning two framing members or mounting on brackets specifically designed for the purpose.
- Y. Fasten junction and pull boxes to or support from building structure. Do not support boxes by conduits.
- Z. Set metal floor boxes level and flush with finished floor surface.

### **3.3 INSTALLATION OF UNDERGROUND CONDUIT**

- A. Direct-Buried Conduit:
1. Excavate trench bottom to provide firm and uniform support for conduit.
  2. Install backfill.
  3. After installing conduit, backfill and compact. Start at tie-in point, and work toward end of conduit run, leaving conduit at end of run free to move with expansion and contraction as temperature changes during this process. Firmly hand tamp backfill around conduit to provide maximum supporting strength. After placing controlled backfill to within 12 inches of finished grade, make final conduit connection at end of run and complete backfilling with normal compaction.
  4. Install manufactured duct elbows for stub-ups at poles and equipment and at building entrances through floor unless otherwise indicated. Encase elbows for stub-up ducts throughout length of elbow.

### **3.4 INSTALLATION OF UNDERGROUND HANDHOLES AND BOXES**

- A. Install handholes and boxes level and plumb and with orientation and depth coordinated with connecting conduits to minimize bends and deflections required for proper entrances.
- B. Unless otherwise indicated, support units on a level bed of crushed stone or gravel, graded from 1/2-inch sieve to No. 4 sieve and compacted to same density as adjacent undisturbed earth.
- C. Elevation: In paved areas, set so cover surface will be flush with finished grade. Set covers of other enclosures 1 inch above finished grade.
- D. Install handholes with bottom below frost line.
- E. Install removable hardware, including pulling eyes, cable stanchions, cable arms, and insulators, as required for installation and support of cables and conductors and as indicated. Select arm lengths to be long enough to provide spare space for future cables but short enough to preserve adequate working clearances in enclosure.
- F. Field-cut openings for conduits according to enclosure manufacturer's written instructions. Cut wall of enclosure with a tool designed for material to be cut. Size holes for terminating fittings to be used, and seal around penetrations after fittings are installed.

### **3.5 PROTECTION**

- A. Protect coatings, finishes, and cabinets from damage and deterioration.
  - 1. Repair damage to galvanized finishes with zinc-rich paint recommended by manufacturer.
  - 2. Repair damage to PVC coatings or paint finishes with matching touchup coating recommended by manufacturer.

**END OF SECTION 260533**

## **SECTION 262923 - VARIABLE-FREQUENCY MOTOR CONTROLLERS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section includes separately enclosed, preassembled, combination VFCs, rated 600 V and less, for speed control of three-phase, squirrel-cage induction motors.

#### **1.3 DEFINITIONS**

- A. CPT: Control power transformer.
- B. DDC: Direct digital control.
- C. EMI: Electromagnetic interference.
- D. LED: Light-emitting diode.
- E. NC: Normally closed.
- F. NO: Normally open.
- G. OCPD: Overcurrent protective device.
- H. PID: Control action, proportional plus integral plus derivative.
- I. RFI: Radio-frequency interference.
- J. VFC: Variable-frequency motor controller.

#### **1.4 ACTION SUBMITTALS**

- A. Product Data: For each type and rating of VFC indicated.
  - 1. Include dimensions and finishes for VFCs.
  - 2. Include rated capacities, operating characteristics, electrical characteristics, and furnished specialties and accessories.
  - 3. Include diagrams for power, signal, and control wiring.



## **1.5 INFORMATIONAL SUBMITTALS**

- A. Warranty: For special warranty.

## **1.6 CLOSEOUT SUBMITTALS**

- A. Operation and Maintenance Data: For VFCs to include in emergency, operation, and maintenance manuals.
  - 1. Include the following:
    - a. Manufacturer's written instructions for testing and adjusting thermal-magnetic circuit breaker and motor-circuit protector trip settings.
    - b. Manufacturer's written instructions for setting field-adjustable overload relays.
    - c. Manufacturer's written instructions for testing, adjusting, and reprogramming microprocessor control modules.
    - d. Manufacturer's written instructions for setting field-adjustable timers, controls, and status and alarm points.

## **1.7 QUALITY ASSURANCE**

- A. Testing Agency Qualifications: Member company of NETA or an NRTL.
  - 1. Testing Agency's Field Supervisor: Currently certified by NETA to supervise on-site testing.

## **1.8 WARRANTY**

- A. Special Warranty: Manufacturer agrees to repair or replace VFCs that fail in materials or workmanship within specified warranty period.
  - 1. Warranty Period: Five years from date of Substantial Completion.

## **PART 2 - PRODUCTS**

### **2.1 MANUFACTURERS**

- A. ABB.
- B. Schneider Electric.
- C. Siemens.

### **2.2 SYSTEM DESCRIPTION**

- A. General Requirements for VFCs:

1. VFCs and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
  2. Comply with NEMA ICS 7 and NEMA ICS 61800-2.
- B. Application: variable torque.
- C. VFC Description: Variable-frequency motor controller, consisting of power converter that employs pulse-width-modulated inverter, factory built and tested in an enclosure, with integral disconnecting means and overcurrent and overload protection; listed and labeled by an NRTL as a complete unit; arranged to provide self-protection, protection, and variable-speed control of one or more three-phase induction motors by adjusting output voltage and frequency.
1. Units suitable for operation of inverter-duty motors as defined by NEMA MG 1, Section IV, Part 31, "Definite-Purpose Inverter-Fed Polyphase Motors."
- D. Design and Rating: Match load type, such as fans, blowers, and pumps; and type of connection used between motor and load such as direct or through a power-transmission connection.
- E. Output Rating: Three phase; 10 to 60 Hz, with voltage proportional to frequency throughout voltage range; maximum voltage equals input voltage.
- F. Unit Operating Requirements:
1. Input ac voltage tolerance of 380 to 480 V, plus 10 and minus 15 percent.
  2. Input frequency tolerance of 50/60 Hz, plus or minus 5 percent.
  3. Minimum Efficiency: 96 percent at 60 Hz, full load.
  4. Minimum Displacement Primary-Side Power Factor: 96 percent.
  5. Overload Capability: 1.1 times the base load current for 60 seconds; 2.0 times the base load current for 3 seconds.
  6. Starting Torque: 100 percent of rated torque or as indicated.
  7. Speed Regulation: Plus or minus 1 percent.
- G. Isolated Control Interface: Allows VFCs to follow remote-control signal over a minimum 10:1 speed range.
1. Signal: Electrical.
- H. Internal Adjustability Capabilities:
1. Minimum Speed: 5 to 25 percent of maximum rpm.
  2. Maximum Speed: 80 to 100 percent of maximum rpm.
  3. Acceleration: 2 to 22 seconds.
  4. Deceleration: 2 to 22 seconds.
  5. Current Limit: 30 to minimum of 150 percent of maximum rating.
- I. Self-Protection and Reliability Features:
1. Surge Suppression: Factory installed as an integral part of the VFC, complying with UL 1449 SPD, Type 1 or Type 2.
  2. Loss of Input Signal Protection: Selectable response strategy, including speed default to a percent of the most recent speed, a preset speed, or stop; with alarm.
  3. Under- and overvoltage trips.
  4. Inverter overcurrent trips.

5. VFC and Motor-Overload/Overtemperature Protection: Microprocessor-based thermal protection system for monitoring VFCs and motor thermal characteristics, and for providing VFC overtemperature and motor-overload alarm and trip; settings selectable via the keypad.
  6. Notch filter to prevent operation of the controller-motor-load combination at a natural frequency of the combination.
  7. Instantaneous line-to-line and line-to-ground overcurrent trips.
  8. Loss-of-phase protection.
  9. Reverse-phase protection.
  10. Short-circuit protection.
  11. Motor-overtemperature fault.
- J. Automatic Reset/Restart: Attempt three restarts after drive fault or on return of power after an interruption and before shutting down for manual reset or fault correction; adjustable delay time between restart attempts.
- K. Power-Interruption Protection: To prevent motor from re-energizing after a power interruption until motor has stopped, unless "Bidirectional Autospeed Search" feature is available and engaged.
- L. Bidirectional Autospeed Search: Capable of starting VFC into rotating loads spinning in either direction and returning motor to set speed in proper direction, without causing damage to drive, motor, or load.
- M. Torque Boost: Automatically varies starting and continuous torque to at least 1.5 times the minimum torque to ensure high-starting torque and increased torque at slow speeds.
- N. Motor Temperature Compensation at Slow Speeds: Adjustable current fall-back based on output frequency for temperature protection of self-cooled, fan-ventilated motors at slow speeds.

## 2.3 CONTROLS AND INDICATION

- A. Status Lights: Door-mounted LED indicators displaying the following conditions:
1. Power on.
  2. Run.
  3. Overvoltage.
  4. Line fault.
  5. Overcurrent.
  6. External fault.
- B. Indicating Devices: Digital display mounted flush in VFC door and connected to display VFC parameters including, but not limited to:
1. Output frequency (Hz).
  2. Motor speed (rpm).
  3. Motor status (running, stop, fault).
  4. Motor current (amperes).
  5. Motor torque (percent).
  6. Fault or alarming status (code).

7. PID feedback signal (percent).
8. DC-link voltage (V dc).
9. Set point frequency (Hz).
10. Motor output voltage (V ac).

C. Control Signal Interfaces:

1. Electric Input Signal Interface: A minimum of 2 analog inputs (0 to 10 V or 0/4-20 mA).
2. Remote Signal Inputs: Capability to accept any of the following speed-setting input signals from the BMS or other control systems:
  - a. 0 to 10-V dc.
  - b. 0-20 or 4-20 mA.
  - c. RS485.
  - d. Keypad display for local hand operation.
3. Output Signal Interface: A minimum of 1 analog output signal (0/4-20 mA), which can be programmed to any of the following:
  - a. Output frequency (Hz).
  - b. Output current (load).
  - c. DC-link voltage (V dc).
  - d. Motor torque (percent).
  - e. Motor speed (rpm).
  - f. Set point frequency (Hz).

- D. Interface with DDC System for HVAC: Factory-installed hardware and software shall interface with DDC system for HVAC to monitor, control, display, and record data for use in processing reports. VFC settings shall be retained within VFC's nonvolatile memory.

## 2.4 LINE CONDITIONING AND FILTERING

- A. Input Line Conditioning: Based on the manufacturer's harmonic analysis study and report, provide input filtering, as required, to limit total demand (harmonic current) distortion and total harmonic voltage demand at the defined point of common coupling to meet IEEE 519 recommendations.
- B. EMI/RFI Filtering: CE marked; certify compliance with IEC 61800-3 for Category C2.

## 2.5 ENCLOSURES

- A. VFC Enclosures: NEMA 4

## 2.6 SOURCE QUALITY CONTROL

- A. Testing: Test and inspect VFCs according to requirements in **NEMA ICS 61800-2**.
  1. Test each VFC while connected to its specified motor.
  2. Verification of Performance: Rate VFCs according to operation of functions and features specified.

- B. VFCs will be considered defective if they do not pass tests and inspections.
- C. Prepare test and inspection reports.

### **PART 3 - EXECUTION**

#### **3.1 EXAMINATION**

- A. Examine areas, surfaces, and substrates to receive VFCs, with Installer present, for compliance with requirements for installation tolerances, and other conditions affecting performance of the Work.
- B. Examine VFC before installation. Reject VFCs that are wet, moisture damaged, or mold damaged.
- C. Examine roughing-in for conduit systems to verify actual locations of conduit connections before VFC installation.
- D. Prepare written report, endorsed by Installer, listing conditions detrimental to performance of the Work
- E. Proceed with installation only after unsatisfactory conditions have been corrected.

#### **3.2 INSTALLATION**

- A. Wall-Mounting Controllers: Install with tops at uniform height and with disconnect operating handles not higher than 79 inches above finished floor, unless otherwise indicated, and by bolting units to wall or mounting on lightweight structural-steel channels bolted to wall. For controllers not on walls, provide freestanding racks complying with Section 260529 "Hangers and Supports for Electrical Systems."
- B. Comply with NECA 1.

#### **3.3 CONTROL WIRING INSTALLATION**

- A. Install wiring between VFCs and remote devices and facility's central-control system.
- B. Bundle, train, and support wiring in enclosures.

#### **3.4 IDENTIFICATION**

- A. Identify VFCs, components, and control wiring. Comply with requirements for identification specified in Section 260553 "Identification for Electrical Systems."
  - 1. Identify field-installed conductors, interconnecting wiring, and components; provide warning signs.
  - 2. Label each VFC with engraved nameplate.

3. Label each enclosure-mounted control and pilot device.

### 3.5 FIELD QUALITY CONTROL

- A. Manufacturer's Field Service: Engage a factory-authorized service representative to test and inspect components, assemblies, and equipment installations, including connections.
- B. Perform tests and inspections with the assistance of a factory-authorized service representative.
- C. Acceptance Testing Preparation:
  1. Test insulation resistance for each VFC element, bus, component, connecting supply, feeder, and control circuit.
  2. Test continuity of each circuit.
- D. Tests and Inspections:
  1. Inspect VFC, wiring, components, connections, and equipment installation. Test and adjust controllers, components, and equipment.
  2. Test insulation resistance for each VFC element, component, connecting motor supply, feeder, and control circuits.
  3. Test continuity of each circuit.
  4. Verify that voltages at VFC locations are within 10 percent of motor nameplate rated voltages. If outside this range for any motor, notify Engineer before starting the motor.
  5. Test each motor for proper phase rotation.
  6. Perform tests according to the Inspection and Test Procedures for Adjustable Speed Drives stated in NETA Acceptance Testing Specification. Certify compliance with test parameters.
  7. Correct malfunctioning units on-site, where possible, and retest to demonstrate compliance; otherwise, replace with new units and retest.
  8. Perform the following infrared (thermographic) scan tests and inspections, and prepare reports:
    - a. Initial Infrared Scanning: After Substantial Completion, but not more than 60 days after Final Acceptance, perform an infrared scan of each VFC. Remove front panels so joints and connections are accessible to portable scanner.
    - b. Follow-up Infrared Scanning: Perform an additional follow-up infrared scan of each VFC 11 months after date of Substantial Completion.
    - c. Instruments and Equipment: Use an infrared scanning device designed to measure temperature or to detect significant deviations from normal values. Provide calibration record for device.
  9. Test and adjust controls, remote monitoring, and safeties. Replace damaged and malfunctioning controls and equipment.
- E. VFCs will be considered defective if they do not pass tests and inspections.
- F. Prepare test and inspection reports, including a certified report that identifies the VFC and describes scanning results. Include notation of deficiencies detected, remedial action taken, and observations made after remedial action.

### **3.6 STARTUP SERVICE**

- A. Engage a factory-authorized service representative to perform startup service. Complete installation and startup checks according to manufacturer's written instructions.

### **3.7 ADJUSTING**

- A. Program microprocessors for required operational sequences, status indications, alarms, event recording, and display features. Clear events memory after final acceptance testing and prior to Substantial Completion.
- B. Set field-adjustable switches, auxiliary relays, time-delay relays, timers, and overload-relay pickup and trip ranges.
- C. Adjust the trip settings of instantaneous-only circuit breakers and thermal-magnetic circuit breakers with adjustable, instantaneous trip elements. Initially adjust to 6 times the motor nameplate full-load amperes and attempt to start motors several times, allowing for motor cool-down between starts. If tripping occurs on motor inrush, adjust settings in increments until motors start without tripping. Do not exceed 8 times the motor full-load amperes (or 11 times for NEMA Premium Efficient motors if required). Where these maximum settings do not allow starting of a motor, notify Engineer before increasing settings.

### **3.8 PROTECTION**

- A. Replace VFCs whose interiors have been exposed to water or other liquids prior to Substantial Completion.

### **3.9 DEMONSTRATION**

- A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, reprogram, and maintain VFCs. Reference section 017900 Demonstration and Training for additional requirements.

**END OF SECTION 262923**