ADDENDUM NO. 1

TO: PLANS AND SPECIFICATIONS FOR STATE OF MISSOURI

(REBID) Missouri State Fair – Design & Construct New Directors House.
SEDALIA, MO
PROJECT No.: F240201

Bid Opening Date is: 1:30 PM, THURSDAY, NOVEMBER 12TH, 2026 (Not Changed)

Bidders are hereby informed that the Construction Plans and/or Specifications are modified as follows:

SPECIFICATION CHANGES:

1. As an addition to the specifications, please see the attached specification section 096513 Resilient Base and Accessories.

DRAWING CHANGES:

1. Sheets C-100, C-101, and C-102
   a. Changed drawings to omit removal and replacement of asphalt drive listed as Alternate 3. There is no Alternate 3
2. Sheet E-102
   a. See revised keynote reference in the bathroom
3. Sheet E-501
   a. See updated Panel 'P1'.

GENERAL COMMENTS:

1. **The Pre-Bid Meeting was held October 20th, 2026, at 10:00 AM, followed by a walk-through of the site. The Pre-Bid Meeting sign-in sheet is attached.**
2. **Bidders needing additional site inspection should contact Joseph Jisa at 573.690.7120 to schedule a time if access to the facility is required.**
3. **Please contact Contract Specialist, April Howser, at 573-690-9874 or April.Howser@oa.mo.gov , for questions about bidding procedures, MBE\WBE\SDVE goals, and submittal requirements.**
4. **The deadline for technical questions was WEDNESDAY, NOVEMBER 4TH, 2026, at noon.**
5. **Changes to the bid documents are only made as issued in the addenda.**
6. **All correspondence with respect to this project must include the State of Missouri project number as indicated above.**
7. **Current Planholders list available online at: https://www.oafmdcplanroom.com/projects/3446/details/f2402-01-rebid-design-construct-new-directors-house-missouri-state-fairgrounds**
8. **Prospective Bidders contact American Document Solutions, 1400 Forum Blvd Suite 1C, Columbia MO 65201, 573-446-7768 to order official plans and specifications.**
9. **All bids shall be submitted on the bid form without additional terms and conditions, modifications, or stipulations. Each space on the bid form shall be properly filled including a bid amount for the alternate. Failure to do so will result in rejection of the bid.**
10. **MBE/WBE/SDVE/HDVE participation requirements can be found in DIVISION 00. The MBE/WBE/SDVE/HDVE participation goals are 0%/0%/3%/3%, respectively. Only certified firms as of the bid opening date can be used to satisfy the**

MBE/WBE/SDVE/HDVE participation goals for this project. If a bidder is unable to meet a participation goal, a Good Faith Effort Determination Form must be completed. Failure to complete this process will result in rejection of the bid.

11. **The Contractor shall pay not less than the prevailing hourly rate of wages for work of a similar character in the locality in which the work is performed, as determined by the Missouri Department of Labor and Industrial Relations. Bidders are to adhere to Prevailing Wage Hourly Rate of Wages, and the Department of Labor and Industrial Relations can be contacted to determine the applicable wage rate for the work on this project.**

ATTACHMENTS:

1. Pre-bid Meeting Sign-In Sheet
2. Specification Section 096513 Resilient Base and Accessories.
3. Sheets C-100, C-101, C-102, E-102, & E-501

October 30, 2026 *issued date

END ADDENDUM NO. 1

Robert Rollings Architects LLC

208 S. Lamine Avenue
Sedalia, MO 65301
Fax: 660.829.9752, Phone: 660.829.9751

ATTENDANCE SHEET

NAME: F2402 Director's House Re-Bid
NUMBER: Pre-Bid attendance
DATE: 10/20/2026

Project:
Job Number:

Attendee	Company	Telephone
JEFF CARVER	C + C ELECTRIC	660-281-2539
Jordan Daugherty	REI Development	(660) 924-1128
Don Wheeler	Westport Constr	660 885-2231
Mason Ailstock	PCE Construction	(573) 881-2035
Vance Jisa	OA - FMDC	(573)-690-7120
AARON KENNEDY	ROBERT ROLLINGS ARCHITECTS	660-829-9751 ext 1
JUSTIN ANDERSON	MISSOURI STATE FAIRGROUNDS	660-317-8740
JESSE FLOWER	OA - FMDC	573-619-4395

Robert Rollings Architects LLC

208 S. Lamine Avenue
Sedalia, MO 65301
Fax: 660.829.9752, Phone: 660.829.9751

ATTENDANCE SHEET

NAME: F2402 Director's House Re-Bid
NUMBER: Pre-Bid attendance
DATE: 10/20/2026

Project:
Job Number:

Attendee	Company	Telephone
~~LEAP FACILITY & DOOR~~ / PRODIGAL SON ~~GARAGE~~ DOORS		
BRODIE LEAP	LEAP FACILITY & DOOR PRODIGAL SONS GARAGE DOOR	660-624-8707
Scott Schieber	Reinhardt Construction	(573) 999-6865
Heather Chambers	McCollister Construction	660-620-2544
Josh Hettinger	Anchor Contractors LLC	660-988-1234

ADDENDUM 1

SECTION 096513 - RESILIENT BASE AND ACCESSORIES

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Resilient base.

1.2 ACTION SUBMITTALS

A. Product Data: For each type of product indicated.

B. Samples: For each type of product indicated, in manufacturer's standard-size sample chain with full range of each resilient product color, texture, and pattern required.

1.3 QUALITY ASSURANCE

A. Fire-Test-Response Characteristics: As determined by testing identical products according to ASTM E 648 or NFPA 253 by a qualified testing agency.

1. Critical Radiant Flux Classification: Class I, not less than 0.45 W/sq. cm.

1.4 PROJECT CONDITIONS

A. Maintain ambient temperatures within range recommended by manufacturer in spaces to receive resilient products.

B. Until Substantial Completion, maintain ambient temperatures within range recommended by manufacturer.

C. Install resilient products after other finishing operations, including painting, have been completed.

1.5 EXTRA MATERIAL

A. Provide 120 linear. ft. of each type, color, and pattern utilized.

PART 2 - PRODUCTS

2.1 RESILIENT BASE

A. Resilient Base:

A. Basis-of-Design Product:
   1. Roppe Pinnacle Rubber Base, 4” standard toe base 5/8” or Johnsonite, Dura-Cove Thermoplastic Rubber, or similar by Shaw Contract or Mannington Commercial.
   2. Color: As selected by architect from manufacturer’s full range of standard colors.
   3. Material: Rubber
   4. Length: Coils in manufacturer’s standard length.
   5. Inside and outside corners: Preformed
   6. Finish: As selected by architect from manufacturer’s full range.
   7. Or approved equal.

2.2 INSTALLATION MATERIALS

A. Trowelable Leveling and Patching Compounds: Latex-modified, portland cement based or blended hydraulic-cement-based formulation provided or approved by manufacturer for applications indicated.

B. Adhesives: Water-resistant type recommended by manufacturer to suit resilient products and substrate conditions indicated.

   1. Adhesives shall have a VOC content of 50 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24), except that adhesive for rubber stair treads shall have a VOC content of 60 g/L or less.
   2. Adhesives shall comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."

C. Floor Polish: Provide protective liquid floor polish products as recommended by resilient stair tread manufacturer.

PART 3 - EXECUTION

3.1 PREPARATION

A. Prepare substrates according to manufacturer's written instructions to ensure adhesion of resilient products.

B. Fill cracks, holes, and depressions in substrates with trowelable leveling and patching compound and remove bumps and ridges to produce a uniform and smooth substrate.

C. Do not install resilient products until they are same temperature as the space where they are to be installed.

   1. Move resilient products and installation materials into spaces where they will be installed at least 48 hours in advance of installation.

D. Sweep and vacuum clean substrates to be covered by resilient products immediately before installation.

ADDENDUM 1

3.2 RESILIENT BASE INSTALLATION

A. Comply with manufacturer's written instructions for installing resilient base.

B. Apply resilient base to walls, columns, pilasters, casework and cabinets in toe spaces, and other permanent fixtures in rooms and areas where base is required.

C. Install resilient base in lengths as long as practicable without gaps at seams and with tops of adjacent pieces aligned.

D. Tightly adhere resilient base to substrate throughout length of each piece, with base in continuous contact with horizontal and vertical substrates.

E. Do not stretch resilient base during installation.

3.3 CLEANING AND PROTECTION

A. Comply with manufacturer's written instructions for cleaning and protection of resilient products.


B. Floor Polish: Remove soil, visible adhesive, and surface blemishes from resilient stair treads before applying liquid floor polish.

1. Apply two coat(s).

2. Coordinate polish type with owner and architect prior to application.

C. Cover resilient products until Substantial Completion.

END OF SECTION 096513

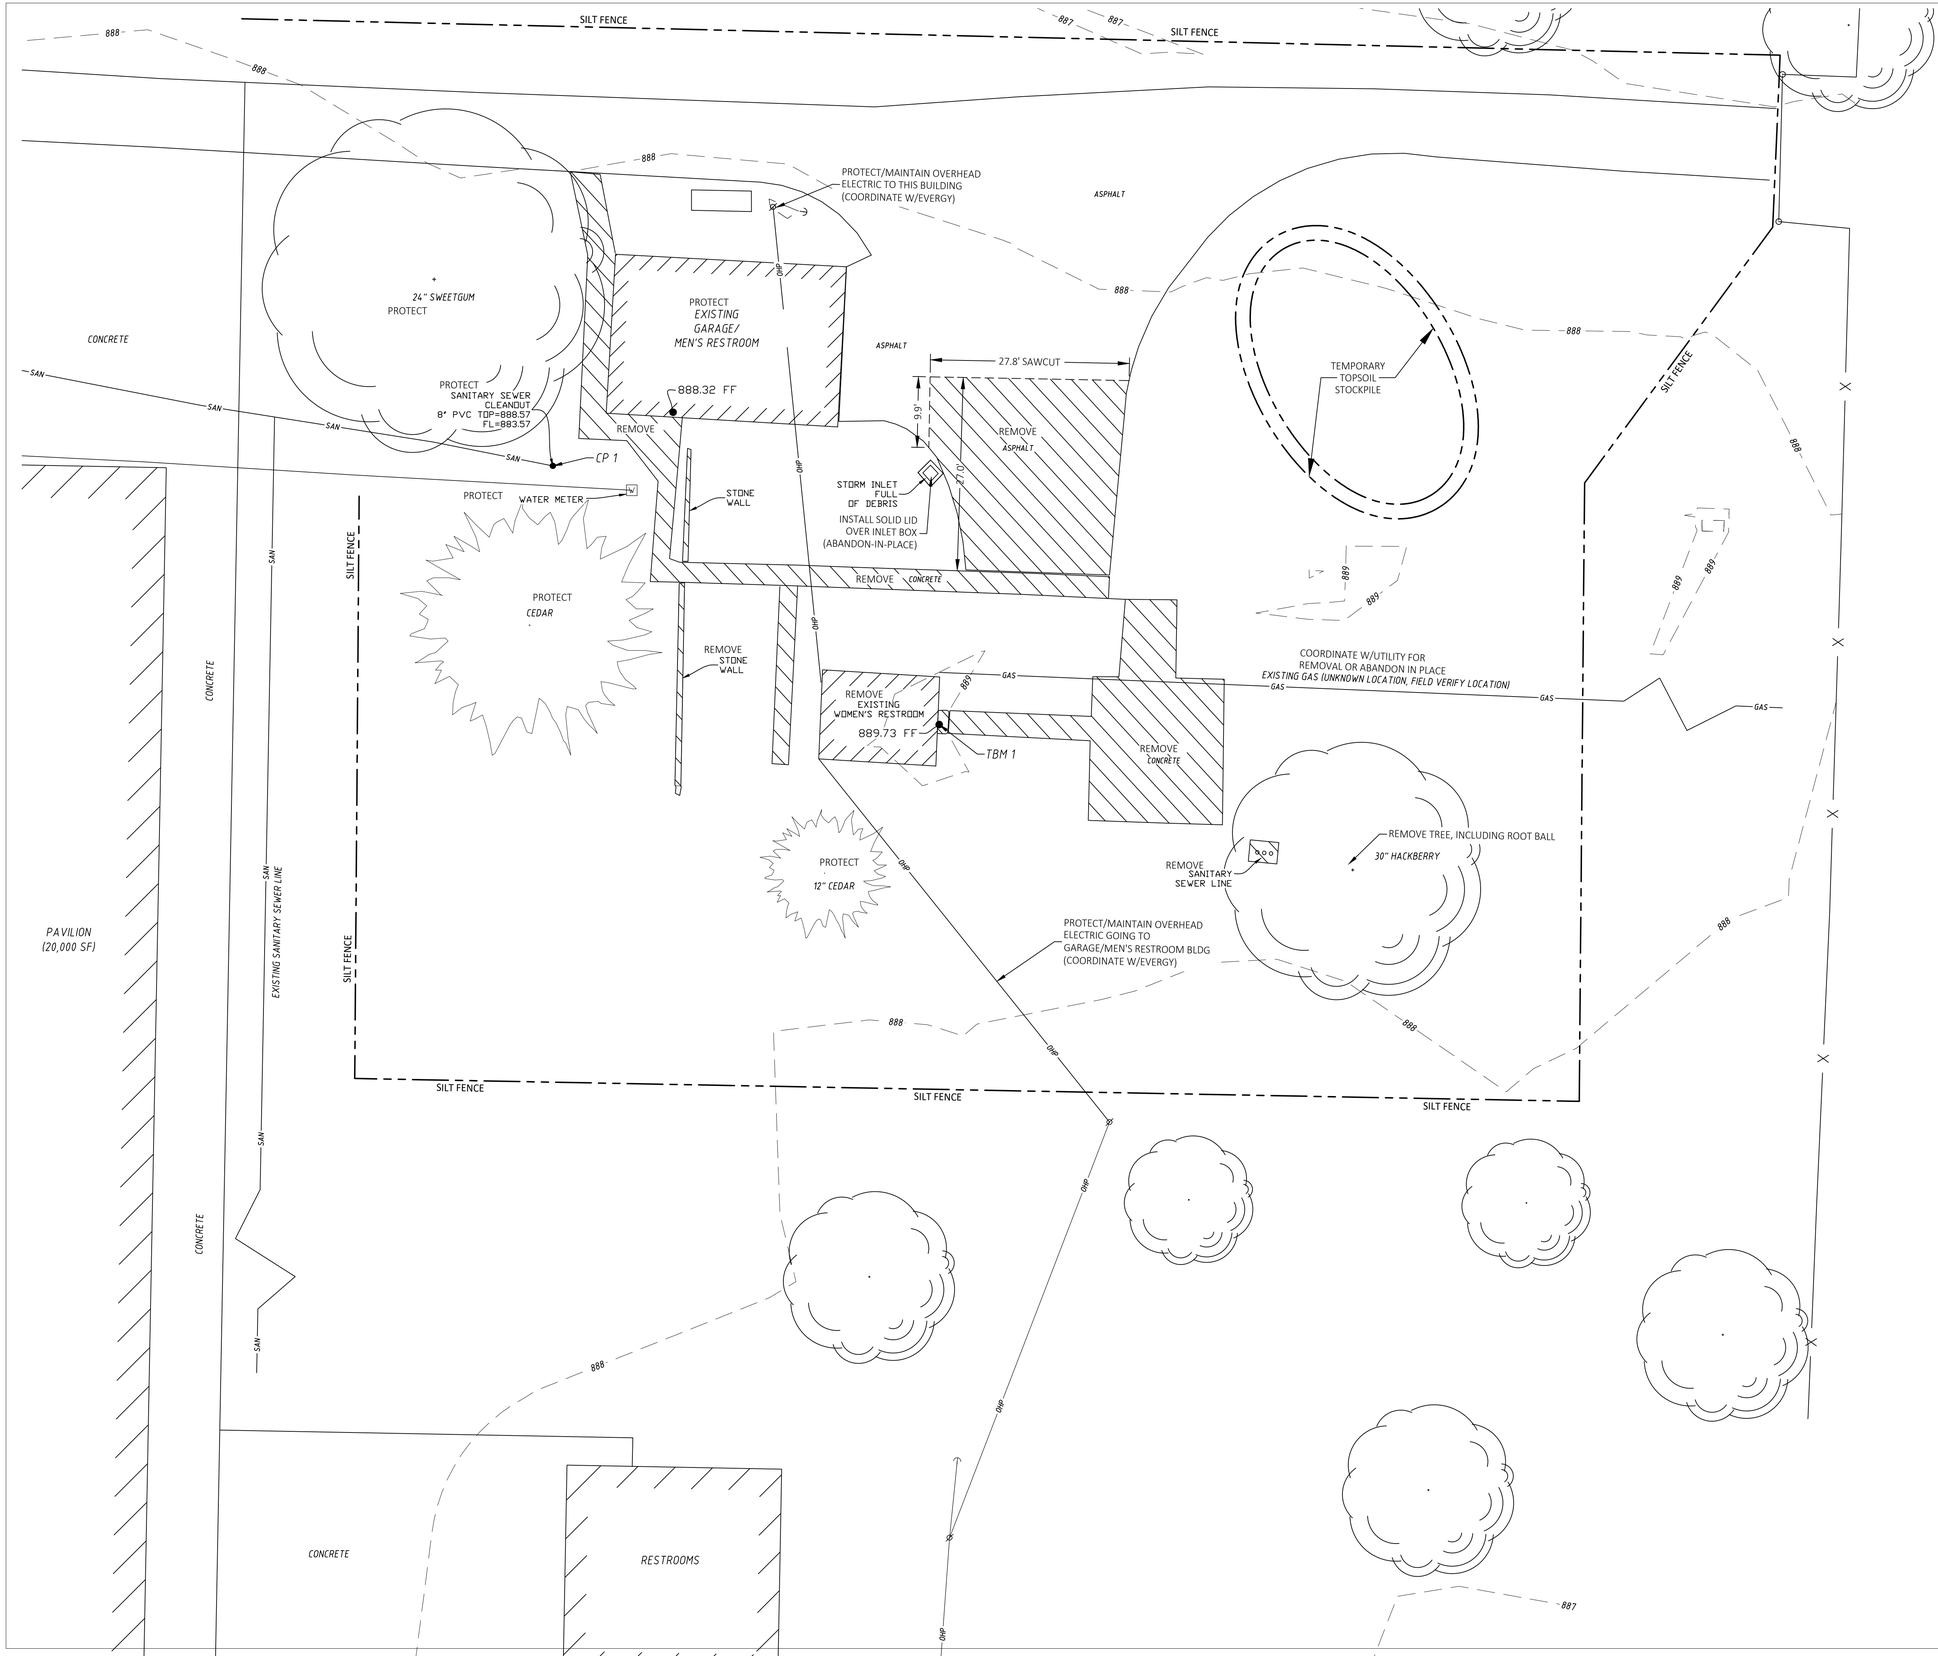

LEGEND

100	EXISTING SURFACE CONTOUR
SS	STORM SEWER LINE
SAN	SANITARY SEWER LINE
G	GAS LINE
UT	UNDERGROUND TELEPHONE LINE
UE	UNDERGROUND ELECTRIC LINE
W	WATER LINE
	SILT FENCE
	REMOVE (DEMO) CONCRETE /ASPHALT PAVEMENT

EROSION CONTROL NOTES:

1. CONTRACTOR SHALL INSTALL PERIMETER SILT FENCE AS NECESSARY TO PREVENT SEDIMENT FROM LEAVING THE SITE.

DEMOLITION NOTES:

1. CONTRACTOR SHALL COORDINATE ALL DEMOLITION WITH OWNER AND UTILITIES.
2. ALL OTHER ITEMS SHALL BE PROTECTED.
3. CONTRACTOR SHALL HAUL DISPOSAL ITEMS TO AN APPROVED LOCATION, OFF-SITE IF REQUIRED, COORDINATE WITH OWNER.

STATE OF MISSOURI
MIKE KEHOE
GOVERNOR

STATE OF MISSOURI
THERON J. BROADFOOT
NUMBER PE-2009015435
PROFESSIONAL ENGINEER
10-31-26

Theron J. Broadfoot, PE-2009015435
MO CERTIFICATE OF AUTHORITY # 2018030429

Robert Rollings Architects LLC
208 South Lamine
Sedalia, MO 65301
Phone: 660.826.3751
Fax: 660.826.3752

J-SQUARED ENGINEERING
2400 BLUFF CREEK DR. STE. 101
COLUMBIA, MO 65201
573.234.4492 phone
www.j-squaredeng.com

Broadfoot Engineering, LLC
30277 Carpenter Road
Sedalia, MO 65301
Phone: 660-619-7001
broadfooteng@yahoo.com

CROCKETT ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1.
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES MANAGEMENT DESIGN AND CONSTRUCTION
REBID, NEW DIRECTOR'S HOUSE

MISSOURI STATE FAIRGROUNDS
2503 W. 16TH ST
SEDALIA, MO 65301

PROJECT # F2402-01

SITE # 1501

ASSET # 3511501149

REVISION: ADDENDUM 1
DATE: 10/30/2026

ISSUE DATE: 06/10/2026

BID DOCUMENTS


CAD DWG FILE:
DRAWN BY: TJB
CHECKED BY: TJB
DESIGNED BY: TJB

SHEET TITLE:

EXISTING CONDITIONS & DEMOLITION PLAN

SHEET NUMBER:

C-100

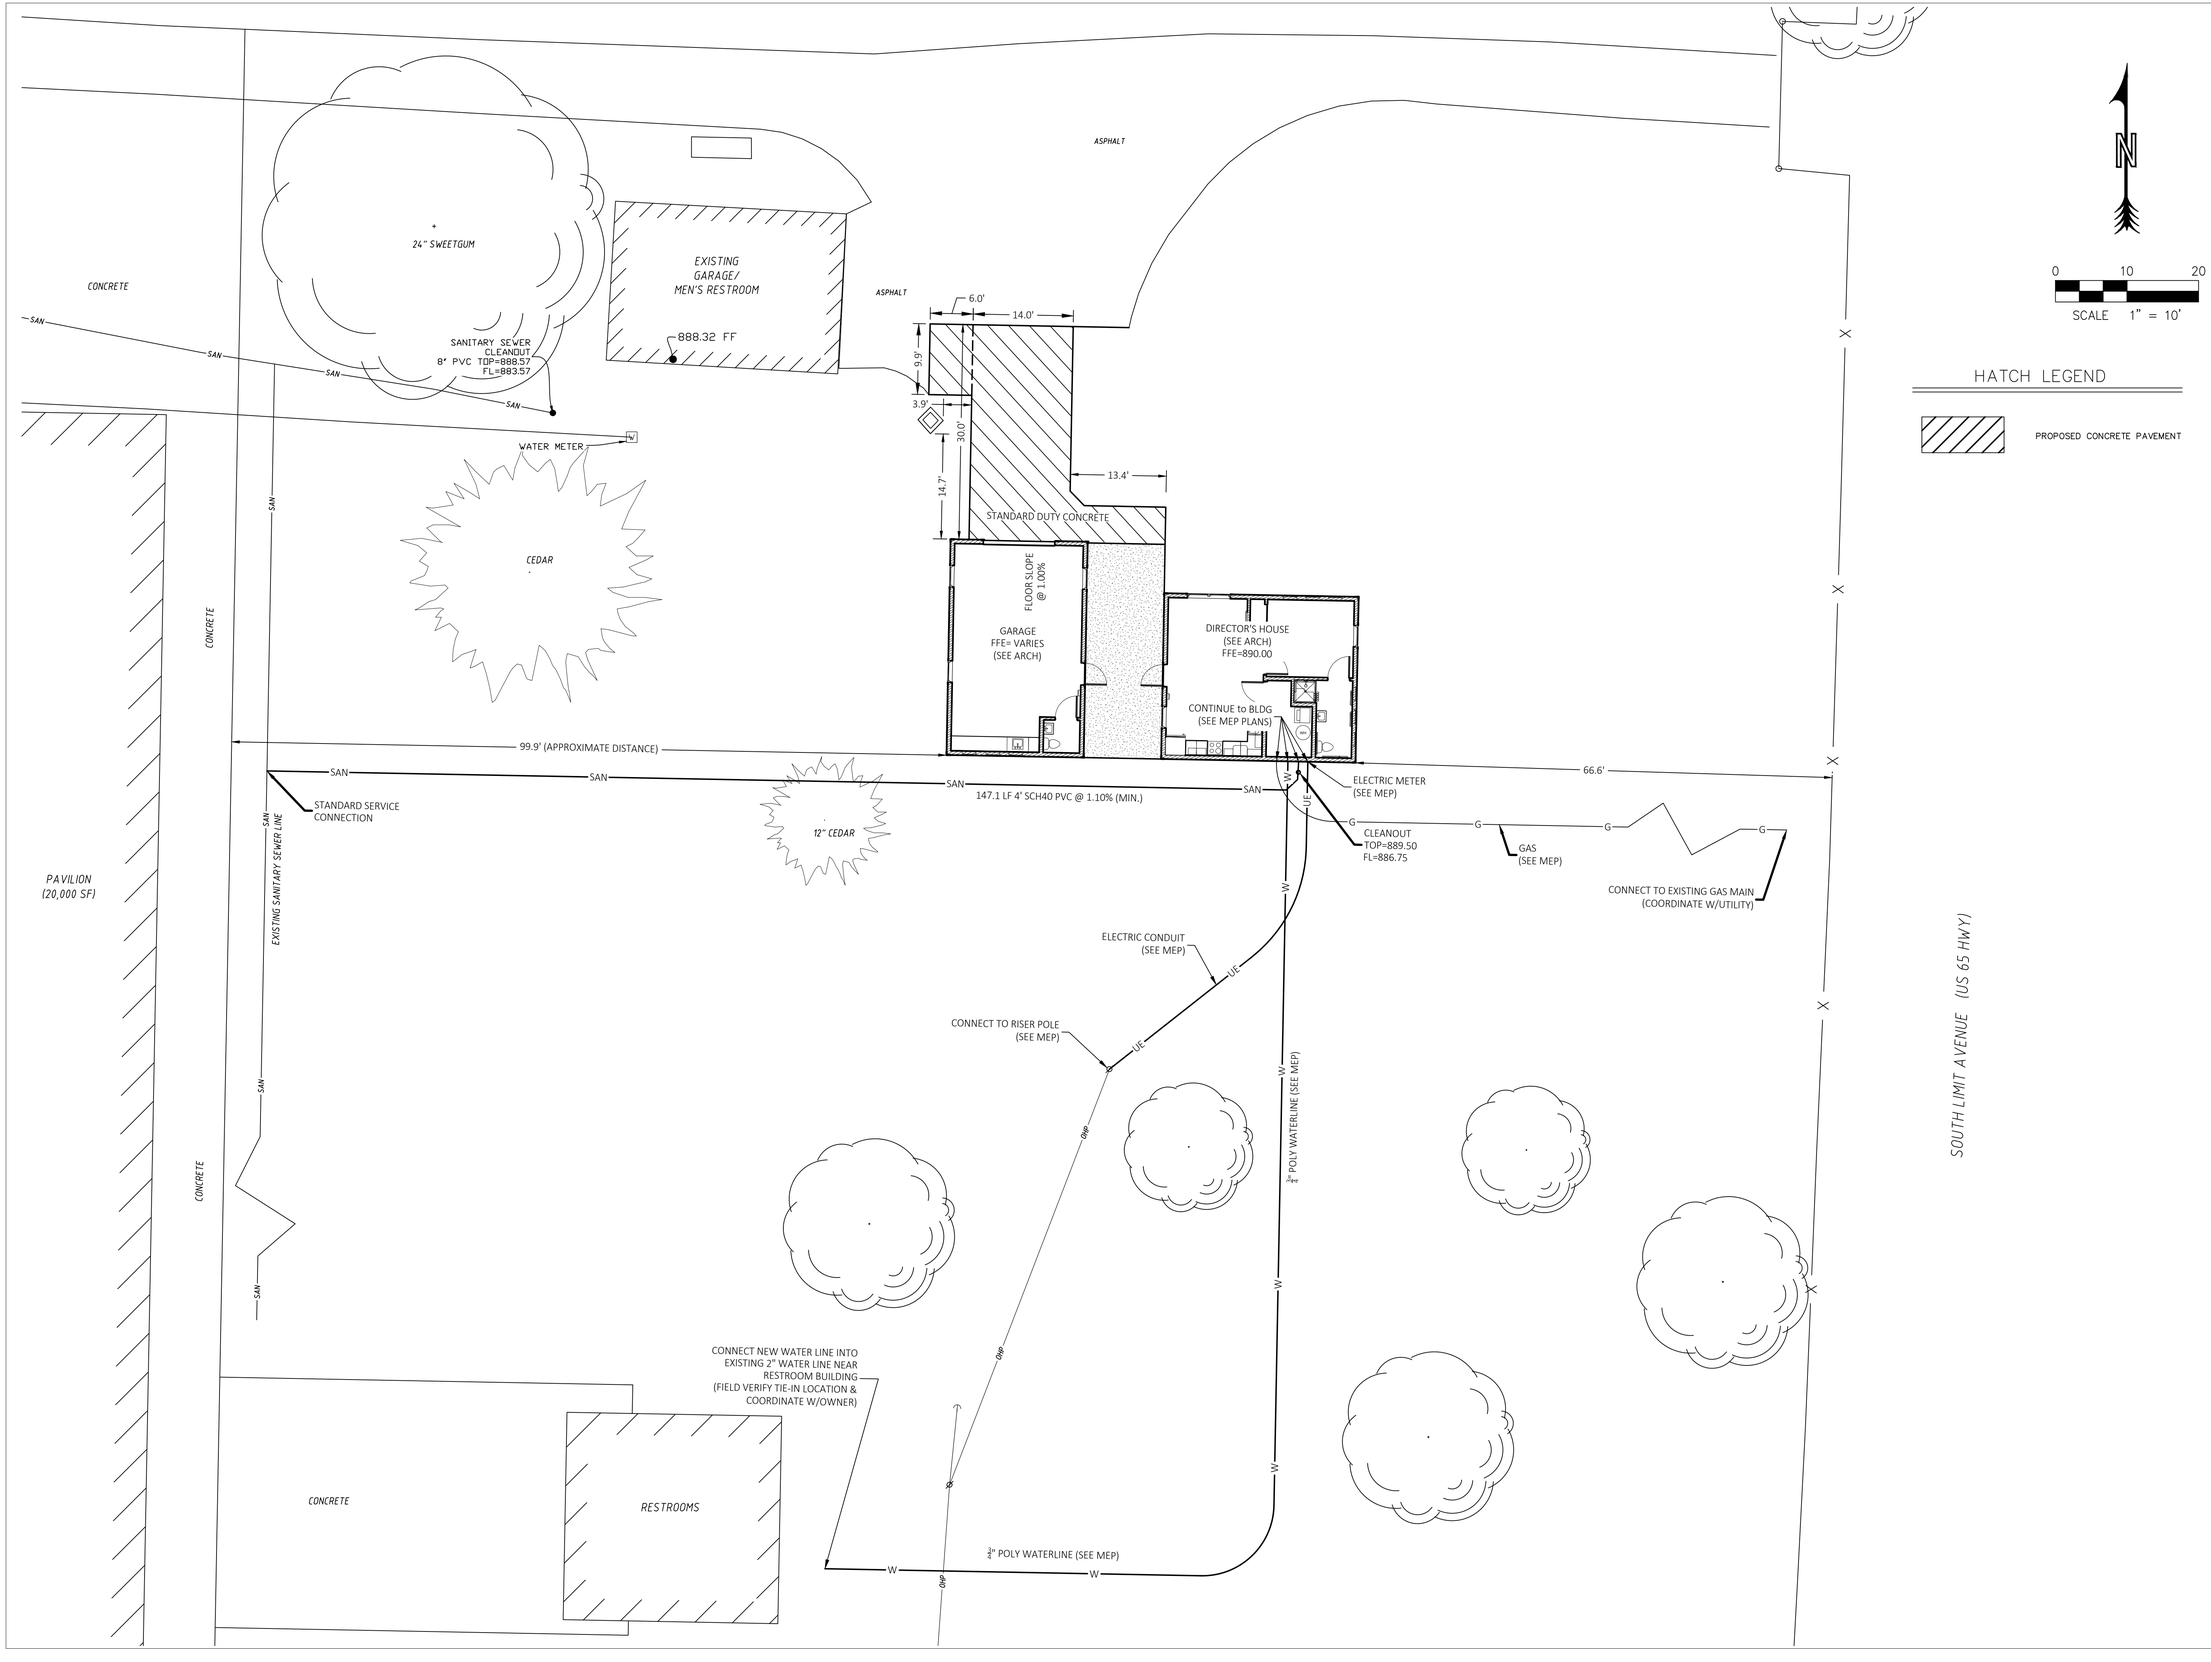

STATE OF MISSOURI
MIKE KEHOE
GOVERNOR

STATE OF MISSOURI
THERON J. BROADFOOT
NUMBER PE-2009015435
PROFESSIONAL ENGINEER
10-31-26

Theron J. Broadfoot, PE-2009015435
MO CERTIFICATE OF AUTHORITY # 2018030429

Robert Rollings Architects LLC
208 South Lamine
Sedalia, MO 65301
Phone: 660.827.9751
Fax: 660.827.9752

J-SQUARED ENGINEERING
2400 BLUFF CREEK DR. STE. 101
COLUMBIA, MO 65201
573.234.4492 phone
www.j-squaredeng.com

Broadfoot Engineering, LLC
30277 Carpenter Road
Sedalia, MO 65301
Phone: 660-619-7001
broadfooteng@yahoo.com

CROCKETT ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1.
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES MANAGEMENT DESIGN AND CONSTRUCTION
REBID, NEW DIRECTOR'S HOUSE

MISSOURI STATE FAIRGROUNDS
2503 W. 16TH ST
SEDALIA, MO 65301

PROJECT # F2402-01

SITE # 1501

ASSET # 3511501149

REVISION: ADDENDUM 1
DATE: 10/30/2026

ISSUE DATE: 06/10/2026

BID DOCUMENTS


CAD DWG FILE:
DRAWN BY: TJB
CHECKED BY: TJB
DESIGNED BY: TJB

SHEET TITLE:

SITE LAYOUT & UTILITY PLAN

SHEET NUMBER:

C-101

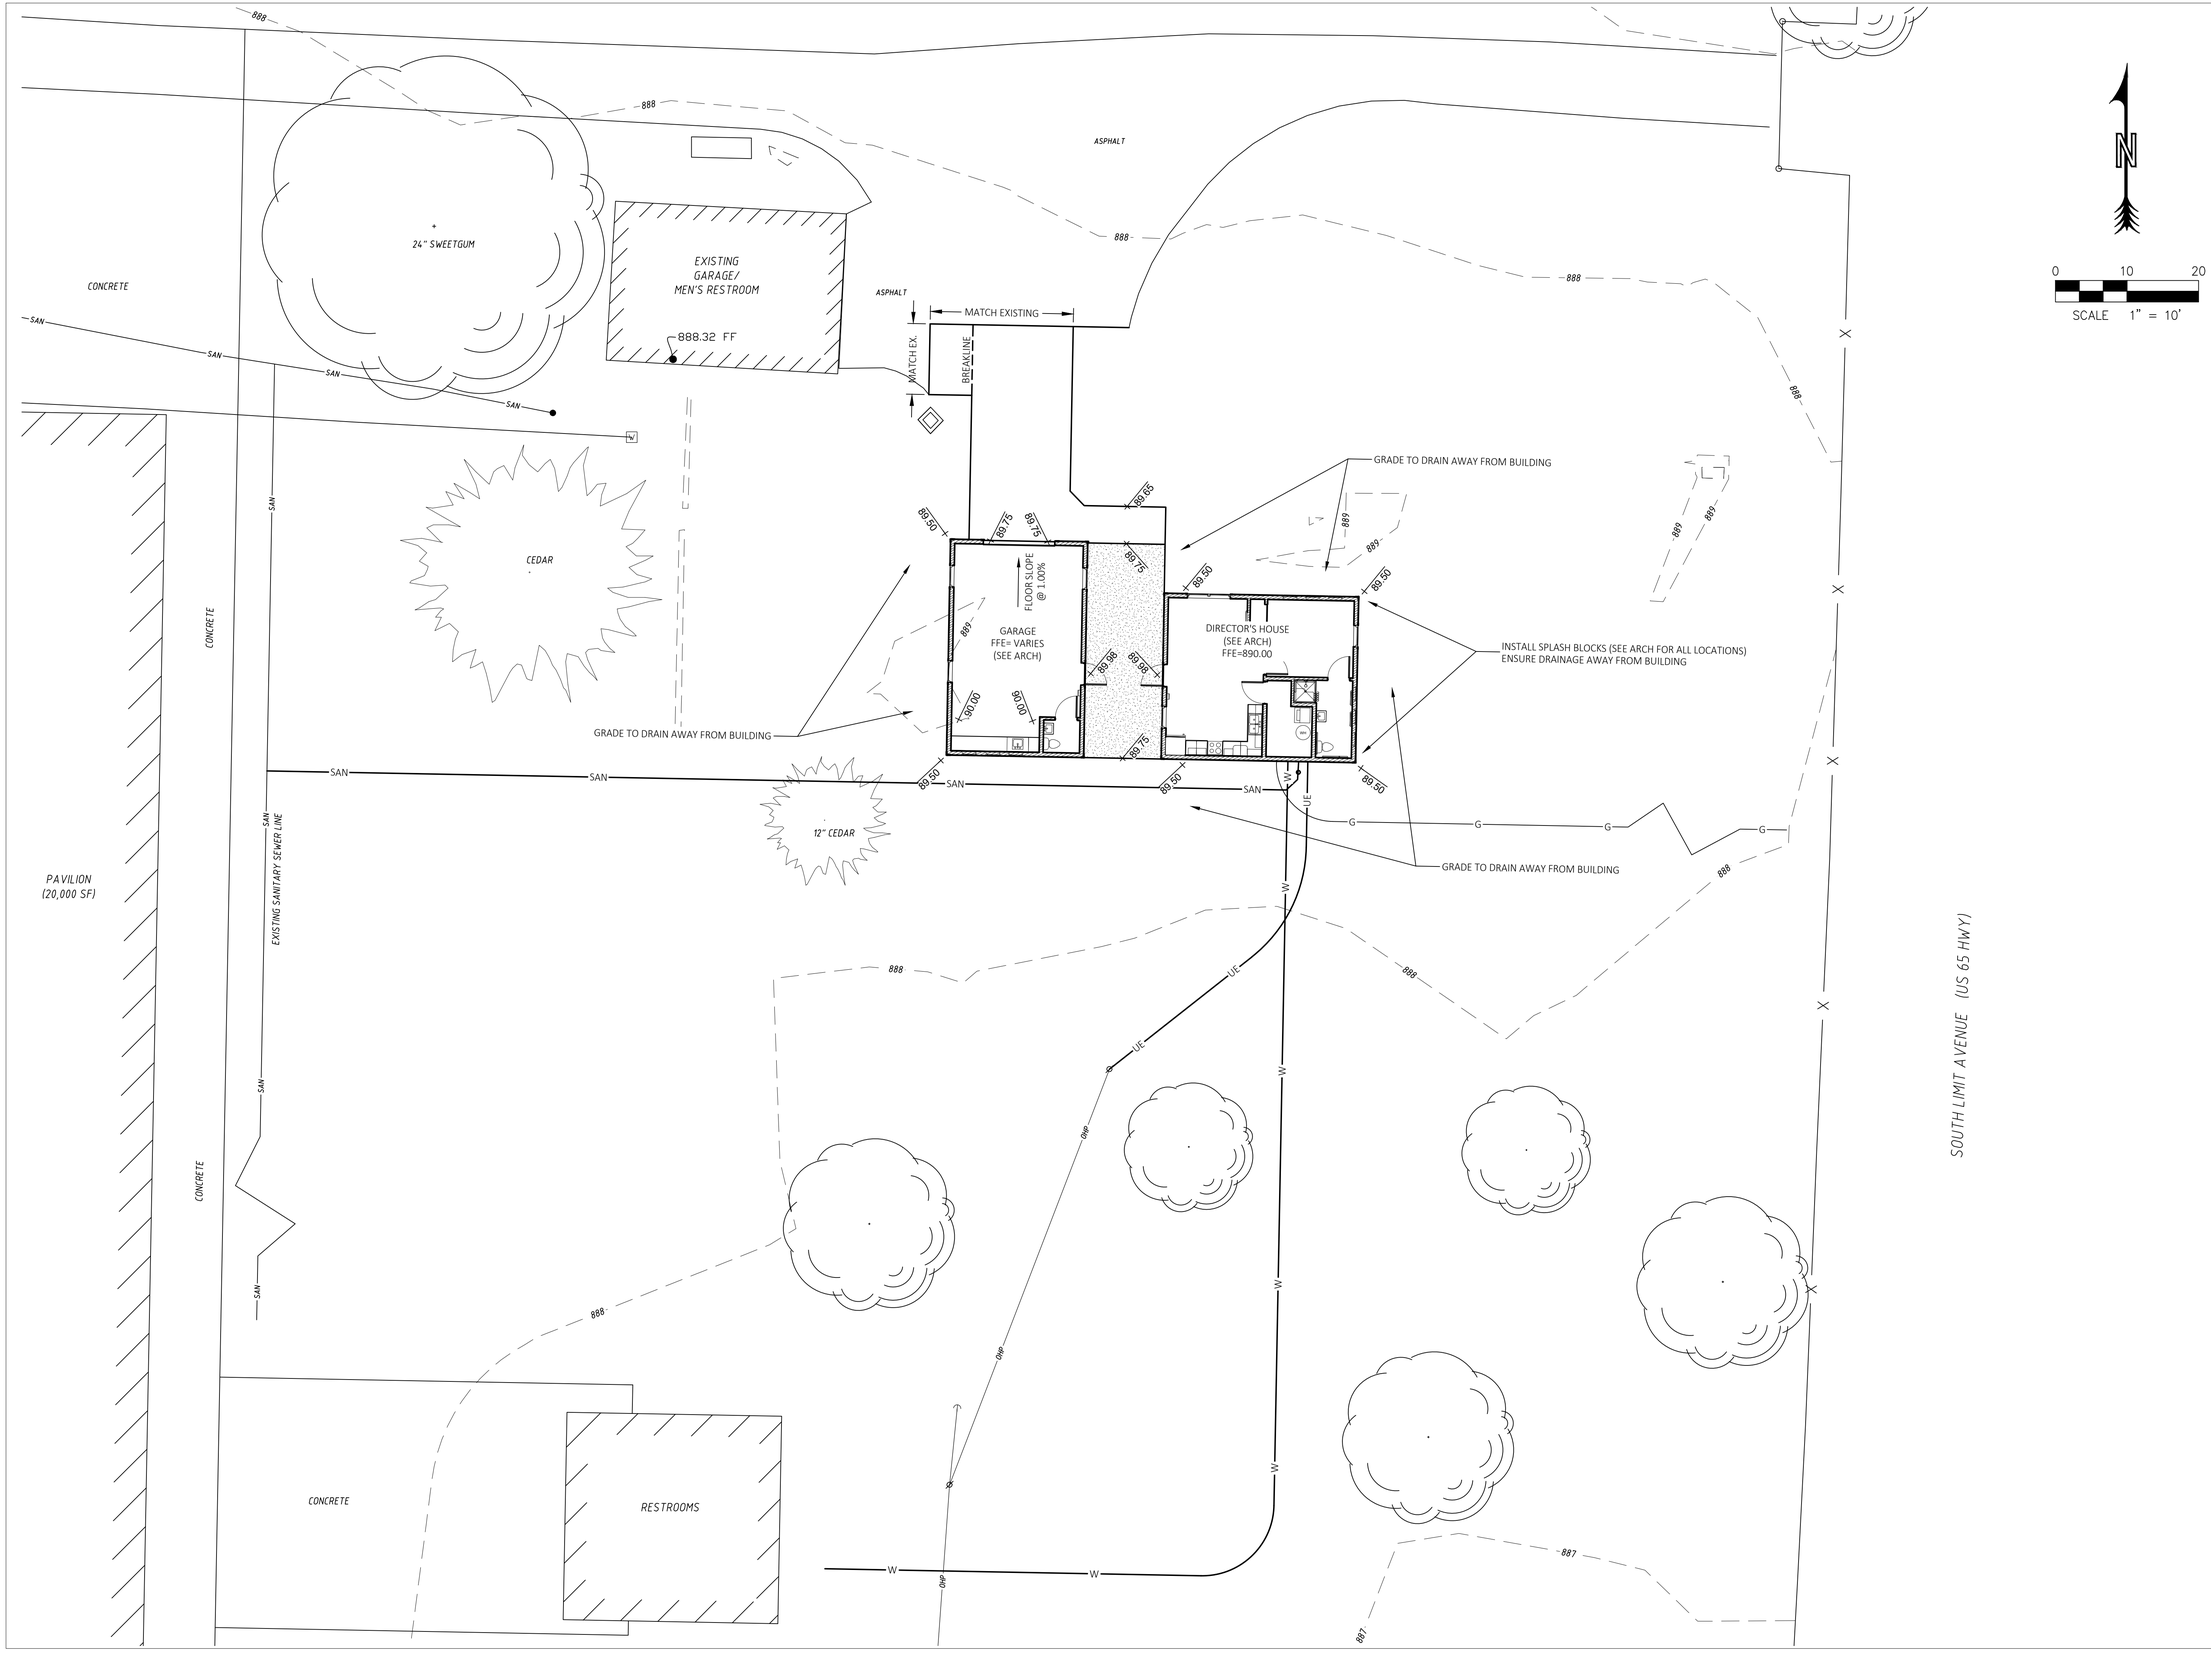

STATE OF MISSOURI
MIKE KEHOE
GOVERNOR

STATE OF MISSOURI
THERON J. BROADFOOT
NUMBER PE-2009015435
PROFESSIONAL ENGINEER
10-31-26

Theron J. Broadfoot, PE-2009015435
MO CERTIFICATE OF AUTHORITY # 2018030429

Robert Rollings Architects LLC
208 South Lamine
Sedalia, MO 65301
Phone: 660.827.9751
Fax: 660.827.9752

J-SQUARED ENGINEERING
2400 BLUFF CREEK DR. STE. 101
COLUMBIA, MO 65201
573.234.4492 phone
www.j-squaredeng.com

Broadfoot Engineering, LLC
30277 Carpenter Road
Sedalia, MO 65301
Phone: 660-619-7001
broadfooteng@yahoo.com

CROCKETT
ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1.
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES MANAGEMENT DESIGN AND CONSTRUCTION
REBID, NEW DIRECTOR'S HOUSE

MISSOURI STATE FAIRGROUNDS
2503 W. 16TH ST
SEDALIA, MO 65301

PROJECT # F2402-01

SITE # 1501

ASSET # 3511501149

REVISION: ADDENDUM 1
DATE: 10/30/2026

ISSUE DATE: 06/10/2026

BID DOCUMENTS

CAD DWG FILE:
DRAWN BY: TJB
CHECKED BY: TJB
DESIGNED BY: TJB

SHEET TITLE:

GRADING & DRAINAGE PLAN

SHEET NUMBER:

C-102

LIGHTING PLAN SYMBOL LEGEND

X1
EM
NL

"X1" INDICATES FIXTURE TYPE (REFER TO SCHEDULE)

LIGHTING FIXTURE

"EM" INDICATES EMERGENCY BATTERY BACKUP

"NL" INDICATES UN-SWITCHED NIGHT LIGHT

EXIT LIGHT

INDICATES REQUIRED REMOTE HEAD

EMERGENCY EGRESS LIGHT

SWITCH (WALL MOUNTED)

SWITCH TYPE:
- 3 = 3-WAY
- 4 = 4-WAY
- OP = PASSIVE INFRARED OCCUPANCY SENSOR
- OU = ULTRASONIC OCCUPANCY SENSOR
- OT = DUAL-TECHNOLOGY OCCUPANCY SENSOR
- VP = PASSIVE INFRARED VACANCY SENSOR
- VU = ULTRASONIC VACANCY SENSOR
- VT = DUAL-TECHNOLOGY VACANCY SENSOR
- M = MOMENTARY SWITCH
- SS = SCENE SWITCH

DIMMER SWITCH (WALL MOUNTED)

SWITCH TYPE:
- SEE "SWITCH (WALL MOUNTED)" FOR TYPE DESIGNATIONS

SWITCH (CEILING MOUNTED)


SWITCH TYPE:
- SEE "SWITCH (WALL MOUNTED)" FOR TYPE DESIGNATIONS

LIGHTING PLAN GENERAL NOTES:

1. REFER TO E500 AND/OR E600 SERIES SHEETS FOR ADDITIONAL LIGHTING NOTES, DETAILS, REQUIREMENTS, AND SCHEDULES.
2. OCCUPANCY/VACANCY SENSOR QUANTITIES AND GENERAL LOCATIONS SHOWN FOR REFERENCE ONLY. CONTRACTOR TO PROVIDE & INSTALL SENSOR WITH SPACING PER MANUFACTURER'S SPECIFICATIONS AND INCLUDE ADDITIONAL SENSORS IF NECESSARY. CEILING-MOUNTED SENSORS SHALL BE INSTALLED WITHIN MANUFACTURER'S ACCEPTABLE MOUNTING HEIGHT RANGE.
3. ELECTRICAL CONTRACTOR SHALL REVIEW ALL PROJECT DOCUMENTS AND COORDINATE LOCATION OF ALL FIXTURES, WIRING, HANGERS / SUPPORTS, ETC. WITH HVAC AND PLUMBING TRADES BEFORE INSTALLATION OF ANY MATERIAL. ADDITIONAL COSTS ASSOCIATED WITH LACK OF COORDINATION WILL NOT BE REIMBURSED.

LIGHTING PLAN KEY NOTES:

1. LIGHT SWITCH SHALL CONTROL EXHAUST FAN.

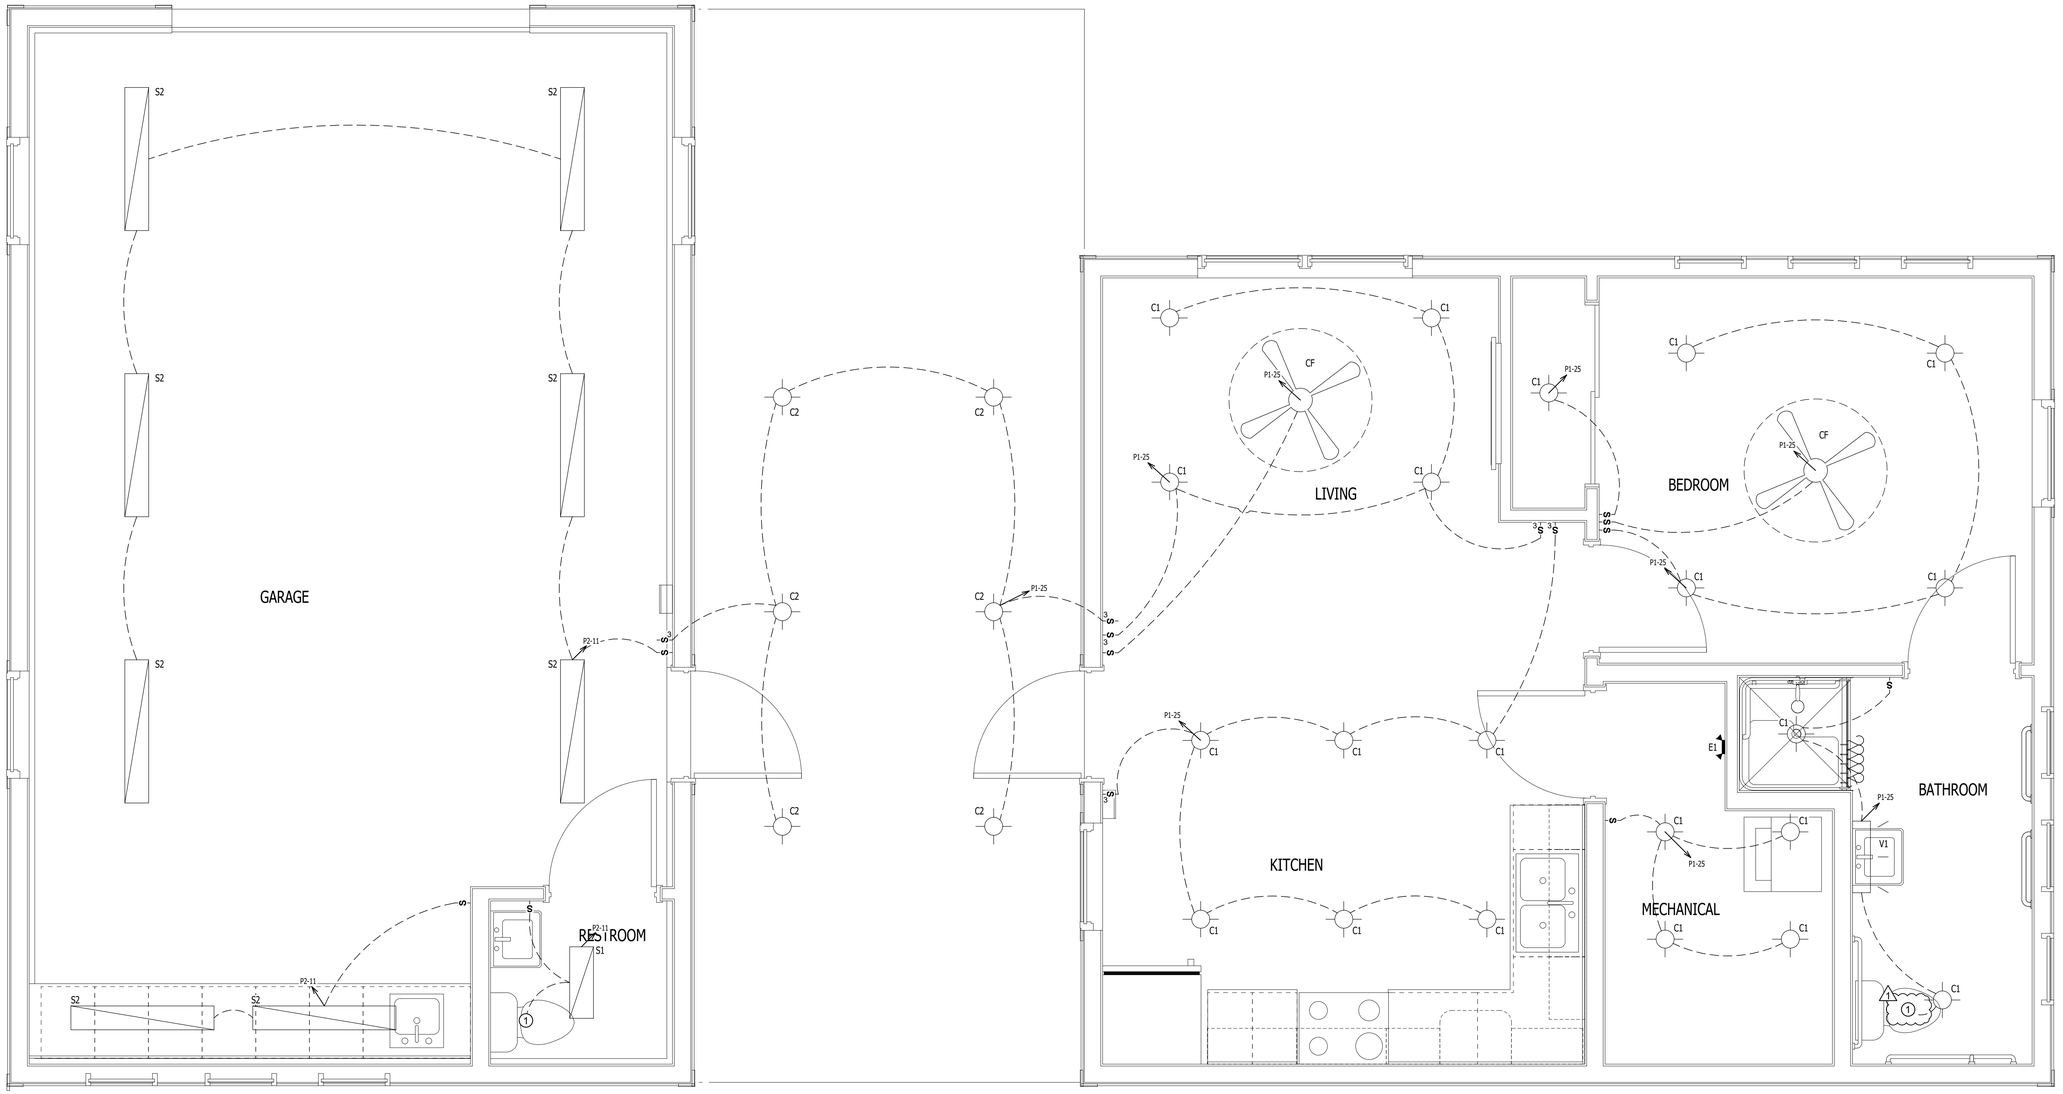

LIGHTING PLAN

SCALE: 1/2" = 1'-0"

STATE OF MISSOURI
MIKE KEHOE
GOVERNOR

STATE OF MISSOURI
KEATON F. LEISINGER
NUMBER PE-2021035875
PROFESSIONAL ENGINEER
10/30/2026

KEATON F. LEISINGER, PE - 2021035875
MO CERTIFICATE OF AUTHORITY # 2018029680

Robert Rollings Architects LLC
208 S Lamine
SEDALIA, MO 65301
PHONE: 660 829 9151
FAX: 660 829 9152

J-SQUARED ENGINEERING
2400 BLUFF CREEK DR. STE. 101
COLUMBIA, MO 65201
573.234.4492 phone
www.j-squaredeng.com

Broadfoot Engineeing, LLC
30277 Carpenter Road
Sedalia, MO 65301
Phone: 660-619-7001
broadfooteng@yahoo.com

CROCKETT ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1,
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES MANAGEMENT DESIGN AND CONSTRUCTION
REBID, NEW DIRECTOR'S HOUSE

MISSOURI STATE FAIRGROUNDS
2503 W. 16TH ST
SEDALIA, MO 65301

PROJECT # F2402-01

SITE # 1501

ASSET # 3511501149

REVISION: ADDENDUM #1 (1)
DATE: 10-30-2026

ISSUE DATE: 06/10/2026
BID DOCUMENTS

CAD DWG FILE:
DRAWN BY: AMK
CHECKED BY: RDR
DESIGNED BY: AMK

SHEET TITLE:

LIGHTING PLAN

SHEET NUMBER:

E-102

LIGHT FIXTURE SCHEDULE

TAG	MANUFACTURER (OR EQUAL)	MODEL NUMBER (OR EQUAL)	DESCRIPTION	MOUNTING	LUMEN OUTPUT	CCT (°K)	CRI	VOLTAGE	WATTS	DIMMING	NOTES
C1	HALO	SMX6RLSFS010	6" ROUND LED DOWNLIGHT	SURFACE	1200	3000	80	120	13	0-10V	SELECTABLE FIXTURE. CONTRACTOR SHALL INSTALL PER SCHEDULE
C2	HALO	SMX4RLSFS010	4" ROUND LED DOWNLIGHT	SURFACE	650	4000	80	120	7	0-10V	SELECTABLE FIXTURE. CONTRACTOR SHALL INSTALL PER SCHEDULE
CF	HUNTER	PRESTO	44" CEILING FAN	SURFACE	-	-	-	120	38	-	NO LIGHT KIT
E1	SURE LITES	APEL	EMERGENCY EGRESS LIGHT	WALL	-	-	-	UNV	1	-	MOUNT AT 7' A.F.F.
S1	METALUX	2SLSTP2040DD-120V	2' LINEAR	SURFACE	2600	4000	80	120	22	0-10V	
S2	METALUX	4SLSTP4040DD-120V	4' LINEAR	SURFACE	5000	4000	80	120	40	0-10V	
V1	VISUAL COMFORT & CO.	VS24304ORB	VANITY	WALL	3200	3000	90	120	40	-	MOUNTED ABOVE MIRROR

NOTES:
1. VERIFY LIGHT FIXTURE FINISHES WITH OWNER / ARCHITECT PRIOR TO INSTALLATION.
2. REFER TO ARCHITECTURAL REFLECTED CEILING PLAN FOR CEILING TYPES THROUGHOUT. COORDINATE EXACT MOUNTING DETAILS WITH GENERAL CONTRACTOR.

BRANCH CIRCUIT CONDUCTOR SCHEDULE

AMPACITY	COPPER AWG SIZE	MAXIMUM DISTANCE (FEET) 1Ø 120V	1Ø 277V	3Ø 208V	3Ø 480V	MINIMUM CONDUIT SIZE
20	12	55'	130'	115'	260'	1/2"
	10	90'	205'	180'	415'	3/4"
30	10	60'	135'	120'	275'	3/4"
	8	95'	220'	190'	445'	1"
35	8	80'	190'	165'	380'	1"
	6	130'	300'	260'	605'	1"
40	8	70'	165'	145'	330'	1"
	6	110'	260'	225'	525'	1"
45	6	100'	235'	200'	470'	1'
	4	160'	370'	325'	750'	1-1/4"
50	6	90'	210'	180'	420'	1-1/4"
	4	145'	335'	290'	675'	1-1/4"
60	6	75'	175'	150'	350'	1-1/4"
	4	120'	280'	240'	560'	1-1/4"
70	4	105'	240'	205'	480'	1-1/4"
	3	130'	300'	260'	605'	1-1/4"
80	4	55'	210'	180'	420'	1-1/4"
	3	90'	260'	230'	530'	1-1/4"
90	3	105'	245'	210'	490'	1-1/4"
	2	130'	300'	260'	600'	1-1/4"
100	2	115'	270'	235'	540'	1-1/4"
	1	140'	330'	285'	660'	1-1/4"

NOTES:
1. ALL BRANCH CIRCUIT CONDUCTORS SHALL BE COPPER. ALL WIRE SIZES SHOWN ARE BASED ON CONDUCTOR TEMPERATURE RATING OF 60°C & AMBIENT TEMPERATURE OF 30°C PER NEC.
2. DISTANCE SHOWN ABOVE IS LENGTH FROM OVERCURRENT PROTECTION TO DEVICE/EQUIPMENT.
3. REFER TO PLAN SHEETS FOR BRANCH CONDUCTOR SIZING LENGTHS GREATER THAN SHOWN ABOVE.
4. VOLTAGE DROP CALCULATIONS BASED ON 3% DROP, 80% CIRCUIT LOAD, THHN/THWN INSULATION, 100% POWER FACTOR, BALANCED LOAD, NEGLIGIBLE REACTANCE, & SIX OR LESS CURRENT-CARRYING CONDUCTORS IN RACEWAY.

FEEDER CONDUCTOR SCHEDULE

AMPACITY	CONDUCTORS # OF SETS	QUANTITY PER SET 3Ø 'WYE'	1Ø OR 3Ø▲	AWG SIZE COPPER	AWG SIZE ALUMINUM	EQUIPMENT GROUND AWG SIZE COPPER	EQUIPMENT GROUND AWG SIZE ALUMINUM	MINIMUM CONDUIT SIZE (PER SET)
30	1	4	3	10	8	10	8	3/4"
40	1	4	3	8	8	8	8	1"
45	1	4	3	8	6	8	8	1"
50	1	4	3	8	6	10	8	1"
60	1	4	3	6	4	10	6	1"
70	1	4	3	4	2	8	6	1-1/4"
80	1	4	3	4	2	8	6	1-1/4"
90	1	4	3	3	2	8	6	1-1/4"
100	1	4	3	3	1	8	6	1-1/4"
110	1	4	3	2	1/O	6	4	1-1/4"
125	1	4	3	1	2/O	6	4	2"
150	1	4	3	1/O	3/O	6	4	2"
175	1	4	3	2/O	4/O	6	4	2"
200	1	4	3	3/O	250	6	4	2-1/2"
225	1	4	3	4/O	300	4	2	2-1/2"
250	1	4	3	250	350	4	2	3"
300	1	4	3	350	500	4	2	4"
350	1	4	3	400	600	3	1	4"
400	1	4	3	500	750	3	1	4"
500	2	4	3	250	350	2	1/O	4"
600	2	4	3	350	500	1	2/O	4"
800	2	4	3	500	750	1/O	3/O	4"
1000	3	4	3	400	350	2/O	4/O	4"
1200	4	4	3	350	500	3/O	250	4"
1600	5	4	3	400	750	4/O	350	4"
2000	6	4	3	400	750	250	400	4"

NOTES:
1. ALL WIRE SIZES SHOWN ARE BASED ON CONDUCTOR TEMPERATURE RATING OF 75°C & AMBIENT TEMPERATURE RATING OF 30°C PER NEC.
2. MAXIMUM ALLOWABLE VOLTAGE DROP FOR FEEDER CONDUCTORS SHALL BE 2%.
3. ELECTRICAL CONTRACTOR TO ADJUST CONDUCTOR SIZES FOR LONG CIRCUIT LENGTHS & AMBIENT TEMPERATURES HIGHER THAN 30°C.

PANEL 'P1' SCHEDULE

PANEL SPECIFICATIONS
VOLTAGE: 120/240V 1-PH | **NEMA RATING:** 1
AMPACITY: 200A MLO | **PANEL MOUNTING:** RECESSED
AIC-RATING: 10kA

TOTAL CONNECTED LOAD
PHASE "A" LOAD: 162.8 AMPS
PHASE "B" LOAD: 158.5 AMPS

CIRCUIT NUMBER	DESCRIPTION	BREAKER SIZE	AMPS	PHASE	AMPS	BREAKER SIZE	DESCRIPTION	CIRCUIT NUMBER
1	LIVING ROOM / RECEPTS	20-1*	9	A	39.8	100-2	SUB PANEL 'P2'	2
3	BEDROOM / RECEPTS	20-1*	7.5	B	35.5	-	-	4
5	KITCHEN / COUNTER GFCI RECEPTS	20-1*	4.5	A	25	30-2##	HEAT PUMP (HP-2)	6
7	KITCHEN / DISP	20-1*	5	B	25	-	-	8
9	KITCHEN / COUNTER GFCI RECEPTS	20-1*	3	A		20-1	SPARE	10
11	KITCHEN / MICROWAVE	20-1*	5	B	0.5	15-1	FRESH AIR VENTILATOR (FAV-1)	12
13	KITCHEN / RANGE HOOD	20-1*	5	A	4	20-1	WATER HEATER (WH)	14
15	KITCHEN / RANGE	50-2##	40	B	12.5	20-1	DUCT HEATER (DH-1)	16
17	-	-	40	A		20-1	SPARE	18
19	KITCHEN / REFRIG	20-1*	3	B	1.5	20-1	WATER SOFTENER	20
21	BATHROOM / GFCI RECEPT	20-1*	1.5	A	5	20-1	MECH / CLOTHES WASHER	22
23	SPARE	20-1		B	20	30-2##	MECH / CLOTHES DRYER	24
25	LIGHTING	20-1*	5	A	20	-	-	26
27	SPARE	20-1		B	3	20-1*	MECH / GFCI RECEPTS	28
29	SPARE	20-1		A	1	20-1*	SMOKE DETECTORS	30
31	SPARE	20-1		B		20-1	SPARE	32
33	SPARE	20-1		A		20-1	SPARE	34
35	SPARE	20-1		B		20-1	SPARE	36
37	SPARE	20-1		A		20-1	SPARE	38
39	SPARE	20-1		B		20-1	SPARE	40
41	SPARE	20-1		A		20-1	SPARE	42

NOTES:
A: PANEL SHALL BE EQUAL TO SQUARE D MODEL "HOMELINE"
B: ELECTRICIAN SHALL VERIFY EXACT EQUIPMENT OVERCURRENT PROTECTION REQUIREMENTS PRIOR TO PURCHASE & INSTALLATION OF EQUIPMENT.
C: AFTER COMPLETION OF WORK, ELECTRICAN SHALL PROVIDE A TYPE WRITTEN PANEL DIRECTORY IN NEW PANEL.
D: * SHALL INDICATE AFCI PROTECTED BREAKER TO BE INSTALLED.
E: ## SHALL INDICATE GFCI PROTECTION (EITHER BREAKER OR RECEPTACLE) TO BE INSTALLED.


PANEL 'P2' SCHEDULE

PANEL SPECIFICATIONS
VOLTAGE: 120/240V 1-PH | **NEMA RATING:** 1
AMPACITY: 100A MLO | **PANEL MOUNTING:** SURFACE
AIC-RATING: 10kA


TOTAL CONNECTED LOAD
PHASE "A" LOAD: 39.8 AMPS
PHASE "B" LOAD: 35.5 AMPS

CIRCUIT NUMBER	DESCRIPTION	BREAKER SIZE	AMPS	PHASE	AMPS	BREAKER SIZE	DESCRIPTION	CIRCUIT NUMBER
1	GARAGE / GFCI RECEPTS	20-1	3	A	24	40-2	MINI-SPLIT (CC-1 & HP-1)	2
3	GARAGE / GFCI RECEPTS	20-1	3	B	24	-	-	4
5	GARAGE / COUNTER GFCI RECEPTS	20-1	4.5	A	8.3	15-1	ELECTRIC HEATER (EH-1)	6
7	GARAGE / TOILET GFCI RECEPTS	20-1	3	B	1.5	20-1	GARAGE DOOR POWER	8
9	SPARE	20-1		A		20-1	SPARE	10
11	LIGHTING	20-1	4	B		20-1	SPARE	12
13	SPARE	20-1		A		20-1	SPARE	14
15	SPARE	20-1		B		20-1	SPARE	16
17	SPARE	20-1		A		20-1	SPARE	18
19	SPARE	20-1		B		20-1	SPARE	20

NOTES:
A: PANEL SHALL BE EQUAL TO SQUARE D MODEL "HOMELINE"
B: ELECTRICIAN SHALL VERIFY EXACT EQUIPMENT OVERCURRENT PROTECTION REQUIREMENTS PRIOR TO PURCHASE & INSTALLATION OF EQUIPMENT.
C: AFTER COMPLETION OF WORK, ELECTRICAN SHALL PROVIDE A TYPE WRITTEN PANEL DIRECTORY IN NEW PANEL.

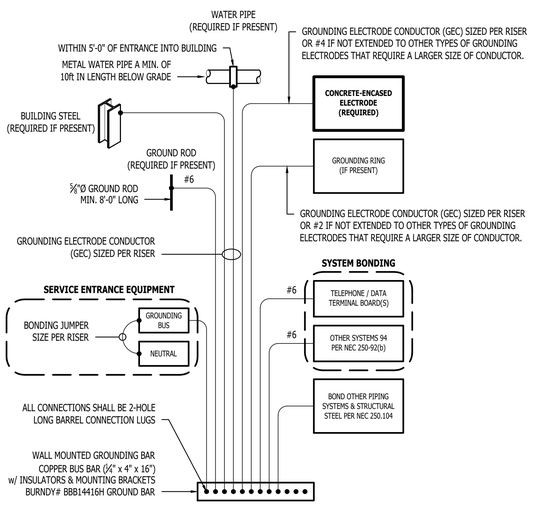

TYPICAL GROUNDING & BONDING DETAIL

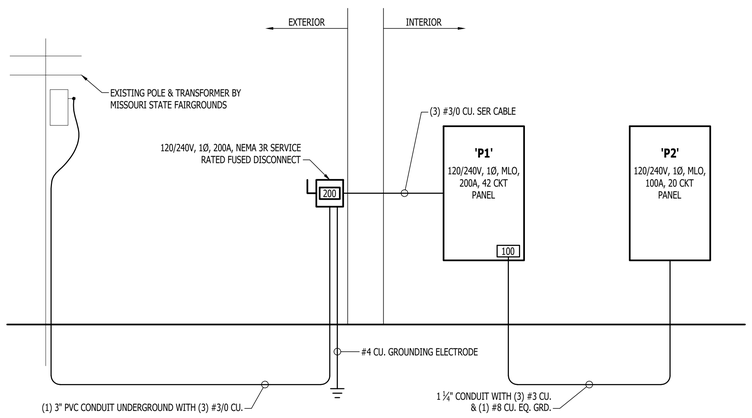

POWER RISER

STATE OF MISSOURI
MIKE KEHOE
GOVERNOR

KEATON E LEISINGER
NUMBER PE-2021035875
PROFESSIONAL ENGINEER
10/30/2026

KEATON E. LEISINGER, PE - 2021035875
MO CERTIFICATE OF AUTHORITY # 2018029680

Robert Rollings Architects LLC
208 S. Lamine
SEDALIA, MO 65301
PHONE: 660 829 9151
FAX: 660 829 9152

J-SQUARED ENGINEERING
2400 BLUFF CREEK DR. STE. 101
COLUMBIA, MO 65201
573.234.4492 phone
www.j-squaredeng.com

Broadfoot Engineering, LLC
30277 Carpenter Road
Sedalia, MO 65301
Phone: 660-619-7001
broadfooteng@yahoo.com

CROCKETT ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1.
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES MANAGEMENT DESIGN AND CONSTRUCTION
REBID, NEW DIRECTOR'S HOUSE

MISSOURI STATE FAIRGROUNDS
2503 W. 16TH ST
SEDALIA, MO 65301

PROJECT # F2402-01

SITE # 1501

ASSET # 3511501149

REVISION: ADDENDUM #1 (1)
DATE: 10-30-2026

ISSUE DATE: 06/10/2026
BID DOCUMENTS

CAD DWG FILE:
DRAWN BY: AMK
CHECKED BY: RDR
DESIGNED BY: AMK

SHEET TITLE:

ELECTRICAL DETAILS & SCHEDULES

SHEET NUMBER:

E-501