

ADDENDUM NO. 2

TO: PLANS AND SPECIFICATIONS FOR STATE OF MISSOURI

Renovate Interior/Exterior Barns 39, 40, & 41
Missouri State Fairgrounds
Sedalia, Missouri
PROJECT NO. F2404-01

Bid Opening Date is: 1:30 PM, Tuesday, April 1st, 2025

Bidders are hereby informed that the Construction Plans and/or Specifications are modified as follows:

SPECIFICATION CHANGES:

1. ADD Section 040120 1.7-A.4 as follows:
 - a. The awarded masonry contractor shall be required to submit evidence of the following certifications and training.
 - i. Training and Safety Requirements:
 - 1) Silica Certified in Construction
 - 2) Historic Masonry Preservation Certificate (1 to every 4 men onsite)
 - 3) Osha 10 required for Journeyman
 - 4) Osha 30 required for Foreman
 - 5) Osha 30 required for Superintendent
 - 6) JAHNS Certification
 - 7) Suspension and system scaffold Certified
 - 8) Respirable Crystalline Silica Safety Certificate
 - 9) Aerial Certified
 - 10) Grout Certification
 - 11) 2024 Fit Test Record
 - 12) Pulmonary Testing Medical Clearance
 - 13) Must provide Site Specific Safety Plan (SSSP)
 - 14) Must provide material submittals with all Product data and Safety data sheets
 - 15) Contractor to provide mockups
 - a. Mockups must be approved by owner's representative

DRAWING CHANGES:

1. REPLACE Sheet A-401 in its entirety
2. Sheet C502
 - a. DELETE note "GEOTEXTILE FABRIC (MIRAFI 500X OR APPROVED EQUAL) from concrete pavement detail. No geotextile fabric is needed.
3. REPLACE Sheet E-501 in its entirety

GENERAL COMMENTS:


1. The Pre-Bid Meeting was held March 20, 2025 followed by a walk-through of the site. The Pre-Bid Meeting sign-in sheet is attached.
2. Bidders needing additional site inspection should contact Justin Anderson at 660-317-8740 to schedule a time.
3. Please contact April Howser, Contract Specialist, at 573-751-0053 or april.howser@oa.mo.gov, for questions about bidding procedures and MBE\WBE\SDVE goals and submittal requirements.
4. The deadline for technical questions was 5pm on March 24, 2025.
5. Changes to, or clarification of, the bid documents are only made as issued in the addenda.
6. All correspondence with respect to this project must include the State of Missouri project number as indicated above.
7. Current Planholders list available online at:
<https://www.oafmdcplanroom.com/projects/2804/plan-holders/f2404-01-renovate-interior-exterior-barns-39-40-41-missouri-state-fairgrounds>
8. Prospective Bidders contact American Document Solutions, 1400 Forum Blvd Suite 1C, Columbia MO 65201, 573-446-7768 to order official plans and specifications.

ATTACHMENTS:

1. REVISED Sheet A-401
2. REVISED Sheet E-501

March 25, 2025

END ADDENDUM NO. 2

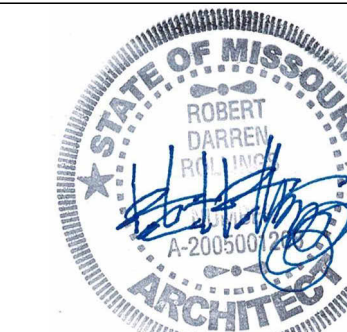


10.14.24

Robert D. Rollings 200501208, Certificate of Authority # A-2006003870



Robert Rollings
Architects LLC
208 S. Lamine Avenue
Sedalia, MO 65301
660.829.9751



J-SQUARED
ENGINEERING
2400 BLUFF CREEK DR. STE. 101
COLUMBIA, MO 65203
573.234.4492



Broadfoot Engineering, LLC
30277 Carpenter Road
Sedalia, MO 65301
Phone: 660-619-7001
broadfooteng@yahoo.com



Crockett Engineering Consultants, LLC
Missouri Certificate of Authority #2000151304

OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES
MANAGEMENT DESIGN AND
CONSTRUCTION
RENOVATE INTERIOR &
EXTERIOR, BARN 39, 40, & 41
MISSOURI STATE
FAIRGROUNDS
2503 W. 16TH ST
SEDALIA, MO 65301
PROJECT # F2404-01
SITE # 1501
ASSET #s
3511501048 - 39 - HEREFORD
3511501052 - 40 - DONNELL
3511501053 - 41 - MULE BARN

REVISION: ADDENDUM 2 2025/03/25
DATE: _____
REVISION: _____
DATE: _____

ISSUE DATE: 10/14/2024
BID DOCUMENTS

CAD DWG FILE: A-SC-23
DRAWN BY: AMK
CHECKED BY: RDR
DESIGNED BY: AMK


SHEET TITLE:

SECTION DETAILS

SHEET NUMBER:

A-401

SHEET 23 OF 47

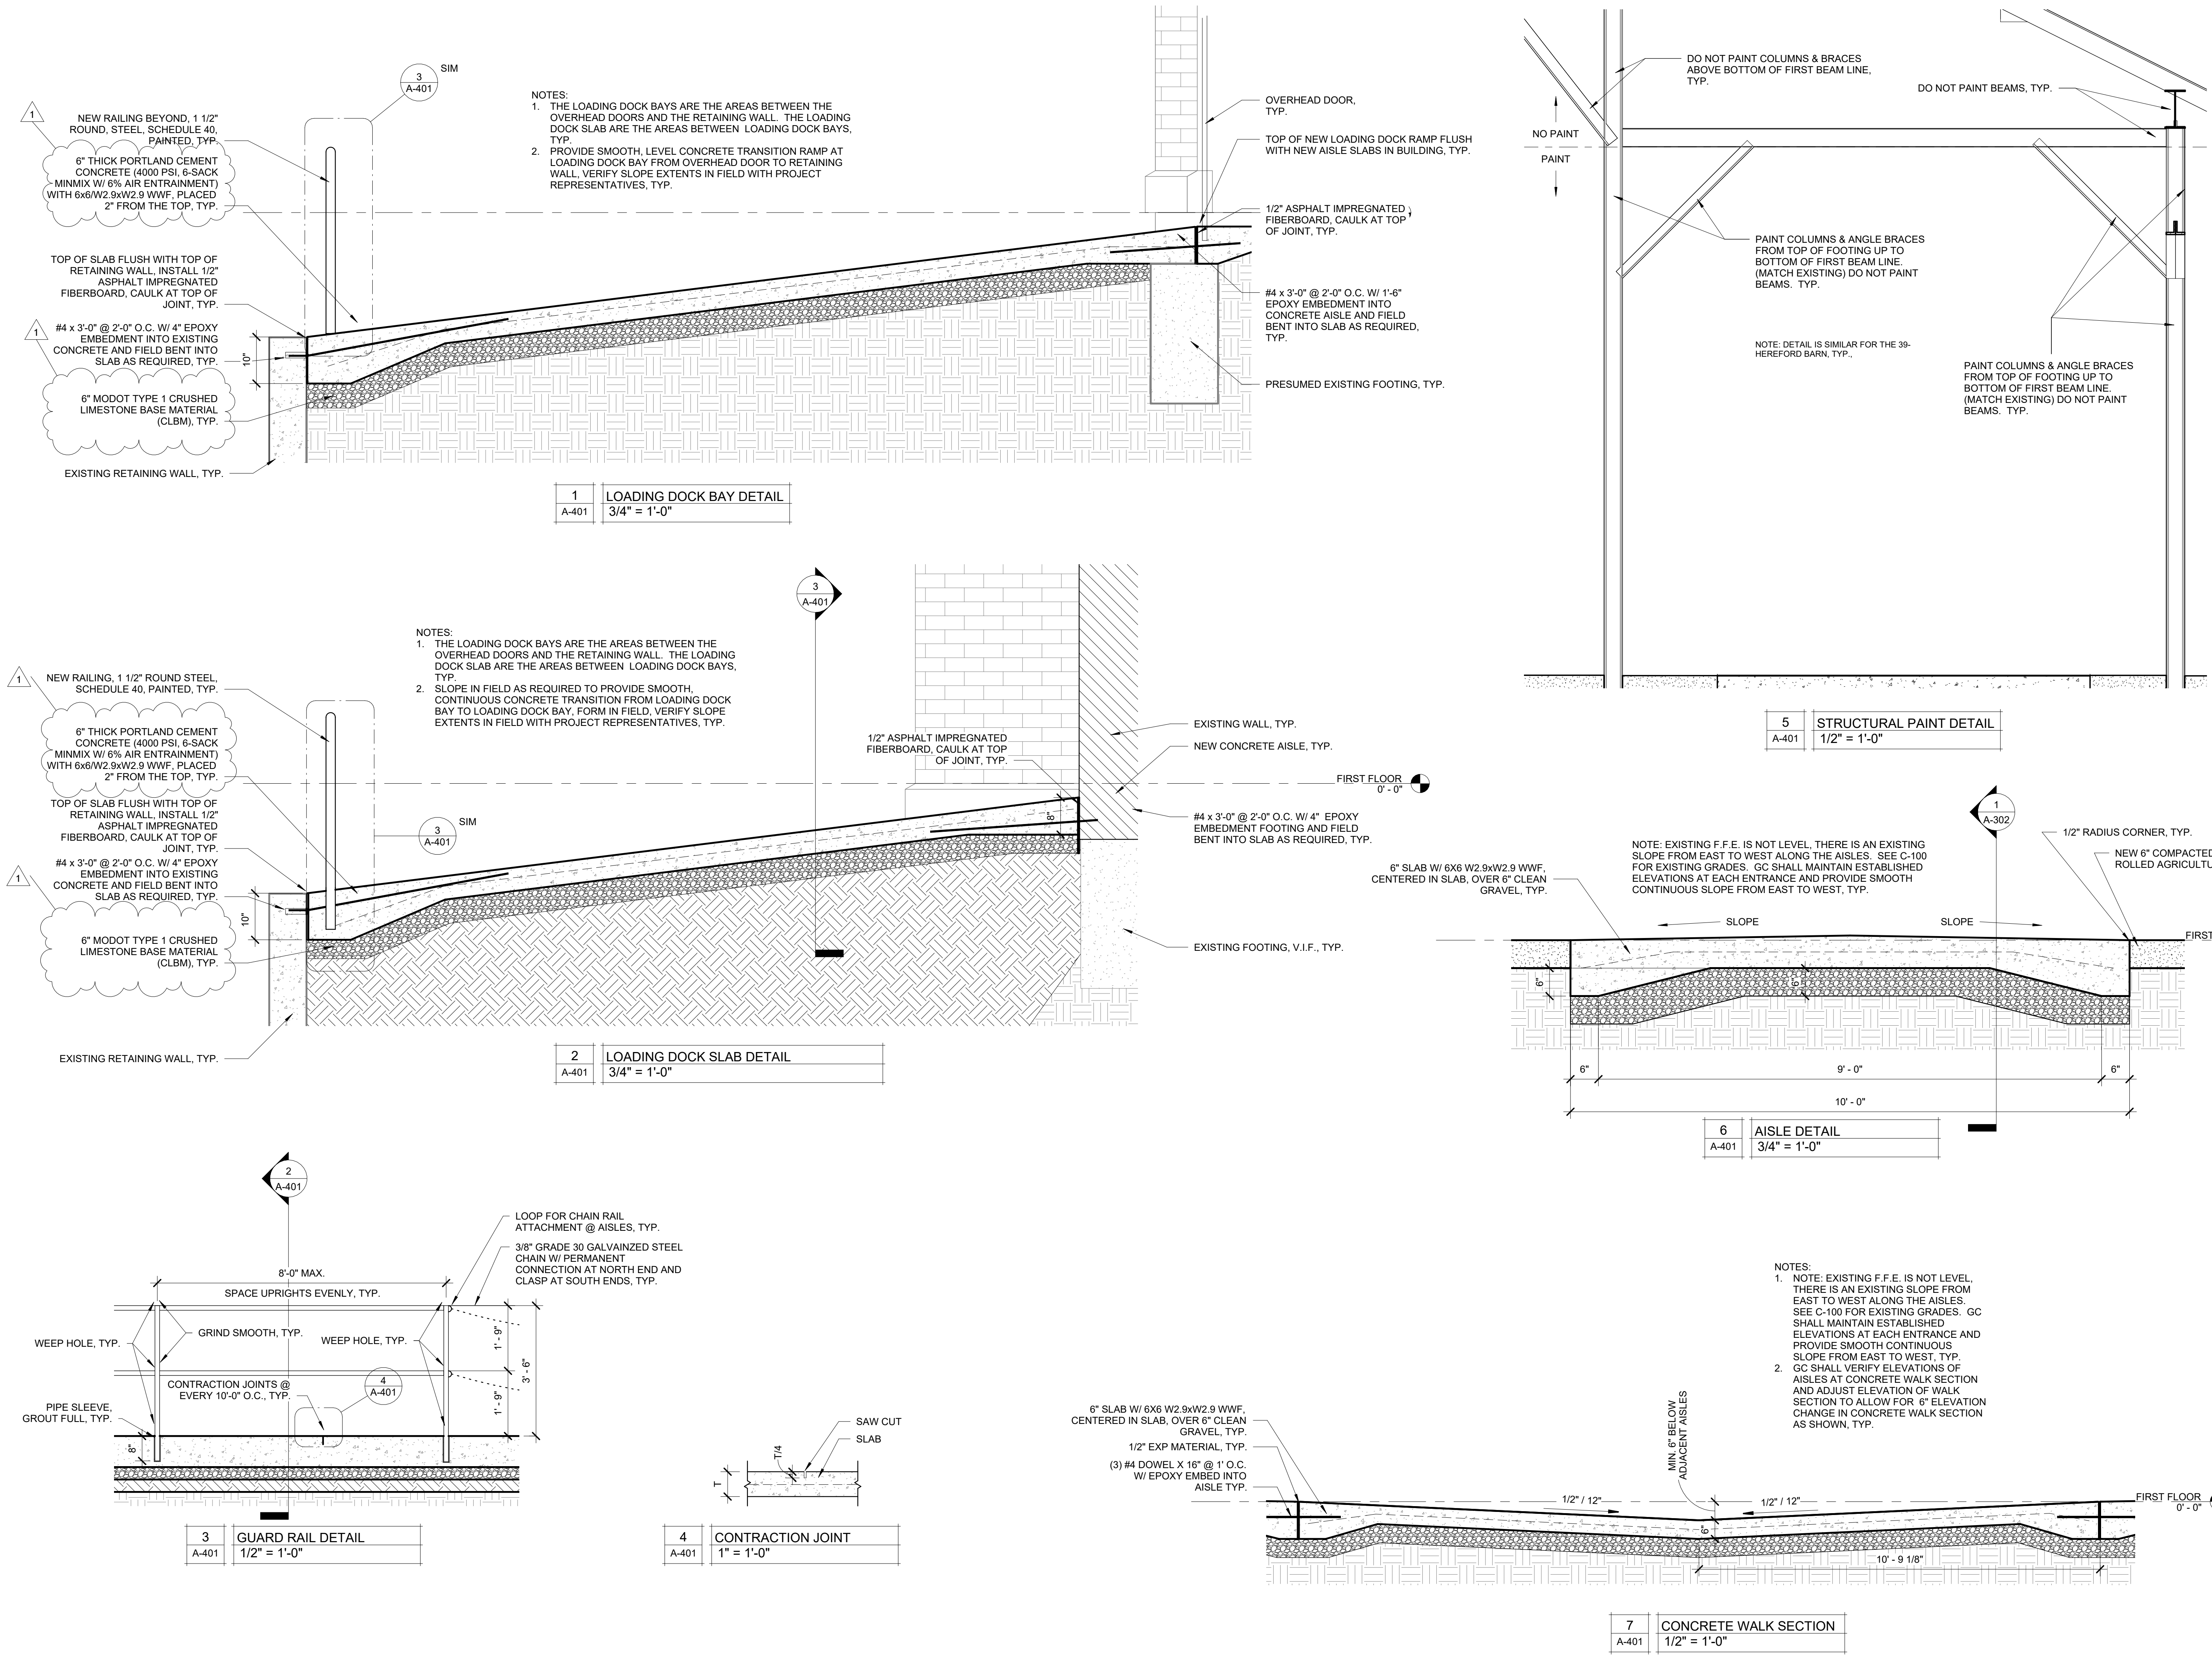





KEATON E. LINSINGER, P.E. 2021035875
MO CERTIFICATE OF AUTHORITY # 2018029688



Robert Rollings
Architects LLC
208 South Lanning
Sedalia, MO 65301
Phone: 660.829.9751
Fax: 660.829.9752



J-SQUARED
ENGINEERING
2400 BLUFF CREEK DR. STE. 101
COLUMBIA, MO 65203
573.234.4492



Broadfoot Engineering, LLC
30277 Carpenter Road
Sedalia, MO 65301
Phone: 660-619-7001
broadfooteng@yahoo.com

CROCKETT
ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1.
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES
MANAGEMENT DESIGN AND
CONSTRUCTION

RENOVATE INTERIOR &
EXTERIOR, BARN 39,40, & 41
MISSOURI STATE
FAIRGROUNDS
2503 W. 16TH ST
SEDALIA, MO 65301

PROJECT # F2404-01
SITE # 1501
ASSET #s
3511501048 - 39 - HEREFORD
3511501052 - 40 - DONNELL
3511501053 - 41 - MULE BARN

REVISION: ADDENDUM 2
DATE: 03-25-2025

REVISION:
DATE:

ISSUE DATE: 10/14/2024

BID DOCUMENTS

CAD DWG FILE: F2404-01-...-E-501.dwg
DRAWN BY: RXM
CHECKED BY: JAP
DESIGNED BY: KEL


SHEET TITLE:

**ELECTRICAL
DETAILS**


SHEET NUMBER:

E-501


SHEET OF 47

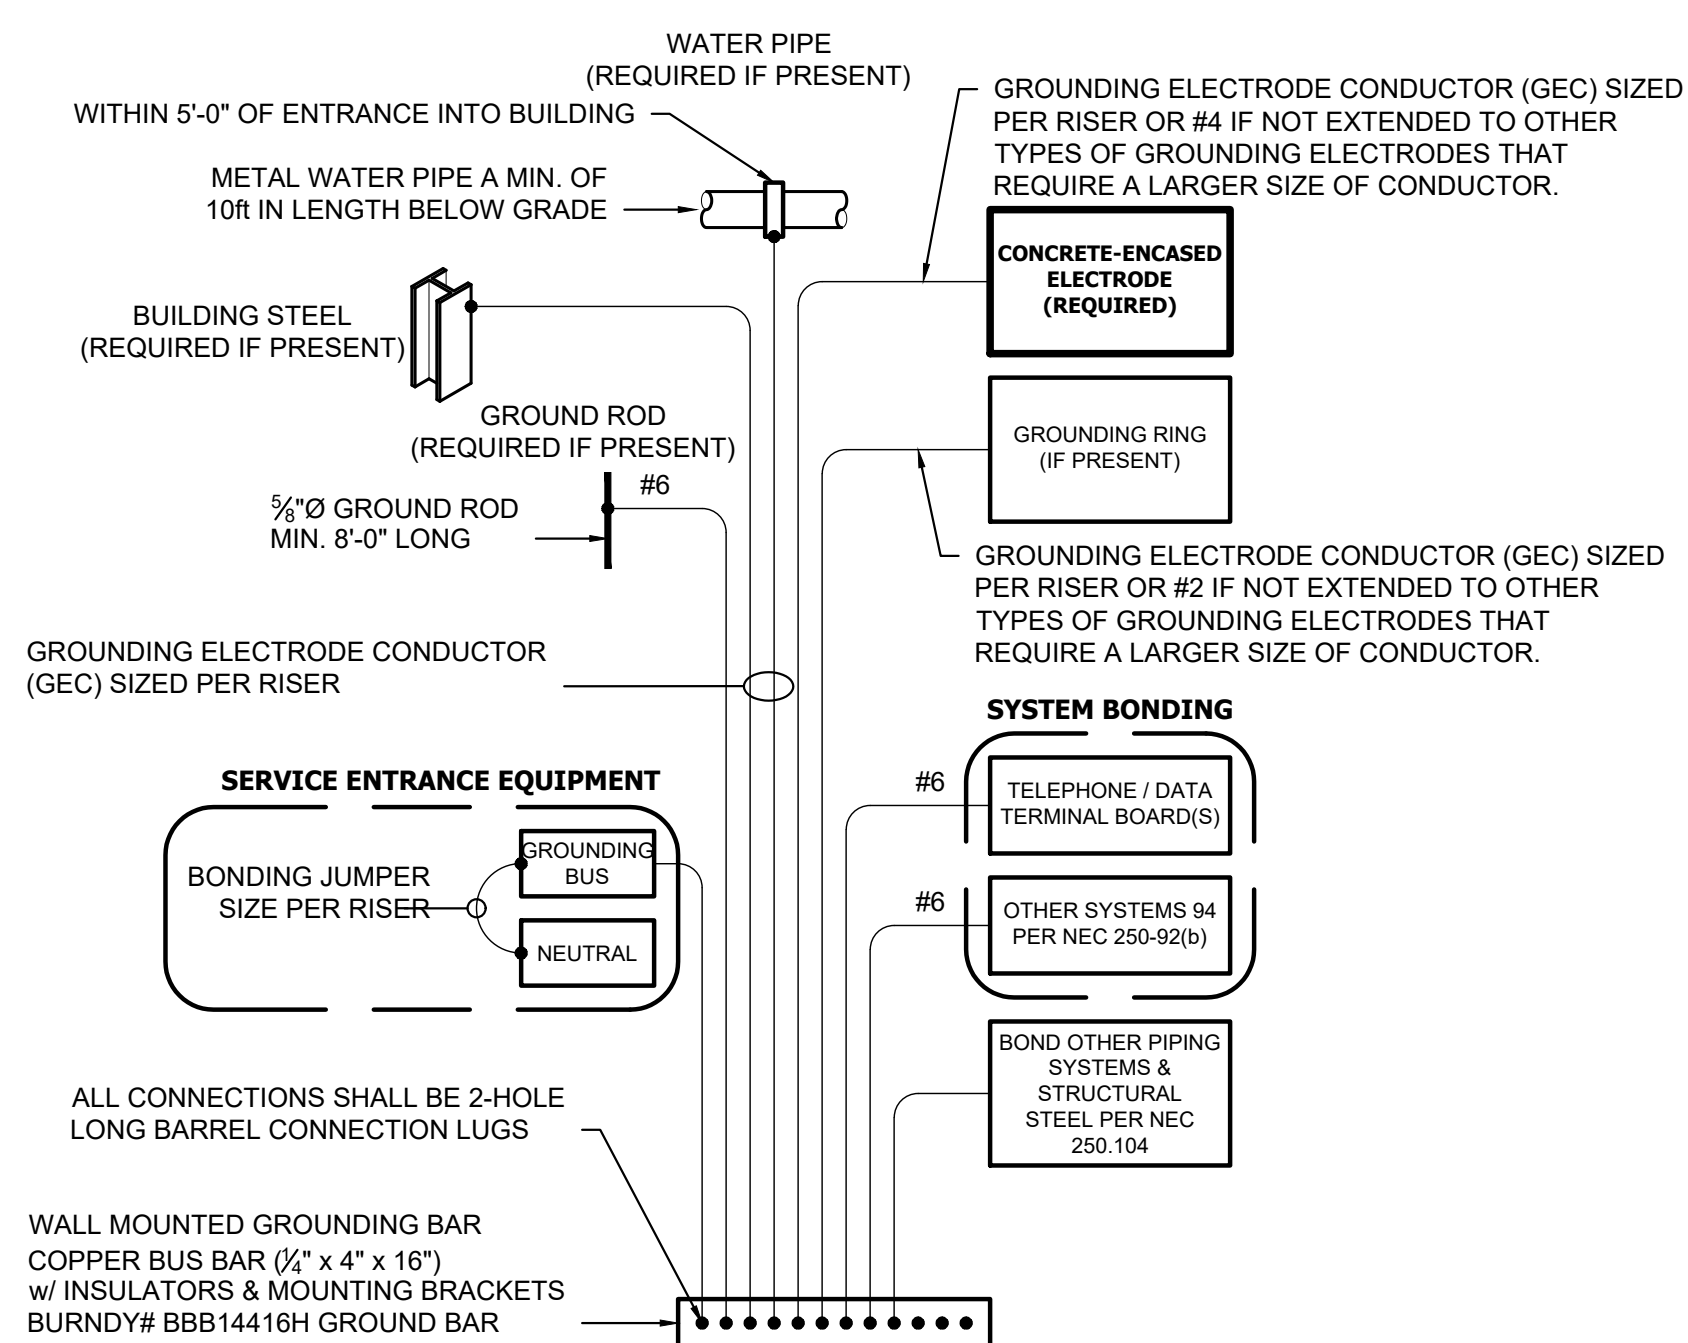

TYPICAL GROUNDING & BONDING DETAIL

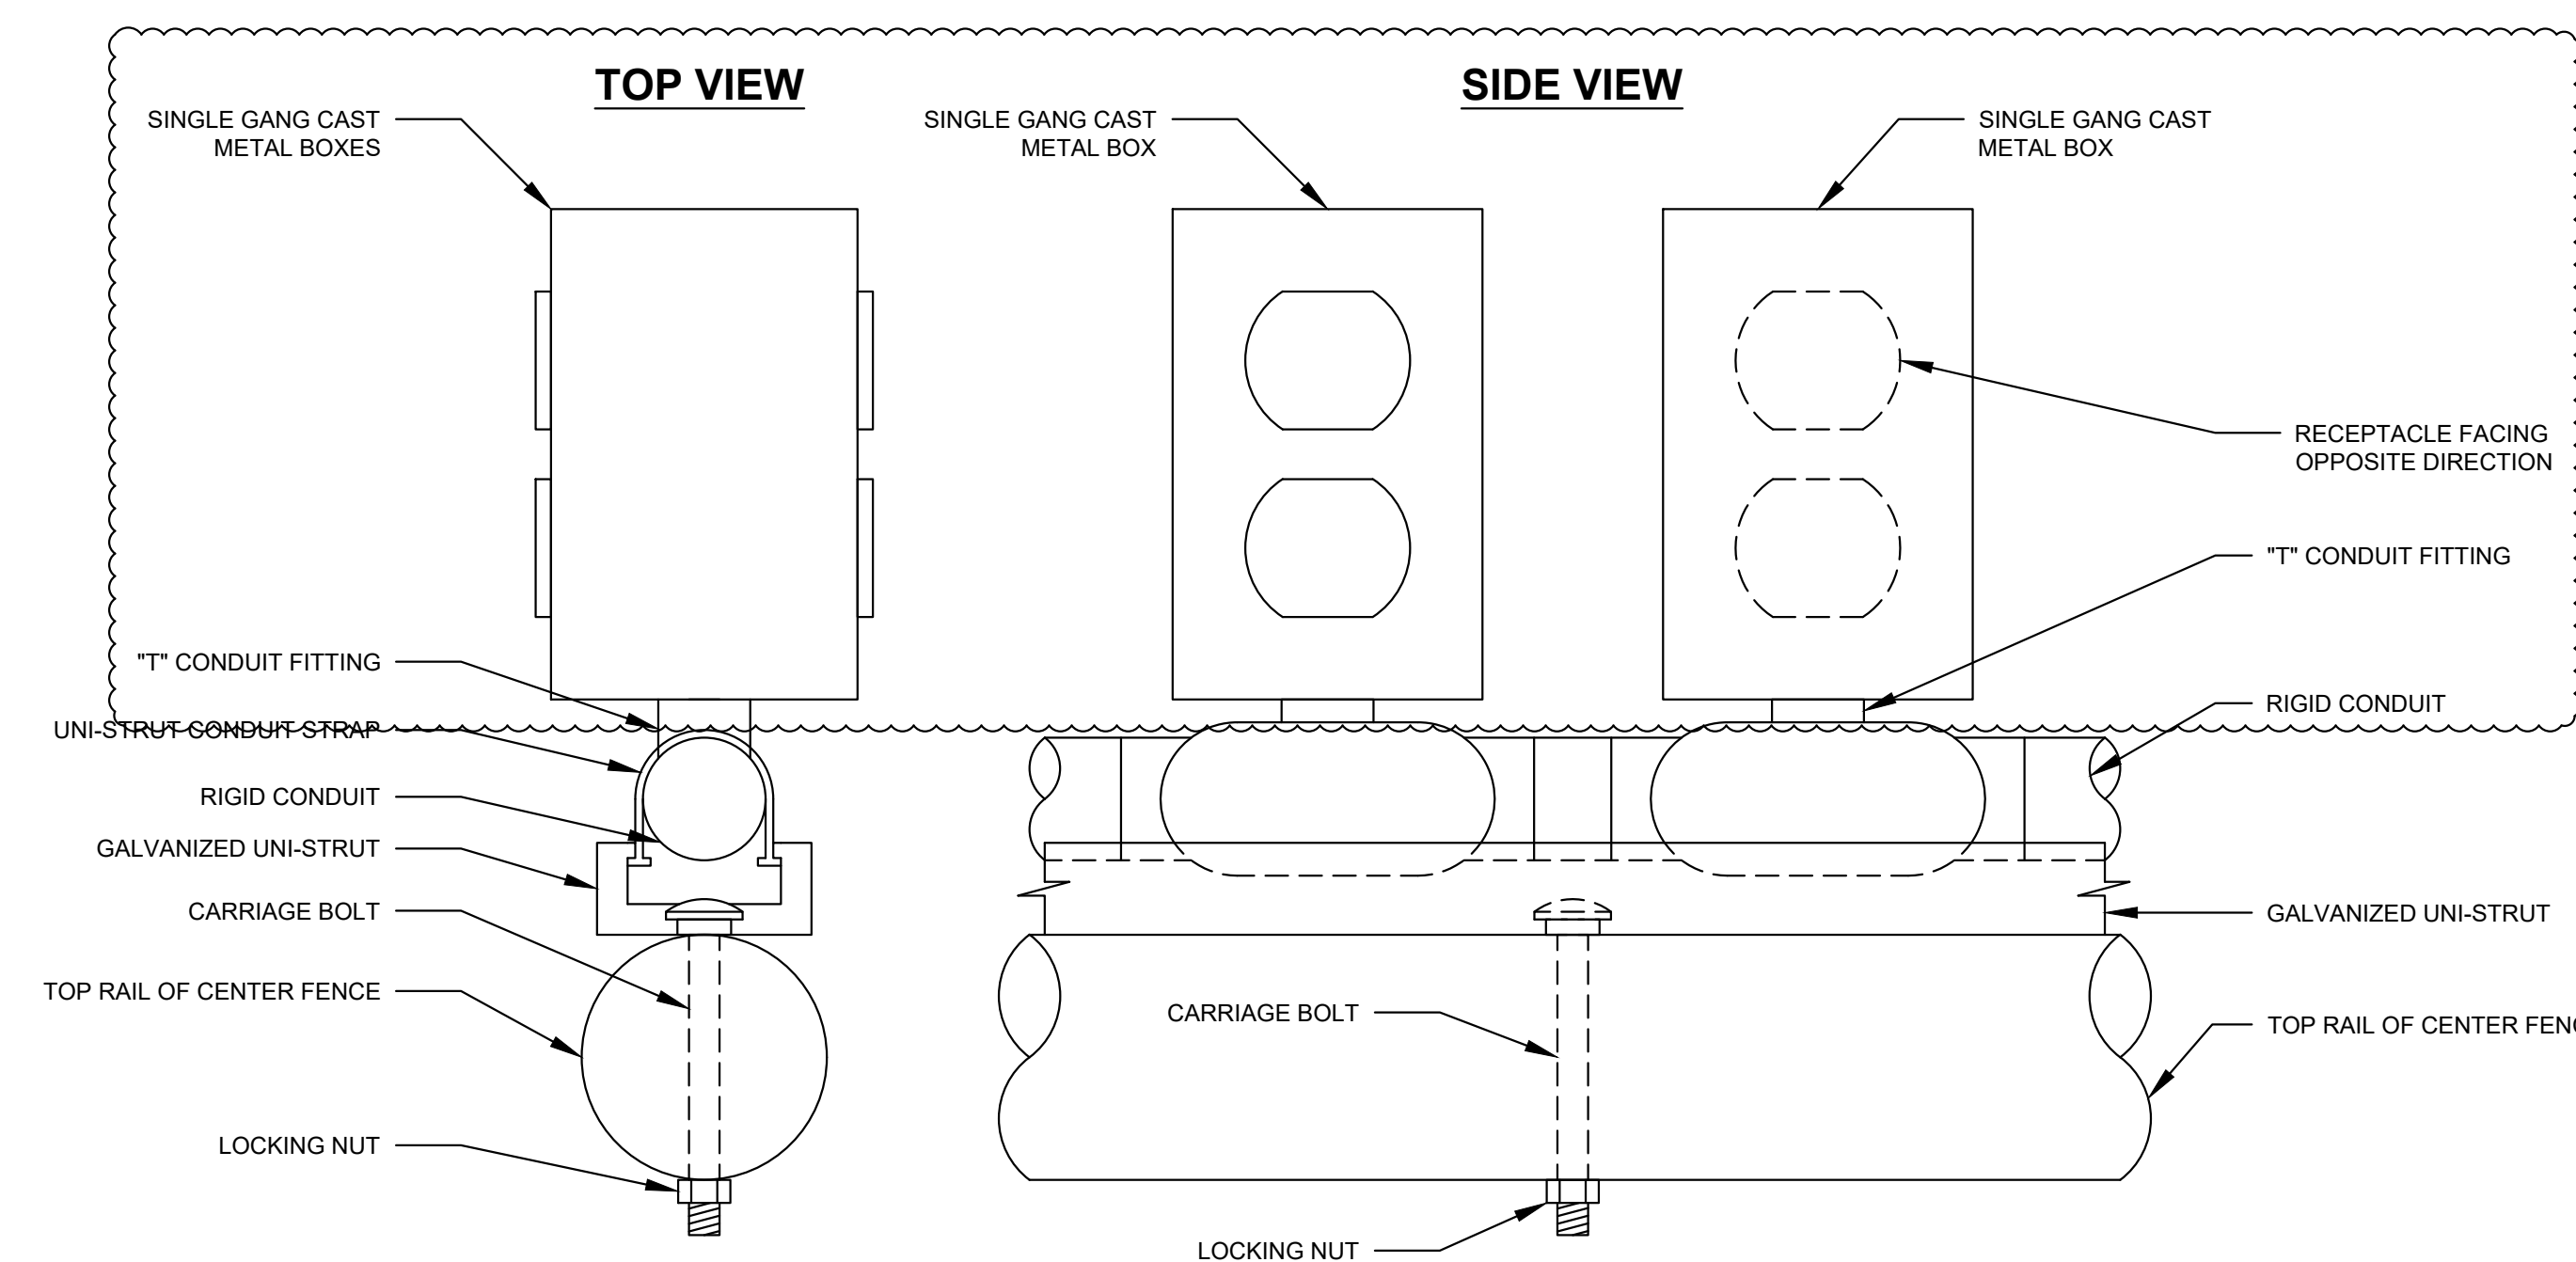


DUPLX AND CONDUIT MOUNTING DETAIL

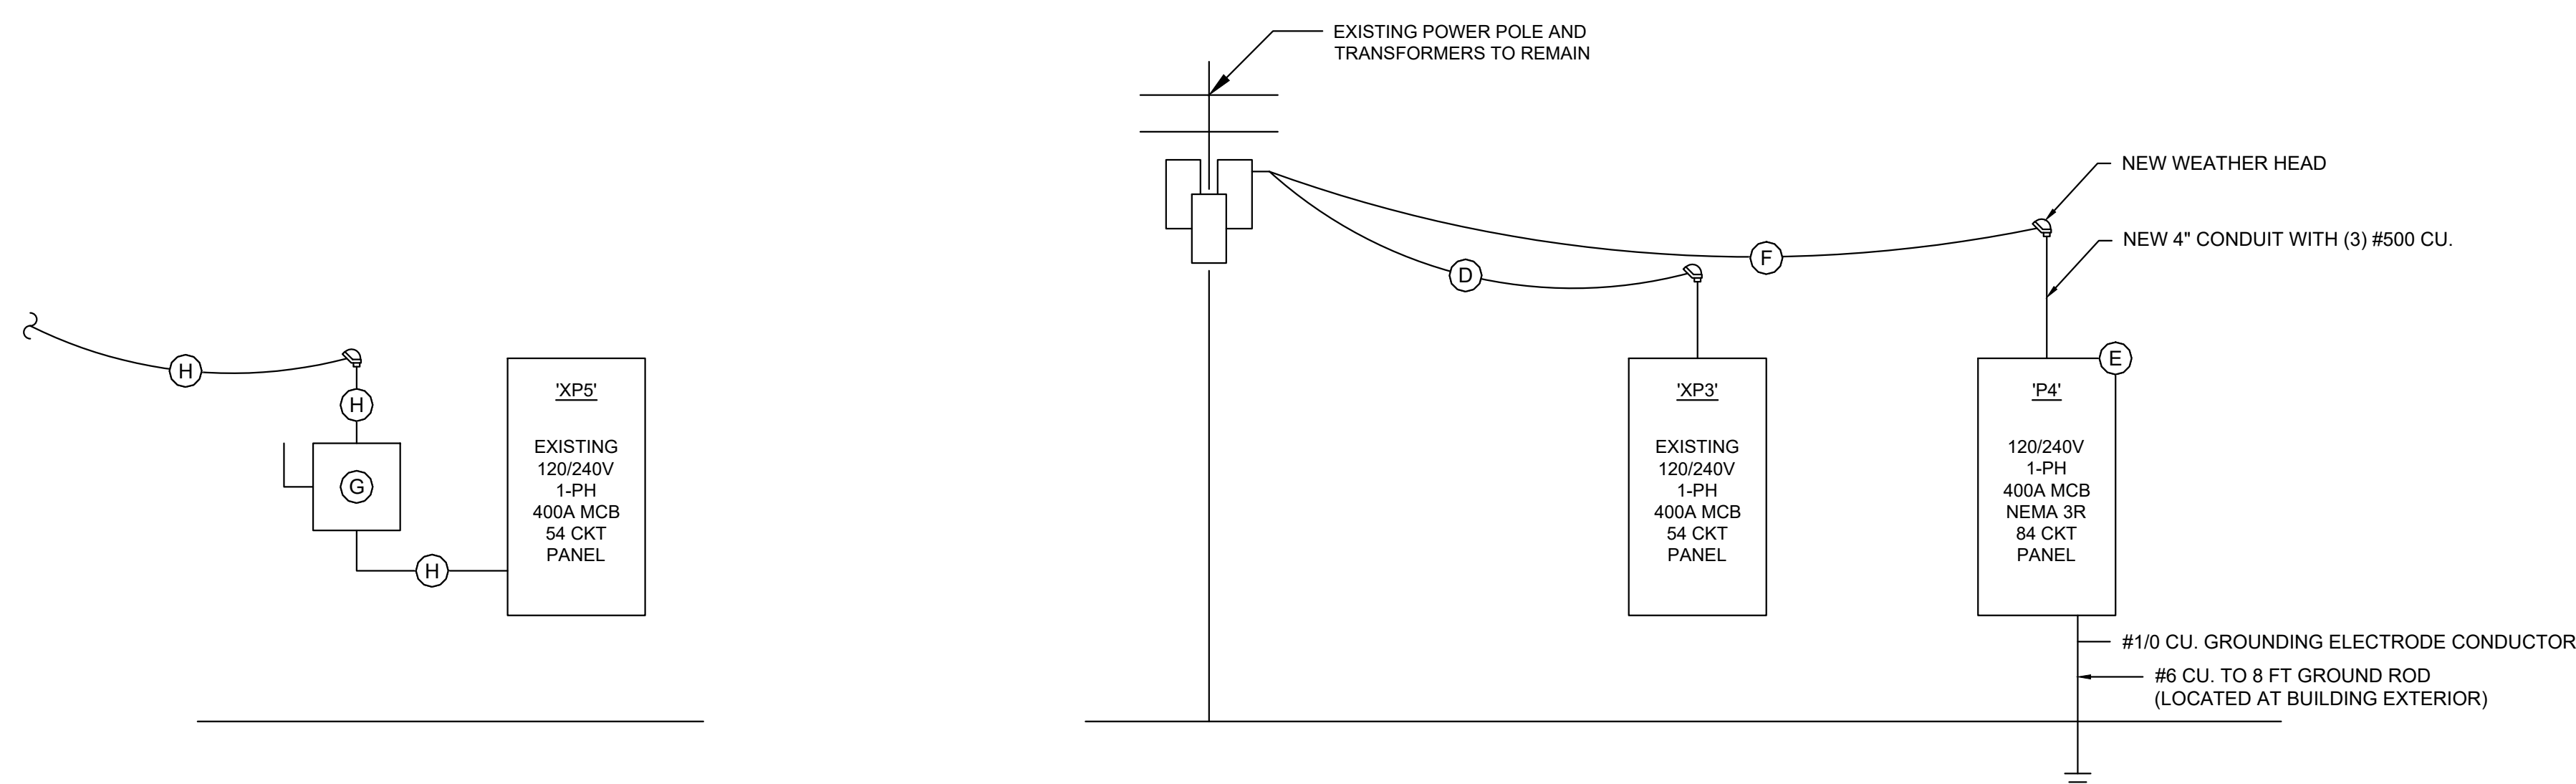

MULE BARN POWER RISER

DONNELL BARN POWER RISER

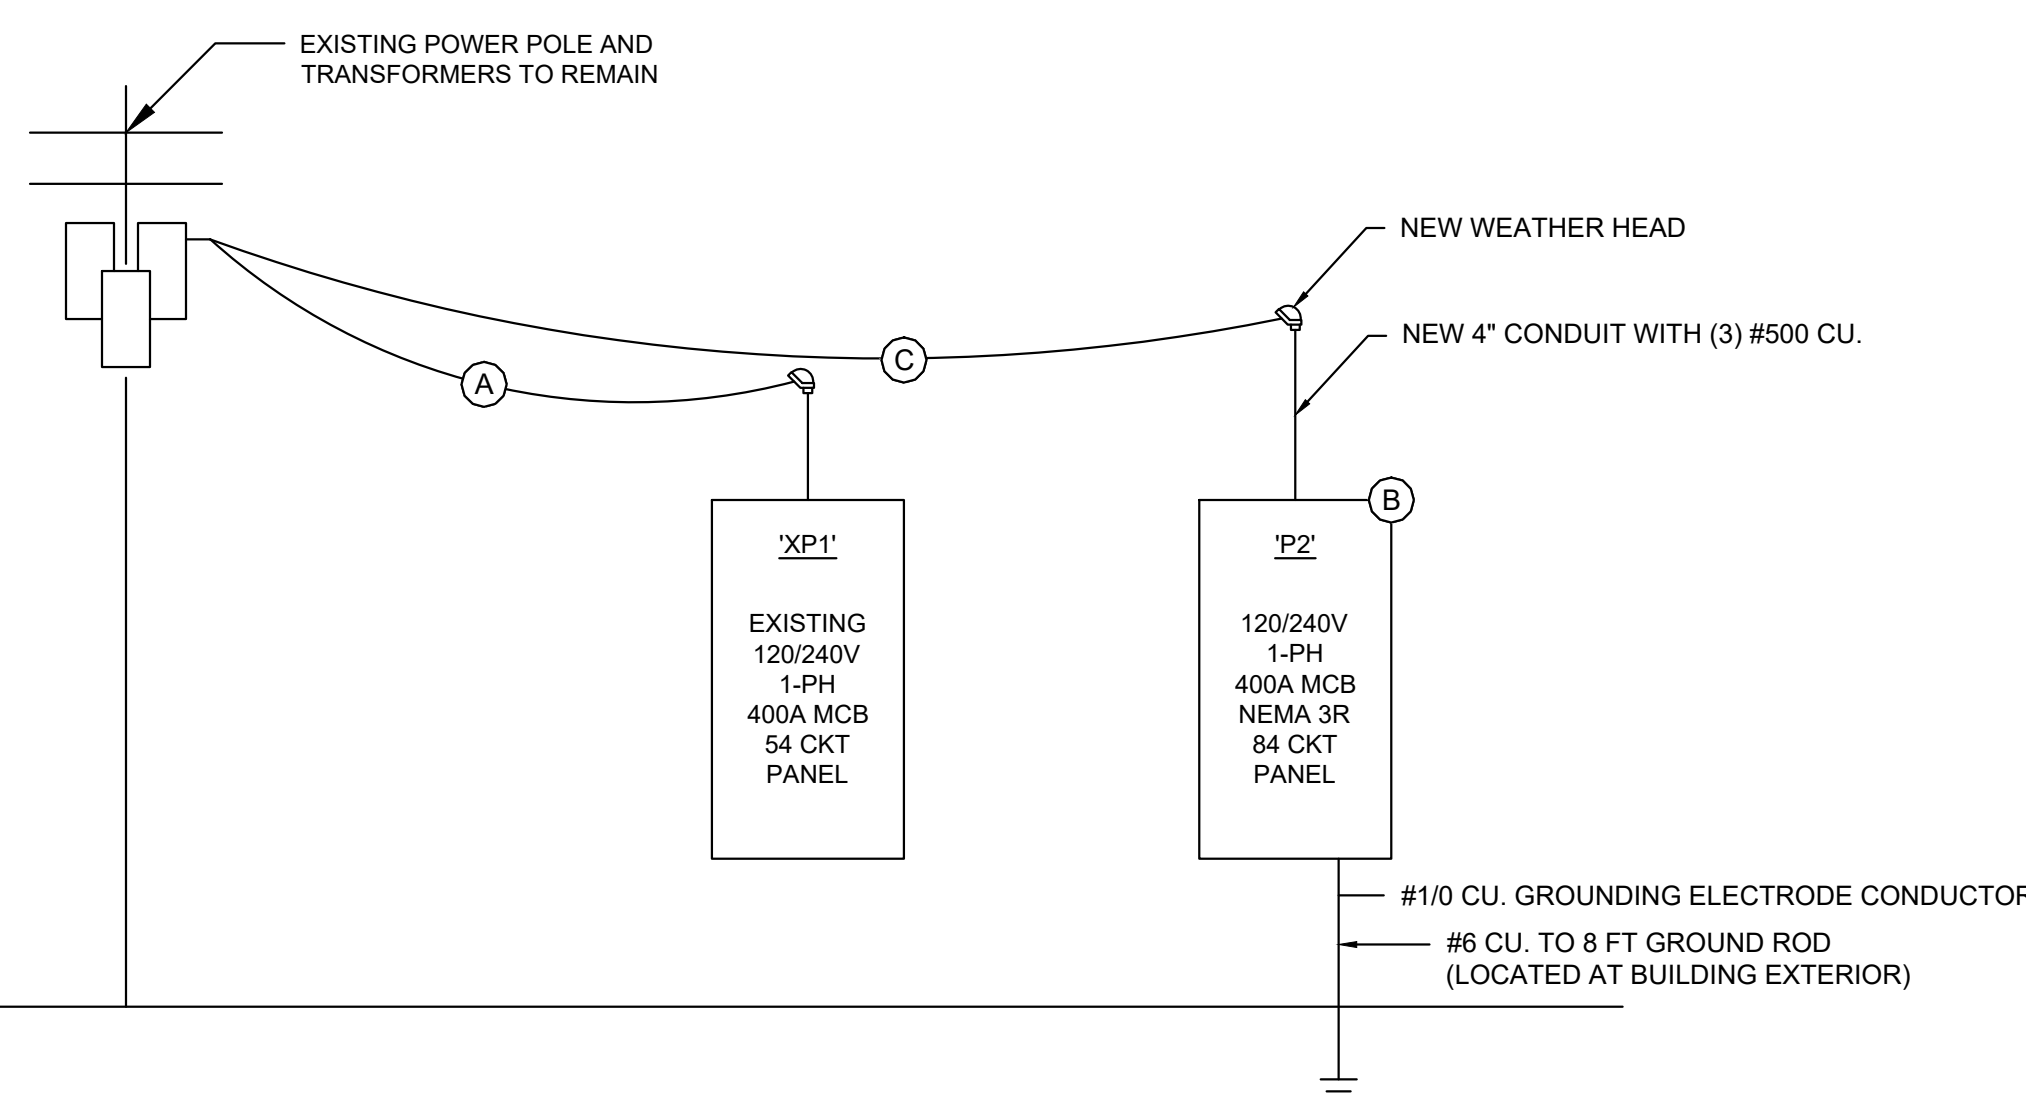

HEREFORD BARN POWER RISER

- (G) → EXISTING DISCONNECT TO REMAIN.
- (H) → EXISTING CONDUIT AND/OR CONDUCTORS TO REMAIN.

- (D) → EXISTING CONDUCTORS TO REMAIN.
- (E) → PROVIDE NEW PANEL AS SHOWN.
- (F) → COORDINATE WITH POWER COMPANY ON NEW 400A SERVICE CONNECTION TO POLE MOUNTED TRANSFORMER.

- (A) → EXISTING CONDUCTORS TO REMAIN.
- (B) → REPLACE EXISTING PANEL WITH NEW PANEL AS SHOWN.
- (C) → COORDINATE WITH POWER COMPANY ON NEW 400A SERVICE CONNECTION TO POLE MOUNTED TRANSFORMER.