

PROJECT MANUAL

New Comfort Station at Swine Pavilion

Missouri State Fairgrounds (MSF) Sedalia, Missouri

Designed By: PWAarchitects, Inc
2120 Forum Blvd, Ste 101
Columbia, MO 65201

Date Issued: October 18, 2024

Project No.: F2406-01

STATE *of* MISSOURI

OFFICE *of* ADMINISTRATION
Facilities Management, Design and Construction


SECTION 000107 - PROFESSIONAL SEALS AND CERTIFICATIONS

PROJECT NUMBER: F2406-01

THE FOLLOWING DESIGN PROFESSIONALS HAVE SIGNED AND SEALED THE ORIGINAL PLANS AND SPECIFICATIONS FOR THIS PROJECT, WHICH ARE ON FILE WITH THE DIVISION OF FACILITIES MANAGEMENT, DESIGN AND CONSTRUCTION:

Architect:

PWArchitects, Inc.
Eric Roselle, AIA, LEED AP
2120 Forum Blvd., Ste. 101
Columbia, Mo. 65203

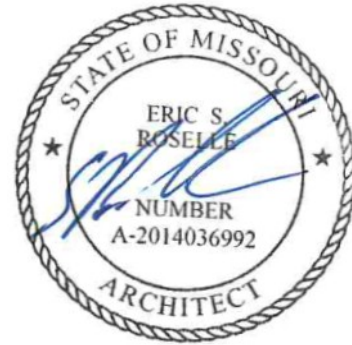

Structural:

Crockett Engineering Consultants
Jared Verslues, PE
1000 W. Nifong., Bldg. 1
Columbia, Mo. 65203



Civil:

Crockett Engineering Consultants
Kyle Miller, PE
1000 W. Nifong., Bldg. 1
Columbia, Mo. 65203



Mechanical, Electrical, Plumbing:

J-Squared Engineering
James Watson, PE
2400 Bluff Creek Dr., Suite 101
Columbia, Mo. 65201

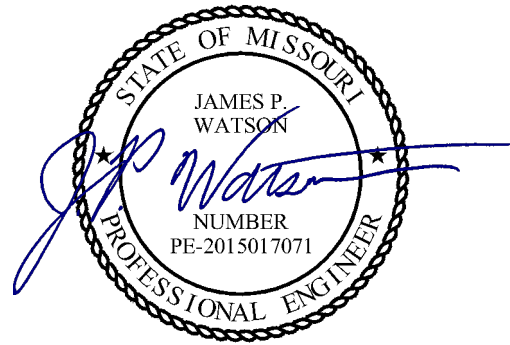


TABLE OF CONTENTS

SECTION	TITLE	NUMBER OF PAGES
---------	-------	-----------------

DIVISION 00 – PROCUREMENT AND CONTRACTING INFORMATION

000000 INTRODUCTORY INFORMATION

000101	Project Manual Cover	1
000107	Professional Seals and Certifications	1
000110	Table of Contents	3
000115	List of Drawings	2

001116	INVITATION FOR BID (IFB)	1
---------------	---------------------------------	---

002113	INSTRUCTIONS TO BIDDERS	7
---------------	--------------------------------	---

NOTICE TO BIDDERS

The following procurement forms can be found on our website at:
<https://oa.mo.gov/facilities/bid-opportunities/bid-listing-electronic-plans>
 and shall be submitted with your bid to FMDCBids@oa.mo.gov

004000 PROCUREMENT FORMS & SUPPLEMENTS

004113	Bid Form	*
004322	Unit Prices Form	*
004336	Proposed Subcontractors Form	*
004337	MBE/WBE/SDVE Compliance Evaluation Form	*
004338	MBE/WBE/SDVE Eligibility Determination Form for Joint Ventures	*
004339	MBE/WBE/SDVE Good Faith Effort (GFE) Determination Forms	*
004340	SDVE Business Form	*
004541	Affidavit of Work Authorization	*
004545	Anti-Discrimination Against Israel Act Certification form	*

005000 CONTRACTING FORMS AND SUPPLEMENTS

005213	Construction Contract	3
--------	-----------------------	---

006000 PROJECT FORMS

006113	Performance and Payment Bond	2
006325	Product Substitution Request	2
006519.16	Final Receipt of Payment and Release Form	1
006519.18	MBE/WBE/SDVE Progress Report	2
006519.21	Affidavit of Compliance with Prevailing Wage Law	1

007000 CONDITIONS OF THE CONTRACT

007213	General Conditions	20
007300	Supplementary Conditions	1
007346	Wage Rate	4

DIVISION 1 - GENERAL REQUIREMENTS

011000	Summary of Work	3
012200	Unit Prices	2
012300	Alternates	3
012600	Contract Modification Procedures	2
013100	Coordination	4
013115	Project Management Communications	5
013200	Schedules – Bar Chart	5
013300	Submittals	6
013513.28	Site Security and Health Requirements	4
015000	Construction Facilities and Temporary Controls	7
017400	Cleaning	3

TECHNICAL SPECIFICATIONS INDEX

DIVISION 03 – CONCRETE		
03 3000	Cast-in-Place Concrete	8
DIVISION 04 – MASONRY		
04 2200	Concrete Unit Masonry	10
DIVISION 05 – METALS		
05 5213	Pipe and Tube Railings	3
DIVISION 06 – WOOD AND PLASTICS		
06 1000	Rough Carpentry	8
06 1600	Sheathing	3
06 1753	Shop-Fabricated Wood Trusses	4
06 8316	Fiberglass Reinforced Paneling	2
DIVISION 07 – THERMAL and MOISTURE PROTECTION		
07 3113	Asphalt Shingles	4
07 4113	ALTERNATE 4: Metal Roof Panels	4
07 4646	Fiber-Cement Siding	2
07 6200	Sheet Metal Flashing and Trim	3
07 9200	Joint Sealants	3
DIVISION 08 – OPENINGS		
08 1113	Hollow Metal Door and Frames	3
08 7100	Door Hardware	4
08 9100	Louvers and Foundation Vents	2
DIVISION 09 – FINISHES		
09 2116	Gypsum Board Assemblies	2
09 9000	Painting and Coating	6
DIVISION 10 – SPECIALTIES		
10 1400	Signage	2
10 2113.19	ALTERNATE 3: Plastic Toilet Compartments	2
10 2800	ALTERNATE 2: Toilet, Bath, and Laundry Accessories	2
DIVISION 22 – PLUMBING		
22 0529	Hangers and Supports for Plumbing Piping and Equipment	2
22 0553	Identification for Plumbing Piping and Equipment	1
22 0719	Plumbing Pipe Insulation	2
22 1005	Plumbing Piping	3
22 3000	Plumbing Equipment	1
22 4000	Plumbing Fixtures	3
DIVISION 23 – HEATING, VENTILATING, AND AIR CONDITIONING		
23 3100	HVAC Ducts and Casings	1
23 3416	Centrifugal HVAC Fans	1
DIVISION 26 – ELECTRICAL		
26 0519	Low-Voltage Electrical Power Conductors and Cables	5
26 0526	Grounding and Bonding for Electrical Systems	3
26 0529	Hangers and Supports for Electrical Systems	2
26 0533.13	Conduit for Electrical Systems	4
26 0533.16	Boxes for Electrical Systems	3
26 0553	Identification for Electrical Systems	3
26 2416	Panelboards	3
26 2726	Wiring Devices	4
26 5100	ALTERNATE 3: Interior Lighting	3
SECTION 000110 – TABLE OF CONTENTS		
01/2025		

26 5600	ALTERNATE 3: Exterior Lighting	3
---------	--------------------------------	---

DIVISION 31 – EARTHWORK

31 1000	Site Clearing and Demolition	5
31 2000	Earth Moving	12
31 2500	Erosion Control	7

DIVISION 32 – EXTERIOR IMPROVEMENTS

32 1313	Concrete Pavement	3
32 1373	Concrete Paving Joint Sealants	4
32 2000	Turf and Grasses	2

DIVISION 33 – UTILITIES

33 1113	Facility Water Distribution Piping	8
33 3300	Sanitary Sewerage Utilities	6
33 4100	Storm Utility Drainage Piping	5

END OF TABLE OF CONTENTS

SECTION 00 0115 – LIST OF DRAWINGS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

1.2 SUMMARY

- A. This Section provides a comprehensive list of the drawings that comprise the Bid Documents for this project.

PART 2 - PRODUCTS (NOT APPLICABLE)

PART 3 - EXECUTION

3.1 LIST OF DRAWINGS

- A. The following list of drawings is a part of the Bid Documents:

<u>TITLE</u>	<u>SHEET #</u>	<u>DATE</u>	<u>CAD #</u>
Cover Sheet	1	10/18/24	G-001
Location Plan, Legends, Drawing Index, Life Safety	2	10/18/24	G-101
Civil Plan Cover Sheet	3	10/18/24	C-100
Demolition, Site & Utility Plan	4	10/18/24	C-101
Erosion Control Plan & Grading Plan	5	10/18/24	C-102
Storm Sewer Plan & Profile, and Storm Sewer Details	6	10/18/24	C-103
Construction Details	7	10/18/24	C-104
Alternate #1 – Grading, Site, and Storm Profile Plan	8	10/18/24	C-105
General Structural Data	9	10/18/24	S-100
Foundation Plan	10	10/18/24	S-200
Foundation Details	11	10/18/24	S-210
Foundation Details	12	10/18/24	S-211
Roof Framing Plan	13	10/18/24	S-300
Roof Framing Details	14	10/18/24	S-310
Typical Masonry Details	15	10/18/24	S-311
Floor Plan & Details	16	10/18/24	A-101
Alternate 1: Floor Plan & Details	17	10/18/24	A-102
Roof Plans & Details	18	10/18/24	A-110
Reflected Ceiling Plans & Details	19	10/18/24	A-120
Elevations & Details	20	10/18/24	A-201
Elevations & Details	21	10/18/24	A-202
Sections & Details	22	10/18/24	A-301

Sections & Details	23	10/18/24	A-302
Sections & Details	24	10/18/24	A-303
Schedules & Details	25	10/18/24	A-601
MEP Site Utilities Plan	26	10/18/24	ME-101
HVAC Plan	27	10/18/24	M-101
Power Plan	28	10/18/24	E-101
Lighting Plan	29	10/18/24	E-102
Electrical Details & Schedules	30	10/18/24	E-501
Sanitary Sewer Plan	31	10/18/24	P-101
Water Piping Plan	32	10/18/24	P-102
Plumbing Details & Schedules	33	10/18/24	P-501

END OF SECTION 000115

SECTION 001116 - INVITATION FOR BID

1.0 OWNER:

- A. The State of Missouri
Office of Administration,
Division of Facilities Management, Design and Construction
Jefferson City, Missouri

2.0 PROJECT TITLE AND NUMBER:

- A. New Comfort Station at Swine Pavilion
Missouri State Fairgrounds (MSF)
Sedalia, Missouri
Project No.: F2406-01

3.0 BIDS WILL BE RECEIVED:

- A. Until: 1:30 PM, April 10, 2025
- B. **Only electronic bids sent to FMDCBids@oa.mo.gov shall be accepted: (See Instructions to Bidders for further detail)**

4.0 DESCRIPTION:

- A. Scope: The project includes a new comfort station consisting of separate men's and women's restrooms, each with 4 stalls and 4 sinks; additionally there are 4 shower rooms, each with a stool and sink.
- B. MBE/WBE/SDVE Goals: MBE 10%, WBE 10%, and SDVE 3%. **NOTE: Only MBE/WBE firms certified by the State of Missouri Office of Equal Opportunity as of the date of bid opening, or SDVE(s) meeting the requirements of Section 34.074, RSMo and 1 CSR 30-5.010, can be used to satisfy the MBE/WBE/SDVE participation goals for this project.**

5.0 PRE-BID MEETING:

- A. Place/Time: 10:00 AM, March 28, 2025, at MSF Boardroom - 2503 W 16th Street, Sedalia MO.
- B. Access to State of Missouri property requires presentation of a photo ID by all persons.

6.0 HOW TO GET PLANS & SPECIFICATIONS:

- A. View Only Electronic bid sets are available at no cost or paper bid sets for a deposit of \$30.00 from American Document Solutions (ADS). MAKE CHECKS PAYABLE TO: American Document Solutions. Mail to: American Document Solutions, 1400 Forum Blvd., Suite 7A, Columbia, Missouri 65203. Phone 573-446-7768, Fax 573-355-5433, <https://www.adsplanroom.net>. NOTE: Prime contractors will be allowed a maximum of two bid sets at the deposit rate shown above. Other requesters will be allowed only one bid set at this rate. Additional bid sets or parts thereof may be obtained by any bidder at the cost of printing and shipping by request to American Document Solutions at the address shown above. Bidder must secure at least one bid set to become a planholder.
- B. **Refunds: Return plans and specifications in unmarked condition within 15 working days of bid opening to American Document Solutions, 1400 Forum Blvd., Suite 7A, Columbia, Missouri 65203. Phone 573-446-7768, Fax 573-355-5433. Deposits for plans not returned within 15 working days shall be forfeited.**
- C. Information for upcoming bids, including downloadable plans, specifications, Invitation for Bid, bid tabulation, award, addenda, and access to the ADS planholders list, is available on the Division of Facilities Management, Design and Construction's web site: <https://oa.mo.gov/facilities/bid-opportunities/bid-listing-electronic-plans>.

7.0 POINT OF CONTACT:

- A. Designer: PWArchitects, Inc, Eric Roselle, 573.449.2683, email: eroselle@pwarchitects.com
- B. Project Manager: Jared Cook, 573.690.6733, email: jared.cook2@oa.mo.gov

8.0 GENERAL INFORMATION:

- A. The State reserves the right to reject any and all bids and to waive all informalities in bids. No bid may be withdrawn for a period of 20 working days subsequent to the specified bid opening time. The contractor shall pay not less than the prevailing hourly rate of wages for work of a similar character in the locality in which the work is performed, as determined by the Missouri Department of Labor and Industrial Relations and as set out in the detailed plans and specifications.
- B. Bid results will be available at <https://oa.mo.gov/facilities/bid-opportunities/bid-listing-electronic-plans> after it is verified that at least one bid is awardable and affordable.

SECTION 002113 – INSTRUCTIONS TO BIDDERS

1.0 - SPECIAL NOTICE TO BIDDERS

- A. If awarded a contract, the Bidder's employees, and the employees of all subcontractors, who perform the work on the project must adhere to requirements in Section 013513 – Site Security and Health Requirements as applicable per Agency.
- B. The Bidder's prices shall include all city, state, and federal sales, excise, and similar taxes that may lawfully be assessed in connection with the performance of work, and the purchased of materials to be incorporated in the work. **THIS PROJECT IS NOT TAX EXEMPT.**

2.0 - BID DOCUMENTS

- A. The number of sets obtainable by one (1) party may be limited in accordance with available supply.
- B. For the convenience of contractors, subcontractors and suppliers, bidding documents are available on the Owner's website at <https://oa.mo.gov/facilities/bid-opportunities/bid-listing-electronic-plans>.

3.0 - BIDDERS' OBLIGATIONS

- A. Bidders must carefully examine the entire site of the work and shall make all reasonable and necessary investigations to inform themselves thoroughly as to the facilities available as well as to all the difficulties involved in the completion of all work in accordance with the specifications and the plans. Bidders are required to examine all maps, plans and data mentioned in the specifications. No plea of ignorance concerning observable existing conditions or difficulties that may be encountered in the execution of the work under this contract will be accepted as an excuse for any failure or omission on the part of the successful Bidder (contractor) to fulfill every detail of the requirements of the contract, nor accepted as a basis for any claims for extra compensation or time extension.
- B. Under no circumstances will Bidders give their plans and specifications to other Bidders. It is highly encouraged, but not required, that all Bidders be on the official planholders list to receive project updates including but not limited to any addenda that are issued during the bidding process.

4.0 - INTERPRETATIONS

- A. No Bidder shall be entitled to rely on oral or written representations from any person as to the meaning of the plans and specifications or the acceptability of alternate products, materials, form or type of construction.
- B. Bidders shall make all requests for interpretations in writing and submit all requests to the Project Designer and Project Manager identified in Section 007300 – Supplementary Conditions with all necessary supporting documentation no less than five (5) working days before opening of bids. Responses to requests for interpretation will be issued via a written addendum and will be sent as promptly as is practicable to all official planholders and posted on the Owner's website. All such addenda shall become part of the bid and contract documents.
- C. Bidders shall make all requests for an "Acceptable Substitution" on the Section 006325 Substitution Request Form. The request shall be emailed to the Project Designer and Project Manager identified in Section 007300 – Supplementary Conditions no less than five (5) working days before opening of bids. Responses to requests for substitutions will be issued via a written addendum and will be sent as promptly as is practicable to all official planholders and posted on the Owner's website. All such addenda shall become part of the bid and contract documents.
- D. An "Acceptable Substitution" requested after the award of bid will only be approved if proven to the satisfaction of the Owner and the Designer that the product is acceptable in design, strength, durability, usefulness, and convenience for the purpose intended. Approval of the substitution after award is at the sole discretion of the Owner and all requests of this nature must be submitted in accordance with Article 3.1 of the General Conditions.

5.0 - BIDS AND BIDDING PROCEDURE

- A. Bidders shall submit all submission forms and accompanying documents listed in Section 004113 – Bid Form, Article 5.0, Attachments to Bid by the stated time on the bid documents or the bid will be rejected for being non-responsive.
- B. Depending on the specific project requirements, **the following is a GENERIC list** of all possible bid forms that may be due with bid submittals. Bidders must verify each specific project’s requirements in Section 004113 to ensure they have provided all the required documentation with their submission.

Bid Submittal – due before stated date and time of bid opening (see IFB):

004113	Bid Form (all pages are always required)
004322	Unit Prices Form
004336	Proposed Subcontractors Form
004337	MBE/WBE/SDVE Compliance Evaluation Form
004338	MBE/WBE/SDVE Eligibility Determination for Joint Ventures
004339	MBE/WBE/SDVE GFE Determination
004340	SDVE Business Form
004541	Affidavit of Work Authorization
004545	Anti-Discrimination Against Israel Act Certification form

- C. The Bidder shall submit its bid on the forms provided by the Owner in the same file format (PDF) with each space fully and properly completed, typewritten or legibly printed, including all amounts required for alternate bids, unit prices, cost accounting data, etc. The Owner will reject bids that are not on the Owner’s forms or that do not contain all requested information. All forms can be found on the Owner’s website at <https://oa.mo.gov/facilities/bid-opportunities/bid-listing-electronic-plans> and shall be submitted with your bid to FMDCBids@oa.mo.gov.
- D. All bids shall be submitted without additional terms and conditions, modifications, or reservations. The completed forms should not include interlineations, alterations, or erasures. Bids not in compliance with the requirements of this paragraph will be rejected as non-responsive.
- E. All bids shall be accompanied by a bid bond executed by the bidder and a duly authorized surety company, certified check, cashier's check or bank draft made payable to the Division of Facilities Management, Design and Construction, State of Missouri, in the amount indicated in the bid documents in Section 004113. Failure of the Bidder to submit the duly authorized bid bond or the full amount required shall be sufficient cause to reject his bid. The Bidder agrees that the proceeds of the check, draft, or bond shall become the property of the State of Missouri, if for any reason the Bidder withdraws his bid after bid closing or if the Bidder, within ten (10) working days after notification of award, refuses or is unable to 1) execute the tendered contract, 2) provide an acceptable performance and payment bond, or 3) provide evidence of required insurance coverage.
- F. The bid bond check or draft submitted by the successful Bidder will be returned after the receipt of an acceptable performance and payment bond and execution of the formal contract. Checks or drafts of all other Bidders will be returned within a reasonable time after it is determined that the bid represented by same will receive no further consideration by the State of Missouri.

6.0 - SIGNING OF BIDS

- A. A bid should contain the full and correct legal name of the Bidder. If the Bidder is an entity registered with the Missouri Secretary of State, the Bidder’s name on the bid form should appear as shown in the Secretary of State’s records. If the Bidder is an entity organized in a state other than Missouri, the Bidder must provide a Certificate of Authority to do business in the State of Missouri.
- B. If the successful Bidder is doing business in the State of Missouri under a fictitious name, the Bidder shall furnish to Owner, attached to the Bid Form, a properly certified copy of the certificate of Registration of Fictitious Name from the State of Missouri, and such certificate shall remain on file with the Owner.
- C. A bid from an individual shall be signed as noted on the Bid Form.
- D. A bid from a partnership or joint venture shall require only one signature of a partner, an officer of the joint venture authorized to bind the venture, or an attorney-in-fact. If the bid is signed by an officer of

a joint venture or an attorney-in-fact, a document evidencing the individual's authority to execute contracts should be included with the bid form.

- E. A bid from a limited liability company (LLC) shall be signed by a manager or a managing member of the LLC.
- F. A bid from a corporation shall have the correct corporate name thereon and the signature of an authorized officer of the corporation. Title of office held by the person signing for the corporation shall appear, along with typed name of said individual and the corporate license number shall be provided. In addition, for corporate proposals, the President or Vice-President listed per the current filing with the Missouri Secretary of State should sign as the Bidder. If the signatory is other than the corporate president or vice president, the bidder must provide satisfactory evidence that the signatory has the legal authority to bind the corporation.

7.0 - RECEIVING BID SUBMITTALS

- A. It is the Bidder's sole responsibility to ensure receipt of the bid submittals by Owner on or before the date and time specified in the Invitation for Bid or as modified via written addenda. Bids received after the date and time specified will not be considered by the Owner.
- B. All bids shall be received via email at FMDCBids@oa.mo.gov and bids received by the Owner through any other means, including hard copies, will not be considered, and will be discarded by the Owner unopened.

8.0 - MODIFICATION AND WITHDRAWAL OF BIDS

- A. Bidder may withdraw a bid at any time prior to the scheduled closing time for receipt of bids, but no bidder may withdraw his bid for a period of twenty (20) working days after the scheduled closing time for receipt of bids.
- B. Bidder may modify a bid until the scheduled closing time by sending a revised bid to FMDCBids@oa.mo.gov with a note in the subject line and body of the email that it is a revised bid. All revised bids must be submitted to FMDCBids@oa.mo.gov, revised bids sent any other way will not be considered.

9.0 - AWARD OF CONTRACT

- A. The Owner reserves the right to reject any and/or all bids and further to waive all informalities in bidding when deemed in the best interest of the State of Missouri.
- B. The Owner reserves the right to let other contracts in connection with the work including, but not limited to, contracts for the furnishing and installation of furniture, equipment, machinery, appliances and other apparatuses.
- C. The Owner will award a contract to the lowest, responsive, and responsible Bidder in accordance with Section 8.250, RSMo. No contract will be awarded to any Bidder who has had a contract with the Owner terminated within the preceding twelve months for material breach of contract or who has been suspended or debarred by the Owner.
- D. Award of alternates, if any, will be made in numerical order unless all bids received are such that the order of acceptance of alternates does not affect the determination of the lowest, responsive, responsible bidder.
- E. No award shall be considered binding upon the Owner until the written contract has been properly executed and the following documentation has been provided: 1) performance and payment bond consistent with Article 6.1 of the General Conditions; 2) proof of the required insurance coverage; 3) an executed Section 004541 - Affidavit of Work Authorization form; and 4) documentation evidence enrollment and participation in a federal work authorization program.
- F. Failure to execute and return the contract and associated documents within the prescribed period shall be treated, at the option of the Owner, as a breach of Bidder's obligation and the Owner shall be under no further obligation to Bidder.
- G. Transient employers subject to Sections 285.230 and 285.234, RSMo, (out-of-state employers who temporarily transact any business in the State of Missouri) may be required to file a bond with the

Missouri Department of Revenue. No contract will be awarded by the Owner unless the successful Bidder certifies that he has complied with all applicable provisions of Section 285.230-234.

- H. Sections 285.525 and 285.530, RSMo, require business entities to enroll and participate in a federal work authorization program in order to be eligible to receive award of any state contract in excess of \$5,000. Bidders should submit with their bid an Affidavit of Work Authorization (Section 004541) along with appropriate documentation evidencing such enrollment and participation. Bidders must also submit an E-Verify Memorandum before the Owner may award a contract to the Bidder. Information regarding a E-Verify is located at <https://www.uscis.gov/e-verify/>. The contractor shall be responsible for ensuring that all subcontractors and suppliers associated with this contract enroll in E-Verify.
- I. The successful Bidder must be registered in MissouriBUYS powered by MOVERS at <https://missouribuys.mo.gov/supplier-registration#> as an approved vendor prior to being issued a contract.

10.0 - CONTRACT SECURITY

- A. The successful Bidder shall furnish a performance/payment bond as set forth in General Conditions Article 6.1 prior to the State executing the contract and issuing a notice to proceed.

11.0 - LIST OF SUBCONTRACTORS

- A. If required by “Section 004113 – Bid Form,” each Bidder must submit as part of their bid a list of subcontractors to be used in performing the work (Section 004336). The list must specify the name of the single designated subcontractor, manufacturer, or suppliers for each category of work listed in “Section 004336 - Proposed Subcontractors Form.” If work within a category will be performed by more than one subcontractor, the bidder must provide the name of each subcontractor and specify the exact portion of the work to be done by each. If the Bidder intends to perform any of the designated subcontract work with the use of his own employees, the Bidder shall make that fact clear, by listing his own firm for the subject category. **If any category of work is left vacant or if more than one subcontractor is listed for any category without designating the portion of work to be performed by each, the bid shall be rejected.**

12.0 - WORKING DAYS

- A. Contract duration time is stated in working days and will use the following definition in determining the actual calendar date for contract completion:
 - 1. Working days are defined as all calendar days except Saturdays, Sundays and the following State of Missouri observed holidays: New Year’s Day, Martin Luther King, Jr. Day, Lincoln Day, Washington’s Birthday, Truman Day, Memorial Day, Juneteenth, Independence Day, Labor Day, Columbus Day, Veterans Day, Thanksgiving Day and Christmas Day.

13.0 - AMERICAN AND MISSOURI - MADE PRODUCTS AND FIRMS

- A. By signing the bid form and submitting a bid on this project, the Bidder certifies that it will use American and Missouri products as set forth in Article 1.7 of the General Conditions. Bidders are advised to review those requirements carefully prior to bidding.
- B. A preference shall be given to Missouri firms, corporations or individuals, or firms, corporations or individuals that maintain Missouri offices or places of business, when the quality of performance promised is equal or better and the price quoted is the same or less.
- C. Pursuant to Section 34.076, RSMo, a contractor or Bidder domiciled outside the boundaries of the State of Missouri shall be required, in order to be successful, to submit a bid the same percent less than the lowest bid submitted by a responsible contractor or Bidder domiciled in Missouri as would be required for such a Missouri domiciled contractor or Bidder to succeed over the bidding contractor or Bidder domiciled outside Missouri on a like contract or bid being let in the Bidder’s domiciliary state and, further, the contractor or Bidder domiciled outside the boundaries of Missouri shall be required to submit an audited financial statement as would be required of a Missouri domiciled contractor or Bidder on a like contract or bid being let in the domiciliary state of that contractor or Bidder.

14.0 – ANTI-DISCRIMINATION AGAINST ISRAEL ACT CERTIFICATION:

- A. If the Bidder meets the section 34.600, RSMo., definition of a “company” and the Bidder has ten or more employees, the Bidder must certify in writing that the Bidder is not currently engaged in a boycott of goods or services from the State of Israel and shall not engage in a boycott of goods or services from the State of Israel, if awarded a contract, for the duration of the contract. The Bidder is required to complete and submit the applicable portion of Section 004545 - Anti-Discrimination Against Israel Act Certification with its Bid Form. The applicable portion of the exhibit must be submitted prior to execution of a contract by the Owner and issuance of Notice to Proceed.

15.0 - MBE/WBE/SDVE INSTRUCTIONS

A. Definitions:

- 1. “**MBE**” means a Minority Business Enterprise.
- 2. “**MINORITY**” has the same meaning as set forth in 1 C.S.R. 10-17.010.
- 3. “**MINORITY BUSINESS ENTERPRISE**” has the same meaning as set forth in section 37.020, RSMo.
- 4. “**WBE**” means a Women’s Business Enterprise.
- 5. “**WOMEN’S BUSINESS ENTERPRISE**” has the same meaning as set forth in section 37.020, RSMo.
- 6. “**SDVE**” means a Service-Disabled Veterans Enterprise.
- 7. “**SERVICE-DISABLED VETERAN**” has the same meaning as set forth in section 34.074, RSMo.
- 8. “**SERVICE-DISABLED VETERAN ENTERPRISE**” has the same meaning as “Service-Disabled Veteran Business” set forth in section 34.074, RSMo.

B. MBE/WBE/SDVE General Requirements:

- 1. For all bids greater than \$100,000, the Bidder shall obtain MBE, WBE and SDVE participation in an amount equal to or greater than the percentage goals set forth in the Invitation for Bid and the Bid Form, unless the Bidder is granted a Good Faith Effort waiver by the Director of the Division, as set forth below. If the Bidder does not meet the MBE, WBE and SDVE goals, or make a good faith effort to do so, the Bidder shall be nonresponsive, and its bid shall be rejected.
- 2. The Bidder should submit with its bid all the information requested in the MBE/WBE/SDVE Compliance Evaluation Form for every MBE, WBE, or SDVE subcontractor or material supplier the Bidder intends to use for the contract work. The Bidder is required to submit all MBE/WBE/SDVE documentation before the stated time and date set forth in the Invitation for Bid. If the Bidder fails to provide such information by the specified date and time, the Owner shall reject the bid.
- 3. The Director reserves the right to request additional information from a Bidder to clarify the Bidder’s proposed MBE, WBE, and/or SDVE participation. The Bidder shall submit the clarifying information requested by the Owner within two (2) working days of receiving the request for clarification.
- 4. Pursuant to section 34.074, RSMo, a Prime Bidder that qualifies as an SDVE shall receive a three-percentage point bonus preference in the contract award evaluation process. The bonus preference will be calculated and applied by reducing the bid amount of the eligible SDVE by three percent of the apparent low responsive Bidder’s bid. Based on this calculation, if the eligible SDVE’s evaluation is less than the apparent low responsive Bidder’s bid, the eligible SDVE’s bid will become the apparent low responsive bid. This reduction is for evaluation purposes only and will have no impact on the actual amount(s) of the bid or the amount(s) of any contract awarded. In order to be eligible for the SDVE preference, the Bidder must complete and submit with its bid the Missouri Service-Disabled Veteran Business Form, and any information required by the form.

C. Computation of MBE/WBE/SDVE Goal Participation:

- 1. A Bidder who is a MBE, WBE, or SDVE may count 100% of the contract towards the MBE, WBE or SDVE goal, less any amounts awarded to another MBE, WBE or SDVE. (NOTE: a MBE firm that bids as general contractor must obtain WBE and SDVE participation; a WBE firm that bids as a general contractor must obtain MBE and SDVE participation; and a SDVE firm that bids as general

contractor must obtain MBE and WBE participation.) For the remaining contract amount to be counted towards the MBE, WBE or SDVE goal, the Bidder must complete the MBE/WBE/SDVE Compliance Evaluation Form (Section 004337) identifying itself as an MBE, WBE or SDVE.

2. The total dollar value of the work granted to a certified MBE, WBE or SDVE by the Bidder shall be counted towards the applicable goal.
3. Expenditures for materials and supplies obtained from a certified MBE, WBE, or SDVE supplier or manufacturer may be counted towards the MBE, WBE and SDVE goals, if the MBE, WBE, or SDVE assumes the actual and contractual responsibility for the provision of the materials and supplies.
4. The total dollar value of the work granted to a second or subsequent tier subcontractor or a supplier may be counted towards a Bidder's MBE, WBE and SDVE goals, if the MBE, WBE, or SDVE properly assumes the actual and contractual responsibility for the work.
5. The total dollar value of work granted to a certified joint venture equal to the percentage of the ownership and control of the MBE, WBE, or SDVE partner in the joint venture may be counted towards the MBE/WBE/SDVE goals.
6. Only expenditures to a MBE, WBE, or SDVE that performs a commercially useful function in the work may be counted towards the MBE, WBE and SDVE goals. A MBE, WBE, or SDVE performs a commercially useful function when it is responsible for executing a distinct element of the work and carrying out its responsibilities by performing, managing and supervising the work or providing supplies or manufactured materials.

D. Certification of MBE/WBE/SDVE Subcontractors:

1. In order to be counted towards the goals, an MBE or WBE must be certified by the State of Missouri Office of Equal Opportunity and an SDVE must be certified by the State of Missouri, Office of Equal Opportunity or by the Federal U.S. Small Business Administration directory.
2. The Bidder may determine the certification status of a proposed MBE or WBE subcontractor or supplier by referring to the Office of Equal Opportunity (OEO)'s online MBE/WBE directory <https://apps1.mo.gov/MWBCertifiedFirms/>. The Bidder may determine the eligibility of a SDVE subcontractor or supplier by referring to the Office of Equal Opportunity online SDVE directory at <https://o eo .mo.gov/sdve-certification-program/> or the Federal U.S. Small Business Administration directory <https://veterans.certify.sba.gov/#search>.
3. Additional information, clarifications, or other information regarding the MBE/WBE/SDVE listings in the directories may be obtained by contacting the Contract Specialist of record as shown in the Supplementary Conditions (Section 007300).

E. Waiver of MBE/WBE/SDVE Participation:

1. If a Bidder has made a good faith effort to secure the required MBE, WBE and/or SDVE participation and has failed, the Bidder shall submit with its bid the information requested in MBE/WBE/SDVE Good Faith Effort (GFE) Determination form. The Director will determine if the Bidder made a good faith effort to meet the applicable goals. If the Director determines that the Bidder did not make a good faith effort, the bid shall be rejected as being nonresponsive to the bid requirements. Bidders who demonstrate that they have made a good faith effort to include MBE, WBE, and/or SDVE participation will be granted a waiver and will be considered to be responsive to the applicable participation goals, regardless of the percent of actual participation obtained, if the bid is otherwise acceptable.
2. In determining whether a Bidder has made a good faith effort to obtain MBE, WBE and/or SDVE participation, the Director may evaluate the factors set forth in 1 CSR 30-5.010(6)(C) and the following:
 - a. The amount of actual participation obtained;

- b. How and when the Bidder contacted potential MBE, WBE, and SDVE subcontractors and suppliers;
- c. The documentation provided by the Bidder to support its contacts, including whether the Bidder provided the names, addresses, phone numbers, and dates of contact for MBE/WBE/SDVE firms contacted for specific categories of work;
- d. If project information, including plans and specifications, were provided to MBE/WBE/SDVE subcontractors;
- e. Whether the Bidder made any attempts to follow-up with MBE, WBE or SDVE firms prior to bid;
- f. Amount of bids received from any of the subcontractors and/or suppliers that the Bidder contacted;
- g. The Bidder's stated reasons for rejecting any bids;

F. Contractor MBE/WBE/SDVE Obligations

- 1. If awarded a contract, the Bidder will be contractually required to subcontract with or obtain materials from the MBE, WBE, and SDVE firms listed in its bid, in amounts equal to or greater than the dollar amount in the bid, unless the amount is modified in writing by the Owner.
- 2. If the Contractor fails to meet or maintain the participation requirements contained in the Contractor's bid, the Contractor must satisfactorily explain to the Director why it cannot comply with the requirement and why failing meeting the requirement was beyond the Contractor's control. If the Director finds the Contractor's explanation unsatisfactory, the Director may take any appropriate action including, but not limited to:
 - a. Declaring the Contractor ineligible to participate in any contracts with the Division for up to twelve (12) months (suspension); and/or
 - b. Declaring the Contractor be nonresponsive to the Invitation for Bid, or in breach of contract and rejecting the bid or terminating the contract.
- 3. If the Contractor replaces an MBE, WBE, or SDVE during the course of the contract, the Contractor shall replace it with another MBE, WBE, or SDVE or make a good faith effort to do so. All MBE, WBE and SDVE substitutions must be approved by the Director in writing.
- 4. The Contractor shall provide the Owner with regular reports on its progress in meeting its MBE/WBE/SDVE obligations. At a minimum, the Contractor shall report the dollar-value of work completed by each MBE, WBE, or SDVE during the preceding month and the cumulative total of work completed by each MBE, WBE or SDVE to date with each monthly application for payment. The Contractor shall also make a final report, which shall include the total dollar-value of work completed by each MBE, WBE, and SDVE during the entire contract.



State of Missouri Construction Contract

THIS AGREEMENT is made (DATE) by and between:

Contractor Name and Address

hereinafter called the "Contractor," and the **State of Missouri**, hereinafter called the "**Owner**", represented by the Office of Administration, Division of Facilities Management, Design and Construction.

WITNESSETH, that the Contractor and the Owner, for the consideration stated herein agree as follows:

ARTICLE 1. STATEMENT OF WORK

The Contractor shall furnish all labor and materials and perform all work required for furnishing and installing all labor, materials, equipment and transportation and everything necessarily inferred from the general nature and tendency of the plans and specifications for the proper execution of the work for:

Project Name: **New Comfort Station at Swine Pavilion
Missouri State Fairgrounds (MSF)
Sedalia, Missouri**

Project Number: **F2406-01**

in strict accordance with the Contract Documents as enumerated in Article 7, all of which are made a part hereof.

ARTICLE 2. TIME OF COMPLETION

The contract completion date is **July 15, 2025**. This time includes ten (10) working days for the Contractor to receive, sign and return the contract form along with required bonding and insurance certificates. Failure of the Contractor to provide correct bonding and insurance within the ten (10) working days shall not be grounds for a time extension. Receipt of proper bonding and insurance is a condition precedent to the formation of the contract and if not timely received, may result in forfeiture of the Contractor's bid security. Work may not commence until the Owner issues a written Notice to Proceed and must commence within seven (7) working days thereafter.

ARTICLE 3. LIQUIDATED DAMAGES

Whenever time is mentioned in this contract, time shall be and is of the essence of this contract. The Owner would suffer a loss should the Contractor fail to have the work embraced in this contract fully completed on or before the time above specified. THEREFORE, the parties hereto realize in order to adjust satisfactorily the damages on account of such failure that it might be impossible to compute accurately or estimate the amount of such loss or damages which the Owner would sustain by reason of failure to complete fully said work within the time required by this contract. The Contractor hereby covenants and agrees to pay the Owner, as and for **liquidated damages, the sum of \$700** per day for each and every day, Sunday and legal holidays excepted, during which the work remains incomplete and unfinished. Any sum which may be due the Owner for such damages shall be deducted and retained by the Owner from any balance which may be due the Contractor when said work shall have been finished and accepted. But such provisions shall not release the Bond of the Contractor from liability according to its terms. In case of failure to complete, the Owner will be under no obligation to show or prove any actual or specific loss or damage.

ARTICLE 4. CONTRACT SUM

The Owner shall pay the Contractor for the prompt, faithful and efficient performance of the conditions and undertakings of this contract, subject to additions, and deductions as provided herein, in current funds the sum of:

Base Bid: \$

Accepted Alternates, if applicable to the Project and accepted by the Owner.

TOTAL CONTRACT AMOUNT: (\$CONTRACT AMOUNT)

UNIT PRICES: The Owner accepts the following Unit Prices:

For changing specified quantities of work from those indicated by the contract drawings and specifications, upon written instructions of Owner, the following unit prices shall prevail. The unit prices include all labor, overhead and profit, materials, equipment, appliances, bailing, shoring, shoring removal, etc., to cover the finished work of the several kinds of work called for. Only a single unit price shall be given and it shall apply for either MORE or LESS work than that shown on the drawings and called for in the specifications or included in the Base Bid. In the event of more or less units than so indicated or included, change orders may be issued for the increased or decreased amount.

ARTICLE 5. PREVAILING WAGE RATE

MISSOURI PREVAILING WAGE LAW (Sections 290.210 to 290.340, RSMo): The Contractor shall pay not less than the specified hourly rate of wages, as set out in the wage order attached to and made part of the specifications for work under this contract, to all workers performing work under the contract, in accordance with sections 290.210 to 290.340, RSMo. The Contractor shall forfeit a penalty to the Owner of one hundred dollars per day (or portion of a day) for each worker that is paid less than the specified rates for any work done under the contract by the Contractor or by any subcontractor, in accordance with section 290.250, RSMo.

DAVIS-BACON ACT: If this Project is financed in whole or in part from Federal funds (as indicated in the Instructions to Bidders or other bid or contract documents for this Project), then this contract shall be subject to all applicable federal labor statutes, rules and regulations, including provisions of the Davis-Bacon Act, 40 U.S.C. §3141 et seq., and the "Federal Labor Standards Provisions," as further set forth in Section 007333 – Supplementary General Conditions for Federally Funded/Assisted Construction Projects, which is incorporated into the contract by reference. Where the Missouri Prevailing Wage Law and the Davis-Bacon Act require payment of different wages for work performed under this contract, the Contractor and all Subcontractors shall pay the greater of the wages required under either law, on a classification-by-classification basis.

ARTICLE 6. MINORITY/WOMEN/SERVICE DISABLED VETERAN BUSINESS ENTERPRISE PARTICIPATION

The Contractor has been granted a waiver of the 10% MBE and 10% WBE and 3% SDVE participation goals. The Contractor agrees to secure the MBE/WBE/SDVE participation amounts for this project as follows: (OR)

The Contractor has met the MBE/WBE/SDVE participation goals and agrees to secure the MBE/WBE/SDVE participation amounts for this project as follows:

MBE/WBE/SDVE Firm: Subcontract Amt:\$
MBE/WBE/SDVE Firm: Subcontract Amt:\$
MBE/WBE/SDVE Firm: Subcontract Amt:\$

Total \$

MBE/WBE/SDVE assignments identified above shall not be changed without a contract change signed by the Owner.

The Director of the Division of Facilities Management, Design and Construction or his Designee shall be the final authority to resolve disputes and disagreements between the Contractor and the MBE/WBE/SDVE firms listed above when such disputes impact the subcontract amounts shown above.

ARTICLE 7. CONTRACT DOCUMENTS

The following documents are hereby incorporated into this contract by reference (all division/section numbers and titles are as utilized in the Project Manual published by the Owner for this Project):

1. Division 0 – Procurement and Contracting Information, including, but not limited to:
 - a. Invitation for Bid (Section 001116)
 - b. Instructions to Bidders (Section 002113)
 - c. Supplementary Instructions to Bidders (if applicable) (Section 002213)
 - d. The following documents as completed and executed by the Contractor and accepted by the Owner, if applicable:
 - i. Bid Form (Section 004113)
 - ii. Unit Prices (Section 004322)
 - iii. Proposed Contractors Form (Section 004336)
 - iv. MBE, WBE, SDVE Compliance Evaluation Form(s) (Section 004337)
 - v. MBE, WBE, SDVE Eligibility Determination Form for Joint Ventures (Section 004338)
 - vi. MBE, WBE, SDVE Good Faith Effort (GFE) Determination Form (Section 004339)
 - vii. Missouri Service Disabled Veteran Business Form (Section 004340)
 - viii. Affidavit of Work Authorization (Section 004541)
 - ix. Affidavit for Affirmative Action (Section 005414), if applicable
 - e. Performance and Payment Bond, completed and executed by the Contractor and surety (Section 006113)
 - f. General Conditions (Section 007213)
 - g. Supplementary Conditions (Section 007300)
 - h. Supplementary General Conditions for Federally Funded/Assisted Construction Projects (Section 007333), if applicable
 - i. Wage Rate(s) (Section 007346)
2. Division 1 – General Requirements
3. All Drawings identified in the Project Manual
4. All Technical Specifications included in the Project Manual
5. Addenda, if applicable

ARTICLE 8 – CERTIFICATION

By signing this contract, the Contractor hereby re-certifies compliance with all legal requirements set forth in Section 6.0, Bidder’s Certifications of the Bid Form.

By signature below, the parties hereby execute this contract document.

APPROVED:

Brian Yansen, Director
 Division of Facilities Management,
 Design and Construction

Contractor’s Authorized Signature

I, Corporate Secretary, certify that I am Secretary of the corporation named above and that (CONTRACTOR NAME), who signed said contract on behalf of the corporation, was then (TITLE) of said corporation and that said contract was duly signed for and in behalf of the corporation by authority of its governing body, and is within the scope of its corporate powers.

Corporate Secretary

SECTION 006113 - PERFORMANCE AND PAYMENT BOND FORM

KNOW ALL MEN BY THESE PRESENTS, THAT we _____

as principal, and _____

_____ as Surety, are held and firmly bound unto the

STATE OF MISSOURI. in the sum of _____ Dollars (\$ _____)

for payment whereof the Principal and Surety bind themselves, their heirs, executors, administrators and successors, jointly and severally, firmly by these presents.

WHEREAS, the Principal has, by means of a written agreement dated the _____

day of _____, 20_____, enter into a contract with the State of Missouri for

(Insert Project Title and Number)

NOW, THEREFORE, if the Principal shall faithfully perform and fulfill all the undertakings, covenants, terms, conditions and agreements of said contract during the original term of said contract and any extensions thereof that may be granted by the State of Missouri, with or without notice to the Surety and during the life of any guaranty required under the contract; and shall also faithfully perform and fulfill all undertakings, covenants, terms, conditions and agreements of any and all duly authorized modifications of said contract that may hereafter be made with or without notice to the Surety; and shall also promptly make payment for materials incorporated, consumed or used in connection with the work set forth in the contract referred to above, and all insurance premiums, both compensation and all other kinds of insurance, on said work, and for all labor performed on such work, whether by subcontractor or otherwise, at not less than the prevailing hourly rate of wages for work of a similar character (exclusive of maintenance work) in the locality in which the work is performed and not less than the prevailing hourly rate of wages for legal holiday and overtime work (exclusive of maintenance work) in the locality in which the work is performed both as determined by the Department of Labor and Industrial Relations or determined by the Court of Appeal, as provided for in said contract and in any and all duly authorized modifications of said contract that may be hereafter made, with or without notice to the Surety, then, this obligation shall be void and of no effect, but it is expressly understood that if the Principal should make default in or should fail to strictly, faithfully and efficiently do, perform and comply with any or more of the covenants, agreements, stipulations, conditions, requirements or undertakings, as specified in or by the terms of said contract, and with the time therein named, then this obligation shall be valid and binding upon each of the parties hereto and this bond shall remain in full force and effect; and the same may be sued on at the instance of any material man, laborer, mechanic, subcontractor, individual, or otherwise to whom such payment is due, in the name of the State of Missouri, to the use of any such person.

AND, IT IS FURTHER specifically provided that any modifications which may hereinafter be made in the terms of the contract or in the work to be done under it or the giving by the Owner of any extension of the time for the performance of the contract or any other forbearance on the part of either the Owner or the Principal to the other, shall not in any way release the Principal and the Surety, or either or any of them, their heirs, executors, administrators and successors, from their liability hereunder, notice to the Surety of any such extension, modifications or forbearance being hereby waived.

IN WITNESS WHEREOF, the above bounden parties have executed the within instrument this _____ day of _____, 20 ____.

AS APPLICABLE:

AN INDIVIDUAL

Name: _____

Signature: _____

A PARTNERSHIP

Name of Partner: _____

Signature of Partner: _____

Name of Partner: _____

Signature of Partner: _____

CORPORATION

Firm Name: _____

Signature of President: _____

SURETY

Surety Name: _____

Attorney-in-Fact: _____

Address of Attorney-in-Fact: _____

Telephone Number of Attorney-in-Fact: _____

Signature Attorney-in-Fact: _____

NOTE: Surety shall attach Power of Attorney



STATE OF MISSOURI
 OFFICE OF ADMINISTRATION
 DIVISION OF FACILITIES MANAGEMENT, DESIGN AND CONSTRUCTION
PRODUCT SUBSTITUTION REQUEST

PROJECT NUMBER

PROJECT TITLE AND LOCATION

CHECK APPROPRIATE BOX

- SUBSTITUTION PRIOR TO BID OPENING**
 (Minimum of (5) working days prior to receipt of Bids as per Article 4 – Instructions to Bidders)
- SUBSTITUTION FOLLOWING AWARD**
 (Maximum of (20) working days from Notice to Proceed as per Article 3 – General Conditions)

FROM: BIDDER/CONTRACTOR (PRINT COMPANY NAME)

TO: ARCHITECT/ENGINEER (PRINT COMPANY NAME)

Bidder/Contractor hereby requests acceptance of the following product or systems as a substitution in accordance with provisions of Division One of the Bidding Documents:

SPECIFIED PRODUCT OR SYSTEM

SPECIFICATION SECTION NO.

SUPPORTING DATA

- Product data for proposed substitution is attached (include description of product, standards, performance, and test data)
- Sample Sample will be sent, if requested

QUALITY COMPARISON

	SPECIFIED PRODUCT	SUBSTITUTION REQUEST
NAME, BRAND		
CATALOG NO.		
MANUFACTURER		
VENDOR		

PREVIOUS INSTALLATIONS

PROJECT	ARCHITECT/ENGINEER	DATE INSTALLED
LOCATION		

SIGNIFICANT VARIATIONS FROM SPECIFIED PRODUCT

REASON FOR SUBSTITUTION

DOES PROPOSED SUBSTITUTION AFFECT OTHER PARTS OF WORK?

YES NO

IF YES, EXPLAIN

SUBSTITUTION REQUIRES DIMENSIONAL REVISION OR REDESIGN OF STRUCTURE OR A/E WORK

YES NO

BIDDER'S/CONTRACTOR'S STATEMENT OF CONFORMANCE OF PROPOSED SUBSTITUTION TO CONTRACT REQUIREMENT:

We have investigated the proposed substitution. We believe that it is equal or superior in all respects to specified product, except as stated above; that it will provide the same Warranty as specified product; that we have included complete implications of the substitution; that we will pay redesign and other costs caused by the substitution which subsequently become apparent; and that we will pay costs to modify other parts of the Work as may be needed, to make all parts of the Work complete and functioning as a result of the substitution.

BIDDER/CONTRACTOR

DATE

REVIEW AND ACTION

Resubmit Substitution Request with the following additional information:

Substitution is accepted.

Substitution is accepted with the following comments:

Substitution is not accepted.

ARCHITECT/ENGINEER

DATE



PROJECT NUMBER

KNOW ALL MEN BY THESE PRESENT THAT: hereinafter called "Subcontractor" who heretofore entered into an agreement with hereinafter called "Contractor", for the performance of work and/or furnishing of material for the construction of the project entitled

(PROJECT TITLE, PROJECT LOCATION, AND PROJECT NUMBER)

at

 (ADDRESS OF PROJECT)

for the State of Missouri (Owner) which said subcontract is by this reference incorporated herein, in consideration of such final payment by Contractor.

DOES HEREBY:

1. ACKNOWLEDGE that they have been **PAID IN FULL** all sums due for work and materials contracted or done by their Subcontractors, Material Vendors, Equipment and Fixture Suppliers, Agents and Employees, or otherwise in the performance of the Work called for by the aforesaid Contract and all modifications or extras or additions thereto, for the construction of said project or otherwise.
2. RELEASE and fully, finally, and forever discharge the Owner from any and all suits, actions, claims, and demands for payment for work performed or materials supplied by Subcontractor in accordance with the requirements of the above referenced Contract.
1. REPRESENT that all of their Employees, Subcontractors, Material Vendors, Equipment and Fixture Suppliers, and everyone else has been **paid in full** all sums due them, or any of them, in connection with performance of said Work, or anything done or omitted by them, or any of them in connection with the construction of said improvements, or otherwise.

DATED this day of , 20 .

NAME OF SUBCONTRACTOR

BY (TYPED OR PRINTED NAME)

SIGNATURE

TITLE

ORIGINAL: FILE/Closeout Documents



STATE OF MISSOURI
 OFFICE OF ADMINISTRATION
 DIVISION OF FACILITIES MANAGEMENT,
 DESIGN AND CONSTRUCTION

MBE/WBE/SDVE PROGRESS REPORT

Remit with **ALL** Progress and Final Payments

(Please check appropriate box) CONSULTANT CONSTRUCTION

PAY APP NO.	PROJECT NUMBER
CHECK IF FINAL <input checked="" type="checkbox"/> FINAL	DATE

PROJECT TITLE			
PROJECT LOCATION			
FIRM			
ORIGINAL CONTRACT SUM (Same as Line Item 1. on Form A of Application for Payment) \$		TOTAL CONTRACT SUM TO DATE (Same as Line Item 3. on Form A of Application for Payment) \$	
THE TOTAL MBE/WBE/SDVE PARTICIPATION DOLLAR AMOUNT OF THIS PROJECT AS INDICATED IN THE ORIGINAL CONTRACT: \$			
SELECT MBE, WBE, SDVE	ORIGINAL CONTRACT PARTICIPATION AMOUNT	PARTICIPATION AMOUNT PAID-TO-DATE (includes approved contract changes)	CONSULTANT/SUBCONSULTANT OR CONTRACTOR/SUBCONTRACTOR/SUPPLIER COMPANY NAME
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	

Revised 06/2023

INSTRUCTIONS FOR MBE/WBE/SDVE PROGRESS REPORT

CONTRACTOR OR CONSULTANT TO FILL OUT AND REMIT WITH EACH PAY APPLICATION:

The MBE/WBE/SDVE Progress Report for the project is issued with the contract comprising values reported in the consultant's Proposal or on the successful contractor's Section 004337 Compliance Evaluation Forms.

At Initial Pay Application fill in the following:

1. Pay App No. Start with 1.
2. Fill in the Project Number and Date.
3. Enter Project Title, Project Location, and Firm.
4. Fill in the "Original Contract Sum" and "Total Contract Sum To Date" (Reference applicable Line Items on Form A of Application for Payment).
5. Indicate the Total Participation Dollar Amount from the Original Contract.
6. Select MBE, WBE, or SDVE for each Consultant/Subconsultant or Contractor/Subcontractor/Supplier.
7. Enter the "Total Amount of Subcontract", "\$ Amount (Paid-To-Date)", and Company Name.

For all subsequent Pay Applications fill in the following:

1. Pay App No.
2. If Final Pay App, check box.
3. Fill in the Project Number and Date.
4. Enter Project Title, Project Location, and Firm
5. At each Pay App fill in the "Original Contract Sum" and "Total Contract Sum To Date" (reference applicable Line Items on Form A of Application for Payment).
6. Indicate the Total Participation Dollar Amount from the Original Contract.
7. Select MBE, WBE, or SDVE for each Consultant/Subconsultant or Contractor/Subcontractor/Supplier
8. Enter the "Total Amount of Subcontract", "\$ Amount (Paid-To-Date)", and Company Name.



STATE OF MISSOURI
 OFFICE OF ADMINISTRATION
 DIVISION OF FACILITIES MANAGEMENT, DESIGN AND CONSTRUCTION
AFFIDAVIT – COMPLIANCE WITH PREVAILING WAGE LAW

PROJECT NUMBER

Before me, the undersigned Notary Public, in and for the County of _____

State of _____ personally came and appeared _____

(NAME)

_____ of the _____

(POSITION) (NAME OF THE COMPANY)

(a corporation) (a partnership) (a proprietorship) and after being duly sworn did depose and say that all provisions and requirements set out in Chapter 290, Sections 290.210 through and including 290.340, Missouri Revised Statutes, pertaining to the payment of wages to workmen employed on public works project have been fully satisfied and there has been no exception to the full and completed compliance with said provisions and requirements and with Wage Determination No: _____ issued by the Department of Labor and Industrial Relations, State of Missouri on the _____ day of _____ 20 _____ in carrying out the contract and working in connection with _____

(NAME OF PROJECT)

Located at _____ in _____ County

(NAME OF THE INSTITUTION)

Missouri, and completed on the _____ day of _____ 20 _____

SIGNATURE

NOTARY INFORMATION

NOTARY PUBLIC EMBOSSEER OR BLACK INK RUBBER STAMP SEAL	STATE	COUNTY (OR CITY OF ST. LOUIS)
	SUBSCRIBED AND SWORN BEFORE ME, THIS	
	DAY OF	YEAR
	NOTARY PUBLIC SIGNATURE	MY COMMISSION EXPIRES
NOTARY PUBLIC NAME (TYPED OR PRINTED)		USE RUBBER STAMP IN CLEAR AREA BELOW

FILE: Closeout Documents

GENERAL CONDITIONS

INDEX

ARTICLE:

1. General Provisions

- 1.1. Definitions
- 1.2. Drawings and Specifications
- 1.3. Compliance with Laws, Permits, Regulations and Inspections
- 1.4. Nondiscrimination in Employment
- 1.5. Anti-Kickback
- 1.6. Patents and Royalties
- 1.7. Preference for American and Missouri Products and Services
- 1.8. Communications
- 1.9. Separate Contracts and Cooperation
- 1.10. Assignment of Contract
- 1.11. Indemnification
- 1.12. Disputes and Disagreements

2. Owner/Designer Responsibilities

3. Contractor Responsibilities

- 3.1. Acceptable Substitutions
- 3.2. Submittals
- 3.3. As-Built Drawings
- 3.4. Guaranty and Warranties
- 3.5. Operation and Maintenance Manuals
- 3.6. Other Contractor Responsibilities
- 3.7. Subcontracts

4. Changes in the Work

- 4.1. Changes in the Work
- 4.2. Changes in Completion Time

5. Construction and Completion

- 5.1. Construction Commencement
- 5.2. Project Construction
- 5.3. Project Completion
- 5.4. Payments

6. Bond and Insurance

6.1. Bond

6.2. Insurance

7. Termination or Suspension of Contract

7.1. For Site Conditions

7.2. For Cause

7.3. For Convenience

SECTION 007213 - GENERAL CONDITIONS

- A. These General Conditions apply to each section of these specifications. The Contractor is subject to the provisions contained herein.
- B. The General Conditions are intended to define the relationship of the Owner, the Designer and the Contractor thereby establishing certain rules and provisions governing the operation and performance of the work so that the work may be performed in a safe, orderly, expeditious and workmanlike manner.

ARTICLE 1 – GENERAL PROVISIONS

ARTICLE 1.1 - DEFINITIONS

As used in these contract documents, the following terms shall have the meanings and refer to the parties designated in these definitions.

1. **"COMMISSIONER"**: The Commissioner of the Office of Administration.
2. **"CONSTRUCTION DOCUMENTS"**: The "Construction Documents" shall consist of the Project Manual, Drawings and Addenda.
3. **"CONSTRUCTION REPRESENTATIVE"**: Whenever the term "Construction Representative" is used, it shall mean the Owner's Representative at the work site.
4. **"CONTRACTOR"**: Party or parties who have entered into a contract with the Owner to furnish work under these specifications and drawings.
5. **"DESIGNER"**: When the term "Designer" is used herein, it shall refer to the Architect, Engineer, or Consultant of Record specified and defined in Paragraph 2.0 of the Supplemental Conditions, or his duly authorized representative. The Designer may be either a consultant or state employee.
6. **"DIRECTOR"**: Whenever the term "Director" is used, it shall mean the Director of the Division of Facilities Management, Design and Construction or his Designee, representing the Office of Administration, State of Missouri. The Director is the agent of the Owner.
7. **"DIVISION"**: Shall mean the Division of Facilities Management, Design and Construction, State of Missouri.
8. **"INCIDENTAL JOB BURDENS"**: Shall mean those expenses relating to the cost of work, incurred either in the home office or on the job-site, which are necessary in the course of doing business but are incidental to the job. Such costs include office supplies and equipment, postage, courier services, telephone expenses including long distance, water and ice and other similar expenses.
9. **"JOINT VENTURE"**: An association of two (2) or more businesses to carry out a single business enterprise for profit for which purpose they combine their property, capital, efforts, skills and knowledge.
10. **"OWNER"**: Whenever the term "Owner" is used, it shall mean the State of Missouri. Acting by and through the Office of Administration, Division of Facilities Management, Design and Construction.
11. **"PROJECT"**: Wherever the term "Project" is used, it shall mean the work required to be completed by the construction contract.
12. **"PROJECT MANUAL"**: The "Project Manual" shall consist of Introductory Information, Invitation for Bid, Instructions to Bidders, Bid Documents, Additional Information, Standard Forms, General Conditions, Supplemental General Conditions, General Requirements and Technical Specifications.
13. **"SUBCONTRACTOR"**: Party or parties who contract under, or for the performance of part or this entire Contract between the Owner and Contractor. The subcontract may or may not be direct with the Contractor.
14. **"WORK"**: All supervision, labor, materials, tools, supplies, equipment, and any incidental operations and/or activities required by or reasonably inferable from the Contract Documents necessary to construct the Project and to produce the results intended by the Contract Documents in a safe, expeditious, orderly, and workmanlike manner so that the project shall be complete and finished in the best manner known to each respective trade.
15. **"WORKING DAYS"**: are all calendar days except Saturdays, Sundays and the following holidays: New Year's Day, Martin Luther King, Jr. Day, Lincoln Day, Washington's Birthday (observed), Truman Day, Memorial Day, Juneteenth, Independence Day, Labor Day, Columbus Day, Veterans Day (observed), Thanksgiving Day, Christmas Day.

ARTICLE 1.2 DRAWINGS AND SPECIFICATIONS

- A. In case of discrepancy between drawings and specifications, specifications shall govern. Should discrepancies in architectural drawings, structural drawings and mechanical drawings occur, architectural drawings shall govern and, in case of conflict between structural and mechanical drawings, structural drawings shall govern.
- B. Specifications are separated into titled divisions for convenience of reference only and to facilitate letting of contracts and subcontracts. The Contractor is responsible for establishing the scope of work for subcontractors, which may cross titled divisions. Neither the Owner nor Designer will establish limits and jurisdiction of subcontracts.
- C. Figured dimensions take precedence over scaled measurements and details over smaller scale general drawings. In the event of conflict between any of the documents contained within the contract, the documents shall take precedence and be controlling in the following sequence: addenda, supplementary general conditions, general conditions, division 1 specifications, technical division specifications, drawings, bid form and instructions to bidders.
- D. Anything shown on drawings and not mentioned in these specifications or vice versa, as well as any incidental work which is obviously necessary to complete the project within the limits established by the drawings and specifications, although not shown on or described therein, shall be performed by the Contractor at no additional cost as a part of his contract.
- E. Upon encountering conditions differing materially from those indicated in the contract documents, the Contractor shall promptly notify the Designer and Construction Representative in writing before such conditions are disturbed. The Designer shall promptly investigate said conditions and report to the Owner, with a recommended course of action. If conditions do materially differ and cause an increase or decrease in contract cost or time required for completion of any portion of the work, a contract change will be initiated as outlined in Article 4 of these General Conditions.
- E. Only work included in the contract documents is authorized, and the Contractor shall do no work other than that described therein or in accordance with appropriately authorized and approved contract changes.

ARTICLE 1.3 - COMPLIANCE WITH LAWS, PERMITS, REGULATIONS AND INSPECTIONS

- A. Since the Owner is the State of Missouri, municipal or political subdivisions, zoning ordinances, construction codes (other than licensing of trades), and other like ordinances are not applicable to construction on Owner's property, and Contractor will not be required to submit drawings and specifications to any municipal or political subdivision, authority, obtain construction permits or any other licenses (other than licensing of trades) or permits from or submit to inspections by any municipality or political subdivision relating to the construction for this project. All permits or licenses required by municipality or political subdivision for operation on property not belonging to Owner shall be obtained by and paid for by Contractor. Each Contractor shall comply with all applicable laws, ordinances, rules and regulations that pertain to the work of this contract.
- B. Contractors, subcontractors and their employees engaged in the businesses of electrical, mechanical, plumbing, carpentry, sprinkler system work, and other construction related trades shall be licensed to perform such work by the municipal or political subdivision where the project is located, if such licensure is required by local code. Local codes shall dictate the level (master, journeyman, and apprentice) and the number, type and ratio of licensed tradesmen required for this project within the jurisdiction of such municipal or political subdivision.
- C. Equipment and controls manufacturers and their authorized service and installation technicians that do not maintain an office within the jurisdiction of the municipal or political subdivision but are a listed or specified contractor or subcontractor on this project are exempt from Paragraph 1.3 B above.
- D. The Contractor shall post a copy of the wage determination issued for the project and included as a part of the contract documents, in a prominent and easily accessible location at the site of construction for the duration of the project.
- E. Any contractor or subcontractor to such contractor at any tier signing a contract to work on this project shall provide a ten-hour Occupational Safety and Health Administration (OSHA) construction safety program for their on-site employees which includes a course in construction safety and health approved by OSHA or a similar program approved by the Department of Labor and Industrial Relations which is at least as stringent as an approved OSHA program. The contractor shall forfeit as a penalty to the public body on whose

behalf the contract is made or awarded, two thousand five hundred dollars plus one hundred dollars for each employee employed by the contractor or subcontractor, for each calendar day, or portion thereof, such employee is employed without the required training.

ARTICLE 1.4 - NONDISCRIMINATION IN EMPLOYMENT

A. The Contractor and his subcontractors will not discriminate against individuals based on race, color, religion, national origin, sex, disability, or age, but may use restrictions which relate to bona fide occupational qualifications. Specifically, the Contractor and his subcontractors shall not discriminate:

1. Against recipients of service on the basis of race, color, religion, national origin, sex, disability or age.
2. Against any employee or applicant, for employment on the basis of race, color, religion, national origin, sex or otherwise qualified disability status.
3. Against any applicant for employment or employee on the basis of age, where such applicant or employee is between ages 40 and 70 and where such Contractor employs at least 20 persons.
4. Against any applicant for employment or employee on the basis of that person's status as a disabled or Vietnam-era veteran.

The Contractor and his Subcontractors will ensure applicants for employment and employees are treated equally without regard to race, color, religion, national origin, sex, disability, or age. Such action shall include, but not be limited to, the following: employment, upgrading, demotion and transfer; recruitment or recruitment advertising; and selection for training, including apprenticeship. The Contractor and his Subcontractors will give written notice of their commitments under this clause to any labor union with which they have bargaining or other agreements under this clause to any labor union with which they have bargaining or other agreements.

B. In the event of the Contractor's or his subcontractor's noncompliance with any provisions of this Article of the Contract, the Owner may cancel this contract in whole or in part or require the Contractor to terminate his contract with the subcontractor.

ARTICLE 1.5 - ANTI-KICKBACK

No employee of the division, shall have or acquire any pecuniary interest, whether direct or indirect, in this contract or in any part hereof. No officer, employee, designer, attorney, or administrator of or for the Owner who is authorized in such capacity and on behalf of the Owner to exercise any legislative, executive, supervisory or other similar functions in connection with the construction of the project, shall have or acquire any pecuniary interest, whether direct or indirect, in this contract, any material supply contract, subcontract, insurance contract, or any other contract pertaining to the project.

ARTICLE 1.6 - PATENTS AND ROYALTIES

A. The Contractor shall hold and save the Owner and its officers, agents, servants, and employees harmless from liabilities of any nature or kind, including cost and expenses, for, or on account of, any patented or unpatented invention, process, article or appliance manufactured or used in the performance of this contract, including its use by the Owner, unless otherwise specifically stipulated in the contract documents.

B. If the Contractor uses any design, device or materials covered by letters, patent or copyright, the Contractor shall provide for such use by suitable agreement with the Owner of such patented or copyrighted design, device or material. It is mutually agreed and understood, without exception, that the contract prices shall include all royalties or costs arising from the use of such design, device or materials, in any way involved in the work. The Contractor and/or his sureties shall indemnify and save harmless the Owner of the project from any and all claims for infringement by reason of the use of such patented or copyrighted design, device or materials or any trademark or copyright in connection with work agreed to be performed under this contract and shall indemnify the Owner for any cost, expense or damage it may be obliged to pay by reason of such infringement at any time during the prosecution of the work or after completion of the work.

ARTICLE 1.7 - PREFERENCE FOR AMERICAN AND MISSOURI PRODUCTS AND SERVICES

- A. By virtue of statutory authority a preference will be given to Missouri labor and to products of mines, forests and quarries of the state of Missouri when they are found in marketable quantities in the state, and all such materials shall be of the best quality and suitable character that can be obtained at reasonable market prices, all as provided for in Section 8.280, Missouri Revised Statutes and Cumulative Supplements.
- B. Furthermore, pursuant to Section 34.076 Missouri Revised Statutes and Cumulative Supplements, a preference shall be given to those persons doing business as Missouri firms, corporations, or individuals, or which maintain Missouri offices or places of business, when the quality of performance promised is equal or better and the price quoted is the same or less. In addition, in order for a non-domiciliary bidder to be successful, his bid must be that same percentage lower than a domiciliary Missouri bidder's bid, as would be required for a Missouri bidder to successfully bid in the non-domiciliary state.
- C. In accordance with the Missouri Domestic Products Procurement Act Section 34.350 RSMo and Cumulative Supplements any manufactured goods or commodities used or supplied in the performance of this contract or any subcontract thereto shall be manufactured, assembled or produced in the United States, unless the specified products are not manufactured, assembled or produced in the United States in sufficient quantities to meet the agency's requirements or cannot be manufactured, assembled or produced in the United States within the necessary time in sufficient quantities to meet the contract requirements, or if obtaining the specified products manufactured, assembled or produced in the United States would increase the cost of this contract for purchase of the product by more than ten percent.

ARTICLE 1.8 - COMMUNICATIONS

- A. All notices, requests, instructions, approvals, and claims must be in writing and shall be delivered to the Designer and copied to the Construction Representative for the project except as required by Article 1.12 Disputes and Disagreements, or as otherwise specified by the Owner in writing as stated in Section 012600. Any such notice shall be deemed to have been given as of the time of actual receipt.
- B. The Contractor shall attend on-site progress and coordination meetings, as scheduled by the Construction Representative, no less than once a month.

- C. The Contractor shall ensure that major subcontractors and suppliers shall attend monthly progress meetings as necessary to coordinate the work, and as specifically requested by the Construction Representative.

ARTICLE 1.9 - SEPARATE CONTRACTS AND COOPERATION

- A. The Owner reserves the right to let other contracts in connection with this work. The Contractor shall afford other contractors reasonable opportunity for the introduction and storage of their materials and the execution of their work and shall properly connect and coordinate his work with theirs.
- B. The Contractor shall consult the drawings for all other contractors in connection with this work. Any work conflicting with the above shall be brought to the attention of the Owner's Representative before the work is performed. If the Contractor fails to do this, and constructs any work which interferes with the work of another contractor, the Contractor shall remove any part so conflicting and rebuild same, as directed by the Owner's Representative at no additional cost to the Owner.
- C. Each contractor shall be required to coordinate his work with other contractors so as to afford others reasonable opportunity for execution of their work. No contractor shall delay any other contractor by neglecting to perform contract work at the proper time. If any contractor causes delay to another, they shall be liable directly to that contractor for such delay in addition to any liquidated damages which might be due the Owner.
- D. Should the Contractor or project associated subcontractors refuse to cooperate with the instructions and reasonable requests of other Contractors or other subcontractors in the overall coordinating of the work, the Owner may take such appropriate action and issue directions, as required, to avoid unnecessary and unwarranted delays.
- E. Each Contractor shall be responsible for damage done to Owner's or other Contractor's property by him/her or workers in his employ through their fault or negligence.
- F. Should a Contractor sustain any damage through any act or omission of any other Contractor having a contract with the Owner, the Contractor so damaged shall have no claim or cause of action against the Owner for such damage, but shall have a claim or cause of action against the other Contractor to recover any and all damages sustained by reason of the acts or omissions of such Contractor. The phrase "acts or omissions" as used in this section shall be defined to include, but

not be limited to, any unreasonable delay on the part of any such contractors.

ARTICLE 1.10 - ASSIGNMENT OF CONTRACT

- A. No assignment by Contractor of any amount or any part of this contract or of the funds to be received there under will be recognized unless such assignment has had the written approval of the Director and the surety has been given due notice of such assignment and has furnished written consent thereto. In addition to the usual recitals in assignment contracts, the following language must be set forth: "It is agreed that the funds to be paid to the assignee under this assignment are subject to performance by the Contractor of this contract and to claims or liens for services rendered or materials supplied for the performance of the work called for in said contract in favor of all persons, firms or corporations rendering such services or supplying such materials."

ARTICLE 1.11 - INDEMNIFICATION

- A. Contractor agrees to indemnify and save harmless Owner and its respective commissioners, officers, officials, agents, consultants and employees and Designer, their agents, servants and employees, from and against any and all liability for damage arising from injuries to persons or damage to property occasioned by any acts or omissions of Contractor, any subcontractors, agents, servants or employees, including any and all expense, legal or otherwise, which may be incurred by Owner or Designer, its agents, servants or employees, in defense of any claim, action or suit.
- B. The obligations of the Contractor under this paragraph shall not extend to the liability of the Designer, his agents or employees, arising out of (1) the preparation or approval of maps, drawings, opinions, reports, surveys, contract changes, design or specifications, or (2) giving of or the failure to give directions or instructions by the Designer, his agents or employees as required by this contract documents provided such giving or failure to give is the primary cause of the injury or damage.

ARTICLE 1.12 - DISPUTES AND DISAGREEMENTS

It is hereby expressly agreed and understood that in case any controversy or difference of opinion arises during construction, best efforts will be given to resolution at the field level. Should those efforts be unsuccessful, the Contractor has the right to appeal in writing, the decision of the Director's Designee to the Director at Room 730 Truman Building, P.O. Box 809, Jefferson City, Missouri 65102. The decision of the Director shall be final and binding on all parties.

ARTICLE 2 -- OWNER/DESIGNER RESPONSIBILITIES

- A. The Owner shall give all orders and directions contemplated under this contract relative to the execution of the work. During progress of work the Owner will be represented at the project site by the Construction Representative and/or Designer, whose responsibilities are to see that this contract is properly fulfilled.
- B. The Owner shall at all times have access to the work whenever it is in preparation or progress. The Contractors shall provide proper facilities for such access and for inspection and supervision.
- C. All materials and workmanship used in the work shall be subject to the inspection of the Designer and Construction Representative, and any work which is deemed defective shall be removed, rebuilt or made good immediately upon notice. The cost of such correction shall be borne by the Contractor. Contractor shall not be entitled to an extension of the contract completion date in order to remedy defective work. All rejected materials shall be immediately removed from the site of the work.
- D. If the Contractor fails to proceed at once with the correction of rejected defective materials or workmanship, the Owner may, by separate contract or otherwise, have the defects remedied or rejected. Materials removed from the site and charge the cost of the same against any monies which may be due the Contractor, without prejudice to any other rights or remedies of the Owner.
- E. Failure or neglect on the part of Owner to observe faulty work, or work done which is not in accordance with the drawings and specifications shall not relieve the Contractor from responsibility for correcting such work without additional compensation.
- F. The Owner shall have the right to direct the Contractor to uncover any completed work.
 - 1. If the Contractor fails to adequately notify the Construction Representative and/or Designer of an inspection as required by the Contract Documents, the Contractor shall, upon written request, uncover the work. The Contractor shall bear all costs associated with uncovering and again covering the work exposed.
 - 2. If the Contractor is directed to uncover work, which was not otherwise required by the Contract Documents to be inspected, and the work is found to be defective in any respect, no compensation shall be allowed for this work. If, however, such work is found to meet

the requirements of this contract, the actual cost of labor and material necessarily involved in the examination and replacement plus 10% shall be allowed the Contractor.

- G. The Designer shall give all orders and directions contemplated under this contract relative to the scope of the work and shall give the initial interpretation of the contract documents.
- H. The Owner may file a written notice to the Contractor to dismiss immediately any subcontractors, project managers, superintendents, foremen, workers, watchmen or other employees whom the Owner may deem incompetent, careless or a hindrance to proper or timely execution of the work. The Contractor shall comply with such notice as promptly as practicable without detriment to the work or its progress.
- I. If in the Owner's judgment it becomes necessary at any time to accelerate work, when ordered by the Owner in writing, the Contractor shall redirect resources to such work items and execute such portions of the work as may be required to complete the work within the current approved contract schedule.

ARTICLE 3 -- CONTRACTOR RESPONSIBILITIES

The Contractor shall register and utilize the Owner's eBuilder digital project management system for submission of documents described in the following sections. This includes but is not limited to submittals as required by designer, payment applications, Request for Information (RFI), construction change orders, Request for Proposals (RFP), Designer Supplemental Instructions (DSI), etc.

ARTICLE 3.1 -- ACCEPTABLE SUBSTITUTIONS

- A. The Contractor may request use of any article, device, product, material, fixture, form or type of construction which in the judgment of the Owner and Designer is equal in all respects to that named. Standard products of manufacturers other than those specified will be accepted when, prior to the ordering or use thereof, it is proven to the satisfaction of the Owner and Designer that they are equal in design, strength, durability, usefulness and convenience for the purpose intended.
- B. Any changes required in the details and dimensions indicated on the drawings for the substitution of products other than those specified shall be properly made at the expense of the Contractor requesting the substitution or change.
- C. The Contractor shall submit a request for such substitutions in writing to the Owner and Designer within twenty (20) working days after the date of

the "Notice to Proceed." Thereafter no consideration will be given to alternate forms of accomplishing the work. This Article does not preclude the Owner from exercising the provisions of Article 4 hereof.

- D. Any request for substitution by the Contractor shall be submitted in accordance with SECTION 002113 - INSTRUCTIONS TO BIDDERS.
- E. When a material has been approved, no change in brand or make will be permitted unless:
 - 1. Written verification is received from the manufacturer stating they cannot make delivery on the date previously agreed, or
 - 2. Material delivered fails to comply with contract requirements.

ARTICLE 3.2 -- SUBMITTALS

- A. The Contractor's submittals must be submitted with such promptness as to allow for review and approval so as not to cause delay in the work. The Contractor shall coordinate preparation and processing of submittals with performance of construction activities.

Coordinate each submittal with fabrication, = purchasing, testing, delivery, other submittals, and related activities that require sequential activity.

Submit four (4) copies to the Designer and additional copies as required for the subcontractors and material suppliers. Also provide copies to meet the requirements for maintenance manuals.

- B. All subcontractors' shop drawings and schedules shall be submitted by the Contractor and shall bear evidence that Contractor has received, reviewed, and approved them. Any shop drawings and schedules submitted without this evidence will be returned to the Contractor for resubmission.
- C. The Contractor shall include with the shop drawing, a letter indicating any and all deviations from the drawings and/or specifications. Failure to notify the Designer of such deviations will be grounds for subsequent rejection of the related work or materials. If, in the opinion of the Designer, the deviations are not acceptable, the Contractor will be required to furnish the item as specified and indicated on the drawings.
- D. The Designer shall check shop drawings and schedules with reasonable promptness and approve them only if they conform to the design concept of the project and comply with the information given in the contract documents. The approval shall not relieve the Contractor from the responsibility to comply with the drawings and specifications, unless the Contractor has called the Designer's attention to the deviation, in writing, at the time of

submission and the Designer has knowingly approved thereof. An approval of any such modification will be given only under the following conditions:

1. It is in the best interest of the Owner
 2. It does not increase the contract sum and/or completion time
 3. It does not deviate from the design intent
 4. It is without prejudice to any and all rights under the surety bond.
- E. No extension of time will be granted because of the Contractor's failure to submit shop drawings and schedules in ample time to allow for review, possible resubmission, and approval. Fabrication of work shall not commence until the Contractor has received approval. The Contractor shall furnish prints of approved shop drawings and schedules to all subcontractors whose work is in any way related to the work under this contract. Only prints bearing this approval will be allowed on the site of construction
- F. The Contractor shall maintain a complete file on-site of approved shop drawings available for use by the Construction Representative.

ARTICLE 3.3 – AS-BUILT DRAWINGS

- A. The Contractor shall update a complete set of the construction drawings, shop drawings and schedules of all work monthly by marking changes, and at the completion of their work (prior to submission of request for final payment) note all changes and turn the set over to the Construction Representative. The updates shall show all addenda, all field changes that were made to adapt to field conditions, changes resulting from contract changes or supplemental instructions, and all locations of structures, buried installations of piping, conduit, and utility services. All buried and concealed items both inside and outside shall be accurately located as to depth and referenced to permanent features such as interior or exterior wall faces and dimensions shall be given in a neat and legible manner in a contrasting colored pencil or ink. If approved by the Designer, an electronic file format may be provided.

ARTICLE 3.4 – GUARANTY AND WARRANTIES

- A. General Guaranty
1. Neither the final certificate of payment nor any provision in the contract documents nor partial use or occupancy of the premises by the Owner shall constitute an acceptance of work not done in accordance with contract requirements.

2. The Contractor or surety shall remedy any defects in the work and pay for any damage to property resulting there from which shall appear within a period of one (1) year from the date of substantial completion unless a longer period is otherwise specified or a differing guaranty period has been established in the substantial completion certificate. The Owner will give notice of observed defects with reasonable promptness.
3. In case of default on the part of the Contractor in fulfilling this part of this contract, the Owner may correct the work or repair the damage and the cost and expense incurred in such event shall be paid by or recoverable from the Contractor or surety.
4. The work will be free from defects not inherent in the quality required or permitted, and that the Work will conform to the requirements of the Contract Documents. Work not conforming to these requirements, including substitutions not properly approved and authorized, may be considered defective. The Contractor's guaranty excludes remedy for damage or defect caused by abuse, modifications not executed by the Contractor, improper or insufficient maintenance, improper operation, or normal wear and tear under normal usage. If required by the Owner, the Contractor shall furnish satisfactory evidence as to the kind and quality of materials and equipment

B. Extended Warranty

Manufacturer's certificates of warranty shall be obtained for all major equipment. Warranty shall be obtained for at least one year. Where a longer period is offered at no additional cost or called for in the specific equipment specifications, the longer period shall govern.

ARTICLE 3.5 -- OPERATION AND MAINTENANCE MANUALS

- A. Immediately after equipment submittals are approved and no later than ten (10) working days prior to the substantial completion inspection, the Contractor shall provide to the Designer three (3) copies of operating instructions and service manuals, containing the following:
1. Start-up and Shut-down Procedures: Provide a step-by-step write up of all major equipment. When manufacturer's printed start-up, trouble shooting and shut-down procedures are available; they may be incorporated into the operating manual for reference.

2. Operating Instructions: Written operating instructions shall be included for the efficient and safe operation of all equipment.
 3. Equipment List: List of all major equipment as installed shall be prepared to include model number, capacities, flow rate, name plate data, shop drawings and air and water balance reports.
 4. Service Instructions: Provide the following information for all pieces of equipment.
 - a. Recommended spare parts including catalog number and name of local supplier or factory representative.
 - b. Belt sizes, types, and lengths.
 - c. Wiring diagrams.
 5. Manufacturer's Certificate of Warranty as described in Article 3.4.
 6. Prior to the final payment, furnish to the Designer three (4) copies of parts catalogs for each piece of equipment furnished by him/her on the project with the components identified by number for replacement ordering.
- B. Submission of operating instructions shall be done in the following manner.
1. Manuals shall be in quadruplicate, and all materials shall be bound into volumes of standard 8½" x 11" hard binders. Large drawings too bulky to be folded into 8½" x 11" shall be separately bound or folded and in envelopes, cross referenced and indexed with the manuals.
 2. The manuals shall identify project name, project number, and include the name and address of the Contractor, subcontractors and manufacturers who were involved with the activity described in that particular manual.
 3. Internally subdivide the binder contents with permanent page dividers, logically organized with tab titles clearly printed under reinforced laminated plastic tabs.
 4. Contents: Prepare a Table of Contents for each volume, with each product or system description identified.

ARTICLE 3.6 – OTHER CONTRACTOR RESPONSIBILITIES

- A. The Contractor shall keep on site, during progress of the work, a competent superintendent satisfactory to the Construction Representative. The superintendent shall represent the Contractor and all agreements made by the superintendent shall be binding. The superintendent shall

- carefully study and compare all drawings, specifications and other instructions and shall promptly notify the Construction Representative and Designer, in writing, any error, inconsistency or omission which may be discovered. The superintendent shall coordinate all work on the project. Any change of the superintendent shall be approved by the Construction Representative.
- B. Contractor shall, at all times, enforce strict discipline and good order among his employees, and shall not employ on the work any unfit person or anyone not skilled in the work assigned to him/her.
 - C. The Contractor shall supply sufficient labor, material, plant and equipment and pay when due any laborer, subcontractor or supplier for supplies furnished and otherwise prosecute the work with diligence to prevent work stoppage and ensure completion thereof within the time specified.
 - D. The Contractor and each of his subcontractors shall submit to the Construction Representative, through the Designer such schedules of quantities and costs, progress schedules, payrolls, reports, estimates, records and other data as the Owner may request concerning work performed or to be performed under this contract.
 - E. The Contractor, subcontractors, and material suppliers shall upon written request, give the Owner access to all time cards, material invoices, payrolls, estimates, profit and loss statements, and all other direct or indirect costs related to this work.
 - F. The Contractor shall be responsible for laying out all contract work such as layout of architectural, structural, mechanical and electrical work, which shall be coordinated with layouts of subcontractors for general construction work. The Contractor is also responsible for unloading, uncrating and handling of all materials and equipment to be erected or placed by him/her, whether furnished by Contractor or others. No extra charges or compensation will be allowed as a result of failure to verify dimensions before ordering materials or fabricating items.
 - G. The Contractor must notify the Construction Representative at least one working day before placing concrete or burying underground utilities, pipelines, etc.
 - H. Contractors shall prearrange time with the Construction Representative for the interruption of any facility operation. Unless otherwise specified in these documents, all connections, alterations or relocations as well as all other portions of the work will be performed during normal working hours.

- I. The Contractor shall coordinate all work so there will not be prolonged interruptions of existing equipment operation. Any existing plumbing, heating, ventilating, air conditioning or electrical disconnections necessary for the project, which affect portions of this construction or building or any other building must be scheduled with the Construction Representative to minimize or avoid any disruption of facility operations. In no case, unless previously approved in writing by the Construction Representative, shall utilities be left disconnected at the end of a work day or over a weekend. Any interruption of utilities either intentionally or accidentally shall not relieve the Contractor responsible for the interruption from the responsibility to repair and restore the utility to normal service. Repairs and restoration shall be made before the workers responsible for the repair and restoration leave the job.
- J. Contractors shall limit operations and storage of materials to the area within the project, except as necessary to connect to existing utilities, and shall not encroach on neighboring property. The Contractor shall be responsible for repair of their damage to property on or off the project site occurring during construction of project. All such repairs shall be made to the satisfaction of the property owner.
- K. Unless otherwise permitted, all materials shall be new and both workmanship and materials shall be of the best quality.
- L. Unless otherwise provided and stipulated within these specifications, the Contractor shall furnish, construct, and/or install and pay for materials, devices, mechanisms, equipment, all necessary personnel, utilities including, but not limited to water, heat, light and electric power, transportation services, applicable taxes of every nature, and all other facilities necessary for the proper execution and completion of the work.
- M. Contractor shall carefully examine the plans and drawings and shall be responsible for the proper fitting of his material, equipment and apparatus into the building.
- N. The Contractor or subcontractors shall not overload, or permit others to overload, any part of any structure during the performance of this contract.
- O. All temporary shoring, bracing, etc., required for the removal of existing work and/or for the installation of new work shall be included in this contract. The Contractor shall make good, at no cost to the Owner, any damage caused by improper support or failure of shoring in any respect. Each Contractor shall be responsible for shoring required to protect his work or adjacent property and improvements of Owner and shall be responsible for shoring or for giving written notice to adjacent property owners. Shoring shall be removed only after completion of permanent supports.
- P. The Contractor shall provide at the proper time such material as is required for support of the work. If openings are required, whether shown on drawings or not, the Contractor shall see that they are properly constructed.
- Q. During the performance of work the Contractor shall be responsible for providing and maintaining warning signs, lights, signal devices, barricades, guard rails, fences and other devices appropriately located on site which will give proper and understandable warning to all persons of danger of entry onto land, structure or equipment.
- R. The Contractor shall be responsible for protection, including weather protection, and proper maintenance of all equipment and materials.
- S. The Contractor shall be responsible for care of the finished work and shall protect same from damage or defacement until substantial completion by the Owner. If the work is damaged by any cause, the Contractor shall immediately begin to make repairs in accordance with the drawings and specifications. Contractor shall be liable for all damage or loss unless attributable to the acts or omissions of the Owner or Designer. Any claim for reimbursement shall be submitted in accordance with Article 4. After substantial completion the Contractor will only be responsible for damage resulting from acts or omissions of the Contractor or subcontractors through final warranty.
- T. In the event the Contractor encounters an unforeseen hazardous material, the Contractor shall immediately stop work in the area affected and report the condition to the Owner and Designer in writing. The Contractor shall not be required, pursuant to Article 4, to perform, any work relating to hazardous materials.
- U. In an emergency affecting safety of persons or property, the Contractor shall act, at the Contractor's discretion, to prevent threatened damage, injury or loss. Additional compensation or extension of time claimed by the Contractor on account of an emergency shall be determined as provided in Article 4.
- V. Before commencing work, Contractors shall confer with the Construction Representative and facility representative and review any facility rules and regulations which may affect the conduct of the work.

- W. Project signs will only be erected on major projects and only as described in the specifications. If no sign is specified, none shall be erected.

ARTICLE 3.7 -- SUBCONTRACTS

- A. Subcontractor assignments as identified in the bid form shall not be changed without written approval of the Owner. The Owner will not approve changes of a listed subcontractor unless the Contractor documents, to the satisfaction of the Owner that the subcontractor cannot or will not perform the work as specified.
- B. The Contractor is fully responsible to the Owner for the acts and omissions of all subcontractors and of persons either directly or indirectly employed by them.
- C. Every subcontractor shall be bound by the applicable terms and provisions of these contract documents, but no contractual relationship shall exist between any subcontractor and the Owner unless the right of the Contractor to proceed with the work is suspended or this contract is terminated as herein provided, and the Owner in writing elects to assume the subcontract.
- D. The Contractor shall upon receipt of "Notice to Proceed" and prior to submission of the first payment request, notify the Designer and Construction Representative in writing of the names of any subcontractors to be used in addition to those identified in the bid form and all major material suppliers proposed for all parts of the work.

ARTICLE 4 -- CHANGES IN THE WORK

4.1 CHANGES IN THE WORK

- A. The Construction Representative, without giving notice to the surety and without invalidating this contract, may order extra work or make changes by altering, adding to or deducting from the work, this contract sum being adjusted accordingly. All such work shall be executed under the conditions of the original contract. A claim for extension of time caused by any change must be adjusted at the time of ordering such change. No future request for time will be considered.
- B. Each Contract Change shall include all costs required to perform the work including all labor, material, equipment, overheads and profit, delay, disruptions, or other miscellaneous expenses. No subsequent requests for additional compensation including claims for delay, disruption, or reduced efficiency as a result of each change will be considered. Values from the Schedule of Values will not be binding as a basis for additions to or deductions from the contract price.

- C. The amount of any adjustment in this contract price for authorized changes shall be agreed upon before such changes become effective and shall be determined, through submission of a request for proposal, as follows:

1. By an acceptable fixed price proposal from the Contractor. Breakdowns shall include all takeoff sheets of each Contractor and subcontractor. Breakdown shall include a listing of each item of material with unit prices and number of hours of labor for each task. Labor costs per hour shall be included with labor burden identified, which shall be not less than the prevailing wage rate, etc. Overhead and profit shall be shown separately for each subcontractor and the Contractor.
2. By a cost-plus-fixed-fee (time and material) basis with maximum price, total cost not to exceed said maximum. Breakdown shall include a listing of each item of material with unit prices and number of hours of labor for each task. Labor costs per hour shall be included with labor burden identified, which shall be not less than the prevailing wage rate, etc. Overhead and profit shall be shown separately for each subcontractor and the Contractor.
3. By unit prices contained in Contractor's original bid form and incorporated in the construction contract.

- D. Overhead and Profit on Contract Changes shall be applied as follows:

1. The overhead and profit charge by the Contractor and all subcontractors shall be considered to include, but is not limited to: incidental job burdens, small truck (under 1 ton) expense, mileage, small hand tools, warranty costs, company benefits and general office overhead. Project supervision including field supervision and job site office expense shall be considered a part of overhead and profit unless a compensable time extension is granted.
2. The percentages for overhead and profit charged on Contract Changes shall be subject to the following limits: (a) the percentage mark-up for the Contractor shall be limited to the Contractor's fee; (b) fifteen percent (15%) maximum for Work directly performed by employees of a subcontractor, or sub-subcontractor; (c) five percent (5%) maximum for the Work performed or passed through to the Owner by the Contractor; (d) five percent (5%) maximum subcontractor's mark-up for

Work performed by a sub-subcontractor and passed through to the Owner by the subcontractor and Contractor; and (e) in no case shall the total overhead and profit paid by the Owner on any Contract Changes exceed twenty-five percent (25%) of the cost of materials, labor and equipment (exclusive of Contractor or any Subcontractor overhead and profit) necessary to put the contract change work in place.

3. The Contractor will be allowed to add the cost of Contractor's payment and performance bonding, builder's risk insurance, and general liability insurance to their cost of work. The above listed bonding and insurance cost shall not exceed two percent (2%) and shall be allowed on the total cost of the added work, including overhead and profit.
 4. On proposals covering both increases and decreases in the amount of this contract, the application of overhead and profit shall be on the net change in the cost of the work.
 5. The percentage(s) for overhead and profit to be credited to the Owner on Contract Changes that are solely decreases in the quantity of work or materials shall be the same as those for additive Contract Changes provided above.
- E. No claim for an addition to this contract sum shall be valid unless authorized as aforesaid in writing by the Owner. In the event that none of the foregoing methods are agreed upon, the Owner may order the Contractor to perform work on a time and material basis. The cost of such work shall be determined by the Contractor's actual labor and material cost to perform the work plus overhead and profit as outlined herein. The Designer and Construction Representative shall approve the Contractor's daily time and material invoices for the work involved.
- F. If the Contractor claims that any instructions involve extra cost under this contract, the Contractor shall give the Owner's Representative written notice thereof within a reasonable time after the receipt of such instructions, and in any event before proceeding to execute the work. No such claim shall be valid unless so made and authorized by the Owner, in writing.
- G. In an emergency affecting the safety of life or of the structure or of adjoining property, the Contractor, without special instruction or authorization from the Construction Representative, is hereby permitted to act at their discretion to prevent such threatened loss or injury. The Contractor shall submit a claim for compensation for such emergency work in writing to the Owner's Representative.

ARTICLE 4.2 – CHANGES IN COMPLETION TIME

- A. Extension of the number of work days stipulated in the Contract for completion of the work with compensation may be made when:
1. The contractor documents that proposed Changes in the work, as provided in Article 4.1, extends construction activities critical to contract completion date, OR
 2. The Owner suspends all work for convenience of the Owner as provided in Article 7.3, OR
 3. An Owner caused delay extends construction activities critical to contract completion (except as provided elsewhere in these General Conditions). The Contractor is to review the work activities yet to begin and evaluate the possibility of rescheduling the work to minimize the overall project delay.
- B. Extension of the number of work days stipulated in the Contract for completion of the work without compensation may be made when:
1. Weather-related delays occur, subject to provisions for the inclusion of a specified number of "bad weather" days when provided for in Section 012100-Allowances, OR
 2. Labor strikes or acts of God occur, OR
 3. The work of the Contractor is delayed on account of conditions which were beyond the control of the Contractor, subcontractors or suppliers, and were not the result of their fault or negligence.
- C. No time extension or compensation will be provided for delays caused by or within the control of the Contractor, subcontractors or suppliers and for concurrent delays caused by the Owner.
- D. The Contractor shall notify the Owner promptly of any occurrence or conditions which in the Contractor's opinion results in a need for an extension of time. The notice shall be in writing and shall include all necessary supporting materials with details of any resultant costs and be submitted in time to permit full investigation and evaluation of the Contractor's claim. The Owner shall promptly acknowledge the Contractor's notice and, after recommendation from the Owner's Representative and/or Designer, shall provide a decision to the Contractor. Failure on the part of the Contractor to provide such notice and to detail the costs shall constitute a waiver by the Contractor of any claim. Requests for extensions of time shall be for working days only.

ARTICLE 5 - CONSTRUCTION AND COMPLETION

ARTICLE 5.1 – CONSTRUCTION COMMENCEMENT

A. Upon receipt of the "Intent to Award" letter, the Contractor must submit the following properly executed instruments to the Owner:

1. Contract;
2. Performance/payment bond as described in Article 6.1;
3. Certificates of Insurance, or the actual policies themselves, showing that the Contractor has obtained the insurance coverage required by Article 6.2.

Above referenced items must be received by the Owner within ten (10) working days after the effective date of the contract. If not received, the Owner may treat the failure to timely submit them as a refusal by the Contractor to accept a contract for this work and may retain as liquidated damages the Contractor's bid bond, cashier's check or certified check as provided in the Instructions to Bidders. Upon receipt the Owner will issue a "Notice to Proceed" with the work to the Contractor.

B. Within the time frame noted in Section 013200 - Schedules, following receipt of the "Notice to Proceed", the Contractor shall submit to the Owner a progress schedule and schedule of values, showing activities through the end of the contract period. Should the Contractor not receive written notification from the Owner of the disapproval of the schedule of values within fifteen (15) working days, the Contractor may consider it approved for purpose of determining when the first monthly Application and Certification for Payment may be submitted.

C. The Contractor may commence work upon receipt of the Division of Facilities Management, Design and Construction's "Notice to Proceed" letter. Contractor shall prosecute the work with faithfulness and energy, and shall complete the entire work on or before the completion time stated in the contract documents or pay to the Owner the damages resulting from the failure to timely complete the work as set out within Article 5.4.

ARTICLE 5.2 -- PROJECT CONSTRUCTION

A. Each Contractor shall submit for the Owner's approval, in reproducible form, a progress schedule showing the rate of progress and the order of the work proposed to carry on various phases of the project. The schedule shall be in conformance

with the requirements outlined in Section 013200 – Schedules.

B. Contractor shall employ and supply a sufficient force of workers, material, and equipment and shall pay when due, any worker, subcontractor or supplier and otherwise prosecute the work with such diligence so as to maintain the rate of progress indicated on the progress schedule, prevent work stoppage, and insure completion of the project within the time specified.

ARTICLE 5.3 -- PROJECT COMPLETION

A. Substantial Completion. A Project is substantially complete when construction is essentially complete and work items remaining to be completed can be done without interfering with the Owner's ability to use the Project for its intended purpose.

1. Once the Contractor has reached what they believe is Substantial Completion, the Contractor shall notify the Designer and the Construction Representative of the following:
 - a. That work is essentially complete with the exception of certain listed work items. The list shall be referred to as the "Contractor's Punch."
 - b. That all Operation and Maintenance Manuals have been assembled and submitted in accordance with Article 3.5A.
 - c. That the Work is ready for inspection by the Designer and Construction Representative. The Owner shall be entitled to a minimum of ten working days notice before the inspection shall be performed.

2. If the work is acceptable, the Owner shall issue a Certificate of Substantial Completion, which shall set forth the responsibilities of the Owner and the Contractor for utilities, security, maintenance, damage to the work and risk of loss. The Certificate shall also identify those remaining items of work to be performed by the Contractor. All such work items shall be complete within 30 working days of the date of the Certificate, unless the Certificate specifies a different time. If the Contractor shall be required to perform tests that must be delayed due to climatic conditions, it is understood that such tests and affected equipment will be identified on the Certificate and shall be accomplished by the Contractor at the earliest possible date. Performance of the tests may not be required before Substantial Completion can be issued. The date of the issuance of the Certificate of

Substantial Completion shall determine whether or not the work was completed within the contract time and whether or not Liquidated Damages are due.

3. If the work is not acceptable, and the Owner does not issue a Certificate of Substantial Completion, the Owner shall be entitled to charge the Contractor with the Designer's and Owner's costs of re-inspection, including time and travel.
- B. Partial Occupancy. Contractor agrees that the Owner shall be permitted to occupy and use any completed or partially completed portions of the Project, when such occupancy and use is in the Owner's best interest. Owner shall notify Contractor of its desire and intention to take Partial Occupancy as soon as possible but at least ten (10) working days before the Owner intends to occupy. If the Contractor believes that the portion of the work the Owner intends to occupy is not ready for occupancy, the Contractor shall notify the Owner immediately. The Designer shall inspect the work in accordance with the procedures above. If the Contractor claims increased cost of the project or delay in completion as a result of the occupancy, he shall notify the Owner immediately but in all cases before occupancy occurs.
- C. Final Completion. The Project is finally complete when the Certificate of Substantial Completion has been issued and all work items identified therein as incomplete have been completed, and when all administrative items required by the contract have been completed. Final Completion entitles the Contractor to payment of the outstanding balance of the contract amount including all change orders and retainage. Within five (5) working days of the date of the Certificate of Substantial Completion, the Contractor shall identify the cost to complete any outstanding items of work. The Designer shall review the Contractor's estimate and either approve it or provide an independent estimate for all such items. If the Contractor fails to complete the remaining items within the time specified in the Certificate, the Owner may terminate the contract and go to the surety for project completion in accordance with Article 7.2 or release the contract balance to the Contractor less 150% of the approved estimate to complete the outstanding items. Upon completion of the outstanding items, when a final cost has been established, any monies remaining shall be paid to the Contractor. Failure to complete items of work does not relieve the Contractor from the obligation to complete the administrative requirements of the contract, such as the provisions of Article 5.3 FAILURE TO COMPLETE ALL ITEMS OF WORK UNDER THE CONTRACT SHALL BE CONSIDERED A

DEFAULT AND BE GROUNDS FOR CONTRACT TERMINATION AND DEBARMENT.

- D. Liquidated Damages. Contractor agrees that the Owner may deduct from the contract price and retain as liquidated damages, and not as penalty or forfeiture, the sum stipulated in this contract for each work day after the Contract Completion Day on which work is not Substantially Complete. Assessment of Liquidated Damages shall not relieve the Contractor or the surety of any responsibility or obligation under the Contract. In addition, the Owner may, without prejudice to any other rights, claims, or remedies the Owner may have including the right to Liquidated Damages, charge the Contractor for all additional expenses incurred by the Owner and/or Designer as the result of the extended contract period through Final Completion. Additional Expenses shall include but not be limited to the costs of additional inspections.
- E. Early Completion. The Contractor has the right to finish the work before the contract completion date; however, the Owner assumes no liability for any hindrances to the Contractor unless Owner caused delays result in a time extension to the contract completion date. The Contractor shall not be entitled to any claims for lost efficiencies or for delay if a Certificate of Substantial Completion is given on or before the Contract Completion Date.

ARTICLE 5.4 -- PAYMENT TO CONTRACTOR

- A. Payments on account of this contract will be made monthly in proportion to the work which has been completed. Request for payment must be submitted on the Owner's forms. No other pay request will be processed. Supporting breakdowns must be in the same format as Owner's forms and must provide the same level of detail. The Designer will, within 5 working days from receipt of the contractor's request for payment either issue a Certificate for Payment to the Owner, for such amount as the Designer determines is properly due, or notify the Contractor in writing of reasons for withholding a Certificate. The Owner shall make payment within 30 calendar days after the "Application and Certification for Payment" has been received and certified by the Designer. The following items are to be attached to the contractor's pay request:
 1. Updated construction schedule
 2. Certified payrolls consisting of name, occupation and craft, number of hours worked and actual wages paid for each individual employee, of the Contractor and all subcontractors working on the project

- B. The Owner shall retain 5 percent of the amount of each such payment application, except as allowed by Article 5.4, until final completion and acceptance of all work covered by this contract.
- C. Each payment made to Contractor shall be on account of the total amount payable to Contractor and all material and work covered by paid partial payment shall thereupon become the sole property of Owner. This provision shall not be construed as relieving Contractor from sole responsibility for care and protection of materials and work upon which payments have been made or restoration of any damaged work or as a waiver of the right of Owner to require fulfillment of all terms of this contract.
- D. Materials delivered to the work site and not incorporated in the work will be allowed in the Application and Certification for Payment on the basis of one hundred (100%) percent of value, subject to the 5% retainage providing that they are suitably stored on the site or in an approved warehouse in accordance with the following requirements:
1. Material has previously been approved through submittal and acceptance of shop drawings conforming to requirements of Article 3.2 of General Conditions.
 2. Delivery is made in accordance with the time frame on the approved schedule.
 3. Materials, equipment, etc., are properly stored and protected from damage and deterioration and remain so - if not, previously approved amounts will be deleted from subsequent pay applications.
 4. The payment request is accompanied by a breakdown identifying the material equipment, etc. in sufficient detail to establish quantity and value.
- E. The Contractor shall be allowed to include in the Application and Certification for Payment, one hundred (100%) of the value, subject to retainage, of major equipment and material stored off the site if all of the following conditions are met:
1. The request for consideration of payment for materials stored off site is made at least 15 working days prior to submittal of the Application for Payment including such material. Only materials inspected will be considered for inclusion on Application for Payment requests.
 2. Materials stored in one location off site are valued in excess of \$25,000.
 3. That a Certificate of Insurance is provided indicating adequate protection from loss, theft conversion or damage for materials stored off site. This Certificate shall show the State of Missouri as an additional insured for this loss.
4. The materials are stored in a facility approved and inspected, by the Construction Representative.
 5. Contractor shall be responsible for, Owner costs to inspect out of state facilities, and any delays in the completion of the work caused by damage to the material or for any other failure of the Contractor to have access to this material for the execution of the work.
- F. The Owner shall determine the amount, quality and acceptability of the work and materials which are to be paid for under this contract. In the event any questions shall arise between the parties, relative to this contract or specifications, determination or decision of the Owner or the Construction Representative and the Designer shall be a condition precedent to the right of the Contractor to receive any money or payment for work under this contract affected in any manner or to any extent by such question.
- G. Payments Withheld: The Owner may withhold or nullify in whole or part any certificate to such extent as may be necessary to protect the Owner from loss on account of:
1. Defective work not remedied. When a notice of noncompliance is issued on an item or items, corrective action shall be undertaken immediately. Until corrective action is completed, no monies will be paid and no additional time will be allowed for the item or items. The cost of corrective action(s) shall be borne by the Contractor.
 2. A reasonable doubt that this contract can be completed for the unpaid balance.
 3. Failure of the Contractor to update as-built drawings monthly for review by the Construction Representative.
 4. Failure of the Contractor to update the construction schedule.
- When the Construction Representative is satisfied the Contractor has remedied above deficiencies, payment shall be released.
- H. Final Payment: Upon receipt of written notice from the Contractor to the Designer and Project Representative that the work is ready for final inspection and acceptance, the Designer and Project Representative, with the Contractor, shall promptly make such inspection. If the work is acceptable and the contract fully performed, the Construction Representative shall complete a final acceptance report and the Contractor will be

directed to submit a final Application and Certification for Payment. If the Owner approves the same, the entire balance shall be due and payable, with the exception of deductions as provided for under Article 5.4.

1. Where the specifications provide for the performance by the Contractor of (certain tests for the purpose of balancing and checking the air conditioning and heating equipment and the Contractor shall have furnished and installed all such equipment in accordance with the specifications, but said test cannot then be made because of climatic conditions, such test shall may be considered as required under the provisions of the specifications, Section 013300 and this contract may be substantial Full payment will not be made until the tests have been made and the equipment and system is finally accepted. If the tests are not completed when scheduled, the Owner may deduct 150% of the value of the tests from the final payment.
2. The final payment shall not become due until the Contractor delivers to the Construction Representative:
 - a) A complete file of releases, on the standard form included in the contract documents as "Final Receipt of Payment and Release Form", from subcontractors and material suppliers evidencing payment in full for services, equipment and materials, as the case may require, if the Owner approves, or a consent from the Surety to final payment accepting liability for any unpaid amounts.
 - b) An Affidavit of Compliance with Prevailing Wage Law, in the form as included in this contract specifications, properly executed by each subcontractor, and the Contractor
 - c) Certified copies of all payrolls
 - d) As-built drawings
3. If any claim remains unsatisfied after all payments are made, the Contractor shall refund to the Owner all monies that the latter may be compelled to pay in discharging such a claim including all costs and a reasonable attorney's fee.
4. Missouri statute requires prompt payment from the Owner to the Contractor within thirty calendar days and from the Contractor to his subcontractors within fifteen calendar days. Failure to make payments within the required

time frame entitles the receiving party to charge interest at the rate of one and one half percent per month calculated from the expiration of the statutory time period until paid.

5. The value of all unused unit price allowances and/or 150% of the value of the outstanding work items, and/or liquidated damages may be deducted from the final pay request without executing a Contract Change. Any unit price items which exceed the number of units in the contract may be added by Contract Change.

ARTICLE 6 -- INSURANCE AND BONDS

ARTICLE 6.1 -- BOND

- A. Contractor shall furnish a performance/payment bond in an amount equal to 100% of the contract price to guarantee faithful performance of the contract and 100% of the contract price to guarantee the payment of all persons performing labor on the project and furnishing materials in connection therewith under this contract as set forth in the standard form of performance and payment bond included in the contract documents. The surety on such bond shall be issued by a surety company authorized by the Missouri Department of Insurance to do business in the state of Missouri.
- B. All Performance/Payment Bonds furnished in response to this provision shall be provided by a bonding company with a rating of B+ or higher as established by A.M. Best Company, Inc. in their most recent publication.

ARTICLE 6.2 – INSURANCE

- A. The successful Contractor shall procure and maintain for the duration of the contract issued a policy or policies of insurance for the protection of both the Contractor and the Owner and their respective officers, officials, agents, consultants and employees. The Owner requires certification of insurance coverage from the Contractor prior to commencing work.
- B. Minimum Scope and Extent of Coverage
 - 1. General Liability
Commercial General Liability, ISO coverage form number or equivalent CG 00 01 ("occurrence" basis), or I-SO coverage form number CG 00 02, or ISO equivalent.

If ISO equivalent or manuscript general liability coverage forms are used, minimum coverage will be as follows: Premises/Operations; Independent Contractors; Products/Completed Operations; personal Injury; Broad Form Property Damage including Completed Operations; Broad Form Contractual Liability Coverage to include Contractor's obligations under Article 1.11 Indemnification and any other Special Hazards required by the work of the contract.
 - 2. Automobile Liability
Business Automobile Liability Insurance, ISO Coverage form number or equivalent CA 00 01 covering automobile liability, code 1 "ANY AUTO".
 - 3. Workers' Compensation and Employer's Liability
Statutory Workers' Compensation Insurance for Missouri and standard Employer's Liability Insurance, or the authorization to self-insure for such liability from the Missouri Division of Workers' Compensation.
 - 4. Builder's Risk or Installation Floater Insurance
Insurance upon the work and all materials, equipment, supplies, temporary structures and similar items which may be incident to the performance of the work and located at or adjacent to the site, against loss or damage from fire and such other casualties as are included in extended coverage in broad "All Risk" form, including coverage for Flood and Earthquake, in an amount not less than the replacement cost of the work or this contract price, whichever is greater, with loss payable to Contractor and Owner as their respective interests may appear.

Contractor shall maintain sufficient insurance to cover the full value of the work and materials as the work progresses, and shall furnish Owner copies of all endorsements. If Builder's Risk Reporting- Form of Endorsement is used, Contractor shall make all reports as required therein so as to keep in force an amount of insurance which will equal the replacement cost of the work, materials, equipment, supplies, temporary structures, and other property covered thereby; and if, as a result of Contractor's failure to make any such report, the amount of insurance so recoverable shall be less than such replacement cost, Contractor's interest in the proceeds of such insurance, if any, shall be subordinated to Owner's interest to the end that Owner may receive full reimbursement for its loss.

- C. Minimum Limits of Insurance
 - 1. General Liability
Contractor
\$2,000,000 combined single limit per occurrence for bodily injury, personal injury, and property damage
\$2,000,000 annual aggregate
 - 2. Automobile Liability
\$2,000,000 combined single limit per occurrence for bodily injury and property damage
 - 3. Workers' Compensation and Employers Liability
Workers' Compensation limits as required by applicable State Statutes (generally unlimited) and minimum of \$1,000,000 limit per accident for Employer's Liability.

General Liability and Automobile Liability insurance may be arranged under individual policies for the full limits required or by a combination of underlying policies with the balance provided by a form-following Excess or Umbrella Liability policy.
- D. Deductibles and Self-Insured Retentions
All deductibles, co-payment clauses, and self-insured retentions must be declared to and approved by the Owner. The Owner reserves the right to request the reduction or elimination of unacceptable deductibles or self-insured retentions, as they would apply to the Owner, and their respective officers, officials, agents, consultants and employees. Alternatively, the Owner may request Contractor to procure a bond guaranteeing

payment of losses and related investigations, claims administration, and defense expenses.

E. Other Insurance Provisions and Requirements

The respective insurance policies and coverage, as specified below, must contain, or be endorsed to contain the following conditions or provisions:

1. General Liability

The Owner, and its respective commissioners, officers, officials, agents, consultants and employees shall be endorsed as additional insured's by ISO form CG 20 26 Additional Insured - Designated Person or Organization. As additional insured's, they shall be covered as to work performed by or on behalf of the Contractor or as to liability which arises out of Contractor's activities or resulting from the performance of services or the delivery of goods called for by the Contract.

Contractor's insurance coverage shall be primary with respect to all additional insured's. Insurance of self-insurance programs maintained by the designated additional -insured's shall be excess of the Contractor's insurance and shall not contribute with it.

Additionally, the Contractor and Contractor's general liability insurer shall agree to waive all rights of subrogation against the Owner and any of their respective officers, officials, agents, consultants or employees for claims, losses, or expenses which arise out of Contractor's activities or result from the performance of services or the delivery of goods called for by the Contract.

Contractor's failure to comply with the terms and conditions of these insurance policies shall not affect or abridge coverage for the Owner, or for any of their officers, officials, agents, consultants or employees.

2. Automobile Insurance

The Owner, and their respective officers, officials, agents, consultants and employees shall be endorsed as additional insured's by ISO form CG 20 26 - Additional Insured Designated Person or Organization. As additional insured's, they shall be covered as to work performed by or on behalf of the Contractor or as to liability which arises out of Contractor's activities or resulting from the performance of services or the delivery of goods called for by the Contract.

Contractor's insurance coverage shall be primary with respect to all additional insured's. Insurance or self-insurance

programs maintained by the designated additional insured's shall be in excess of the Contractor's insurance and shall not contribute with it.

Additionally, the Contractor and Contractor's automobile insurer shall agree to waive all rights of subrogation against the Owner and any of their respective officers, officials, agents, consultants or employees for claims, losses, or expenses which arise out of Contractor's activities or result from the performance of services or the delivery of goods called for by the Contract.

Contractor's failure to comply with the terms and conditions of these insurance policies shall not affect or abridge coverage for the Owner or for any of its officers, officials, agents, consultants or employees.

3. Workers' Compensation/Employer's Liability

Contractor's workers' compensation insurance shall be endorsed with NCCI form WC 00 03 01 A - Alternative Employer Endorsement. The Alternative Employer Endorsement shall designate the Owner as "alternate employers."

4. All Coverages

Each insurance policy required by this section of the Contract shall contain a stipulation, endorsed if necessary, that the Owner will receive a minimum of a thirty (30) calendar day advance notice of any policy cancellation. Ten (10) calendar days advance notice is required for policy cancellation due to non-payment of premium.

F. Insurer Qualifications and Acceptability

Insurance required hereunder shall be issued by an A.M. Best, "B+" rated, Class IX insurance company approved to conduct insurance business in the state of Missouri.

G. Verification of Insurance Coverage

Prior to Owner issuing a Notice to Proceed, the Contractor shall furnish the Owner with Certificate(s) of Insurance and with any applicable original endorsements evidencing the required insurance coverage. The insurance certificates and endorsements are to be signed by a person authorized by that insurer to bind coverage on its behalf. All certificates and endorsements received by the Owner are subject to review and approval by the Owner. The Owner reserves the right to require certified copies of all required policies at any time. If the scope of this contract will exceed one (1) year - or, if any of Contractor's applicable insurance coverage expires prior to completion of the work or services required under this contract -

the Contractor will provide a renewal or replacement certificate before continuing work or services hereunder. If the Contractor fails to provide documentation of required insurance coverage, the Owner may issue a stop work order and no additional contract completion time and/or compensation shall be granted as a result thereof.

ARTICLE 7 – SUSPENSION OR TERMINATION OF CONTRACT

ARTICLE 7.1 - FOR SITE CONDITIONS

When conditions at the site of the proposed work are considered by the Owner to be unsatisfactory for prosecution of the work, the Contractor may be ordered in writing to suspend the work or any part thereof until reasonable conditions exist. When such suspension is not due to fault or negligence of the Contractor, time allowed for completion of such suspended work will be extended by a period of time equal to that lost due to delay occasioned by ordered suspension. This will be a no cost time extension.

ARTICLE 7.2 - FOR CAUSE

A. Termination or Suspension for Cause:

1. If the Contractor shall file for bankruptcy, or should make a general assignment for the benefit of the creditors, or if a receiver should be appointed on account of insolvency, or if the contractor should persistently or repeatedly refuse or fail to supply enough properly skilled workers or proper materials, or if the contractor should fail to make prompt payment to subcontractors or for material or labor, or persistently disregard laws, ordinances or the instructions of the Owner, or otherwise be guilty of a substantial violation of any provision of this contract, then the Owner may serve notice on the Contractor and the surety setting forth the violations and demanding compliance with this contract. Unless within ten (10) consecutive calendar days after serving such notice, such violations shall cease and satisfactory arrangements for correction be made, the Owner may suspend the Contractor's right to proceed with the work or terminate this contract.
2. In the event the Owner suspends Contractor's right to proceed with the work or terminates the contract, the Owner may demand that the Contractor's surety take over and complete the work on this contract, after the surety submits a written proposal to the Owner and receives written approval and upon the surety's failure or refusal to do so within ten (10) consecutive

calendar days after demand therefore, the Owner may take over the work and prosecute the same to completion by bid or negotiated contract, or the Owner may elect to take possession of and utilize in completing the work such materials, supplies, appliances and plant as may be on the site of the work, and all subcontractors, if the Owner elects, shall be bound to perform their contracts.

- B. The Contractor and its surety shall be and remain liable to the Owner for any excess cost or damages occasioned to the Owner as a result of the actions above set forth.
- C. The Contractor in the event of such suspension or termination shall not be entitled to receive any further payments under this contract until the work is wholly finished. Then if the unpaid balance under this contract shall exceed all expenses of the Owner as certified by the Director, such excess shall be paid to the Contractor; but, if such expenses shall exceed the unpaid balance as certified by the Director, the Contractor and their surety shall be liable for and shall pay the difference and any damages to the Owner.
- D. In exercising Owner's right to secure completion of the work under any of the provisions hereof, the Director shall have the right to exercise Owner's sole discretion as to the manner, methods and reasonableness of costs of completing the work.
- E. The rights of the Owner to suspend or terminate as herein provided shall be cumulative and not exclusive and shall be in addition to any other remedy provided by law.
- F. The Contractor in the event of such suspension or termination may be declared ineligible for Owner contracts for a minimal period of twelve (12) months. Further, no contract will be awarded to any Contractor who lists in their bid form any subcontractor whose prior performance has contributed, as determined by the Owner, to a breach of a contract. In order to be considered for state-awarded contracts after this period, the Contractor/subcontractor will be required to forward acceptance reports to the Owner regarding successful completion of non-state projects during the intervening twelve (12) months from the date of default. No contracts will be awarded to a subcontractor/Contractor until the ability to perform responsibly in the private sector has been proven to the Owner.

ARTICLE 7.3 -- FOR CONVENIENCE

- A. The Owner may terminate or suspend the Contract or any portion of the Work without cause at any time, and at the Owner's convenience. Notification of a termination or suspension shall be in writing

and shall be given to the Contractor and their surety. If the Contract is suspended, the notice will contain the anticipated duration of the suspension or the conditions under which work will be permitted to resume. If appropriate, the Contractor will be requested to demobilize and re-mobilize and will be reimbursed time and costs associated with the suspension.

B. Upon receipt of notification, the Contractor shall:

1. Cease operations when directed.
2. Take actions to protect the work and any stored materials.
3. Place no further subcontracts or orders for material, supplies, services or facilities except as may be necessary to complete the portion of the Contract that has not been terminated. No claim for payment of materials or supplies ordered after the termination date shall be considered.
4. Terminate all existing subcontracts, rentals, material, and equipment orders.

5. Settle all outstanding liabilities arising from termination with subcontractors and suppliers.

6. Transfer title and deliver to the Owner, work in progress, completed work, supplies and other material produced or acquire for the work terminated, and completed or partially completed plans, drawings information and other property that, if the Contract had been completed, would be required to be furnished to the Owner.

C. For termination without cause and at the Owner's convenience, in addition to payment for work completed prior to date of termination, the Contractor may be entitled to payment of other documented costs directly associated with the early termination of the contract. Payment for anticipated profit and unapplied overhead will not be allowed.

SECTION 007300 - SUPPLEMENTARY CONDITIONS

1.0 GENERAL:

A. These Supplementary General Conditions clarify, add, delete, or otherwise modify standard terms and conditions of DIVISION 0, BIDDING AND CONTRACTING REQUIREMENTS.

2.0 CONTACTS:

Designer: Eric Roselle
PWArchitects, Inc
2120 Forum Blvd, Ste 101
Columbia, MO 65201
Telephone: 573.449.2683
Email: eroselle@pwarchitects.com

Construction Representative: Dustin Cooper
Division of Facilities Management, Design and Construction
709 Missouri Blvd (Upper Level)
Jefferson City, MO 65109
Telephone: 573.536.1692
Email: dustin.cooper@oa.mo.gov

Project Manager: Jared Cook
Division of Facilities Management, Design and Construction
301 West High Street, Room 730
Jefferson City, Missouri 65101
Telephone: 573.690.6733
Email: jared.cook2@oa.mo.gov

Contract Specialist: April Howser
Division of Facilities Management, Design and Construction
301 West High Street, Room 730
Jefferson City, Missouri 65101
Telephone: 573.751.0053
Email: april.howser@oa.mo.gov

3.0 NOTICE: ALL BID MATERIALS ARE DUE AT THE TIME OF BID SUBMITTAL. THERE IS NO SECOND SUBMITTAL FOR THIS PROJECT.

4.0 FURNISHING CONSTRUCTION DOCUMENTS:

- A. The Owner will furnish the Contractor with approximately 5 complete sets of drawings and specifications at no charge.
- B. The Owner will furnish the Contractor with approximately 5 sets of explanatory or change drawings at no charge.
- C. The Contractor may make copies of the documents as needed with no additional cost to the Owner.
- D.

5.0 SAFETY REQUIREMENTS

Contractor and subcontractors at any tier shall comply with RSMo 292.675 and Article 1.3, E, of Section 007213, General Conditions.

Missouri

Division of Labor Standards

WAGE AND HOUR SECTION



MICHAEL L. PARSON, Governor

Annual Wage Order No. 31

Section 080
PETTIS COUNTY

In accordance with Section 290.262 RSMo 2000, within thirty (30) days after a certified copy of this Annual Wage Order has been filed with the Secretary of State as indicated below, any person who may be affected by this Annual Wage Order may object by filing an objection in triplicate with the Labor and Industrial Relations Commission, P.O. Box 599, Jefferson City, MO 65102-0599. Such objections must set forth in writing the specific grounds of objection. Each objection shall certify that a copy has been furnished to the Division of Labor Standards, P.O. Box 449, Jefferson City, MO 65102-0449 pursuant to 8 CSR 20-5.010(1). A certified copy of the Annual Wage Order has been filed with the Secretary of State of Missouri.

Original Signed by _____

Todd Smith, Director
Division of Labor Standards

Filed With Secretary of State: _____ **March 8, 2024**

Last Date Objections May Be Filed: **April 8, 2024**

Prepared by Missouri Department of Labor and Industrial Relations

OCCUPATIONAL TITLE	**Prevailing Hourly Rate
Asbestos Worker	\$26.51*
Boilermaker	\$26.51*
Bricklayer-Stone Mason	\$55.70
Carpenter	\$54.95
Lather	
Linoleum Layer	
Millwright	
Pile Driver	
Cement Mason	\$26.51*
Plasterer	
Communication Technician	\$26.51*
Electrician (Inside Wireman)	\$71.03
Electrician Outside Lineman	\$26.51*
Lineman Operator	
Lineman - Tree Trimmer	
Groundman	
Groundman - Tree Trimmer	
Elevator Constructor	\$26.51*
Glazier	\$26.51*
Ironworker	\$68.67
Laborer	\$26.51*
General Laborer	
First Semi-Skilled	
Second Semi-Skilled	
Mason	\$26.51*
Marble Mason	
Marble Finisher	
Terrazzo Worker	
Terrazzo Finisher	
Tile Setter	
Tile Finisher	
Operating Engineer	\$26.51*
Group I	
Group II	
Group III	
Group III-A	
Group IV	
Group V	
Painter	\$41.49
Plumber	\$76.75
Pipe Fitter	
Rofer	\$60.63
Sheet Metal Worker	\$75.15
Sprinkler Fitter	\$66.78
Truck Driver	\$26.51*
Truck Control Service Driver	
Group I	
Group II	
Group III	
Group IV	

*The Division of Labor Standards received fewer than 1,000 reportable hours for this occupational title. The public works contracting minimum wage is established for this occupational title using data provided by Missouri Economic Research and Information Center.

**The Prevailing Hourly Rate includes any applicable fringe benefit amounts for each occupational title as defined in RSMo Section 290.210.

Heavy Construction Rates for
PETTIS County

Section 080

OCCUPATIONAL TITLE	**Prevailing Hourly Rate
Carpenter	\$52.84
Millwright	
Pile Driver	
Electrician (Outside Lineman)	\$26.51*
Lineman Operator	
Lineman - Tree Trimmer	
Groundman	
Groundman - Tree Trimmer	
Laborer	\$26.51*
General Laborer	
Skilled Laborer	
Operating Engineer	\$26.51*
Group I	
Group II	
Group III	
Group IV	
Truck Driver	\$26.51*
Truck Control Service Driver	
Group I	
Group II	
Group III	
Group IV	

Use Heavy Construction Rates on Highway and Heavy construction in accordance with the classifications of construction work established in 8 CSR 30-3.040(3).

Use Building Construction Rates on Building construction in accordance with the classifications of construction work established in 8 CSR 30-3.040(2).

If a worker is performing work on a heavy construction project within an occupational title that is not listed on the Heavy Construction Rate Sheet, use the rate for that occupational title as shown on the Building Construction Rate Sheet.

*The Division of Labor Standards received fewer than 1,000 reportable hours for this occupational title. Public works contracting minimum wage is established for this occupational title using data provided by Missouri Economic Research and Information Center.

**The Prevailing Hourly Rate includes any applicable fringe benefit amounts for each occupational title.

OVERTIME and HOLIDAYS

OVERTIME

For all work performed on a Sunday or a holiday, not less than twice (2x) the prevailing hourly rate of wages for work of a similar character in the locality in which the work is performed or the public works contracting minimum wage, whichever is applicable, shall be paid to all workers employed by or on behalf of any public body engaged in the construction of public works, exclusive of maintenance work.

For all overtime work performed, not less than one and one-half (1½) the prevailing hourly rate of wages for work of a similar character in the locality in which the work is performed or the public works contracting minimum wage, whichever is applicable, shall be paid to all workers employed by or on behalf of any public body engaged in the construction of public works, exclusive of maintenance work or contractual obligation. For purposes of this subdivision, "**overtime work**" shall include work that exceeds ten hours in one day and work in excess of forty hours in one calendar week; and

A thirty-minute lunch period on each calendar day shall be allowed for each worker on a public works project, provided that such time shall not be considered as time worked.

HOLIDAYS

January first;
The last Monday in May;
July fourth;
The first Monday in September;
November eleventh;
The fourth Thursday in November; and
December twenty-fifth;

If any holiday falls on a Sunday, the following Monday shall be considered a holiday.

SECTION 011000 – SUMMARY OF WORK

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and Division 1 Specification Sections apply to this Section.

1.2 WORK COVERED BY CONTRACT DOCUMENTS

- A. The Project consists of a new comfort station with shower facilities to be located at the Missouri State Fairgrounds. The comfort station consists of separate men's and women's restrooms, each with 4 stalls and 4 sinks; additionally there are 4 shower rooms, each with a stool and sink.
1. Project Location: Missouri State Fairgrounds, 2503 W. 16th St., Sedalia, Mo.
 2. Owner: State of Missouri, Office of Administration, Division of Facilities Management, Design and Construction, Harry S Truman State Office Building, Post Office Box 809, 301 West High Street, Jefferson City, Missouri 65102.
- B. Contract Documents dated October 18, 2024 were prepared for the Project by PWArchitects, Inc, 2120 Forum Blvd., Ste. 101, Columbia, Mo. 65203.
- C. The Work consists of: A new CMU building with either a composition shingle roof (base bid) or standing seam metal roof (alternate 4). The building will house separate men's and women's restrooms, each with 4 stalls and 4 sinks. Alternate 1 will expand the building to also provide 4 shower rooms, each with a stool and sink. The new building will not be conditioned. Site work will include new sidewalks connecting the building to the existing Swine Pavilion paving and connection to existing utilities.
1. The Work includes:
 - Concrete – Site paving, shallow footing, and slab-on-grade.
 - CMU masonry.
 - Wood roof trusses.
 - Sheathing.
 - Roofing – Composition shingles (base bid);
Standing seam metal roofing (alternate 4).
 - Associated flashing(s).
 - Doors and Door Hardware.
 - Interior Finishes.
 - Toilet partitions/accessories.
 - Plumbing.
 - Ventilation.
 - Electrical.
 - Site restoration.
- D. The Work will be constructed under a single prime contract.

1.3 CONTRACTOR USE OF PREMISES

- A. General: During the construction period the Contractor shall have full use of the premises for construction operations, including use of the site. The Contractor's use of

the premises will be limited only by the Owner's right to perform work or to retain other contractors on portions of the Project.

- B. Use of the Site: Limit use of the premises to work in areas indicated. Confine operations to areas within contract limits indicated. Do not disturb portions of the site beyond the areas in which the Work is indicated.
 - 1. Owner Occupancy: Allow for Owner occupancy and use by the public.
 - 2. Driveways and Entrances: Keep driveways and entrances serving the premises clear and available to the Owner, the Owner's employees, and emergency vehicles at all times. Do not use these areas for parking or storage of materials. Schedule deliveries to minimize space and time requirements for storage of materials and equipment on-site.

1.4 OCCUPANCY REQUIREMENTS

- A. Full Owner Occupancy: Cooperate with the Owner during construction operations to minimize conflicts and facilitate owner usage. Perform the Work so as not to interfere with the Owner's operations.

1.5 OWNER-FURNISHED PRODUCTS

- A. The Owner will furnish toilet accessories as noted on the Project Drawings. The Work includes providing support systems to receive Owner's equipment, and mechanical and electrical connections.
 - 1. The Owner will arrange for and deliver necessary shop drawings, product data, and samples to the Contractor.
 - 2. The Owner will arrange and pay for delivery of Owner-furnished items according to the contractor's Construction Schedule.
 - 3. The Contractor is responsible for receiving, unloading, and handling Owner furnished items at the site.
 - 4. Following delivery, the Contractor will inspect items delivered for damage. The Contractor shall not accept damaged items and shall notify the Owner of rejection of damaged items.
 - 5. If Owner-furnished items are damaged, defective, or missing, the Owner will arrange for replacement.
 - 6. The Owner will arrange for manufacturer's field services and for the delivery of manufacturer's warranties to the appropriate Contractor.
 - 7. The Contractor shall designate delivery dates of Owner-furnished items in the Contractor's Construction Schedule.
 - 8. The Contractor shall review shop drawings, product data and samples and return them to the Designer noting discrepancies or problems anticipated in use of the project.
 - 9. The Contractor is responsible for protecting Owner-furnished items from damage, including damage from exposure to the elements. The Contractor shall repair or replace items damaged as a result of his operations.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION (Not Applicable)

END OF SECTION 011000

SECTION 012200 – UNIT PRICES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and other Division 1 Specification Sections apply to this Section.

1.2 SUMMARY

- A. This Section includes administrative and procedural requirements for Unit Prices.
- B. Related Sections include the following:
 1. Division 1 Section "Allowances" for procedures for using Unit Prices to adjust quantity allowances.
 2. Division 1 Section "Contract Modification Procedures" for procedures for submitting and handling Change Orders.
 3. Division Section **31 2000 EARTH MOVING** for procedures for measurement and payment for Unsuitable Materials or Mass Rock Removal and Replacement.

1.3 DEFINITIONS

- A. Unit Price is a price per unit of measurement for materials or services **ADDED TO** or **DEDUCTED FROM** the Contract Sum by appropriate modification, if estimated quantities of Work required by the Contract Documents are increased or decreased.

1.4 PROCEDURES

- A. Unit Prices include all necessary material plus cost for delivery, installation, insurance, applicable taxes, overhead, and profit.
- B. Measurement and Payment: Refer to individual Specification Sections for work that requires establishment of Unit Prices. Methods of measurement and payment for Unit Prices are specified in those Sections.
- C. Owner reserves the right to reject Contractor's measurement of Work in-place that involves use of established Unit Prices and to have this work measured, at Owner's expense, by an independent surveyor acceptable to Contractor.
- D. List of Unit Prices: A list of Unit Prices is included in Part 3. Specification Sections referenced in the schedule contain requirements for materials described under each Unit Price.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION

3.1 LIST OF UNIT PRICES

- A. Unit Price No. 1 – Unsuitable Subgrade Excavation and Replacement:
1. Description: Unsuitable Subgrade Excavation above quantities shown on the drawings according to Division 31 Section **31 2000 EARTH MOVING**.
 2. Unit of Measurement: Cubic Yard (CY).
 3. Base Bid Quantity: 50 cubic yards.
 4. Alternate 1 Quantity: 50 cubic yards.
- B. Unit Price No. 2 – Mass Rock Removal and Replacement:
1. Description: Unsuitable Subgrade Excavation above quantities shown on the drawings according to Division 31 Section **31 2000 EARTH MOVING**.
 2. Unit of Measurement: Cubic Yard (CY).
 3. Base Bid Quantity: 25 cubic yards.
 4. Alternate 1 Quantity: 25 cubic yards.

END OF SECTION 012200

SECTION 012300 - ALTERNATES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions, Bid Form and other Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes administrative and procedural requirements governing Alternates.

1.3 DEFINITIONS

- A. Definition: An alternate is an amount proposed by bidders and stated on the Bid Form for certain work defined in the Bidding Requirements that may be added to the Base Bid amount if the Owner decides to accept a corresponding change in either the amount of construction to be completed, or in the products, materials, equipment, systems, or installation methods described in the Contract Documents.
 - 1. The cost for each alternate is the net addition to the Contract Sum to incorporate the Alternate into the Work. No other adjustments are made to the Contract Sum.
- B. No additional time will be allowed for alternate work unless the number of workdays is so stated on the bid form.

1.4 PROCEDURES

- A. Coordination: Modify or adjust affected adjacent Work as necessary to completely and fully integrate the Alternate Work into the Project.
 - 1. Include as part of each alternate, miscellaneous devices, accessory objects, and similar items incidental to or required for a complete installation whether or not mentioned as part of the Alternate.
- B. Notification: The award of the Contract will indicate whether alternates have been accepted or rejected.
- C. Execute accepted alternates under the same conditions as other Work of this Contract.
- D. Schedule: A “Schedule of Alternates” is included at the end of this Section. Specification Sections referenced in the Schedule contain requirements for materials necessary to achieve the Work described under each alternate.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION

3.1 SCHEDULE OF ALTERNATES

A. Alternate 1 – Shower Rooms Addition:

1. Construct shower rooms addition on west end of building. Completion date of December 31, 2025.
2. To include:
 - a. Rough-in and wall-hung brackets for the Alternate 1 - water closets, showers, and lavatories.
 - b. Shower enclosure(s) and drain(s).
 - c. Owner to provide and install all Alternate 1 - Toilet Accessories.

B. Alternate 2 - Contractor-installed Plumbing Fixtures and Toilet Accessories:

1. Contractor to:
 - a. Provide and install plumbing fixtures to include water closets and flush valves, urinals and flush valves, shower valves, shower heads, lavatories, and faucets.
 - b. Provide and install toilet accessories as noted in the "Restroom Accessory Schedule" included on sheets A-101, A-102, A-301, and A-302.
2. Base Bid: To include:
 - a. Rough-in and wall-hung brackets for the water closets, urinals, showers, and lavatories.
 - b. Shower enclosure and drain.
 - c. Owner to provide and install all toilet accessories.

C. Alternate 3 – Water Heater, Exterior Lighting, Interior Lighting, Toilet Partitions, Epoxy Coating:

1. Contractor to:
 - a. Provide and install water heater with wall kit as shown and noted on sheet P-101.
 - b. Provide and install all exterior and interior light fixtures as shown and noted on sheet E-101.
 - c. Provide and install HDPE toilet compartment door/pilaster assemblies (including hardware), as shown on sheets A-101 and A-301.
 - d. Provide and install Epoxy Wall Coating PNT-01, as shown the Interior Finish Legend on sheet A-601.

2. Base Bid:

- a. Provide all plumbing and electrical rough-in for future water heater and wall kit to be installed by Owner; Provide blank plate at junction box; temporarily cap plumbing pipes.
- b. Provide all electrical rough-in for future exterior and interior light fixtures to be installed by Owner; Provide blank plates at junction boxes.
- c. Do not provide HDPE toilet partitions.
- d. CMU to remain exposed; Walls will be finished and painted by Owner.

D. Alternate 4 - Standing Seam Metal Roofing System:

- 1. Provide standing seam metal roof and associated flashing changes.
- 2. Base Bid: To include composition shingle roof system.

END OF SECTION 012300

SECTION 012600 – CONTRACT MODIFICATION PROCEDURES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and other Division 1 Specification Sections apply to this Section.

1.2 SUMMARY

- A. This Section specifies administrative and procedural requirements for handling and processing Contract Modifications.
- B. Related Sections include the following:
 - 1. Division 1, Section 012200 "Unit Prices" for administrative requirements for using Unit Prices.
 - 2. Division 1, Section 013115 "Project Management Communications" for administrative requirements for communications.
 - 3. Division 0, Section 007213, Article 3.1 "Acceptable Substitutions" for administrative procedures for handling Requests for Substitutions made after Contract award.
 - 4. Division 0, Section 007213, Article 4.0 "Changes in the Work" for Change Order requirements.

1.3 REQUESTS FOR INFORMATION

- A. In the event that the Contractor or Subcontractor, at any tier, determines that some portion of the Drawings, Specifications, or other Contract Documents requires clarification or interpretation, the Contractor shall submit a "Request for Information" (RFI) in writing to the Designer. A RFI may only be submitted by the Contractor and shall only be submitted on the RFI forms provided by the Owner. The Contractor shall clearly and concisely set forth the issue for which clarification or interpretation is sought and why a response is needed. In the RFI, the Contractor shall set forth an interpretation or understanding of the requirement along with reasons why such an understanding was reached.
- B. Responses to RFI shall be issued within ten (10) working days of receipt of the Request from the Contractor unless the Designer determines that a longer time is necessary to provide an adequate response. If a longer time is determined necessary by the Designer, the Designer will, within five (5) working days of receipt of the request, notify the Contractor of the anticipated response time. If the Contractor submits a RFI on a time sensitive activity on the current project schedule, the Contractor shall not be entitled to any time extension due to the time it takes the Designer to respond to the request provided that the Designer responds within the ten (10) working days set forth above.
- C. Responses from the Designer will not change any requirement of the Contract Documents. In the event the Contractor believes that a response to a RFI will cause a change to the requirements of the Contract Document, the Contractor shall give written notice to the Designer requesting a Change Order for the work. Failure to give such written notice within ten (10) working days, shall waive the Contractor's right to seek additional time or cost under Article 4, "Changes in the Work" of the General Conditions.

1.4 MINOR CHANGES IN THE WORK

- A. Designer will issue supplemental instructions authorizing Minor Changes in the Work, not involving adjustment to the Contract Amount or the Contract Time, on "Designer's Supplemental Instructions" (DSI).

1.5 PROPOSAL REQUESTS

- A. The Designer or Owner Representative will issue a detailed description of proposed Changes in the Work that may require adjustment to the Contract Amount or the Contract Time. The proposed Change Description will be issued using the "Request for Proposal" (RFP) form. If necessary, the description will include supplemental or revised Drawings and Specifications.
 - 1. Proposal Requests issued by the Designer or Owner Representative are for information only. Do not consider them instructions either to stop work in progress or to execute the proposed change.
 - 2. Within ten (10) working days after receipt of Proposal Request, submit a proposal for the cost adjustments to the Contract Amount and the Contract Time necessary to execute the Change. The Contractor shall submit his proposal on the appropriate Change Order Detailed Breakdown form. Subcontractors may use the appropriate Change Order Detailed Breakdown form or submit their proposal on their letterhead provided the same level of detail is included. All proposals shall include:
 - a. A detailed breakdown of costs per Article 4.1 of the General Conditions.
 - b. If requesting additional time per Article 4.2 of the General Conditions, include an updated Contractor's Construction Schedule that indicates the effect of the Change including, but not limited to, changes in activity duration, start and finish times, and activity relationship.

1.6 CHANGE ORDER PROCEDURES

- A. On Owner's approval of a Proposal Request, the Designer or Owner Representative will issue a Change Order for signatures of Owner and Contractor on the "Change Order" form.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF SECTION 012600

SECTION 013100 – COORDINATION

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and other Division 1 Specification Sections apply to this Section.

1.2 SUMMARY

- A. This Section includes administrative provisions for coordinating construction operations on Projects including, but not limited to, the following:
 - 1. Coordination Drawings.
 - 2. Administrative and supervisory personnel.
 - 3. Project meetings.
- B. Each Contractor shall participate in coordination requirements. Certain areas of responsibility will be assigned to a specific Contractor.
- C. Related Sections include the following:
 - 1. Division 1, Section 013200 "Schedules" for preparing and submitting Contractor's Construction Schedule.
 - 2. Articles 1.8.B and 1.8.C of Section 007213 "General Conditions" for coordinating meetings onsite.
 - 3. Article 5.4.H of Section 007213 "General Conditions" for coordinating Closeout of the Contract.

1.3 COORDINATION

- A. Coordination: Coordinate construction operations included in different Sections of the Specifications to ensure efficient and orderly installation of each part of the Work. Coordinate construction operations included in different Sections, which depend on each other for proper installation, connection, and operation.
- B. Coordination: Each Contractor shall coordinate its construction operations with those of other contractors and entities to ensure efficient and orderly installation of each part of the Work. Each Contractor shall coordinate its operations with operations included in different Sections that depend on each other for proper installation, connection, and operation.
 - 1. Schedule construction operations in sequence required to obtain the best results where installation of one part of the Work depends on installation of other components, before or after its own installation.
 - 2. Coordinate installation of different components with other Contractors to ensure maximum accessibility for required maintenance, service, and repair.
 - 3. Make adequate provisions to accommodate items scheduled for later installation.
 - 4. Where availability of space is limited, coordinate installation of different components to ensure maximum performance and accessibility for required

maintenance, service, and repair of all components including mechanical and electrical.

- C. Prepare memoranda for distribution to each party involved outlining special procedures required for coordination. Include such items as required notices, reports, and list of attendees at meetings.
 - 1. Prepare similar memoranda for Owner and separate Contractors if coordination of their Work is required.
- D. Administrative Procedures: Coordinate scheduling and timing of required administrative procedures with other construction activities and activities of other Contractors to avoid conflicts and to ensure orderly progress of the Work. Such administrative activities include, but are not limited to, the following:
 - 1. Preparation of Contractor's Construction Schedule.
 - 2. Preparation of the Schedule of Values.
 - 3. Installation and removal of temporary facilities and controls.
 - 4. Delivery and processing of submittals.
 - 5. Progress meetings.
 - 6. Preinstallation conferences.
 - 7. Startup and adjustment of systems.
 - 8. Project Closeout activities.
- E. Conservation: Coordinate construction activities to ensure that operations are carried out with consideration given to conservation of energy, water, and materials.
 - 1. Salvage materials and equipment involved in performance of, but not actually incorporated into, the Work. Refer to other Sections for disposition of salvaged materials that are designated as Owner's property.

1.4 SUBMITTALS

- A. Coordination Drawings: Prepare Coordination Drawings if limited space availability necessitates maximum utilization of space for efficient installation of different components or if coordination is required for installation of products and materials fabricated by separate entities.
- B. Key Personnel Names: Within fifteen (15) workdays of starting construction operations, submit a list of key personnel assignments including superintendent and other personnel in attendance at Project site. Identify individuals and their duties and responsibilities; list addresses and telephone numbers including home and office telephone numbers. Provide names, addresses, and telephone numbers of individuals assigned as standbys in the absence of individuals assigned to Project.
 - 1. Post copies of list in Project meeting room, in temporary field office, and by each temporary telephone. Keep list current at all times.

1.5 PROJECT MEETINGS

- A. The Owner's Construction Representative will schedule a Pre-Construction Meeting prior to beginning of construction. The date, time, and exact place of this meeting will be determined after Contract Award and notification of all interested parties. The

Contractor shall arrange to have the Job Superintendent and all prime Subcontractors present at the meeting. During the Pre-Construction Meeting, the construction procedures and information necessary for submitting payment requests will be discussed and materials distributed along with any other pertinent information.

1. Minutes: Designer will record and distribute meeting minutes.
- B. Progress Meetings: The Owner's Construction Representative will conduct Monthly Progress Meetings as stated in Articles 1.8.B and 1.8.C of Section 007213 "General Conditions".
1. Minutes: Designer will record and distribute to Contractor the meeting minutes.
- C. Preinstallation Conferences: Contractor shall conduct a preinstallation conference at Project site before each construction activity that requires coordination with other construction.
1. Attendees: Installer and representatives of Manufacturers and Fabricators involved in or affected by the installation and its coordination or integration with other materials and installations that have preceded or will follow, shall attend the meeting. Advise Designer and Construction Representative of scheduled meeting dates.
 2. Agenda: Review progress of other construction activities and preparations for the particular activity under consideration including requirements for the following:
 - a. Contract Documents
 - b. Options
 - c. Related RFIs
 - d. Related Change Orders
 - e. Purchases
 - f. Deliveries
 - g. Submittals
 - h. Review of mockups
 - i. Possible conflicts
 - j. Compatibility problems
 - k. Time schedules
 - l. Weather limitations
 - m. Manufacturer's written recommendations
 - n. Warranty requirements
 - o. Compatibility of materials
 - p. Acceptability of substrates
 - q. Temporary facilities and controls
 - r. Space and access limitations
 - s. Regulations of authorities having jurisdiction
 - t. Testing and inspecting requirements

- u. Installation procedures
 - v. Coordination with other Work
 - w. Required performance results
 - x. Protection of adjacent Work
 - y. Protection of construction and personnel
3. Contractor shall record significant conference discussions, agreements, and disagreements including required corrective measures and actions.
 4. Reporting: Distribute minutes of the meeting to each party present and to parties who should have been present.
 5. Do not proceed with installation if the conference cannot be successfully concluded. Initiate whatever actions are necessary to resolve impediments to performance of the Work and reconvene the conference at earliest feasible date.
 6. Revise paragraph below if Project requires holding progress meetings at different intervals. Insert special intervals such as "every third Tuesday" to suit special circumstances.
 7. Project name
 8. Name and address of Contractor
 9. Name and address of Designer
 10. RFI number including RFIs that were dropped and not submitted
 11. RFI description
 12. Date the RFI was submitted
 13. Date Designer's response was received
 14. Identification of related DSI or Proposal Request, as appropriate

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF SECTION 013100

SECTION 013115 - PROJECT MANAGEMENT COMMUNICATIONS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.
- B. Division 1, Section 013300 – Submittals
- C. Division 1, Section 012600 – Contract Modification Procedures

1.2 SUMMARY

- A. Project Management Communications: The Contractor shall use the Internet web-based project management communications tool, E-Builder® ASP software, and protocols included in that software during this project. The use of project management communications as herein described does not replace or change any contractual responsibilities of the participants.
 - 1. Project management communications is available through E-Builder® as provided by "e-Builder®" in the form and manner required by the Owner.
 - 2. The project communications database is on-line and fully functional. User registration, electronic and computer equipment, and Internet connections are the responsibility of each project participant. The sharing of user accounts is prohibited.
- B. Support: E-Builder® will provide on-going support through on-line help files.
- C. Copyrights and Ownership: Nothing in this specification or the subsequent communications supersedes the parties' obligations and rights for copyright or document ownership as established by the Contract Documents. The use of CAD files, processes or design information distributed in this system is intended only for the project specified herein.
- D. Purpose: The intent of using E-Builder® is to improve project work efforts by promoting timely initial communications and responses. Secondly, to reduce the number of paper documents while providing improved record keeping by creation of electronic document files.

- E. Authorized Users: Access to the web site will be by individuals who are authorized users.
1. Individuals shall complete the E-Builder New Company/User Request Form located at the following web site:
<https://oa.mo.gov/facilities/vendor-links/contractor-forms>. Completed forms shall be emailed to the following email address: OA.FMDCE-BuilderSupport@oa.mo.gov.
 2. Authorized users will be contacted directly and assigned a temporary user password.
 3. Individuals shall be responsible for the proper use of their passwords and access to data as agents of the company in which they are employed.
 4. Administrative Users: Administrative users have access and control of user licenses and all posted items. DO NOT POST PRIVATE OR YOUR COMPANY CONFIDENTIAL ITEMS IN THE DATABASE! Improper or abusive language toward any party or repeated posting of items intended to deceive or disrupt the work of the project will not be tolerated and will result in deletion of the offensive items and revocation of user license at the sole discretion of the Administrative User(s).

- F. Communications: The use of fax, email and courier communication for this project is discouraged in favor of using E-Builder® to send messages. Communication functions are as follows:

1. Document Integrity and Revisions:
 - a. Documents, comments, drawings, and other records posted to the system shall remain for the project record. The authorship time and date shall be recorded for each document submitted to the system. Submitting a new document or record with a unique ID, authorship, and time stamp shall be the method used to make modifications or corrections.
 - b. The system shall make it easy to identify revised or superseded documents and their predecessors.
 - c. Server or Client-side software enhancements during the life of the project shall not alter or restrict the content of data published by the system. System upgrades shall not affect access to older documents or software.
2. Document Security:
 - a. The system shall provide a method for communication of documents. Documents shall allow security group assignment to respect the contractual party's communication except for Administrative Users. DO NOT POST PRIVATE OR YOUR COMPANY CONFIDENTIAL ITEMS IN THE DATABASE!

3. Document Integration:
 - a. Documents of various types shall be logically related to one another and discoverable. For example, requests for information, daily field reports, supplemental sketches and photographs shall be capable of reference as related records.
4. Reporting:
 - a. The system shall be capable of generating reports for work in progress, and logs for each document type. Summary reports generated by the system shall be available for team members.
5. Notifications and Distribution:
 - a. Document distribution to project members shall be accomplished both within the extranet system and via email as appropriate. Project document distribution to parties outside of the project communication system shall be accomplished by secure email of outgoing documents and attachments, readable by a standard email client.
6. Required Document Types:
 - a. RFI, Request for Information.
 - b. Submittals, including record numbering by drawing and specification section.
 - c. Transmittals, including record of documents and materials delivered in hard copy.
 - d. Meeting Minutes.
 - e. Application for Payments (Draft or Pencil).
 - f. Review Comments.
 - g. Field Reports.
 - h. Construction Photographs.
 - i. Drawings.
 - j. Supplemental Sketches.
 - k. Schedules.
 - l. Specifications.
 - m. Request for Proposals
 - n. Designer's Supplemental Instructions
 - o. Punch Lists

G. Record Keeping: Except for paper documents, which require original signatures and large format documents (greater than 8½ x 11 inches), all other 8½ x 11 inches documents shall be submitted by transmission in electronic form to the E-Builder® web site by licensed users.

1. The Owner and his representatives, the Designer and his consultants, and the Contractor and his Sub Contractors and suppliers at every tier shall respond to documents received in electronic form on the web site and consider them as if received in paper document form.

2. The Owner and his representatives, the Designer and his consultants, and the Contractor and his Sub Contractors and suppliers at every tier reserves the right to and shall reply or respond by transmissions in electronic form on the web site to documents actually received in paper document form.
 3. The Owner and his representatives, the Designer and his consultants, and the Contractor and his Sub Contractors and suppliers at every tier reserves the right to and shall copy any paper document into electronic form and make same available on the web site.
- H. Minimum Equipment and Internet Connection: In addition to other requirements specified in this Section, the Owner and his representatives, the Construction Manager and his representatives, the Architect and his consultants, and the Contractor and his sub-contractors and suppliers at every tier required to have a user license(s) shall be responsible for the following:
1. Providing suitable computer systems for each licensed user at the user's normal work location¹ with high-speed Internet access, i.e. DSL, local cable company's Internet connection, or T1 connection.
 2. Each of the above referenced computer systems shall have the following minimum system² and software requirements:
 - a. Desktop configuration (Laptop configurations are similar and should be equal to or exceed desktop system.)
 - 1) Operating System: Windows XP or newer
 - 2) Internet Browser: Internet Explorer 6.01SP2+ (Recommend IE7.0+)
 - 3) Minimum Recommend Connection Speed: 256K or above
 - 4) Processor Speed: 1 Gigahertz and above
 - 5) RAM: 512 mb
 - 6) Operating system and software shall be properly licensed.
 - 7) Internet Explorer version 7 (current version is a free distribution for download). This specification is not intended to restrict the host server or client computers provided that industry standard HTTP clients may access the published content.
 - 8) Adobe Acrobat Reader (current version is a free distribution for download).
 - 9) Users should have the standard Microsoft Office Suite (current version must be purchased) or the equivalent.

PART 2 - PRODUCTS (Not Applicable)

¹ The normal work location is the place where the user is assigned for more than one-half of his time working on this project.

² The minimum system herein will not be sufficient for many tasks and may not be able to process all documents and files stored in the E-Builder® Documents area.

PART 3 - EXECUTION (Not Applicable)

END OF SECTION 013115

SECTION 013200 – SCHEDULE – BAR CHART

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

1.2 SUMMARY

- A. This Section includes requirements for a Bar Chart Schedule for the project construction activities, schedule of submittals, and schedule for testing.

PART 2 - PRODUCTS – (Not Applicable)

PART 3 - EXECUTION

3.1 SUBMITTAL PROCEDURES

- A. The Contractor shall submit to the Designer, within ten (10) working days following the Notice to Proceed, a Progress Schedule including Schedule of Values showing the rate of progress the Contractor agrees to maintain and the order in which he proposed to carry out the various phases of Work. No payments shall be made to the Contractor until the Progress Schedule has been approved by the Owner.
 - 1. The Schedule of Values must have the following line items included with the value of the item as indicated below:
 - a. O&M's (Owner's Manual)
 - 1) \$1,000,000.00 (One million) and under – 2% of the total contract amount
 - 2) Over \$1,000,000.00 (One million) – 1% of the total contract amount
 - b. Close Out Documents
 - 1) \$1,000,000.00 (One million) and under – 2% of the total contract amount
 - 2) Over \$1,000,000.00 (One million) – 1% of the total contract amount
 - c. General Conditions
 - 1) No more than 10%
- B. The Contractor shall submit an updated Schedule for presentation at each Monthly Progress Meeting. The Schedule shall be updated by the Contractor as necessary to reflect the current Schedule and its relationship to the original Schedule. The updated

Schedule shall reflect any changes in the logic, sequence, durations, or completion date. Payments to the Contractor shall be suspended if the Progress Schedule is not adequately updated to reflect actual conditions.

- C. The Contractor shall submit Progress Schedules to Subcontractors to permit coordinating their Progress Schedules to the general construction Work. The Contractor shall coordinate preparation and processing of Schedules and reports with performance of other construction activities.

3.2 CONSTRUCTION PROGRESS SCHEDULE – BAR CHART SCHEDULE

- A. Bar-Chart Schedule: The Contractor shall prepare a comprehensive, fully developed, horizontal bar chart-type Contractor’s Construction Schedule. The Contractor for general construction shall prepare the Construction Schedule for the entire Project. The Schedule shall show the percentage of work to be completed at any time, anticipated monthly payments by Owner, as well as significant dates (such as completion of excavation, concrete foundation work, underground lines, superstructure, rough-ins, enclosure, hanging of fixtures, etc.) which shall serve as check points to determine compliance with the approved Schedule. The Schedule shall also include an activity for the number of “bad” weather days specified in Section 012100 – Allowances.
 - 1. The Contractor shall provide a separate time bar for each significant construction activity. Provide a continuous vertical line to identify the first working day of each week.
 - a. If practical, use the same Schedule of Values breakdown for schedule time bars.
 - 2. Secure time commitments for performing critical elements of the Work from parties involved. Coordinate each element on schedule with other construction activities. Include minor elements involved in the overall sequence of the Work. Show each activity in proper sequence. Indicate graphically the sequences necessary for completion of related portions of the Work.
 - 3. Coordinate the Contractor’s Construction Schedule with the Schedule of Values, list of subcontracts, Submittal Schedule, progress reports, payment requests, and other required schedules and reports.
 - 4. Indicate the Intent to Award and the Contract Substantial Completion dates on the schedule.
- B. Phasing: Provide notations on the schedule to show how the sequence of the Work is affected by the following:
 - 1. Requirement for Phased completion
 - 2. Work by separate Contractors
 - 3. Work by the Owner
 - 4. Pre-purchased materials
 - 5. Coordination with existing construction

6. Limitations of continued occupancies
 7. Un-interruptible services
 8. Partial Occupancy prior to Substantial Completion
 9. Site restrictions
 10. Provisions for future construction
 11. Seasonal variations
 12. Environmental control
- C. Work Stages: Use crosshatched bars to indicate important stages of construction for each major portion of the Work. Such stages include, but are not necessarily limited to, the following:
1. Subcontract awards
 2. Submittals
 3. Purchases
 4. Mockups
 5. Fabrication
 6. Sample testing
 7. Deliveries
 8. Installation
 9. Testing
 10. Adjusting
 11. Curing
 12. Startup and placement into final use and operation
- D. Area Separations: Provide a separate time bar to identify each major area of construction for each major portion of the Work. For the purposes of this Article, a “major area” is a story of construction, a separate building, or a similar significant construction element.
1. Indicate where each construction activity within a major area must be sequenced or integrated with other construction activities to provide for the following:
 - a. Structural completion.
 - b. Permanent space enclosure
 - c. Completion of mechanical installation
 - d. Completion of the electrical portion of the Work
 - e. Substantial Completion

3.3 SCHEDULE OF SUBMITTALS

- A. Upon acceptance of the Construction Progress Schedule, prepare and submit a complete schedule of submittals. Coordinate the submittal schedule with Section 013300 SUBMITTALS, the approved Construction Progress Schedule, list of subcontracts, Schedule of Values and the list of products.
- B. Prepare the schedule in chronological order. Provide the following information
 - 1. Scheduled date for the first submittal
 - 2. Related Section number
 - 3. Submittal category
 - 4. Name of the Subcontractor
 - 5. Description of the part of the Work covered
 - 6. Scheduled date for resubmittal
 - 7. Scheduled date for the Designer's final release or approval
- C. Distribution: Following the Designer's response to the initial submittal schedule, print and distribute copies to the Designer, Owner, subcontractors, and other parties required to comply with submittal dates indicated.
 - 1. Post copies in the Project meeting room and temporary field office.
 - 2. When revisions are made, distribute to the same parties and post in the same locations. Delete parties from distribution when they have completed their assigned part of the Work and are no longer involved in construction activities.
- D. Schedule Updating: Revise the schedule after each meeting or other activity where revisions have been recognized or made. Issue the updated schedule concurrently with the report of each meeting.

3.4 SCHEDULE OF INSPECTIONS AND TESTS

- A. Prepare a schedule of inspections, tests, and similar services required by the Contract Documents. Submit the schedule with (15) days of the date established for commencement of the Contract Work. The Contractor is to notify the testing agency at least (5) working days in advance of the required tests unless otherwise specified.
- B. Form: This schedule shall be in tabular form and shall include, but not be limited to, the following:
 - 1. Specification Section number
 - 2. Description of the test
 - 3. Identification of applicable standards
 - 4. Identification of test methods
 - 5. Number of tests required

6. Time schedule or time span for tests
 7. Entity responsible for performing tests
 8. Requirements for taking samples
 9. Unique characteristics of each service
- C. Distribution: Distribute the schedule to the Owner, Architect, and each party involved in performance of portions of the Work where inspections and tests are required.

END OF SECTION 013200

SECTION 013300 – SUBMITTALS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.
- B. Division 1, Section 013115 “Project Management Communications” for administrative requirements for communications.

1.2 SUMMARY

- A. This Section includes administrative and procedural requirements for submittals required for performance of the Work including the following:
 - 1. Shop Drawings
 - 2. Product Data
 - 3. Samples
 - 4. Quality Assurance Submittals
 - 5. Construction Photographs
 - 6. Operating and Maintenance Manuals
 - 7. Warranties
- B. Administrative Submittals: Refer to General and Supplementary Conditions other applicable Division 1 Sections and other Contract Documents for requirements for administrative submittals. Such submittals include, but are not limited to, the following:
 - 1. Construction Progress Schedule including Schedule of Values
 - 2. Performance and Payment Bonds
 - 3. Insurance Certificates
 - 4. Applications for Payment
 - 5. Certified Payroll Reports
 - 6. Partial and Final Receipt of Payment and Release Forms
 - 7. Affidavit – Compliance with Prevailing Wage Law
 - 8. Record Drawings
 - 9. Notifications, Permits, etc.
- C. The Contractor is obliged and responsible to check all shop drawings and schedules to assure compliance with contract plans and specifications. The Contractor is responsible for the content of the shop drawings and coordination with other contract work. Shop drawings and schedules shall indicate, in detail, all parts of an Item or Work including erection and setting instructions and integration with the Work of other trades.
- D. The Contractor shall at all times make a copy, of all approved submittals, available on site to the Construction Representative.

1.3 SUBMITTAL PROCEDURES

- A. The Contractor shall comply with the General and Supplementary Conditions and other applicable sections of the Contract Documents. The Contractor shall submit, with such promptness as to cause no delay in his work or in that of any other contractors, all required submittals indicated in Part 3.1 of this section and elsewhere in the Contract Documents. Coordinate preparation and processing of submittals with performance of construction activities. Transmit each submittal sufficiently in advance of performance of related construction activities to avoid delay.
 - 1. Coordinate each submittal with fabrication, purchasing, testing, delivery, other submittals, and related activities that require sequential activity.
 - 2. Coordinate transmittal of different types of submittals for related elements of the Work so processing will not be delayed by the need to review submittals concurrently for coordination.
 - a. The Designer reserves the right to withhold action on a submittal requiring coordination with other submittals until all related submittals are received.

- B. Each drawing and/or series of drawings submitted must be accompanied by a letter of transmittal giving a list of the titles and numbers of the drawings. Each series shall be numbered consecutively for ready reference and each drawing shall be marked with the following information:
 - 1. Date of Submission
 - 2. Name of Project
 - 3. Location
 - 4. Section Number of Specification
 - 5. State Project Number
 - 6. Name of Submitting Contractor
 - 7. Name of Subcontractor
 - 8. Indicate if Item is submitted as specified or as a substitution

1.4 SHOP DRAWINGS

- A. Comply with the General Conditions, Article 3.2.

- B. The Contractor shall submit newly prepared information drawn accurately to scale. Highlight, encircle, or otherwise indicate deviations from the Contract Documents. Do not reproduce Contract Documents or copy standard information as the basis of Shop Drawings. Standard information prepared without specific reference to the Project is not a Shop Drawing.

- C. Shop Drawings include fabrication and installation drawings, setting diagrams, schedules, patterns, templates, and similar drawings including the following information:
 - 1. Dimensions
 - 2. Identification of products and materials included by sheet and detail number
 - 3. Compliance with specified standards
 - 4. Notation of coordination requirements

5. Notation of dimensions established by field measurement
6. Sheet Size: Except for templates, patterns, and similar full-size Drawings, submit Shop Drawings on sheets at least 8½"x11" but no larger than 36"x48".

1.5 PRODUCT DATA

- A. The Contractor shall comply with the General Conditions, Article 3.2.
- B. The Contractor shall collect Product Data into a single submittal for each element of construction or system. Product Data includes printed information, such as manufacturer's installation instructions, catalog cuts, standard color charts, roughing-in diagrams and templates, standard wiring diagrams, and performance curves.
 1. Mark each copy to show applicable choices and options. Where printed Product Data includes information on several products that are not required, mark copies to indicate the applicable information including the following information:
 - a. Manufacturer's printed recommendations
 - b. Compliance with Trade Association standards
 - c. Compliance with recognized Testing Agency standards
 - d. Application of Testing Agency labels and seals
 - e. Notation of dimensions verified by field measurement
 - f. Notation of coordination requirements
 2. Do not submit Product Data until compliance with requirements of the Contract Documents has been confirmed.

1.6 SAMPLES

- A. The Contractor shall comply with the General Conditions, Article 3.2.
- B. The Contractor shall submit full-size, fully fabricated samples, cured and finished as specified, and physically identical with the material or product proposed. Samples include partial sections of manufactured or fabricated components, cuts or containers of materials, color range sets, and swatches showing color, texture, and pattern.
 1. The Contractor shall mount or display samples in the manner to facilitate review of qualities indicated. Prepare samples to match the Designer's sample including the following:
 - a. Specification Section number and reference
 - b. Generic description of the Sample
 - c. Sample source
 - d. Product name or name of the Manufacturer
 - e. Compliance with recognized standards
 - f. Availability and delivery time
 2. The Contractor shall submit samples for review of size, kind, color, pattern, and texture. Submit samples for a final check of these characteristics with other elements and a comparison of these characteristics between the final submittal and the actual component as delivered and installed.

- a. Where variation in color, pattern, texture, or other characteristic is inherent in the material or product represented, submit at least three (3) multiple units that show approximate limits of the variations.
 - b. Refer to other Specification Sections for requirements for samples that illustrate workmanship, fabrication techniques, details of assembly, connections, operation, and similar construction characteristics.
 - c. Refer to other Sections for samples to be returned to the Contractor for incorporation in the Work. Such samples must be undamaged at time of use. On the transmittal, indicate special requests regarding disposition of sample submittals.
 - d. Samples not incorporated into the Work, or otherwise designated as the Owner's property, are the property of the Contractor and shall be removed from the site prior to Substantial Completion.
3. Field samples are full-size examples erected onsite to illustrate finishes, coatings, or finish materials and to establish the Project standard.
 - a. The Contractor shall comply with submittal requirements to the fullest extent possible. The Contractor shall process transmittal forms to provide a record of activity.

1.7 QUALITY ASSURANCE DOCUMENTS

- A. The Contractor shall comply with the General Conditions, Article 3.2
- B. The Contractor shall submit quality control submittals including design data, certifications, manufacturer's instructions, manufacturer's field reports, and other quality-control submittals as required under other Sections of the Specifications.
- C. Certifications: Where other Sections of the Specifications require certification that a product, material, or installation complies with specified requirements, submit a notarized certification from the Manufacturer certifying compliance with specified requirements.
 1. Signature: Certification shall be signed by an officer of the Manufacturer or other individual authorized to contractually bind the Company.
- D. Inspection and Test Reports: The Contractor shall submit the required inspection and test reports from independent testing agencies as specified in this Section and in other Sections of the Contract Documents.
- E. Construction Photographs: The Contractor shall submit record construction photographs as specified in this Section and in other Sections of the Contract Documents.
 1. The Contractor shall submit digital photographs. The Construction Administrator shall determine the quantity and naming convention at the preconstruction meeting.
 2. The Contractor shall identify each photograph with project name, location, number, date, time, and orientation.
 3. The Contractor shall submit progress photographs monthly unless specified otherwise. Photographs shall be taken one (1) week prior to submitting.
 4. The Contractor shall take four (4) site photographs from differing directions and a minimum of five (5) interior photographs indicating the relative progress of the Work.

1.8 OPERATING AND MAINTENANCE MANUALS AND WARRANTIES

- A. The Contractor shall submit all required manufacturer's operating instructions, maintenance/service manuals, and warranties in accordance with the General Conditions, Article 3.5, and Supplementary Conditions along with this and other Sections of the Contract Documents.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION

3.1 REQUIRED SUBMITTALS

- A. Contractor shall submit the following information for materials and equipment to be provided under this contract.

SPEC SECTION	TITLE	CATEGORY
013200	Schedules	Construction Schedule
013200	Schedules	Schedule of Values
013200	Schedules	List of Subcontractors
013200	Schedules	Major Material Suppliers
013300	Submittals	As-Builts
033000	Cast-in-Place Concrete	Product Data
033000	Cast-in-Place Concrete	Certification
033000	Cast-in-Place Concrete	Test Report
042200	Concrete Unit Masonry	Shop Drawings
042200	Concrete Unit Masonry	Product Data
042200	Concrete Unit Masonry	Sample
042200	Concrete Unit Masonry	Certification
042200	Concrete Unit Masonry	Test Report
055213	Pipe and Tube Railings	Shop Drawings
055213	Pipe and Tube Railings	Certification
061000	Rough Carpentry	Product Data
061600	Sheathing	Product Data
061753	Shop-Fabricated Wood Trusses	Shop Drawings
061753	Shop-Fabricated Wood Trusses	Product Data
068316	Fiberglass Reinforced Paneling	Product Data
073113	Asphalt Shingles	Product Data
073113	Asphalt Shingles	Sample
073113	Asphalt Shingles	Certification
073113	Asphalt Shingles	Warranty
074113	ALT. 4: Metal Roof Panels	Shop Drawings
074113	ALT. 4: Metal Roof Panels	Product Data
074113	ALT. 4: Metal Roof Panels	Sample
074113	ALT. 4: Metal Roof Panels	Warranty
074646	Fiber Cement Siding	Product Data
074646	Fiber Cement Siding	Warranty
076200	Sheet Metal Flashing and Trim	Shop Drawings
076200	Sheet Metal Flashing and Trim	Sample

079200	Joint Sealants	Product Data
079200	Joint Sealants	Sample
081113	H.M. Doors and Frames	Shop Drawings
081113	H.M. Doors and Frames	Product Data
087100	Door Hardware	Shop Drawings
087100	Door Hardware	Product Data
087100	Door Hardware	Operation / Maintenance Manual
089100	Louvers and Foundation Vents	Product Data
092116	Gypsum Board Assemblies	Product Data
099000	Painting and Coating	Product Data
099000	Painting and Coating	Sample
099000	Painting and Coating	Certification
099000	Painting and Coating	Operation / Maintenance Manual
101400	Signage	Product Data
101400	Signage	Sample
102113.19	ALT. 3: Plastic Toilet Compartments	Shop Drawings
102113.19	ALT. 3: Plastic Toilet Compartments	Product Data
102800	ALT. 2: Toilet Accessories	Product Data
223000	Plumbing Equipment	Product Data
224000	Plumbing Fixtures	Product Data
233416	Centrifugal HVAC Fans	Product Data
262416	Panelboards	Product Data
262726	Wiring Devices	Product Data
265100	ALT. 3: Interior Lighting	Shop Drawings
265100	ALT. 3: Interior Lighting	Product Data
265600	ALT. 3: Exterior Lighting	Shop Drawings
265600	ALT. 3: Exterior Lighting	Product Data
311000	Site Clearing & Demolition	Product Data
312000	Earth Moving	Product Data
312000	Earth Moving	Sample
321313	Concrete Pavement	Product Data
321313	Concrete Pavement	Test Report
321373	Concrete Paving Joint Sealants	Product Data
321373	Concrete Paving Joint Sealants	Certification
331113	Facility Water Distribution Piping	Product Data
331113	Facility Water Distribution Piping	Test Report
331113	Facility Water Distribution Piping	Operation / Maintenance Manual
333000	Sanitary Sewage Utilities	Shop Drawings
334100	Storm Utility Drainage Piping	Product Data
334100	Storm Utility Drainage Piping	Shop Drawings

END OF SECTION 013300

SECTION 013513.28 – SITE SECURITY AND HEALTH REQUIREMENTS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

1.2 SUBMITTALS

- A. List of required submittals:
 - 1. Materials Safety Data Sheets for all hazardous materials to be brought onsite.
 - 2. Schedule of proposed shutdowns, if applicable.
 - 3. A list of the names of all employees who will submit fingerprints for a background check, and the signed privacy documents identified below for each employee.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION

3.1 ACCESS TO THE SITE

- A. The Contractor shall arrange with Facility Representatives to establish procedures for the controlled entry of workers and materials into the work areas at the Facility.
- B. The Contractor shall establish regular working hours with Facility Representatives. The Contractor must report changes in working hours or overtime to Facility Representatives and obtain approval twenty-four (24) hours ahead of time. The Contractor shall report emergency overtime to Facility Representatives as soon as it is evident that overtime is needed. The Contractor must obtain approval from Facility Representatives for all work performed after dark.
- C. The Contractor shall provide the name and phone number of the Contractor's employee or agent who is in charge onsite; this individual must be able to be contacted in case of emergency. The Contractor must be able to furnish names and address of all employees upon request.
- D. All construction personnel shall visibly display issued identification cards.

3.2 FIRE PROTECTION, SAFETY, AND HEALTH CONTROLS

- A. The Contractor shall take all necessary precautions to guard against and eliminate possible fire hazards.
 - 1. Onsite burning is prohibited.
 - 2. The Contractor shall store all flammable or hazardous materials in proper containers located outside the buildings or offsite, if possible.
 - 3. The Contractor shall provide and maintain, in good order, during construction fire extinguishers as required by the National Fire Protection Association. In areas of

flammable liquids, asphalt, or electrical hazards, 15-pound carbon dioxide or 20-pound dry chemical extinguishers shall be provided.

- B. The Contractor shall not obstruct streets or walks without permission from the Owner's Construction Representative and Facility Representatives.
- C. The Contractor's personnel shall not exceed the speed limit of 15 mph while at the Facility unless otherwise posted.
- D. The Contractor shall take all necessary, reasonable measures to reduce air and water pollution by any material or equipment used during construction. The Contractor shall keep volatile wastes in covered containers, and shall not dispose of volatile wastes or oils in storm or sanitary drains.
- E. The Contractor shall keep the project site neat, orderly, and in a safe condition at all times. The Contractor shall immediately remove all hazardous waste, and shall not allow rubbish to accumulate. The Contractor shall provide onsite containers for collection of rubbish and shall dispose of it at frequent intervals during the progress of the Work.
- F. Fire exits, alarm systems, and sprinkler systems shall remain fully operational at all times, unless written approval is received from the Owner's Construction Representative and the appropriate Facility Representative at least twenty-four (24) hours in advance. The Contractor shall submit a written time schedule for any proposed shutdowns.
- G. For all hazardous materials brought onsite, Material Safety Data Sheets shall be on site and readily available upon request at least a day before delivery.
- H. Alcoholic beverages or illegal substances shall not be brought upon the Facility premises. The Contractor's workers shall not be under the influence of any intoxicating substances while on the Facility premises.

3.3 SECURITY CLEARANCES AND RESTRICTIONS

A. FMDC REQUIRED FINGERPRINTING FOR CRIMINAL BACKGROUND AND WARRANTS CHECK

1. All employees of the Contractor are required to submit fingerprints to the Missouri State Highway Patrol to enable the Office of Administration, Division of Facilities Management, Design and Construction (FMDC) to receive state and national criminal background checks on such employees. FMDC reserves the right to prohibit any employee of the Contractor from performing work in or on the premises of any facility owned, operated, or utilized by the State of Missouri for any reason.
2. The Contractor shall ensure all of its employees submit fingerprints to the Missouri State Highway Patrol and pay for the cost of such background checks. The Contractor shall submit to FMDC via email to FMDCSecurity@oa.mo.gov a list of the names of the Contractor's employees who will be fingerprinted and a signed Missouri Applicant Fingerprint Privacy Notice, Applicant Privacy Rights and Privacy Act Statement for each employee. All employees of the Contractor approved by FMDC to work at a State facility must obtain a contractor ID badge from FMDC prior to beginning work on-site, unless the Director of FMDC, at the Director's discretion, waives the requirement for a contractor ID badge. The Contractor and its employees must comply with the process for background checks

and contractor ID badges found on FMDC's website at: <https://oa.mo.gov/fmdc-contractor-id-badges>.

3. Pursuant to section 43.540, RSMo, FMDC participates in the Missouri Rap Back and National Rap Back programs as of August 28, 2018. This means that the Missouri State Highway Patrol, Central Records Repository, and the Federal Bureau of Investigation will retain the fingerprints submitted by each of the Contractor's employees, and those fingerprints will be searched against other fingerprints on file, including latent fingerprints. While retained, an employee's fingerprints may continue to be compared against other fingerprints submitted or retained by the Federal Bureau of Investigation, including latent fingerprints.
4. As part of the Missouri and National Rap Back programs, FMDC will receive notification if a new arrest is reported for an employee whose fingerprints have been submitted for FMDC after August 28, 2018. If the employee is performing work on a State contract at the time of the arrest notification, FMDC will request and receive the employee's updated criminal history records. If the employee is no longer performing work on a State contract, FMDC will not obtain updated criminal records.
5. Pursuant to section 43.540, RSMo, the Missouri State Highway Patrol will provide the results of the employee's background check directly to FMDC. FMDC may NOT release the results of a background check to the Contractor or provide the Contractor any information obtained from a background check, either verbally or in writing. FMDC will notify the Contractor only whether an employee is approved to work on State property.
6. Each employee who submits fingerprints to the Missouri State Highway Patrol has a right to obtain a copy of the results of his or her background check. The employee may challenge the accuracy and completeness of the information contained in a background check report and obtain a determination from the Missouri State Highway Patrol and/or the FBI regarding the validity of such challenge prior to FMDC making a final decision about his or her eligibility to perform work under a State contract.
7. The Contractor shall notify FMDC via email to FMDCSecurity@oa.mo.gov if an employee is terminated or resigns from employment with the Contractor. If the Contractor does not anticipate performing work on a State contract in the future, the Contractor may request that FMDC remove its employees from the Rap Back programs. However, if removed from the Rap Back programs, employees will be required to submit new fingerprints should the contractor be awarded another State contract.
8. Upon award of a Contract, the Contractor should contact FMDC at FMDCSecurity@oa.mo.gov to determine if its employees need to provide a new background check. If a Contractor's employee has previously submitted a fingerprint background check to FMDC as part of the Missouri and National Rap Back programs, the employee may not need to submit another fingerprint search for a period of three to six years, depending upon the circumstances. The Contractor understands and agrees that FMDC may require more frequent background checks without providing any explanation to the Contractor. The fact that an additional background check is requested by FMDC does not indicate that the employee has a criminal record.

3.4 DISRUPTION OF UTILITIES

- A. The Contractor shall give a minimum of seventy-two (72) hours written notice to the Construction Representative and the Facility Representative before disconnecting electric, gas, water, fire protection, or sewer service to any building.
- B. The Contractor shall give a minimum of seventy-two (72) hours written notice to the Construction Representative and Facility Representative before closing any access drives, and shall make temporary access available, if possible. The Contractor shall not obstruct streets, walks, or parking.

END OF SECTION 013513.28

SECTION 015000 – CONSTRUCTION FACILITIES AND TEMPORARY CONTROLS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

1.2 SUMMARY

- A. This Section includes requirements for construction facilities and temporary controls including temporary utilities, support facilities, security, and protection.
- B. Temporary utilities include, but are not limited to, the following:
 - 1. Water service and distribution
 - 2. Temporary electric power and light
 - 3. Temporary heat
 - 4. Ventilation
 - 5. Telephone service
 - 6. Sanitary facilities, including drinking water
 - 7. Storm and sanitary sewer
- C. Support facilities include, but are not limited to, the following:
 - 1. Field offices and storage sheds
 - 2. Dewatering facilities and drains
 - 3. Temporary enclosures
 - 4. Hoists
 - 5. Waste disposal services
 - 6. Construction aids and miscellaneous services and facilities
- D. Security and protection facilities include, but are not limited to, to following:
 - 1. Temporary fire protection
 - 2. Barricades, warning signs, and lights
 - 3. Sidewalk bridge or enclosure fence for the site
 - 4. Environmental protection

1.3 SUBMITTALS

- A. Temporary Utilities: Submit reports of tests, inspections, meter readings, and similar procedures performed on temporary utilities.
- B. Implementation and Termination Schedule: Within (15) days of the date established for commencement of the Work, submit a schedule indicating implementation and termination of each temporary utility.

1.4 QUALITY ASSURANCE

- A. Regulations: Comply with industry standards and applicable laws and regulations including, but not limited to, the following:
 - 1. Building code requirements
 - 2. Health and safety regulations
 - 3. Utility company regulations
 - 4. Police, fire department, and rescue squad rules
 - 5. Environmental protection regulations
- B. Standards: Comply with NFPA 241 “Standard for Safeguarding Construction, Alterations, and Demolition Operations”. ANSI A10 Series standards for “Safety Requirements for Construction and Demolition”, and NECA Electrical Design Library “Temporary Electrical Facilities”.
 - 1. Electrical Service: Comply with NEMA, NECA, and UL standards and regulations for temporary electric service. Install service in compliance with NFPA 70 “National Electric Code”.
- C. Inspections: Arrange for authorities having jurisdiction to inspect and test each temporary utility before use. Obtain required certifications and permits.

1.5 PROJECT CONDITIONS

- A. Temporary Utilities: Prepare a schedule indicating dates for implementation and termination of each temporary utility. At the earliest feasible time, when acceptable to the Owner, change over from use of temporary service to use of permanent service.
- B. Conditions of Use: Keep temporary services and facilities clean and neat in appearance. Operate in a safe and efficient manner. Relocate temporary services and facilities as the Work progresses. Do not overload facilities or permit them to interfere with progress. Take necessary fire-prevention measures. Do not allow hazardous, dangerous, or unsanitary conditions, or public nuisances to develop or persist onsite.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. General: Provide new materials. If acceptable to the Designer, the Contractor may use undamaged, previously used materials in serviceable condition. Provide materials suitable for use intended.
- B. Tarpaulins: Provide waterproof, fire-resistant, UL-labeled tarpaulins with flame-spread rating of (15) or less. For temporary enclosures, provide translucent, nylon-reinforced laminated polyethylene or polyvinyl chloride, fire-retardant tarpaulins.
- C. Water: Provide potable water approved by local health authorities.
- D. Open-Mesh Fencing: Provide 0.120” (3mm) thick, galvanized 2” (50mm) chainlink fabric fencing 6’ (2m) high with galvanized steel pipe posts, 1½” (38mm) ID for line posts and 2½” (64mm) ID for corner posts.

2.2 EQUIPMENT

- A. General: Provide new equipment. If acceptable to the Designer, the Contractor may use undamaged, previously used equipment in serviceable condition. Provide equipment suitable for use intended.
- B. Water Hoses: Provide ¾" (19mm), heavy-duty, abrasion-resistant, flexible rubber hoses 100' (30m) long, with pressure rating greater than the maximum pressure of the water distribution system. Provide adjustable shutoff nozzles at hose discharge.
- C. Electrical Outlets: Provide properly configured, NEMA-polarized outlets to prevent insertion of 110 to 120V plugs into higher voltage outlets. Provide receptacle outlets equipped with ground-fault circuit interrupters, reset button, and pilot light for connection of power tools and equipment.
- D. Electrical Power Cords: Provide grounded extension cords. Use hard-service cords where exposed to abrasion and traffic. Provide waterproof connectors to connect separate lengths of electric cords if single lengths will not reach areas where construction activities are in progress. Do not exceed safe length-voltage rating.
- E. Lamps and Light Fixtures: Provide general service incandescent lamps of wattage required for adequate illumination. Provide guard cages or tempered-glass enclosures where exposed to breakage. Provide exterior fixture where exposed to moisture.
- F. Heating Units: Provide temporary heating units that have been tested and labeled by UL, FM, or another recognized trade association related to the type of fuel being consumed.
- G. Temporary Offices: Provide prefabricated or mobile units or similar job-built construction with lockable entrances, operable windows, and serviceable finishes. Provide heated and air-conditioned units on foundations adequate for normal loading.
- H. Temporary Toilet Units: Provide self-contained, single-occupant toilet units of the chemical, aerated re-circulation, or combustion type. Provide units properly vented and fully enclosed with a glass-fiber-reinforced polyester shell or similar nonabsorbent material.
- I. Fire Extinguishers: Provide hand-carried, portable, UL-rated, Class A fire extinguishers for temporary offices and similar spaces. In other locations, provide hand-carried, portable, UL-rated, Class ABC, dry-chemical extinguishers, or a combination of extinguishers of NFPA-recommended classes for the exposures.
 - 1. Comply with NFPA 10 and NFPA 241 for classification, extinguishing agent, and size required by location and class of fire exposure.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Use qualified personnel for installation of temporary facilities. Locate facilities where they will serve the Project adequately and result in minimum interference with performance of the Work. Relocate and modify facilities as required.

- B. Provide each Facility ready for use when needed to avoid delay. Maintain and modify as required. Do not remove until facilities are no longer needed or are replaced by authorized use of completed permanent facilities.

3.2 TEMPORARY UTILITY INSTALLATION

- A. Temporary Water Service: The Owner will provide water for construction purposes from the existing building system. All required temporary extensions shall be provided and removed by the Contractor. Connection points and methods of connection shall be designated and approved by the Construction Representative.
- B. Temporary Electric Power Service: The Owner will provide electric power for construction lighting and power tools. Contractors using such services shall pay all costs of temporary services, circuits, outlet, extensions, etc.
- C. Temporary Lighting: When overhead floor or roof deck has been installed, provide temporary lighting with local switching.
 - 1. Install and operate temporary lighting that will fulfill security and protection requirements without operating the entire system. Provide temporary lighting that will provide adequate illumination for construction operations and traffic conditions.
- D. Temporary Heating: Provide temporary heat required by construction activities for curing or drying of completed installations or for protection of installed construction from adverse effects of low temperatures or high humidity. Select safe equipment that will not have a harmful effect on completed installations or elements being installed. Coordinate ventilation requirements to produce the ambient condition required and minimize consumption of energy.
 - 1. Heating Facilities: Except where the Owner authorizes use of the permanent system, provide vented, self-contained, LP gas or fuel-oil heaters with individual space thermostatic control.
 - 2. Use of gasoline-burning space heaters, open flame, or salamander heating units is prohibited.
- E. Temporary Telephones: Provide temporary telephone service throughout the construction period for all personnel engaged in construction activities.
- F. Temporary Toilets: Install self-contained toilet units. Use of pit-type privies will not be permitted. Comply with regulations and health codes for the type, number, location, operation, and maintenance of fixtures and facilities. Install where facilities will best serve the Project's needs.
 - 1. Shield toilets to ensure privacy.
 - 2. Provide toilet tissue materials for each facility.
- G. Wash Facilities: Install wash facilities supplied with potable water at convenient locations for personnel involved in handling materials that require wash-up for a health and sanitary condition. Dispose of drainage properly. Supply cleaning compounds appropriate for each condition.
 - 1. Provide paper towels or similar disposable materials for each facility.
 - 2. Provide covered waste containers for used material.

- H. Drinking-Water Facilities: Provide containerized, tap-dispenser, bottled-water drinking-water units, including paper supply.
- I. Provide earthen embankments and similar barriers in and around excavations and subgrade construction, sufficient to prevent flooding by runoff of storm water from heavy rains.

3.3 SUPPORT FACILITIES INSTALLATION

- A. General: Locate field offices, storage sheds, and other temporary construction and support facilities for easy access.
 - 1. Maintain support facilities until near Substantial Completion. Remove prior to Substantial Completion. Personnel remaining after Substantial Completion will be permitted to use permanent facilities, under conditions acceptable to the Owner.
- B. Field Offices: Provide insulated, weathertight temporary offices of sufficient size to accommodate required office personnel at the Project site. Keep the office clean and orderly for use for small progress meetings.
- C. Storage Facilities: The Owner will provide storage onsite as designated by the Facility Representative or the Construction Representative. Areas for use by the Contractor for storage will be identified at the Pre-Bid Meeting.
- D. Construction Parking: Parking at the site will be provided in the areas designated at the Pre-Construction Meeting.
- E. Dewatering Facilities and Drains: For temporary drainage and dewatering facilities and operations not directly associated with construction activities included under individual Sections, comply with dewatering requirements of applicable Division 2 Sections. Where feasible, utilize the same facilities. Maintain the site, excavations, and construction free of water.
- F. Temporary Enclosures: Provide temporary enclosures for protection of construction, in progress and completed, from exposure, foul weather, other construction operations, and similar activities.
 - 1. Where heat is needed and the permanent building enclosure is not complete, provide temporary enclosures where there is no other provision for containment of heat. Coordinate enclosure with ventilating and materials drying or curing requirements to avoid dangerous conditions and effects.
 - 2. Install tarpaulins securely with incombustible wood framing and other materials. Close openings of 25SqFt (2.3SqM) or less with plywood or similar materials.
 - 3. Close openings through floor or roof decks and horizontal surfaces with load-bearing, wood-framed construction.
 - 4. Where temporary wood or plywood enclosure exceeds 100SqFt (9.2SqM) in area, use UL-labeled, fire-retardant-treated material for framing and main sheathing.
- G. Temporary Lifts and Hoists: Provide facilities for hoisting materials and employees. Truck cranes and similar devices used for hoisting materials are considered “tools and equipment” and not temporary facilities.

- H. Collection and Disposal of Waste: Collect waste from construction areas and elsewhere daily. Comply with requirements of NFPA 241 for removal of combustible waste material and debris. Enforce requirements strictly. Do not hold materials more than seven (7) days during normal weather or three (3) days when the temperature is expected to rise above 80°F (27°C). Handle hazardous, dangerous, or unsanitary waste materials separately from other waste by containerizing properly. Dispose of material lawfully.

3.4 SECURITY AND PROTECTION FACILITIES INSTALLATION

- A. Except for use of permanent fire protection as soon as available, do not change over from use of temporary security and protection facilities to permanent facilities until Substantial Completion, or longer, as requested by the Designer.
- B. Temporary Fire Protection: Until fire-protection needs are supplied by permanent facilities, install and maintain temporary fire-protection facilities of the types needed to protect against reasonable predictable and controllable fire losses. Comply with NFPA 10 “Standard for Portable Fire Extinguishers” and NFPA 241 “Standard for Safeguarding Construction, Alterations, and Demolition Operations”.
 - 1. Locate fire extinguishers where convenient and effective for their intended purpose, but not less than one (1) extinguisher on each floor at or near each usable stairwell.
 - 2. Store combustible materials in containers in fire-safe locations.
 - 3. Maintain unobstructed access to fire extinguishers, fire hydrants, temporary fire-protection facilities, stairways, and other access routes for fighting fires. Prohibit smoking in hazardous fire-exposure areas.
 - 4. Provide supervision of welding operations, combustion-type temporary heating units, and similar sources of fire ignition.
- C. Barricades, Warning Signs, and Lights: Comply with standards and code requirements for erection of structurally adequate barricades. Paint with appropriate colors, graphics, and warning signs to inform personnel and the public of the hazard being protected against. Where appropriate and needed, provide lighting including flashing red or amber lights.
- D. Enclosure Fence: Before excavation begins, install an enclosure fence with lockable entrance gates. Locate where indicated or enclose the entire site or the portion determined sufficient to accommodate construction operations. Install in a manner that will prevent people, dogs, and other animals from easily entering the site, except by the entrance gates.
 - 1. Provide open-mesh, chainlink fencing with posts set in a compacted mixture of gravel and earth.
- E. Security Enclosure and Lockup: Install substantial temporary enclosure of partially completed areas of construction. Provide locking entrances to prevent unauthorized entrance, vandalism, theft, and similar violations of security.
 - 1. Storage: Where materials and equipment must be stored and are of value or attractive for theft, provide a secure lockup. Enforce discipline in connection with the installation and release of material to minimize the opportunity for theft and vandalism.
- F. Environmental Protection: Provide protection, operate temporary facilities, and conduct construction in ways and by methods that comply with environmental regulations and

minimize the possibility that air, waterways, and subsoil might be contaminated or polluted or that other undesirable effects might result. Avoid use of tools and equipment that produce harmful noise. Restrict use of noisemaking tools and equipment to hours that will minimize complaints from persons or firms near the site.

3.5 OPERATION, TERMINATION AND REMOVAL

- A. Supervision: Enforce strict discipline in use of temporary facilities. Limit availability of temporary facilities to essential and intended uses to minimize waste and abuse.
- B. Maintenance: Maintain facilities in good operating condition until removal. Protect from damage by freezing temperatures and similar elements.
 - 1. Maintain operation of temporary enclosures, heating, cooling, humidity control, ventilation, and similar facilities on a 24-hour basis where required to achieve indicated results and to avoid possibility of damage.
 - 2. Protection: Prevent water-filled piping from freezing. Maintain markers for underground lines. Protect from damage during excavation operations.
- C. Termination and Removal: Unless the Designer requests that it be maintained longer, remove each temporary facility when the need has ended, when replaced by authorized use of a permanent facility, or no later than Substantial Completion. Complete or, if necessary, restore permanent construction that may have been delayed because of interference with the temporary facility. Repair damaged Work, clean exposed surfaces, and replace construction that cannot be satisfactorily repaired.
 - 1. Materials and facilities that constitute temporary facilities are the Contractor's property. The Owner reserves the right to take possession of project identification signs.
 - 2. Remove temporary paving not intended for or acceptable for integration into permanent paving. Where the area is intended for landscape development, remove soil and aggregate fill that do not comply with requirements for fill or subsoil in the area. Remove materials contaminated with road oil, asphalt and other petrochemical compounds, and other substances that might impair growth of plant materials or lawns. Repair or replace street paving, curbs, and sidewalks at the temporary entrances as required by the governing authority.
 - 3. At Substantial Completion, clean and renovate permanent facilities used during the construction period including, but not limited to, the following:
 - a. Replace air filters and clean inside of ductwork and housing.
 - b. Replace significantly worn parts and parts subject to unusual operating conditions.
 - c. Replace lamps burned out or noticeably dimmed by hours of use.

END OF SECTION 015000

SECTION 017400 – CLEANING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

1.2 SUMMARY

- A. This Section includes administrative and procedural requirements for cleaning during the Project.
- B. Environmental Requirements: Conduct cleaning and waste-disposal operations in compliance with local laws and ordinances. Comply fully with federal and local environmental and anti-pollution regulations.
 - 1. Do not dispose of volatile wastes such as mineral spirits, oil, or paint thinner in storm or sanitary drains.
 - 2. Burning or burying of debris, rubbish, or other waste material on the premises is not permitted.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Cleaning Agents: Use cleaning materials and agents recommended by the manufacturer or fabricator for the surface to be cleaned. Do not use cleaning agents that are potentially hazardous to health or property or that might damage finished surfaces.

PART 3 - EXECUTION

3.1 PROGRESS CLEANING

- A. General
 - 1. Retain all stored items in an orderly arrangement allowing maximum access, not impeding drainage or traffic, and providing the required protection of materials.
 - 2. Do not allow the accumulation of scrap, debris, waste material, and other items not required for construction of this Work.
 - 3. At least twice each month, and more often if necessary, completely remove all scrap, debris, and waste material from the jobsite.
 - 4. Provide adequate storage for all items awaiting removal from the jobsite, observing all requirements for fire protection and protection of the ecology.
- B. Site
 - 1. Daily, inspect the site and pick up all scrap, debris, and waste material. Remove all such items to the place designated for their storage.
 - 2. Weekly, inspect all arrangements of materials stored onsite. Re-stack, tidy, or otherwise service all material arrangements.
 - 3. Maintain the site in a neat and orderly condition at all times.

C. Structures

1. Daily, inspect the structures and pick up all scrap, debris, and waste material. Remove all such items to the place designated for their storage.
2. Weekly, sweep all interior spaces clean. "Clean" for the purposes of this paragraph, shall be interpreted as meaning free from dust and other material capable of being removed by use of reasonable effort and handheld broom.
3. In preparation for installation of succeeding materials, clean the structures or pertinent portions thereof to the degree of cleanliness recommended by the manufacturer of the succeeding material, using all equipment and materials required to achieve the required cleanliness.
4. Following the installation of finish floor materials, clean the finish floor daily while work is being performed in the space in which finish materials have been installed. "Clean" for the purposes of this subparagraph, shall be interpreted as meaning free from all foreign material which, in the opinion of the Construction Representative, may be injurious to the finish of the finish floor material.

3.2 FINAL CLEANING

- A. General: Provide final cleaning operations when indicated. Employ experienced workers or professional cleaners for final cleaning. Clean each surface or unit of Work to the condition expected from a commercial building cleaning and maintenance program. Comply with manufacturer's instructions.
- B. Complete the following cleaning operations before requesting inspection for certification of Substantial Completion for the entire Project or a portion of the Project.
1. Clean the Project Site, yard and grounds, in areas disturbed by construction activities including landscape development areas, of rubbish, waste material, litter, and foreign substances.
 2. Sweep paved areas broom clean. Rake grounds that are neither planted nor paved to a smooth, even-textured surface.
 3. Remove petrochemical spills, stains, and other foreign deposits.
 4. Remove tools, construction equipment, machinery, and surplus material from the site.
 5. Remove snow and ice to provide safe access to the building.
 6. Clean exposed exterior and interior hard-surfaced finishes to a dirt-free condition, free of stains, films, and similar foreign substances. Avoid disturbing natural weathering of exterior surfaces. Restore reflective surfaces to their original condition.
 7. Remove debris and surface dust from limited access spaces, including roofs, plenums, shafts, trenches, equipment vaults, manholes, attics, and similar spaces.
 8. Broom clean concrete floors in unoccupied spaces.
 9. Vacuum clean carpet and similar soft surfaces removing debris and excess nap. Shampoo, if required.

10. Clean transparent material, including mirrors and glass in doors and windows. Remove glazing compounds and other substances that are noticeable vision-obscuring materials. Replace chipped or broken glass and other damaged transparent materials. Polish mirrors and glass, taking care not to scratch surfaces.
 11. Remove labels that are not permanent labels.
 12. Touch up and otherwise repair and restore marred, exposed finishes and surfaces. Replace finishes and surfaces that cannot be satisfactorily repaired or restored or that already show evidence of repair or restoration.
 - a. Do not paint over “UL” and similar labels, including mechanical and electrical nameplates.
 13. Wipe surfaces of mechanical and electrical equipment, elevator equipment, and similar equipment. Remove excess lubrication, paint and mortar droppings, and other foreign substances.
 14. Clean plumbing fixtures to a sanitary condition free of stains, including stains resulting from water exposure.
 15. Replace disposable air filters and clean permanent air filters. Clean exposed surfaces of diffusers, registers, and grills.
 16. Clean ducts, blowers, and coils if units were operated without filters during construction
 17. Clean food-service equipment to a sanitary condition, ready and acceptable for its intended use.
 18. Clean light fixtures, lamps, globes, and reflectors to function with full efficiency. Replace burned-out bulbs and defective and noisy starters in fluorescent and mercury vapor fixtures.
 19. Leave the Project clean and ready for occupancy.
- C. Pest Control: Engage an experienced, licensed exterminator to make a final inspection and rid the Project of rodents, insects, and other pests. Comply with regulations of local authorities.
- D. Removal of Protection: Remove temporary protection and facilities installed during construction to protect previously completed installations during the remainder of the construction period.
- E. Compliances: Comply with governing regulations and safety standards for cleaning operations. Remove waste materials from the site and dispose of lawfully.
1. Where extra materials of value remain after Final Acceptance by the Owner, they become the Owner’s property.

END OF SECTION 017400

SECTION 033000 - CAST-IN-PLACE CONCRETE

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes cast-in-place concrete, including formwork, reinforcement, concrete materials, mixture design, placement procedures, and finishes.
- B. Related Sections:
 - 1. Division 31 Section "Earth Moving" for drainage fill under slabs-on-grade.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Design Mixtures: For each concrete mixture.
- C. Steel Reinforcement Shop Drawings: Placing drawings that detail fabrication, bending, and placement.

1.3 INFORMATIONAL SUBMITTALS

- A. Material certificates.
- B. Material test reports.
- C. Floor surface flatness and levelness measurements.

1.4 QUALITY ASSURANCE

- A. Manufacturer Qualifications: A firm experienced in manufacturing ready-mixed concrete products and that complies with ASTM C 94/C 94M requirements for production facilities and equipment.
 - 1. Manufacturer certified according to NRMCA's "Certification of Ready Mixed Concrete Production Facilities."
- B. Testing Agency Qualifications: An independent agency, acceptable to authorities having jurisdiction, qualified according to ASTM C 1077 and ASTM E 329 for testing indicated.
- C. ACI Publications: Comply with the following unless modified by requirements in the Contract Documents:
 - 1. ACI 301, "Specifications for Structural Concrete," Sections 1 through 5.
 - 2. ACI 117, "Specifications for Tolerances for Concrete Construction and Materials."
- D. Concrete Testing Service: Owner engage a qualified independent testing agency to perform material evaluation tests and to design concrete mixtures.
- E. Moisture Vapor Reduction Admixture Warranty
 - 1. Manufacturer's Warranty: Submit, for the owner's acceptance, the manufacturer's standard warranty document executed by an authorized company official. The

manufacturer's warranty is in addition to, and not a limitation of, other rights the Owner may have under provisions of the contract documents.

2. Warranty Period: Ten years commencing on the date of acceptance of the project by the Owner or Notice of Completion whichever is earliest.
 - a. Warranty Terms: Terms to include moisture related failures, including all finish floor materials and labor. Admixture warranty issued on completion of ASTM-D-5084 or ASTM-D-4263 test and results submitted to a Concure Systems Representative.

PART 2 - PRODUCTS

2.1 FORM-FACING MATERIALS

- A. Smooth-Formed Finished Concrete: Form-facing panels that will provide continuous, true, and smooth concrete surfaces. Furnish in largest practicable sizes to minimize number of joints.
- B. Rough-Formed Finished Concrete: Plywood, lumber, metal, or another approved material. Provide lumber dressed on at least two edges and one side for tight fit.

2.2 STEEL REINFORCEMENT

- A. Reinforcing Bars: ASTM A 615/A 615M, Grade 60 (Grade 420), deformed.
- B. Plain-Steel Welded Wire Reinforcement: ASTM A 185/A 185M, plain, fabricated from as-drawn steel wire into flat sheets.
- C. Deformed-Steel Welded Wire Reinforcement: ASTM A 497/A 497M, flat sheet.
- D. Bar Supports: Bolsters, chairs, spacers, and other devices for spacing, supporting, and fastening reinforcing bars and welded wire reinforcement in place. Manufacture bar supports from steel wire, plastic, or precast concrete according to CRSI's "Manual of Standard Practice.

2.3 CONCRETE MATERIALS

- A. Cementitious Material: Use the following cementitious materials, of the same type, brand, and source, throughout Project:
 1. Portland Cement: ASTM C 150 Type I/II, gray. Supplement with the following:
 - a. Fly Ash: ASTM C 618, Class F or C.
 - b. Ground Granulated Blast-Furnace Slag: ASTM C 989, Grade 100 or 120.
- B. Normal-Weight Aggregates: ASTM C 33, graded.
 1. Maximum Coarse-Aggregate Size: 1-1/2 inches (38 mm) nominal.
 2. Fine Aggregate: Free of materials with deleterious reactivity to alkali in cement.
- C. Water: ASTM C 94/C 94M and potable.

2.4 ADMIXTURES

- A. Chemical Admixtures: Provide admixtures certified by manufacturer to be compatible with other admixtures and that will not contribute water-soluble chloride ions exceeding those permitted in hardened concrete. Do not use calcium chloride or admixtures containing calcium chloride.
1. Water-Reducing Admixture: ASTM C 494/C 494M, Type A.
 2. Retarding Admixture: ASTM C 494/C 494M, Type B.
 3. Water-Reducing and Retarding Admixture: ASTM C 494/C 494M, Type D.
 4. High-Range, Water-Reducing Admixture: ASTM C 494/C 494M, Type F.
 5. High-Range, Water-Reducing and Retarding Admixture: ASTM C 494/C 494M, Type G.
 6. Plasticizing and Retarding Admixture: ASTM C 1017/C 1017M, Type II.
 7. Moisture Vapor Reduction Admixture:
 - a. Acceptable Products:
 - 1) Concure Systems
 - 2) Barrier One
 - 3) Vapor Lock 20/20

2.5 WATERSTOPS

- A. Self-Expanding Butyl Strip Waterstops: Manufactured rectangular or trapezoidal strip, butyl rubber with sodium bentonite or other hydrophilic polymers, for adhesive bonding to concrete, 3/4 by 1 inch (19 by 25 mm).
- B. Self-Expanding Rubber Strip Waterstops: Manufactured rectangular or trapezoidal strip, bentonite-free hydrophilic polymer modified chloroprene rubber, for adhesive bonding to concrete, 3/8 by 3/4 inch (10 by 19 mm).

2.6 VAPOR RETARDERS

- A. Sheet Vapor Retarder: ASTM E 1745, Class A. Include manufacturer's recommended adhesive or pressure-sensitive tape.

2.7 CURING MATERIALS

- A. Evaporation Retarder: Waterborne, monomolecular film forming, manufactured for application to fresh concrete.
- B. Absorptive Cover: AASHTO M 182, Class 2, burlap cloth made from jute or kenaf, weighing approximately 9 oz./sq. yd. (305 g/sq. m) when dry.
- C. Moisture-Retaining Cover: ASTM C 171, polyethylene film or white burlap-polyethylene sheet.
- D. Water: Potable.

- E. Clear, Waterborne, Membrane-Forming Curing Compound: ASTM C 309, Type 1, Class B, dissipating.
- F. Clear, Waterborne, Membrane-Forming Curing Compound: ASTM C 309, Type 1, Class B, nondissipating, certified by curing compound manufacturer to not interfere with bonding of floor covering.
- G. Clear, Solvent-Borne, Membrane-Forming Curing and Sealing Compound: ASTM C 1315, Type 1, Class A.
 - 1. VOC Content: Curing and sealing compounds shall have a VOC content of 200 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
- H. Clear, Waterborne, Membrane-Forming Curing and Sealing Compound: ASTM C 1315, Type 1, Class A.
 - 1. VOC Content: Curing and sealing compounds shall have a VOC content of 200 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

2.8 RELATED MATERIALS

- A. Expansion- and Isolation-Joint-Filler Strips: ASTM D 1751, asphalt-saturated cellulosic fiber or ASTM D 1752, cork or self-expanding cork.
- B. Moisture Vapor Reduction Crack Filler

2.9 CONCRETE MIXTURES

- A. Prepare design mixtures for each type and strength of concrete, proportioned on the basis of laboratory trial mixture or field test data, or both, according to ACI 301.
- B. Cementitious Materials: Use fly ash, pozzolan, ground granulated blast-furnace slag, and silica fume as needed to reduce the total amount of portland cement, which would otherwise be used, by not less than 20 percent.
- C. Admixtures: Use admixtures according to manufacturer's written instructions.
 - 1. Use water-reducing admixture in concrete, as required, for placement and workability.
- D. Proportion normal-weight concrete mixture as follows:
 - 1. Minimum Compressive Strength: As specified in drawings at 28 days.
 - 2. Maximum Water-Cementitious Materials Ratio: 0.50 – footings; 0.45 – all other mixes
 - 3. Slump Limit: 4 inches (125 mm) or 8 inches (200 mm) for concrete with verified slump of 2 to 4 inches (50 to 100 mm) before adding high-range water-reducing admixture or plasticizing admixture, plus or minus 1 inch (25 mm).
 - 4. Air Content: Do not allow air content of trowel-finished floors to exceed 3 percent.
 - 5. Admixtures: Add acceptable admixtures as recommended in ACI 211.1 and at rates recommended by manufacturer.
 - a. Add water vapor reducing admixture per manufacturers specified dosage rate to ready mix truck at the batch plant, or jobsite before discharge, mix rapidly for 7 minutes. (Follow Manufacturer's Instructions).

2.10 FABRICATING REINFORCEMENT

- A. Fabricate steel reinforcement according to CRSI's "Manual of Standard Practice."

2.11 CONCRETE MIXING

- A. Ready-Mixed Concrete: Measure, batch, mix, and deliver concrete according to ASTM C 94/C 94M and ASTM C 1116/C 1116M, and furnish batch ticket information.
 - 1. When air temperature is between 85 and 90 deg F (30 and 32 deg C), reduce mixing and delivery time from 1-1/2 hours to 75 minutes; when air temperature is above 90 deg F (32 deg C), reduce mixing and delivery time to 60 minutes.

PART 3 - EXECUTION

3.1 FORMWORK

- A. Design, erect, shore, brace, and maintain formwork, according to ACI 301, to support vertical, lateral, static, and dynamic loads, and construction loads that might be applied, until structure can support such loads.
- B. Construct formwork so concrete members and structures are of size, shape, alignment, elevation, and position indicated, within tolerance limits of ACI 117.
- C. Chamfer exterior corners and edges of permanently exposed concrete.

3.2 EMBEDDED ITEMS

- A. Place and secure anchorage devices and other embedded items required for adjoining work that is attached to or supported by cast-in-place concrete. Use setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.

3.3 VAPOR RETARDERS

- A. Sheet Vapor Retarders: Place, protect, and repair sheet vapor retarder according to ASTM E 1643 and manufacturer's written instructions.
 - 1. Lap joints 6 inches (150 mm) and seal with manufacturers recommended tape.

3.4 STEEL REINFORCEMENT

- A. General: Comply with CRSI's "Manual of Standard Practice" for placing reinforcement.
 - 1. Do not cut or puncture vapor retarder. Repair damage and reseal vapor retarder before placing concrete.

3.5 JOINTS

- A. General: Construct joints true to line with faces perpendicular to surface plane of concrete.

- B. Construction Joints: Install so strength and appearance of concrete are not impaired, at locations indicated or as approved by Architect.
- C. Contraction Joints in Slabs-on-Grade: Form weakened-plane contraction joints, sectioning concrete into areas as indicated. Construct contraction joints for a depth equal to at least one-fourth of concrete thickness as follows:
 - 1. Sawed Joints: Form contraction joints with power saws equipped with shatterproof abrasive or diamond-rimmed blades. Cut 1/8-inch- (3.2-mm-) wide joints into concrete when cutting action will not tear, abrade, or otherwise damage surface and before concrete develops random contraction cracks.
- D. Isolation Joints in Slabs-on-Grade: After removing formwork, install joint-filler strips at slab junctions with vertical surfaces, such as column pedestals, foundation walls, grade beams, and other locations, as indicated.
- E. Waterstops: Install in construction joints and at other joints indicated according to manufacturer's written instructions.

3.6 CONCRETE PLACEMENT

- A. Before placing concrete, verify that installation of formwork, reinforcement, and embedded items is complete and that required inspections have been performed.
- B. Deposit concrete continuously in one layer or in horizontal layers of such thickness that no new concrete will be placed on concrete that has hardened enough to cause seams or planes of weakness. If a section cannot be placed continuously, provide construction joints as indicated. Deposit concrete to avoid segregation.
 - 1. Consolidate placed concrete with mechanical vibrating equipment according to ACI 301.
- C. Cold-Weather Placement: Comply with ACI 306.1.
- D. Hot-Weather Placement: Comply with ACI 301.

3.7 FINISHING FORMED SURFACES

- A. Rough-Formed Finish: As-cast concrete texture imparted by form-facing material with tie holes and defects repaired and patched. Remove fins and other projections that exceed specified limits on formed-surface irregularities.
 - 1. Apply to concrete surfaces not exposed to public view.
- B. Smooth-Formed Finish: As-cast concrete texture imparted by form-facing material, arranged in an orderly and symmetrical manner with a minimum of seams. Repair and patch tie holes and defects. Remove fins and other projections that exceed specified limits on formed-surface irregularities.
 - 1. Apply to concrete surfaces exposed to public view.
- C. Related Unformed Surfaces: At tops of walls, horizontal offsets, and similar unformed surfaces adjacent to formed surfaces, strike off smooth and finish with a texture matching adjacent formed surfaces. Continue final surface treatment of formed surfaces uniformly across adjacent unformed surfaces unless otherwise indicated.

3.8 FINISHING FLOORS AND SLABS

- A. General: Comply with ACI 302.1R recommendations for screeding, restraightening, and finishing operations for concrete surfaces. Do not wet concrete surfaces.
- B. Trowel Finish: After applying float finish, apply first troweling and consolidate concrete by hand or power-driven trowel. Continue troweling passes and restraighten until surface is free of trowel marks and uniform in texture and appearance. Grind smooth any surface defects that would telegraph through applied coatings or floor coverings.
 - 1. Apply a trowel finish to surfaces exposed to view or to be covered with resilient flooring, carpet, ceramic or quarry tile set over a cleavage membrane, paint, or another thin-film-finish coating system.
 - 2. Finish and measure surface so gap at any point between concrete surface and an unlevelled, freestanding, 10-ft.- (3.05-m-) long straightedge resting on two high spots and placed anywhere on the surface does not exceed 1/8 inch (3.2 mm) at the gymnasium floor and 1/4" (6.4mm) at all other locations.

3.9 CONCRETE PROTECTING AND CURING

- A. General: Protect freshly placed concrete from premature drying and excessive cold or hot temperatures. Comply with ACI 306.1 for cold-weather protection and ACI 301 for hot-weather protection during curing.
- B. Evaporation Retarder: Apply evaporation retarder to unformed concrete surfaces if hot, dry, or windy conditions cause moisture loss approaching 0.2 lb/sq. ft. x h (1 kg/sq. m x h) before and during finishing operations. Apply according to manufacturer's written instructions after placing, screeding, and bull floating or darbying concrete, but before float finishing.
- C. Cure concrete according to ACI 308.1, by one or a combination of the following methods:
 - 1. Moisture Curing: Keep surfaces continuously moist for not less than seven days.
 - 2. Moisture-Retaining-Cover Curing: Cover concrete surfaces with moisture-retaining cover for curing concrete, placed in widest practicable width, with sides and ends lapped at least 12 inches (300 mm), and sealed by waterproof tape or adhesive. Cure for not less than seven days. Immediately repair any holes or tears during curing period using cover material and waterproof tape.
 - 3. Curing Compound: Apply uniformly in continuous operation by power spray or roller according to manufacturer's written instructions. Recoat areas subjected to heavy rainfall within three hours after initial application. Maintain continuity of coating and repair damage during curing period.
 - a. Removal: After curing period has elapsed, remove curing compound without damaging concrete surfaces by method recommended by curing compound manufacturer unless manufacturer certifies curing compound will not interfere with bonding of floor covering used on Project.
 - 4. Curing and Sealing Compound: Apply uniformly to floors and slabs indicated in a continuous operation by power spray or roller according to manufacturer's written instructions. Recoat areas subjected to heavy rainfall within three hours after initial application. Repeat process 24 hours later and apply a second coat. Maintain continuity of coating and repair damage during curing period.

3.10 CONCRETE SURFACE REPAIRS

- A. Defective Concrete: Repair and patch defective areas when approved by Architect. Remove and replace concrete that cannot be repaired and patched to Architect's approval.

3.11 FIELD QUALITY CONTROL

- A. Testing and Inspecting: Owner will engage a qualified testing and inspecting agency to perform field tests and inspections and prepare test reports.

END OF SECTION 033000

SECTION 042200 - CONCRETE UNIT MASONRY

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Concrete masonry units (CMU's).
 - 2. Decorative concrete masonry units.
 - 3. Steel reinforcing bars.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: For reinforcing steel. Detail bending and placement of unit masonry reinforcing bars. Comply with ACI 315, "Details and Detailing of Concrete Reinforcement." Show elevations of reinforced walls with embedded items and proposed expansion joint locations. Provide bracing/shoring diagrams signed and sealed by a professional engineer as required to meet OSHA requirements.
- C. Samples: For each type and color of exposed masonry unit and colored mortar.

1.3 INFORMATIONAL SUBMITTALS

- A. Material Certificates: For each type and size of product indicated. For masonry units include data on material properties.
- B. Mix Designs: For each type of mortar and grout. Include description of type and proportions of ingredients.
 - 1. Include test reports for mortar mixes required to comply with property specification. Test according to ASTM C 109/C 109M for compressive strength, ASTM C 1506 for water retention, and ASTM C 91 for air content.
 - 2. Include test reports, according to ASTM C 1019, for grout mixes required to comply with compressive strength requirement.

1.4 QUALITY ASSURANCE

- A. Masonry Standard: Comply with ACI 530.1/ASCE 6/TMS 602 unless modified by requirements in the Contract Documents.

1.5 PROJECT CONDITIONS

- A. Cold-Weather Requirements: Do not use frozen materials or materials mixed or coated with ice or frost. Do not build on frozen substrates. Remove and replace unit masonry damaged by frost or by freezing conditions. Comply with cold-weather construction requirements contained in ACI 530.1/ASCE 6/TMS 602.

- B. Hot-Weather Requirements: Comply with hot-weather construction requirements contained in ACI 530.1/ASCE 6/TMS 602.

PART 2 - PRODUCTS

2.1 MASONRY UNITS, GENERAL

- A. Defective Units: Referenced masonry unit standards may allow a certain percentage of units to contain chips, cracks, or other defects exceeding limits stated in the standard. Do not use units where such defects will be exposed in the completed Work.

2.2 CONCRETE MASONRY UNITS

- A. Shapes: Provide shapes indicated and for lintels, corners, jambs, sashes, movement joints, headers, bonding, and other special conditions.
- B. CMUs: ASTM C 90.
 - 1. Unit Compressive Strength: Provide units with minimum average net-area compressive strength as shown on the drawings.
 - 2. Density Classification: Normal weight unless otherwise indicated.
- C. Decorative CMUs: ASTM C 90.
 - 1. Unit Compressive Strength: Provide units with minimum average net-area compressive strength as shown on the drawings.
 - 2. Density Classification: Normal weight.
 - 3. Pattern and Texture:
 - a. Split-Face.
 - b. Color: Any manufacturer meeting the above requirements and able to match "Deep Burgundy" color as offered through Oldcastle/Echelon Masonry - Northfield West-Miller (Bonner Springs, KS).

2.3 MASONRY LINTELS

- A. General: Provide one of the following:
- B. Masonry Lintels: Prefabricated or built-in-place masonry lintels made from bond beam CMUs with reinforcing bars placed as indicated and filled with coarse grout or steel W-shape beams as indicated on the drawings.

2.4 MORTAR AND GROUT MATERIALS

- A. Portland Cement: ASTM C 150, Type I or II, except Type III may be used for cold-weather construction. Provide natural color or white cement as required to produce mortar color indicated.
- B. Hydrated Lime: ASTM C 207, Type S.
- C. Portland Cement-Lime Mix: Packaged blend of portland cement and hydrated lime containing no other ingredients.

- D. Masonry Cement: ASTM C 91.
1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Capital Materials Corporation; Flamingo Color Masonry Cement.
 - b. Cemex S.A.B. de C.V.; Citadel Type S or Dixie Type S or Victor Plastic Cement.
 - c. Essroc, Italcementi Group; Brixment or Velvet.
 - d. Holcim (US) Inc.; Mortamix Masonry Cement Rainbow, Mortamix Custom Buff Masonry Cement, or White Mortamix Masonry Cement.
 - e. Lafarge North America Inc.; Magnolia Masonry Cement or Lafarge Masonry Cement or Trinity White Masonry Cement.
 - f. Lehigh Cement Company; Lehigh Masonry Cement or Lehigh White Masonry Cement.
 - g. National Cement Company, Inc.; Coosa Masonry Cement.
- E. Mortar Cement: ASTM C 1329.
1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Lafarge North America Inc.; Lafarge Mortar Cement or Magnolia Superbond Mortar Cement.
- F. Mortar Pigments: Natural and synthetic iron oxides and chromium oxides, compounded for use in mortar mixes and complying with ASTM C 979. Use only pigments with a record of satisfactory performance in masonry mortar.
1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Davis Colors; True Tone Mortar Colors.
 - b. Lanxess Corporation; Bayferrox Iron Oxide Pigments.
 - c. Solomon Colors, Inc.; SGS Mortar Colors.
- G. Colored Cement Product: Packaged blend made from portland cement and hydrated lime, masonry cement or mortar cement and mortar pigments, all complying with specified requirements, and containing no other ingredients.
1. Products: Subject to compliance with requirements available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Colored Portland Cement-Lime Mix:
 - 1) Capital Materials Corporation; Riverton Portland Cement Lime Custom Color.
 - 2) Holcim (US) Inc.; Rainbow Mortamix Custom Color Cement/Lime.
 - 3) Lafarge North America Inc.; Eaglebond Portland & Lime.
 - 4) Lehigh Cement Company; Lehigh Custom Color Portland/Lime Cement.
 - b. Colored Masonry Cement:

- 1) Capital Materials Corporation; Flamingo Color Masonry Cement.
 - 2) Cemex S.A.B. de C.V.; Richcolor Masonry Cement.
 - 3) Essroc, Italcementi Group; Brixment-in-Color.
 - 4) Holcim (US) Inc.; Rainbow Mortamix Custom Color Masonry Cement.
 - 5) Lafarge North America Inc.; U.S. Cement Custom Color Masonry Cement.
 - 6) Lehigh Cement Company; Lehigh Custom Color Masonry Cement.
 - 7) National Cement Company, Inc.; Coosa Masonry Cement.
- H. Aggregate for Mortar: ASTM C 144.
1. For joints less than 1/4 inch (6 mm) thick, use aggregate graded with 100 percent passing the No. 16 (1.18-mm) sieve.
 2. White-Mortar Aggregates: Natural white sand or crushed white stone.
 3. Colored-Mortar Aggregates: Natural sand or crushed stone of color necessary to produce required mortar color.
- I. Aggregate for Grout: ASTM C 404.
- J. Cold-Weather Admixture: Nonchloride, noncorrosive, accelerating admixture complying with ASTM C 494/C 494M, Type C, and recommended by manufacturer for use in masonry mortar of composition indicated.
1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Euclid Chemical Company (The); Accelguard 80.
 - b. Grace Construction Products, W. R. Grace & Co. - Conn.; Morset.
 - c. Sonneborn Products, BASF Aktiengesellschaft; Trimix-NCA.
- K. Water-Repellent Admixture: Liquid water-repellent mortar admixture intended for use with CMUs, containing integral water repellent by same manufacturer.
1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. ACM Chemistries, Inc.; RainBloc for Mortar.
 - b. BASF Aktiengesellschaft; Rheopel Mortar Admixture.
 - c. Grace Construction Products, W. R. Grace & Co. - Conn.; Dry-Block Mortar Admixture.
- L. Water: Potable.

2.5 REINFORCEMENT

- A. Uncoated Steel Reinforcing Bars: ASTM A 615/A 615M or ASTM A 996/A 996M, Grade 60 (Grade 420).
- B. Masonry Joint Reinforcement, General: ASTM A 951/A 951M.
1. Interior Walls: Hot-dip galvanized, carbon steel.
 2. Exterior Walls: Hot-dip galvanized, carbon steel.
 3. Wire Size for Side Rods: 0.148-inch (3.77-mm) diameter.
 4. Wire Size for Cross Rods: 0.148-inch (3.77-mm) diameter.

5. Wire Size for Veneer Ties: 0.148-inch (3.77-mm) diameter.
6. Spacing of Cross Rods, Tabs, and Cross Ties: Not more than 16 inches (407 mm) o.c.
7. Provide in lengths of not less than 10 feet (3 m), with prefabricated corner and tee units.

2.6 TIES AND ANCHORS

- A. Materials: Provide ties and anchors specified in this article that are made from materials that comply with the following unless otherwise indicated.
 1. Hot-Dip Galvanized, Carbon-Steel Wire: ASTM A 82/A 82M; with ASTM A 153/A 153M, Class B-2 coating.
 2. Steel Sheet, Galvanized after Fabrication: ASTM A 1008/A 1008M, Commercial Steel, with ASTM A 153/A 153M, Class B coating.
 3. Steel Plates, Shapes, and Bars: ASTM A 36/A 36M.
- B. Rigid Anchors: Fabricate from steel bars 1-1/2 inches (38 mm) wide by 1/4 inch (6.35 mm) thick by 24 inches (610 mm) long, with ends turned up 2 inches (51 mm) or with cross pins unless otherwise indicated.
 1. Corrosion Protection: Hot-dip galvanized to comply with ASTM A 153/A 153M.
- C. Anchor Bolts: Headed steel bolts complying with ASTM A 307, Grade A (ASTM F 568M, Property Class 4.6); with ASTM A 563 (ASTM A 563M) hex nuts and, where indicated, flat washers; hot-dip galvanized to comply with ASTM A 153/A 153M, Class C; of dimensions indicated.

2.7 MISCELLANEOUS MASONRY ACCESSORIES

- A. Compressible Filler: Pre-molded filler strips complying with ASTM D 1056, Grade 2A1; compressible up to 35 percent; formulated from neoprene, urethane, or PVC.
- B. Preformed Control-Joint Gaskets: Made from styrene-butadiene-rubber compound, complying with ASTM D 2000, Designation M2AA-805 or PVC, complying with ASTM D 2287, Type PVC-65406 and designed to fit standard sash block and to maintain lateral stability in masonry wall; size and configuration as indicated.
- C. Bond-Breaker Strips: Asphalt-saturated, organic roofing felt complying with ASTM D 226, Type I (No. 15 asphalt felt).

2.8 MORTAR AND GROUT MIXES

- A. General: Do not use admixtures, including pigments, air-entraining agents, accelerators, retarders, water-repellent agents, antifreeze compounds, or other admixtures unless otherwise indicated.
 1. Do not use calcium chloride in mortar or grout.
 2. Use mortar cement mortar unless otherwise indicated.
 3. For exterior masonry, use mortar cement mortar.
 4. For reinforced masonry, use mortar cement mortar.
 5. Add cold-weather admixture (if used) at same rate for all mortar that will be exposed to view, regardless of weather conditions, to ensure that mortar color is consistent.

- B. Preblended, Dry Mortar Mix: Furnish dry mortar ingredients in form of a preblended mix. Measure quantities by weight to ensure accurate proportions, and thoroughly blend ingredients before delivering to Project site.
- C. Mortar for Unit Masonry: Comply with ASTM C 270, Proportion Specification. Provide the following types of mortar for applications stated unless another type is indicated.
 - 1. For masonry below grade or in contact with earth, use Type S.
 - 2. For reinforced masonry, use Type S.
 - 3. For mortar parge coats, use Type S.
 - 4. For exterior, above-grade, load-bearing and non-load-bearing walls and parapet walls; for interior load-bearing walls; for interior non-load-bearing partitions; and for other applications where another type is not indicated, use Type N.
 - 5. For interior non-load-bearing partitions, Type O may be used instead of Type N.
- D. Pigmented Mortar: Use colored cement product or select and proportion pigments with other ingredients to produce color required. Do not add pigments to colored cement products.
 - 1. Pigments shall not exceed 10 percent of portland cement by weight.
 - 2. Pigments shall not exceed 5 percent of mortar cement by weight.
 - 3. Application: Use pigmented mortar for exposed mortar joints with the following units:
 - a. Decorative CMUs.
- E. Colored-Aggregate Mortar: Produce required mortar color by using colored aggregates and natural color or white cement as necessary to produce required mortar color.
 - 1. Application: Use colored aggregate mortar for exposed mortar joints with the following units:
 - a. Decorative CMUs.
- F. Grout for Unit Masonry: Comply with ASTM C 476.
 - 1. Use grout of type indicated or, if not otherwise indicated, of type (fine or coarse) that will comply with Table 1.15.1 in ACI 530.1/ASCE 6/TMS 602 for dimensions of grout spaces and pour height.
 - 2. Proportion grout in accordance with ASTM C 476, paragraph 4.2.2 for specified 28-day compressive strength indicated on drawings.
 - 3. Provide grout with a slump of 8 to 11 inches (203 to 279 mm) as measured according to ASTM C 143/C 143M.

PART 3 - EXECUTION

3.1 TOLERANCES

- A. Dimensions and Locations of Elements:
 - 1. For dimensions in cross section or elevation do not vary by more than plus 1/2 inch (12 mm) or minus 1/4 inch (6 mm).
 - 2. For location of elements in plan do not vary from that indicated by more than plus or minus 1/2 inch (12 mm).

3. For location of elements in elevation do not vary from that indicated by more than plus or minus 1/4 inch (6 mm) in a story height or 1/2 inch (12 mm) total.
- B. Lines and Levels:
1. For bed joints and top surfaces of bearing walls do not vary from level by more than 1/4 inch in 10 feet (6 mm in 3 m), or 1/2 inch (12 mm) maximum.
 2. For conspicuous horizontal lines, such as lintels, sills, parapets, and reveals, do not vary from level by more than 1/8 inch in 10 feet (3 mm in 3 m), 1/4 inch in 20 feet (6 mm in 6 m), or 1/2 inch (12 mm) maximum.
 3. For vertical lines and surfaces do not vary from plumb by more than 1/4 inch in 10 feet (6 mm in 3 m), 3/8 inch in 20 feet (9 mm in 6 m), or 1/2 inch (12 mm) maximum.
 4. For conspicuous vertical lines, such as external corners, door jambs, reveals, and expansion and control joints, do not vary from plumb by more than 1/8 inch in 10 feet (3 mm in 3 m), 1/4 inch in 20 feet (6 mm in 6 m), or 1/2 inch (12 mm) maximum.
 5. For lines and surfaces do not vary from straight by more than 1/4 inch in 10 feet (6 mm in 3 m), 3/8 inch in 20 feet (9 mm in 6 m), or 1/2 inch (12 mm) maximum.
- C. Joints:
1. For bed joints, do not vary from thickness indicated by more than plus or minus 1/8 inch (3 mm), with a maximum thickness limited to 1/2 inch (12 mm).
 2. For head and collar joints, do not vary from thickness indicated by more than plus 3/8 inch (9 mm) or minus 1/4 inch (6 mm).
 3. For exposed head joints, do not vary from thickness indicated by more than plus or minus 1/8 inch (3 mm).

3.2 LAYING MASONRY WALLS

- A. Lay out walls in advance for accurate spacing of surface bond patterns with uniform joint thicknesses and for accurate location of openings, movement-type joints, returns, and offsets. Avoid using less-than-half-size units, particularly at corners, jambs, and, where possible, at other locations.
- B. Use full-size units without cutting if possible. If cutting is required to provide a continuous pattern or to fit adjoining construction, cut units with motor-driven saws; provide clean, sharp, unchipped edges. Allow units to dry before laying unless wetting of units is specified. Install cut units with cut surfaces and, where possible, cut edges concealed.
- C. Bond Pattern for Exposed Masonry: Unless otherwise indicated, lay exposed masonry in running bond; do not use units with less than nominal 4-inch (100-mm) horizontal face dimensions at corners or jambs.
- D. Built-in Work: As construction progresses, build in items specified in this and other Sections. Fill in solidly with masonry around built-in items.
- E. Where built-in items are to be embedded in cores of hollow masonry units, place a layer of metal lath, wire mesh, or plastic mesh in the joint below and rod mortar or grout into core.
- F. Fill cores in hollow CMUs with grout 24 inches (600 mm) under bearing plates, beams, lintels, posts, and similar items unless otherwise indicated.

3.3 MORTAR BEDDING AND JOINTING

- A. Lay hollow CMUs as follows:
 - 1. With face shells fully bedded in mortar and with head joints of depth equal to bed joints.
 - 2. With webs fully bedded in mortar in all courses of piers, columns, and pilasters.
 - 3. With webs fully bedded in mortar in grouted masonry, including starting course on footings.
 - 4. With entire units, including areas under cells, fully bedded in mortar at starting course on footings where cells are not grouted.
- B. Lay solid masonry units with completely filled bed and head joints; butter ends with sufficient mortar to fill head joints and shove into place. Do not deeply furrow bed joints or slush head joints.
- C. Tool exposed joints slightly concave when thumbprint hard, using a jointer larger than joint thickness unless otherwise indicated.
- D. Cut joints flush for masonry walls to receive plaster or other direct-applied finishes (other than paint) unless otherwise indicated.

3.4 MASONRY JOINT REINFORCEMENT

- A. General: Install entire length of longitudinal side rods in mortar with a minimum cover of 5/8 inch (16 mm) on exterior side of walls, 1/2 inch (13 mm) elsewhere. Lap reinforcement a minimum of 6 inches (150 mm).
 - 1. Space reinforcement not more than 16 inches (406 mm) o.c.
 - 2. Space reinforcement not more than 8 inches (203 mm) o.c. in foundation walls and parapet walls.
 - 3. Provide reinforcement not more than 8 inches (203 mm) above and below wall openings and extending 12 inches (305 mm) beyond openings in addition to continuous reinforcement.
- B. Interrupt joint reinforcement at control and expansion joints unless otherwise indicated.
- C. Provide continuity at wall intersections by using prefabricated T-shaped units.
- D. Provide continuity at corners by using prefabricated L-shaped units.

3.5 REINFORCED UNIT MASONRY INSTALLATION

- A. Temporary Formwork and Shores: Construct formwork and shores as needed to support reinforced masonry elements during construction.
 - 1. Construct formwork to provide shape, line, and dimensions of completed masonry as indicated. Make forms sufficiently tight to prevent leakage of mortar and grout. Brace, tie, and support forms to maintain position and shape during construction and curing of reinforced masonry.
 - 2. Do not remove forms and shores until reinforced masonry members have hardened sufficiently to carry their own weight and other loads that may be placed on them during construction.
- B. Placing Reinforcement: Comply with requirements in ACI 530.1/ASCE 6/TMS 602.

- C. Grouting: Do not place grout until entire height of masonry to be grouted has attained enough strength to resist grout pressure.
 - 1. Comply with requirements in ACI 530.1/ASCE 6/TMS 602 for cleanouts and for grout placement, including minimum grout space and maximum pour height.
 - 2. Limit height of vertical grout pours to not more than 60 inches (1520 mm)] [12.67 ft. (3.86 m).

3.6 PARGING

- A. Dampen masonry walls prior to parging.
- B. Scarify each parging coat to ensure full bond to subsequent coat.
- C. Parge masonry walls in two uniform coats of mortar to a total thickness of 3/4 inch (19 mm).
- D. Steel trowel surface smooth and flat with a maximum surface variation of 1/8 inch per foot (1 mm/m).
- E. Strike top edge of parging at 45 degrees.

3.7 FIELD QUALITY CONTROL

- A. Testing and Inspecting: Owner will engage special inspectors to perform tests and inspections and prepare reports. Allow inspectors access to scaffolding and work areas, as needed to perform tests and inspections. Retesting of materials that fail to meet specified requirements shall be done at Contractor's expense.
- B. Inspections: Level 1 special inspections according to the "International Building Code."
 - 1. Begin masonry construction only after inspectors have verified proportions of site-prepared mortar.
 - 2. Place grout only after inspectors have verified compliance of grout spaces and of grades, sizes, and locations of reinforcement.
 - 3. Place grout only after inspectors have verified proportions of site-prepared grout.
- C. Testing Prior to Construction: One set of tests.
- D. Testing Frequency: One set of tests for each 5000 sq. ft. (464 sq. m) of wall area or portion thereof.
- E. Concrete Masonry Unit Test: For each type of unit provided, according to ASTM C 140 for compressive strength.
- F. Mortar Aggregate Ratio Test (Proportion Specification): For each mix provided, according to ASTM C 780.
- G. Mortar Test (Property Specification): For each mix provided, according to ASTM C 780. Test mortar for compressive strength.
- H. Grout Test (Compressive Strength): For each mix provided, according to ASTM C 1019.

3.8 REPAIRING, POINTING, AND CLEANING

- A. In-Progress Cleaning: Clean unit masonry as work progresses by dry brushing to remove mortar fins and smears before tooling joints.
- B. Final Cleaning: After mortar is thoroughly set and cured, clean exposed masonry as follows:

1. Test cleaning methods on sample wall panel; leave one-half of panel uncleaned for comparison purposes.
2. Clean concrete masonry by cleaning method indicated in NCMA TEK 8-2A applicable to type of stain on exposed surfaces.

3.9 MASONRY WASTE DISPOSAL

- A. Excess Masonry Waste: Remove excess masonry waste, and legally dispose of off Owner's property.

END OF SECTION 042200

SECTION 05 5213 - PIPE AND TUBE RAILINGS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Guardrails.

1.02 RELATED REQUIREMENTS

- A. Section 09 9000 Painting and Coating.

1.03 REFERENCE STANDARDS

- A. ASTM A53/A53M - Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless; 2022.
- B. ASTM A123/A123M - Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products; 2017.
- C. ASTM A780/A780M - Standard Practice for Repair of Damaged and Uncoated Areas of Hot-Dip Galvanized Coatings; 2020.
- D. ASTM E935 - Standard Test Methods for Performance of Permanent Metal Railing Systems and Rails for Buildings; 2021.
- E. AWS A2.4 - Standard Symbols for Welding, Brazing, and Nondestructive Examination; 202
- F. AWS B2.1/B2.1M - Specification for Welding Procedure and Performance Qualification; 2021.
- G. SSPC-Paint 20 - Zinc-Rich Coating (Type I - Inorganic, and Type II - Organic); 2019.

1.04 SUBMITTALS

- A. See Division One for submittal procedures.
- B. Shop Drawings: Indicate profiles, sizes, connection attachments, anchorage, size and type of fasteners, and accessories.
 - 1. Indicate welded connections using standard AWS A2.4 welding symbols. Indicate net weld lengths.
 - 2. Include the design engineer's seal and signature on each sheet of shop drawings.
- C. Welders' Qualification Statement: Welders' certificates in accordance with AWS B2.1/B2.1M and dated within the previous 12 months.

1.05 QUALITY ASSURANCE

- A. Structural Designer Qualifications: Professional Structural Engineer experienced in design of this work and licensed in the State in which the Project is located.
- B. Welder Qualifications: Welding processes and welding operators qualified within previous 12 months.
- C. Fabricator Qualifications:
 - 1. A company specializing in manufacturing products specified in this section, with not less than five years of documented experience.

1.06 DELEGATED ENGINEERING REQUIREMENTS

- A. Contract Documents: Concept of work specified by this Section is expressed on Drawings and Specifications; however, they may not indicate or specify full extent of work required.

- B. Delegated Engineering Responsibility: Employ delegated engineering professional to provide engineering for each member and component of railing systems required to meet concept expressed in Contract Documents that includes, but is not limited to, following:
 - 1. Engineering to withstand structural design loads within limits and under conditions indicated, specified, or required, without material failure or permanent deformation of building structural frame or work specified according to following:
 - a. Applicable local building codes.
 - b. Criteria indicated in Contract Documents.
 - 2. Comprehensive engineering analysis indicating location, type, magnitude, and direction of loads imposed on building structure.
 - 3. Preparation of engineering calculations, shop drawings, and other submittals with professional seal affixed according to respective jurisdictional licensing requirements.

PART 2 PRODUCTS

2.01 RAILINGS - GENERAL REQUIREMENTS

- A. Design, fabricate, and test railing assemblies in accordance with the most stringent requirements of applicable local code.
- B. Distributed Loads: Design railing assembly, wall rails, and attachments to resist distributed force of 75 pounds per linear foot (1095 N/m) applied to the top of the assembly and in any direction, without damage or permanent set.
- C. Concentrated Loads: Design railing assembly, wall rails, and attachments to resist a concentrated force of 200 pounds (890 N) applied at any point on the top of the assembly and in any direction, without damage or permanent set.
- D. Allow for expansion and contraction of members and building movement without damage to connections or members.
- E. Dimensions: See drawings for configurations and heights.
- F. Provide anchors and other components as required to attach to structure, made of same materials as railing components unless otherwise indicated; where exposed fasteners are unavoidable provide flush countersunk fasteners.
- G. Provide welding fittings to join lengths, seal open ends, and conceal exposed mounting bolts and nuts, including but not limited to elbows, T-shapes, splice connectors, flanges, escutcheons, and wall brackets.

2.02 STEEL RAILING SYSTEM

- A. Steel Pipe: ASTM A53/A53M Grade B Schedule 40, galvanized finish.
- B. Welding Fittings: Factory- or shop-welded from matching pipe or tube; seams continuously welded; joints and seams ground smooth.
- C. Straight Splice Connectors: Steel concealed spigots.
- D. Galvanizing: In accordance with requirements of ASTM A123/A123M.
 - 1. Touch-Up Primer for Galvanized Surfaces: SSPC-Paint 20 Type I - Inorganic.

2.03 FABRICATION

- A. Accurately form components to suit specific project conditions and for proper connection to building structure.
- B. Fit and shop assemble components in largest practical sizes for delivery to site.

- C. Fabricate components with joints tightly fitted and secured. Provide spigots and sleeves to accommodate site assembly and installation.
- D. Welded Joints:
 - 1. Exterior Components: Continuously seal joined pieces by intermittent welds and plastic filler. Drill condensate drainage holes at bottom of members at locations that will not encourage water intrusion.
 - 2. Grind exposed joints flush and smooth with adjacent finish surface. Make exposed joints butt tight, flush, and hairline. Ease exposed edges to small uniform radius.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field conditions are acceptable and are ready to receive work.

3.02 INSTALLATION

- A. Install components plumb and level, accurately fitted, free from distortion or defects, with tight joints.
- B. Anchor railings securely to structure.
- C. Conceal anchor bolts and screws whenever possible. Where not concealed, use flush countersunk fastenings.

3.03 TOLERANCES

- A. Maximum Variation From Plumb: 1/4 inch (6 mm) per floor level, non-cumulative.
- B. Maximum Offset From True Alignment: 1/4 inch (6 mm).
- C. Maximum Out-of-Position: 1/4 inch (6 mm).

END OF SECTION 05 5213

SECTION 061000 - ROUGH CARPENTRY

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
1. Framing with dimension lumber.
 2. Framing with engineered wood products.
 3. Shear wall panels.
 4. Rooftop equipment bases and support curbs.
 5. Wood blocking, cants, and nailers.
 6. Wood furring and grounds.
 7. Wood sleepers.
 8. Plywood backing panels.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of process and factory-fabricated product.
1. Include data for wood-preservative treatment from chemical treatment manufacturer and certification by treating plant that treated materials comply with requirements
 2. Include data for fire-retardant treatment from chemical treatment manufacturer and certification by treating plant that treated materials comply with requirements.

1.3 INFORMATIONAL SUBMITTALS

- A. Material Certificates: For dimension lumber specified to comply with minimum allowable unit stresses. Indicate species and grade selected for each use and design values approved by the ALSC Board of Review.
- B. Evaluation Reports: For the following, from ICC-ES:
1. Wood-preservative-treated wood.
 2. Fire-retardant-treated wood.
 3. Engineered wood products.
 4. Shear panels.
 5. Power-driven fasteners.
 6. Powder-actuated fasteners.
 7. Expansion anchors.
 8. Metal framing anchors.

PART 2 - PRODUCTS

2.1 WOOD PRODUCTS, GENERAL

- A. Certified Wood: Materials shall be produced from wood obtained from forests certified by an FSC-accredited certification body to comply with FSC STD-01-001, "FSC Principles and Criteria for Forest Stewardship for the following:
 - 1. Dimension lumber framing.
 - 2. Laminated-veneer lumber.
 - 3. Parallel-strand lumber.
 - 4. Prefabricated wood I-joists.
 - 5. Rim boards.
 - 6. Miscellaneous lumber.
- B. Lumber: DOC PS 20 and applicable rules of grading agencies indicated. If no grading agency is indicated, provide lumber that complies with the applicable rules of any rules-writing agency certified by the ALSC Board of Review. Provide lumber graded by an agency certified by the ALSC Board of Review to inspect and grade lumber under the rules indicated.
 - 1. Factory mark each piece of lumber with grade stamp of grading agency.
 - 2. For exposed lumber indicated to receive a stained or natural finish, mark grade stamp on end or back of each piece.
 - 3. Provide dressed lumber, S4S, unless otherwise indicated.
- C. Maximum Moisture Content of Lumber: 19 percent unless otherwise indicated.
- D. Engineered Wood Products: Provide engineered wood products acceptable to authorities having jurisdiction and for which current model code research or evaluation reports exist that show compliance with building code in effect for Project.
 - 1. Allowable Design Stresses: Provide engineered wood products with allowable design stresses, as published by manufacturer, that meet or exceed those indicated. Manufacturer's published values shall be determined from empirical data or by ratiom engineering analysis and demonstrated by comprehensive testing performed by a qualified independent testing agency.

2.2 WOOD-PRESERVATIVE-TREATED LUMBER

- A. Preservative Treatment by Pressure Process: AWWA U1; Use Category UC2 for interior construction not in contact with the ground, Use Category UC3b for exterior construction not in contact with the ground, and Use Category UC4a for items in contact with the ground.
 - 1. Preservative Chemicals: Acceptable to authorities having jurisdiction and containing no arsenic or chromium. Do not use inorganic boron (SBX) for sill plates.
- B. Kiln-dry lumber after treatment to a maximum moisture content of 19 percent. Do not use material that is warped or that does not comply with requirements for untreated material.
- C. Mark lumber with treatment quality mark of an inspection agency approved by the ALSC Board of Review.
- D. Application: Treat items indicated on Drawings, and the following:

1. Wood cants, nailers, curbs, equipment support bases, blocking, stripping, and similar members in connection with roofing, flashing, vapor barriers, and waterproofing.
2. Wood sills, sleepers, blocking, furring, stripping, and similar concealed members in contact with masonry or concrete.
3. Wood framing and furring attached directly to the interior of below-grade exterior masonry or concrete walls.
4. Wood framing members that are less than 18 inches (460 mm) above the ground in crawlspaces or unexcavated areas.
5. Wood floor plates that are installed over concrete slabs-on-grade.

2.3 FIRE-RETARDANT-TREATED MATERIALS

- A. General: Where fire-retardant-treated materials are indicated, use materials complying with requirements in this article, that are acceptable to authorities having jurisdiction, and with fire-test-response characteristics specified as determined by testing identical products per test method indicated by a qualified testing agency.
- B. Fire-Retardant-Treated Lumber and Plywood by Pressure Process: Products with a flame spread index of 25 or less when tested according to ASTM E 84, and with no evidence of significant progressive combustion when the test is extended an additional 20 minutes, and with the flame front not extending more than 10.5 feet (3.2 m) beyond the centerline of the burners at any time during the test.
 1. Exterior Type: Treated materials shall comply with requirements specified above for fire-retardant-treated lumber and plywood by pressure process after being subjected to accelerated weathering according to ASTM D 2898. Use for exterior locations and where indicated.
 2. Interior Type A: Treated materials shall have a moisture content of 28 percent or less when tested according to ASTM D 3201 at 92 percent relative humidity. Use where exterior type is not indicated.
- C. Kiln-dry lumber after treatment to a maximum moisture content of 19 percent. Kiln-dry plywood after treatment to a maximum moisture content of 15 percent.
- D. Identify fire-retardant-treated wood with appropriate classification marking of qualified testing agency.
- E. Application: Treat items indicated on Drawings, and the following:
 1. Framing for raised platforms.
 2. Framing for stages.
 3. Concealed blocking.
 4. Framing for non-load-bearing partitions.
 5. Framing for non-load-bearing exterior walls.
 6. Roof construction.
 7. Plywood backing panels.

2.4 DIMENSION LUMBER FRAMING

- A. Non-Load-Bearing Interior Partitions: Standard, Stud, or No. 3 grade.
 1. Application: Interior partitions not indicated as load-bearing.
 2. Species:
 - a. Mixed southern pine; SPIB.

- b. Northern species; NLGA.
 - c. Eastern softwoods; NeLMA.
 - d. Western woods; WCLIB or WWPA.
- B. Framing Other Than Non-Load-Bearing Interior Partitions: As shown on the drawings.
 - 1. Application: Framing other than interior partitions not indicated as load-bearing.
 - 2. Species:
 - a. Hem-fir (north); NLGA.
 - b. Southern pine; SPIB.
 - c. Douglas fir-larch; WCLIB or WWPA.
 - d. Mixed southern pine; SPIB.
 - e. Spruce-pine-fir; NLGA.
 - f. Douglas fir-south; WWPA.
 - g. Hem-fir; WCLIB or WWPA.
 - h. Douglas fir-larch (north); NLGA.
 - i. Spruce-pine-fir (south); NeLMA, WCLIB, or WWPA.
- C. Exposed Framing: Provide material hand-selected for uniformity of appearance and freedom from characteristics, on exposed surfaces and edges, that would impair finish appearance, including decay, honeycomb, knot-holes, shake, splits, torn grain, and wane.
 - 1. Application: Exposed exterior and interior framing indicated to receive a stained or natural finish.
 - 2. Species and Grade: As indicated above for load-bearing construction of same type.

2.5 ENGINEERED WOOD PRODUCTS

- A. Engineered Wood Products, General: Products shall comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."
- B. Laminated-Veneer Lumber: Structural composite lumber made from wood veneers with grain primarily parallel to member lengths, evaluated and monitored according to ASTM D 5456 and manufactured with an exterior-type adhesive complying with ASTM D 2559.
 - 1. Extreme Fiber Stress in Bending, Edgewise: As shown on drawings.
 - 2. Modulus of Elasticity, Edgewise: As shown on drawings.
- C. Wood I-Joists: Prefabricated units, I-shaped in cross section, made with solid or structural composite lumber flanges and wood-based structural panel webs, let into and bonded to flanges. Provide units complying with material requirements of and with structural capacities established and monitored according to ASTM D 5055.
 - 1. Web Material: Either oriented strand board or plywood, complying with DOC PS 1 or DOC PS 2, Exposure.
 - 2. Structural Properties: Provide units with depths and design values not less than those indicated.

3. Provide units complying with APA PRI-400, factory marked with APA trademark indicating nominal joist depth, joist class, span ratings, mill identification, and compliance with APA standard.
- D. Rim Boards: Product designed to be used as a load-bearing member and to brace wood I-joists at bearing ends, complying with research/evaluation report for I-joists.
1. Material: Product made from any combination solid lumber, wood strands, and veneers.
 2. Thickness: 1-1/4 inches (32 mm).
 3. Provide performance-rated product complying with APA PRR-401, rim board grade, factory marked with APA trademark indicating thickness, grade, and compliance with APA standard.

2.6 SHEAR WALL PANELS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
- B. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
1. Shear Transfer Systems.
 2. Simpson Strong-Tie Co., Inc.
 3. Weyerhaeuser Company.
Wood-Framed Shear Wall Panels: Prefabricated assembly consisting of wood perimeter framing, tie downs, and Exposure I, Structural I plywood or OSB sheathing.
 4. Products shall comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."
- C. Steel-Framed Shear Wall Panels: Prefabricated assembly consisting of cold-formed galvanized steel panel, steel top and bottom plates, and wood studs.
- D. Allowable Design Loads: Provide products with allowable design loads, as published by manufacturer, that meet or exceed those indicated. Manufacturer's published values shall be determined from empirical data or by rational engineering analysis and demonstrated by comprehensive testing performed by a qualified independent testing agency.

2.7 MISCELLANEOUS LUMBER

- A. General: Provide miscellaneous lumber indicated and lumber for support or attachment of other construction, including the following:
1. Blocking.
 2. Nailers.
 3. Rooftop equipment bases and support curbs.
 4. Cants.
 5. Furring.
 6. Grounds.

- B. For items of dimension lumber size, provide Standard, Stud, or No. 3 grade lumber of any species.
- C. For concealed boards, provide lumber with 19 percent maximum moisture content and any of the following species and grades:
 1. Mixed southern pine; No. 2 grade; SPIB.
 2. Eastern softwoods; No. 2 Common grade; NeLMA.
 3. Northern species; No. 2 Common grade; NLGA.
 4. Western woods; Construction or No. 2 Common; WCLIB or WWPA.

2.8 PLYWOOD BACKING PANELS

- A. Equipment Backing Panels: DOC PS 1, Exterior, AC in thickness indicated or, if not indicated, not less than 1/2-inch (13-mm) nominal thickness.
 1. Plywood shall comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."

2.9 FASTENERS

- A. General: Provide fasteners of size and type indicated that comply with requirements specified in this article for material and manufacture.
 1. Where rough carpentry is exposed to weather, in ground contact, pressure-preservative treated, or in area of high relative humidity, provide fasteners with hot-dip zinc coating complying with ASTM A 153/A 153M or Type 304 stainless steel.
- B. Power-Driven Fasteners: NES NER-272.
- C. Bolts: Steel bolts complying with ASTM A 307, Grade A (ASTM F 568M, Property Class 4.6); with ASTM A 563 (ASTM A 563M) hex nuts and, where indicated, flat washers.

2.10 METAL FRAMING ANCHORS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
- B. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 1. Cleveland Steel Specialty Co.
 2. KC Metals Products, Inc.
 3. Phoenix Metal Products, Inc.
 4. Simpson Strong-Tie Co., Inc.
 5. USP Structural Connectors.
- C. Allowable Design Loads: Provide products with allowable design loads, as published by manufacturer, that meet or exceed those indicated. Manufacturer's published values shall be determined from empirical data or by rational engineering analysis and demonstrated by comprehensive testing performed by a qualified independent testing agency.
- D. Galvanized-Steel Sheet: Hot-dip, zinc-coated steel sheet complying with ASTM A 653/A 653M, G60 (Z180) coating designation.

1. Use for interior locations unless otherwise indicated.
- E. Hot-Dip, Heavy-Galvanized Steel Sheet: ASTM A 653/A 653M; structural steel (SS), high-strength low-alloy steel Type A (HSLAS Type A), or high-strength low-alloy steel Type B (HSLAS Type B); G185 (Z550) coating designation; and not less than 0.036 inch (0.9 mm) thick.
1. Use for wood-preservative-treated lumber and where indicated.

2.11 MISCELLANEOUS MATERIALS

- A. Sill-Sealer Gaskets: Glass-fiber-resilient insulation, fabricated in strip form, for use as a sill sealer; 1-inch (25-mm) nominal thickness, compressible to 1/32 inch (0.8 mm); selected from manufacturer's standard widths to suit width of sill members indicated.
- B. Sill-Sealer Gaskets: Closed-cell neoprene foam, 1/4 inch (6.4 mm) thick, selected from manufacturer's standard widths to suit width of sill members indicated.
- C. Flexible Flashing: Composite, self-adhesive, flashing product consisting of a pliable, butyl rubber or rubberized-asphalt compound, bonded to a high-density polyethylene film, aluminum foil, or spunbonded polyolefin to produce an overall thickness of not less than 0.025 inch (0.6 mm).

PART 3 - EXECUTION

3.1 INSTALLATION, GENERAL

- A. Set rough carpentry to required levels and lines, with members plumb, true to line, cut, and fitted. Fit rough carpentry to other construction; scribe and cope as needed for accurate fit. Locate furring, nailers, blocking, grounds, and similar supports to comply with requirements for attaching other construction.
- B. Framing Standard: Comply with AF&PA's WCD 1, "Details for Conventional Wood Frame Construction," unless otherwise indicated.
- C. Framing with Engineered Wood Products: Install engineered wood products to comply with manufacturer's written instructions.
- D. Install fire-retardant treated plywood backing panels with classification marking of testing agency exposed to view.
- E. Shear Wall Panels: Install shear wall panels to comply with manufacturer's written instructions.
- F. Metal Framing Anchors: Install metal framing anchors to comply with manufacturer's written instructions. Install fasteners through each fastener hole.
- G. Do not splice structural members between supports unless otherwise indicated.
- H. Comply with AWWPA M4 for applying field treatment to cut surfaces of preservative-treated lumber.
- I. Where wood-preservative-treated lumber is installed adjacent to metal decking, install continuous flexible flashing separator between wood and metal decking.
- J. Securely attach rough carpentry work to substrate by anchoring and fastening as indicated, complying with the following:
1. NES NER-272 for power-driven fasteners.
 2. Table 2304.9.1, "Fastening Schedule," in ICC's International Building Code.

3. Table R602.3(1), "Fastener Schedule for Structural Members," and Table R602.3(2), "Alternate Attachments," in ICC's International Residential Code for One- and Two-Family Dwellings.

3.2 PROTECTION

- A. Protect wood that has been treated with inorganic boron (SBX) from weather. If, despite protection, inorganic boron-treated wood becomes wet, apply EPA-registered borate treatment. Apply borate solution by spraying to comply with EPA-registered label.
- B. Protect rough carpentry from weather. If, despite protection, rough carpentry becomes sufficiently wet that moisture content exceeds that specified, apply EPA-registered borate treatment. Apply borate solution by spraying to comply with EPA-registered label.

END OF SECTION 061000

SECTION 061600 - SHEATHING

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Wall sheathing.
 - 2. Roof sheathing.
 - 3. Sheathing joint and penetration treatment.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of process and factory-fabricated product. Indicate component materials and dimensions and include construction and application details.
 - 1. Include data for wood-preservative treatment from chemical treatment manufacturer and certification by treating plant that treated plywood complies with requirements.
 - 2. Include data for fire-retardant treatment from chemical treatment manufacturer and certification by treating plant that treated plywood complies with requirements.

PART 2 - PRODUCTS

2.1 WOOD PANEL PRODUCTS

- A. Plywood: Either DOC PS 1 or DOC PS 2 unless otherwise indicated.
- B. Oriented Strand Board: DOC PS 2.

2.2 WALL SHEATHING

- A. Plywood Wall Sheathing: Exterior Exposure 1 sheathing.
- B. Oriented-Strand-Board Wall Sheathing: Exposure 1 sheathing.
- C. Glass-Mat Gypsum Sheathing: ASTM C 1177/1177M.
 - 1. Type and Thickness: Type X, 5/8 inch (15.9 mm) thick.

2.3 ROOF SHEATHING

- A. Plywood Roof Sheathing: Exterior, Exposure 1 sheathing.
- B. Oriented-Strand-Board Roof Sheathing: Exposure 1, sheathing.

2.4 FASTENERS

- A. General: Provide fasteners of size and type indicated that comply with requirements specified in this article for material and manufacture.
 - 1. For roof and wall sheathing, provide fasteners with hot-dip zinc coating complying with ASTM A 153/A 153M

B. SHEATHING JOINT-AND-PENETRATION TREATMENT MATERIALS

- 1. Sealant for Glass-Mat Gypsum Sheathing: Silicone emulsion sealant complying with ASTM C 834, compatible with sheathing tape and sheathing and recommended by tape and sheathing manufacturers for use with glass-fiber sheathing tape and for covering exposed fasteners.
 - a. Sheathing Tape: Self-adhering glass-fiber tape, minimum 2 inches (50 mm) wide, 10 by 10 or 10 by 20 threads/inch (390 by 390 or 390 by 780 threads/m), of type recommended by sheathing and tape manufacturers for use with silicone emulsion sealant in sealing joints in glass-mat gypsum sheathing and with a history of successful in-service use.

PART 3 - EXECUTION

3.1 INSTALLATION, GENERAL

- A. Do not use materials with defects that impair quality of sheathing or pieces that are too small to use with minimum number of joints or optimum joint arrangement. Arrange joints so that pieces do not span between fewer than three support members.
- B. Cut panels at penetrations, edges, and other obstructions of work; fit tightly against abutting construction unless otherwise indicated.
- C. Securely attach to substrate by fastening as indicated, complying with the following:
 - 1. NES NER-272 for power-driven fasteners.
 - 2. Table 2304.9.1, "Fastening Schedule," in ICC's "International Building Code."
 - 3. Table R602.3(1), "Fastener Schedule for Structural Members," and Table R602.3(2), "Alternate Attachments," in ICC's "International Residential Code for One- and Two-Family Dwellings."
- D. Coordinate wall and roof sheathing installation with flashing and joint-sealant installation so these materials are installed in sequence and manner that prevent exterior moisture from passing through completed assembly.
- E. Do not bridge building expansion joints; cut and space edges of panels to match spacing of structural support elements.

3.2 WOOD STRUCTURAL PANEL INSTALLATION

- A. General: Comply with applicable recommendations in APA Form No. E30, "Engineered Wood Construction Guide," for types of structural-use panels and applications indicated.
 - 1. Wall and Roof Sheathing:

- a. Nail to wood framing.
- b. Screw to cold-formed metal framing.
- c. Space panels 1/8 inch apart at edges and ends.

3.3 GYPSUM SHEATHING INSTALLATION

- A. Comply with GA-253 and with manufacturer's written instructions.
 1. Fasten gypsum sheathing to wood framing with nails or screws.
 2. Install panels with a 1/4-inch gap where they abut masonry or similar materials that might retain moisture, to prevent wicking.
- B. Apply fasteners so heads bear tightly against face of sheathing, but do not cut into facing.
- C. Horizontal Installation: Install sheathing with V-grooved edge down and tongue edge up. Interlock tongue with groove to bring long edges in contact with edges of adjacent panels without forcing. Abut ends over centers of studs, and stagger end joints of adjacent panels not less than one stud spacing. Attach at perimeter and within field of panel to each stud.
 1. Space fasteners approximately 8 inches o.c. and set back a minimum of 3/8 inch from edges and ends of panels.
 2. For sheathing under stucco cladding, panels may be initially tacked in place with screws if overlying self-furring metal lath is screw-attached through sheathing to studs immediately after sheathing is installed.
- D. Vertical Installation: Install vertical edges centered over studs. Abut ends and edges with those of adjacent panels. Attach at perimeter and within field of panel to each stud.
 1. Space fasteners approximately 8 inches o.c. and set back a minimum of 3/8 inch from edges and ends of panels.
 2. For sheathing under stucco cladding, panels may be initially tacked in place with screws if overlying self-furring metal lath is screw-attached through sheathing to studs immediately after sheathing is installed.
- E. Seal sheathing joints according to sheathing manufacturer's written instructions.
 1. Apply elastomeric sealant to joints and fasteners and trowel flat. Apply sufficient amount of sealant to completely cover joints and fasteners after troweling. Seal other penetrations and openings.
 2. Apply glass-fiber sheathing tape to glass-mat gypsum sheathing joints and apply and trowel sealant to embed entire face of tape in sealant. Apply sealant to exposed fasteners with a trowel so fasteners are completely covered. Seal other penetrations and openings.

END OF SECTION 061600

SECTION 061753 - SHOP-FABRICATED WOOD TRUSSES

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Wood roof trusses.
 - 2. Wood girder trusses.
 - 3. Wood truss bracing.
- B. Allowances: Provide wood truss bracing under the Metal-Plate-Connected Truss Bracing Allowance as specified in Division 01 Section "Allowances."

1.2 ACTION SUBMITTALS

- A. Product Data: For metal-plate connectors, metal truss accessories, and fasteners.
- B. Shop Drawings: Show fabrication and installation details for trusses.
 - 1. Show location, pitch, span, camber, configuration, and spacing for each type of truss required.
 - 2. Indicate sizes, stress grades, and species of lumber.
 - 3. Indicate locations of permanent bracing required to prevent buckling of individual truss members due to design loads.
 - 4. Indicate locations, sizes, and materials for permanent bracing required to prevent buckling of individual truss members due to design loads.
 - 5. Indicate type, size, material, finish, design values, orientation, and location of metal connector plates.
 - 6. Show splice details and bearing details.
- C. Delegated-Design Submittal: For metal-plate-connected wood trusses indicated to comply with performance requirements and design criteria, including analysis data signed and sealed by the qualified professional engineer responsible for their preparation.

1.3 INFORMATIONAL SUBMITTALS

- A. Product certificates.
- B. Evaluation Reports: For the following, from ICC-ES:
 - 1. Metal-plate connectors.
 - 2. Metal truss accessories.

1.4 QUALITY ASSURANCE

- A. Metal Connector-Plate Manufacturer Qualifications: A manufacturer that is a member of TPI and that complies with quality-control procedures in TPI 1 for manufacture of connector plates.

1. Manufacturer's responsibilities include providing professional engineering services needed to assume engineering responsibility.
2. Engineering Responsibility: Preparation of Shop Drawings and comprehensive engineering analysis by a qualified professional engineer.

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Handle and store trusses to comply with recommendations in TPI BCSI, "Building Component Safety Information: Guide to Good Practice for Handling, Installing, Restraining, & Bracing Metal Plate Connected Wood Trusses."

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Delegated Design: Engage a qualified professional engineer, as defined in Division 01 Section "Quality Requirements," to design metal-plate-connected wood trusses.
- B. Structural Performance: Provide metal-plate-connected wood trusses capable of withstanding design loads within limits and under conditions indicated. Comply with requirements in TPI 1 unless more stringent requirements are specified below.

2.2 DIMENSION LUMBER

- A. Certified Wood: For metal-plate-connected wood trusses and permanent bracing, provide materials produced from wood obtained from forests certified by an FSC-accredited certification body to comply with FSC STD-01-001, "FSC Principles and Criteria for Forest Stewardship."
- B. Lumber: DOC PS 20 and applicable rules of grading agencies indicated. If no grading agency is indicated, provide lumber that complies with the applicable rules of any rules writing agency certified by the ALSC Board of Review. Provide lumber graded by an agency certified by the ALSC Board of Review to inspect and grade lumber under the rules indicated.
 1. Provide dry lumber with 19 percent maximum moisture content at time of dressing.
- C. Permanent Bracing: Provide wood bracing that complies with requirements for miscellaneous lumber in Division 06 Section "Rough Carpentry."

2.3 METAL CONNECTOR PLATES

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 1. Alpine Engineered Products, Inc.; an ITW company.
 2. Cherokee Metal Products, Inc.; Masengill Machinery Company.
 3. CompuTrus, Inc.
 4. Eagle Metal Products.
 5. Jager Building Systems, Inc.; a Tembec/SGF Rexfor company.
 6. MiTek Industries, Inc.; a subsidiary of Berkshire Hathaway Inc.

7. Robbins Engineering, Inc.
 8. Truswal Systems Corporation; an ITW company.
- B. General: Fabricate connector plates to comply with TPI 1.
- C. Hot-Dip Galvanized-Steel Sheet: ASTM A 653/A 653M; Structural Steel (SS), high-strength low-alloy steel Type A (HSLAS Type A), or high-strength low-alloy steel Type B (HSLAS Type B); G60 (Z180) coating designation; and not less than 0.036 inch (0.9 mm) thick.

2.4 FASTENERS

- A. General: Provide fasteners of size and type indicated that comply with requirements specified in this article for material and manufacture.
1. Provide fasteners for use with metal framing anchors that comply with written recommendations of metal framing manufacturer.
 2. Where trusses are exposed to weather, in ground contact, made from pressure-preservative treated wood, or in area of high relative humidity, provide fasteners with hot-dip zinc coating complying with ASTM A 153/A 153M or of Type 304 stainless steel].

2.5 FABRICATION

- A. Assemble truss members in design configuration indicated; use jigs or other means to ensure uniformity and accuracy of assembly with joints closely fitted to comply with tolerances in TPI 1. Position members to produce design camber indicated.
1. Fabricate wood trusses within manufacturing tolerances in TPI 1.
- B. Connect truss members by metal connector plates located and securely embedded simultaneously in both sides of wood members by air or hydraulic press.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install wood trusses only after supporting construction is in place and is braced and secured.
- B. If trusses are delivered to Project site in more than one piece, assemble trusses before installing.
- C. Hoist trusses in place by lifting equipment suited to sizes and types of trusses required, exercising care not to damage truss members or joints by out-of-plane bending or other causes.
- D. Install and brace trusses according to TPI recommendations and as indicated.
- E. Anchor trusses securely at bearing points; use metal truss tie-downs or floor truss hangers as applicable. Install fasteners through each fastener hole in metal framing anchors according to manufacturer's fastening schedules and written instructions.
- F. Securely connect each truss ply required for forming built-up girder trusses.
- G. Install and fasten permanent bracing during truss erection and before construction loads are applied. Anchor ends of permanent bracing where terminating at walls or beams.
 1. Install bracing to comply with Division 06 Section "Rough Carpentry."

2. Install and fasten strongback bracing vertically against vertical web of parallel-chord floor trusses at centers indicated.
- H. Install wood trusses within installation tolerances in TPI 1.
 - I. Do not alter trusses in field. Do not cut, drill, notch, or remove truss members.
 - J. Replace wood trusses that are damaged or do not meet requirements.

END OF SECTION 061753

SECTION 06 8316 - FIBERGLASS REINFORCED PANELING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Fiberglass reinforced plastic panels.
- B. Trim.

1.02 REFERENCE STANDARDS

- A. ASTM D5319 - Standard Specification for Glass-Fiber Reinforced Polyester Wall and Ceiling Panels; 2022.
- B. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2023d.

1.03 SUBMITTALS

- A. See Division One for submittal procedures.
- B. Product Data: Provide data on specified products, describing physical and performance characteristics; including sizes, patterns and colors available; and installation instructions.

1.04 DELIVERY, STORAGE, AND HANDLING

- A. Store panels flat, indoors, on a clean, dry surface. Remove packaging and allow panels to acclimate to room temperature for 48 hours prior to installation.

PART 2 PRODUCTS

3.01 PANEL SYSTEMS

- A. Wall Panels:
 - 1. Panel Size: 4 by 8 feet (1.2 by 2.4 m).
 - 2. Panel Thickness: 0.10 inch (2.5 mm).
 - 3. Surface Design: Embossed.
 - 4. Color: White.
 - 5. Attachment Method: Adhesive only, with trim and sealant in joints.

3.02 MATERIALS

- A. Panels: Fiberglass reinforced plastic (FRP), complying with ASTM D5319.
 - 1. Surface Burning Characteristics: Maximum flame spread index of 25 and smoke developed index of 450; when system tested in accordance with ASTM E84.
- B. Trim: Aluminum; clear satin finish.
- C. Sealant: Type recommended by panel manufacturer; white.

PART 3 EXECUTION

5.01 EXAMINATION

- A. Verify existing conditions and substrate flatness before starting work.
- B. Verify that substrate conditions are ready to receive the work of this section.

5.02 INSTALLATION - WALLS

- A. Install panels in accordance with manufacturer's instructions.
- B. Cut and drill panels with carbide tipped saw blades, drill bits, or snips.
- C. Apply adhesive to the back side of the panel using trowel as recommended by adhesive manufacturer.
- D. Apply panels to wall with seams plumb and pattern aligned with adjoining panels.
- E. Install panels with manufacturer's recommended gap for panel field and corner joints.
- F. Place trim on panel before fastening edges, as required.
- G. Fill channels in trim with sealant before attaching to panel.
- H. Install trim with adhesive and screws or nails, as required.
- I. Seal gaps at floor, ceiling, and between panels with applicable sealant to prevent moisture intrusion.
- J. Remove excess sealant after paneling is installed and prior to curing.

END OF SECTION 06 8316

SECTION 07 3113 - ASPHALT SHINGLES

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Asphalt shingle roofing.
- B. Flexible sheet membranes for eave protection and underlayment.
- C. Associated metal flashings and accessories.

1.02 SUBMITTALS

- A. See Division One for submittal procedures.
- B. Product Data: Provide data indicating material characteristics.
- C. Samples: Submit two samples of each shingle color indicating color range and finish texture/pattern; for color selection.
- D. Manufacturer's Installation Instructions: Indicate installation criteria and procedures.
- E. Manufacturer's Certificate: Certify that products meet or exceed specified requirements.
- F. Warranty Documentation: Submit manufacturer warranty and ensure that forms have been completed in Owner's name and registered with manufacturer.

1.03 QUALITY ASSURANCE

- A. Products are Required to Comply with Fire Resistance Criteria: UL (DIR) listed and labeled.

1.04 FIELD CONDITIONS

- A. Do not install shingles when surface temperatures are below 45 degrees F.

1.05 WARRANTY

- A. Correct defective Work within a five-year period after Date of Substantial Completion.
- B. Provide lifetime manufacturer's warranty for coverage against black streaks caused by algae.
- C. Provide five-year manufacturer's warranty for wind damage.

PART 2 - PRODUCTS

2.01 MANUFACTURERS

- A. Asphalt Shingles:
 - 1. Basis of Design: Owens Corning Corp; TruDefinition Duration: www.owenscorning.com. Complete system with Eave/Rake Starter Strips and Ridge Cap Shingles.
 - 2. No substitutions allowed.

2.02 ASPHALT SHINGLES

- A. Asphalt Shingles: Asphalt-coated glass felt, mineral granule surfaced, complying with ASTM D3462/D3462M.
 - 1. Fire Resistance: Class A, complying with ASTM E108.
 - 2. Warranted Wind Speed: Not greater than 130 mph.
 - 3. Self-sealing type.
 - 4. Color: Chateau Green.

2.03 SHEET MATERIALS

- A. Eave, Ridge, and Hip Protection Membrane:
 - 1. Protection Membrane: Self-adhering polymer-modified asphalt sheet complying with ASTM D1970/D1970M; 40 mil total thickness; with strippable treated release paper and polyethylene sheet top surface.
 - 2. Compatible with Asphalt Shingle system.
- B. Underlayment: Synthetic non-asphaltic sheet, intended by manufacturer for mechanically fastened roofing underlayment without sealed seams.
 - 1. Minimum Requirements: Comply with requirements of ICC-ES AC188 for non-self-adhesive sheet.
 - 2. Self Sealability: Passing nail sealability test specified in ASTM D1970/D1970M.
 - 3. Flammability: Minimum of Class A, when tested in accordance with ASTM E108.
 - 4. Low Temperature Flexibility: Passing test specified in ASTM D1970/D1970M.
 - 5. Fasteners: As recommended by manufacturer or building code qualification report or approval.
 - 6. Compatible with Asphalt Shingle system.

2.04 ACCESSORIES

- A. Roofing Nails: Standard round wire shingle type, galvanized steel or stainless steel, minimum 3/8 inch head diameter, 12 gauge, 0.109 inch nail shank diameter, 1-1/2 inch long and complying with ASTM F1667.
- B. Plastic Cement: ASTM D4586/D4586M, asphalt roof cement.
- C. Lap Cement: Fibrated cutback asphalt type, recommended for use in application of underlayment, free of toxic solvents.
- D. Plastic Ridge Vents: Extruded plastic with vent openings that do not permit direct water or weather entry, flanged to receive shingles.

2.05 METAL FLASHINGS

- A. Metal Flashings: Provide sheet metal eave edge, gable edge, ridge, and other flashing indicated.
 - 1. Form flashings to protect roofing materials from physical damage and shed water.
 - 2. Form sections square and accurate to profile, in maximum possible lengths, free from distortion or defects detrimental to appearance or performance.
 - 3. Hem exposed edges of flashings minimum 1/4 inch on underside.
 - 4. Coat concealed surfaces of flashings with bituminous paint.
- B. Steel Sheet Metal: Prefinished and galvanized steel sheet, 26 gauge, 0.0179 inch minimum thickness, G90/Z275 hot-dipped galvanized; PVC coated, color as selected.
- C. Bituminous Paint: Acid and alkali resistant type; black color.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions prior to beginning work.
- B. Verify that roof deck is of sufficient thickness to accept fasteners.
- C. Verify that roof penetrations and plumbing stacks are in place and flashed to deck surface.
- D. Verify roof openings are correctly framed.
- E. Verify deck surfaces are dry, free of ridges, warps, or voids.

3.02 PREPARATION

- A. Seal roof deck joints wider than 1/16 inch as recommended by shingle manufacturer.
- B. At areas where eave protection membrane is to be adhered to substrate, fill knot holes and surface cracks with latex filler.
- C. Broom clean deck surfaces before installing underlayment or eave protection.
- D. Install eave edge flashings tight with fascia boards, weather lap joints 2 inches and seal with plastic cement, and secure flange with nails spaced 8 inches on center.

3.03 INSTALLATION - EAVE PROTECTION MEMBRANE

- A. Install eave protection membrane from eave edge to minimum 2 ft up-slope beyond interior face of exterior wall.
- B. Install eave protection membrane in accordance with manufacturer's instructions and NRCA (RM) applicable requirements.

3.04 INSTALLATION - UNDERLAYMENT

- A. Underlayment at Roof Slopes Greater Than 4:12: Install underlayment perpendicular to slope of roof, with ends and edges weather lapped minimum 4 inches, stagger end laps of each consecutive layer, nail in place, and weather lap minimum 4 inches over eave protection.
- B. Weather lap and seal watertight with plastic cement any items projecting through or mounted on roof.

3.05 INSTALLATION - METAL FLASHING AND ACCESSORIES

- A. Install flashings in accordance with manufacturer's instructions and NRCA (RM) applicable requirements.
- B. Weather lap joints minimum 2 inches and seal weather tight with plastic cement.
- C. Secure in place with nails at 16 inches on center and conceal fastenings.
- D. Items Projecting Through or Mounted on Roofing: Flash and seal weather tight with plastic cement.

3.06 INSTALLATION - SHINGLES

- A. Install shingles in accordance with manufacturer's instructions manufacturer's instructions and NRCA (RM) applicable requirements.
 - 1. Fasten individual shingles using two nails per shingle, or as required by manufacturer and local building code, whichever is greater.

2. Fasten strip shingles using four nails per strip, or as required by manufacturer and local building code, whichever is greater.
- B. Place shingles in straight coursing pattern with 5-inch weather exposure to produce double thickness over full roof area, and provide double course of shingles at eaves.
- C. Project first course of shingles 3/4 inch beyond fascia boards.
- D. Extend shingles 1/2 inch beyond face of gable edge fascia boards.
- E. Coordinate installation of roof mounted components or work projecting through roof with weather tight placement of counterflashings.
- F. Complete installation to provide weather tight service.

3.07 PROTECTION

- A. Do not permit traffic over finished roof surface.

END OF SECTION 073113

SECTION 07 4113 - ALTERNATE 4: METAL ROOF PANELS

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. **ALTERNATE 4:** Architectural roofing system of preformed steel panels.

1.02 SUBMITTALS

- A. See Division One for submittal procedures.
- B. Product Data: Manufacturer's data sheets on each product to be used, including:
 - 1. Storage and handling requirements and recommendations.
 - 2. Installation methods.
 - 3. Specimen warranty.
- C. Shop Drawings: Include layouts of roof panels, details of edge and penetration conditions, spacing and type of connections, flashings, underlayments, and special conditions.
 - 1. Show work to be field-fabricated or field-assembled.
- D. Selection Samples: For each roofing system specified, submit color chips representing manufacturer's full range of available colors and patterns.
- E. Warranty: Submit specified manufacturer's warranty and ensure that forms have been completed in Owner's name and are registered with manufacturer.

1.03 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing products specified in this section, with not less than three years of documented experience.
- B. Installer Qualifications: Company specializing in performing work of the type specified and with at least three years of documented experience.

1.04 DELIVERY, STORAGE, AND HANDLING

- A. Provide strippable plastic protection on pre-finished roofing panels for removal after installation.
- B. Store roofing panels on project site as recommended by manufacturer to minimize damage to panels prior to installation.

1.05 WARRANTY

- A. Finish Warranty: Provide manufacturer's special warranty covering failure of factory-applied exterior finish on metal roof panels and agreeing to repair or replace panels that show evidence of finish degradation, including significant fading, chalking, cracking, or peeling within specified warranty period of twenty years from Date of Substantial Completion.

PART 2 - PRODUCTS

2.01 MANUFACTURERS

- A. Basis of Design:
 - 1. Architectural Metal Roof Panels: TEE Panel manufactured by Berridge Manufacturing Company.

- B. Other Acceptable Manufacturers; Architectural Metal Roof Panels:
 - 1. Morin Corporation: www.morincorp.com.
 - 2. Petersen Aluminum Corporation: www.pac-clad.com.
 - 3. Substitutions: See Division One.

2.02 ARCHITECTURAL METAL ROOF PANELS

- A. Architectural Metal Roof Panels: Provide complete engineered system complying with specified requirements and capable of remaining weather-tight while withstanding anticipated movement of substrate and thermally induced movement of roofing system.
- B. Architectural Metal Panels: Factory-formed panels with factory-applied finish.
 - 1. Steel Panels:
 - a. Steel Thickness: Minimum 24 gauge (0.024 inch).
 - 2. Profile: Standing seam, with minimum 1.0 inch seam height; concealed fastener system for snap-on application of matching standing seam batten.
 - 3. Texture: Smooth.
 - 4. Length: Full length of roof slope, without lapped horizontal joints.
 - 5. Width: Maximum panel coverage of 12-3/4 inches.

2.03 ATTACHMENT SYSTEM

- A. Concealed System: Provide manufacturer's standard steel concealed anchor clips designed for specific roofing system and engineered to meet performance requirements, including anticipated thermal movement.

2.04 FABRICATION

- A. Panels: Provide factory or field fabricated panels with applied finish and accessory items, using manufacturer's standard processes as required to achieve specified appearance and performance requirements.
- B. Joints: Provide captive gaskets, sealants, or separator strips at panel joints to ensure weathertight seals, eliminate metal-to-metal contact, and minimize noise from panel movements.

2.05 FINISHES

- A. Fluoropolymer Coil Coating System: Polyvinylidene fluoride (PVDF) multi-coat superior performing organic coatings system complying with AAMA 2605, including at least 70 percent PVDF resin, and at least 80 percent of coil coated aluminum surfaces having minimum total dry film thickness (DFT) of 0.9 mil, 0.0009 inch; color and gloss as selected by Architect from manufacturer's standard line.

2.06 ACCESSORIES

- A. Miscellaneous Sheet Metal Items: Provide flashings, trim, and closure strips of the same material, thickness, and finish as used for the roofing panels. Items completely concealed after installation may optionally be made of stainless steel.
- B. Rib and Ridge Closures: Provide prefabricated, close-fitting components of steel with corrosion resistant finish or combination steel and closed-cell foam.
- C. Sealants:
 - 1. Exposed Sealant: See Section 07 9200.
 - 2. Concealed Sealant: See Section 07 9200.
 - 3. Seam Sealant: Factory-applied, non-skinning, non-drying type.

- D. Eave Protection Membrane:
 - 1. Protection Membrane: Self-adhering polymer-modified asphalt sheet complying with ASTM D1970/D1970M; 40 mil total thickness; with strippable treated release paper and polyethylene sheet top surface.
- E. Underlayment: Synthetic non-asphaltic sheet, intended by manufacturer for mechanically fastened roofing underlayment without sealed seams.
 - 1. Type: Woven polypropylene with anti-slip polyolefin coating on both sides.
 - 2. Minimum Requirements: Comply with requirements of ICC-ES AC188 for non-self-adhesive sheet.
 - 3. Self Sealability: Passing nail sealability test specified in ASTM D1970/D1970M.
 - 4. Low Temperature Flexibility: Passing test specified in ASTM D1970/D1970M.
 - 5. Fasteners: As specified by manufacturer and building code qualification report or approval.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Do not begin installation of preformed metal roof panels until substrates have been properly prepared.
- B. If substrate preparation is the responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.

3.02 PREPARATION

- A. Broom clean wood sheathing prior to installation of roofing system.
- B. Coordinate roofing work with provisions for roof drainage, flashing, trim, penetrations, and other adjoining work to assure that the completed roof will be free of leaks.
- C. Remove protective film from surface of roof panels immediately prior to installation. Strip film carefully, to avoid damage to pre-finished surfaces.
- D. Separate dissimilar metals by applying a bituminous coating, self-adhering rubberized asphalt sheet, or other permanent method approved by roof panel manufacturer.
- E. Where metal will be in contact with wood or other absorbent material subject to wetting, seal joints with sealing compound and apply one coat of heavy-bodied bituminous paint.

3.03 INSTALLATION

- A. Overall: Install roofing system in accordance with approved shop drawings and panel manufacturer's instructions and recommendations, as applicable to specific project conditions. Anchor all components of roofing system securely in place while allowing for thermal and structural movement.
 - 1. Install roofing system with concealed clips and fasteners, except as otherwise recommended by manufacturer for specific circumstances.
 - 2. Minimize field cutting of panels. Where field cutting is absolutely required, use methods that will not distort panel profiles. Use of torches for field cutting is absolutely prohibited.
- B. Accessories: Install all components required for a complete roofing assembly, including flashings, gutters, downspouts, trim, moldings, closure strips, preformed crickets, caps, equipment curbs, rib closures, ridge closures, and similar roof accessory items.
- C. Roof Panels: Install panels in strict accordance with manufacturer's instructions, minimizing transverse joints except at junction with penetrations.

3.04 CLEANING

- A. Clean exposed sheet metal work at completion of installation. Remove grease and oil films, excess joint sealer, handling marks, and debris from installation, leaving the work clean and unmarked, free from dents, creases, waves, scratch marks, or other damage to the finish.

3.05 PROTECTION

- A. Do not permit storage of materials or roof traffic on installed roof panels. Provide temporary walkways or planks as necessary to avoid damage to completed work. Protect roofing until completion of project.
- B. Touch-up, repair, or replace damaged roof panels or accessories before Date of Substantial Completion.

END OF SECTION 074113

SECTION 07 4646 - FIBER-CEMENT SIDING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Fiber-cement siding.

1.02 SUBMITTALS

- A. See Division One for submittal procedures.
- B. Product Data: Submit manufacturer's data sheets on each product to be used, including:
 - 1. Manufacturer's requirements for related materials to be installed by others.
 - 2. Preparation instructions and recommendations.
 - 3. Storage and handling requirements and recommendations.
 - 4. Installation methods, including nail patterns.
- C. Installer's Qualification Statement.
- D. Warranty: Submit copy of manufacturer's warranty, made out in Owner's name, showing that it has been registered with manufacturer.

1.03 QUALITY ASSURANCE

- A. Installer Qualifications: Company specializing in performing work of the type specified in this section with minimum three years of experience.

1.04 DELIVERY, STORAGE, AND HANDLING

- A. Store products under waterproof cover and elevated above grade, on a flat surface.

1.05 WARRANTY

- A. Correct defective work within a five-year period after Date of Substantial Completion.

PART 2 PRODUCTS

2.01 FIBER-CEMENT SIDING

- A. Panel Siding: Vertically oriented panels made of cement and cellulose fiber formed under high pressure with integral surface texture, complying with ASTM C1186, Type A, Grade II; with machined edges, for nail attachment.
 - 1. Texture: Wood Grain.
 - 2. Length (Height): 96 inches, nominal.
 - 3. Width: 48 inches.
 - 4. Thickness: 5/16 inch, nominal.
 - 5. Finish: Factory applied finish.
 - 6. Color: As selected from Manufacturer's standard range.
 - 7. Warranty: 50 year limited; nontransferable.

8. Products:
 - a. Allura, a division of Plycem USA, Inc: www.allurausa.com.
 - b. James Hardie Building Products, Inc: www.jameshardie.com.
 - c. Nichiha USA, Inc: www.nichiha.com.
 - d. Substitutions: See Division One for substitution requirements.

2.02 ACCESSORIES

- A. Trim: Same material and texture as siding.
- B. Fasteners: Galvanized or corrosion resistant; length as required to penetrate, 1-1/4-inch, minimum.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Examine substrate, clean and repair as required to eliminate conditions that would be detrimental to proper installation.
- B. Verify that water-resistant barrier has been installed over substrate completely and correctly.
- C. Do not begin until unacceptable conditions have been corrected.
- D. If substrate preparation is responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.

3.02 INSTALLATION

- A. Install in accordance with manufacturer's instructions and recommendations.
 1. Read warranty and comply with terms necessary to maintain warranty coverage.
 2. Use trim details indicated on drawings.
 3. Touch up field cut edges before installing.
 4. Pre-drill nail holes if necessary to prevent breakage.
- B. Over Wood and Wood-Composite Sheathing: Fasten siding through sheathing into studs.
- C. Joints in Vertical Siding: Install Z-flashing in horizontal joints between successive courses of vertical siding.
- D. Do not install siding less than 6 inches from surface of ground nor closer than 1 inch to roofs, patios, porches, and other surfaces where water may collect.
- E. After installation, seal joints except lap joints of lap siding; seal around penetrations, and paint exposed cut edges.

3.03 PROTECTION

- A. Protect installed products until Date of Substantial Completion.
- B. Touch-up, repair or replace damaged products before Date of Substantial Completion.

END OF SECTION 074646

SECTION 07 6200 - SHEET METAL FLASHING AND TRIM

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Fabricated sheet metal items, including flashings, counterflashings, gutters, downspouts, exterior penetrations, and miscellaneous sheet metal items shown on drawings, not specified elsewhere..
- B. Precast concrete splash pads.

1.02 REFERENCE STANDARDS

- A. AAMA 2605 - Voluntary Specification, Performance Requirements and Test Procedures for Superior Performing Organic Coatings on Aluminum Extrusions and Panels (with Coil Coating Appendix) 2017a.
- B. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process 2020.
- C. ASTM D226/D226M - Standard Specification for Asphalt-Saturated Organic Felt Used in Roofing and Waterproofing 2017.
- D. ASTM D4586/D4586M - Standard Specification for Asphalt Roof Cement, Asbestos-Free 2007 (Reapproved 2018).
- E. SMACNA (ASMM) - Architectural Sheet Metal Manual 2012.

1.03 SUBMITTALS

- A. See Division One for submittal procedures.
- B. Shop Drawings: Indicate material profile, jointing pattern, jointing details, fastening methods, flashings, terminations, and installation details.
- C. Samples: Submit two samples 2 by 2 inch in size illustrating metal finish color.

1.04 QUALITY ASSURANCE

- A. Perform work in accordance with SMACNA (ASMM) requirements and standard details, except as otherwise indicated.
- B. Fabricator and Installer Qualifications: Company specializing in sheet metal work with 5 years of documented experience.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Stack material to prevent twisting, bending, and abrasion, and to provide ventilation. Slope metal sheets to ensure drainage.
- B. Prevent contact with materials that could cause discoloration or staining.

PART 2 - PRODUCTS

2.01 SHEET MATERIALS

- A. Pre-Finished Galvanized Steel: ASTM A653/A653M, with G90/Z275 zinc coating; minimum 24-gauge, (0.0239) inch thick base metal, shop pre-coated with PVDF coating.

1. PVDF (Polyvinylidene Fluoride) Coating: Superior Performance Organic Finish, AAMA 2605; multiple coat, thermally cured fluoropolymer finish system.
2. Color: As selected by Architect from manufacturer's standard colors.

2.02 FABRICATION

- A. Form sections true to shape, accurate in size, square, and free from distortion or defects.
- B. Fabricate cleats of same material as sheet, minimum 4 inches wide, interlocking with sheet.
- C. Form pieces in longest possible lengths.
- D. Hem exposed edges on underside 1/2 inch; miter and seam corners.
- E. Form material with flat lock seams, except where otherwise indicated; at moving joints, use sealed lapped, bayonet-type or interlocking hooked seams.
- F. Joints and Seams: Use locks and seams recommended by appropriate SMACNA standard for item being joined. Set in compatible sealant as specified in Section 07 9200. Allow joint to move.
- G. Fabricate corners from one piece with minimum 18 inch long legs; seam for rigidity, seal with sealant.
- H. Fabricate vertical faces with bottom edge formed outward 1/4 inch and hemmed to form drip.

2.03 GUTTER AND DOWNSPOUT FABRICATION

- A. Gutters: Profile as indicated on drawings.
- B. Downspouts: Rectangular profile; Corrugated.
- C. Gutters and Downspouts: Size indicated; install in continuous lengths (seamless).
- D. Accessories: Profiled to suit gutters and downspouts.
 1. Gutter Supports: Brackets.
 2. Downspout Supports: Straps.
- E. Splash Pads: Precast concrete type, of size and profiles indicated; minimum 3000 psi at 28 days, with minimum 5 percent air entrainment.
- F. Seal metal joints.

2.04 ACCESSORIES

- A. Fasteners: Same material and finish as flashing metal.
- B. Underlayment: ASTM D226/D226M, organic roofing felt, Type II (No. 30).
- C. Primer: Manufacturer's recommended type.
- D. Protective Backing Paint: Manufacturer's recommended.
- E. Sealants – as defined in Section 07 9200 Joint Sealants:
 1. Type E1 for exposed sealants, color to match adjacent material.
 2. Type E2 for concealed sealants.
- F. Plastic Cement: ASTM D4586/D4586M, Type I.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Verify roof openings, curbs, pipes, sleeves, ducts, and vents through roof are solidly set, reglets in place, and nailing strips located.

- B. Verify roofing termination and base flashings are in place, sealed, and secure.

3.02 PREPARATION

- A. Install starter and edge strips, and cleats before starting installation.
- B. Back paint concealed metal surfaces with protective backing paint to a minimum dry film thickness of 15 mil. Manufacturer's standard back paint on pre-finished sheet metal is acceptable in lieu of in-field back painting.

3.03 INSTALLATION

- A. Conform to drawing details and/or SMACNA standards, whichever is most stringent.
- B. Secure flashings in place using concealed cleats and fasteners, unless otherwise detailed.
- C. Apply plastic cement compound between metal flashings and felt flashings.
- D. Fit flashings tight in place; make corners square, surfaces true and straight in planes, and lines accurate to profiles.
- E. Seal metal joints watertight with sealant specified in Section 07 9200.
- F. Secure gutters and downspouts in place with concealed fasteners.
- G. Slope gutters 1/4 inch per 10 feet, minimum.
- H. Set splash pads under downspouts at grade, whether indicated or not.

END OF SECTION 076200

SECTION 07 9200 - JOINT SEALANTS

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Sealants, joint backing, and bond breakers.
- B. Joint backings and accessories.

1.02 ADMINISTRATIVE REQUIREMENTS

- A. Coordinate the work with other sections referencing this section.

1.03 SUBMITTALS

- A. See Division One for Submittal Procedures.
- B. Product Data for Sealants: Submit manufacturer's technical data sheets for each product to be used, that includes the following.
 - 1. Physical characteristics, including movement capability, VOC content, hardness, cure time, and color availability.
 - 2. List of backing materials approved for use with the specific product.
 - 3. Substrates that product is known to satisfactorily adhere to and with which it is compatible.
 - 4. Substrates the product should not be used on.
- C. Product Data for Accessory Products: Submit manufacturer's technical data sheet for each product to be used, including physical characteristics, installation instructions, and recommended tools.
- D. Color Cards for Selection: Where sealant color is not specified, submit two (2) sets of manufacturer's color cards showing standard colors available for selection.

1.04 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum ten years documented experience.
- B. Installer Qualifications: Company specializing in performing the work of this section and with at least three years of documented experience.

1.05 WARRANTY

- A. Correct defective work within a five-year period after Date of Substantial Completion.
- B. Warranty: Include coverage for installed sealants and accessories that fail to achieve watertight seal, exhibit loss of adhesion or cohesion, or do not cure.

PART 2 - PRODUCTS

2.01 JOINT SEALANT APPLICATIONS

- A. Type E-1 - General Purpose Exterior Sealant: Polyurethane; ASTM C920, Grade NS, Class 25, Uses M, G, and A; single or multi-component.
 - 1. Color: To be selected by Architect from manufacturer's standard range.
 - 2. Applications: Use for:
 - a. Joints between metal frames and other materials.
 - b. Other exterior joints for which no other sealant is indicated.

- B. Type E-2 - Exterior Metal Lap Joint Sealant: Butyl or polyisobutylene; non-drying, non-skinning, non-curing.
 - 1. Applications: Use for:
 - a. Concealed sealant bead in sheet metal work.
- C. Type I-1 - General Purpose Interior Sealant: Acrylic emulsion latex; ASTM C834, Type OP, Grade NF single component, paintable.
 - 1. Color: To be selected by Architect from manufacturer's standard range.
 - 2. Applications: Use for:
 - a. Interior wall and ceiling control joints.
 - b. Joints between door and window frames and wall surfaces.
 - c. Other interior joints for which no other type of sealant is indicated.
- D. Type I-2 - Bathroom Sealant: Silicone; ASTM C920, Uses I, M, and A; single-component, mildew-resistant.
 - 1. Color: To be selected by Architect from manufacturer's standard range.
 - 2. Applications: Use for:
 - a. Joints between plumbing fixtures and floor and wall surfaces.

2.02 ACCESSORIES

- A. Backer Rod: Cylindrical cellular foam rod with surface that sealant will not adhere to, compatible with specific sealant used, and recommended by backing and sealant manufacturers for specific application.
 - 1. Closed Cell and Bi-Cellular: 25 to 33 percent larger in diameter than joint width.
- B. Backing Tape: Self-adhesive polyethylene tape with surface that sealant will not adhere to and recommended by tape and sealant manufacturers for specific application.
- C. Masking Tape: Self-adhesive, nonabsorbent, non-staining, removable without adhesive residue, and compatible with surfaces adjacent to joints and sealants.
- D. Joint Cleaner: Non-corrosive and non-staining type, type recommended by sealant manufacturer; compatible with joint forming materials.
- E. Primers: Type recommended by sealant manufacturer to suit application; non-staining.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Verify that joints are ready to receive work.
- B. Verify that backing materials are compatible with sealants.
- C. Verify that backer rods are of the correct size.

3.02 PREPARATION

- A. Remove loose materials and foreign matter that could impair adhesion of sealant.
- B. Clean joints, and prime as necessary, in accordance with manufacturer's instructions.
- C. Perform preparation in accordance with manufacturer's instructions and ASTM C1193.
- D. Mask elements and surfaces adjacent to joints from damage and disfigurement due to sealant work; be aware that sealant drips and smears may not be completely removable.

3.03 INSTALLATION

- A. Perform work in accordance with sealant manufacturer's requirements for preparation of surfaces and material installation instructions.
- B. Perform installation in accordance with ASTM C1193.
- C. Measure joint dimensions and size joint backers to achieve width-to-depth ratio, neck dimension, and surface bond area as recommended by manufacturer, except where specific dimensions are indicated.
- D. Install bond breaker backing tape where backer rod cannot be used.
- E. Install sealant free of air pockets, foreign embedded matter, ridges, and sags, and without getting sealant on adjacent surfaces.
- F. Do not install sealant when ambient temperature is outside manufacturer's recommended temperature range, or will be outside that range during the entire curing period, unless manufacturer's approval is obtained and instructions are followed.
- G. Non-sag Sealants: Tool surface concave, unless otherwise indicated; remove masking tape immediately after tooling sealant surface.

3.04 CLEANING

- A. Clean adjacent surfaces of excess sealant and smears as a result of this work, before the sealant cures.
- B. Repair joints that have shrunk, sagged, run, and/or that have thin spots or other defects.
- C. Leave adjacent surfaces in as good or better condition than they were before sealant operations.

3.05 PROTECTION

- A. Protect sealants until cured.

3.06 SCHEDULE

- A. See Drawings for designated sealant joints.
- B. Exterior joints for which no other sealant type is Indicated: Type E-1.
- C. Soft joints between masonry and adjacent work: Type E-1.
- D. Lap joints in exterior sheet metal work: Type E-2.
- E. Joints between exterior metal frames and adjacent work: Type E-1.
- F. Under exterior thresholds: Type E-1.
- G. Interior joints for which no other sealant is Indicated: Type I-1.
- H. Joints between plumbing fixtures and walls/floors: Type I-2.

END OF SECTION 07 9200

SECTION 08 1113 - HOLLOW METAL DOORS AND FRAMES

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Non-fire-rated hollow metal doors and frames.

1.02 SUBMITTALS

- A. See Division One for submittal procedures.
- B. Product Data: Materials and details of design and construction, hardware locations, reinforcement type and locations, anchorage and fastening methods, and finishes.
- C. Shop Drawings: Details of each opening, showing elevations, glazing, frame profiles, and any indicated finish requirements.
- D. Installation Instructions: Manufacturer's published instructions, including any special installation instructions relating to this project.

1.03 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing products specified in this section, with not less than three years documented experience.
- B. Maintain at project site copies of reference standards relating to installation of products specified.

1.04 DELIVERY, STORAGE, AND HANDLING

- A. Store in accordance with NAAMM HMMA 840.
- B. Protect with resilient packaging; avoid humidity build-up under coverings; prevent corrosion and adverse effects on factory applied painted finish.

PART 2 - PRODUCTS

2.01 MANUFACTURERS

- A. Hollow Metal Doors and Frames:
 - 1. Ceco Door, an Assa Abloy Group company: www.assaabloydss.com.
 - 2. Curries, an Assa Abloy Group company: www.assaabloydss.com.
 - 3. Steelcraft, an Allegion brand: www.allegion.com.
 - 4. Substitutions: See Division One.

2.02 PERFORMANCE REQUIREMENTS

- A. Requirements for Hollow Metal Doors and Frames:
 - 1. Steel Sheet: Comply with one or more of the following requirements; Galvannealed steel complying with ASTM A653/A653M, cold-rolled steel complying with ASTM A1008/A1008M, or hot-rolled pickled and oiled (HRPO) steel complying with ASTM A1011/A1011M, commercial steel (CS) Type B, for each.
 - 2. Accessibility: Comply with ICC A117.1 and ADA Standards.
 - 3. Exterior Door Top Closures: Flush end closure channel, with top and door faces aligned.
 - 4. Door Edge Profile: Beveled, both sides.

5. Typical Door Face Sheets: Flush. Refer to Door Schedule for additional information.
 6. Hardware Preparations, Selections and Locations: Comply with NAAMM HMMA 830 and NAAMM HMMA 831 or BHMA A156.115 and ANSI/SDI A250.8 (SDI-100) in accordance with specified requirements.
 7. Zinc Coating for Typical Interior and/or Exterior Locations: Provide metal components zinc-coated (galvanized) and/or zinc-iron alloy-coated (galvannealed) by the hot-dip process in accordance with ASTM A653/A653M, with manufacturer's standard coating thickness, unless noted otherwise for specific hollow metal doors and frames.
- B. Combined Requirements: If a particular door and frame unit is indicated to comply with more than one type of requirement, comply with the specified requirements for each type; for instance, an exterior door that is also indicated as being sound-rated must comply with the requirements specified for exterior doors and for sound-rated doors; where two requirements conflict, comply with the most stringent.

2.03 HOLLOW METAL DOORS

- A. Door Finish: Factory primed and field finished.
- B. Exterior Doors:
1. Based on SDI Standards: ANSI/SDI A250.8 (SDI-100).
 - a. Level 3 - Extra Heavy-duty.
 - b. Physical Performance Level B, 500,000 cycles; in accordance with ANSI/SDI A250.4.
 - c. Model 1 - Full Flush.
 - d. Door Face Metal Thickness: 16 gauge, 0.053 inch, minimum.
 - e. Zinc Coating: A60/ZF180 galvannealed coating; ASTM A653/A653M.
 2. Door Core Material: Manufacturers standard core material/construction and in compliance with requirements.
 3. Door Thickness: 1-3/4 inches, nominal.
 4. Weatherstripping: Refer to Section 08 7100.

2.04 HOLLOW METAL FRAMES

- A. Comply with standards and/or custom guidelines as indicated for corresponding door in accordance with applicable door frame requirements.
- B. General:
1. Provide mortar guard/dust boxes for hardware cut-outs in all frames.
 2. Frames in Masonry Walls: Size to suit masonry coursing with head member 4 inches high to fill opening without cutting masonry units.
- C. Exterior Door Frames: Full profile/continuously welded type.
1. Galvanizing: Components hot-dipped zinc-iron alloy-coated (galvannealed) in accordance with ASTM A653/A653M, with A60/ZF180 coating.
 2. Frame Metal Thickness: 14 gauge, 0.067 inch, minimum.
 3. Weatherstripping: Separate, see Section 08 7100.

2.05 FINISHES

- A. Primer: Rust-inhibiting, complying with ANSI/SDI A250.10, door manufacturer's standard.
- B. Bituminous Coating: Cold-applied asphalt mastic, compounded for 15 mil, 0.015 inch dry film thickness (DFT) per coat; provide inert-type noncorrosive compound free of asbestos fibers, sulfur components, and other deleterious impurities.

2.06 ACCESSORIES

- A. Grout for Frames: Mortar grout complying with ASTM C476 with maximum slump of 4 inches as measured in accordance with ASTM C143/C143M for hand troweling in place; plaster grout and thinner pumpable grout are prohibited.
- B. Silencers: Resilient rubber, fitted into drilled hole; provide three on strike side of single door, three on center mullion of pairs, and two on head of pairs without center mullions.
- C. Temporary Frame Spreaders: Provide for factory- or shop-assembled frames.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions before starting work.
- B. Verify that opening sizes and tolerances are acceptable.
- C. Verify that finished walls are in plane to ensure proper door alignment.

3.02 PREPARATION

- A. Coat inside of frames to be installed in masonry or to be grouted, with bituminous coating, prior to installation.

3.03 INSTALLATION

- A. Install doors and frames in accordance with manufacturer's instructions and related requirements of specified door and frame standards or custom guidelines indicated.
- B. Coordinate frame anchor placement with wall construction.
- C. Grout frames in masonry construction, using hand trowel methods; brace frames so that pressure of grout before setting will not deform frames.
- D. Install door hardware as specified in Section 08 7100.

3.04 TOLERANCES

- A. Clearances Between Door and Frame: Comply with related requirements of specified frame standards or custom guidelines indicated in accordance with SDI 117 or NAAMM HMMA 861.
- B. Maximum Diagonal Distortion: 1/16 inch measured with straight edge, corner to corner.

3.05 ADJUSTING

- A. Adjust for smooth and balanced door movement.

3.06 SCHEDULE

- A. Refer to Door and Frame Schedule on the drawings.

END OF SECTION 081113

SECTION 08 7100 - DOOR HARDWARE

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Hardware for hollow metal doors.
- B. Thresholds.
- C. Weatherstripping and gasketing.

1.02 ADMINISTRATIVE REQUIREMENTS

- A. Coordinate the manufacture, fabrication, and installation of products that door hardware is installed on.
- B. Furnish templates for door and frame preparation to manufacturers and fabricators of products requiring internal reinforcement for door hardware.
- C. Convey Owner's keying requirements to manufacturers.

1.03 SUBMITTALS

- A. See Division One for submittal procedures.
- B. Product Data: Manufacturer's catalog literature for each type of hardware, marked to clearly show products to be furnished for this project, and includes construction details, material descriptions, finishes, and dimensions and profiles of individual components.
- C. Shop Drawings - Door Hardware Schedule: Submit detailed listing that includes each item of hardware to be installed on each door. Use door numbering scheme as included in Contract Documents.
 - 1. Provide complete description for each door listed.
 - 2. Provide manufacturers and product names, and catalog numbers; include functions, types, styles, sizes and finishes of each item.
 - 3. Include account of abbreviations and symbols used in schedule.
- D. Manufacturer's Installation Instructions: Indicate special procedures and perimeter conditions requiring special attention.
- E. Maintenance Data: Include data on operating hardware, lubrication requirements, and inspection procedures related to preventative maintenance.
- F. Keys: Deliver with identifying tags to Owner by security shipment direct from hardware supplier.
- G. Maintenance Materials and Tools: Furnish the following for Owner's use in maintenance of project.
 - 1. Tools: One set of each special wrench or tool applicable for each different or special hardware component, whether supplied by hardware component manufacturer or not.

1.04 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing products specified in this section with minimum three years of experience.
- B. Installer Qualifications: Company specializing in performing work of the type specified for commercial door hardware with at least three years of experience.
- C. Supplier Qualifications: Company specializing in supplying commercial door hardware with at least three years of experience.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Package hardware items individually; label and identify each package with door opening code to match door hardware schedule.

PART 2 - PRODUCTS

2.01 DESIGN AND PERFORMANCE CRITERIA

- A. Provide specified door hardware as required to make doors fully functional, compliant with applicable codes, and secure to extent indicated.
- B. Provide door hardware products that comply with the following requirements:
 - 1. Applicable provisions of federal, state, and local codes.
 - 2. Accessibility: ADA Standards and ICC A117.1.
 - 3. Applicable provisions of NFPA 101.
- C. Finishes: Provide door hardware of the same finish unless otherwise indicated.
 - 1. Finish: Satin chrome plated over nickel on brass or bronze, 626 (approx. US26D).
- D. Provide non-removable pins (NRP) when hinges are exposed to the outside of a room with locking hardware or to the exterior of exterior doors.

2.02 HINGES

- A. Manufacturers:
 - 1. Basis of Design: Hager Companies: www.hagerco.com/#sle.
 - 2. Other manufacturers:
 - a. Stanley, dormakaba Group: www.stanleyhardwarefordoors.com/#sle.
 - b. McKinney; an Assa Abloy Group company: www.assaabloydss.com/#sle
 - 3. Substitutions: See Division One.

2.03 CYLINDRICAL LOCKS, AUXILIARY LOCKS (DEADLOCKS)

- A. Manufacturers:
 - 1. Basis of Design: Falcon: www.falconlock.com.
 - 2. Other manufacturers:
 - a. Schlage, an Allegion brand: www.allegion.com/us/#sle.
 - b. Stanley, dormakaba Group: www.stanleyhardwarefordoors.com/#sle.
 - 3. Substitutions: See Division One.

2.04 LOCK CYLINDERS

- A. Manufacturers:
 - 1. Basis of Design: Falcon: www.falconlock.com.
 - 2. Other manufacturers:
 - a. Schlage, an Allegion brand: www.allegion.com/us/#sle.
 - b. Stanley, dormakaba Group: www.stanleyhardwarefordoors.com/#sle.
 - 3. Substitutions: See Division One.
- B. Provide high security mechanical type cylinders, Grade 1, with 6-pin core; coordinate with Owner for keying requirements.
 - 1. Provide cylinders from same manufacturer as locking devices.
 - 2. Provide cams and/or tailpieces as required for locking devices.

2.05 DOOR PULLS AND PUSH PLATES

- A. Manufacturers:
 - 1. Basis of Design: Hager Companies; www.hagerco.com/#sle.
 - 2. Other manufacturers:
 - a. Rockwood; an Assa Abloy Group company: www.assaabloydss.com/#sle.
 - b. Trimco: www.trimcohardware.com/#sle.
 - 3. Substitutions: See Division One.

2.06 CLOSERS

- A. Manufacturers; Surface Mounted:
 - 1. Basis of Design: LCN, an Allegion brand; www.allegion.com/us.
 - 2. Other manufacturers:
 - a. Corbin Russwin, Norton, Rixson, Sargent, or Yale; an Assa Abloy Group company: www.assaabloydss.com/#sle.
 - b. Stanley, dormakaba Group: www.stanleyhardwarefordoors.com/#sle.
 - 3. Substitutions: See Division One.

2.07 FLOOR STOPS, DRIP GUARDS

- A. Manufacturers:
 - 1. Basis of Design: Hager Companies; www.hagerco.com/#sle.
 - 2. Other manufacturers:
 - a. Rockwood; an Assa Abloy Group company: www.assaabloydss.com/#sle.
 - b. Trimco: www.trimcohardware.com/#sle.
 - 3. Substitutions: See Division One.

2.08 THRESHOLDS, WEATHERSTRIPPING AND GASKETING

- A. Manufacturers:
 - 1. Basis of Design: Hager Companies; www.hagerco.com/#sle.
 - 2. Other manufacturers:
 - a. Pemko; an Assa Abloy Group company: www.assaabloydss.com/#sle.
 - b. National Guard Products, Inc: www.ngpinc.com/#sle.
 - 3. Substitutions: See Division One.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Verify that doors and frames are ready to receive this work, and that dimensions are as indicated on shop drawings.

3.02 INSTALLATION

- A. Install hardware in accordance with manufacturer's instructions and applicable codes.
- B. Use templates provided by hardware item manufacturer.
- C. Door Hardware Mounting Heights: Distance from finished floor to center line of hardware item. As indicated in following list; unless noted otherwise in Door Hardware Schedule or on drawings.
 - 1. For Steel Doors and Frames: Install in compliance with DHI (LOCS) recommendations.

- D. Set exterior door thresholds with full-width bead of elastomeric sealant at each point of contact with floor providing a continuous weather seal; anchor thresholds with stainless steel countersunk screws.

3.03 ADJUSTING

- A. Adjust hardware for smooth operation.
- B. Adjust gasketing for complete, continuous seal; replace if unable to make complete seal.

3.04 PROTECTION

- A. Protect finished Work.
- B. Do not permit adjacent work to damage hardware or finish.

3.05 SCHEDULE

Hardware Group 1: Single Side-Swinging Doors: 102A, 102B

3 ea.	BB1191 4-1/2x4-1/2 NRP	Butts	Hager
1 ea.	FAL-K581P6-6DA-626-DAN (ANSI F86)	Leverset (Tactile)	Falcon
1 ea.	412S (MIL)	Threshold	Hager
1 ea.	881S N	Weatherstrip\	Hager
1 ea.	234W x US26D	Drip Guard	Hager

Hardware Group 2: Single Side-Swinging Doors: 101, 103

3 ea.	BB1199 4-1/2x4-1/2 NRP	Butts	Hager
1 ea.	4040XP	Closer	LCN
1 ea.	12G x US26D	Pull	Hager
1 ea.	30S x US26D, 4x16	Push	Hager
1 ea.	FAL-D141P6-626	Tubular Deadbolt	Falcon
1 ea.	412S (MIL)	Threshold	Hager
1 ea.	881S N	Weatherstrip	Hager
1 ea.	258F x US26D	Floor Stop w/ Holder	Hager
1 ea.	810S (MIL)	Drip Guard	Hager

Hardware Group 3: Single Side-Swinging Doors: 104, 105, 107, 108

3 ea.	BB1199 4-1/2x4-1/2 NRP	Butts	Hager
1 ea.	4040XP	Closer	LCN
1 ea.	FAL-K101-DA-626-DAN (ANSI F75)	Leverset	Falcon
1 ea.	FAL-D141P6-626	Tubular Deadbolt	Falcon
1 ea.	412S (MIL)	Threshold	Hager
1 ea.	881S N	Weatherstrip	Hager
1 ea.	258F x US26D	Floor Stop w/ Holder	Hager
1 ea.	810S (MIL)	Drip Guard	Hager

END OF SECTION 087100

SECTION 08 9100 – LOUVERS AND FOUNDATION VENTS

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Louvers, frames, and accessories.
- B. Foundation Vents.

1.02 SUBMITTALS

- A. See Division One for submittal procedures.
- B. Product Data: Provide data describing design characteristics, maximum recommended air velocity, design free area, materials and finishes.

PART 2 - PRODUCTS

2.01 LOUVERS

- A. Louvers: Factory fabricated and assembled, complete with frame, mullions, and accessories; AMCA Certified in accordance with AMCA 511.
- B. Stationary Louvers: Horizontal blade, extruded aluminum construction.
 - 1. Blades: Straight.
 - 2. Frame: Depth as indicated on drawings, channel profile; corner joints, with continuous recessed caulking channel each side.
 - 3. Materials: Extruded Aluminum: ASTM B221 (ASTM B221M).
 - a. Aluminum Thickness: Frame 12 gauge, 0.0808 inch minimum; blades 12 gauge, 0.0808 inch minimum.
 - 4. Aluminum Finish: Primed for field finishing.
 - a. Primer: Zinc chromate, alkyd type.

2.02 FOUNDATION VENTS

- A. Factory fabricated and assembled.
 - 1. Screens: Provide insect screens.
- B. Stationary Vents: Grate Style with sliding manual damper. Suitable for use in CMU block wall construction without a separate lintel.
 - 1. Frame: 16" x 8".
 - 2. Net-Free Area: 28 sq. in.
- C. Materials: Die-Cast Aluminum.
- D. Finishes: Mill.

2.03 ACCESSORIES

- A. Insect Screen: 18 x 16 size aluminum mesh.
- B. Fasteners and Anchors: Stainless steel.
- C. Head and Sill Flashings: See Section 07 6200.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Verify that prepared openings and flashings are ready to receive this work and that opening dimensions are as indicated on shop drawings.
- B. Verify that field measurements are as indicated.

3.02 INSTALLATION

- A. Install louver/vent assembly in accordance with manufacturer's instructions.
- B. Coordinate with installation of flashings by others.
- C. Install louvers level and plumb.
- D. Secure louver/vent frames in openings with concealed fasteners.

3.03 CLEANING

- A. Strip protective finish coverings.
- B. Clean surfaces and components.

END OF SECTION 089100

SECTION 09 2116 - GYPSUM BOARD ASSEMBLIES

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Glass-Mat Gypsum Sheathing.
- B. Joint treatment and accessories.

1.02 SUBMITTALS

- A. See Division One for submittal procedures.
- B. Product Data: Provide data on gypsum board and accessories.

PART 2 - PRODUCTS

2.01 GYPSUM BOARD ASSEMBLIES

- A. Provide completed assemblies complying with ASTM C840 and GA-216.
 - 1. See PART 3 for finishing requirements.

2.02 BOARD MATERIALS

- A. Glass-Mat Sheathing:
 - 1. Application: Interior ceilings.
 - 2. Mold Resistance: Score of 10, when tested in accordance with ASTM D3273.
 - 3. Type: Fire-resistance-rated Type X, UL or WH listed.
 - 4. Thickness: 5/8 inch.
 - 5. Edges: Square.
 - 6. Glass Mat Faced Products:
 - a. Georgia-Pacific Gypsum; DensGlass Sheathing. www.buildgp.com.
 - b. USG Corporation; USG Securock Brand Ultralight Glass-Mat Sheathing. www.usg.com.
 - c. Certainteed; GlasRoc Sheathing Reinforced Glass Mat Sheathing Panels. www.certainteed.com.
 - d. Substitutions: See Division One.

2.03 GYPSUM WALLBOARD ACCESSORIES

- A. Finishing Accessories: ASTM C1047, rigid plastic, unless noted otherwise.
 - 1. Types: As detailed or required for finished appearance, including:
 - a. Tear Away L Beads.
 - b. Tear Away XTL Beads.
 - c. Pullaway L Beads.
 - d. Flat Tear Aways.
 - 2. Special Shapes: In addition to conventional corner bead and control joints, provide U-bead, L-bead, and LC-bead at exposed panel edges as detailed or required for finished appearance.
- B. Joint Materials: ASTM C475/C475M and as recommended by gypsum board manufacturer for project conditions.

- C. Screws for Fastening of Gypsum Panel Products to Cold-Formed Steel Studs Less than 0.033 inches in Thickness and Wood Members: ASTM C1002; self-piercing tapping screws, corrosion-resistant.
- D. Anchorage to Substrate: Tie wire, nails, screws, and other metal supports, of type and size to suit application; to rigidly secure materials in place.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Verify that project conditions are appropriate for work of this section to commence.

3.02 BOARD INSTALLATION

- A. Comply with ASTM C840, GA-216, and manufacturer's instructions. Install to minimize butt end joints, especially in highly visible locations.
- B. Single-Layer Nonrated: Install gypsum board in most economical direction, with ends and edges occurring over firm bearing.
 - 1. Exception: Tapered edges to receive joint treatment at right angles to framing.
- C. Installation on Wood Framing: For nonrated assemblies, install as follows:
 - 1. Single-Layer Applications: Screw attachment.

3.03 INSTALLATION OF TRIM AND ACCESSORIES

- A. Control Joints: Place control joints consistent with lines of building spaces and as indicated.
 - 1. Not more than 30 feet apart on walls and ceilings over 50 feet long.
- B. Corner Beads: Install at external corners, using longest practical lengths.
- C. Edge Trim: Install at locations where gypsum board abuts dissimilar materials.

3.04 JOINT TREATMENT

- A. Glass Mat Faced Gypsum Board and Exterior Glass Mat Faced Sheathing: Use fiberglass joint tape, embed and finish with setting type joint compound.
- B. Finish gypsum board in accordance with levels defined in ASTM C840, as follows:
 - 1. Level 4: Walls and ceilings to receive paint finish or wall coverings, unless otherwise indicated.
 - 2. Level 1: Wall areas above finished ceilings, whether or not accessible in the completed construction.
- C. Tape, fill, and sand exposed joints, edges, and corners to produce smooth surface ready to receive finishes.
 - 1. Feather coats of joint compound so that camber is maximum 1/32 inch.
- D. At Glass-Mat Faced Gypsum Board panels scheduled to receive painted finish, skim-coat entire surface of panel per manufacturer recommendations.

3.05 TOLERANCES

- A. Maximum Variation of Finished Gypsum Board Surface from True Flatness: 1/8 inch in 10 feet in any direction.

END OF SECTION 092116

SECTION 09 9000 - PAINTING AND COATING

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Surface preparation.
- B. Field application of paints.
- C. Specified testing of substrates.
- D. Scope: Finish all interior and exterior surfaces exposed to view, unless fully factory-finished and unless otherwise indicated, including the following:
 - 1. Mechanical and Electrical:
 - a. In finished areas, paint all insulated and exposed pipes, conduit, boxes, insulated and exposed ducts, hangers, brackets, collars and supports, mechanical equipment, and electrical equipment, unless otherwise indicated.
 - 2. All items noted on drawings to be painted.
- E. Do Not Paint or Finish the Following Items:
 - 1. Items fully factory-finished unless specifically so indicated; materials and products having factory-applied primers are not considered factory finished.
 - 2. Items indicated to receive other finishes.
 - 3. Items indicated to remain unfinished.
 - 4. Fire rating labels, equipment serial number and capacity labels, and operating parts of equipment.
 - 5. Non-metallic roofing and flashing.
 - 6. Stainless steel, anodized aluminum, bronze, terne, and lead items.
 - 7. Glass.
 - 8. Acoustical materials, unless specifically so indicated.
 - 9. Concealed pipes, ducts, and conduits.

1.02 DEFINITIONS

- A. Conform to ASTM D16 for interpretation of terms used in this section.

1.03 SUBMITTALS

- A. See Division One, for submittal procedures.
- B. Product Data: Provide complete list of all products to be used, with the following information for each:
 - 1. Manufacturer's name, product name and/or catalog number, and general product category (e.g. "alkyd enamel").
 - 2. Cross-reference to specified paint system(s) product is to be used in; include description of each system.
 - 3. Manufacturer's installation instructions.
 - 4. If proposal of substitutions is allowed under submittal procedures, explanation of all substitutions proposed.
- C. Samples: Submit two painted samples, illustrating selected colors for each color and system selected with specified coats cascaded. Submit on tempered hardboard, 12x12 inch in size.
- D. Certification: By manufacturer that all paints and coatings comply with VOC limits specified.

- E. Certification: By manufacturer that all paints and coatings do not contain any of the prohibited chemicals specified; GreenSeal GS-11 certification is not required but if provided shall constitute acceptable certification.
- F. Results of all required testing.
- G. Manufacturer's Instructions: Indicate special surface preparation procedures and substrate conditions requiring special attention.
- H. Maintenance Data: Submit data on cleaning, touch-up, and repair of painted and coated surfaces.
- I. Maintenance Materials: Furnish the following for Owner's use in maintenance of project.
 - 1. Extra Paint and Coatings: 1 gallon of each color; store where directed.
 - 2. Label each container with color in addition to the manufacturer's label.

1.04 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the products specified, with minimum ten years documented experience.
- B. Applicator Qualifications: Company specializing in performing the type of work specified with minimum five years documented experience.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Deliver products to site in sealed and labeled containers; inspect to verify acceptability.
- B. Container Label: Include manufacturer's name, type of paint, brand name, lot number, brand code, coverage, surface preparation, drying time, cleanup requirements, color designation, and instructions for mixing and reducing.
- C. Paint Materials: Store at minimum ambient temperature of 45 degrees F and a maximum of 90 degrees F, in ventilated area, and as required by manufacturer's instructions.

1.06 FIELD CONDITIONS

- A. Do not apply materials when surface and ambient temperatures are outside the temperature ranges required by the paint product manufacturer.
- B. Follow manufacturer's recommended procedures for producing best results, including testing of substrates, moisture in substrates, and humidity and temperature limitations.
- C. Do not apply exterior coatings during rain or snow, or when relative humidity is outside the humidity ranges required by the paint product manufacturer.
- D. Minimum Application Temperatures for Latex Paints: 45 degrees F for interiors; 50 degrees F for exterior; unless required otherwise by manufacturer's instructions.
- E. Provide lighting level of 80 ft candles measured mid-height at substrate surface.

PART 2 - PRODUCTS

2.01 MANUFACTURERS

- A. Provide all paint and coating products used in any individual system from the same manufacturer, no exceptions.
- B. Paints:
 - 1. Basis of Design: Sherwin-Williams Company: www.sherwin-williams.com.
 - 2. Other manufacturers:
 - a. Benjamin Moore: www.benjaminmoore.com.

- b. PPG Paints: www.ppgpaints.com.
- 3. Substitutions: See Division One.
- C. Primer Sealers: Same manufacturer as topcoats.

2.02 PAINTS AND COATINGS - GENERAL

- A. Paints and Coatings: Ready mixed, unless intended to be a field-catalyzed coating.
 - 1. Provide paints and coatings of a soft paste consistency, capable of being readily and uniformly dispersed to a homogeneous coating, with good flow and brushing properties, and capable of drying or curing free of streaks or sags.
 - 2. Provide materials that are compatible with one another and the substrates indicated under conditions of service and application, as demonstrated by manufacturer based on testing and field experience.
 - 3. For opaque finishes, tint each coat including primer coat and intermediate coats, one-half shade lighter than succeeding coat, with final finish coat as base color.
 - 4. Supply each coating material in quantity required to complete entire project's work from a single production run.
 - 5. Do not reduce, thin, or dilute coatings or add materials to coatings unless such procedure is specifically described in manufacturer's product instructions.
- B. Primers: Where the manufacturer offers options on primers for a particular substrate, use primer categorized as "best" by the manufacturer.
- C. Volatile Organic Compound (VOC) Content:
 - 1. Provide coatings that comply with the most stringent requirements specified in the following:
 - a. 40 CFR 59, Subpart D--National Volatile Organic Compound Emission Standards for Architectural Coatings.
 - 2. Determination of VOC Content: Testing and calculation in accordance with 40 CFR 59, Subpart D (EPA Method 24), exclusive of colorants added to a tint base and water added at project site; or other method acceptable to authorities having jurisdiction.
- D. Chemical Content: The following compounds are prohibited:
 - 1. Aromatic Compounds: In excess of 1.0 percent by weight of total aromatic compounds (hydrocarbon compounds containing one or more benzene rings).
 - 2. Acrolein, acrylonitrile, antimony, benzene, butyl benzyl phthalate, cadmium, di (2-ethylhexyl) phthalate, di-n-butyl phthalate, di-n-octyl phthalate, 1,2-dichlorobenzene, diethyl phthalate, dimethyl phthalate, ethylbenzene, formaldehyde, hexavalent chromium, isophorone, lead, mercury, methyl ethyl ketone, methyl isobutyl ketone, methylene chloride, naphthalene, toluene (methylbenzene), 1,1,1-trichloroethane, vinyl chloride.
- E. Flammability: Comply with applicable code for surface burning characteristics.
- F. Colors: As indicated on drawings in finish schedule.
 - 1. Extend colors to surface edges; colors may change at any edge as directed by Architect.
 - 2. In finished areas, finish pipes, ducts, conduit, and equipment the same color as the wall/ceiling they are mounted on/under.

2.03 PAINT SYSTEMS - EXTERIOR

- A. Exterior Ferrous Metal Galvanized and Non-Galvanized; Lintels, and other ferrous metal items shown on drawings to be painted.
 - 1. Two topcoats and one coat primer.
 - 2. Semi-Gloss.
 - 3. Topcoat Product:

- a. Sherwin-Williams DTM Acrylic Coating Product No. B-66-W2-11.
4. Primer: Sherwin-Williams DTM Acrylic Primer Product No. B-66-W1.

2.04 PAINT SYSTEMS - INTERIOR

- A. All Interior Surfaces Indicated to be Painted, Unless Otherwise Indicated: Including gypsum board, concrete, concrete masonry, shop-primed steel, and galvanized steel.
 1. Two topcoats and one coat primer.
 2. Eggshell: MPI gloss level 3; use this sheen at all locations.
 3. Topcoat Product(s):
 - a. Sherwin-Williams Pre-Catalyzed Waterbased Epoxy, K45-150.
 4. Primer(s): As recommended by manufacturer of topcoats.
- B. Interior Ferrous Metal Galvanized and Non-Galvanized; Hollow metal frames and other ferrous metal items shown on drawings to be painted.
 1. Two topcoats and one coat primer.
 2. Semi-Gloss.
 3. Topcoat Product(s):
 - a. Latex, interior, semi-gloss: S-W ProMar 200 Zero VOC Latex Semi-Gloss, B31-2600 Series, at 4.0 mils wet, 1.6 mils dry, per coat.
 4. Primer(s): SW Pro-Cryl Universal Primer, B66-310.

2.05 ACCESSORY MATERIALS

- A. Accessory Materials: Provide all primers, sealers, cleaning agents, cleaning cloths, sanding materials, and clean-up materials required to achieve the finishes specified whether specifically indicated or not; commercial quality.
- B. Patching Material: Latex filler.
- C. Fastener Head Cover Material: Latex filler.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Do not begin application of coatings until substrates have been properly prepared.
- B. Verify that surfaces are ready to receive work as instructed by the product manufacturer.
- C. Examine surfaces scheduled to be finished prior to commencement of work. Report any condition that may potentially affect proper application.
- D. If substrate preparation is the responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.
- E. Test shop-applied primer for compatibility with subsequent cover materials.
- F. Moisture Testing: Measure moisture content of surfaces using an electronic moisture meter. Do not apply finishes unless moisture content of surfaces are below the following maximums:
 1. Gypsum Wallboard: 12 percent.
 2. Masonry, Concrete, and Concrete Unit Masonry: 12 percent.

3.02 PREPARATION

- A. Clean surfaces thoroughly and correct defects prior to coating application.
- B. Prepare surfaces using the methods recommended by the manufacturer for achieving the best result for the substrate under the project conditions.

- C. Remove or repair existing coatings that exhibit surface defects.
- D. Remove or mask surface appurtenances, including electrical plates, hardware, light fixture trim, escutcheons, and fittings, prior to preparing surfaces or finishing.
- E. Seal surfaces that might cause bleed through or staining of topcoat.
- F. Remove mildew from impervious surfaces by scrubbing with solution of tri-sodium phosphate and bleach. Rinse with clean water and allow surface to dry.
- G. Masonry:
 - 1. Remove efflorescence and chalk. Do not coat surfaces if moisture content or alkalinity of surfaces or if alkalinity of mortar joints exceed that permitted in manufacturer's written instructions. Allow to dry.
 - 2. Prepare surface as recommended by topcoat manufacturer.
- H. Gypsum Board Surfaces to be Painted: Fill minor defects with filler compound. Spot prime defects after repair.
- I. Galvanized Surfaces to be Painted: Remove surface contamination and oils and wash with solvent. Apply coat of etching primer.
- J. Corroded Steel and Iron Surfaces to be Painted: Prepare using at least SSPC-PC 2 (hand tool cleaning) or SSPC-SP 3 (power tool cleaning) followed by SSPC-SP 1 (solvent cleaning).
- K. Uncorroded Uncoated Steel and Iron Surfaces to be Painted: Remove grease, mill scale, weld splatter, dirt, and rust. Where heavy coatings of scale are evident, remove by hand or power tool wire brushing or sandblasting; clean by washing with solvent. Apply a treatment of phosphoric acid solution, ensuring weld joints, bolts, and nuts are similarly cleaned. Prime paint entire surface; spot prime after repairs.
- L. Shop-Primed Steel Surfaces to be Finish Painted: Sand and scrape to remove loose primer and rust. Feather edges to make touch-up patches inconspicuous. Clean surfaces with solvent. Prime bare steel surfaces. Re-prime entire shop-primed item.

3.03 APPLICATION

- A. Remove unfinished louvers, grilles, covers, and access panels on mechanical and electrical components and paint separately.
- B. Apply products in accordance with manufacturer's instructions.
- C. Where adjacent sealant is to be painted, do not apply finish coats until sealant is applied.
- D. Do not apply finishes to surfaces that are not dry. Allow applied coats to dry before next coat is applied.
- E. Apply each coat to uniform appearance.
- F. Dark Colors and Deep Clear Colors: Regardless of number of coats specified, apply as many coats as necessary for complete hide.
- G. Sand metal surfaces lightly between coats to achieve required finish.
- H. Vacuum clean surfaces of loose particles. Use tack cloth to remove dust and particles just prior to applying next coat.
- I. Reinstall electrical cover plates, hardware, light fixture trim, escutcheons, and fittings removed prior to finishing.

3.04 CLEANING

- A. Collect waste material that could constitute a fire hazard, place in closed metal containers, and remove daily from site.

3.05 PROTECTION

- A. Protect finished coatings until completion of project.
- B. Touch-up damaged coatings after Substantial Completion.

END OF SECTION 099000

SECTION 10 1400 - SIGNAGE

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Room and door signs.

1.02 REFERENCE STANDARDS

- A. ADA Standards - Americans with Disabilities Act (ADA) Standards for Accessible Design 2010.
- B. ICC A117.1 - Accessible and Usable Buildings and Facilities 2017.

1.03 SUBMITTALS

- A. See Division One for submittal procedures.
- B. Product Data: Manufacturer's printed product literature for each type of sign, indicating sign styles, font, foreground and background colors, locations, overall dimensions of each sign.
- C. Selection Samples: Where colors are not specified, submit two sets of color selection charts or chips.

1.04 DELIVERY, STORAGE, AND HANDLING

- A. Package signs as required to prevent damage before installation.

PART 2 - PRODUCTS

2.01 SIGNAGE APPLICATIONS

- A. Accessibility Compliance: Signs are required to comply with ADA Standards and ICC A117.1, unless otherwise indicated; in the event of conflicting requirements, comply with the most comprehensive and specific requirements.
- B. Room and Door Signs: Provide a sign for every doorway, whether it has a door or not, not including corridors, lobbies, and similar open areas.
 - 1. Sign Type: Flat signs with injection molded panel media as specified.
 - 2. Provide "tactile" signage, with letters raised minimum 1/32 inch and Grade II braille.
 - 3. Character Height: 5/8" minimum to 2" maximum.
 - 4. Sign Height: As indicated on Drawings.
 - 5. Rest Rooms: Identify with pictograms, the names "MEN" and "WOMEN", and braille.

2.02 SIGN TYPES

- A. Flat Signs: Signage media without frame.
 - 1. Edges: Square.
 - 2. Corners: Square.
 - 3. Wall Mounting of One-Sided Signs: Concealed or exposed screws.
- B. Color and Font: Unless otherwise indicated:
 - 1. Character Font: Helvetica, Arial, or other sans serif font.
 - 2. Character Case: Upper case only.

3. Background Color: Blue.
4. Character Color: White.

2.03 TACTILE SIGNAGE MEDIA

- A. Injection Molded Panels: One-piece acrylic plastic, with raised letters and braille.
 1. Total Thickness: 1/8 inch.

2.04 ACCESSORIES

- A. Concealed Screws: Stainless steel, galvanized steel, chrome plated, or other non-corroding metal.
- B. Exposed Screws: Stainless steel.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Verify that substrate surfaces are ready to receive work.

3.02 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Install neatly, with horizontal edges level.
- C. Locate signs and mount at heights indicated on drawings and in accordance with ADA Standards and ICC A117.1.
- D. Protect from damage until Date of Substantial Completion; repair or replace damaged items.

END OF SECTION 101400

SECTION 10 2113.19 - ALTERNATE 3: PLASTIC TOILET COMPARTMENTS

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Solid plastic toilet compartments.

1.02 ADMINISTRATIVE REQUIREMENTS

- A. Coordination: Coordinate the work with placement of support framing and anchors in walls and ceilings.

1.03 SUBMITTALS

- A. See Division One for submittal procedures.
- B. Product Data: Provide data on panel construction, hardware, and accessories.
- C. Shop Drawings: Indicate partition plan, elevation views, dimensions, details of wall supports, door swings.
- D. Manufacturer's Installation Instructions: Indicate special procedures.

PART 2 - PRODUCTS

2.01 MANUFACTURERS

- A. Solid Plastic Toilet Compartments:
 - 1. Scranton Products; Hiny Hiders Partitions: www.scrantonproducts.com.
 - 2. Bradley Corporation; HDPE Partitions: www.bradleycorp.com.
 - 3. General Partitions; HDPE Partitions: www.generalpartitions.com.
 - 4. Substitutions: See Division One.

2.02 PLASTIC TOILET COMPARTMENTS

- A. Solid Plastic Toilet Compartments: Factory fabricated doors, pilasters, and divider panels made of solid molded high-density polyethylene (HDPE), tested in accordance with NFPA 286; floor-mounted unbraced.
 - 1. Color: Selected from manufacturer's full range of standard colors..
 - 2. Doors:
 - a. Thickness: 1 inch.
 - b. Width: 24 inch.
 - c. Width for Handicapped Use: 36 inch.
 - d. Height: 58 inch.
 - 3. Panels:
 - a. Thickness: 1 inch.
 - b. Height: 58 inch.
 - 4. Pilasters:
 - a. Thickness: 1 inch.
 - b. Width: As required to fit space; minimum 3 inch.

2.03 ACCESSORIES

- A. Pilaster Shoes: Plastic, to match compartments, 3 inches high; concealing floor fastenings.
- B. Wall and Pilaster Brackets: Stainless steel; manufacturer's standard type for conditions indicated on drawings.
- C. Attachments, Screws, and Bolts: Stainless-steel, tamper-proof type.
- D. Hinges: Stainless steel, manufacturer's standard finish.
 - 1. Pivot hinges, gravity type, adjustable for door close positioning; two per door.
- E. Door Hardware: Stainless steel, manufacturer's standard finish.
 - 1. Door Latch: Slide type with exterior emergency access feature.
 - 2. Door Strike and Keeper with Rubber Bumper: Mount on pilaster in alignment with door latch.
 - 3. Provide door pull for out-swinging doors.
- F. Coat Hook with Rubber Bumper: One per compartment, mounted on door.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated on shop drawings.
- B. Verify correct location of built-in framing, anchorage, and bracing.

3.02 INSTALLATION

- A. Install partitions secure, rigid, plumb, and level in accordance with manufacturer's instructions.
- B. Maintain 3/8 inch to 1/2-inch space between wall and panels and between wall and end pilasters.
- C. Attach panel brackets securely to walls using anchor devices.
- D. Attach panels and pilasters to brackets.

3.03 TOLERANCES

- A. Maximum Variation from True Position: 1/4 inch.
- B. Maximum Variation from Plumb: 1/8 inch.

3.04 ADJUSTING

- A. Adjust and align hardware to uniform clearance at vertical edge of doors, not exceeding 3/16 inch.
- B. Adjust hinges to position doors in partial opening position when unlatched. Return out-swinging doors to closed position.
- C. Adjust adjacent components for consistency of line or plane.

END OF SECTION 102113.19

SECTION 10 2800 - ALTERNATE 2: TOILET, BATH, AND LAUNDRY ACCESSORIES

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Commercial toilet accessories.
- B. Grab bars.

1.02 SUBMITTALS

- A. See Division One for submittal procedures.
- B. Product Data: Submit data on accessories describing size, finish, details of function, and attachment methods.
- C. Manufacturer's Installation Instructions: Indicate special procedures and conditions requiring special attention.

PART 2 - PRODUCTS

2.01 MANUFACTURERS

- A. Commercial Toilet Accessories: See Schedule on Drawings.
 - 1. Basis of Design: Bobrick Washroom Equipment: www.bobrick.com.
 - 2. Other Manufacturers:
 - a. AJW Architectural Products: www.ajw.com.
 - b. American Specialties, Inc: www.americanspecialties.com.
 - c. Bradley Corporation: www.bradleycorp.com.
 - 3. Substitutions: See Division One.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions before starting work.
- B. Verify exact location of accessories for installation.
- C. Verify that field measurements are as indicated on drawings.

3.02 PREPARATION

- A. Deliver inserts and rough-in frames to site for timely installation.
- B. Provide templates and rough-in measurements as required.

3.03 INSTALLATION

- A. Install accessories in accordance with manufacturers' instructions in locations indicated on drawings.
- B. Install plumb and level, securely and rigidly anchored to substrate.
- C. Mounting Heights: As required by accessibility regulations and as indicated on drawings.

3.04 SCHEDULE

A. See Drawing Sheet A-101 for Restroom Accessory Schedule.

END OF SECTION 102800

SECTION 220529 - HANGERS AND SUPPORTS FOR PLUMBING PIPING AND EQUIPMENT

PART 1 GENERAL

1.01 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate sizes and arrangement of supports and bases with the actual equipment and components to be installed.
 - 2. Coordinate the work with other trades to provide additional framing and materials required for installation.
 - 3. Coordinate compatibility of support and attachment components with mounting surfaces at the installed locations.
 - 4. Coordinate the arrangement of supports with ductwork, piping, equipment and other potential conflicts installed under other sections or by others.
 - 5. Notify Architect of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.

1.02 QUALITY ASSURANCE

- A. Comply with applicable building code.

PART 2 PRODUCTS

2.01 SUPPORT AND ATTACHMENT COMPONENTS

- A. General Requirements:
 - 1. Provide all required hangers, supports, anchors, fasteners, fittings, accessories, and hardware as necessary for the complete installation of plumbing work.
 - 2. Provide products listed, classified, and labeled as suitable for the purpose intended, where applicable.
 - 3. Where support and attachment component types and sizes are not indicated, select in accordance with manufacturer's application criteria as required for the load to be supported. Include consideration for vibration, equipment operation, and shock loads where applicable.
 - 4. Steel Components: Use corrosion resistant materials suitable for the environment where installed.
 - a. Zinc-Plated Steel: Electroplated in accordance with ASTM B633.
 - b. Galvanized Steel: Hot-dip galvanized after fabrication in accordance with ASTM A123/A123M or ASTM A153/A153M.
- B. Metal Channel (Strut) Framing Systems:
 - 1. Manufacturers:
 - a. Cooper B-Line, a division of Eaton Corporation: www.cooperindustries.com/#sle.
 - b. Thomas & Betts Corporation: www.tnb.com/#sle.
 - c. Unistrut, a brand of Atkore International Inc: www.unistrut.com/#sle.
 - 2. Comply with MFMA-4.
- C. Hanger Rods: Threaded zinc-plated steel unless otherwise indicated.
 - 1. Minimum Size, Unless Otherwise Indicated or Required:
 - a. Equipment Supports: 1/2 inch (13 mm) diameter.
 - b. Piping up to 1 inch (27 mm) nominal: 1/4 inch (6 mm) diameter.
 - c. Piping larger than 1 inch (27 mm) nominal: 3/8 inch (10 mm) diameter.
- D. Dielectric Barriers: Provide between metallic supports and metallic piping and associated items of dissimilar type; acceptable dielectric barriers include rubber or plastic sheets or coatings attached securely to pipe or item.
- E. Anchors and Fasteners:
 - 1. Manufacturers - Mechanical Anchors:
 - a. Hilti, Inc: www.us.hilti.com/#sle.
 - b. ITW Red Head, a division of Illinois Tool Works, Inc: www.itwredhead.com/#sle.
 - c. Powers Fasteners, Inc: www.powers.com/#sle.

- d. Simpson Strong-Tie Company Inc: www.strongtie.com/#sle.
2. Unless otherwise indicated and where not otherwise restricted, use the anchor and fastener types indicated for the specified applications.
3. Concrete: Use preset concrete inserts, expansion anchors, or screw anchors.
4. Solid or Grout-Filled Masonry: Use expansion anchors or screw anchors.
5. Hollow Masonry: Use toggle bolts.
6. Hollow Stud Walls: Use toggle bolts.
7. Steel: Use beam clamps, machine bolts, or welded threaded studs.
8. Sheet Metal: Use sheet metal screws.
9. Wood: Use wood screws.
10. Preset Concrete Inserts: Continuous metal channel (strut) and spot inserts specifically designed to be cast in concrete ceilings, walls, and floors.
 - a. Comply with MFMA-4.
 - b. Channel Material: Use galvanized steel.
 - c. Manufacturer: Same as manufacturer of metal channel (strut) framing system.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that mounting surfaces are ready to receive support and attachment components.
- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Provide independent support from building structure. Do not provide support from piping, ductwork, conduit, or other systems.
- C. Unless specifically indicated or approved by Architect, do not provide support from suspended ceiling support system or ceiling grid.
- D. Unless specifically indicated or approved by Architect, do not provide support from roof deck.
- E. Do not penetrate or otherwise notch or cut structural members without approval of Structural Engineer.
- F. Equipment Support and Attachment:
 1. Use metal fabricated supports or supports assembled from metal channel (strut) to support equipment as required.
 2. Use metal channel (strut) secured to studs to support equipment surface-mounted on hollow stud walls when wall strength is not sufficient to resist pull-out.
 3. Use metal channel (strut) to support surface-mounted equipment in wet or damp locations to provide space between equipment and mounting surface.
 4. Securely fasten floor-mounted equipment. Do not install equipment such that it relies on its own weight for support.
- G. Preset Concrete Inserts: Use manufacturer-provided closure strips to inhibit concrete seepage during concrete pour.
- H. Secure fasteners according to manufacturer's recommended torque settings.
- I. Remove temporary supports.

END OF SECTION 220529

SECTION 220553 - IDENTIFICATION FOR PLUMBING PIPING AND EQUIPMENT

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Tags.
- B. Pipe markers.

PART 2 PRODUCTS

2.01 IDENTIFICATION APPLICATIONS

- A. Piping: Pipe markers.

2.02 TAGS

- A. Manufacturers:
 1. Advanced Graphic Engraving: www.advancedgraphicengraving.com/#sle.
 2. Brady Corporation: www.bradycorp.com/#sle.
 3. Brimar Industries, Inc: www.pipemarker.com/#sle.
 4. Craftmark Pipe Markers: www.craftmarkid.com/#sle.
 5. Kolbi Pipe Marker Co: www.kolbipipemarkers.com/#sle.
 6. Seton Identification Products: www.seton.com/#sle.

2.03 PIPE MARKERS

- A. Manufacturers:
 1. Brady Corporation: www.bradycorp.com/#sle.
 2. Brimar Industries, Inc: www.pipemarker.com/#sle.
 3. Craftmark Pipe Markers: www.craftmarkid.com/#sle.
 4. Kolbi Pipe Marker Co: www.kolbipipemarkers.com/#sle.
 5. MIFAB, Inc: www.mifab.com/#sle.

PART 3 EXECUTION

3.01 PREPARATION

- A. Degrease and clean surfaces to receive adhesive for identification materials.

3.02 INSTALLATION

- A. Install tags with corrosion resistant chain.
- B. Install plastic pipe markers in accordance with manufacturer's instructions.

END OF SECTION 220553

SECTION 220719 - PLUMBING PIPING INSULATION

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Piping insulation.
- B. Jackets and accessories.

1.02 REFERENCE STANDARDS

- A. ASTM B209 - Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate 2014.
- B. ASTM B209M - Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate (Metric) 2014.
- C. ASTM C534/C534M - Standard Specification for Preformed Flexible Elastomeric Cellular Thermal Insulation in Sheet and Tubular Form 2020a.
- D. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials 2018b.
- E. UL 723 - Standard for Test for Surface Burning Characteristics of Building Materials Current Edition, Including All Revisions.

PART 2 PRODUCTS

2.01 REGULATORY REQUIREMENTS

- A. Surface Burning Characteristics: Flame spread index/Smoke developed index of 25/50, maximum, when tested in accordance with ASTM E84 or UL 723.

2.02 FLEXIBLE ELASTOMERIC CELLULAR INSULATION

- A. Manufacturer:
 - 1. Aeroflex USA, Inc: www.aeroflexusa.com/#sle.
 - 2. Armacell LLC; AP Armaflex: www.armacell.us/#sle.
 - 3. K-Flex USA LLC; Insul-Tube: www.kflexusa.com/#sle.
- B. Insulation: Preformed flexible elastomeric cellular rubber insulation complying with ASTM C534/C534M Grade 1; use molded tubular material wherever possible.
 - 1. Minimum Service Temperature: Minus 40 degrees F (Minus 40 degrees C).
 - 2. Maximum Service Temperature: 220 degrees F (104 degrees C).
 - 3. Connection: Waterproof vapor barrier adhesive.

2.03 JACKETS

- A. Aluminum Jacket: ASTM B209 (ASTM B209M) formed aluminum sheet.
 - 1. Thickness: 0.016 inch (0.40 mm) sheet.
 - 2. Finish: Smooth.
 - 3. Joining: Longitudinal slip joints and 2 inch (50 mm) laps.
 - 4. Fittings: 0.016 inch (0.4 mm) thick die shaped fitting covers with factory attached protective liner.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that piping has been tested before applying insulation materials.
- B. Verify that surfaces are clean and dry, with foreign material removed.

3.02 INSTALLATION

- A. Install in accordance with manufacturer's instructions.

3.03 SCHEDULES

- A. Plumbing Systems:
 - 1. Domestic Hot Water Supply & Hot Water Recirc:
 - a. Cellular Foam Insulation:
 - 1) Thickness: 3/4".

2. Domestic Cold Water:
 - a. Cellular Foam Insulation:
 - 1) Thickness: 3/4".

END OF SECTION 220719

SECTION 221005 - PLUMBING PIPING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Pipe, pipe fittings, specialties, and connections for piping systems.
 - 1. Sanitary sewer.
 - 2. Domestic water.
 - 3. Pipe hangers and supports.

1.02 RELATED REQUIREMENTS

- A. Section 220553 - Identification for Plumbing Piping and Equipment.
- B. Section 220719 - Plumbing Piping Insulation.

1.03 REFERENCE STANDARDS

- A. ASME B16.18 - Cast Copper Alloy Solder Joint Pressure Fittings 2021.
- B. ASME B16.22 - Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings 2021.
- C. ASME B16.26 - Cast Copper Alloy Fittings for Flared Copper Tubes 2018.
- D. ASME B31.9 - Building Services Piping 2020.
- E. ASTM B42 - Standard Specification for Seamless Copper Pipe, Standard Sizes 2020.
- F. ASTM B88 - Standard Specification for Seamless Copper Water Tube 2020.
- G. ASTM B88M - Standard Specification for Seamless Copper Water Tube (Metric) 2020.
- H. ASTM D2564 - Standard Specification for Solvent Cements for Poly(Vinyl Chloride) (PVC) Plastic Piping Systems 2020.
- I. ASTM D2665 - Standard Specification for Poly(Vinyl Chloride) (PVC) Plastic Drain, Waste, and Vent Pipe and Fittings 2020.
- J. ASTM D2855 - Standard Practice for the Two-Step (Primer and Solvent Cement) Method of Joining Poly (Vinyl Chloride) (PVC) or Chlorinated Poly (Vinyl Chloride) (CPVC) Pipe and Piping Components with Tapered Sockets 2020.
- K. ASTM D3034 - Standard Specification for Type PSM Poly(Vinyl Chloride) (PVC) Sewer Pipe and Fittings 2021.
- L. MSS SP-58 - Pipe Hangers and Supports - Materials, Design, Manufacture, Selection, Application, and Installation 2018.
- M. MSS SP-110 - Ball Valves Threaded, Socket-Welding, Solder Joint, Grooved and Flared Ends 2010, with Errata .
- N. NSF 61 - Drinking Water System Components - Health Effects 2021.
- O. NSF 372 - Drinking Water System Components - Lead Content 2022.

1.04 QUALITY ASSURANCE

- A. Perform work in accordance with applicable codes.
- B. Valves: Manufacturer's name and pressure rating marked on valve body.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Protect piping systems from entry of foreign materials by temporary covers, completing sections of the work, and isolating parts of completed system.

1.06 FIELD CONDITIONS

- A. Do not install underground piping when bedding is wet or frozen.

PART 2 PRODUCTS

2.01 GENERAL REQUIREMENTS

- A. Potable Water Supply Systems: Provide piping, pipe fittings, and solder and flux (if used), that comply with NSF 61 and NSF 372 for maximum lead content; label pipe and fittings.

2.02 SANITARY SEWER PIPING, BURIED WITHIN 5 FEET (1500 MM) OF BUILDING

- A. PVC Pipe: ASTM D2665 or ASTM D3034.
 - 1. Fittings: PVC.
 - 2. Joints: Solvent welded, with ASTM D2564 solvent cement.

2.03 SANITARY SEWER PIPING, ABOVE GRADE

- A. PVC Pipe: ASTM D2665.
 - 1. Fittings: PVC.
 - 2. Joints: Solvent welded, with ASTM D2564 solvent cement.

2.04 DOMESTIC WATER PIPING, BURIED BEYOND 5 FEET (1500 MM) OF BUILDING

- A. Copper Pipe: ASTM B42, annealed.
 - 1. Fittings: ASME B16.26, cast bronze.
 - 2. Joints: Flared.
- B. SDR9 / Cooper tube size poly
 - 1. Fitting: Compression.

2.05 DOMESTIC WATER PIPING, BURIED WITHIN 5 FEET (1500 MM) OF BUILDING

- A. Copper Pipe: ASTM B42, annealed.
 - 1. Fittings: ASME B16.26, cast bronze.
 - 2. Joints: Flared.
- B. SDR9 / Cooper tube size poly
 - 1. Fittings: Compression

2.06 DOMESTIC WATER PIPING, ABOVE GRADE

- A. Copper Tube: ASTM B88 (ASTM B88M), Type L (B), Drawn (H).
 - 1. Fittings: ASME B16.18, cast copper alloy or ASME B16.22, wrought copper and bronze.
 - 2. Joints: Grooved mechanical couplings.

2.07 PIPE HANGERS AND SUPPORTS

- A. Provide hangers and supports that comply with MSS SP-58.
 - 1. If type of hanger or support for a particular situation is not indicated, select appropriate type using MSS SP-58 recommendations.
 - 2. Overhead Supports: Individual steel rod hangers attached to structure or to trapeze hangers.
 - 3. Trapeze Hangers: Welded steel channel frames attached to structure.
 - 4. Vertical Pipe Support: Steel riser clamp.
 - 5. Floor Supports: Concrete pier or steel pedestal with floor flange; fixture attachment.
- B. Plumbing Piping - Drain, Waste, and Vent:
 - 1. Hangers for Pipe Sizes 1/2 Inch (15 mm) to 1-1/2 Inches (40 mm): Carbon steel, adjustable swivel, split ring.
 - 2. Hangers for Pipe Sizes 2 Inches (50 mm) and Over: Carbon steel, adjustable, clevis.
 - 3. Wall Support for Pipe Sizes 4 Inches (100 mm) and Over: Welded steel bracket and wrought steel clamp.
 - 4. Floor Support: Cast iron adjustable pipe saddle, lock nut, nipple, floor flange, and concrete pier or steel support.
- C. Plumbing Piping - Water:
 - 1. Hangers for Pipe Sizes 1/2 Inch (15 mm) to 1-1/2 Inches (40 mm): Carbon steel, adjustable swivel, split ring.

2.08 BALL VALVES

- A. Manufacturers:
 - 1. Apollo Valves: www.apollovalves.com/#sle.

2. Grinnell Products: www.grinnell.com/#sle.
 3. Nibco, Inc: www.nibco.com/#sle.
 4. Uponor, Inc: www.uponorengineering.com/#sle.
- B. Construction, 4 Inches (100 mm) and Smaller: MSS SP-110, Class 150, 400 psi (2760 kPa) CWP, bronze or ductile iron body, 304 stainless steel or chrome plated brass ball, regular port, teflon seats and stuffing box ring, blow-out proof stem, lever handle with balancing stops, threaded or grooved ends with union.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that excavations are to required grade, dry, and not over-excavated.

3.02 PREPARATION

- A. Ream pipe and tube ends. Remove burrs.
- B. Remove scale and dirt, on inside and outside, before assembly.
- C. Prepare piping connections to equipment with flanges or unions.

3.03 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Provide non-conducting dielectric connections wherever jointing dissimilar metals.
- C. Route piping in orderly manner and maintain gradient. Route parallel and perpendicular to walls.
- D. Install piping to maintain headroom, conserve space, and not interfere with use of space.
- E. Install piping to allow for expansion and contraction without stressing pipe, joints, or connected equipment.
- F. Provide clearance in hangers and from structure and other equipment for installation of insulation and access to valves and fittings.
- G. PVC Pipe: Make solvent-welded joints in accordance with ASTM D2855.
- H. Pipe Hangers and Supports:
1. Install in accordance with ASME B31.9.

3.04 APPLICATION

- A. Use grooved mechanical couplings and fasteners only in accessible locations.

3.05 SERVICE CONNECTIONS

- A. Provide new sanitary sewer services. Before commencing work check invert elevations required for sewer connections, confirm inverts and ensure that these can be properly connected with slope for drainage and cover to avoid freezing.

END OF SECTION 221005

SECTION 223000 - PLUMBING EQUIPMENT

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Residential electric water heaters.

1.02 REFERENCE STANDARDS

- A. ASHRAE Std 90.1 I-P - Energy Standard for Buildings Except Low-Rise Residential Buildings Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- B. UL 174 - Standard for Household Electric Storage Tank Water Heaters Current Edition, Including All Revisions.

1.03 SUBMITTALS

- A. Product Data:
 - 1. Provide dimension drawings of water heaters indicating components and connections to other equipment and piping.

1.04 QUALITY ASSURANCE

- A. Certifications:
 - 1. Water Heaters: NSF approved.
 - 2. Electric Water Heaters: UL listed and labeled to UL 174.
 - 3. Products Requiring Electrical Connection: Listed and classified by Underwriters Laboratories Inc., as suitable for the purpose specified and indicated.

PART 2 PRODUCTS

2.01 WATER HEATERS

- A. Manufacturers:
 - 1. A.O. Smith Water Products Co: www.hotwater.com/#sle.
 - 2. Bock Water Heaters, Inc: www.bockwaterheaters.com/#sle.
 - 3. Rheem Manufacturing Company www.rheem.com/#sle.
- B. Electric Water Heaters:
 - 1. Type: Automatic, electric, vertical storage.
 - 2. Minimum Efficiency Required: ASHRAE Std 90.1 I-P.
 - 3. Performance:
 - a. Storage Capacity:40 Gallons.
 - b. Heating Element Size: 4,500 kW.
 - 4. Electrical Characteristics:
 - a. 208 volts, single phase.
 - 5. Tank: Glass lined welded steel, thermally insulated with one inch (25 mm) thick glass fiber; encased in corrosion-resistant steel jacket; baked-on enamel finish.
 - 6. Controls: Automatic water thermostat with externally adjustable temperature range from 120 to 170 degrees F (49 to 77 degrees C), flanged or screw-in nichrome elements, enclosed controls and electrical junction box and operating light. Wire double element units so elements do not operate simultaneously.
 - 7. Accessories:
 - a. Water Connections: Brass.
 - b. Dip Tube: Brass.
 - c. Drain valve.
 - d. Anode: Magnesium.
 - e. Temperature and Pressure Relief Valve: ASME labeled.

END OF SECTION 223000

SECTION 224000 - PLUMBING FIXTURES

PART 1 GENERAL

1.01 REFERENCE STANDARDS

- A. ADA Standards - 2010 ADA Standards for Accessible Design 2010.
- B. ASME A112.18.1 - Plumbing Supply Fittings 2018, with Errata.
- C. ASME A112.19.2 - Ceramic Plumbing Fixtures 2018, with Errata.
- D. ICC A117.1 - Accessible and Usable Buildings and Facilities 2017.
- E. NSF 61 - Drinking Water System Components - Health Effects 2021.
- F. NSF 372 - Drinking Water System Components - Lead Content 2022.

1.02 SUBMITTALS

- A. Product Data: Provide catalog illustrations of fixtures, sizes, utility sizes, trim, and finishes.

1.03 DELIVERY, STORAGE, AND HANDLING

- A. Protect installed fixtures from damage by securing areas and by leaving factory packaging in place to protect fixtures and prevent use.

PART 2 PRODUCTS

2.01 GENERAL REQUIREMENTS

- A. Potable Water Systems: Provide plumbing fittings and faucets that comply with NSF 61 and NSF 372 for maximum lead content; label pipe and fittings.

2.02 REGULATORY REQUIREMENTS

- A. Comply with applicable codes for installation of plumbing systems.

2.03 FLUSH VALVE WATER CLOSETS

- A. Water Closets: Vitreous china, ASME A112.19.2, wall hung, siphon jet flush action, china bolt caps.
 - 1. Flush Valve: Exposed (top spud).
 - 2. Flush Operation: Manual operated.
 - 3. Manufacturers:
 - a. American Standard, Inc: www.americanstandard-us.com/#sle.
 - b. Gerber Plumbing Fixtures LLC: www.gerberonline.com/#sle.
 - c. Kohler Company: www.kohler.com/#sle.
 - d. Zurn Industries, Inc: www.zurn.com/#sle.
- B. Flush Valves: ASME A112.18.1, diaphragm type, complete with vacuum breaker stops and accessories.
 - 1. Exposed Type: Chrome plated, escutcheon, integral screwdriver stop.
 - 2. Manufacturers:
 - a. American Standard, Inc: www.americanstandard-us.com/#sle.
 - b. Sloan Valve Company: www.sloanvalve.com/#sle.
 - c. Zurn Industries, Inc: www.zurn.com/#sle.
- C. Seats:
 - 1. Manufacturers:
 - a. American Standard, Inc: www.americanstandard-us.com/#sle.
 - b. Bemis Manufacturing Company: www.bemismfg.com/#sle.
 - c. Church Seat Company: www.churchseats.com/#sle.
 - d. Olsonite: www.olsonite.com/#sle.
 - e. Zurn Industries, Inc: www.zurn.com/#sle.
- D. Water Closet Carriers:
 - 1. Manufacturers:
 - a. Jay R. Smith MFG. Co: www.jrsmith.com/#sle.
 - b. JOSAM Company: www.josam.com/#sle.

- c. Zurn Industries, Inc: www.zurn.com/#sle.

2.04 WALL HUNG URINALS

- A. Wall Hung Urinal Manufacturers:
 - 1. American Standard, Inc: www.americanstandard-us.com/#sle.
 - 2. Gerber Plumbing Fixtures LLC: www.gerberonline.com/#sle.
 - 3. Kohler Company: www.kohler.com/#sle.
 - 4. Zurn Industries, Inc: www.zurn.com/#sle.
- B. Urinals: Vitreous china, ASME A112.19.2, wall hung with side shields and concealed carrier.
 - 1. Flush Volume: 1.0 gallons (3.7 liters), maximum.
 - 2. Flush Valve: Exposed (top spud).
 - 3. Flush Operation: Manual, oscillating handle.
 - 4. Trap: Integral.
- C. Flush Valves: ASME A112.18.1, diaphragm type, complete with vacuum breaker stops and accessories.
 - 1. Exposed Type: Chrome plated, escutcheon, integral screwdriver stop.
 - 2. Manufacturers:
 - a. American Standard, Inc: www.americanstandard-us.com/#sle.
 - b. Sloan Valve Company: www.sloanvalve.com/#sle.
 - c. Zurn Industries, Inc: www.zurn.com/#sle.
- D. Carriers:
 - 1. Manufacturers:
 - a. Jay R. Smith MFG. Co: www.jrsmith.com/#sle.
 - b. JOSAM Company: www.josam.com/#sle.
 - c. Zurn Industries, Inc: www.zurn.com/#sle.

2.05 LAVATORIES

- A. Lavatory Manufacturers:
 - 1. American Standard, Inc: www.americanstandard-us.com/#sle.
 - 2. Gerber Plumbing Fixtures LLC: www.gerberonline.com/#sle.
 - 3. Zurn Industries, Inc: www.zurn.com/#sle.
- B. Vitreous China Wall Hung Basin: ASME A112.19.2; vitreous china wall hung lavatory,.
 - 1. Drilling Centers: 4 inch (100 mm).
- C. Supply Faucet Manufacturers:
 - 1. American Standard, Inc: www.americanstandard-us.com/#sle.
 - 2. Grohe America, Inc: www.grohe.com/us/#sle.
 - 3. Kohler Company: www.kohler.com/#sle.
 - 4. Zurn Industries, Inc: www.zurn.com/#sle.

2.06 UNDER-LAVATORY PIPE SUPPLY COVERS

- A. General:
 - 1. Insulate exposed drainage piping including hot, cold and tempered water supplies under lavatories or sinks per ADA Standards.
 - 2. Construction: 1/8 inch (3.2 mm) PVC with antimicrobial, antifungal and UV resistant properties.
 - a. Comply with ASME A112.18.9 for covers on accessible lavatory piping.
 - b. Comply with ICC A117.1.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that walls and floor finishes are prepared and ready for installation of fixtures.
- B. Verify that electric power is available and of the correct characteristics.

3.02 PREPARATION

- A. Rough-in fixture piping connections in accordance with minimum sizes indicated in fixture rough-in schedule for particular fixtures.

3.03 INSTALLATION

- A. Install each fixture with trap, easily removable for servicing and cleaning.
- B. Provide chrome plated rigid or flexible supplies to fixtures with screwdriver stops, reducers, and escutcheons.
- C. Install components level and plumb.

3.04 ADJUSTING

- A. Adjust stops or valves for intended water flow rate to fixtures without splashing, noise, or overflow.

3.05 CLEANING

- A. Clean plumbing fixtures and equipment.

3.06 PROTECTION

- A. Protect installed products from damage due to subsequent construction operations.
- B. Do not permit use of fixtures by construction personnel.
- C. Repair or replace damaged products before Date of Substantial Completion.

3.07 SCHEDULES

- A. Fixture Rough-In
 - 1. Water Closet (Flush Valve Type):
 - a. Cold Water: 1 Inch (25 mm).
 - b. Waste: 4 Inch (100 mm).
 - 2. Urinal (Flush Valve Type):
 - a. Cold Water: 3/4 Inch (20 mm).
 - b. Waste: 2 Inch (50 mm).
 - 3. Lavatory:
 - a. Hot Water: 1/2 Inch (15 mm).
 - b. Waste: 1-1/2 Inch (40 mm).
 - c. Vent: 1-1/4 Inch (32 mm).

END OF SECTION 224000

SECTION 233100 - HVAC DUCTS AND CASINGS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Metal ductwork.

1.02 REFERENCE STANDARDS

- A. ASHRAE (FUND) - ASHRAE Handbook - Fundamentals Most Recent Edition Cited by Referring Code or Reference Standard.
- B. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process 2020.
- C. NFPA 90A - Standard for the Installation of Air-Conditioning and Ventilating Systems 2021.
- D. SMACNA (DCS) - HVAC Duct Construction Standards Metal and Flexible 2021.

1.03 FIELD CONDITIONS

- A. Do not install duct sealants when temperatures are less than those recommended by sealant manufacturers.
- B. Maintain temperatures within acceptable range during and after installation of duct sealants.

PART 2 PRODUCTS

2.01 DUCT ASSEMBLIES

- A. Regulatory Requirements: Construct ductwork to comply with NFPA 90A standards.
- B. General Exhaust: 1 inch wg (250 Pa) pressure class, galvanized steel.

2.02 MATERIALS

- A. Galvanized Steel for Ducts: Hot-dipped galvanized steel sheet, ASTM A653/A653M FS Type B, with G60/Z180 coating.

2.03 DUCTWORK FABRICATION

- A. Fabricate and support in accordance with SMACNA (DCS) and as indicated.
- B. Increase duct sizes gradually, not exceeding 15 degrees divergence wherever possible; maximum 30 degrees divergence upstream of equipment and 45 degrees convergence downstream.
- C. Fabricate continuously welded round and oval duct fittings in accordance with SMACNA (DCS).

2.04 MANUFACTURED DUCTWORK AND FITTINGS

- A. Round Ducts: Round lockseam duct with galvanized steel outer wall.
 - 1. Manufacture in accordance with SMACNA (DCS).

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install, support, and seal ducts in accordance with SMACNA (DCS).
- B. Duct sizes indicated are inside clear dimensions. For lined ducts, maintain sizes inside lining.
- C. Locate ducts with sufficient space around equipment to allow normal operating and maintenance activities.

END OF SECTION 233100

SECTION 233416 - CENTRIFUGAL HVAC FANS

PART 1 GENERAL

1.01 SECTION INCLUDES

1.02 SUBMITTALS

- A. Product Data: Provide data on centrifugal fans and accessories including fan curves with specified operating point clearly plotted, power, RPM, sound power levels for both fan inlet and outlet at rated capacity, and electrical characteristics and connection requirements.

1.03 FIELD CONDITIONS

- A. Permanent fans may not be used for ventilation during construction.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. ACME Engineering and Manufacturing Corporation: www.acmefan.com/#sle.
- B. Carnes, a division of Carnes Company Inc; VIBK: www.carnes.com/#sle.
- C. Loren Cook Company: www.lorencook.com/#sle.
- D. PennBarry, Division of Air System Components: www.pennbarry.com/#sle.
- E. Twin City Fan & Blower: www.tcf.com/#sle.
- F. Soler & Palau.

2.02 PERFORMANCE REQUIREMENTS

- A. See schedule on plans

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Provide backdraft dampers on discharge of exhaust fans..

END OF SECTION 233416

SECTION 260519 - LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Single conductor building wire.
- B. Underground feeder and branch-circuit cable.
- C. Metal-clad cable.
- D. Wiring connectors.
- E. Electrical tape.
- F. Oxide inhibiting compound.
- G. Wire pulling lubricant.

1.02 REFERENCE STANDARDS

- A. ASTM B3 - Standard Specification for Soft or Annealed Copper Wire 2013 (Reapproved 2018).
- B. ASTM B8 - Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft 2011 (Reapproved 2017).
- C. ASTM B33 - Standard Specification for Tin-Coated Soft or Annealed Copper Wire for Electrical Purposes 2010, with Editorial Revision (2020).
- D. ASTM B787/B787M - Standard Specification for 19 Wire Combination Unilay-Stranded Copper Conductors for Subsequent Insulation 2004 (Reapproved 2020).
- E. ASTM B800 - Standard Specification for 8000 Series Aluminum Alloy Wire for Electrical Purposes - Annealed and Intermediate Tempers 2005 (Reapproved 2021).
- F. ASTM B801 - Standard Specification for Concentric-Lay-Stranded Conductors of 8000 Series Aluminum Alloy for Subsequent Covering or Insulation 2018.
- G. ASTM D3005 - Standard Specification for Low-Temperature Resistant Vinyl Chloride Plastic Pressure-Sensitive Electrical Insulating Tape 2017.
- H. NECA 1 - Standard for Good Workmanship in Electrical Construction 2015.
- I. NECA 104 - Standard for Installing Aluminum Building Wire and Cable 2012.
- J. NECA 120 - Standard for Installing Armored Cable (AC) and Type Metal-Clad (MC) Cable 2018.
- K. NECA 121 - Standard for Installing Nonmetallic-Sheathed Cable (Type NM-B) and Underground Feeder and Branch-Circuit Cable (Type UF) 2007.
- L. NEMA WC 70 - Power Cables Rated 2000 Volts or Less for the Distribution of Electrical Energy 2021.
- M. NFPA 70 - National Electrical Code Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- N. UL 44 - Thermoset-Insulated Wires and Cables Current Edition, Including All Revisions.
- O. UL 83 - Thermoplastic-Insulated Wires and Cables Current Edition, Including All Revisions.
- P. UL 486A-486B - Wire Connectors Current Edition, Including All Revisions.
- Q. UL 486C - Splicing Wire Connectors Current Edition, Including All Revisions.
- R. UL 493 - Thermoplastic-Insulated Underground Feeder and Branch-Circuit Cables Current Edition, Including All Revisions.
- S. UL 510 - Polyvinyl Chloride, Polyethylene, and Rubber Insulating Tape Current Edition, Including All Revisions.
- T. UL 1569 - Metal-Clad Cables Current Edition, Including All Revisions.

1.03 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:

1. Coordinate sizes of raceways, boxes, and equipment enclosures installed under other sections with the actual conductors to be installed, including adjustments for conductor sizes increased for voltage drop.
2. Coordinate with electrical equipment installed under other sections to provide terminations suitable for use with the conductors to be installed.
3. Notify Architect of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.

1.04 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store conductors and cables in accordance with manufacturer's instructions.

PART 2 PRODUCTS

2.01 CONDUCTOR AND CABLE APPLICATIONS

- A. Do not use conductors and cables for applications other than as permitted by NFPA 70 and product listing.
- B. Provide single conductor building wire installed in suitable raceway unless otherwise indicated, permitted, or required.
- C. Nonmetallic-sheathed cable is not permitted.
- D. Metal-clad cable is permitted only as follows:
 1. Where not otherwise restricted, may be used:
 - a. Where concealed above accessible ceilings for final connections from junction boxes to luminaires.
 - 1) Maximum Length: 6 feet (1.8 m).

2.02 CONDUCTOR AND CABLE GENERAL REQUIREMENTS

- A. Provide products that comply with requirements of NFPA 70.
- B. Provide products listed, classified, and labeled as suitable for the purpose intended.
- C. Unless specifically indicated to be excluded, provide all required conduit, boxes, wiring, connectors, etc. as required for a complete operating system.
- D. Comply with NEMA WC 70.
- E. Thermoplastic-Insulated Conductors and Cables: Listed and labeled as complying with UL 83.
- F. Thermoset-Insulated Conductors and Cables: Listed and labeled as complying with UL 44.
- G. Conductor Material:
 1. Provide copper conductors except where aluminum conductors are specifically indicated. Substitution of aluminum conductors for copper is not permitted. Conductor sizes indicated are based on copper unless specifically indicated as aluminum. Conductors designated with the abbreviation "AL" indicate aluminum.
 2. Copper Conductors: Soft drawn annealed, 98 percent conductivity, uncoated copper conductors complying with ASTM B3, ASTM B8, or ASTM B787/B787M unless otherwise indicated.
 3. Tinned Copper Conductors: Comply with ASTM B33.
 4. Aluminum Conductors (only where specifically indicated or permitted for substitution): AA-8000 series aluminum alloy conductors recognized by ASTM B800 and compact stranded in accordance with ASTM B801 unless otherwise indicated.
- H. Conductor Color Coding:
 1. Color code conductors as indicated unless otherwise required by the authority having jurisdiction. Maintain consistent color coding throughout project.
 2. Color Coding Method: Integrally colored insulation.
 3. Color Code:
 - a. 208Y/120 V, 3 Phase, 4 Wire System:

- 1) Phase A: Black.
 - 2) Phase B: Red.
 - 3) Phase C: Blue.
 - 4) Neutral: White.
- b. Equipment Ground, All Systems: Green.

2.03 SINGLE CONDUCTOR BUILDING WIRE

- A. Manufacturers:
1. Copper Building Wire:
 - a. Cerro Wire LLC: www.cerrowire.com/#sle.
 - b. Encore Wire Corporation: www.encorewire.com/#sle.
 - c. General Cable Technologies Corporation: www.generalcable.com/#sle.
 - d. Southwire Company: www.southwire.com/#sle.
- B. Description: Single conductor insulated wire.
- C. Conductor Stranding:
1. Feeders and Branch Circuits:
 - a. Size 10 AWG and Smaller: Solid.
 - b. Size 8 AWG and Larger: Stranded.
- D. Insulation Voltage Rating: 600 V.
- E. Insulation:
1. Copper Building Wire: Type THHN/THWN or THHN/THWN-2, except as indicated below.
 - a. Installed Underground: Type XHHW-2.

2.04 UNDERGROUND FEEDER AND BRANCH-CIRCUIT CABLE

- A. Manufacturers:
1. Cerro Wire LLC: www.cerrowire.com/#sle.
 2. Encore Wire Corporation: www.encorewire.com/#sle.
 3. Southwire Company: www.southwire.com/#sle.
- B. Description: NFPA 70, Type UF multiple-conductor cable listed and labeled as complying with UL 493, Type UF-B.
- C. Provide equipment grounding conductor unless otherwise indicated.
- D. Conductor Stranding:
1. Size 10 AWG and Smaller: Solid.
 2. Size 8 AWG and Larger: Stranded.
- E. Insulation Voltage Rating: 600 V.

2.05 METAL-CLAD CABLE

- A. Manufacturers:
1. AFC Cable Systems Inc: www.afcweb.com/#sle.
 2. Encore Wire Corporation: www.encorewire.com/#sle.
 3. Southwire Company: www.southwire.com/#sle.
- B. Description: NFPA 70, Type MC cable listed and labeled as complying with UL 1569, and listed for use in classified firestop systems to be used.
- C. Conductor Stranding:
1. Size 10 AWG and Smaller: Solid.
 2. Size 8 AWG and Larger: Stranded.
- D. Insulation Voltage Rating: 600 V.
- E. Insulation: Type THHN, THHN/THWN, or THHN/THWN-2.
- F. Grounding: Full-size integral equipment grounding conductor.
- G. Armor: Steel, interlocked tape.

2.06 WIRING CONNECTORS

- A. Description: Wiring connectors appropriate for the application, suitable for use with the conductors to be connected, and listed as complying with UL 486A-486B or UL 486C as applicable.

2.07 ACCESSORIES

- A. Electrical Tape:
 - 1. Vinyl Insulating Electrical Tape: Complying with ASTM D3005 and listed as complying with UL 510; minimum thickness of 7 mil (0.18 mm); resistant to abrasion, corrosion, and sunlight; conformable for application down to 0 degrees F (-18 degrees C) and suitable for continuous temperature environment up to 221 degrees F (105 degrees C).
- B. Oxide Inhibiting Compound: Listed; suitable for use with the conductors or cables to be installed.
- C. Wire Pulling Lubricant: Listed; suitable for use with the conductors or cables to be installed and suitable for use at the installation temperature.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that interior of building has been protected from weather.
- B. Verify that work likely to damage wire and cable has been completed.
- C. Verify that raceways, boxes, and equipment enclosures are installed and are properly sized to accommodate conductors and cables in accordance with NFPA 70.
- D. Verify that field measurements are as indicated.
- E. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Circuiting Requirements:
 - 1. Unless dimensioned, circuit routing indicated is diagrammatic.
 - 2. When circuit destination is indicated without specific routing, determine exact routing required.
 - 3. Circuiting Adjustments: Unless otherwise indicated, when branch circuits are indicated as separate, combining them together in a single raceway is permitted, under the following conditions:
 - a. Increase size of conductors as required to account for ampacity derating.
 - b. Size raceways, boxes, etc. to accommodate conductors.
 - 4. Common Neutrals: Unless otherwise indicated, sharing of neutral/grounded conductors among single phase branch circuits of different phases installed in the same raceway is not permitted. Provide dedicated neutral/grounded conductor for each individual branch circuit.
- B. Install products in accordance with manufacturer's instructions.
- C. Perform work in accordance with NECA 1 (general workmanship).
- D. Install aluminum conductors in accordance with NECA 104.
- E. Install underground feeder and branch-circuit cable (Type UF-B) in accordance with NECA 121.
- F. Install metal-clad cable (Type MC) in accordance with NECA 120.
- G. Installation in Raceway:
 - 1. Tape ends of conductors and cables to prevent infiltration of moisture and other contaminants.
 - 2. Pull all conductors and cables together into raceway at same time.
 - 3. Do not damage conductors and cables or exceed manufacturer's recommended maximum pulling tension and sidewall pressure.
 - 4. Use suitable wire pulling lubricant where necessary, except when lubricant is not recommended by the manufacturer.
- H. Paralleled Conductors: Install conductors of the same length and terminate in the same manner.
- I. Secure and support conductors and cables in accordance with NFPA 70 using suitable supports and methods approved by the authority having jurisdiction. Provide independent support from building structure. Do not provide support from raceways, piping, ductwork, or other systems.

- J. Terminate cables using suitable fittings.
 - 1. Metal-Clad Cable (Type MC):
 - a. Use listed fittings.
 - b. Cut cable armor only using specialized tools to prevent damaging conductors or insulation. Do not use hacksaw or wire cutters to cut armor.
- K. Install conductors with a minimum of 12 inches (300 mm) of slack at each outlet.
- L. Neatly train and bundle conductors inside boxes, wireways, panelboards and other equipment enclosures.
- M. Group or otherwise identify neutral/grounded conductors with associated ungrounded conductors inside enclosures in accordance with NFPA 70.
- N. Make wiring connections using specified wiring connectors.
 - 1. Make splices and taps only in accessible boxes. Do not pull splices into raceways or make splices in conduit bodies or wiring gutters.
 - 2. Remove appropriate amount of conductor insulation for making connections without cutting, nicking or damaging conductors.
 - 3. Do not remove conductor strands to facilitate insertion into connector.
 - 4. Clean contact surfaces on conductors and connectors to suitable remove corrosion, oxides, and other contaminants. Do not use wire brush on plated connector surfaces.
 - 5. Connections for Aluminum Conductors: Fill connectors with oxide inhibiting compound where not pre-filled by manufacturer.
- O. Insulate splices and taps that are made with uninsulated connectors using methods suitable for the application, with insulation and mechanical strength at least equivalent to unspliced conductors.
- P. Insulate ends of spare conductors using vinyl insulating electrical tape.
- Q. Install firestopping to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 078400.
- R. Unless specifically indicated to be excluded, provide final connections to all equipment and devices, including those furnished by others, as required for a complete operating system.

END OF SECTION 260519

SECTION 260526 - GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Grounding and bonding requirements.
- B. Conductors for grounding and bonding.
- C. Connectors for grounding and bonding.

1.02 RELATED REQUIREMENTS

- A. Section 260519 - Low-Voltage Electrical Power Conductors and Cables: Additional requirements for conductors for grounding and bonding, including conductor color coding.
- B. Section 260553 - Identification for Electrical Systems: Identification products and requirements.

1.03 REFERENCE STANDARDS

- A. NECA 1 - Standard for Good Workmanship in Electrical Construction 2015.
- B. NFPA 70 - National Electrical Code Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- C. UL 467 - Grounding and Bonding Equipment Current Edition, Including All Revisions.

1.04 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.

PART 2 PRODUCTS

2.01 GROUNDING AND BONDING REQUIREMENTS

- A. Do not use products for applications other than as permitted by NFPA 70 and product listing.
- B. Unless specifically indicated to be excluded, provide all required components, conductors, connectors, conduit, boxes, fittings, supports, accessories, etc. as necessary for a complete grounding and bonding system.
- C. Where conductor size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.
- D. Grounding Electrode System:
 - 1. Provide connection to required and supplemental grounding electrodes indicated to form grounding electrode system.
 - a. Provide continuous grounding electrode conductors without splice or joint.
 - b. Install grounding electrode conductors in raceway where exposed to physical damage. Bond grounding electrode conductor to metallic raceways at each end with bonding jumper.
 - 2. Metal Underground Water Pipe(s):
 - a. Provide connection to underground metal domestic water service pipe(s) that are in direct contact with earth for at least 10 feet (3.0 m) at an accessible location not more than 5 feet (1.5 m) from the point of entrance to the building.
 - b. Provide bonding jumper(s) around insulating joints/pipes as required to make pipe electrically continuous.
 - c. Provide bonding jumper around water meter of sufficient length to permit removal of meter without disconnecting jumper.
 - 3. Concrete-Encased Electrode:
 - a. Provide connection to concrete-encased electrode consisting of not less than 20 feet (6.0 m) of either steel reinforcing bars or bare copper conductor not smaller than 4 AWG embedded within concrete foundation or footing that is in direct contact with earth in accordance with NFPA 70.
- E. Bonding and Equipment Grounding:
 - 1. Provide bonding for equipment grounding conductors, equipment ground busses, metallic equipment enclosures, metallic raceways and boxes, device grounding terminals, and other

normally non-current-carrying conductive materials enclosing electrical conductors/equipment or likely to become energized as indicated and in accordance with NFPA 70.

2. Provide insulated equipment grounding conductor in each feeder and branch circuit raceway. Do not use raceways as sole equipment grounding conductor.
3. Where circuit conductor sizes are increased for voltage drop, increase size of equipment grounding conductor proportionally in accordance with NFPA 70.
4. Unless otherwise indicated, connect wiring device grounding terminal to branch circuit equipment grounding conductor and to outlet box with bonding jumper.
5. Terminate branch circuit equipment grounding conductors on solidly bonded equipment ground bus only. Do not terminate on neutral (grounded) or isolated/insulated ground bus.
6. Provide bonding jumper across expansion or expansion/deflection fittings provided to accommodate conduit movement.
7. Provide bonding for interior metal piping systems in accordance with NFPA 70. This includes, but is not limited to:
 - a. Metal water piping where not already effectively bonded to metal underground water pipe used as grounding electrode.
8. Provide bonding for interior metal air ducts.

2.02 GROUNDING AND BONDING COMPONENTS

- A. General Requirements:
 1. Provide products listed, classified, and labeled as suitable for the purpose intended.
 2. Provide products listed and labeled as complying with UL 467 where applicable.
- B. Conductors for Grounding and Bonding, in Addition to Requirements of Section 260526:
 1. Use insulated copper conductors unless otherwise indicated.
 - a. Exceptions:
 - 1) Use bare copper conductors where installed underground in direct contact with earth.
 - 2) Use bare copper conductors where directly encased in concrete (not in raceway).
- C. Connectors for Grounding and Bonding:
 1. Description: Connectors appropriate for the application and suitable for the conductors and items to be connected; listed and labeled as complying with UL 467.
 2. Unless otherwise indicated, use exothermic welded connections for underground, concealed and other inaccessible connections.
 3. Unless otherwise indicated, use mechanical connectors, compression connectors, or exothermic welded connections for accessible connections.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that work likely to damage grounding and bonding system components has been completed.
- B. Verify that field measurements are as indicated.
- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Perform work in accordance with NECA 1 (general workmanship).
- C. Make grounding and bonding connections using specified connectors.
 1. Remove appropriate amount of conductor insulation for making connections without cutting, nicking or damaging conductors. Do not remove conductor strands to facilitate insertion into connector.
 2. Remove nonconductive paint, enamel, or similar coating at threads, contact points, and contact surfaces.
 3. Exothermic Welds: Make connections using molds and weld material suitable for the items to be connected in accordance with manufacturer's recommendations.

4. Mechanical Connectors: Secure connections according to manufacturer's recommended torque settings.
 5. Compression Connectors: Secure connections using manufacturer's recommended tools and dies.
- D. Identify grounding and bonding system components in accordance with Section 260553.

END OF SECTION 260526

SECTION 260529 - HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 RELATED REQUIREMENTS

- A. Section 033000 - Cast-in-Place Concrete: Concrete equipment pads.

1.02 REFERENCE STANDARDS

- A. ASTM A123/A123M - Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products 2017.
- B. ASTM A153/A153M - Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware 2016a.
- C. ASTM B633 - Standard Specification for Electrodeposited Coatings of Zinc on Iron and Steel 2015.
- D. MFMA-4 - Metal Framing Standards Publication 2004.
- E. NECA 1 - Standard for Good Workmanship in Electrical Construction 2015.
- F. NFPA 70 - National Electrical Code Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- G. NFPA 101 - Life Safety Code Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.

1.03 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate sizes and arrangement of supports and bases with the actual equipment and components to be installed.
 - 2. Coordinate the work with other trades to provide additional framing and materials required for installation.
 - 3. Coordinate compatibility of support and attachment components with mounting surfaces at the installed locations.
 - 4. Coordinate the arrangement of supports with ductwork, piping, equipment and other potential conflicts installed under other sections or by others.
 - 5. Notify Architect of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.
- B. Sequencing:
 - 1. Do not install products on or provide attachment to concrete surfaces until concrete has fully cured in accordance with Section 033000.

1.04 QUALITY ASSURANCE

- A. Comply with NFPA 70.
- B. Comply with applicable building code.

PART 2 PRODUCTS

2.01 SUPPORT AND ATTACHMENT COMPONENTS

- A. General Requirements:
 - 1. Provide all required hangers, supports, anchors, fasteners, fittings, accessories, and hardware as necessary for the complete installation of electrical work.
 - 2. Provide products listed, classified, and labeled as suitable for the purpose intended, where applicable.
 - 3. Where support and attachment component types and sizes are not indicated, select in accordance with manufacturer's application criteria as required for the load to be supported. Include consideration for vibration, equipment operation, and shock loads where applicable.
 - 4. Do not use products for applications other than as permitted by NFPA 70 and product listing.
 - 5. Steel Components: Use corrosion resistant materials suitable for the environment where installed.
 - a. Zinc-Plated Steel: Electroplated in accordance with ASTM B633.

- b. Galvanized Steel: Hot-dip galvanized after fabrication in accordance with ASTM A123/A123M or ASTM A153/A153M.
- B. Conduit and Cable Supports: Straps, clamps, etc. suitable for the conduit or cable to be supported.
 - 1. Conduit Straps: One-hole or two-hole type; steel or malleable iron.
 - 2. Conduit Clamps: Bolted type unless otherwise indicated.
- C. Outlet Box Supports: Hangers, brackets, etc. suitable for the boxes to be supported.
- D. Metal Channel (Strut) Framing Systems: Factory-fabricated continuous-slot metal channel (strut) and associated fittings, accessories, and hardware required for field-assembly of supports.
 - 1. Comply with MFMA-4.
- E. Hanger Rods: Threaded zinc-plated steel unless otherwise indicated.
 - 1. Minimum Size, Unless Otherwise Indicated or Required:
 - a. Equipment Supports: 1/2 inch (13 mm) diameter.
 - b. Single Conduit up to 1 inch (27 mm) trade size: 1/4 inch (6 mm) diameter.
 - c. Single Conduit larger than 1 inch (27 mm) trade size: 3/8 inch (10 mm) diameter.
- F. Anchors and Fasteners:
 - 1. Unless otherwise indicated and where not otherwise restricted, use the anchor and fastener types indicated for the specified applications.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that mounting surfaces are ready to receive support and attachment components.
- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Perform work in accordance with NECA 1 (general workmanship).
- C. Provide independent support from building structure. Do not provide support from piping, ductwork, or other systems.
- D. Unless specifically indicated or approved by Architect, do not provide support from suspended ceiling support system or ceiling grid.
- E. Unless specifically indicated or approved by Architect, do not provide support from roof deck.
- F. Do not penetrate or otherwise notch or cut structural members without approval of Structural Engineer.
- G. Equipment Support and Attachment:
 - 1. Use metal fabricated supports or supports assembled from metal channel (strut) to support equipment as required.
 - 2. Use metal channel (strut) secured to studs to support equipment surface-mounted on hollow stud walls when wall strength is not sufficient to resist pull-out.
 - 3. Use metal channel (strut) to support surface-mounted equipment in wet or damp locations to provide space between equipment and mounting surface.
 - 4. Securely fasten floor-mounted equipment. Do not install equipment such that it relies on its own weight for support.
- H. Secure fasteners according to manufacturer's recommended torque settings.
- I. Remove temporary supports.

END OF SECTION 260529

SECTION 260533.13 - CONDUIT FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Galvanized steel rigid metal conduit (RMC).
- B. Electrical metallic tubing (EMT).
- C. Rigid polyvinyl chloride (PVC) conduit.
- D. Conduit fittings.

1.02 RELATED REQUIREMENTS

- A. Section 078400 - Firestopping.
- B. Section 260526 - Grounding and Bonding for Electrical Systems.
- C. Section 260529 - Hangers and Supports for Electrical Systems.
- D. Section 260533.16 - Boxes for Electrical Systems.
- E. Section 260553 - Identification for Electrical Systems: Identification products and requirements.

1.03 REFERENCE STANDARDS

- A. ANSI C80.1 - American National Standard for Electrical Rigid Steel Conduit (ERSC) 2020.
- B. ANSI C80.3 - American National Standard for Electrical Metallic Tubing -- Steel (EMT-S) 2020.
- C. NECA 1 - Standard for Good Workmanship in Electrical Construction 2015.
- D. NECA 101 - Standard for Installing Steel Conduits (Rigid, IMC, EMT) 2013.
- E. NECA 111 - Standard for Installing Nonmetallic Raceways (RNC, ENT, LFNC) 2017.
- F. NEMA FB 1 - Fittings, Cast Metal Boxes, and Conduit Bodies for Conduit, Electrical Metallic Tubing, and Cable 2014.
- G. NEMA TC 2 - Electrical Polyvinyl Chloride (PVC) Conduit 2020.
- H. NEMA TC 3 - Polyvinyl Chloride (PVC) Fittings for Use with Rigid PVC Conduit and Tubing 2021.
- I. NFPA 70 - National Electrical Code Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- J. UL 6 - Electrical Rigid Metal Conduit-Steel Current Edition, Including All Revisions.
- K. UL 514B - Conduit, Tubing, and Cable Fittings Current Edition, Including All Revisions.
- L. UL 651 - Schedule 40, 80, Type EB and A Rigid PVC Conduit and Fittings Current Edition, Including All Revisions.
- M. UL 797 - Electrical Metallic Tubing-Steel Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate minimum sizes of conduits with the actual conductors to be installed, including adjustments for conductor sizes increased for voltage drop.
 - 2. Coordinate the arrangement of conduits with structural members, ductwork, piping, equipment and other potential conflicts installed under other sections or by others.
 - 3. Verify exact conduit termination locations required for boxes, enclosures, and equipment installed under other sections or by others.
 - 4. Coordinate the work with other trades to provide roof penetrations that preserve the integrity of the roofing system and do not void the roof warranty.
 - 5. Notify Architect of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.
- B. Sequencing:

1. Do not begin installation of conductors and cables until installation of conduit is complete between outlet, junction and splicing points.

1.05 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.

PART 2 PRODUCTS

2.01 CONDUIT APPLICATIONS

- A. Do not use conduit and associated fittings for applications other than as permitted by NFPA 70 and product listing.
- B. Unless otherwise indicated and where not otherwise restricted, use the conduit types indicated for the specified applications. Where more than one listed application applies, comply with the most restrictive requirements. Where conduit type for a particular application is not specified, use galvanized steel rigid metal conduit.
- C. Underground:
 1. Under Slab on Grade: Use rigid PVC conduit.
- D. Concealed Within Masonry Walls: Use galvanized steel rigid metal conduit or electrical metallic tubing (EMT).
- E. Exposed, Interior, Not Subject to Physical Damage: Use electrical metallic tubing (EMT).
- F. Exposed, Interior, Subject to Physical Damage: Use galvanized steel rigid metal conduit.
- G. Exposed, Exterior: Use galvanized steel rigid metal conduit.

2.02 CONDUIT REQUIREMENTS

- A. Provide all conduit, fittings, supports, and accessories required for a complete raceway system.
- B. Provide products listed, classified, and labeled as suitable for the purpose intended.
- C. Minimum Conduit Size, Unless Otherwise Indicated:
- D. Where conduit size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.

2.03 GALVANIZED STEEL RIGID METAL CONDUIT (RMC)

- A. Description: NFPA 70, Type RMC galvanized steel rigid metal conduit complying with ANSI C80.1 and listed and labeled as complying with UL 6.
- B. Fittings:
 1. Non-Hazardous Locations: Use fittings complying with NEMA FB 1 and listed and labeled as complying with UL 514B.
 2. Material: Use steel or malleable iron.
 3. Connectors and Couplings: Use threaded type fittings only. Threadless set screw and compression (gland) type fittings are not permitted.

2.04 ELECTRICAL METALLIC TUBING (EMT)

- A. Description: NFPA 70, Type EMT steel electrical metallic tubing complying with ANSI C80.3 and listed and labeled as complying with UL 797.
- B. Fittings:
 1. Description: Fittings complying with NEMA FB 1 and listed and labeled as complying with UL 514B.
 2. Material: Use steel or malleable iron.
 3. Connectors and Couplings: Use set-screw type.
 - a. Do not use indenter type connectors and couplings.

2.05 RIGID POLYVINYL CHLORIDE (PVC) CONDUIT

- A. Description: NFPA 70, Type PVC rigid polyvinyl chloride conduit complying with NEMA TC 2 and listed and labeled as complying with UL 651; Schedule 40 unless otherwise indicated, Schedule 80 where subject to physical damage; rated for use with conductors rated 90 degrees C.
- B. Fittings:
 - 1. Manufacturer: Same as manufacturer of conduit to be connected.
 - 2. Description: Fittings complying with NEMA TC 3 and listed and labeled as complying with UL 651; material to match conduit.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that mounting surfaces are ready to receive conduits.
- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Perform work in accordance with NECA 1 (general workmanship).
- C. Install galvanized steel rigid metal conduit (RMC) in accordance with NECA 101.
- D. Install rigid polyvinyl chloride (PVC) conduit in accordance with NECA 111.
- E. Conduit Routing:
 - 1. When conduit destination is indicated without specific routing, determine exact routing required.
 - 2. Conceal all conduits unless specifically indicated to be exposed.
 - 3. Conduits in the following areas may be exposed, unless otherwise indicated:
 - a. Electrical rooms.
 - b. Mechanical equipment rooms.
 - c. Within joists in areas with no ceiling.
 - 4. Conduits installed underground or embedded in concrete may be routed in the shortest possible manner unless otherwise indicated. Route all other conduits parallel or perpendicular to building structure and surfaces, following surface contours where practical.
 - 5. Arrange conduit to maintain adequate headroom, clearances, and access.
- F. Conduit Support:
 - 1. Secure and support conduits in accordance with NFPA 70 and Section 260529 using suitable supports and methods approved by the authority having jurisdiction.
 - 2. Provide independent support from building structure. Do not provide support from piping, ductwork, or other systems.
- G. Connections and Terminations:
 - 1. Use approved zinc-rich paint or conduit joint compound on field-cut threads of galvanized steel conduits prior to making connections.
 - 2. Where two threaded conduits must be joined and neither can be rotated, use three-piece couplings or split couplings. Do not use running threads.
 - 3. Use suitable adapters where required to transition from one type of conduit to another.
 - 4. Terminate threaded conduits in boxes and enclosures using threaded hubs or double lock nuts for dry locations and raintight hubs for wet locations.
 - 5. Provide insulating bushings or insulated throats at all conduit terminations to protect conductors.
 - 6. Secure joints and connections to provide maximum mechanical strength and electrical continuity.
- H. Penetrations:
 - 1. Do not penetrate or otherwise notch or cut structural members, including footings and grade beams, without approval of Structural Engineer.
 - 2. Make penetrations perpendicular to surfaces unless otherwise indicated.
 - 3. Provide sleeves for penetrations as indicated or as required to facilitate installation. Set sleeves flush with exposed surfaces unless otherwise indicated or required.

4. Conceal bends for conduit risers emerging above ground.
 5. Seal interior of conduits entering the building from underground at first accessible point to prevent entry of moisture and gases.
 6. Where conduits penetrate waterproof membrane, seal as required to maintain integrity of membrane.
 7. Make penetrations for roof-mounted equipment within associated equipment openings and curbs where possible to minimize roofing system penetrations. Where penetrations are necessary, seal as indicated or as required to preserve integrity of roofing system and maintain roof warranty. Include proposed locations of penetrations and methods for sealing with submittals.
 8. Install firestopping to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 078400.
- I. Underground Installation:
1. Minimum Cover, Unless Otherwise Indicated or Required:
 - a. Underground, Exterior: 36" .
 2. Provide underground warning tape in accordance with Section 260553 along entire conduit length for service entrance where not concrete-encased.
- J. Conduit Movement Provisions: Where conduits are subject to movement, provide expansion and expansion/deflection fittings to prevent damage to enclosed conductors or connected equipment.
1. Where calculated in accordance with NFPA 70 for rigid polyvinyl chloride (PVC) conduit installed above ground to compensate for thermal expansion and contraction.
- K. Condensation Prevention: Where conduits cross barriers between areas of potential substantial temperature differential, provide sealing fitting or approved sealing compound at an accessible point near the penetration to prevent condensation. This includes, but is not limited to:
1. Where conduits pass from outdoors into conditioned interior spaces.
 2. Where conduits pass from unconditioned interior spaces into conditioned interior spaces.
- L. Provide grounding and bonding in accordance with Section 260526.

END OF SECTION 260533.13

SECTION 260533.16 - BOXES FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Outlet and device boxes up to 100 cubic inches (1,650 cu cm), including those used as junction and pull boxes.
- B. Cabinets and enclosures, including junction and pull boxes larger than 100 cubic inches (1,650 cu cm).

1.02 RELATED REQUIREMENTS

- A. Section 083100 - Access Doors and Panels: Panels for maintaining access to concealed boxes.
- B. Section 260526 - Grounding and Bonding for Electrical Systems.
- C. Section 260529 - Hangers and Supports for Electrical Systems.
- D. Section 260533.13 - Conduit for Electrical Systems:
 - 1. Conduit bodies and other fittings.
- E. Section 262726 - Wiring Devices:
 - 1. Wall plates.

1.03 REFERENCE STANDARDS

- A. NECA 1 - Standard for Good Workmanship in Electrical Construction 2015.
- B. NECA 130 - Standard for Installing and Maintaining Wiring Devices 2016.
- C. NEMA FB 1 - Fittings, Cast Metal Boxes, and Conduit Bodies for Conduit, Electrical Metallic Tubing, and Cable 2014.
- D. NEMA OS 1 - Sheet-Steel Outlet Boxes, Device Boxes, Covers, and Box Supports 2013 (Reaffirmed 2020).
- E. NEMA 250 - Enclosures for Electrical Equipment (1000 Volts Maximum) 2020.
- F. NFPA 70 - National Electrical Code Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- G. UL 50 - Enclosures for Electrical Equipment, Non-Environmental Considerations Current Edition, Including All Revisions.
- H. UL 50E - Enclosures for Electrical Equipment, Environmental Considerations Current Edition, Including All Revisions.
- I. UL 508A - Industrial Control Panels Current Edition, Including All Revisions.
- J. UL 514A - Metallic Outlet Boxes Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate the work with other trades to avoid placement of ductwork, piping, equipment, or other potential obstructions within the dedicated equipment spaces and working clearances for electrical equipment required by NFPA 70.
 - 2. Coordinate arrangement of electrical equipment with the dimensions and clearance requirements of the actual equipment to be installed.
 - 3. Coordinate minimum sizes of boxes with the actual installed arrangement of conductors, clamps, support fittings, and devices, calculated according to NFPA 70.
 - 4. Coordinate minimum sizes of pull boxes with the actual installed arrangement of connected conduits, calculated according to NFPA 70.
 - 5. Coordinate the placement of boxes with millwork, furniture, devices, equipment, etc. installed under other sections or by others.
 - 6. Coordinate the work with other trades to preserve insulation integrity.
 - 7. Coordinate the work with other trades to provide walls suitable for installation of flush-mounted boxes where indicated.

8. Notify Architect of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.

1.05 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.

PART 2 PRODUCTS

2.01 BOXES

- A. General Requirements:
 1. Do not use boxes and associated accessories for applications other than as permitted by NFPA 70 and product listing.
 2. Provide all boxes, fittings, supports, and accessories required for a complete raceway system and to accommodate devices and equipment to be installed.
 3. Provide products listed, classified, and labeled as suitable for the purpose intended.
 4. Where box size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.
 5. Provide grounding terminals within boxes where equipment grounding conductors terminate.
- B. Outlet and Device Boxes Up to 100 cubic inches (1,650 cu cm), Including Those Used as Junction and Pull Boxes:
 1. Use sheet-steel boxes for dry locations unless otherwise indicated or required.
 2. Use cast iron boxes or cast aluminum boxes for damp or wet locations unless otherwise indicated or required; furnish with compatible weatherproof gasketed covers.
 3. Use suitable concrete type boxes where flush-mounted in concrete.
 4. Use suitable masonry type boxes where flush-mounted in masonry walls.
 5. Use raised covers suitable for the type of wall construction and device configuration where required.
 6. Use shallow boxes where required by the type of wall construction.
 7. Do not use "through-wall" boxes designed for access from both sides of wall.
 8. Sheet-Steel Boxes: Comply with NEMA OS 1, and list and label as complying with UL 514A.
 9. Cast Metal Boxes: Comply with NEMA FB 1, and list and label as complying with UL 514A; furnish with threaded hubs.
 10. Boxes for Supporting Luminaires and Ceiling Fans: Listed as suitable for the type and weight of load to be supported; furnished with fixture stud to accommodate mounting of luminaire where required.
 11. Boxes for Ganged Devices: Use multigang boxes of single-piece construction. Do not use field-connected gangable boxes unless specifically indicated or permitted.
 12. Wall Plates: Comply with Section 262726.
- C. Cabinets and Enclosures, Including Junction and Pull Boxes Larger Than 100 cubic inches (1,650 cu cm):
 1. Comply with NEMA 250, and list and label as complying with UL 50 and UL 50E, or UL 508A.
 2. NEMA 250 Environment Type, Unless Otherwise Indicated:
 - a. Indoor Clean, Dry Locations: Type 1, painted steel.
 3. Junction and Pull Boxes Larger Than 100 cubic inches (1,650 cu cm):
 - a. Provide screw-cover enclosures unless otherwise indicated.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that mounting surfaces are ready to receive boxes.
- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.

- B. Install boxes in accordance with NECA 1 (general workmanship) and, where applicable, NECA 130, including mounting heights specified in those standards where mounting heights are not indicated.
- C. Arrange equipment to provide minimum clearances in accordance with manufacturer's instructions and NFPA 70.
- D. Box Locations:
 - 1. Locate boxes to be accessible. Provide access panels in accordance with Section 083100 as required where approved by the Architect.
 - 2. Unless dimensioned, box locations indicated are approximate.
 - 3. Locate boxes as required for devices installed under other sections or by others.
 - 4. Locate boxes so that wall plates do not span different building finishes.
 - 5. Locate boxes so that wall plates do not cross masonry joints.
- E. Box Supports:
 - 1. Secure and support boxes in accordance with NFPA 70 and Section 260529 using suitable supports and methods approved by the authority having jurisdiction.
 - 2. Provide independent support from building structure except for cast metal boxes (other than boxes used for fixture support) supported by threaded conduit connections in accordance with NFPA 70. Do not provide support from piping, ductwork, or other systems.
- F. Install boxes plumb and level.
- G. Flush-Mounted Boxes:
 - 1. Install boxes in noncombustible materials such as concrete, tile, gypsum, plaster, etc. so that front edge of box or associated raised cover is not set back from finished surface more than 1/4 inch (6 mm) or does not project beyond finished surface.
 - 2. Install boxes in combustible materials such as wood so that front edge of box or associated raised cover is flush with finished surface.
 - 3. Repair rough openings around boxes in noncombustible materials such as concrete, tile, gypsum, plaster, etc. so that there are no gaps or open spaces greater than 1/8 inch (3 mm) at the edge of the box.
- H. Install boxes as required to preserve insulation integrity.
- I. Install permanent barrier between ganged wiring devices when voltage between adjacent devices exceeds 300 V.
- J. Install firestopping to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 078400.
- K. Close unused box openings.
- L. Install blank wall plates on junction boxes and on outlet boxes with no devices or equipment installed or designated for future use.
- M. Provide grounding and bonding in accordance with Section 260526.

END OF SECTION 260533.16

SECTION 260553 - IDENTIFICATION FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Electrical identification requirements.
- B. Identification nameplates and labels.
- C. Warning signs and labels.

1.02 RELATED REQUIREMENTS

- A. Section 260519 - Low-Voltage Electrical Power Conductors and Cables: Color coding for power conductors and cables 600 V and less; vinyl color coding electrical tape.

1.03 REFERENCE STANDARDS

- A. ANSI Z535.2 - American National Standard for Environmental and Facility Safety Signs 2011 (Reaffirmed 2017).
- B. ANSI Z535.4 - American National Standard for Product Safety Signs and Labels 2011 (Reaffirmed 2017).
- C. NFPA 70 - National Electrical Code Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- D. NFPA 70E - Standard for Electrical Safety in the Workplace 2021.
- E. UL 969 - Marking and Labeling Systems Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Verify final designations for equipment, systems, and components to be identified prior to fabrication of identification products.
- B. Sequencing:
 - 1. Do not conceal items to be identified, in locations such as above suspended ceilings, until identification products have been installed.
 - 2. Do not install identification products until final surface finishes and painting are complete.

1.05 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.

1.06 FIELD CONDITIONS

- A. Do not install adhesive products when ambient temperature is lower than recommended by manufacturer.

PART 2 PRODUCTS

2.01 IDENTIFICATION REQUIREMENTS

- A. Identification for Equipment:
 - 1. Use identification nameplate to identify each piece of electrical distribution and control equipment and associated sections, compartments, and components.
 - a. Panelboards:
 - 1) Identify ampere rating.
 - 2) Identify voltage and phase.
 - 3) Identify power source and circuit number. Include location when not within sight of equipment.
 - 4) Use typewritten circuit directory to identify load(s) served for panelboards with a door. Identify spares and spaces.
 - 5) For power panelboards without a door, use identification nameplate to identify load(s) served for each branch device. Do not identify spares and spaces.

2. Available Fault Current Documentation: Use identification label to identify the available fault current and date calculations were performed at locations requiring documentation by NFPA 70 including but not limited to the following.
 - a. Service equipment.
 - b. Industrial control panels.
 - c. Motor control centers.
 - d. Elevator control panels.
 - e. Industrial machinery.
 3. Arc Flash Hazard Warning Labels: Use warning labels to identify arc flash hazards for electrical equipment, such as switchboards, panelboards, industrial control panels, meter socket enclosures, and motor control centers that are likely to require examination, adjustment, servicing, or maintenance while energized.
 - a. Minimum Size: 3.5 by 5 inches (89 mm by 127 mm).
 - b. Legend: Include orange header that reads "WARNING", followed by the word message "Arc Flash and Shock Hazard; Appropriate PPE Required; Do not operate controls or open covers without appropriate personal protection equipment; Failure to comply may result in injury or death; Refer to NFPA 70E for minimum PPE requirements" or approved equivalent.
- B. Identification for Conductors and Cables:
1. Color Coding for Power Conductors 600 V and Less: Comply with Section 260519.
 2. Use identification nameplate or identification label to identify color code for ungrounded and grounded power conductors inside door or enclosure at each piece of feeder or branch-circuit distribution equipment when premises has feeders or branch circuits served by more than one nominal voltage system.

2.02 IDENTIFICATION NAMEPLATES AND LABELS

- A. Identification Nameplates:
1. Materials:
 - a. Indoor Clean, Dry Locations: Use plastic nameplates.
 2. Plastic Nameplates: Two-layer or three-layer laminated acrylic or electrically non-conductive phenolic with beveled edges; minimum thickness of 1/16 inch (1.6 mm); engraved text.
 3. Mounting Holes for Mechanical Fasteners: Two, centered on sides for sizes up to 1 inch (25 mm) high; Four, located at corners for larger sizes.
- B. Identification Labels:
1. Materials: Use self-adhesive laminated plastic labels; UV, chemical, water, heat, and abrasion resistant.
 2. Text: Use factory pre-printed or machine-printed text. Do not use handwritten text unless otherwise indicated.

2.03 WARNING SIGNS AND LABELS

- A. Comply with ANSI Z535.2 or ANSI Z535.4 as applicable.
- B. Warning Signs:
1. Materials:
 2. Minimum Size: 7 by 10 inches (178 by 254 mm) unless otherwise indicated.
- C. Warning Labels:
1. Materials: Use factory pre-printed or machine-printed self-adhesive polyester or self-adhesive vinyl labels; UV, chemical, water, heat, and abrasion resistant; produced using materials recognized to UL 969.
 2. Machine-Printed Labels: Use thermal transfer process printing machines and accessories recommended by label manufacturer.
 3. Minimum Size: 2 by 4 inches (51 mm by 102 mm) unless otherwise indicated.

PART 3 EXECUTION

3.01 PREPARATION

- A. Clean surfaces to receive adhesive products according to manufacturer's instructions.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install identification products to be plainly visible for examination, adjustment, servicing, and maintenance. Unless otherwise indicated, locate products as follows:
 - 1. Surface-Mounted Equipment: Enclosure front.
 - 2. Flush-Mounted Equipment: Inside of equipment door.
 - 3. Free-Standing Equipment: Enclosure front; also enclosure rear for equipment with rear access.
 - 4. Elevated Equipment: Legible from the floor or working platform.
 - 5. Branch Devices: Adjacent to device.
 - 6. Interior Components: Legible from the point of access.
 - 7. Conductors and Cables: Legible from the point of access.
- C. Install identification products centered, level, and parallel with lines of item being identified.
- D. Secure nameplates to exterior surfaces of enclosures using stainless steel screws and to interior surfaces using self-adhesive backing or epoxy cement.
- E. Install self-adhesive labels and markers to achieve maximum adhesion, with no bubbles or wrinkles and edges properly sealed.

END OF SECTION 260553

SECTION 262416 - PANELBOARDS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Load centers.
- B. Overcurrent protective devices for panelboards.

1.02 RELATED REQUIREMENTS

- A. Section 260526 - Grounding and Bonding for Electrical Systems.
- B. Section 260529 - Hangers and Supports for Electrical Systems.

1.03 REFERENCE STANDARDS

- A. FS W-C-375 - Circuit Breakers, Molded Case; Branch Circuit and Service 2013e (Amended 2017).
- B. NECA 1 - Standard for Good Workmanship in Electrical Construction 2015.
- C. NECA 407 - Standard for Installing and Maintaining Panelboards 2015.
- D. NEMA 250 - Enclosures for Electrical Equipment (1000 Volts Maximum) 2020.
- E. NEMA PB 1.1 - General Instructions for Proper Installation, Operation and Maintenance of Panelboards Rated 600 Volts or Less 2013.
- F. NFPA 70 - National Electrical Code Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- G. UL 50 - Enclosures for Electrical Equipment, Non-Environmental Considerations Current Edition, Including All Revisions.
- H. UL 50E - Enclosures for Electrical Equipment, Environmental Considerations Current Edition, Including All Revisions.
- I. UL 67 - Panelboards Current Edition, Including All Revisions.
- J. UL 489 - Molded-Case Circuit Breakers, Molded-Case Switches and Circuit Breaker Enclosures Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate the work with other trades to avoid placement of ductwork, piping, equipment, or other potential obstructions within the dedicated equipment spaces and working clearances for electrical equipment required by NFPA 70.
 - 2. Coordinate arrangement of electrical equipment with the dimensions and clearance requirements of the actual equipment to be installed.
 - 3. Verify with manufacturer that conductor terminations are suitable for use with the conductors to be installed.
 - 4. Notify Architect of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.

1.05 SUBMITTALS

- A. Product Data: Provide manufacturer's standard catalog pages and data sheets for panelboards, enclosures, overcurrent protective devices, and other installed components and accessories.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store panelboards in accordance with manufacturer's instructions and NECA 407.
- B. Store in a clean, dry space. Maintain factory wrapping or provide an additional heavy canvas or heavy plastic cover to protect units from dirt, water, construction debris, and traffic.

- C. Handle carefully in accordance with manufacturer's written instructions to avoid damage to panelboard internal components, enclosure, and finish.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Eaton Corporation: www.eaton.com/#sle.
- B. Schneider Electric; Square D Products: www.schneider-electric.us/#sle.
- C. Siemens Industry, Inc: www.usa.siemens.com/#sle.

2.02 PANELBOARDS - GENERAL REQUIREMENTS

- A. Provide products listed, classified, and labeled as suitable for the purpose intended.
- B. Unless otherwise indicated, provide products suitable for continuous operation under the following service conditions:
 - 1. Altitude: Less than 6,600 feet (2,000 m).
 - 2. Ambient Temperature:
 - a. Panelboards Containing Circuit Breakers: Between 23 degrees F (-5 degrees C) and 104 degrees F (40 degrees C).
- C. Short Circuit Current Rating:
 - 1. Provide panelboards with listed short circuit current rating as indicated on the drawings.
- D. Mains: Configure for top or bottom incoming feed as indicated or as required for the installation.
- E. Branch Overcurrent Protective Devices: Replaceable without disturbing adjacent devices.
- F. Bussing: Sized in accordance with UL 67 temperature rise requirements.
 - 1. Provide fully rated neutral bus unless otherwise indicated, with a suitable lug for each feeder or branch circuit requiring a neutral connection.
 - 2. Provide solidly bonded equipment ground bus in each panelboard, with a suitable lug for each feeder and branch circuit equipment grounding conductor.
- G. Conductor Terminations: Suitable for use with the conductors to be installed.
- H. Enclosures: Comply with NEMA 250, and list and label as complying with UL 50 and UL 50E.
 - 1. Environment Type per NEMA 250: Unless otherwise indicated, as specified for the following installation locations:
 - a. Outdoor Locations: NEMA 3R
 - 2. Boxes: Galvanized steel unless otherwise indicated.
 - a. Provide wiring gutters sized to accommodate the conductors to be installed.
 - 3. Fronts:
 - a. Fronts for Surface-Mounted Enclosures: Same dimensions as boxes.
 - 4. Lockable Doors: All locks keyed alike unless otherwise indicated.
- I. Future Provisions: Prepare all unused spaces for future installation of devices including bussing, connectors, mounting hardware and all other required provisions.

2.03 LOAD CENTERS

- A. Description: Circuit breaker type load centers listed and labeled as complying with UL 67; ratings, configurations, and features as indicated on the drawings.
- B. Bussing:
 - 1. Phase Bus Connections: Arranged for sequential phasing of overcurrent protective devices.
 - 2. Bus Material: Aluminum or copper.
- C. Circuit Breakers: Thermal magnetic plug-in type.
- D. Enclosures:
 - 1. Provide surface-mounted enclosures unless otherwise indicated.
 - 2. Provide circuit directory label on inside of door or individual circuit labels adjacent to circuit breakers.

2.04 OVERCURRENT PROTECTIVE DEVICES

- A. Molded Case Circuit Breakers:
 - 1. Description: Quick-make, quick-break, over center toggle, trip-free, trip-indicating circuit breakers listed and labeled as complying with UL 489, and complying with FS W-C-375 where applicable; ratings, configurations, and features as indicated on the drawings.
 - 2. Interrupting Capacity:
 - a. Provide circuit breakers with interrupting capacity as required to provide the short circuit current rating indicated, but not less than:
 - b. Fully Rated Systems: Provide circuit breakers with interrupting capacity not less than the short circuit current rating indicated.
 - 3. Conductor Terminations:
 - a. Provide mechanical lugs unless otherwise indicated.
 - b. Lug Material: Aluminum, suitable for terminating aluminum or copper conductors.
 - 4. Thermal Magnetic Circuit Breakers: For each pole, furnish thermal inverse time tripping element for overload protection and magnetic instantaneous tripping element for short circuit protection.
 - 5. Multi-Pole Circuit Breakers: Furnish with common trip for all poles.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that the ratings and configurations of the panelboards and associated components are consistent with the indicated requirements.
- C. Verify that mounting surfaces are ready to receive panelboards.
- D. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Perform work in accordance with NECA 1 (general workmanship).
- B. Install products in accordance with manufacturer's instructions.
- C. Install panelboards in accordance with NECA 407 and NEMA PB 1.1.
- D. Arrange equipment to provide minimum clearances in accordance with manufacturer's instructions and NFPA 70.
- E. Provide required support and attachment in accordance with Section 260529.
- F. Install panelboards plumb.
- G. Mount panelboards such that the highest position of any operating handle for circuit breakers or switches does not exceed 79 inches (2000 mm) above the floor or working platform.
- H. Provide grounding and bonding in accordance with Section 260526.
- I. Install all field-installed branch devices, components, and accessories.
- J. Provide filler plates to cover unused spaces in panelboards.

3.03 CLEANING

- A. Clean dirt and debris from panelboard enclosures and components according to manufacturer's instructions.
- B. Repair scratched or marred exterior surfaces to match original factory finish.

END OF SECTION 262416

SECTION 262726 - WIRING DEVICES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Receptacles.
- B. Wall plates.
- C. Occupancy sensors
- D. Wall switches

1.02 RELATED REQUIREMENTS

- A. Section 260533.16 - Boxes for Electrical Systems.

1.03 REFERENCE STANDARDS

- A. FS W-C-596 - Connector, Electrical, Power, General Specification for 2014h, with Amendments (2017).
- B. NECA 1 - Standard for Good Workmanship in Electrical Construction 2015.
- C. NECA 130 - Standard for Installing and Maintaining Wiring Devices 2016.
- D. NEMA WD 1 - General Color Requirements for Wiring Devices 1999 (Reaffirmed 2020).
- E. NEMA WD 6 - Wiring Devices - Dimensional Specifications 2016.
- F. NFPA 70 - National Electrical Code Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- G. UL 498 - Attachment Plugs and Receptacles Current Edition, Including All Revisions.
- H. UL 514D - Cover Plates for Flush-Mounted Wiring Devices Current Edition, Including All Revisions.
- I. UL 943 - Ground-Fault Circuit-Interrupters Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate the placement of outlet boxes with millwork, furniture, equipment, etc. installed under other sections or by others.
 - 2. Coordinate wiring device ratings and configurations with the electrical requirements of actual equipment to be installed.
 - 3. Coordinate the placement of outlet boxes for wall switches with actual installed door swings.
 - 4. Coordinate the installation and preparation of uneven surfaces, such as split face block, to provide suitable surface for installation of wiring devices.
 - 5. Notify Architect of any conflicts or deviations from Contract Documents to obtain direction prior to proceeding with work.

1.05 SUBMITTALS

- A. Product Data: Provide manufacturer's catalog information showing dimensions, colors, and configurations.
- B. Project Record Documents: Record actual installed locations of wiring devices.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.
- B. Products: Listed, classified, and labeled as suitable for the purpose intended.

1.07 DELIVERY, STORAGE, AND PROTECTION

- A. Store in a clean, dry space in original manufacturer's packaging until ready for installation.

PART 2 PRODUCTS

2.01 WIRING DEVICE APPLICATIONS

- A. Provide wiring devices suitable for intended use and with ratings adequate for load served.

- B. Provide GFCI protection for receptacles installed within 6 feet (1.8 m) of sinks.

2.02 WIRING DEVICE FINISHES

- A. Provide wiring device finishes as described below unless otherwise indicated.
- B. Wiring Devices Installed in Finished Spaces: White with white nylon wall plate.

2.03 RECEPTACLES

- A. Manufacturers:
 - 1. Hubbell Incorporated: www.hubbell.com/#sle.
 - 2. Leviton Manufacturing Company, Inc: www.leviton.com/#sle.
 - 3. Lutron Electronics Company, Inc: www.lutron.com/#sle.
 - 4. Pass & Seymour, a brand of Legrand North America, Inc: www.legrand.us/#sle.
- B. Receptacles - General Requirements: Self-grounding, complying with NEMA WD 1 and NEMA WD 6, and listed as complying with UL 498, and where applicable, FS W-C-596; types as indicated on the drawings.
 - 1. Wiring Provisions: Terminal screws for side wiring with separate ground terminal screw.
 - 2. NEMA configurations specified are according to NEMA WD 6.
- C. Convenience Receptacles:
- D. GFCI Receptacles:
 - 1. GFCI Receptacles - General Requirements: Self-testing, with feed-through protection and light to indicate ground fault tripped condition and loss of protection; listed as complying with UL 943, class A.
 - a. Provide test and reset buttons of same color as device.
 - 2. Tamper Resistant GFCI Receptacles: Industrial specification grade, duplex, 20A, 125V, NEMA 5-20R, rectangular decorator style, listed and labeled as tamper resistant type.
 - a. Products:
 - 1) Hubbell Incorporated: www.hubbell-wiring.com/#sle.
 - 2) Leviton Manufacturing Company, Inc: www.leviton.com/#sle.
 - 3) Lutron Electronics Company, Inc: www.lutron.com/#sle.
 - 4) Pass & Seymour, a brand of Legrand North America, Inc: www.legrand.us/#sle.

2.04 WALL PLATES

- A. Manufacturers:
 - 1. Hubbell Incorporated: www.hubbell-wiring.com/#sle.
 - 2. Leviton Manufacturing Company, Inc: www.leviton.com/#sle.
 - 3. Lutron Electronics Company, Inc: www.lutron.com/#sle.
 - 4. Pass & Seymour, a brand of Legrand North America, Inc: www.legrand.us/#sle.
- B. Wall Plates: Comply with UL 514D.
 - 1. Configuration: One piece cover as required for quantity and types of corresponding wiring devices.
 - 2. Size: Standard.
 - 3. Screws: Metal with slotted heads finished to match wall plate finish.
- C. Nylon Wall Plates: Smooth finish, high-impact thermoplastic.

2.05 OCCUPANCY SENSORS

- A. All Occupancy Sensors:
 - 1. Description: Factory-assembled commercial specification grade devices for indoor use capable of sensing both major motion, such as walking, and minor motion, such as small desktop level movements, according to published coverage areas, for automatic control of load indicated.
 - 2. Sensor Technology:
 - a. Passive Infrared/Ultrasonic Dual Technology Occupancy Sensors: Designed to detect occupancy using a combination of both passive infrared and ultrasonic technologies.
 - 3. Provide LED to visually indicate motion detection with separate color LEDs for each sensor type in dual technology units.

4. Operation: Unless otherwise indicated, occupancy sensor to turn load on when occupant presence is detected and to turn load off when no occupant presence is detected during an adjustable turn-off delay time interval.
5. Turn-Off Delay: Field adjustable, with time delay settings up to 30 minutes.
6. Compatibility (Non-Dimming Sensors): Suitable for controlling incandescent lighting, low-voltage lighting with electronic and magnetic transformers, fluorescent lighting with electronic and magnetic ballasts, and fractional motor loads, with no minimum load requirements.

2.06 WALL SWITCHES

- A. Wall Switches - General Requirements: AC only, quiet operating, general-use snap switches with silver alloy contacts, complying with NEMA WD 1 and NEMA WD 6, and listed as complying with UL 20 and where applicable, FS W-S-896; types as indicated on the drawings.
 1. Wiring Provisions: Terminal screws for side wiring and screw actuated binding clamp for back wiring with separate ground terminal screw.
- B. Standard Wall Switches: Commercial specification grade, 20 A, 120/277 V with standard toggle type switch actuator and maintained contacts; single pole single throw as indicated on the drawings.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that outlet boxes are installed in proper locations and at proper mounting heights and are properly sized to accommodate devices and conductors in accordance with NFPA 70.
- C. Verify that wall openings are neatly cut and will be completely covered by wall plates.
- D. Verify that final surface finishes are complete, including painting.
- E. Verify that branch circuit wiring installation is completed, tested, and ready for connection to wiring devices.
- F. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Perform work in accordance with NECA 1 (general workmanship) and, where applicable, NECA 130, including mounting heights specified in those standards unless otherwise indicated.
- B. Coordinate locations of outlet boxes provided under Section 260533.16 as required for installation of wiring devices provided under this section.
- C. Install wiring devices in accordance with manufacturer's instructions.
- D. Install permanent barrier between ganged wiring devices when voltage between adjacent devices exceeds 300 V.
- E. Where required, connect wiring devices using pigtails not less than 6 inches (150 mm) long. Do not connect more than one conductor to wiring device terminals.
- F. Connect wiring devices by wrapping conductor clockwise 3/4 turn around screw terminal and tightening to proper torque specified by the manufacturer. Where present, do not use push-in pressure terminals that do not rely on screw-actuated binding.
- G. Unless otherwise indicated, connect wiring device grounding terminal to branch circuit equipment grounding conductor and to outlet box with bonding jumper.
- H. Unless otherwise indicated, GFCI receptacles may be connected to provide feed-through protection to downstream devices. Label such devices to indicate they are protected by upstream GFCI protection.
- I. Install wiring devices plumb and level with mounting yoke held rigidly in place.
- J. Install wall switches with OFF position down.

- K. Install vertically mounted receptacles with grounding pole on top and horizontally mounted receptacles with grounding pole on left.
- L. Install wall plates to fit completely flush to wall with no gaps and rough opening completely covered without strain on wall plate. Repair or reinstall improperly installed outlet boxes or improperly sized rough openings. Do not use oversized wall plates in lieu of meeting this requirement.
- M. Install blank wall plates on junction boxes and on outlet boxes with no wiring devices installed or designated for future use.

3.03 ADJUSTING

- A. Adjust devices and wall plates to be flush and level.
- B. Adjust presets for wall dimmers according to manufacturer's instructions as directed by Architect.

3.04 CLEANING

- A. Clean exposed surfaces to remove dirt, paint, or other foreign material and restore to match original factory finish.

END OF SECTION 262726

SECTION 265100 - ALTERNATE 3: INTERIOR LIGHTING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Interior luminaires.

1.02 RELATED REQUIREMENTS

- A. Section 260529 - Hangers and Supports for Electrical Systems.
- B. Section 260533.16 - Boxes for Electrical Systems.

1.03 REFERENCE STANDARDS

- A. IES LM-79 - Approved Method: Optical and Electrical Measurements of Solid-State Lighting Products 2019.
- B. IES LM-80 - Approved Method: Measuring Maintenance of Light Output Characteristics of Solid-State Light Sources 2021.
- C. NECA 1 - Standard for Good Workmanship in Electrical Construction 2015.
- D. NECA/IESNA 500 - Standard for Installing Indoor Lighting Systems 2006.
- E. NECA/IESNA 502 - Standard for Installing Industrial Lighting Systems 1999 (Reaffirmed 2006).
- F. NFPA 70 - National Electrical Code Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- G. UL 1598 - Luminaires Current Edition, Including All Revisions.
- H. UL 8750 - Light Emitting Diode (LED) Equipment for Use in Lighting Products Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate the installation of luminaires with mounting surfaces installed under other sections or by others. Coordinate the work with placement of supports, anchors, etc. required for mounting. Coordinate compatibility of luminaires and associated trims with mounting surfaces at installed locations.
 - 2. Coordinate the placement of luminaires with structural members, ductwork, piping, equipment, diffusers, fire suppression system components, and other potential conflicts installed under other sections or by others.
 - 3. Notify Architect of any conflicts or deviations from Contract Documents to obtain direction prior to proceeding with work.

1.05 SUBMITTALS

- A. Shop Drawings:
 - 1. Provide photometric calculations where luminaires are proposed for substitution upon request.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets including detailed information on luminaire construction, dimensions, finishes, mounting requirements, listings, service conditions, photometric performance, installed accessories, and ceiling compatibility; include model number nomenclature clearly marked with all proposed features.
 - 1. LED Luminaires:
 - a. Include estimated useful life, calculated based on IES LM-80 test data.
 - b. Include IES LM-79 test report upon request.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.

1.07 DELIVERY, STORAGE, AND PROTECTION

- A. Receive, handle, and store products according to NECA/IESNA 500 (commercial lighting), NECA/IESNA 502 (industrial lighting), and manufacturer's written instructions.

- B. Keep products in original manufacturer's packaging and protect from damage until ready for installation.

1.08 FIELD CONDITIONS

- A. Maintain field conditions within manufacturer's required service conditions during and after installation.

1.09 WARRANTY

- A. Provide five year manufacturer warranty for LED luminaires, including drivers.

PART 2 PRODUCTS

2.01 LUMINAIRE TYPES

- A. Furnish products as indicated in luminaire schedule included on the drawings.
- B. Substitutions: See state substitution request form - Product Requirements except where individual luminaire types are designated with substitutions not permitted.

2.02 LUMINAIRES

- A. Manufacturers:
 - 1. Acuity Brands, Inc: www.acuitybrands.com/#sle.
 - 2. Cooper Lighting, a division of Cooper Industries: www.cooperindustries.com/#sle.
 - 3. Hubbell Lighting, Inc: www.hubbellighting.com/#sle.
 - 4. Lutron Electronics Company, Inc; www.lutron.com/#sle.
 - 5. Philips Lighting North America Corporation; www.lightingproducts.philips.com/#sle.
- B. Provide products that comply with requirements of NFPA 70.
- C. Provide products that are listed and labeled as complying with UL 1598, where applicable.
- D. Provide products listed, classified, and labeled as suitable for the purpose intended.
- E. Unless otherwise indicated, provide complete luminaires including lamp(s) and all sockets, ballasts, reflectors, lenses, housings and other components required to position, energize and protect the lamp and distribute the light.
- F. Unless specifically indicated to be excluded, provide all required conduit, boxes, wiring, connectors, hardware, supports, trims, accessories, etc. as necessary for a complete operating system.
- G. Provide products suitable to withstand normal handling, installation, and service without any damage, distortion, corrosion, fading, discoloring, etc.
- H. LED Luminaires:
 - 1. Components: UL 8750 recognized or listed as applicable.
 - 2. Tested in accordance with IES LM-79 and IES LM-80.
 - 3. LED Estimated Useful Life: Minimum of 50,000 hours at 70 percent lumen maintenance, calculated based on IES LM-80 test data.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that outlet boxes are installed in proper locations and at proper mounting heights and are properly sized to accommodate conductors in accordance with NFPA 70.
- C. Verify that suitable support frames are installed where required.
- D. Verify that branch circuit wiring installation is completed, tested, and ready for connection to luminaires.
- E. Verify that conditions are satisfactory for installation prior to starting work.

3.02 PREPARATION

- A. Provide extension rings to bring outlet boxes flush with finished surface.
- B. Clean dirt, debris, plaster, and other foreign materials from outlet boxes.

3.03 INSTALLATION

- A. Coordinate locations of outlet boxes provided under Section 260533.16 as required for installation of luminaires provided under this section.
- B. Perform work in accordance with NECA 1 (general workmanship).
- C. Install products in accordance with manufacturer's instructions.
- D. Install luminaires securely, in a neat and workmanlike manner, as specified in NECA 500 (commercial lighting) and NECA 502 (industrial lighting).
- E. Provide required support and attachment in accordance with Section 260529.
- F. Install luminaires plumb and square and aligned with building lines and with adjacent luminaires.
- G. Install accessories furnished with each luminaire.
- H. Bond products and metal accessories to branch circuit equipment grounding conductor.
- I. Install lamps in each luminaire.

3.04 CLEANING

- A. Clean surfaces according to NECA 500 (commercial lighting), NECA 502 (industrial lighting), and manufacturer's instructions to remove dirt, fingerprints, paint, or other foreign material and restore finishes to match original factory finish.

END OF SECTION 265100

SECTION 265600 - ALTERNATE 3: EXTERIOR LIGHTING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Exterior luminaires.

1.02 RELATED REQUIREMENTS

- A. Section 260526 - Grounding and Bonding for Electrical Systems.
- B. Section 260529 - Hangers and Supports for Electrical Systems.
- C. Section 260533.16 - Boxes for Electrical Systems.

1.03 REFERENCE STANDARDS

- A. IES LM-79 - Approved Method: Optical and Electrical Measurements of Solid-State Lighting Products 2019.
- B. IES LM-80 - Approved Method: Measuring Maintenance of Light Output Characteristics of Solid-State Light Sources 2021.
- C. NECA 1 - Standard for Good Workmanship in Electrical Construction 2015.
- D. NECA/IESNA 501 - Standard for Installing Exterior Lighting Systems 2000 (Reaffirmed 2006).
- E. NFPA 70 - National Electrical Code Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- F. UL 1598 - Luminaires Current Edition, Including All Revisions.
- G. UL 8750 - Light Emitting Diode (LED) Equipment for Use in Lighting Products Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate placement of poles and associated foundations with utilities, curbs, sidewalks, trees, walls, fences, striping, etc. installed under other sections or by others. Coordinate elevation to obtain specified foundation height.
 - 2. Notify Architect of any conflicts or deviations from Contract Documents to obtain direction prior to proceeding with work.

1.05 SUBMITTALS

- A. Shop Drawings:
 - 1. Provide photometric calculations where luminaires are proposed for substitution upon request.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets including detailed information on luminaire construction, dimensions, ratings, finishes, mounting requirements, listings, service conditions, photometric performance, weight, effective projected area (EPA), and installed accessories; include model number nomenclature clearly marked with all proposed features.
 - 1. LED Luminaires:
 - a. Include estimated useful life, calculated based on IES LM-80 test data.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Receive, handle, and store products according to NECA/IESNA 501 and manufacturer's written instructions.
- B. Keep products in original manufacturer's packaging and protect from damage until ready for installation.

1.08 WARRANTY

- A. Provide five year manufacturer warranty for all LED luminaires, including drivers.

PART 2 PRODUCTS

2.01 LUMINAIRE TYPES

- A. Furnish products as indicated in luminaire schedule included on the drawings.

2.02 LUMINAIRES

- A. Manufacturers:
 - 1. Acuity Brands, Inc: www.acuitybrands.com/#sle.
 - 2. Cooper Lighting, a division of Cooper Industries: www.cooperindustries.com/#sle.
 - 3. Hubbell Lighting, Inc: www.hubbellighting.com/#sle.
 - 4. Philips Lighting North America Corporation; www.lightingproducts.philips.com/#sle.
- B. Provide products that comply with requirements of NFPA 70.
- C. Provide products that are listed and labeled as complying with UL 1598, where applicable.
- D. Provide products listed, classified, and labeled as suitable for the purpose intended.
- E. Unless otherwise indicated, provide complete luminaires including lamp(s) and all sockets, ballasts, reflectors, lenses, housings and other components required to position, energize and protect the lamp and distribute the light.
- F. Unless specifically indicated to be excluded, provide all required conduit, boxes, wiring, connectors, hardware, poles, foundations, supports, trims, accessories, etc. as necessary for a complete operating system.
- G. Provide products suitable to withstand normal handling, installation, and service without any damage, distortion, corrosion, fading, discoloring, etc.
- H. LED Luminaires:
 - 1. Components: UL 8750 recognized or listed as applicable.
 - 2. Tested in accordance with IES LM-79 and IES LM-80.
 - 3. LED Estimated Useful Life: Minimum of 50,000 hours at 70 percent lumen maintenance, calculated based on IES LM-80 test data.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that outlet boxes are installed in proper locations and at proper mounting heights and are properly sized to accommodate conductors in accordance with NFPA 70.
- C. Verify that suitable support frames are installed where required.
- D. Verify that branch circuit wiring installation is completed, tested, and ready for connection to luminaires.
- E. Verify that conditions are satisfactory for installation prior to starting work.

3.02 PREPARATION

- A. Provide extension rings to bring outlet boxes flush with finished surface.
- B. Clean dirt, debris, plaster, and other foreign materials from outlet boxes.

3.03 INSTALLATION

- A. Coordinate locations of outlet boxes provided under Section 260533.16 as required for installation of luminaires provided under this section.
- B. Perform work in accordance with NECA 1 (general workmanship).
- C. Install products in accordance with manufacturer's instructions.
- D. Install luminaires in accordance with NECA/IESNA 501.
- E. Provide required support and attachment in accordance with Section 260529.
- F. Install luminaires plumb and square and aligned with building lines and with adjacent luminaires.
- G. Install accessories furnished with each luminaire.
- H. Bond products and metal accessories to branch circuit equipment grounding conductor.

- I. Install lamps in each luminaire.

3.04 ADJUSTING

- A. Aim and position adjustable luminaires to achieve desired illumination as indicated or as directed by Architect. Secure locking fittings in place.

3.05 CLEANING

- A. Clean surfaces according to NECA/IESNA 501 and manufacturer's instructions to remove dirt, fingerprints, paint, or other foreign material and restore finishes to match original factory finish.

END OF SECTION 265600

SECTION 31 10 00 -- SITE CLEARING & DEMOLITION

PART 1 – GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, include General and Supplementary Conditions, apply to this Section.

1.2 SUMMARY

- A. Section includes:
 - a. Protecting existing vegetation to remain.
 - b. Removing existing vegetation.
 - c. Clearing and grubbing.
 - d. Stripping and stockpiling topsoil.
 - e. Removing above and below grade site improvements shown to be removed.
 - f. Disconnecting, capping or sealing, and removing site utilities.
 - g. Temporary erosion and sedimentation control.
 - h. Remove and replacement of pavement as required for building and parking lot addition
 - i. It is the intent that the demolition be complete and adequate for the intended purpose. This work shall include the removal of all items, whether in view or hidden underneath the surface of the ground, regardless of whether shown on the drawings or encountered during construction.
- B. Related Requirements:
 - a. Contractor shall comply with all applicable local, state, and federal requirements regarding materials, methods of work, and disposal of excess waste materials.

1.3 DEFINITIONS

- A. BMPs: The term Best Management Practices is used to describe the controls and activities used to prevent stormwater pollution.
- B. Subsoil: Soil beneath the level of subgrade; soil beneath the topsoil layers of a naturally occurring soil profile, typified by less than one percent organic matter and few soil organisms.
- C. Topsoil: Top layer of the soil profile usually richest in organic matter and nutrients consisting of existing native surface topsoil or existing in-place surface soil; the zone where plant roots grow. Its appearance is generally friable, pervious, and black or darker shade of brown, gray, or red than underlying subsoil; reasonably free of subsoil, clay, lumps, gravel, and other objects larger than 2 inches in diameter; and free of weeds, roots, toxic materials, or other non-soil materials. A pH range of 5.0-7.5 is acceptable.

- D. Tree Protection Zone: Area surrounding individual trees or groups of trees to be protected during construction and indicated on Drawings.
- E. Vegetation: Trees, shrubs, groundcovers, grass, and other plants.

1.4 MATERIAL OWNERSHIP

- A. Except for materials indicated to be stockpiled or otherwise remain on Owner's property, manmade cleared materials shall become Contractor's property and shall be removed from the project site.

1.5 ACTION SUBMITTALS

- A. Product Data: For each type of the following manufactured products required:
 - 1. Erosion control blankets / turf reinforcement mats.
 - 2. Sediment fencing.

1.6 INFORMATIONAL SUBMITTALS

- A. Existing Conditions: Documentation of existing trees and plantings, adjoining construction, and site improvements that establishes preconstruction conditions that might be misconstrued as damage caused by site clearing.
 - a. Use sufficiently detailed photographs or video recordings.
 - b. Include plans and notations to indicate specific wounds and damage conditions of each tree or other plant designed to remain.
- B. Record Drawings: Identify and accurately showing location of capped utilities and other subsurface structural, electrical, and mechanical conditions.

1.7 FIELD CONDITIONS

- A. Traffic; Minimize interference with adjoining roads, streets, walks, and other adjacent occupied or used facilities during site clearing operations.
 - 1. Do not close or obstruct streets, walks or other adjacent occupied or used facilities without permission from Owner and authorities having jurisdiction.
- B. Improvements on Adjoining Property: Authority for performing earth moving indicated on property adjoining Owner's property will be obtained by Owner before award of Contract.
 - 1. Do not proceed with work on adjoining property until directed by the Owner.
- C. Utility Locator Service: Notify "Missouri One Call" for area where project is located and obtain and verify all existing utility locations before starting project.
- D. Do not commence site clearing operations until temporary erosion and sediment control and tree protection measures are in place.

- E. Tree-Protection Zones: Protect according to requirements in project plans.
- F. Soil Stripping, Handling, and Stockpiling: Perform only when the soil is dry or slightly moist.

PART 2 – PRODUCTS

2.1 MATERIALS

- A. Satisfactory Soil Material: Requirements for satisfactory soil material are specified in Section 31 2000 “Earth Moving.”

PART 3 – EXECUTION

3.1 PREPARATION

- A. Notification: Provide the owner’s representative a minimum of two business days’ notice prior to commencing work of this section.
- B. Protect and maintain benchmarks and survey control points from disturbance during construction. The contractor will be responsible for hiring a land surveyor to re-establish all control points or benchmarks for use during construction.
- C. Verify that trees, shrubs, and other vegetation to remain or to be relocated have been flagged and that protection zones have been identified and enclosed according to requirements in the project plans.
- D. Protect existing site improvements to remain from damage during construction.
- E. Restore damaged improvements to their original condition, as acceptable to the Owner.

3.2 TEMPORARY EROSION AND SEDIMENTATION CONTROL

- A. Provide temporary erosion and sediment control measures to prevent soil erosion and discharge of soil-bearing water runoff or airborne dust to adjacent properties and walkways, according to erosion and sediment control drawings and requirements of the authorities having jurisdiction.
- B. Verify that flows of water redirected from construction areas or generated by construction activities do not enter or cross protection zones.
- C. Inspect, maintain, and repair erosion control and sediment control measures during construction until permanent vegetation has been established.
- D. Remove erosion and sediment controls, and restore and stabilize areas disturbed during removal.

- E. Adhere to all aspects of erosion and sediment control as indicated in the project Plans.

3.3 TREE AND PLANT PROTECTION

- A. Protect trees and plants remaining on-site according to requirements in project plans.
- B. Repair or replace trees, shrubs, and other vegetation indicated to remain or be relocated that are damaged by construction operations.

3.4 EXISTING UTILITIES

- A. The contractor shall locate existing utility lines and services traversing the site and determine the requirements for their protection. The contractor shall preserve active utilities on the site that are designated to remain.
- B. Arrange for disconnecting and sealing utilities that serve existing structures before site clearing.
- C. Verify that utilities have been disconnected and capped before proceeding with site clearing.
- D. Interrupting Existing Utilities: Do not interrupt utilities serving offsite facilities.
- E. Excavate for and remove underground utilities indicated to be removed.
- F. Removal of underground utilities is included in earthwork sections.

3.5 CLEARING AND GRUBBING

- A. Remove obstructions, trees, shrubs, and other vegetation to permit installation of new construction.
 - a. Do not remove trees, shrubs, and other vegetation indicated to remain or to be protected.
 - b. Excavate to remove the entire root ball for woody vegetation.
- B. Fill depressions caused by clearing and grubbing operations with satisfactory soil material unless further excavation or earthwork is indicated.
 - a. Place fill material in horizontal layers not exceeding a loose depth of 8 inches and compact each layer to a density equal to adjacent original ground.
 - b. Finish grade all areas to provide positive drainage.
- C. Burning: Do not burn!

3.6 TOPSOIL STRIPPING

- A. Remove sod and grass before stripping topsoil.
- B. Strip topsoil to a depth of 6 inches or as encountered in the field in a manner to prevent intermingling with underlying subsoil or other waste materials.

- a. Remove subsoil and non-soil materials from topsoil, including clay lumps, gravel, and other objects larger than 2 inches in diameter; trash, debris, weeds, roots, and other waste materials.
- C. Stockpile topsoil away from edge of excavations without intermixing with subsoil or other materials. Grade and shape stockpiles to drain surface water. Cover to protect windblown dust and erosion by water.
 - a. Limit height of topsoil stockpile to 72 inches.
 - b. Do not stockpile topsoil within protection zones.
 - c. Adhere to all current local municipality stockpile requirements.

3.7 SITE IMPROVEMENTS

- A. Remove existing above and below ground improvements as indicated to facilitate new construction.
- B. Remove all slabs, paving, curbs, gutters, foundations, and aggregate bases shown to be removed.
- C. Remove all utilities, both underground and above ground, shown to be removed on the civil drawings.

3.8 PAVEMENT

- A. In removing pavement, curb and gutter, sidewalks, etc., where a portion is left in place, removal shall be to an existing joint or to a joint sawed to a minimum depth of 2" with a true saw line and a vertical face. Remove sufficient pavement to provide for proper grade and connections in the new work regardless of any limits indicated on the drawing.

3.9 SEWERS

- A. Existing castings and culverts, if salvageable and removed intact, remain the property of the contractor.
- B. All sewers and drainage pipes, which have been or are to be abandoned, shall be abandoned in accordance with Specification Section 33 3000 "Sanitary Sewerage Utilities. Refer to paragraph 3.9 of that specification section.
- C. Abandon storm or sanitary sewer structures in accordance with Specification Section 33 3000 "Sanitary Sewerage Utilities. Refer to paragraph 3.9 of that specification section.

4.0 DISPOSAL OF SURPLUS AND WASTE MATERIALS

- A. Remove all demolished materials, and waste materials including trash and debris, and legally dispose of them off Owner's property.

END OF SECTION 31 10 00

SECTION 31 20 00 -- EARTH MOVING

PART 1 – GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specifications, apply to this Section.

1.2 SUMMARY

- A. Section includes:
 - a. Excavating and filling for rough grading the Site.
 - b. Preparing subgrades for slab-on-grade, walks, pavements, turf and grasses, and plants.
 - c. Excavating and backfilling for buildings and structures.
 - d. Drainage course for concrete slabs-on-grade.
 - e. Subbase course for concrete walks, and pavements.
 - f. Subbase course and base course for asphalt paving.
 - g. Subsurface drainage backfill for walls and trenches.
 - h. Excavation and backfilling trenches for utilities and pits for buried utility structures.
- B. Related Requirements:
 - a. Section 311000 “Site Clearing and Demolition” for site stripping, grubbing, stripping, and stockpiling topsoil, and removal of above- and below-grade improvements and utilities.
 - b. Section 322000 “Turf and Grasses” for finish grading in turf and grass areas, including preparing and placing planting soil for turf areas.

1.3 UNIT PRICES

- A. Unsuitable Soil Materials: Volume of unsuitable soil materials below the subgrade indicated on the plans, actually removed, measured in original position by means of a topographic survey of the bottom surface of the removal limits provided by the contractor to the owner for quantity verification. The costs of all topographic surveys of removal limits shall be the responsibility of the contractor and is considered incidental to the unit price. The contractor shall engage a qualified geotechnical engineering testing agency to verify removal limits as required by the geotechnical report and the contract documents. The contractor is not authorized to exceed the base bid quantity for this unit price without written approval of the owner and the engineer. No payments will be made for unauthorized excavations.
- B. Mass Rock Measurement: volume of rock, actually removed, measured in original position by means of a topographic survey of the bottom surface of the removal limits provided by the contractor to the owner for quantity verification. The costs of all topographic surveys of removal limits shall be the responsibility of the contractor and is considered incidental to

the unit price. Unit prices for rock excavation include replacement with approved materials. The contractor is not authorized to exceed the base bid quantity for this unit price without written approval of the owner and the engineer. No payments will be made for unauthorized excavations. Pay Quantities shall not exceed the following:

- 1) 24 inches outside of concrete forms other than at footings.
- 2) 12 inches outside of concrete forms at footings.
- 3) 6 inches outside of minimum required dimensions of concrete cast against grade.
- 4) 12 inches beneath the bottom of concrete footings or slabs-on-grade.

- 5) 12 inches outside of concrete forms at footings.
- 6) 6 inches outside of minimum required dimensions of concrete cast against grade.
- 7) 12 inches beneath bottom of concrete footings or slabs-on-grade.
- 8) 6 inches (150 mm) beneath pipe in trenches, and 24 inches (600 mm) wider than pipe, unless otherwise noted on the drawings.

C. Trench Rock Measurement: volume of rock, actually removed, measured in original position by means of a topographic survey of the top of rock elevation as compared to the planned flow line elevation of all piping or conduits. The topographic survey of the top or rock elevation shall be provided by the contractor to the owner for quantity verification. The costs of all topographic surveys of the removal limits shall be the responsibility of the contractor and is considered incidental to the unit price. Unit prices for rock excavation include replacement with approved materials. The contractor is not authorized to exceed the base bid quantity for this unit price without written approval of the owner and the engineer. No payments will be made for unauthorized excavations. Pay Quantities shall not exceed the following:

- 1) 6 inches beneath pipe in trenches, and 24 inches wider than the pipe, unless noted otherwise on the drawings.
- 2) 6 inches beneath the base of any storm or sanitary sewer structures
- 3) 24" beyond the outside walls of any storm or sanitary sewer structures.

1.4 DEFINITIONS

A. Backfill: Soil material or controlled low-strength material used to fill excavation.

1. Initial Backfill: Backfill placed beside and over pipe in a trench, including haunches to support sides of pipe.
2. Final Backfill: Backfill placed over initial backfill to fill a trench.

B. Base Course: Aggregate layer placed between the subbase course and hot-mix asphalt paving.

C. Bedding Course: Aggregate layer placed over the excavated subgrade in a trench before laying pipe.

D. Borrow Course: Satisfactory soil imported from off – site use as fill or backfill.

E. Drainage Course: Aggregate layer supporting the slab-on-grade that also minimizes upward capillary flow of pore water.

- F. Excavation: Removal of material encountered above subgrade elevations and to line and dimensions indicated.
 - 1. Authorized Additional Excavation: Excavation below subgrade elevations or beyond indicated lines and dimensions as directed by Owner. Authorized additional excavation and replacement material will be paid for according to Contract provisions for changes in the Work.
 - 2. Unauthorized Excavation: Excavation below subgrade elevations or beyond indicated lines and dimensions without direction by Owner. Unauthorized excavation, as well as remedial work directed by Owner, shall be without additional compensation.
- G. Fill: Soil materials used to raise existing grades.
- H. Rock: Rock is defined as being sandstone, limestone, flint, granite, quartzite, or similar material, in masses measuring more than (1) cubic yard in volume or in ledges four (4) inches or more in thickness, and which requires jack hammering for its practical and effective removal. Should rock be encountered in two or more ledges, each ledge being not less than three (3) inches thick in each stratum, the entire volume from the top of the top ledge to the bottom of the bottom ledge of rock will be classified as rock.
- I. Structures; Buildings, footings, foundations, retaining walls, slabs, tanks, curbs, mechanical and electrical appurtenances, or other man-made stationary features constructed above to below the ground surface.
- J. Subbase Course: Aggregate layer placed between the subgrade and base course for hot-mix asphalt pavement or aggregate layer placed between the subgrade and a cement concrete pavement or hot-mix asphalt walk.
- K. Subgrade: Uppermost surface of an excavation or the top surface of a fill or back fill immediately below subbase, drainage fill, drainage course, or topsoil materials.
- L. Unsuitable Material: Soil and debris material below plan subgrade, which in the opinion of the engineer, or the contractors qualified geotechnical testing agency, is unsuitable bearing material for building structures or pavements.
- M. Utilities: On-site underground pipes, conduits, ducts, and cables as well as underground services within buildings.

1.5 SUBMITTALS

- A. Product Data: For each type of the following manufactured products required:
 - 1. Warning tapes.
 - 2. Vapor Barrier.
- B. Samples for Verification: For the following products, in sizes indicated below:
 - 1. Warning Tape: 12 inches (300 mm) long; of each color.

2. Vapor Barrier: 12 inches by 12 inches.

1.6 INFORMATIONAL SUBMITTALS

- A. Qualification Data: for qualified testing agency.
- B. Material Test Reports: For each on-site and borrow soil material for proposed fill and backfill as follows:
 - a. Classification according to ASTM D 2487
 - b. Laboratory compaction curve according to ASTM D 698.
- C. Pre-excavation photographs or Videotape: Show existing conditions of adjoining construction and site improvements, including finish surface that might be misconstrued as damage caused by earth-moving operations. Submit before earth moving begins.

1.7 FIELD CONDITIONS

- A. Traffic; Minimize interference with adjoining roads, streets, walks, and other adjacent occupied or used facilities during earth-moving operations.
 1. Do not close or obstruct streets, walks or other adjacent occupied or used facilities without permission from Owner and authorities having jurisdiction.
 2. Provide alternate routes around closed or obstructed traffic ways if required by Owner or authorities having jurisdiction.
- B. Improvements on Adjoining Property: Authority for performing earth moving indicated on property adjoining Owner's property will be obtained by Owner before award of Contract.
 1. Do not proceed with work on adjoining property until directed by the Owner.
- C. Utility locator Service: Notify "Missouri One Call" for area where Project is located before beginning earth-moving operations.
- D. Do not commence earth-moving operations until temporary site fencing and erosion- and sedimentation- control measures indicated in civil plans are in place.
- E. Do not commence earth- moving operations until tree protection measures indicated in civil plans are in place.

1.8 SOIL MATERIALS

- A. General: Provide borrow soil materials when sufficient satisfactory soil materials are not available from extensions.
- B. Satisfactory Soils: Soils Classification Groups GW, GM, GC, SW, SP, SM, SC and CL according to ASTM D 2487 or a combination of these groups; free of rock or gravel larger than 8 inches (75 mm) in any dimension, debris, waste, frozen materials, vegetation, and

other deleterious matter. Soils that classify as CH should be analyzed and approved by a qualified geotechnical engineer prior to use.

- C. Unsatisfactory Soils: Soil Classification Groups OL, MH, OH, and PT according to ASRM D 2487 or a combination of these groups.
 - a. Unsatisfactory soils also include satisfactory soils not maintained within -2 to +4 percent of optimum moisture content at time of compaction.
- D. Subbase Material: Subbase material shall meet the crushed stone base MoDOT requirements of Section 1007 of the current Missouri Standards for Highway Construction, Type 1.
- E. Engineered Fill: Controlled and compacted soil fill placed in accordance with ASTM D698.
- F. Bedding Course: Per ASTM C33 #67 or approved equal.
- G. Drainage Course: Rock course meeting the graduation requirements for a #67 rock as defined by ASTM C 33.

1.9 ACCESSORIES

- A. Detectable warning tape: Acid and Alkali resistant polyethylene film warning tape manufactured for marking and identifying underground utilities, a minimum of 6 inches wide and 4 mils thick, continuously inscribed with the description of the utility, with metallic core encased in a protective jacket for corrosion protection, detectable by metal detector when tape is buried 30 inches deep; colored as follows
 - a. Red: Electric
 - b. Yellow: Gas, Oil, steam, and dangerous materials
 - c. Orange: Telephone and other communications
 - d. Blue: Water systems
 - e. Green: Sewer systems

PART 2 – EXECUTION

2.1 PREPARATION

- A. Protect structures, utilities, sidewalks, pavements, and other facilities from damage caused by settlement, lateral movement, undermining, washout, and hazards created by earth-moving operations.
- B. Protect and maintain erosion and sedimentation controls during earth-moving operations.
- C. Protect subgrades and foundation soils from freezing temperatures and frost. Remove temporary protection before placing subsequent materials.

2.2 DEWATERING

- A. Prevent surface water and ground water from entering excavations, from ponding on prepared subgrades, and from flooding project site and surrounding areas.
- B. Protect subgrades from softening, undermining, washout, and damage by rain or water accumulation.
 - a. Reroute surface water runoff away from excavated areas. Do not allow water to accumulate in excavation. Do not use excavated trenches as temporary drainage ditches.

2.3 EXPLOSIVES

- A. Do not use explosives.

2.4 EXCAVATION, GENERAL

- A. Classified Excavation: Excavate to subgrade elevations. Material to be excavated will be classified as earth and rock. The contract sum will be adjusted for rock excavation according to unit prices included in the contract documents.
 - a. Earth excavation includes excavating pavements and obstructions visible on the surface; underground structures, utilities, and other items indicated to be removed; and soil, boulders and other materials not classified as rock or unauthorized excavation.
 - i. Intermittent drilling, ram hammering, or ripping of material not classified as rock excavation is earth excavation.
- B. Rock excavation includes removal and disposal of rock. Remove rock to lines and subgrade elevations indicated to permit installation of permanent construction without exceeding the dimensions indicated in the unit prices.

2.5 EXCAVATION FOR STRUCTURES

- A. Excavate to indicated elevations and dimensions within a tolerance of plus or minus one inch. If applicable, extend excavations a sufficient distance from structures for placing and removing concrete formwork, for installing services and other construction, and for inspections.
 - a. Excavations for footings and foundations; Do not disturb bottom excavation. Excavate by hand to final grade just before placing concrete reinforcement. Trim bottoms to required lines and grades to leave solid base to receive other work.
 - b. Excavation for Underground Tanks, Basins, and Mechanical or Electrical Utility Structures: Excavate to elevations and dimensions indicated within a tolerance of plus or minus 1 inch. Do not disturb bottom of excavations intended as bearing surfaces.

2.6 EXCAVATION FOR WALKS AND PAVEMENTS

- A. Excavate surface under walks and pavements to indicated lines, cross sections, elevations, and subgrades

2.7 EXCAVATION FOR UTILITY TRENCHES

- A. Excavate trenches to indicated gradients, lines, depths, and elevations.
 - a. Beyond the building perimeter, excavate trenches to allow installation of top of pipe below frost line.
- B. Excavate trenches to uniform widths to provide the following clearance on each side of pipes or conduits. Excavate trench walls vertically from trench bottom to 12 inches higher than top of pipe or conduit unless otherwise noted.
 - a. Clearance: 6 inches on each side of pipe or conduit, or as indicated on the drawings.
- C. Trench bottoms: Excavate and shape trench bottoms to provide uniform bearing and support of pipes and conduits. Shape subgrade to provide continuous support for bells, joints, and barrels of pipes and for joints, fittings, and bodies of conduits. Remove projecting stones and sharp objects along trench subgrade.
 - a. Excavate trenches deeper than elevation required in rock or other unyielding bearing material to allow for bedding course.

2.8 SUBGRADE INSPECTION

- A. Notify Owner when excavations have reached required subgrade.
- B. If Owner determines that unsatisfactory soil is present, continue excavation and replace with compacted backfill or fill material as directed.
- C. Proof-roll subgrade below the building slabs and pavements with a pneumatic-tired 10-wheel, tandem-axle dump truck weighing not less than 15 tons to identify soft pockets and areas of excess yielding. Do not proof-roll wet or saturated subgrade.
 - a. Completely proof-roll subgrade in one direction. Limit vehicle speed to 3 mph.
 - b. Excavate soft spots, unsatisfactory soils, and areas of excessive pumping or rutting, as determined by Owner, and replace with compacted backfill or fill as directed.
- D. Authorized additional excavation and replacement material will be paid for according to Contract provisions for changes in the work.
- E. Reconstruct subgrades damaged by freezing temperatures, frost, rain, accumulated water, or construction activities, as directed by the Owner, without additional compensation.

2.9 UNAUTHORIZED EXCAVATION

- A. Fill unauthorized excavation under foundations or wall footings by extending bottom elevation of concrete foundation or footing to excavation bottom, without altering top elevation. Lean concrete fill, with 28-day compressive strength of 2500 psi, may be used when approved by the Owner.

- a. Fill unauthorized excavations under other construction, pipe, or conduit as directed by the Owner.

2.10 STOCKPILES

- A. Stockpile borrow soil materials and excavated satisfactory soil material without intermixing. Place, grade, and shape stockpiles to drain surface water. Cover to prevent windblown dust.
 - a. Stockpile soil materials away from edge of excavations. Do not store within drip line of remaining trees.

2.11 BACKFILL

- A. Place and compact backfill in excavations promptly, but not before completing the following:
 - a. Construction below finish grade including, where applicable, subdrainage, dampproofing, waterproofing, and perimeter insulation.
 - b. As-built locations of underground utilities for Record Documents.
 - c. Testing and inspecting underground utilities.
 - d. Removing concrete formwork.
 - e. Removing trash and debris.
 - f. Removing temporary shoring, bracing, and sheeting.
 - g. Installing permanent or temporary horizontal bracing on horizontally supported walls.
- B. Place backfill on subgrades free of mud, frost, snow or ice.

2.12 UTILITY TRENCH BACKFILL

- A. Place backfill on subgrades free of mulch, frost, snow or ice.
- B. Place and compact bedding course on trench bottoms and where indicated. Shape bedding course to provide continuous support for bells, joints, and barrels of pipes for joints, fittings, and bodies of conduits.
- C. Trenches under Footings: Backfill trenches excavated under footings with lean concrete fill, with 28-day compressive strength of 2500 psi.
- D. Trenches under Roadways: Place and compact backfill for Engineered Fill material to bottom of the roadway pavement and a minimum of 1 foot beyond edge of pavement in all directions. Place and compact in 8 inch maximum lifts.
- E. Backfill voids with satisfactory soil while removing shoring and bracing.
- F. Place and compact initial backfill of Engineered Fill, free of particles larger than 1 inch in any dimension, to a height of 12 inches over the pipe or conduit.

- a. Carefully compact initial backfill under pipe haunches and compact evenly up on both sides and along the full length of piping or conduit to avoid damage or displacement of piping or conduit. Coordinate backfilling with utilities testing.
- G. Final Backfill (if not specifically indicated in civil plans):
 - a. Soil Backfill: Place and compact final backfill of satisfactory soil to final subgrade elevation.
- H. Warning Tape: Install warning tape directly above utilities, 12 inches below finished grade, except 6 inches below subgrade under pavements and slabs.

2.13 SOIL FILL

- A. Plow, scarify, bench, or break up sloped surfaces steeper than 1 vertical unit to 5 horizontal units so fill material will bond with existing material.
- B. Place and compact fill material in layers to required elevations as follows:
 - a. Under walks and pavements, use satisfactory soil material.
 - b. Under steps and ramps, use satisfactory soil material.
 - c. Under building slabs, use satisfactory soil material.
 - d. Under footings and foundations, use satisfactory soil material.
 - e. Under grass and planted areas, use satisfactory soil material to achieve grades to bottom of topsoil layer. Achieve finished grade by placing a topsoil layer to thickness indicated in the civil plans.
 - i. Topsoil shall be obtained from the on-site topsoil pile created with the initial grading operations, or if insufficient topsoil is available on-site, then sufficient topsoil shall be imported to the site as an incidental part of the work.
 - f. Place soil fill on subgrade free of mud, frost, snow, or ice.
- C. Place soil fill on subgrades free of mud, frost, snow, or ice.

2.14 SOIL MOISTURE CONTROL

- A. Uniformly moisten or aerate subgrade and each subsequent fill or backfill soil layer before compaction to within -2% to +4% of optimum moisture content.
 - a. Do not place backfill or fill soil material on surfaces that are muddy, frozen, or contain frost or ice.
 - b. Remove and replace, or scarify and air dry, otherwise satisfactory soil material that exceeds optimum moisture content by +4 percent and is too wet to compact to specified dry unit weight.

2.15 COMPACTION OF SOIL BACKFILLS AND FILLS

- A. Place backfill and fill soil materials in layers not more than 8 inches in loose depth for material compacted by heavy compaction equipment and not more than 4 inches in loose depth for material compacted by hand-operated tampers
- B. Place backfill and fill soil materials on all sides of structures to required elevations and uniformly along the full length of each structure.
- C. Compact soil materials to not less than the following percentages of maximum dry unit weight according to ASTM D 698:
 - a. Under building slabs, compact each layer of backfill or fill soil material at least 95 percent.
 - b. Under walkways, structures, steps, and pavements, compact each layer of backfill or fill soil material at least 95 percent.
 - c. Under turf or unpaved areas, compact each layer of backfill or fill soil material at least 95 percent to achieve bottom of topsoil layer elevation. Topsoil surface material shall not exceed 80-85 percent compaction. Light compaction only. Do not allow vehicular access within topsoil areas after placement. Excessively hardened, compacted, or tight topsoil will be rejected and is to be replaced by the Contractor at no cost to the Owner.
 - d. For utility trenches, compact each layer of initial and final backfill soil material at least 95 percent.

2.16 GRADING

- A. General: Uniformly grade areas to a smooth surface, free of irregular surface changes. Comply with compaction requirements and grade to cross sections, lines, and elevations indicated.
 - a. Provide a smooth transition between adjacent existing grades and new grades.
 - b. Cut out soft spots, fill low spots, and trim high spots to comply with required surface tolerances.
- B. Site Rough Grading: Slope grades to direct water away from buildings and to prevent ponding. Finish subgrades to elevations required to achieve indicated finish elevation, within the following subgrade tolerances:
 - a. Turf or Unpaved Areas: Plus or minus 1 inch.
 - b. Walks: Plus or minus 1/2 inch.
 - c. Pavements: Plus or minus 1/2 inch.
- C. Grading inside Building Lines: Finish subgrade to a tolerance of 1/2 inch when tested with a 10-foot straightedge.

2.17 SUBBASE AND BASE COURSES UNDER PAVEMENTS AND WALKS

- A. Place on subbase course on subgrades free of mud, frost, snow or ice.
- B. On prepared subgrade, place subbase course under pavements and walks as follows:
 - a. Shape subbase course to required crown elevations and cross-slope grades.
 - b. Place subbase course 6 inches or less in compacted thickness in a single layer.

- c. Place subbase course that exceeds 6 inches in compacted thickness in layers of equal thickness, with no compacted layer more than 6 inches thick or less than 3 inches thick.
- d. Compact subbase course at optimum moisture content to required grades, lines, cross sections, and thickness to not less than 95 percent of maximum dry unit weight according to ASTM D 698.

2.18 DRAINAGE COURSE UNDER CONCRETE SLABS-ON-GRADE

- A. Place drainage course on subgrades free of mud, frost, snow, or ice.
- B. On prepared subgrade, place and compact drainage course under cast-in-place concrete slabs-on-grade as follows:
 - a. Install subdrainage geotextile on prepared subgrade according to manufacturer's written instructions, overlapping sides and ends.
 - b. Place drainage course 6 inches or less in compacted thickness in a single layer.
 - c. Place drainage course that exceeds 6 inches in compacted thickness in layers of equal thickness, with no compacted layer more than 6 inches thick or less than 3 inches thick.
 - d. Compact each layer of drainage course to required cross sections and thicknesses to not less than 95 percent of maximum dry unit weight according to ASTM D 698.

2.19 FIELD QUALITY CONTROL

- A. Testing Agency: The contractor will engage a qualified geotechnical engineering testing agency to perform tests and inspections. The costs of all testing will be paid by the contractor and is considered incidental to the work.
- B. Allow testing agency to inspect and test subgrades and each fill or backfill layer. Proceed with subsequent earth moving only after test results for previously completed work will comply with requirements.
- C. Footing Subgrade: At footing subgrades, at least one test of each soil stratum will be performed to verify design bearing capacities. Subsequent verification and approval of other footing subgrades may be based on a visual comparison of subgrade with tested subgrade when approved by the Design Team.
- D. Testing agency will test compaction of soils in place according to ASTM D 1556, ASTM D 2167, ASTM D 2937, and ASTM D 6938, as applicable. Tests will be performed at the following locations and frequencies:
 - a. Building Slab Areas: At subgrade and at each compacted fill and backfill layer, at least one test for every 2,500 square feet or less of paved area or building pad, but in no case fewer than three tests.
 - b. Foundation Wall Backfill: At each compacted backfill layer, at least one test for every 150 feet or less of wall length, but no fewer than two tests.
 - c. Trench Backfill: At each compacted initial and final backfill layer, at least one test for every 150 feet or less of trench length but no fewer than two tests.

- d. Paved areas, sidewalks, and other potential structural areas: At each compacted backfill layer, at least one test for every 10,000 square feet, but in no case fewer than three tests per lift.
- E. When testing agency reports that subgrades, fills, or backfills have not achieved degree of compaction specified, scarify and moisten or aerate, or remove and replace soil materials to depth required; recompact and retest until specified compaction is obtained. All test reports shall be delivered to the owner and engineer as soon as possible.

2.20 PROTECTION

- A. Protecting Graded Areas: Protect newly graded areas from traffic, freezing, and erosion. Keep free of trash and debris.
- B. Repair and reestablish grades to specified tolerances where completed or partially completed surfaces become eroded, rutted, settled, or where they lose compaction due to subsequent construction operations or weather conditions.
 - a. Scarify or remove and replace soil material to depth as directed by the Owner; reshape and recompact.
- C. Where settling occurs before project correction period elapses, remove finished surfacing, backfill with additional soil material, compact, and reconstruct surfacing.
 - a. Restore appearance, quality, and condition of finished surfacing to match adjacent work, and eliminate evidence of restoration to greatest extent possible.

2.21 DISPOSAL OF SURPLUS AND WASTE MATERIALS

- A. Remove waste material, trash, and debris, and legally dispose of them off the Owner's property.

END OF SECTION 31 20 00

SECTION 31 25 00 -- EROSION CONTROL

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. Installation of temporary water pollution control measures to prevent discharge of pollutants such as chemicals, fuels, lubricants, bitumen, raw sewage, or other harmful material from the project.
- B. Drawings and General Provisions of Contract, including General and Special Conditions, apply to this section.

1.2 GENERAL

- A. The Contractor shall manage his operations to control water pollution in accordance with this specification and applicable State regulations. Construction of permanent drainage facilities and other contract work, contributing to control of erosion, shall be scheduled at the earliest practicable time.
- B. The Contractor shall furnish, install, maintain and remove temporary erosion control measures. The Contractor shall prevent discharging silt or polluted storm water from the site.
- C. The Owner's Representative may require installation of additional erosion control facilities, by the Contractor, if in the sole opinion of the Owner's Representative the Contractor's efforts are adequate.

1.3 DEFINITIONS

- A. General Permit: The General Permit for storm water discharges associated with construction activity issued to FMDC as a blanket permit by the Missouri Department of Natural Resources, Water Pollution Program.
- B. Best Management Practice (BMP): Any program, technology, process, siting criteria, operating method, measure, or device that controls, prevents, removes, or reduces pollution.
- C. Temporary Berm: A temporary ridge of compacted soil, with or without a shallow ditch, constructed at the top of slopes or transverse to the centerline of a slope. The berm diverts storm runoff to temporary outlets to discharge water with minimal erosion.
- D. Temporary Slope Drain: A temporary facility used to carry water down a slope.
- E. Ditch Check: An obstruction placed at frequent intervals across ditches, creating small ponds to cause sediment to settle and be contained.
- F. Sediment Basin: An excavated or dammed storage area to trap and store sediment and prevent the discharge of silt.
- G. Temporary Seeding and Mulching: Placement of a quick ground cover to reduce erosion in areas expected to be re-disturbed.
- H. Straw Bales: Standard agricultural bales used to filter the flow of water, trap, deposit sediment, and/or divert water.

- I. Silt Fence: A geotextile barrier fence to contain sediment by removing suspended particles from water passing through the fence.
- J. Temporary Pipe: Conduit utilized to carry water under haul roads, silt fences, etc., and prevent equipment from direct contact with water when crossing an active or intermittent stream.
- K. Sediment Removal: Removal of accumulated sediment to restore the efficiency of sediment control features.

1.4 SUBMITTALS

- A. The Contractor shall submit and coordinate any field modifications to the “Erosion Control Plan” for review and approval by the Owner’s Representative. Approval of the plan changes does not relieve the Contractor of his contractual responsibility to prevent the discharge of pollutants into the receiving drainage ways.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Temporary Seeding:
 - 1. December 1 to March 1: 50 lbs oats/acre.
 - 2. March 1 to December 1: 50 lbs cereal rye or wheat.
 - 3. Mulch shall be wheat straw.
- B. Wire Supported and Self Supporting Silt Fence:
 - 1. Geotextile Fabric
 - a. Fibers used in geotextiles shall consist of longchain synthetic polymers, composed of at least 85 percent by weight polyolefins, polyesters, or polyamides. They shall be formed into a network such that the filaments or yarns retain dimensional stability relative to each other, including selvages.
 - b. The geotextile shall be free of any treatment or coating which might adversely alter its physical properties after installation.
 - c. Geotextile shall be furnished in 36" width rolls.
 - d. Geotextile rolls shall be furnished with suitable wrapping for protection against moisture and extended ultraviolet exposure.
 - e. Each roll shall be labeled or tagged to provide product identification sufficient for inventory.
 - f. Rolls shall be stored in a manner, which protects them from the elements.
 - g. Geotextile shall conform to the following:

TABLE 1
PHYSICAL REQUIREMENTS¹ FOR
TEMPORARY SILT FENCE GEOTEXTILES

<u>Property</u>	<u>Test Method</u>	Wire Fence Supported	Self Supported
-----------------	--------------------	-------------------------	-------------------

		<u>Requirements</u>	<u>Requirements</u>
Tensile Strength, Lbs.	ASTM D4632	90 Minimum ²	90 Minimum ²
Elongation at 50% Minimum			
Tensile Strength (45 Lbs.)	ASTM D4632	N/A	50 Maximum
Filtering Efficiency, %	VTM-51 ³	75	75
Flow Rate gal/ft/min	VTM-51 ³	0.3	0.3
Ultraviolet Degradation at 500 hrs.	ASTM D4355	Minimum 70% Strength Retained	Minimum 70% Strength Retained

Notes: 1. All numerical values represent minimum average roll value.

A. When tested in any principal direction.

B. Virginia DOT test method.

2. Posts: Wood, steel or synthetic posts may be used. Posts shall have a minimum length of 36" plus embedment depth (24" min.). Posts shall have sufficient strength to resist damage during installation and to support applied loads.
3. Support Fence: Wire or other support fence shall be at least 24" high and strong enough to support applied loads.
4. Prefabricated Fence: Prefabricated fence systems may be used provided they meet all of the above material requirements.

2.2 CERTIFICATIONS AND SAMPLING:

- A. The Contractor shall furnish a manufacturer's certification, stating the material conforms to the requirements of these specifications.
- B. The certification shall include, or have attached, typical results of tests for the specified properties, representative of the materials supplied.
- C. The Owner's Representative reserves the right to sample and test any material offered for use.

PART 3 – EXECUTION

3.1 GENERAL REQUIREMENTS

- A. The Owner's Representative may limit the surface area of erodible earth material exposed by clearing and grubbing, excavation, borrow, or fill operations.
- B. The Owner's Representative may direct the Contractor to provide immediate permanent or temporary pollution control measures to prevent contamination of adjacent streams, other watercourses, lakes, ponds, or other areas of water impoundment. Work may involve the construction of temporary berms, dikes, dams, sediment basins, slope drains, use of temporary mulches, seeding or other control devices or methods to control erosion.
- C. The Contractor shall incorporate permanent erosion control features at the earliest practicable time.

- D. The Contractor at no additional cost shall provide temporary pollution control measures needed to control erosion during normal construction practices to the Owner.
- E. If Contractor determines that any BMP should need modification, the changes shall be dated and documented, and all necessary field changes performed.

3.2 LIMITATION OF AREA DISTURBED

- A. The Contractor's operations shall be scheduled to install permanent erosion control features immediately after clearing and grubbing, and grading.
- B. The surface area of erodible earth material exposed at one time by clearing and grubbing, excavating, fill, or borrow shall not exceed one acre without written approval of the Owner's Representative.
- C. The Owner's Representative may limit the area of clearing and grubbing, excavation, borrow, and embankment operations commensurate with the Contractor's capability and progress in completing the finish grading, mulching, seeding, and other such permanent pollution control measures current.
- D. The Contractor shall respond to seasonal variations. If required by weather, temporary erosion control measures shall be taken immediately.

3.3 BORROW AND WASTE AREAS

- A. Material pits other than commercially operated sources and material spoil areas shall be subject to pollution control measures of this specification. An offsite location does not relieve the Contractor of his contractual obligation to prevent the introduction of silt or other pollutants into receiving waterways.

3.4 CONFLICT WITH FEDERAL, STATE OR LOCAL LAWS, RULES OR REGULATIONS

- A. In case of conflict between these requirements and pollution control laws, rules, or regulations or other Federal, State or local agencies, the more restrictive laws, rules, or regulations shall apply.

3.5 TEMPORARY BERMS

- A. Temporary berms may be constructed on newly constructed slopes and / or transverse to grade to divert runoff away from the building construction zone and prevent erosion until permanent controls are installed and / or slopes are stabilized.
- B. Construction Requirements:
 - 1. Berms shall be a minimum of one foot in height and five feet in width. Berms shall be machine compacted with a minimum of three passes over the entire width of the berm with a bulldozer tread, grader wheel, or other approved methods. The top width of any berms may be wider and the side slopes may be flatter to allow equipment to pass over these berms with minimal disruption.

3.6 TEMPORARY SEEDING AND MULCHING

- A. General

1. This item is applicable to all projects.
2. Seeding and/or mulching shall be a continuous operation on all cut slopes, fill slopes, and borrow pits during the construction process. All disturbed areas shall be seeded and mulched within five (5) working days after the last construction activity in all locations where necessary to eliminate erosion.

B. Construction Requirements:

1. Permanent seeding and mulching following temporary seeding will be performed during the favorable seeding seasons only.
2. Temporary seeding mixtures and planting season:
 - a. December 1 to March 1: 50 lbs. oat grain per acre
 - b. March 1 to December 1: 50 lbs. (cereal rye or wheat) per acre
3. Temporary mulch, fertilizer, and lime for seeding:
 - a. Fertilizer and mulch for temporary seed mixtures shall be applied in accordance with Specification Section 32 2000 "Turf and Grasses."
 - b. Fertilizer shall be applied at the rate specified for permanent seeding.
 - c. Lime will not be required for temporary seeding.

3.7 STRAW BALES

A. General

1. Install at the bottom of embankment slopes less than 10' high to divert runoff from sheet flow and intercept some of the sediment in the sheet flow.
2. Install as ditch checks in small ditches and drainage areas.
3. Install on the lower side of cleared areas to catch sediment from sheet flow.

B. Construction Requirements:

1. Bales of straw shall be utilized to control erosion, trap sediment, and divert runoff.
2. Bales must be adequately braced from behind.

3.8 SILT FENCE

A. General

1. Install along the toe of fills over 10' in height, along the right-of-way line, parallel to streams or around an inlet to prevent sediment from entering the pipe system.

B. General Requirements:

1. The Contractor shall install a temporary silt fence in locations shown on the drawings, around inlets that accept flows containing silt, and other locations necessary to prevent the discharge of silt from the site.
2. Installation shall conform to the detail at the end of this section.
3. Fence construction shall be adequate to handle the stress from hydraulic and sediment loading.

C. Installation

1. Geotextile at the bottom of the fence shall be buried as indicated on the detail.

2. The trench shall be backfilled and the soil compacted over the geotextile. The geotextile shall be spliced together as indicated on the detail.
3. Post Installation
 - a. Post spacing shall not exceed 8' for wire support fence installation or 5' for self supported installations.
 - b. Posts shall be driven a minimum of 24" into the ground. Where rock is encountered, posts shall be installed in a manner approved by the Owner's Representative.
 - c. Closer spacing, greater embedment depth and/or wider posts shall be used in low areas, soft, or swampy ground to ensure adequate resistance to applied loads.
4. When support fence is used, the mesh shall be fastened securely to the upstream side of the post.
 - a. The mesh shall extend into the trench a minimum of 2" and extend a maximum of 36" above the original ground surface.
5. When self-supported fence is used, the geotextile shall be securely fastened to fence posts.
6. Maintenance
 - a. The Contractor shall maintain the integrity of silt fences as long as they are necessary to contain sediment runoff.
 - b. The Contractor shall inspect all temporary silt fences immediately after each rainfall and at least daily, during prolonged rainfall.
 - c. The Contractor shall immediately correct deficiencies.
 - d. The Contractor shall make a daily review of the location of silt fences in areas where construction activities have changed the natural contour and drainage runoff to ensure that the silt fences are properly located for effectiveness.
 - e. Where a single fence is not adequate to handle the volume of silt or flows are not completely intercepted, additional silt fences shall be installed.
7. The Contractor shall remove and dispose of sediment deposits when the deposit approaches one-half the height of the fence.
8. The silt fence shall remain in place until the upstream surface is stabilized. Upon removal, the Contractor shall remove the silt fence, dispose of excess silt, and restore the disturbed area.

3.9 SEDIMENT REMOVAL

- A. General
- B. Sediment deposits shall be removed when:
 - C. The deposits reach approximately one-half the height of a ditch check, straw bale barrier or silt fence.
 - D. The sediments have reduced the ponded volume of sediment basins to one-third of the original volume.
 - E. Requested by the Owner's Representative.

- F. Sediment removed from erosion control features shall be deposited in a location where it will not erode into construction areas or watercourses.

END OF SECTION 31 25 00

SECTION 32 13 13 -- CONCRETE PAVEMENT

PART 1 GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions, apply to this section.

1.2 SUMMARY

- A. Cast-in-place concrete paving shall be installed by the Contractor for all portions of the project that have been accepted by the owner to be installed as concrete pavement in lieu of asphalt paving. This section applies to exterior driving and walking surfaces depicted on the plan.

1.3 SUBMITTALS

- A. Product Data: Submit manufacturer's product data and installation instructions for each material and product used.
- B. Design Mixes: Submit for approval design mixes, including adjustments for variations in project conditions.
 - 1. Mixes to be designed in accordance with the Portland Cement Association.
 - 2. All exposed concrete shall be air entrained. Allowable ranges shall be as follows:
 - 1. $\frac{3}{4}$ " to 1" aggregate size shall contain 6.0% average entrained air. The total air content range shall be between 5%-7%.
 - 3. All concrete shall achieve 4000 psi compressive strength in 28 days.
 - 4. Flint and chert to be limited to 1% maximum, by weight of the coarse aggregate, in all exposed concrete. Lignite will be limited to 0.07% by weight of the fine aggregate in all exposed concrete.
 - 5. Sand shall be from local sources meeting ASTM C-33 Size 67 for concrete.
 - 6. The use of calcium chloride in concrete mixes will not be permitted. Fly ash is permitted as needed to reduce the total amount of portland cement, which would otherwise be used, by not more than 30 percent. Limit percentage, by weight, of cementitious materials other than portland cement in concrete as follows:
 - a. Fly Ash: 15 percent.
 - 7. Maximum water-to-cementitious materials ratio shall be .48
 - 8. Concrete slump shall be a maximum of 4" +/- 1" (ASTM C- 143) as delivered in the field. Contractor may use chemical admixtures to attain a maximum slump of 8" for workability. No water may be added to the concrete mix on site unless water is withheld at the batching facility. If water is withheld at the batching facility it

should be reflected on the load ticket. The total amount of water in the mix shall not exceed what is noted on the approved mixed. This shall be noted in the special inspector's records.

- C. Test Mix Reports: Submit test reports for approval prior to construction.

1.4 QUALITY ASSURANCE

- A. Comply with governing codes and regulations. Provide products of acceptable manufacturers, which have been in satisfactory use in similar service for three years. Use experienced installers. Deliver, handle, and store materials in accordance with manufacturer's instructions.
- B. Construction Tolerance: 1/8' in 10' for grade and alignment of top of forms; 1/4' in 10' for vertical face on longitudinal axis.
- C. Testing: Independent testing agency shall be obtained by the contractor. Testing requirements shall be as follows:
 - a. An ACI certified Grade I field technician shall perform the testing
 - b. Test shall be performed for strength, air entrainment, temperature, and slump. Strength tests will require 4 cylinders (1 broken @ 7 days; 2 broken @ 28 days, 1 spare). Test results should be sent to the contractor, architect, and owner's representative.
 - c. Concrete will be tested at the minimum rate of one test for the first 25 cubic yards placed each day, and one test for each additional 50 cubic yards placed thereafter.
 - d. Test data from concrete cylinder breaks will be evaluated using procedures of ACI 214.

PART 2 PRODUCTS

2.1 MATERIALS

- A. Concrete Paving Materials:
 - 1. Accessories:
 - a. Wire Mesh Reinforcement: Welded plain steel wire fabric, ASTM A 185.
 - b. Reinforcing Bars: Deformed steel bars, ASTM A 615, Grade 60.
 - c. Fabricated Bar Mats: Steel bar or rod mats, ASTM A 184, using ASTM A 615, Grade 60 steel bars.
 - d. Joint Dowel Bars: Plain steel bars, ASTM A 615, Grade 60.
 - e. Hook Bolts: ASTM A 307, Grade A threaded bolts.
 - f. Liquid-Membrane Forming and Sealing Curing Compound: ASTM C 309, Type I, Class A.
 - g. Bonding Compound: Polyvinyl acetate or acrylic base.
 - h. Color Pigment: ASTM C 979.
 - i. Marking Paint: FS TT-P-1952 white for parking stripes, and blue at handicap areas.
 - j. Epoxy Adhesive: ASTM C 881.

PART 3 EXECUTION

3.1 INSTALLATION

- A. Comply with ACI 301 for measuring, mixing, transporting, and placing concrete.
- B. Proof roll subbase and check for unstable areas. Report unsatisfactory conditions in writing to the owners representative.
- C. Comply with concrete section for concrete mix, testing placement, joints, tolerances, curing, repairs and protection.
- D. Dispose of over-mixed concrete off-site in a legal manner.
- E. Protect concrete paving until weight of a person will not leave any impression. Remove and replace concrete paving, which shows impressions or other defects. Skim coating defects is not acceptable.
- F. Contraction joints shall be tooled during finishing or sawed within 18 hours of concrete placement. If the joint edge ravel, do not proceed until concrete has sufficient cure time to saw without damage.
 - a. Contraction joints shall have a minimum depth of $\frac{1}{4}$ of the pavement thickness and a minimum width of $\frac{1}{8}$ "
 - b. Transverse contraction joints will be provided at a maximum of 2.5 times the pavement thickness (in inches) in feet for street pavements and 2.0 times for all other pavements.
 - c. Longitudinal joints shall have a maximum separation of 12 feet for streets and drives and 9 feet for sidewalks.
 - d. The ratio of slab width to length should not exceed 1.67 for street pavements and 1.25 for all other pavements.
 - e. All joints to be sealed with bituminous joint sealant.
- G. Sweep and clean surface to eliminate loose material and dust and apply paint with mechanical equipment to produce pavement markings of dimensions indicated with uniform, straight edges. Apply at manufacturer's recommended rates to provide a minimum wet film thickness of 15 mils

END OF SECTION 32 13 13

SECTION 32 13 73 -- CONCRETE PAVING JOINT SEALANTS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following:
 - 1. Expansion and contraction joints within cement concrete pavement.
- B. Related Sections include the following:
 - 1. Specification Section 32 1313 "Concrete Pavement" for constructing joints in concrete pavement.

1.3 SUBMITTALS

- A. Product Data: For each joint-sealed product indicated.
- B. Product Certificates: For each type of joint sealant and accessory, signed by product manufacturer.

1.4 QUALITY ASSURANCE

- A. Installer Qualifications: An employer of workers trained and approved by manufacturer.
- B. Source Limitations: Obtain each type of joint sealant through one source from a single manufacturer.

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Deliver materials to project site in original unopened containers or bundles with labels indicating manufacturer, product name and designation, color, expiration date, pot life, curing time, and mixing instructions for multicomponent materials.
- B. Store and handle materials to comply with manufacturer's written instructions to prevent their deterioration or damage due to moisture, high or low temperatures, contaminants, or other causes.

1.6 PROJECT CONDITIONS

- A. Do not proceed with installation of joint sealants under the following conditions:
 - 1. When ambient and substrate temperature conditions are outside limits permitted by joint sealant manufacturer or are below 40 deg F.
 - 2. When joint substrates are wet or covered with frost.
 - 3. Where joint widths are less than those allowed by joint-sealant manufacturer for applications indicated.

4. Where contaminants capable of interfering with adhesion have not yet been removed from joint substrates.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Products: Subject to compliance with requirements, provide one of the products listed in other Part 2 articles

2.2 MATERIALS, GENERAL

- A. Compatibility: Provide joint sealants, backing materials, and other related materials that are compatible with one another and with joint substrates under conditions of service and application, as demonstrated by joint-sealant manufacturer based on testing and field experience.

2.3 COLD-APPLIED JOINT SEALANTS (SIDEWALKS)

- A. Type NS Silicone Sealant for Concrete: Single-component, low-modulus, neutral-curing, nonsag silicone sealant complying with ASTM D 5893 for Type NS.
 1. Products:
 - a. Crafcro Inc.; RoadSaver Silicone
 - b. Dow Corning Corporation; 888
 - c. W.R. Meadows; Pourthane NS
 2. Joint-Sealant Backer Materials
 - a. General: Provide joint-sealant backer materials that are nonstaining; are compatible with joint substrates, sealants, primers, and other joint fillers; and are approved for applications indicated by joint-sealant manufacturer based on field experience and laboratory testing
 - b. Round Backer Rods for Cold-Applied Sealants: ASTM D 5249, Type 3, of diameter and density required to control sealant depth and prevent bottom-side adhesion of sealant.

2.4 HOT-APPLIED JOINT SEALANTS (PARKING LOTS)

- A. Joint Filler. After the pavement has been properly cured, all open joints including expansion joints, construction joints, and longitudinal joints, shall be cleaned, primed with a light grade of cut-back asphalt, and poured full of an approved hot poured joint sealing compound. The joint sealing compound shall be either polymeric asphalt based (AASHTO M301, ASTM D3405) or elastomeric-type (AASHTO M282, ASTM D3406), heated and applied in strict accordance with instructions of the manufacturer. Joints must be thoroughly clean and dry immediately before seal is poured and sealing compound shall be poured so that the joint is filled to the level of the adjacent concrete surfaces.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine joints indicated to receive joint sealants, with Installer present, for compliance with requirements for joint configuration, installation tolerances, and other conditions affecting joint-sealant performance.
 - 1. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Surface Cleaning of Joints: Clean out joints immediately before installing joint sealants to comply with joint-sealant manufacturer's written instructions.

3.3 INSTALLATION OF JOINT SEALANTS

- A. General: Comply with joint-sealant manufacturer's written installation instructions for products and applications indicated, unless more stringent requirements apply.
- B. Sealant Installation Standard: Comply with recommendations in ASTM C 1193 for use of joint sealants as applicable to materials, applications, and conditions indicated.
- C. Install backer materials of type indicated to support sealants during application and at position required to produce cross-sectional shapes and depths of installed sealants relative to joint widths that allow optimum sealant movement capability.
 - 1. Do not leave gaps between ends of backer materials.
 - 2. Do not stretch, twist, puncture, or tear backer materials.
 - 3. Remove absorbent backer materials that have become wet before sealant application and replace them with dry materials.
- D. Install sealants using proven techniques that comply with the following and at the same time backing are installed:
 - 1. Place sealants so they directly contact and fully wet joint substrates.
 - 2. Completely fill recesses provided for each joint configuration.
 - 3. Produce uniform, cross-sectional shapes and depths relative to joint widths that allow optimum sealant movement capability.
- E. Tooling of Nonsag Sealants: Immediately after sealant application and before skinning or curing begins, tool sealants according to requirements specified below to form smooth, uniform beads of configuration indicated; to eliminate air pockets; and to ensure contact and adhesion of sealant with sides of joint.
 - 1. Remove excess sealants from surfaces adjacent to joint.
 - 2. Use tooling agents that are approved in writing by joint-sealant manufacturer and that do not discolor sealants or adjacent surfaces.
- F. Provide joint configuration to comply with joint-sealant manufacturer's written instructions, unless otherwise indicated.
- G. Provide recessed joint configuration for silicone sealants of recess depth and at locations indicated.

3.4 CLEANING

- A. Clean off excess sealants or sealant smears adjacent to joints as the Work progresses by methods and with cleaning materials approved by manufacturers of joint sealants and of products in which joints occur.

3.5 PROTECTION

- A. Protect joint sealants during and after curing period from contact with contaminating substances and from damage resulting from construction operations or other causes so sealants are without deterioration or damage at time of Substantial Completion. If, despite such protection, damage or deterioration occurs, cut out and remove damaged or deteriorated joint sealants immediately and replace with joint sealant so installations with repaired areas are indistinguishable from the original work.

END OF SECTION 32 13 73

SECTION 32 20 00 -- TURF AND GRASSES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions, apply to this section.

1.2 SCOPE

- A. The Landscape Contractor shall provide all labor, equipment, materials and services necessary to furnish and install seeding as specified herein, as indicated on the drawings and to all areas disturbed by this project for seeding.
- B. Work shall include, but is not limited to, the following:
 - 1. Soil Preparation
 - 2. Seeding
 - 3. Maintenance Period
- C. Related work specified elsewhere:
 - 1. Section 31 1000 Site Clearing
 - 2. Section 31 2000 Earth Moving
- D. Guarantee
 - 1. Seeding
 - a. After final grading the Contractor shall guarantee a satisfactory stand of grass (10lbs/1,000 sf.), and shall repair and re-seed any wash-outs or areas not covered with grass, at the end of sixty (60) days at no additional cost to the Owner.
 - b. The Contractor shall be responsible for the removal of weeds, tall grasses, rocks, etc. before seeding is completed.

PART 2 - MATERIALS

2.1 MATERIALS FOR SEEDING

- A. Agricultural limestone at seed manufacturer's recommended rate based on soils testing.
- B. Commercial fertilizer 23-7-7 or 24-6-6 analysis, urea based, slow release type nitrogen, used at seed manufacturer's recommended based on soils testing.
- C. Seed for "Seed and Straw" area shall be a mix of 80% K-31 Tall Fescue and 20% "Gulf" Annual or "Linn" Perennial Ryegrass. Seed at a rate of 10 lbs. per 1,000 sf.
- D. Other specific commercial pre-mixed seed mixes that have a proven track record of success for the purpose and location will be considered when accompanied by a Request for Substitution.

PART 3 - EXECUTION

3.1 SEEDING

- A. Seeding operations shall be performed when conditions are favorable to establish a strong stand of grass. When seeding in the fall, seeding shall be completed prior to October 1.
- B. Furnish all labor, materials, equipment and services necessary to seed all unpaved areas of the project site and at all areas disturbed by this project.
- C. Cultivate areas to be seeded by disking to a depth of four inches (4"). Remove all stones and rocks larger than one inch (1"), roots, sticks, construction debris and other extraneous materials.
- D. Apply lime and fertilizer at the rates designated and mix thoroughly into the soil to depth of four inches (4").
- E. Areas to be seeded shall then be fine graded to a smooth even surface with a loose, uniformly fine texture. Roll, rake and drag lawn areas, remove ridges and fill depressions, as required to meet the finish grades.
- F. Sow seed using a mechanical spreader or seeding machine calibrated to distribute the seed at the rate designated. Do not seed when wind velocities exceed five (5) miles per hour. Distribute seed evenly over the entire area by sowing equally in two (2) directions at right angles to each other.
- G. Rake seed lightly into the top ¼" of soil, roll lightly and water thoroughly with a fine spray.
- H. Protect newly seeded areas against erosion by spreading straw mulch after completion of the seeding operations. Spread straw mulch uniformly to form a continuous blanket not less than 1½" inch loose thickness. Sloped areas greater than 1:6 shall be protected against erosion by installing erosion control netting as approved by the Architect.
- I. Anchor straw mulch by spraying with an asphalt emulsion at the rate of 10 to 13 gallons per thousand square feet.
- J. The contractor may use hydroseeding in lieu of mechanical seeding. If hydroseeding is used, mix specified seed, fertilizer and pulverized mulch in water using equipment specifically designed for hydroseed applications. Mix into a uniformly blended, homogeneous slurry. Apply slurry uniformly to all areas requiring seeding at a rate of application required to obtain the specified seed sowing rate.
- K. Maintain seeded lawn areas by watering, fertilizing, weeding, mowing, trimming and other operations such as rolling, regarding and replanting as required to establish a smooth acceptable lawn, free of eroded or bare areas.
- L. All seeded lawn areas shall be maintained as outlined above for not less than sixty (60) days after the dates of Substantial Completion. If seeded in the fall and not given a full sixty (60) days of maintenance, or if not considered acceptable at that time, maintenance shall continue the following spring for up to an additional sixty (60) days.

3.2 CLEAN UP

- A. Remove all surplus materials and debris from the project site.
- B. Finally water all seeded areas before leaving site.

END OF SECTION 32 20 00

SECTION 33 1113 – FACILITY WATER DISTRIBUTION PIPING

PART 1 – GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specifications, apply to this Section.

1.2 SUMMARY

- A. This Section includes water-distribution piping and related components outside the building for water service and fire-service mains.
- B. Utility-furnished products include water meters that will be furnished to the site and installed by the Utility.

1.3 DEFINITIONS

- A. EPDM: Ethylene propylene diene terpolymer rubber.
- B. PVC: Polyvinyl chloride plastic.
- C. Utility: Local Utility Company

1.4 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Field quality-control test reports.
- C. Operation and Maintenance Data: For water valves and specialties to include emergency, operation, and maintenance manuals.

1.5 QUALITY ASSURANCE

- A. Regulatory Requirements:
 - a. Comply with requirements of utility company supplying water, include tapping of water mains and backflow prevention.
 - b. Comply with standards of authorities having jurisdiction for potable-water-service piping, including materials, installation, testing, and disinfection.

- c. Comply with standards of authorities having jurisdiction for fire-suppression water service piping, including materials, hose threads, installation, and testing.

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Preparation for Transport: Prepare valves, including fire hydrants, according to following:
 - a. Ensure that valves are dry and internally protected against rust and corrosion.
 - b. Protect valves against damage to threaded ends and flange faces.
 - c. Set valves in best position for handling. Set valves closed to prevent rattling.
- B. During Storage:
 - a. Do not remove end protectors unless necessary for inspection; then reinstall for storage.
 - b. Protect from weather. Store indoors and maintain temperature higher than ambient dew-point temperature. Support off the ground or pavement in watertight enclosures when outdoor storage is necessary.
- C. Handling: Use sling to handle valves and fire hydrants if size requires handling by crane or lift. Rig valves to avoid damage to exposed parts. Do not use handwheels or stems as lifting or rigging points.
- D. Deliver piping with factory-applied end caps. Maintain end caps through shipping, storage, and handling to prevent pipe-end damage and to prevent entrance of dirt, debris, and moisture.
- E. Protect stored piping from moisture and dirt. Elevate above grade. Do not exceed structural capacity of floor when storing inside.
- F. Protect flanges, fittings, and specialties from moisture and dirt.
- G. Store plastic piping protected from direct sunlight. Support to prevent sagging and bending.

1.7 PROJECT CONDITIONS

- A. Interruption of Existing Water Distribution Service: Do not interrupt service to facilities occupied by Owner or others unless permitted under the following conditions, and then only after arranging to provide temporary water-distribution service according to requirements indicated:
 - a. Coordinate all interruptions with utility company supplying water.
 - b. Do not proceed with interruption of water-distribution service without permission from Owner and utility company supplying water.

1.8 COORDINATION

- A. Coordinate connection to water main with utility company.

PART 2 – PRODUCTS

2.1 PVC PIPE AND FITTINGS

- A. PVC, AWWA Pipe: AWWA C900, SDR No. 21, Class 200, with bell end with gasket, and with spigot end.
- B. PVC, AWWA Pipe: AWWA C900, Class 200, with bell end with gasket, and with spigot end.
 - a. Comply with UL 1285 for fire-service mains if indicated.
 - b. PVC Fabricated Fittings: AWWA C900, Class 200, with bell and spigot or double bell ends. Include elastomeric gasket in each bell.
 - c. PVC Molded Fittings: AWWA C907, Class 200, with bell and spigot or double-bell ends. Include elastomeric gasket in each bell.
 - d. Push-on-Joint, Ductile-Iron Fittings: AWWA C110, ductile or gray iron standard pattern or AWWA C153, ductile iron compact pattern.
 - i. Gaskets: AWWA C111, rubber.
 - e. Mechanical-Joint, Ductile-Iron Fittings: AWWA C110, ductile or gray iron standard pattern or AWWA C153, ductile iron compact pattern.
 - i. Glands, Gaskets, and Bolts: AWWA C111, ductile or gray iron glands, rubber gaskets, and steel bolts.

2.2 JOINING MATERIALS

- A. Plastic Pipe Flange Gasket, Bolts, and Nuts: Type and material recommended by piping system manufacturer, unless otherwise indicated.

2.3 PIPING SPECIALTIES

- A. Transition Fittings: Manufactured fitting or coupling same size as, with pressure rating at least equal to and ends compatible with, piping to be joined.

2.4 GATE VALVES

- A. AWWA, Cast Iron Gate Valves:
 - a. All valves and accessories shall comply with the current Utility Specifications for water main construction.
 - b. Manufacturers: Subject to compliance with Utility requirements, acceptable by Utility.
 - c. Nonrising-Stem, High-Pressure, Resilient-Seated Gate Valves
 - i. Description: Ductile-iron body and bonnet; with bronze or ductile-iron gate, resilient seats, bronze stem, and stem nut.
 - ii. Standard: AWWA C509.
 - iii. Minimum Pressure Rating: 250 psig (1725 kPa).
 - iv. End Connections: Push on or mechanical joint.

- v. Interior Coating: Complying with AWWA C550

2.5 GATE VALVE ACCESSORIES AND SPECIALTIES

- A. Tapping-Sleeve Assemblies:
 - a. All tapping sleeves and accessories shall comply with the current Utility specifications.
 - b. Manufacturers: Subject to compliance with Utility requirements, acceptable to Utility

2.6 CHECK VALVES

- A. AWWA, Check Valves:
 - a. All valves and accessories shall comply with current Utility Specifications.
 - b. Manufacturers: Subject to compliance with Utility requirements.
 - c. Description: Swing-check type with resilient seat. Include interior coating according to AWWA C550 and ends to match piping.
 - i. Standard: AWWA C508
 - ii. Pressure Rating: 200 psig.

2.7 CORPORATION VALVES AND CURB VALVES

- A. General: As required by Utility company supplying water.
- B. Manufacturers: Per current Utility Specifications.

2.8 METER BOXES

- A. Meter boxes shall be of durable, high-density polyethylene, molded with solid walls (containing no foam or corrugations) and shall have flanged bottom not only for added strength but also to retard settling or sinking into the ground. The nominal wall thickness of the box shall not be less than 0.55 inch and the box shall have nominal dimensions of 20 inch diameter (O.D.) by 30 inch depth. Other sizes may be used, if necessary, for larger settings.
- B. The polyethylene (PE) plastic material specified for the box shall be Type III or Type IV High Density polyethylene per ASTM D1248, with densities of 0.95 g/c.c. and above, as determined by ASTM D1505 test method. The interior color of the box should be white (natural) to aid in meter reading, but the exterior shall be black, compounded to improve strength and to protect against deterioration below ground. The low temperature brittleness shall be a maximum of 76 degrees Fahrenheit per ASTM D746.

2.9 METER BOX FRAMES AND COVERS

- A. Meter box frame and cover to be used in conjunction with the meter boxes above.
- B. Covers shall be Type A, 21-1/4-inch O.D., and shall be constructed of traffic rated material and load rating.
- C. Meter box frames for traffic areas shall be cast iron sized to suit cover and meter box furnished. Meter box frames and cover shall be tested to withstand AASHTO H-20 loading and shall be approved by owner.
- D. Acceptable manufacturers and models for meter box frame and cover to be coordinated with owner.

PART 3 – EXECUTION

3.1 EARTHWORK

- A. Refer to Section 31 2000 “Earth Moving” for excavating, trenching, and backfilling.

3.2 PIPING APPLICATIONS

- A. General: Use pipe, fittings, and joining methods for piping systems according to the following applications.
- B. Transition couplings and special fitting with pressure ratings at least equal to piping pressure rating may be used, unless otherwise indicated.
- C. Do not use flanges or unions for underground piping.

3.3 PIPING INSTALLATION

- A. Water Main Connection: Arrange with utility company for tap of size and in location indicated in water main.
- B. Water Main Connection: Tap water main according to requirements of water utility and of size and location indicated.
- C. Make connections larger than NPS 2 with tapping machine according to the following:
 - a. Install tapping sleeve and tapping valve according to MSS SP-60
 - b. Install tapping sleeve on pipe to be tapped. Position flanged outlet for gate valve.
 - c. Use tapping machine compatible with valve and tapping sleeve; cut in main. Remove tapping machine and connect water service piping.
 - d. Install gate valve onto tapping sleeve. Comply with MSS SP-60. Install valve with stem pointing up and with valve box.
- D. Comply with NFPA 24 for fire service main piping materials and installation.
- E. Install PVC, AWWA pipe according to ASTM F 645 and AWWA M23.

- F. Bury piping with depth of cover over top at least 48 inches below finish grade.
- G. Install piping by Local Utility Company trenchless methods, under streets and other obstructions that cannot be disturbed.
- H. Extend water service piping and connect to water supply source in locations and pipe sizes indicated.
- I. Install underground piping with restrained joints at horizontal and vertical changes in direction. Use restrained-joint piping, thrust blocks, anchors, tie-rods and clamps, and other supports as needed or required.

3.4 JOINT CONSTRUCTION

- A. Make pipe joints according to the following:
 - a. PVC piping gasketed joints: Use joining materials according to AWWA C900. Construct joints with elastomeric seals and lubricate according to ASTM D 2774 or ASTM D 3139 and pipe manufacturer's written instructions.

3.5 ANCHORAGE INSTALLATION

- A. Anchorage, General: Install water distribution piping with restrained joints. Anchorages and restrained joint types that may be used include the following:
 - a. Concrete thrust blocks.
 - b. Thrust Collars.
 - c. Pipe clamps and tie rods.
- B. Install anchorages for tees, plugs and caps, bens, crosses, valves, and hydrant branches. Include anchorages for the following piping systems:
 - a. Gasketed-Joint, PVC Water-Service Piping: According to AWWA M23.

3.6 VALVE INSTALLATION

- A. AWWA Gate Valves: Comply with AWWA C600 and AWWA M44. Install each underground valve with stem pointing up and with valve box. Valve boxes shall be in compliance with Utility Specifications, and as detailed within the civil plans.
- B. AWWA Valves other than gate valves: Comply with AWWA C600 and AWWA M

3.7 WATER METER INSTALLATION

- A. Install water meters, piping, and specialties according to Utility company's specifications. Meter installation will be performed by the Utility company.

3.8 WATER METER BOX INSTALLATION

- A. Install backflow preventers of type, size, and capacity indicated. Include valve and test cocks. Install according to requirements of plumbing and health department authorities having jurisdiction.

3.9 BACKFLOW PREVENTER INSTALLATION

- A. Install backflow preventers of type, size, and capacity indicated. Include valves and test cocks. Install according to requirements of plumbing and health department and authorities having jurisdiction.

3.10 CONNECTIONS

- A. Install all exterior water piping connections per current Utility Specifications and construction requirements.
- B. Connect water distribution piping to utility in water main, in accordance with Utility requirements. Use tapping sleeve and tapping valve.

3.11 FIELD QUALITY CONTROL

- A. Piping Tests: Conduct piping tests before joints are covered and after concrete thrust blocks have hardened sufficiently. Fill pipeline 24 hours before testing and apply test pressure to stabilize system. Use only potable water.
- B. Hydrostatic Tests: Test at not less than on-and-one-half times the working pressure for two hours or as required by the Utility company.
- C. Prepare reports of testing activities as needed.
- D. Conduct all waterline tests required by Utility and obtain Utility acceptance of all lines to be public.

3.12 IDENTIFICATION

- A. Install continuous underground THHN-12 solid blue locator wire. All installation and connections shall be per the current Utility Specifications, and as detailed in the civil plans. Underground warning tapes are specified in Section 31 2000 "Earth Moving".

3.15 CLEANING

- A. Clean and disinfect water-distribution piping as follows:
 - a. Purge new water-distribution piping systems and parts of existing systems that have been altered, extended, or repaired before used.
 - b. Use purging and disinfecting procedure prescribed by authorities having jurisdiction or, if method is not prescribed by authorities having jurisdiction, use procedure described in NFPA 24 for flushing of piping. Flush piping system with clean, potable water until dirty water does not appear at points of outlet.
 - c. Use purging and disinfecting procedure prescribed by authorities having jurisdiction or, if method is not prescribed by authorities having jurisdiction, use procedure described in AWWA C651 or do as follows:
 - i. Fill system or part of system with water/chlorine solution containing at least 50 ppm or chlorine; isolate and allow to stand for 24 hours.
 - ii. Drain system or part of system or previous solution and refill with water/chlorine solution containing at least 200 ppm of chlorine; isolate and allow to stand for 3 hours.
 - iii. After standing time, flush system with clean, potable water until no chlorine remains in water coming from system.
 - iv. Submit water samples in sterile bottles to authorities having jurisdiction. Repeat procedure if biological examination shows evidence of contamination.
 - v. Obtain approval of Utility and Owner.
- B. Prepare reports of purging and disinfecting activities.

END OF SECTION 33 1113

SECTION 33 3000 - SANITARY SEWERAGE UTILITIES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section. Also refer to:
 - 1. Section 31 1000 – Site Clearing
 - 2. Section 31 2000 – Earth Moving

1.2 SUMMARY

- A. Section includes:
 - 1. Pipe and fittings.
 - 2. Cleanouts.
 - 3. Encasement for piping.
 - 4. Manholes.

1.3 DEFINITIONS

- A. FRP: Fiberglass-reinforced plastic.

1.4 SUBMITTALS

- A. Shop Drawings: For manholes. Include plans, elevations, sections, details, and frames and covers.

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Do not store plastic pipe, and fittings in direct sunlight.
- B. Protect pipe, pipe fittings, and seals, from dirt and damage.
- C. Handle manholes according to manufacturer's written rigging instructions.

1.6 PROJECT CONDITIONS

- A. Interruption of Existing Sanitary Sewerage Service: Do not interrupt service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary service according to requirements indicated:
 - 1. Notify Architect, Engineer, and Owner no fewer than one week in advance of proposed interruption of service.
 - 2. Do not proceed with interruption of service without Owner's written permission.

PART 2 - PRODUCTS

2.1 PVC PIPE AND FITTINGS

- A. PVC Gravity Sewer Piping:
 - 1. Pipe and Fittings: ASTM F 679 PVC gravity sewer pipe with bell-and-spigot ends and with integral ASTM F 477, elastomeric seals for gasketed joints.

2.2 CLEANOUTS

- A. Cast-Iron Cleanouts:
 - 1. Description: ASME A112.36.2M, round, gray-iron housing with clamping device and round, secured, scoriated, gray-iron cover. Include gray-iron ferrule with inside calk or spigot connection and countersunk, tapered-thread, brass closure plug.
 - 2. Sewer Pipe Fitting and Riser to Cleanout: ASTM A 74, Service class, cast-iron soil pipe and fittings.

2.3 MANHOLES

- A. Standard Precast Concrete Manholes:
 - 1. Description: ASTM C 478 precast, reinforced concrete, of depth indicated, with provision for sealant joints.
 - 2. Diameter: 48 inches minimum unless otherwise indicated.
 - 3. Ballast: Increase thickness of precast concrete sections or add concrete to base section, as required to prevent flotation.
 - 4. Base Section: 6-inch minimum thickness for floor slab and 4-inch minimum thickness for walls and base riser section; with separate base slab or base section with integral floor.
 - 5. Riser Sections: 4-inch minimum thickness, of length to provide depth indicated.
 - 6. Top Section: Eccentric-cone type unless concentric-cone or flat-slab-top type is indicated; with top of cone of size that matches grade rings.
 - 7. Joint Sealant: ASTM C 990, bitumen or butyl rubber.
 - 8. Resilient Pipe Connectors: ASTM C 923, A-lok connectors cast into manhole walls, for each pipe connection.
 - 9. Steps: Individual ASTM A 615, deformed, ½-inch steel reinforcing rods encased in ASTM D 4101, PP 12-inches wide and designed to prevent lateral slippage off step. Cast or anchor steps into sidewalls uniformly at 16-inch intervals max. Omit steps if total depth from floor of manhole to finished grade is less than 24-inches.
 - 10. Grade Rings: Reinforced-concrete rings, 8-inch total thickness, with diameter matching manhole frame and cover, and with height as required to adjust manhole frame and cover to indicated elevation and slope.
- B. Manhole Frames and Covers:
 - 1. Description: Ferrous; 24-inch ID by 7- to 9-inch riser, with 4-inch- minimum-width flange and 26-inch diameter cover. Include indented top design with lettering cast into cover, using wording equivalent to “SANITARY SEWER.”
 - 2. Material: ASTM A 48, Class 35 gray iron unless otherwise indicated.

2.4 CONCRETE

- A. General: Cast-in-place concrete complying with ACI 318, ACI 350/350R, and the following:
 - 1. Cement: ASTM C 150, Type ii
 - 2. Fine Aggregate: ASTM C 33, sand
 - 3. Coarse Aggregate: ASTM C 33, crushed gravel
 - 4. Water: potable
- B. Portland Cement Design Mix: 4000 psi minimum, with 0.45 maximum water/cementitious materials ratio.
 - 1. Reinforcing Fabric: ASTM A 185, steel, welded wire fabric, plain.
 - 2. Reinforcing Bars: ASTM A 615, Grade 60 deformed steel.

PART 3 - EXECUTION

3.1 EARTHWORK

- A. Excavating, trenching, and backfilling are specified in Specification Section 31 2000 "Earth Moving."

3.2 PIPING INSTALLATION

- A. General Locations and Arrangements: Drawing plans and details indicate general location and arrangement of underground sanitary sewer piping. Location and arrangement of piping layout take into account design considerations. Install piping as indicated, to extent practical. Where specific installation is not indicated, follow piping manufacturer's written instructions.
- B. Install piping beginning at low point, true to grades and alignment indicated with unbroken continuity of invert. Place bell ends of piping facing upstream. Install gaskets, seals, sleeves, and couplings according to manufacturer's written instructions for using lubricants, cements, and other installation requirements.
- C. Install manholes for changes in direction unless fittings are indicated. Use fitting for branch connections unless direct tap into existing sewer is indicated.
- D. Install proper size increasers, reducers, and couplings where different sizes or materials of pipes and fittings are connected. Reducing size of piping in direction of flow is prohibited.
- E. When installing pipe under streets or other obstructions that cannot be disturbed, use pipe-jacking process of microtunneling.
- F. Install gravity-flow, nonpressure, drainage piping according to the following:
 - 1. Install piping pitched down in direction of flow, at minimum slope of 1 percent unless otherwise indicated.
 - 2. Install piping NPS 6 and larger with restrained joints at tee fittings and at changes in direction. Use corrosion-resistant rods, pipe or fitting manufacturer's proprietary restraint system, or cast-in-place-concrete supports or anchors.
 - 3. Install piping with 36-inch cover unless otherwise noted.
 - 4. Install PVC gravity sewer piping according to ASTM D 2321 and ASTM F 1668.

- G. Clear interior of piping and manholes of dirt and superfluous material as work progresses. Maintain swab or drag in piping, and pull past each joint as it is completed. Place plug in end of incomplete piping at end of day and when work stops.

3.3 PIPE JOINT CONSTRUCTION

- A. Join gravity-flow, nonpressure, drainage piping according to the following:
 - 1. Join PVC gravity sewer piping according to ASTM D 2321 and ASTM D 3034 for elastomeric-seal joints for ASTM D 3034 for elastomeric-gasket joints.
 - 2. Join dissimilar pipe materials with nonpressure-type flexible couplings.
- B. Pipe couplings, expansion joints, and deflection fitting with pressure ratings at least equal to piping rating may be used in applications below unless otherwise indicated.
 - 1. Use nonpressure flexible couplings where required to join gravity-flow, nonpressure sewer piping unless otherwise indicated.
 - a. Ring-type flexible couplings for piping of different sizes where annular space between smaller piping's OD and larger piping's ID permits installation.

3.4 MANHOLE INSTALLATION

- A. General: Install manholes complete with appurtenances and accessories indicated.
- B. Install precast concrete manhole sections with sealants according to ASTM C 891.
- C. Form continuous concrete channels and benches between inlets and outlet.
- D. Set tops of frames and covers flush with finished surface of manholes that occur in pavements. Set tops 3 inches above finished surface elsewhere unless otherwise indicated.

3.5 CONCRETE PLACEMENT

- A. Place cast-in-place concrete according to ACI 318.

3.6 CLEANOUT INSTALLATION

- A. Install cleanouts and riser extensions from sewer pipes to cleanouts at grade. Use cast-iron soil pipe fittings in sewer pipes at branches for cleanouts, and use cast-iron soil pipe for riser extensions to cleanouts. Install piping so cleanouts open in direction of flow in sewer pipe.
 - 1. Use Light-Duty, top-loading classification cleanouts in earth or unpaved foot-traffic areas.
 - 2. Use Medium-Duty, top-loading classification cleanouts in paved foot-traffic areas.
 - 3. Heavy-Duty, top-loading classification cleanouts in vehicle-traffic service areas.
 - 4. Extra-Heavy-Duty, top-loading classification cleanout in roads.
- B. Set cleanout frames and covers in earth cast-in-place-concrete block, 24 by 24 by 6 inches deep. Set with tops 1 inch above surrounding grade.
- C. Set cleanout frames and covers in concrete pavement and roads with tops flush with pavement surface.

3.7 CONNECTIONS

- A. Connect nonpressure, gravity-flow drainage piping to building's sanitary building drains where shown on plans.
- B. Make connections to existing piping and underground manholes.
 - 1. Use commercially manufactured wye fittings for piping branch connections. Remove section of existing pipe, install wye fitting into existing piping, and encase entire wye fitting plus 6-inch overlap with not less than 6 inches of concrete with 28-day compressive strength of 3000 psi.
 - 2. Make branch connections from side into existing piping, NPS 4 to NPS 20. Remove section of existing pipe, install wye fitting into existing piping, and encase entire wye with not less than 6 inches of concrete with 28-day compressive strength of 3000 psi.
 - 3. Make branch connections from side into existing piping, NPS 21 or larger, or to underground manholes by cutting opening into existing unit large enough to allow 3 inches of concrete to be packed around entering connection. Cut end of connection pipe passing through pipe or structure wall to conform to shape of and be flush with inside wall unless otherwise indicated. On outside of pipe or manhole wall, encase entering connection in 6 inches of concrete for minimum length of 12 inches to provide additional support of collar from connection to undisturbed ground.
 - 4. Protect existing piping and manholes to prevent concrete or debris from entering while making tap connections. Remove debris or other extraneous material that may accumulate.

3.8 CLOSING ABANDONED SANITARY SEWER SYSTEMS

- A. Abandoned Piping: Close open ends of abandoned underground piping indicated to remain in place. Include closures strong enough to withstand hydrostatic and earth pressures that may result after ends of abandoned piping have been closed. Use either procedure below.
 - 1. Close open ends by grouting 3' into the abandoned section of pipe with concrete: or,
 - 2. Close open ends of piping with glue on PVC cap for any sections of PVC pipe to be capped.
- B. Abandoned Manholes: Excavate around manhole as required and use either procedure below:
 - 1. Remove manhole (for all manholes within the building or foundation footprint) and close open ends of remaining piping, or,
 - 2. Remove top of manhole down to at least 72 inches below final grade (for all manholes outside the building and foundation footprint). Fill the remaining structure with concrete or grout.
- C. Backfill to grade abandoned to Specification Section 31 2000 Section "Earth Moving."

3.9 IDENTIFICATION

- A. Materials and their installation are specified in Division 31 Section "Earth Moving." Arrange for installation of green warning tapes directly over piping and at outside edges of underground manholes.
 - 1. Use detectable warning tape over ferrous piping.
 - 2. Use detectable warning tape over nonferrous piping and over edges of underground manholes.

3.10 FIELD QUALITY CONTROL

- A. Inspect interior of piping to determine whether line displacement or other damage has occurred. Inspect after approximately 24 inches of backfill is in place, and again at completion of Project.
 - 1. Submit separate report for each system inspection.
 - 2. Defects requiring correction include the following:
 - a. Alignment: Less than full diameter of inside of pipe is visible between structures.
 - b. Deflection: Flexible piping with deflection that prevents passage of ball or cylinder of size not less than 92.5 percent of piping diameter.
 - c. Damage: Crushed, broken, cracked, or otherwise damaged piping.
 - d. Infiltration: Water leakage into piping.
 - e. Exfiltration: Water leakage from or around piping.
 - 3. Replace defective piping using new materials, and repeat inspections until defects are within allowances specified.
 - 4. Reinspect and repeat procedure until results are satisfactory.

- B. Test new piping systems, and parts of existing that have been altered, extended, or repaired, for leaks and defects.
 - 1. Do not enclose, cover, or put into service before inspection and approval.
 - 2. Test completed piping systems according to requirements of authorities having jurisdiction.
 - 3. Schedule tests and inspections by authorities having jurisdiction with at least 24 hours advance notice.
 - 4. Submit separate report for each test.
 - 5. Hydrostatic Tests: Test sanitary sewerage according to requirements of authorities having jurisdiction and the following:
 - a. Fill sewer piping and water. Test with pressure of at least 10-foot head of water, and maintain such pressure without leakage for at least 15 minutes.
 - b. Close openings in systems and fill with water.
 - c. Purge air and refill with water.
 - d. Disconnect water supply.
 - e. Test and inspect joints for leaks.
 - 6. Air Tests: Test sanitary sewerage according to requirements of authorities having jurisdiction, UNI-B-6, and the following:
 - a. Option: Test plastic gravity sewer piping according to ASTM F 1417.
 - b. Option: Test concrete gravity sewer piping according to ASTM C 924.
 - 7. Manholes: Perform hydraulic test according to ASTM C 969.
 - 8. All testing is the responsibility of the contractor, and it is the responsibility of the contractor to coordinate all tests and inspections with the authorities having jurisdiction.

- C. Leaks and loss in test pressure constitute defects that must be repaired.

- D. Replace leaking piping using new materials, and repeat testing until leakage is within allowances specified.

3.11 CLEANING

- A. Clean dirt and superfluous material from interior of piping. Flush with potable water.

END OF SECTION 33 30 00

SECTION 33 4100 – STORM UTILITY DRAINAGE PIPING

PART 1 – GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specifications, apply to this Section.

1.2 SUMMARY

- A. Section includes:
 - a. Pipe and fittings.
 - b. Cleanouts.
 - c. Junction boxes.
 - d. Catch basins.
 - e. Stormwater inlets.
 - f. Trench drains.
 - g. Stormwater detention structures.
 - h. Pipe outlets.

1.3 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings:
 - a. Junction Boxes: Include plans, elevations, sections, details, frames, and covers.
 - b. Catch basins, storm water inlets, and junction boxes. Include elevations, sections, details, frames, covers, and grates.
 - c. Stormwater Detention Structures: Include elevations, sections, details, frames, covers, and concrete mix design reports.
 - d. Pipe Outlets: Include elevations, sections, and details.
- C. Field quality control reports.

1.4 DELIVERY, STORAGE, AND HANDLING

- A. Do not store plastic structures, pipe, and fittings in direct sunlight.
- B. Protect pipe, pipe fittings, and seals from dirt and damage.
- C. Handle structures according to manufacturer's written rigging instructions.

- D. Handle catch basins, trench drains, and storm water inlets according to manufacturer's written rigging instructions.

PART 2 – PRODUCTS

2.1 PE PIPE AND FITTINGS

- A. High Density Corrugated PE Pipe with integrally formed smooth waterway AASHTO M 252 and M294, Type S.
 - a. Manufacturer: Advanced Drainage systems (ADS) N-12 HDPE pipe, or approved equal.
 - b. Soil tight gasket joins.

2.2 PVC PIPE AND FITTINGS

- A. PVC Sewer Piping:
 - a. Pipe: ASTM D 3034, SDR 35, PVC sewer pipe with bell and spigot ends for gasket joints.
 - b. ASTM D 3034, PVC with bell ends.
 - c. Gaskets: ASTM F 477, elastomeric seals.

2.3 CONCRETE PIPE AND FITTINGS

- A. Reinforced Concrete Sewer Pipe and Fittings: ASTM C76
 - a. Bell and spigot ends and gasket joints with ASTM C 443, rubber gaskets
 - b. Class 3, minimum, based on depth as detailed in civil plans.
 - c. Class 4, based on depth as detailed in civil plans.
 - d. Class 5, based on depth as detailed in civil plans.

2.4 CLEANOUTS

- A. Plastic Cleanouts:
 - a. Description: HDPE or PVC body with either PVC top or cast iron frame and lid depending on the location. See civil plans for details.

2.5 CATCH BASINS AND JUNCTION BOXES

- A. Standard Precast Concrete Catch Basins and Junction Boxes:
 - a. Description: Per current Local Municipality details and specifications and as shown in the civil plans.

2.6 STORMWATER INLETS

- A. PVC Inlets: As manufactured by Nyloplast and as shown in the civil plans, or approved equal. Include heavy duty frames and grates.
- B. Concrete Inlets: Precast concrete manufactured per current Local Municipality Specifications and details. Include heavy duty frames and grates.

2.7 TRENCH DRAINS

- A. System: ABT, Inc. Trenchformer TFX 12” wide, pre-engineered, cast in place trench drain forming system with 1.04% slope.
- B. Grate: ABT, Inc. high intake slotted, ductile iron TR-12-12.502D grate.

2.8 STORMWATER DETENTION STRUCTURES

- A. Cast-in-Place or precast Concrete, Storm water Detention Structures: Constructed of reinforced-concrete bottom, walls, and top: designed according to current Local Municipality Specifications and as shown on the civil plans.

2.9 PIPE OUTLETS

- A. Concrete Flared End Sections for reinforced concrete pipe (RCP): Per current State Department of Transportation precast concrete flared end section details 732.00N, with concrete toewall.
- B. Galvanized Metal Flared End Sections for plastic pipe: As detailed in the civil plans. Include toe plate extensions per detail.
- C. Riprap: Broken, irregularly sized and shaped, graded stoned as shown in civil plans.

PART 3 – EXECUTION

3.1 EARTHWORK

- A. Refer to Section 31 2000 “Earth Moving” for excavating, trenching, and backfilling.

3.2 PIPING INSTALLATION

- A. Locations and Arrangements: Drawing plans and details indicate location and arrangement of underground storm piping. Location and arrangement of piping layout take into account design considerations. Install piping as indicated.

- B. Install piping being at low point, true to grades and alignment indicated with unbroken continuity of invert. Place bell ends of piping facing upstream. Install gaskets, seals, sleeves, and couplings according to manufacturer's written instructions for use of lubricants, cements, and other installation requirements.

- C. Install gravity-flow, non-pressure drainage piping according to the following:
 - a. Install piping pitched down in the direction of flow.
 - b. Install piping with depths indicated in civil plans. Minimum cover for HDPE pipe shall be maintained per manufacturer's specifications.
 - c. Install PVC profile gravity sewer piping as detailed in civil plans.
 - d. Install reinforced concrete sewer piping as detailed in civil plans.

3.3 PIPE JOINT CONSTRUCTION

- A. Join gravity-flow, non-pressure drainage piping according to the following:
 - a. Join PVC profile gravity sewer piping according to ASTM D 2321 for elastomeric-seal joints or ASTM F 794 for gasket joints.
 - b. Join reinforced-concrete sewer piping according to ACPA's "Concrete Pipe Installation Manual" for rubber gasket joints.

3.4 CLEANOUT INSTALLATION

- A. Install cleanouts and riser extensions from sewer pipes to cleanouts at grade as detailed in civil plans.

3.5 CATCH BASIN AND JUNCTION BOX INSTALLATION

- A. Construct catch basins and junction boxes to sizes and shapes indicated.
- B. Set frames and grates to elevations indicated.

3.6 STORMWATER INLET AND OUTLET INSTALLATION

- A. Construct riprap of broken stone, as indicated.
- B. Install flared end sections at all outlets that spill onto grade.

3.7 TRENCH DRAIN INSTALLATION

- A. Construct straight trench drain to sizes and shapes indicated per manufacturer's directions.

3.8 IDENTIFICATION

- A. Materials and their installation are specified in Division 31 2000 “Earth Moving.” Arrange for installation of green warning tape directly over piping.
 - a. Use detectable warning tape over nonferrous piping.

3.9 FIELD QUALITY CONTROL

- A. Inspect interior of piping to determine whether line displacement or other damage has occurred. Inspect after approximately 24 inches of backfill is in place, and again at completion of project.
 - a. Submit separate reports for each system inspection.
 - b. Defects requiring correction include the following:
 - i. Alignment: Less than full diameter of inside of pipe is visible between structures.
 - ii. Deflection: Flexible piping with deflection that prevents passage of ball or cylinder of size not less than 92.5% of pipe diameter.
 - iii. Damage: Crushed, broken, cracked, or otherwise damaged piping.
 - iv. Infiltration: Water leakage into piping.
 - v. Exfiltration: Water leakage from or around piping.
 - c. Replace defective piping using new materials, and repeat inspections until defects are within allowances specified.
 - d. Reinspect and repeat procedure until results are satisfactory.
- B. Test new piping systems, and parts of existing systems that have been altered, extended, or repaired, for leaks and defects.
 - a. Do not enclose, cover, or put into service before inspection and approval.
 - b. Test completed piping systems according to requirements of authorities having jurisdiction.
 - c. Schedule tests and inspections by authorities having jurisdiction with at least 24 hours’ advanced notice.
 - d. Submit separate report for each test.
- C. Replace leaking piping using new materials, and repeat testing until leakage is within allowances specified.
- D. Perform all tests and obtain Local Municipality approval and acceptance of all sewers and rip-rap outlets to be public.

3.10 CLEANING

- A. Clean interior of piping of dirt and superfluous materials. Flush with water.

END OF SECTION 33 4100