


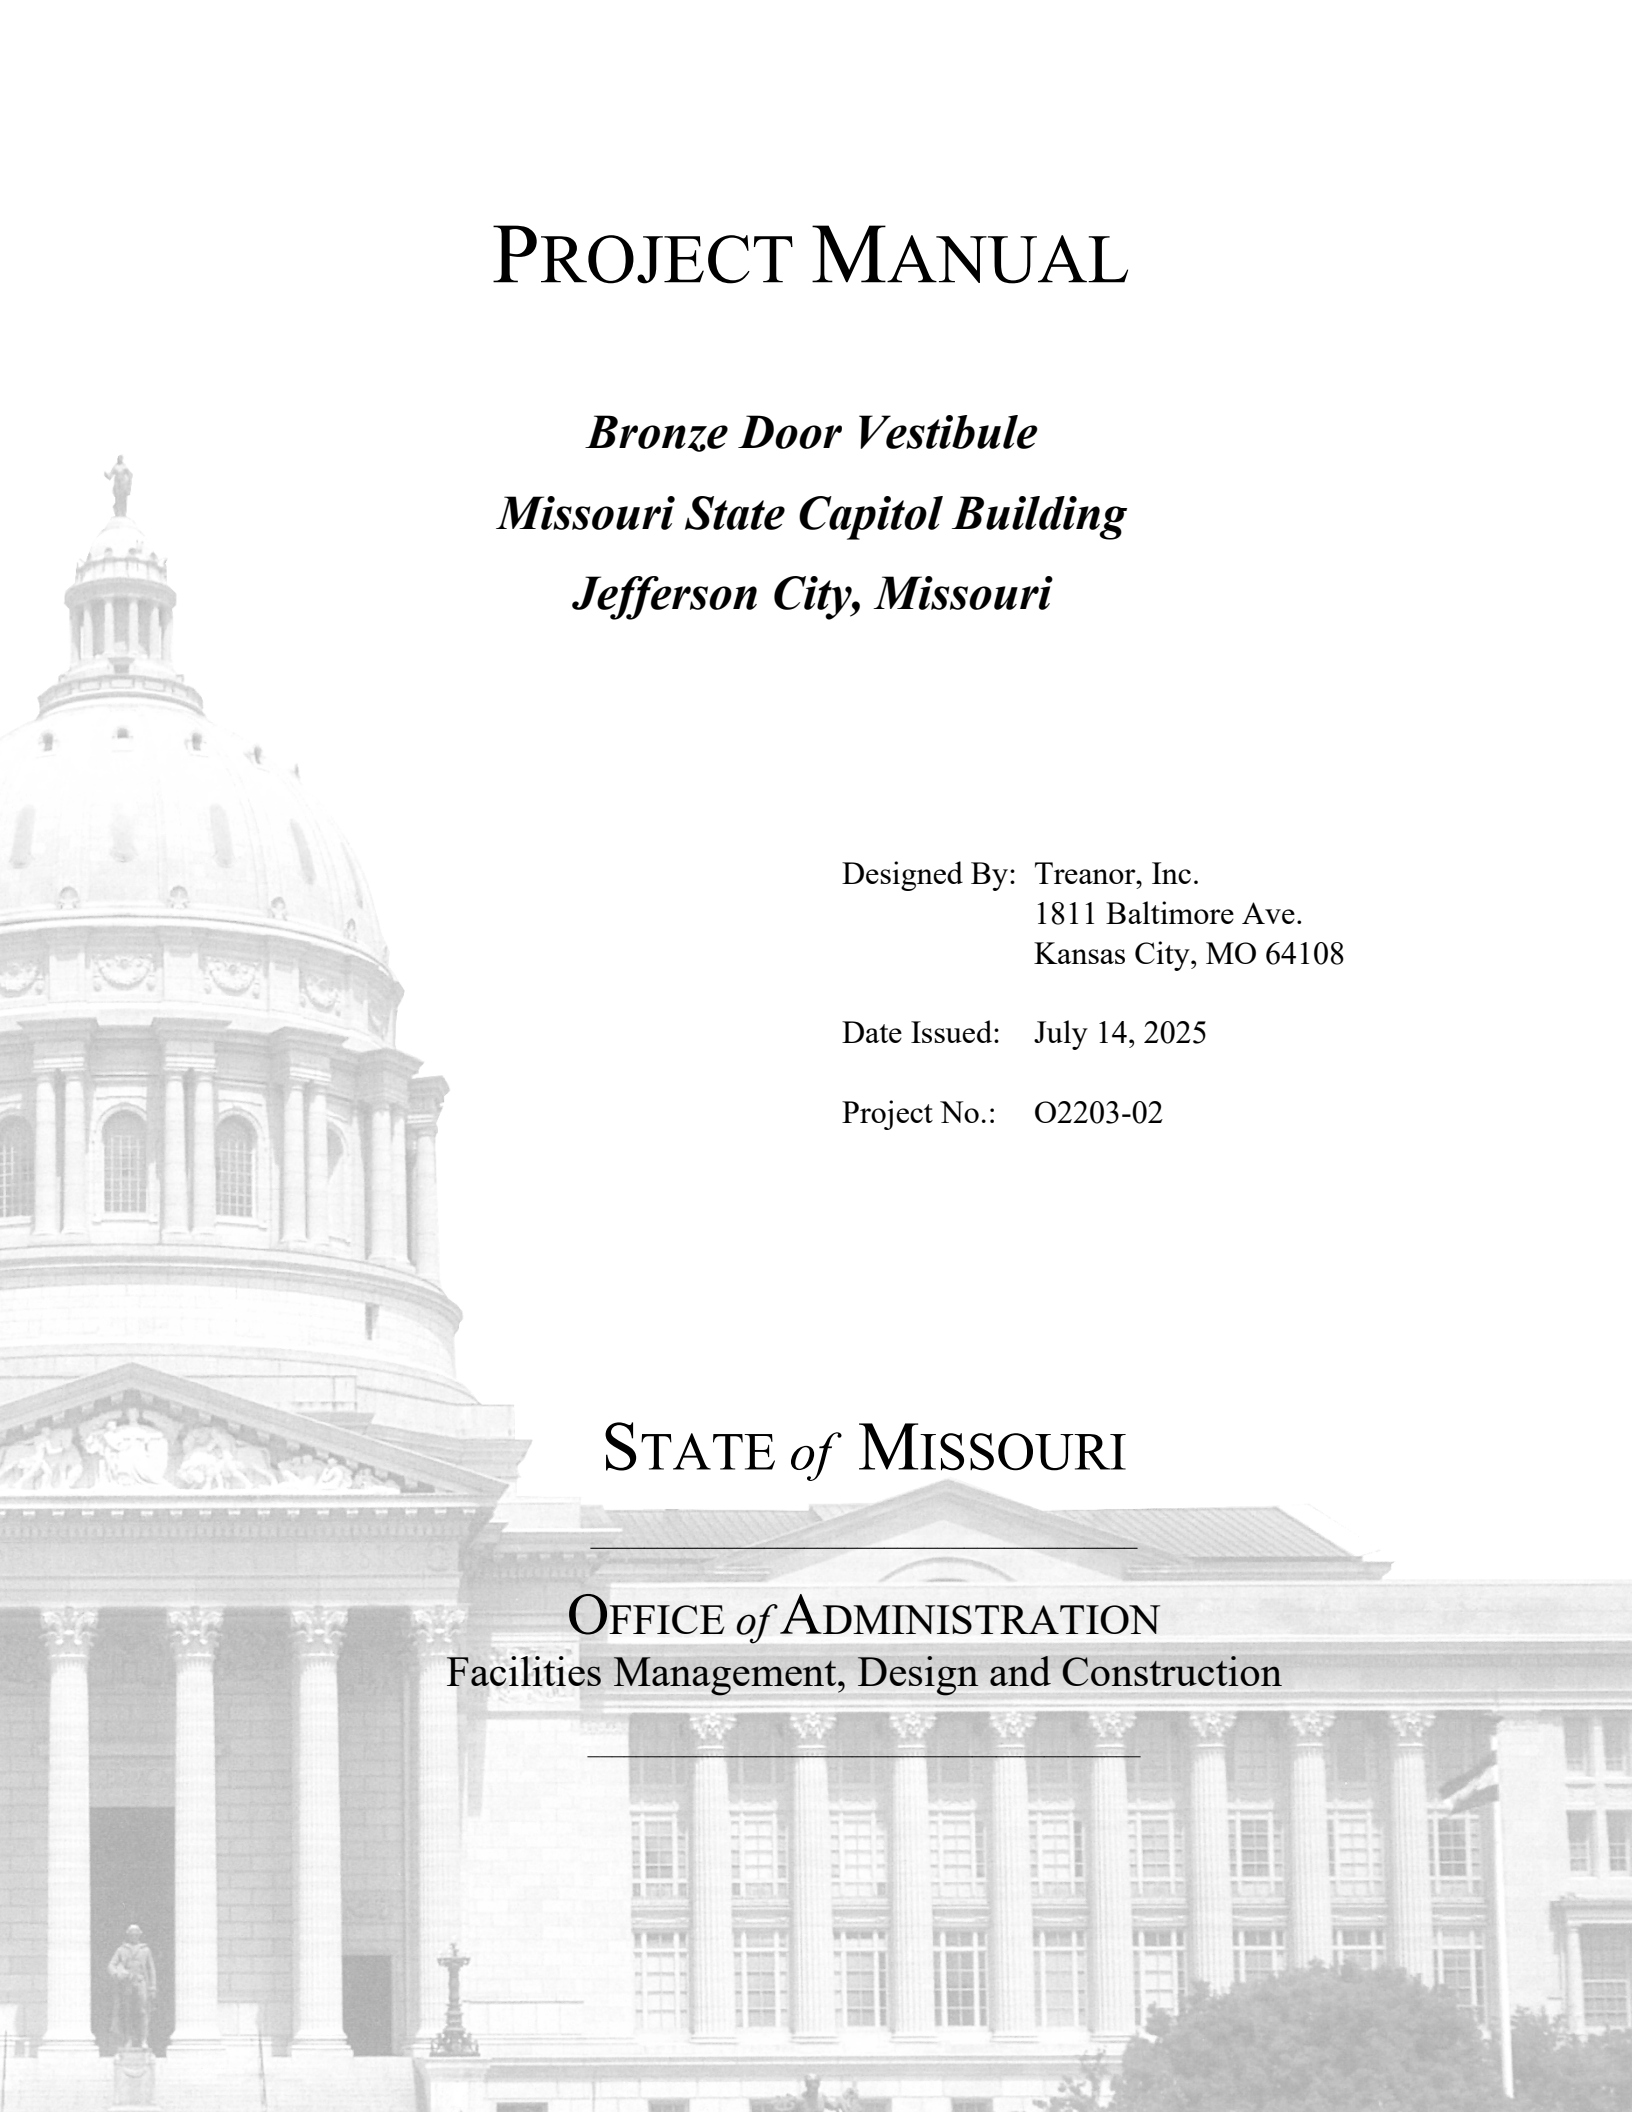

# PROJECT MANUAL

## *Bronze Door Vestibule* *Missouri State Capitol Building* *Jefferson City, Missouri*

Designed By: Treanor, Inc.  
1811 Baltimore Ave.  
Kansas City, MO 64108

Date Issued: July 14, 2025

Project No.: O2203-02

STATE *of* MISSOURI

---


OFFICE *of* ADMINISTRATION  
Facilities Management, Design and Construction

---

## SECTION 000107 - PROFESSIONAL SEALS AND CERTIFICATIONS

**PROJECT NUMBER:** O2203-02 "Bronze Door Vestibule, Missouri State Capitol Building")

**THE FOLLOWING DESIGN PROFESSIONALS HAVE SIGNED AND SEALED THE ORIGINAL PLANS AND SPECIFICATIONS FOR THIS PROJECT, WHICH ARE ON FILE WITH THE DIVISION OF FACILITIES MANAGEMENT, DESIGN AND CONSTRUCTION:**

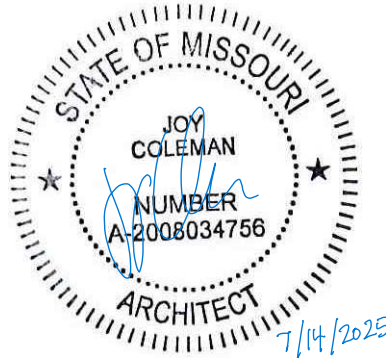

Joy Coleman, AIA  
Principal, Treanor, Inc



Richard Crabtree, PE  
Principal, Bob D. Campbell & Company, Inc

# TABLE OF CONTENTS

| SECTION | TITLE | NUMBER OF PAGES |
|---------|-------|-----------------|
|---------|-------|-----------------|

## DIVISION 00 – PROCUREMENT AND CONTRACTING INFORMATION

### 000000 INTRODUCTORY INFORMATION

|        |                                       |   |
|--------|---------------------------------------|---|
| 000101 | Project Manual Cover                  | 1 |
| 000107 | Professional Seals and Certifications | 1 |
| 000110 | Table of Contents                     | 2 |
| 000115 | List of Drawings                      | 3 |

|        |                          |   |
|--------|--------------------------|---|
| 001116 | INVITATION FOR BID (IFB) | 1 |
|--------|--------------------------|---|

|        |                         |   |
|--------|-------------------------|---|
| 002113 | INSTRUCTIONS TO BIDDERS | 7 |
|--------|-------------------------|---|

### NOTICE TO BIDDERS

The following procurement forms can be found on our website at:  
<https://oa.mo.gov/facilities/bid-opportunities/bid-listing-electronic-plans>  
 and shall be submitted with your bid to [FMDCBids@oa.mo.gov](mailto:FMDCBids@oa.mo.gov)

### 004000 PROCUREMENT FORMS & SUPPLEMENTS

|        |                                                                |   |
|--------|----------------------------------------------------------------|---|
| 004113 | Bid Form                                                       | * |
| 004336 | Proposed Subcontractors Form                                   | * |
| 004337 | MBE/WBE/SDVE Compliance Evaluation Form                        | * |
| 004338 | MBE/WBE/SDVE Eligibility Determination Form for Joint Ventures | * |
| 004339 | MBE/WBE/SDVE Good Faith Effort (GFE) Determination Forms       | * |
| 004340 | SDVE Business Form                                             | * |
| 004541 | Affidavit of Work Authorization                                | * |
| 004545 | Anti-Discrimination Against Israel Act Certification form      | * |

### 005000 CONTRACTING FORMS AND SUPPLEMENTS

|        |                       |   |
|--------|-----------------------|---|
| 005213 | Construction Contract | 3 |
|--------|-----------------------|---|

### 006000 PROJECT FORMS

|           |                                                  |   |
|-----------|--------------------------------------------------|---|
| 006113    | Performance and Payment Bond                     | 2 |
| 006325    | Product Substitution Request                     | 2 |
| 006519.16 | Final Receipt of Payment and Release Form        | 1 |
| 006519.18 | MBE/WBE/SDVE Progress Report                     | 2 |
| 006519.21 | Affidavit of Compliance with Prevailing Wage Law | 1 |

### 007000 CONDITIONS OF THE CONTRACT

|        |                          |    |
|--------|--------------------------|----|
| 007213 | General Conditions       | 20 |
| 007300 | Supplementary Conditions | 1  |
| 007346 | Wage Rate                | 4  |

## DIVISION 1 - GENERAL REQUIREMENTS

|           |                                                |   |
|-----------|------------------------------------------------|---|
| 011000    | Summary of Work                                | 3 |
| 012100    | Allowances                                     | 3 |
| 012600    | Contract Modification Procedures               | 3 |
| 013100    | Coordination                                   | 5 |
| 013115    | Project Management Communications              | 4 |
| 013200    | Schedules                                      | 5 |
| 013233    | Photographic Documentation                     | 3 |
| 013300    | Submittals                                     | 6 |
| 013513.10 | Site Security and Health Requirements (OA)     | 6 |
| 013591    | Historic Treatment Procedures                  | 8 |
| 015000    | Construction Facilities and Temporary Controls | 7 |
| 017400    | Cleaning                                       | 4 |
| 017900    | Demonstration and Training                     | 6 |

**DIVISION 4 - MASONRY**

|        |                                              |   |
|--------|----------------------------------------------|---|
| 040342 | Treatment of Historic Stone Masonry Flooring | 8 |
|--------|----------------------------------------------|---|

**DIVISION 5 - METALS**

|        |                         |    |
|--------|-------------------------|----|
| 057001 | Custom Bronze Vestibule | 10 |
|--------|-------------------------|----|

**DIVISION 7 - THERMAL AND MOISTURE PROTECTION**

|        |                |    |
|--------|----------------|----|
| 079200 | Joint Sealants | 10 |
|--------|----------------|----|

**DIVISION 8 - OPENINGS**

|        |                  |    |
|--------|------------------|----|
| 088853 | Security Glazing | 10 |
|--------|------------------|----|

## SECTION 000115 – LIST OF DRAWINGS

### PART 1 - GENERAL

### PART 2 - RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

### 2.2 SUMMARY

- A. This Section provides a comprehensive list of the drawings that comprise the Bid Documents for this project.

### PART 3 - PRODUCTS (NOT APPLICABLE)

### PART 4 - EXECUTION

### PART 5 - LIST OF DRAWINGS

- A. The following list of drawings is a part of the Bid Documents:

|    | <u>TITLE</u>                                   | <u>SHEET #</u> | <u>DATE</u> | <u>DWG #</u> |
|----|------------------------------------------------|----------------|-------------|--------------|
| 1. | Coversheet                                     | G1.0           | 07/14/2025  | n/a          |
| 2. | Index of Drawings                              | G2.0           | 07/14/2025  | n/a          |
|    | Construction Limit Plan                        | G2.0           | 07/14/2025  | C1           |
| 3. | Vestibule Finish Floor Plan                    | G3.0           | 07/14/2025  | A1           |
|    | C200 Door Elevation –<br>Temporary Enclosure   | G3.0           | 07/14/2025  | A2           |
|    | Foyer Elevation                                | G3.0           | 07/14/2025  | B1           |
|    | Enlarged Floor Plan<br>– Foyer & South Portico | G3.0           | 07/14/2025  | B2           |
| 4. | Interior Elevation of Vestibule                | A1.0           | 07/14/2025  | 1            |
|    | Side Return                                    | A1.0           | 07/14/2025  | 2            |
|    | Top View of Vestibule                          | A1.0           | 07/14/2025  | 3            |
|    | Horizontal Section                             | A1.0           | 07/14/2025  | A            |
|    | Vertical Section                               | A1.0           | 07/14/2025  | B            |
| 5. | Vertical Section                               | A2.0           | 07/14/2025  | A            |
|    | Horizontal Section                             | A2.0           | 07/14/2025  | B            |

|     |                                     |       |            |     |
|-----|-------------------------------------|-------|------------|-----|
|     | Exterior Door Elevation             | A2.0  | 07/14/2025 | 1   |
| 6.  | Corner Mullion                      | A2.1  | 07/14/2025 | A   |
|     | Jamb at Door                        | A2.1  | 07/14/2025 | B   |
|     | Door Meeting Stile Section Mullion  | A2.1  | 07/14/2025 | C   |
|     | at Historical Door Surround         | A2.1  | 07/14/2025 | D   |
| 7.  | Corner Mullion                      | A2.2  | 07/14/2025 | A   |
|     | Typical Vertical Mullion            | A2.2  | 07/14/2025 | B   |
|     | Small Horizontal & Vertical Mullion | A2.2  | 07/14/2025 | C   |
|     | Mullion at Historical Door Surround | A2.2  | 07/14/2025 | D   |
| 8.  | Ornamental Vestibule Base           | A2.3  | 07/14/2025 | A   |
|     | Small Horizontal Mullion            | A2.3  | 07/14/2025 | B   |
|     | Small Horizontal Mullion            | A2.3  | 07/14/2025 | C   |
|     | Vestibule Head                      | A2.3  | 07/14/2025 | D   |
|     | Roof Support Mullion                | A2.3  | 07/14/2025 | E   |
| 9.  | Section Through Door Bottom Stile   | A2.4  | 07/14/2025 | A   |
|     | Section Through Door Head           | A2.4  | 07/14/2025 | B   |
|     | Small Horizontal Mullion            | A2.4  | 07/14/2025 | C   |
|     | Top Horizontal Mullion              | A2.4  | 07/14/2025 | D   |
|     | Mounting of Vestibule Roof          | A2.4  | 07/14/2025 | E   |
| 10. | Small Mullion Cover                 | A3.0  | 07/14/2025 | A   |
|     | Base Molding                        | A3.0  | 07/14/2025 | B   |
|     | Door Jamb                           | A3.0  | 07/14/2025 | C   |
|     | Corner Mullion B                    | A3.0  | 07/14/2025 | D   |
|     | Corner Mullion A                    | A3.0  | 07/14/2025 | E   |
|     | Corner Mullion C                    | A3.0  | 07/14/2025 | F   |
|     | ¼ Mullion                           | A3.0  | 07/14/2025 | G   |
| 11. | Door Head A                         | A3.1  | 07/14/2025 | I   |
|     | Door Head B                         | A3.1  | 07/14/2025 | J   |
|     | Filler Angle                        | A3.1  | 07/14/2025 | K   |
|     | Glass Stop C                        | A3.1  | 07/14/2025 | L   |
|     | Glass Stop B                        | A3.1  | 07/14/2025 | M   |
|     | Glass Stop A                        | A3.1  | 07/14/2025 | N   |
| 12. | Interior Steel Elevation            | ST1.0 | 07/14/2025 | 1   |
|     | Interior Steel Plan View            | ST1.0 | 07/14/2025 | 2   |
|     | Horizontal Section                  | ST1.0 | 07/14/2025 | A   |
|     | Vertical Section                    | ST1.0 | 07/14/2025 | B   |
|     | Vertical Section                    | ST1.0 | 07/14/2025 | C   |
| 13. | Horizontal Section                  | ST2.0 | 07/14/2025 | A   |
|     | Vertical Section                    | ST2.0 | 07/14/2025 | B   |
|     | Vertical Section                    | ST2.0 | 07/14/2025 | C   |
| 14. | Enlarged Steel Details and Sections | ST3.0 | 07/14/2025 | n/a |

Treanor  
July 14, 2025

O2203-02 | HP1075.2101.00  
Bronze Door Vestibule, Missouri State Capitol Building

|     |                                     |       |            |     |
|-----|-------------------------------------|-------|------------|-----|
| 15. | Enlarged Horizontal Section Details | ST3.1 | 07/14/2025 | n/a |
|-----|-------------------------------------|-------|------------|-----|

**END OF SECTION 000115**

## SECTION 001116 - INVITATION FOR BID

### 1.0 OWNER:

- A. The State of Missouri  
Office of Administration,  
Division of Facilities Management, Design and Construction  
Jefferson City, Missouri

### 2.0 PROJECT TITLE AND NUMBER:

- A. Bronze Door Vestibule  
Missouri State Capitol Building  
Jefferson City, Missouri  
**Project No.: O2203-02**

### 3.0 BIDS WILL BE RECEIVED:

- A. Until: 1:30 PM, December 18, 2025
- B. **Only electronic bids sent to [FMDCBids@oa.mo.gov](mailto:FMDCBids@oa.mo.gov) shall be accepted:** (See Instructions to Bidders for further detail)

### 4.0 DESCRIPTION:

- A. Scope: The project includes the reconstruction of the vestibule inside the Monumental Bronze Doors on the South Portico of the Missouri State Capitol Building.
- B. MBE/WBE/SDVE Goals: MBE 0%, WBE 0%, and SDVE 3%. **NOTE: Only MBE/WBE firms certified by the State of Missouri Office of Equal Opportunity as of the date of bid opening, or SDVE(s) meeting the requirements of Section 34.074, RSMo and 1 CSR 30-5.010, can be used to satisfy the MBE/WBE/SDVE participation goals for this project.**

### 5.0 PRE-BID MEETING:

- A. Place/Time: 10:00 AM, December 3, 2025, at Missouri State Capitol building, Room B-30, Jefferson City, Missouri
- B. Access to State of Missouri property requires presentation of a photo ID by all persons.

### 6.0 HOW TO GET PLANS & SPECIFICATIONS:

- A. View Only Electronic bid sets are available at no cost or paper bid sets for a deposit of **\$100.00** from American Document Solutions (ADS). MAKE CHECKS PAYABLE TO: American Document Solutions. Mail to: American Document Solutions, 1400 Forum Blvd., Suite 7A, Columbia, Missouri 65203. Phone 573-446-7768, Fax 573-355-5433, <https://www.adsplanroom.net>. NOTE: Prime contractors will be allowed a maximum of two bid sets at the deposit rate shown above. Other requesters will be allowed only one bid set at this rate. Additional bid sets or parts thereof may be obtained by any bidder at the cost of printing and shipping by request to American Document Solutions at the address shown above. Bidder must secure at least one bid set to become a planholder.
- B. **Refunds: Return plans and specifications in unmarked condition within 15 working days of bid opening to American Document Solutions, 1400 Forum Blvd., Suite 7A, Columbia, Missouri 65203. Phone 573-446-7768, Fax 573-355-5433. Deposits for plans not returned within 15 working days shall be forfeited.**
- C. Information for upcoming bids, including downloadable plans, specifications, Invitation for Bid, bid tabulation, award, addenda, and access to the ADS planholders list, is available on the Division of Facilities Management, Design and Construction's web site: <https://oa.mo.gov/facilities/bid-opportunities/bid-listing-electronic-plans>.

### 7.0 POINT OF CONTACT:

- A. Designer: Treanor, Inc., Joy Coleman, 816-581-4027, email: [jcoleman@treanor.design](mailto:jcoleman@treanor.design)
- B. Project Manager: Andrew Friedmeyer, 573-536-8019, email: [andrew.friedmeyer@oa.mo.gov](mailto:andrew.friedmeyer@oa.mo.gov)

### 8.0 GENERAL INFORMATION:

- A. The State reserves the right to reject any and all bids and to waive all informalities in bids. No bid may be withdrawn for a period of 20 working days subsequent to the specified bid opening time. The contractor shall pay not less than the prevailing hourly rate of wages for work of a similar character in the locality in which the work is performed, as determined by the Missouri Department of Labor and Industrial Relations and as set out in the detailed plans and specifications.
- B. Bid results will be available at <https://oa.mo.gov/facilities/bid-opportunities/bid-listing-electronic-plans> after it is verified that at least one bid is awardable and affordable.

## **SECTION 002113 – INSTRUCTIONS TO BIDDERS**

### **1.0 - SPECIAL NOTICE TO BIDDERS**

- A. If awarded a contract, the Bidder's employees, and the employees of all subcontractors, who perform the work on the project must adhere to requirements in Section 013513 – Site Security and Health Requirements as applicable per Agency.
- B. The Bidder's prices shall include all city, state, and federal sales, excise, and similar taxes that may lawfully be assessed in connection with the performance of work, and the purchased of materials to be incorporated in the work. **THIS PROJECT IS NOT TAX EXEMPT.**

### **2.0 - BID DOCUMENTS**

- A. The number of sets obtainable by one (1) party may be limited in accordance with available supply.
- B. For the convenience of contractors, subcontractors and suppliers, bidding documents are available on the Owner's website at <https://oa.mo.gov/facilities/bid-opportunities/bid-listing-electronic-plans>.

### **3.0 - BIDDERS' OBLIGATIONS**

- A. Bidders must carefully examine the entire site of the work and shall make all reasonable and necessary investigations to inform themselves thoroughly as to the facilities available as well as to all the difficulties involved in the completion of all work in accordance with the specifications and the plans. Bidders are required to examine all maps, plans and data mentioned in the specifications. No plea of ignorance concerning observable existing conditions or difficulties that may be encountered in the execution of the work under this contract will be accepted as an excuse for any failure or omission on the part of the successful Bidder (contractor) to fulfill every detail of the requirements of the contract, nor accepted as a basis for any claims for extra compensation or time extension.
- B. Under no circumstances will Bidders give their plans and specifications to other Bidders. It is highly encouraged, but not required, that all Bidders be on the official planholders list to receive project updates including but not limited to any addenda that are issued during the bidding process.

### **4.0 - INTERPRETATIONS**

- A. No Bidder shall be entitled to rely on oral or written representations from any person as to the meaning of the plans and specifications or the acceptability of alternate products, materials, form or type of construction.
- B. Bidders shall make all requests for interpretations in writing and submit all requests to the Project Designer and Project Manager identified in Section 007300 – Supplementary Conditions with all necessary supporting documentation no less than five (5) working days before opening of bids. Responses to requests for interpretation will be issued via a written addendum and will be sent as promptly as is practicable to all official planholders and posted on the Owner's website. All such addenda shall become part of the bid and contract documents.
- C. Bidders shall make all requests for an "Acceptable Substitution" on the Section 006325 Substitution Request Form. The request shall be emailed to the Project Designer and Project Manager identified in Section 007300 – Supplementary Conditions no less than five (5) working days before opening of bids. Responses to requests for substitutions will be issued via a written addendum and will be sent as promptly as is practicable to all official planholders and posted on the Owner's website. All such addenda shall become part of the bid and contract documents.
- D. An "Acceptable Substitution" requested after the award of bid will only be approved if proven to the satisfaction of the Owner and the Designer that the product is acceptable in design, strength, durability, usefulness, and convenience for the purpose intended. Approval of the substitution after award is at the sole discretion of the Owner and all requests of this nature must be submitted in accordance with Article 3.1 of the General Conditions.

## **5.0 - BIDS AND BIDDING PROCEDURE**

- A. Bidders shall submit all submission forms and accompanying documents listed in Section 004113 – Bid Form, Article 5.0, Attachments to Bid by the stated time on the bid documents or the bid will be rejected for being non-responsive.
- B. Depending on the specific project requirements, **the following is a GENERIC list** of all possible bid forms that may be due with bid submittals. Bidders must verify each specific project's requirements in Section 004113 to ensure they have provided all the required documentation with their submission.

### **Bid Submittal – due before stated date and time of bid opening (see IFB):**

|        |                                                           |
|--------|-----------------------------------------------------------|
| 004113 | Bid Form (all pages are always required)                  |
| 004322 | Unit Prices Form                                          |
| 004336 | Proposed Subcontractors Form                              |
| 004337 | MBE/WBE/SDVE Compliance Evaluation Form                   |
| 004338 | MBE/WBE/SDVE Eligibility Determination for Joint Ventures |
| 004339 | MBE/WBE/SDVE GFE Determination                            |
| 004340 | SDVE Business Form                                        |
| 004541 | Affidavit of Work Authorization                           |
| 004545 | Anti-Discrimination Against Israel Act Certification form |

- C. The Bidder shall submit its bid on the forms provided by the Owner in the same file format (PDF) with each space fully and properly completed, typewritten or legibly printed, including all amounts required for alternate bids, unit prices, cost accounting data, etc. The Owner will reject bids that are not on the Owner's forms or that do not contain all requested information. All forms can be found on the Owner's website at <https://oa.mo.gov/facilities/bid-opportunities/bid-listing-electronic-plans> and shall be submitted with your bid to [FMDCBids@oa.mo.gov](mailto:FMDCBids@oa.mo.gov).
- D. All bids shall be submitted without additional terms and conditions, modifications, or reservations. The completed forms should not include interlineations, alterations, or erasures. Bids not in compliance with the requirements of this paragraph will be rejected as non-responsive.
- E. All bids shall be accompanied by a bid bond executed by the bidder and a duly authorized surety company, certified check, cashier's check or bank draft made payable to the Division of Facilities Management, Design and Construction, State of Missouri, in the amount indicated in the bid documents in Section 004113. Failure of the Bidder to submit the duly authorized bid bond or the full amount required shall be sufficient cause to reject his bid. The Bidder agrees that the proceeds of the check, draft, or bond shall become the property of the State of Missouri, if for any reason the Bidder withdraws his bid after bid closing or if the Bidder, within ten (10) working days after notification of award, refuses or is unable to 1) execute the tendered contract, 2) provide an acceptable performance and payment bond, or 3) provide evidence of required insurance coverage.
- F. The bid bond check or draft submitted by the successful Bidder will be returned after the receipt of an acceptable performance and payment bond and execution of the formal contract. Checks or drafts of all other Bidders will be returned within a reasonable time after it is determined that the bid represented by same will receive no further consideration by the State of Missouri.

## **6.0 - SIGNING OF BIDS**

- A. A bid should contain the full and correct legal name of the Bidder. If the Bidder is an entity registered with the Missouri Secretary of State, the Bidder's name on the bid form should appear as shown in the Secretary of State's records. If the Bidder is an entity organized in a state other than Missouri, the Bidder must provide a Certificate of Authority to do business in the State of Missouri.
- B. If the successful Bidder is doing business in the State of Missouri under a fictitious name, the Bidder shall furnish to Owner, attached to the Bid Form, a properly certified copy of the certificate of Registration of Fictitious Name from the State of Missouri, and such certificate shall remain on file with the Owner.
- C. A bid from an individual shall be signed as noted on the Bid Form.
- D. A bid from a partnership or joint venture shall require only one signature of a partner, an officer of the joint venture authorized to bind the venture, or an attorney-in-fact. If the bid is signed by an officer of

a joint venture or an attorney-in-fact, a document evidencing the individual's authority to execute contracts should be included with the bid form.

- E. A bid from a limited liability company (LLC) shall be signed by a manager or a managing member of the LLC.
- F. A bid from a corporation shall have the correct corporate name thereon and the signature of an authorized officer of the corporation. Title of office held by the person signing for the corporation shall appear, along with typed name of said individual and the corporate license number shall be provided. In addition, for corporate proposals, the President or Vice-President listed per the current filing with the Missouri Secretary of State should sign as the Bidder. If the signatory is other than the corporate president or vice president, the bidder must provide satisfactory evidence that the signatory has the legal authority to bind the corporation.

#### **7.0 - RECEIVING BID SUBMITTALS**

- A. It is the Bidder's sole responsibility to ensure receipt of the bid submittals by Owner on or before the date and time specified in the Invitation for Bid or as modified via written addenda. Bids received after the date and time specified will not be considered by the Owner.
- B. All bids shall be received via email at [FMDCBids@oa.mo.gov](mailto:FMDCBids@oa.mo.gov) and bids received by the Owner through any other means, including hard copies, will not be considered, and will be discarded by the Owner unopened.

#### **8.0 - MODIFICATION AND WITHDRAWAL OF BIDS**

- A. Bidder may withdraw a bid at any time prior to the scheduled closing time for receipt of bids, but no bidder may withdraw his bid for a period of twenty (20) working days after the scheduled closing time for receipt of bids.
- B. Bidder may modify a bid until the scheduled closing time by sending a revised bid to [FMDCBids@oa.mo.gov](mailto:FMDCBids@oa.mo.gov) with a note in the subject line and body of the email that it is a revised bid. All revised bids must be submitted to [FMDCBids@oa.mo.gov](mailto:FMDCBids@oa.mo.gov), revised bids sent any other way will not be considered.

#### **9.0 - AWARD OF CONTRACT**

- A. The Owner reserves the right to reject any and/or all bids and further to waive all informalities in bidding when deemed in the best interest of the State of Missouri.
- B. The Owner reserves the right to let other contracts in connection with the work including, but not limited to, contracts for the furnishing and installation of furniture, equipment, machinery, appliances and other apparatuses.
- C. The Owner will award a contract to the lowest, responsive, and responsible Bidder in accordance with Section 8.250, RSMo. No contract will be awarded to any Bidder who has had a contract with the Owner terminated within the preceding twelve months for material breach of contract or who has been suspended or debarred by the Owner.
- D. Award of alternates, if any, will be made in numerical order unless all bids received are such that the order of acceptance of alternates does not affect the determination of the lowest, responsive, responsible bidder.
- E. No award shall be considered binding upon the Owner until the written contract has been properly executed and the following documentation has been provided: 1) performance and payment bond consistent with Article 6.1 of the General Conditions; 2) proof of the required insurance coverage; 3) an executed Section 004541 - Affidavit of Work Authorization form; and 4) documentation evidence enrollment and participation in a federal work authorization program.
- F. Failure to execute and return the contract and associated documents within the prescribed period shall be treated, at the option of the Owner, as a breach of Bidder's obligation and the Owner shall be under no further obligation to Bidder.
- G. Transient employers subject to Sections 285.230 and 285.234, RSMo, (out-of-state employers who temporarily transact any business in the State of Missouri) may be required to file a bond with the

Missouri Department of Revenue. No contract will be awarded by the Owner unless the successful Bidder certifies that he has complied with all applicable provisions of Section 285.230-234.

- H. Sections 285.525 and 285.530, RSMo, require business entities to enroll and participate in a federal work authorization program in order to be eligible to receive award of any state contract in excess of \$5,000. Bidders should submit with their bid an Affidavit of Work Authorization (Section 004541) along with appropriate documentation evidencing such enrollment and participation. Bidders must also submit an E-Verify Memorandum before the Owner may award a contract to the Bidder. Information regarding a E-Verify is located at <https://www.e-verify.gov/employers/enrolling-in-e-verify>. The contractor shall be responsible for ensuring that all subcontractors and suppliers associated with this contract enroll in E-Verify.
- I. The successful Bidder must be registered in MissouriBUYS powered by MOVERS at <https://missouribuyss.mo.gov/supplier-registration#> as an approved vendor prior to being issued a contract.

#### **10.0 - CONTRACT SECURITY**

- A. The successful Bidder shall furnish a performance/payment bond as set forth in General Conditions Article 6.1 prior to the State executing the contract and issuing a notice to proceed.

#### **11.0 - LIST OF SUBCONTRACTORS**

- A. If required by "Section 004113 – Bid Form," each Bidder must submit as part of their bid a list of subcontractors to be used in performing the work (Section 004336). The list must specify the name of the single designated subcontractor, manufacturer, or suppliers for each category of work listed in "Section 004336 - Proposed Subcontractors Form." If work within a category will be performed by more than one subcontractor, the bidder must provide the name of each subcontractor and specify the exact portion of the work to be done by each. If the Bidder intends to perform any of the designated subcontract work with the use of his own employees, the Bidder shall make that fact clear, by listing his own firm for the subject category. **If any category of work is left vacant or if more than one subcontractor is listed for any category without designating the portion of work to be performed by each, the bid shall be rejected.**

#### **12.0 - WORKING DAYS**

- A. Contract duration time is stated in working days and will use the following definition in determining the actual calendar date for contract completion:
  - 1. Working days are defined as all calendar days except Saturdays, Sundays and the following State of Missouri observed holidays: New Year's Day, Martin Luther King, Jr. Day, Lincoln Day, Washington's Birthday, Truman Day, Memorial Day, Juneteenth, Independence Day, Labor Day, Columbus Day, Veterans Day, Thanksgiving Day and Christmas Day.

#### **13.0 - AMERICAN AND MISSOURI - MADE PRODUCTS AND FIRMS**

- A. By signing the bid form and submitting a bid on this project, the Bidder certifies that it will use American and Missouri products as set forth in Article 1.7 of the General Conditions. Bidders are advised to review those requirements carefully prior to bidding.
- B. A preference shall be given to Missouri firms, corporations or individuals, or firms, corporations or individuals that maintain Missouri offices or places of business, when the quality of performance promised is equal or better and the price quoted is the same or less.
- C. Pursuant to Section 34.076, RSMo, a contractor or Bidder domiciled outside the boundaries of the State of Missouri shall be required, in order to be successful, to submit a bid the same percent less than the lowest bid submitted by a responsible contractor or Bidder domiciled in Missouri as would be required for such a Missouri domiciled contractor or Bidder to succeed over the bidding contractor or Bidder domiciled outside Missouri on a like contract or bid being let in the Bidder's domiciliary state and, further, the contractor or Bidder domiciled outside the boundaries of Missouri shall be required to submit an audited financial statement as would be required of a Missouri domiciled contractor or Bidder on a like contract or bid being let in the domiciliary state of that contractor or Bidder.

#### **14.0 – ANTI-DISCRIMINATION AGAINST ISRAEL ACT CERTIFICATION:**

- A. If the Bidder meets the section 34.600, RSMo., definition of a “company” and the Bidder has ten or more employees, the Bidder must certify in writing that the Bidder is not currently engaged in a boycott of goods or services from the State of Israel and shall not engage in a boycott of goods or services from the State of Israel, if awarded a contract, for the duration of the contract. The Bidder is required to complete and submit the applicable portion of Section 004545 - Anti-Discrimination Against Israel Act Certification with its Bid Form. The applicable portion of the exhibit must be submitted prior to execution of a contract by the Owner and issuance of Notice to Proceed.

#### **15.0 – MBE/WBE/SDVE INSTRUCTIONS**

A. Definitions:

1. **“MBE”** means a Minority Business Enterprise.
2. **“MINORITY”** has the same meaning as set forth in 1 C.S.R. 10-17.010.
3. **“MINORITY BUSINESS ENTERPRISE”** has the same meaning as set forth in section 37.020, RSMo.
4. **“WBE”** means a Women’s Business Enterprise.
5. **“WOMEN’S BUSINESS ENTERPRISE”** has the same meaning as set forth in section 37.020, RSMo.
6. **“SDVE”** means a Service-Disabled Veterans Enterprise.
7. **“SERVICE-DISABLED VETERAN”** has the same meaning as set forth in section 34.074, RSMo.
8. **“SERVICE-DISABLED VETERAN ENTERPRISE”** has the same meaning as “Service-Disabled Veteran Business” set forth in section 34.074, RSMo.

B. MBE/WBE/SDVE General Requirements:

1. For all bids greater than \$100,000, the Bidder shall obtain MBE, WBE and SDVE participation in an amount equal to or greater than the percentage goals set forth in the Invitation for Bid and the Bid Form, unless the Bidder is granted a Good Faith Effort waiver by the Director of the Division, as set forth below. If the Bidder does not meet the MBE, WBE and SDVE goals, or make a good faith effort to do so, the Bidder shall be nonresponsive, and its bid shall be rejected.
2. The Bidder should submit with its bid all the information requested in the MBE/WBE/SDVE Compliance Evaluation Form for every MBE, WBE, or SDVE subcontractor or material supplier the Bidder intends to use for the contract work. The Bidder is required to submit all MBE/WBE/SDVE documentation before the stated time and date set forth in the Invitation for Bid. If the Bidder fails to provide such information by the specified date and time, the Owner shall reject the bid.
3. The Director reserves the right to request additional information from a Bidder to clarify the Bidder’s proposed MBE, WBE, and/or SDVE participation. The Bidder shall submit the clarifying information requested by the Owner within two (2) working days of receiving the request for clarification.
4. Pursuant to section 34.074, RSMo, a Prime Bidder that qualifies as an SDVE shall receive a three-percentage point bonus preference in the contract award evaluation process. The bonus preference will be calculated and applied by reducing the bid amount of the eligible SDVE by three percent of the apparent low responsive Bidder’s bid. Based on this calculation, if the eligible SDVE’s evaluation is less than the apparent low responsive Bidder’s bid, the eligible SDVE’s bid will become the apparent low responsive bid. This reduction is for evaluation purposes only and will have no impact on the actual amount(s) of the bid or the amount(s) of any contract awarded. In order to be eligible for the SDVE preference, the Bidder must complete and submit with its bid the Missouri Service-Disabled Veteran Business Form, and any information required by the form.

C. Computation of MBE/WBE/SDVE Goal Participation:

1. A Bidder who is a MBE, WBE, or SDVE may count 100% of the contract towards the MBE, WBE or SDVE goal, less any amounts awarded to another MBE, WBE or SDVE. (NOTE: a MBE firm that bids as general contractor must obtain WBE and SDVE participation; a WBE firm that bids as

a general contractor must obtain MBE and SDVE participation; and a SDVE firm that bids as general contractor must obtain MBE and WBE participation.) For the remaining contract amount to be counted towards the MBE, WBE or SDVE goal, the Bidder must complete the MBE/WBE/SDVE Compliance Evaluation Form (Section 004337) identifying itself as an MBE, WBE or SDVE.

2. The total dollar value of the work granted to a certified MBE, WBE or SDVE by the Bidder shall be counted towards the applicable goal.
3. Expenditures for materials and supplies obtained from a certified MBE, WBE, or SDVE supplier or manufacturer may be counted towards the MBE, WBE and SDVE goals, if the MBE, WBE, or SDVE assumes the actual and contractual responsibility for the provision of the materials and supplies.
4. The total dollar value of the work granted to a second or subsequent tier subcontractor or a supplier may be counted towards a Bidder's MBE, WBE and SDVE goals, if the MBE, WBE, or SDVE properly assumes the actual and contractual responsibility for the work.
5. The total dollar value of work granted to a certified joint venture equal to the percentage of the ownership and control of the MBE, WBE, or SDVE partner in the joint venture may be counted towards the MBE/WBE/SDVE goals.
6. Only expenditures to a MBE, WBE, or SDVE that performs a commercially useful function in the work may be counted towards the MBE, WBE and SDVE goals. A MBE, WBE, or SDVE performs a commercially useful function when it is responsible for executing a distinct element of the work and carrying out its responsibilities by performing, managing and supervising the work or providing supplies or manufactured materials.

D. Certification of MBE/WBE/SDVE Subcontractors:

1. In order to be counted towards the goals, an MBE or WBE must be certified by the State of Missouri Office of Equal Opportunity and an SDVE must be certified by the State of Missouri, Office of Equal Opportunity or by the Federal U.S. Small Business Administration directory.
2. The Bidder may determine the certification status of a proposed MBE or WBE subcontractor or supplier by referring to the Office of Equal Opportunity (OEO)'s online MBE/WBE directory <https://apps1.mo.gov/MWBCertifiedFirms/>. The Bidder may determine the eligibility of a SDVE subcontractor or supplier by referring to the Office of Equal Opportunity online SDVE directory at <https://oeo.mo.gov/sdve-certification-program/> or the Federal U.S. Small Business Administration directory <https://veterans.certify.sba.gov/#search>.
3. Additional information, clarifications, or other information regarding the MBE/WBE/SDVE listings in the directories may be obtained by contacting the Contract Specialist of record as shown in the Supplementary Conditions (Section 007300).

E. Waiver of MBE/WBE/SDVE Participation:

1. If a Bidder has made a good faith effort to secure the required MBE, WBE and/or SDVE participation and has failed, the Bidder shall submit with its bid the information requested in MBE/WBE/SDVE Good Faith Effort (GFE) Determination form. The Director will determine if the Bidder made a good faith effort to meet the applicable goals. If the Director determines that the Bidder did not make a good faith effort, the bid shall be rejected as being nonresponsive to the bid requirements. Bidders who demonstrate that they have made a good faith effort to include MBE, WBE, and/or SDVE participation will be granted a waiver and will be considered to be responsive to the applicable participation goals, regardless of the percent of actual participation obtained, if the bid is otherwise acceptable.
2. In determining whether a Bidder has made a good faith effort to obtain MBE, WBE and/or SDVE participation, the Director may evaluate the factors set forth in 1 CSR 30-5.010(6)(C) and the following:
  - a. The amount of actual participation obtained;

- b. How and when the Bidder contacted potential MBE, WBE, and SDVE subcontractors and suppliers;
- c. The documentation provided by the Bidder to support its contacts, including whether the Bidder provided the names, addresses, phone numbers, and dates of contact for MBE/WBE/SDVE firms contacted for specific categories of work;
- d. If project information, including plans and specifications, were provided to MBE/WBE/SDVE subcontractors;
- e. Whether the Bidder made any attempts to follow-up with MBE, WBE or SDVE firms prior to bid;
- f. Amount of bids received from any of the subcontractors and/or suppliers that the Bidder contacted;
- g. The Bidder's stated reasons for rejecting any bids;

F. Contractor MBE/WBE/SDVE Obligations

- 1. If awarded a contract, the Bidder will be contractually required to subcontract with or obtain materials from the MBE, WBE, and SDVE firms listed in its bid, in amounts equal to or greater than the dollar amount in the bid, unless the amount is modified in writing by the Owner.
- 2. If the Contractor fails to meet or maintain the participation requirements contained in the Contractor's bid, the Contractor must satisfactorily explain to the Director why it cannot comply with the requirement and why failing meeting the requirement was beyond the Contractor's control. If the Director finds the Contractor's explanation unsatisfactory, the Director may take any appropriate action including, but not limited to:
  - a. Declaring the Contractor ineligible to participate in any contracts with the Division for up to twelve (12) months (suspension); and/or
  - b. Declaring the Contractor be nonresponsive to the Invitation for Bid, or in breach of contract and rejecting the bid or terminating the contract.
- 3. If the Contractor replaces an MBE, WBE, or SDVE during the course of the contract, the Contractor shall replace it with another MBE, WBE, or SDVE or make a good faith effort to do so. All MBE, WBE and SDVE substitutions must be approved by the Director in writing.
- 4. The Contractor shall provide the Owner with regular reports on its progress in meeting its MBE/WBE/SDVE obligations. At a minimum, the Contractor shall report the dollar-value of work completed by each MBE, WBE, or SDVE during the preceding month and the cumulative total of work completed by each MBE, WBE or SDVE to date with each monthly application for payment. The Contractor shall also make a final report, which shall include the total dollar-value of work completed by each MBE, WBE, and SDVE during the entire contract.



# State of Missouri Construction Contract

THIS AGREEMENT is made (DATE) by and between:

## *Contractor Name and Address*

hereinafter called the "Contractor," and the **State of Missouri**, hereinafter called the "**Owner**", represented by the Office of Administration, Division of Facilities Management, Design and Construction.

WITNESSETH, that the Contractor and the Owner, for the consideration stated herein agree as follows:

## **ARTICLE 1. STATEMENT OF WORK**

The Contractor shall furnish all labor and materials and perform all work required for furnishing and installing all labor, materials, equipment and transportation and everything necessarily inferred from the general nature and tendency of the plans and specifications for the proper execution of the work for:

**Project Name:** **Bronze Door Vestibule,  
Missouri State Capitol Building  
Jefferson City, Missouri**

**Project Number:** **O2203-02**

in strict accordance with the Contract Documents as enumerated in Article 7, all of which are made a part hereof.

## **ARTICLE 2. TIME OF COMPLETION**

The contract performance time is **240 working days** from the transmittal date of this agreement. The contract completion date is **MONTH, DAY, YEAR**. This time includes ten (10) working days for the Contractor to receive, sign and return the contract form along with required bonding and insurance certificates. Failure of the Contractor to provide correct bonding and insurance within the ten (10) working days shall not be grounds for a time extension. Receipt of proper bonding and insurance is a condition precedent to the formation of the contract and if not timely received, may result in forfeiture of the Contractor's bid security. Work may not commence until the Owner issues a written Notice to Proceed and must commence within seven (7) working days thereafter.

## **ARTICLE 3. LIQUIDATED DAMAGES**

Whenever time is mentioned in this contract, time shall be and is of the essence of this contract. The Owner would suffer a loss should the Contractor fail to have the work embraced in this contract fully completed on or before the time above specified. THEREFORE, the parties hereto realize in order to adjust satisfactorily the damages on account of such failure that it might be impossible to compute accurately or estimate the amount of such loss or damages which the Owner would sustain by reason of failure to complete fully said work within the time required by this contract. The Contractor hereby covenants and agrees to pay the Owner, as and for **liquidated damages, the sum of \$1,000** per day for each and every day, Sunday and legal holidays excepted, during which the work remains incomplete and unfinished. Any sum which may be due the Owner for such damages shall be deducted and retained by the Owner from any balance which may be due the Contractor when said work shall have been finished and accepted. But such provisions shall not release the Bond of the Contractor from liability according to its terms. In case of failure to complete, the Owner will be under no obligation to show or prove any actual or specific loss or damage.

#### ARTICLE 4. CONTRACT SUM

The Owner shall pay the Contractor for the prompt, faithful and efficient performance of the conditions and undertakings of this contract, subject to additions, and deductions as provided herein, in current funds the sum of:

Base Bid: \$

Accepted Alternates, if applicable to the Project and accepted by the Owner.

**TOTAL CONTRACT AMOUNT:** (\$CONTRACT AMOUNT)

**UNIT PRICES:** The Owner accepts the following Unit Prices:

For changing specified quantities of work from those indicated by the contract drawings and specifications, upon written instructions of Owner, the following unit prices shall prevail. The unit prices include all labor, overhead and profit, materials, equipment, appliances, bailing, shoring, shoring removal, etc., to cover the finished work of the several kinds of work called for. Only a single unit price shall be given and it shall apply for either MORE or LESS work than that shown on the drawings and called for in the specifications or included in the Base Bid. In the event of more or less units than so indicated or included, change orders may be issued for the increased or decreased amount.

#### ARTICLE 5. PREVAILING WAGE RATE

**MISSOURI PREVAILING WAGE LAW (Sections 290.210 to 290.340, RSMo):** The Contractor shall pay not less than the specified hourly rate of wages, as set out in the wage order attached to and made part of the specifications for work under this contract, to all workers performing work under the contract, in accordance with sections 290.210 to 290.340, RSMo. The Contractor shall forfeit a penalty to the Owner of one hundred dollars per day (or portion of a day) for each worker that is paid less than the specified rates for any work done under the contract by the Contractor or by any subcontractor, in accordance with section 290.250, RSMo.

**DAVIS-BACON ACT:** If this Project is financed in whole or in part from Federal funds (as indicated in the Instructions to Bidders or other bid or contract documents for this Project), then this contract shall be subject to all applicable federal labor statutes, rules and regulations, including provisions of the Davis-Bacon Act, 40 U.S.C. §3141 et seq., and the "Federal Labor Standards Provisions," as further set forth in Section 007333 – Supplementary General Conditions for Federally Funded/Assisted Construction Projects, which is incorporated into the contract by reference. Where the Missouri Prevailing Wage Law and the Davis-Bacon Act require payment of different wages for work performed under this contract, the Contractor and all Subcontractors shall pay the greater of the wages required under either law, on a classification-by-classification basis.

#### ARTICLE 6. MINORITY/WOMEN/SERVICE DISABLED VETERAN BUSINESS ENTERPRISE PARTICIPATION

The Contractor has been granted a waiver of the 10% MBE and 10% WBE and 3% SDVE participation goals. The Contractor agrees to secure the MBE/WBE/SDVE participation amounts for this project as follows: (OR)

The Contractor has met the MBE/WBE/SDVE participation goals and agrees to secure the MBE/WBE/SDVE participation amounts for this project as follows:

|                    |                    |
|--------------------|--------------------|
| MBE/WBE/SDVE Firm: | Subcontract Amt:\$ |
| MBE/WBE/SDVE Firm: | Subcontract Amt:\$ |
| MBE/WBE/SDVE Firm: | Subcontract Amt:\$ |

Total \$

MBE/WBE/SDVE assignments identified above shall not be changed without a contract change signed by the Owner.

The Director of the Division of Facilities Management, Design and Construction or his Designee shall be the final authority to resolve disputes and disagreements between the Contractor and the MBE/WBE/SDVE firms listed above when such disputes impact the subcontract amounts shown above.

## ARTICLE 7. CONTRACT DOCUMENTS

The following documents are hereby incorporated into this contract by reference (all division/section numbers and titles are as utilized in the Project Manual published by the Owner for this Project):

1. Division 0 – Procurement and Contracting Information, including, but not limited to:
  - a. Invitation for Bid (Section 001116)
  - b. Instructions to Bidders (Section 002113)
  - c. Supplementary Instructions to Bidders (if applicable) (Section 002213)
  - d. The following documents as completed and executed by the Contractor and accepted by the Owner, if applicable:
    - i. Bid Form (Section 004113)
    - ii. Proposed Contractors Form (Section 004336)
    - iii. MBE, WBE, SDVE Compliance Evaluation Form(s) (Section 004337)
    - iv. MBE, WBE, SDVE Eligibility Determination Form for Joint Ventures (Section 004338)
    - v. MBE, WBE, SDVE Good Faith Effort (GFE) Determination Form (Section 004339)
    - vi. Missouri Service Disabled Veteran Business Form (Section 004340)
    - vii. Affidavit of Work Authorization (Section 004541)
  - e. Performance and Payment Bond, completed and executed by the Contractor and surety (Section 006113)
  - f. General Conditions (Section 007213)
  - g. Supplementary Conditions (Section 007300)
  - h. Supplementary General Conditions for Federally Funded/Assisted Construction Projects (Section 007333), if applicable
  - i. Wage Rate(s) (Section 007346)
2. Division 1 – General Requirements
3. All Drawings identified in the Project Manual
4. All Technical Specifications included in the Project Manual
5. Addenda, if applicable

## ARTICLE 8 – CERTIFICATION

By signing this contract, the Contractor hereby re-certifies compliance with all legal requirements set forth in Section 6.0, Bidder's Certifications of the Bid Form.

By signature below, the parties hereby execute this contract document.

### APPROVED:

\_\_\_\_\_  
Brian Yansen, Director  
Division of Facilities Management,  
Design and Construction

\_\_\_\_\_  
Contractor's Authorized Signature

I, Corporate Secretary, certify that I am Secretary of the corporation named above and that (CONTRACTOR NAME), who signed said contract on behalf of the corporation, was then (TITLE) of said corporation and that said contract was duly signed for and in behalf of the corporation by authority of its governing body, and is within the scope of its corporate powers.

\_\_\_\_\_  
*Corporate Secretary*

**SECTION 006113 - PERFORMANCE AND PAYMENT BOND FORM**

KNOW ALL MEN BY THESE PRESENTS, THAT we \_\_\_\_\_

as principal, and \_\_\_\_\_

\_\_\_\_\_ as Surety, are held and firmly bound unto the

STATE OF MISSOURI. in the sum of \_\_\_\_\_ Dollars (\$ \_\_\_\_\_ )

for payment whereof the Principal and Surety bind themselves, their heirs, executors, administrators and successors, jointly and severally, firmly by these presents.

WHEREAS, the Principal has, by means of a written agreement dated the \_\_\_\_\_

day of \_\_\_\_\_, 20\_\_\_\_\_, enter into a contract with the State of Missouri for

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

(Insert Project Title and Number)

NOW, THEREFORE, if the Principal shall faithfully perform and fulfill all the undertakings, covenants, terms, conditions and agreements of said contract during the original term of said contract and any extensions thereof that may be granted by the State of Missouri, with or without notice to the Surety and during the life of any guaranty required under the contract; and shall also faithfully perform and fulfill all undertakings, covenants, terms, conditions and agreements of any and all duly authorized modifications of said contract that may hereafter be made with or without notice to the Surety; and shall also promptly make payment for materials incorporated, consumed or used in connection with the work set forth in the contract referred to above, and all insurance premiums, both compensation and all other kinds of insurance, on said work, and for all labor performed on such work, whether by subcontractor or otherwise, at not less than the prevailing hourly rate of wages for work of a similar character (exclusive of maintenance work) in the locality in which the work is performed and not less than the prevailing hourly rate of wages for legal holiday and overtime work (exclusive of maintenance work) in the locality in which the work is performed both as determined by the Department of Labor and Industrial Relations or determined by the Court of Appeal, as provided for in said contract and in any and all duly authorized modifications of said contract that may be hereafter made, with or without notice to the Surety, then, this obligation shall be void and of no effect, but it is expressly understood that if the Principal should make default in or should fail to strictly, faithfully and efficiently do, perform and comply with any or more of the covenants, agreements, stipulations, conditions, requirements or undertakings, as specified in or by the terms of said contract, and with the time therein named, then this obligation shall be valid and binding upon each of the parties hereto and this bond shall remain in full force and effect; and the same may be sued on at the instance of any material man, laborer, mechanic, subcontractor, individual, or otherwise to whom such payment is due, in the name of the State of Missouri, to the use of any such person.

AND, IT IS FURTHER specifically provided that any modifications which may hereinafter be made in the terms of the contract or in the work to be done under it or the giving by the Owner of any extension of the time for the performance of the contract or any other forbearance on the part of either the Owner or the Principal to the other, shall not in any way release the Principal and the Surety, or either or any of them, their heirs, executors, administrators and successors, from their liability hereunder, notice to the Surety of any such extension, modifications or forbearance being hereby waived.

IN WITNESS WHEREOF, the above bounden parties have executed the within instrument this \_\_\_\_\_ day of \_\_\_\_\_, 20 \_\_\_\_.

**AS APPLICABLE:**

**AN INDIVIDUAL**

Name: \_\_\_\_\_

Signature: \_\_\_\_\_

**A PARTNERSHIP**

Name of Partner: \_\_\_\_\_

Signature of Partner: \_\_\_\_\_

Name of Partner: \_\_\_\_\_

Signature of Partner: \_\_\_\_\_

**CORPORATION**

Firm Name: \_\_\_\_\_

Signature of President: \_\_\_\_\_

**SURETY**

Surety Name: \_\_\_\_\_

Attorney-in-Fact: \_\_\_\_\_

Address of Attorney-in-Fact: \_\_\_\_\_

Telephone Number of Attorney-in-Fact: \_\_\_\_\_

Signature Attorney-in-Fact: \_\_\_\_\_

**NOTE:** Surety shall attach Power of Attorney



STATE OF MISSOURI  
OFFICE OF ADMINISTRATION  
DIVISION OF FACILITIES MANAGEMENT, DESIGN AND CONSTRUCTION  
**PRODUCT SUBSTITUTION REQUEST**

PROJECT NUMBER

PROJECT TITLE AND LOCATION

CHECK APPROPRIATE BOX

- ☐ **SUBSTITUTION PRIOR TO BID OPENING**  
(Minimum of (5) working days prior to receipt of Bids as per Article 4 – Instructions to Bidders)
- ☐ **SUBSTITUTION FOLLOWING AWARD**  
(Maximum of (20) working days from Notice to Proceed as per Article 3 – General Conditions)

FROM: BIDDER/CONTRACTOR (PRINT COMPANY NAME)

TO: ARCHITECT/ENGINEER (PRINT COMPANY NAME)

Bidder/Contractor hereby requests acceptance of the following product or systems as a substitution in accordance with provisions of Division One of the Bidding Documents:

SPECIFIED PRODUCT OR SYSTEM

SPECIFICATION SECTION NO.

SUPPORTING DATA

- ☐ Product data for proposed substitution is attached (include description of product, standards, performance, and test data)
- ☐ Sample ☐ Sample will be sent, if requested

**QUALITY COMPARISON**

|              | SPECIFIED PRODUCT | SUBSTITUTION REQUEST |
|--------------|-------------------|----------------------|
| NAME, BRAND  |                   |                      |
| CATALOG NO.  |                   |                      |
| MANUFACTURER |                   |                      |
| VENDOR       |                   |                      |

**PREVIOUS INSTALLATIONS**

|          |                    |
|----------|--------------------|
| PROJECT  | ARCHITECT/ENGINEER |
| LOCATION | DATE INSTALLED     |

**SIGNIFICANT VARIATIONS FROM SPECIFIED PRODUCT**

---

---

---

---

---

---

---

---

---

---

**REASON FOR SUBSTITUTION**

---

---

---

---

---

---

**DOES PROPOSED SUBSTITUTION AFFECT OTHER PARTS OF WORK?**☐ YES ☐ NO

IF YES, EXPLAIN

---

---

---

---

---

---

**SUBSTITUTION REQUIRES DIMENSIONAL REVISION OR REDESIGN OF STRUCTURE OR A/E WORK**☐ YES ☐ NO**BIDDER'S/CONTRACTOR'S STATEMENT OF CONFORMANCE OF PROPOSED SUBSTITUTION TO CONTRACT REQUIREMENT:**

We have investigated the proposed substitution. We believe that it is equal or superior in all respects to specified product, except as stated above; that it will provide the same Warranty as specified product; that we have included complete implications of the substitution; that we will pay redesign and other costs caused by the substitution which subsequently become apparent; and that we will pay costs to modify other parts of the Work as may be needed, to make all parts of the Work complete and functioning as a result of the substitution.

BIDDER/CONTRACTOR

DATE

**REVIEW AND ACTION**☐ Resubmit Substitution Request with the following additional information:

---

☐ Substitution is accepted.☐ Substitution is accepted with the following comments:

---

☐ Substitution is not accepted.

ARCHITECT/ENGINEER

DATE



STATE OF MISSOURI  
OFFICE OF ADMINISTRATION  
DIVISION OF FACILITIES MANAGEMENT, DESIGN AND CONSTRUCTION  
**FINAL RECEIPT OF PAYMENT AND RELEASE**

PROJECT NUMBER

KNOW ALL MEN BY THESE PRESENT THAT:                    hereinafter called "Subcontractor" who heretofore entered into an agreement with                    hereinafter called "Contractor", for the performance of work and/or furnishing of material for the construction of the project entitled

(PROJECT TITLE, PROJECT LOCATION, AND PROJECT NUMBER)

at

(ADDRESS OF PROJECT)

for the State of Missouri (Owner) which said subcontract is by this reference incorporated herein, in consideration of such final payment by Contractor.

DOES HEREBY:

1. ACKNOWLEDGE that they have been **PAID IN FULL** all sums due for work and materials contracted or done by their Subcontractors, Material Vendors, Equipment and Fixture Suppliers, Agents and Employees, or otherwise in the performance of the Work called for by the aforesaid Contract and all modifications or extras or additions thereto, for the construction of said project or otherwise.
2. RELEASE and fully, finally, and forever discharge the Owner from any and all suits, actions, claims, and demands for payment for work performed or materials supplied by Subcontractor in accordance with the requirements of the above referenced Contract.
1. REPRESENT that all of their Employees, Subcontractors, Material Vendors, Equipment and Fixture Suppliers, and everyone else has been **paid in full** all sums due them, or any of them, in connection with performance of said Work, or anything done or omitted by them, or any of them in connection with the construction of said improvements, or otherwise.

DATED this                    day of                    , 20                    .

NAME OF SUBCONTRACTOR

BY (TYPED OR PRINTED NAME)

SIGNATURE

TITLE

ORIGINAL: FILE/Closeout Documents



STATE OF MISSOURI  
OFFICE OF ADMINISTRATION  
DIVISION OF FACILITIES MANAGEMENT,  
DESIGN AND CONSTRUCTION

**MBE/WBE/SDVE PROGRESS REPORT**

Remit with ALL Progress and Final Payments

(Please check appropriate box) ☐CONSULTANT ☐CONSTRUCTION

|                                                                    |                |
|--------------------------------------------------------------------|----------------|
| PAY APP NO.                                                        | PROJECT NUMBER |
| CHECK IF FINAL<br><input checked="" type="checkbox"/> <b>FINAL</b> | DATE           |

| PROJECT TITLE                                                                                                |                                                 |                                                                                              |                                                                                  |
|--------------------------------------------------------------------------------------------------------------|-------------------------------------------------|----------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------|
| PROJECT LOCATION                                                                                             |                                                 |                                                                                              |                                                                                  |
| FIRM                                                                                                         |                                                 |                                                                                              |                                                                                  |
| ORIGINAL CONTRACT SUM (Same as Line Item 1. on Form A of Application for Payment)<br>\$                      |                                                 | TOTAL CONTRACT SUM TO DATE (Same as Line Item 3. on Form A of Application for Payment)<br>\$ |                                                                                  |
| THE TOTAL MBE/WBE/SDVE PARTICIPATION DOLLAR AMOUNT OF THIS PROJECT AS INDICATED IN THE ORIGINAL CONTRACT: \$ |                                                 |                                                                                              |                                                                                  |
| SELECT<br>MBE, WBE,<br>SDVE                                                                                  | ORIGINAL<br>CONTRACT<br>PARTICIPATION<br>AMOUNT | PARTICIPATION<br>AMOUNT<br>PAID-TO-DATE<br>(includes approved<br>contract changes)           | CONSULTANT/SUBCONSULTANT OR<br>CONTRACTOR/SUBCONTRACTOR/SUPPLIER<br>COMPANY NAME |
| <input type="checkbox"/> MBE<br><input type="checkbox"/> WBE<br><input type="checkbox"/> SDVE                | \$                                              | \$                                                                                           |                                                                                  |
| <input type="checkbox"/> MBE<br><input type="checkbox"/> WBE<br><input type="checkbox"/> SDVE                | \$                                              | \$                                                                                           |                                                                                  |
| <input type="checkbox"/> MBE<br><input type="checkbox"/> WBE<br><input type="checkbox"/> SDVE                | \$                                              | \$                                                                                           |                                                                                  |
| <input type="checkbox"/> MBE<br><input type="checkbox"/> WBE<br><input type="checkbox"/> SDVE                | \$                                              | \$                                                                                           |                                                                                  |
| <input type="checkbox"/> MBE<br><input type="checkbox"/> WBE<br><input type="checkbox"/> SDVE                | \$                                              | \$                                                                                           |                                                                                  |
| <input type="checkbox"/> MBE<br><input type="checkbox"/> WBE<br><input type="checkbox"/> SDVE                | \$                                              | \$                                                                                           |                                                                                  |

Revised 06/2023

## **INSTRUCTIONS FOR MBE/WBE/SDVE PROGRESS REPORT**

### **CONTRACTOR OR CONSULTANT TO FILL OUT AND REMIT WITH EACH PAY APPLICATION:**

The MBE/WBE/SDVE Progress Report for the project is issued with the contract comprising values reported in the consultant's Proposal or on the successful contractor's Section 004337 Compliance Evaluation Forms.

At Initial Pay Application fill in the following:

1. Pay App No. Start with 1.
2. Fill in the Project Number and Date.
3. Enter Project Title, Project Location, and Firm.
4. Fill in the "Original Contract Sum" and "Total Contract Sum To Date" (Reference applicable Line Items on Form A of Application for Payment).
5. Indicate the Total Participation Dollar Amount from the Original Contract.
6. Select MBE, WBE, or SDVE for each Consultant/Subconsultant or Contractor/Subcontractor/Supplier.
7. Enter the "Total Amount of Subcontract", "\$ Amount (Paid-To-Date)", and Company Name.

For all subsequent Pay Applications fill in the following:

1. Pay App No.
2. If Final Pay App, check box.
3. Fill in the Project Number and Date.
4. Enter Project Title, Project Location, and Firm
5. At each Pay App fill in the "Original Contract Sum" and "Total Contract Sum To Date" (reference applicable Line Items on Form A of Application for Payment).
6. Indicate the Total Participation Dollar Amount from the Original Contract.
7. Select MBE, WBE, or SDVE for each Consultant/Subconsultant or Contractor/Subcontractor/Supplier
8. Enter the "Total Amount of Subcontract", "\$ Amount (Paid-To-Date)", and Company Name.



STATE OF MISSOURI  
OFFICE OF ADMINISTRATION  
DIVISION OF FACILITIES MANAGEMENT, DESIGN AND CONSTRUCTION  
**AFFIDAVIT – COMPLIANCE WITH PREVAILING WAGE LAW**

PROJECT NUMBER

Before me, the undersigned Notary Public, in and for the County of \_\_\_\_\_

State of \_\_\_\_\_ personally came and appeared \_\_\_\_\_

(NAME)

of the \_\_\_\_\_

(POSITION)

(NAME OF THE COMPANY)

(a corporation) (a partnership) (a proprietorship) and after being duly sworn did depose and say that all provisions and requirements set out in Chapter 290, Sections 290.210 through and including 290.340, Missouri Revised Statutes, pertaining to the payment of wages to workmen employed on public works project have been fully satisfied and there has been no exception to the full and completed compliance with said provisions and requirements

and with Wage Determination No: \_\_\_\_\_ issued by the

Department of Labor and Industrial Relations, State of Missouri on the \_\_\_\_\_ day of \_\_\_\_\_ 20 \_\_\_\_

in carrying out the contract and working in connection with \_\_\_\_\_

(NAME OF PROJECT)

Located at \_\_\_\_\_ in \_\_\_\_\_ County

(NAME OF THE INSTITUTION)

Missouri, and completed on the \_\_\_\_\_ day of \_\_\_\_\_ 20 \_\_\_\_

SIGNATURE

**NOTARY INFORMATION**

NOTARY PUBLIC EMBOSSER OR  
BLACK INK RUBBER STAMP SEAL

STATE

COUNTY (OR CITY OF ST. LOUIS)

SUBSCRIBED AND SWORN BEFORE ME, THIS

DAY OF

YEAR

**USE RUBBER STAMP IN CLEAR AREA BELOW**

NOTARY PUBLIC SIGNATURE

MY COMMISSION  
EXPIRES

NOTARY PUBLIC NAME (TYPED OR PRINTED)

FILE: Closeout Documents

# GENERAL CONDITIONS

## INDEX

### ARTICLE:

#### 1. General Provisions

- 1.1. Definitions
- 1.2. Drawings and Specifications
- 1.3. Compliance with Laws, Permits, Regulations and Inspections
- 1.4. Nondiscrimination in Employment
- 1.5. Anti-Kickback
- 1.6. Patents and Royalties
- 1.7. Preference for American and Missouri Products and Services
- 1.8. Communications
- 1.9. Separate Contracts and Cooperation
- 1.10. Assignment of Contract
- 1.11. Indemnification
- 1.12. Disputes and Disagreements

#### 2. Owner/Designer Responsibilities

#### 3. Contractor Responsibilities

- 3.1. Acceptable Substitutions
- 3.2. Submittals
- 3.3. As-Built Drawings
- 3.4. Guaranty and Warranties
- 3.5. Operation and Maintenance Manuals
- 3.6. Other Contractor Responsibilities
- 3.7. Subcontracts

#### 4. Changes in the Work

- 4.1. Changes in the Work
- 4.2. Changes in Completion Time

#### 5. Construction and Completion

- 5.1. Construction Commencement
- 5.2. Project Construction
- 5.3. Project Completion
- 5.4. Payments

#### 6. Bond and Insurance

#### 6.1. Bond

#### 6.2. Insurance

#### 7. Termination or Suspension of Contract

#### 7.1. For Site Conditions

#### 7.2. For Cause

#### 7.3. For Convenience

## SECTION 007213 - GENERAL CONDITIONS

- A. These General Conditions apply to each section of these specifications. The Contractor is subject to the provisions contained herein.
- B. The General Conditions are intended to define the relationship of the Owner, the Designer and the Contractor thereby establishing certain rules and provisions governing the operation and performance of the work so that the work may be performed in a safe, orderly, expeditious and workmanlike manner.

## ARTICLE 1 – GENERAL PROVISIONS

### ARTICLE 1.1 - DEFINITIONS

As used in these contract documents, the following terms shall have the meanings and refer to the parties designated in these definitions.

1. **"COMMISSIONER"**: The Commissioner of the Office of Administration.
2. **"CONSTRUCTION DOCUMENTS"**: The "Construction Documents" shall consist of the Project Manual, Drawings and Addenda.
3. **"CONSTRUCTION REPRESENTATIVE"**: Whenever the term "Construction Representative" is used, it shall mean the Owner's Representative at the work site.
4. **"CONTRACTOR"**: Party or parties who have entered into a contract with the Owner to furnish work under these specifications and drawings.
5. **"DESIGNER"**: When the term "Designer" is used herein, it shall refer to the Architect, Engineer, or Consultant of Record specified and defined in Paragraph 2.0 of the Supplemental Conditions, or his duly authorized representative. The Designer may be either a consultant or state employee.
6. **"DIRECTOR"**: Whenever the term "Director" is used, it shall mean the Director of the Division of Facilities Management, Design and Construction or his Designee, representing the Office of Administration, State of Missouri. The Director is the agent of the Owner.
7. **"DIVISION"**: Shall mean the Division of Facilities Management, Design and Construction, State of Missouri.
8. **"INCIDENTAL JOB BURDENS"**: Shall mean those expenses relating to the cost of work, incurred either in the home office or on the job-site, which are necessary in the course of doing business but are incidental to the job. Such costs include office supplies and equipment, postage, courier services, telephone expenses including long distance, water and ice and other similar expenses.
9. **"JOINT VENTURE"**: An association of two (2) or more businesses to carry out a single business enterprise for profit for which purpose they combine their property, capital, efforts, skills and knowledge.
10. **"OWNER"**: Whenever the term "Owner" is used, it shall mean the State of Missouri. Acting by and through the Office of Administration, Division of Facilities Management, Design and Construction.
11. **"PROJECT"**: Wherever the term "Project" is used, it shall mean the work required to be completed by the construction contract.
12. **"PROJECT MANUAL"**: The "Project Manual" shall consist of Introductory Information, Invitation for Bid, Instructions to Bidders, Bid Documents, Additional Information, Standard Forms, General Conditions, Supplemental General Conditions, General Requirements and Technical Specifications.
13. **"SUBCONTRACTOR"**: Party or parties who contract under, or for the performance of part or this entire Contract between the Owner and Contractor. The subcontract may or may not be direct with the Contractor.
14. **"WORK"**: All supervision, labor, materials, tools, supplies, equipment, and any incidental operations and/or activities required by or reasonably inferable from the Contract Documents necessary to construct the Project and to produce the results intended by the Contract Documents in a safe, expeditious, orderly, and workmanlike manner so that the project shall be complete and finished in the best manner known to each respective trade.
15. **"WORKING DAYS"**: are all calendar days except Saturdays, Sundays and the following holidays: New Year's Day, Martin Luther King, Jr. Day, Lincoln Day, Washington's Birthday (observed), Truman Day, Memorial Day, Juneteenth, Independence Day, Labor Day, Columbus Day, Veterans Day (observed), Thanksgiving Day, Christmas Day.

## ARTICLE 1.2 DRAWINGS AND SPECIFICATIONS

- A. In case of discrepancy between drawings and specifications, specifications shall govern. Should discrepancies in architectural drawings, structural drawings and mechanical drawings occur, architectural drawings shall govern and, in case of conflict between structural and mechanical drawings, structural drawings shall govern.
- B. Specifications are separated into titled divisions for convenience of reference only and to facilitate letting of contracts and subcontracts. The Contractor is responsible for establishing the scope of work for subcontractors, which may cross titled divisions. Neither the Owner nor Designer will establish limits and jurisdiction of subcontracts.
- C. Figured dimensions take precedence over scaled measurements and details over smaller scale general drawings. In the event of conflict between any of the documents contained within the contract, the documents shall take precedence and be controlling in the following sequence: addenda, supplementary general conditions, general conditions, division 1 specifications, technical division specifications, drawings, bid form and instructions to bidders.
- D. Anything shown on drawings and not mentioned in these specifications or vice versa, as well as any incidental work which is obviously necessary to complete the project within the limits established by the drawings and specifications, although not shown on or described therein, shall be performed by the Contractor at no additional cost as a part of his contract.
- E. Upon encountering conditions differing materially from those indicated in the contract documents, the Contractor shall promptly notify the Designer and Construction Representative in writing before such conditions are disturbed. The Designer shall promptly investigate said conditions and report to the Owner, with a recommended course of action. If conditions do materially differ and cause an increase or decrease in contract cost or time required for completion of any portion of the work, a contract change will be initiated as outlined in Article 4 of these General Conditions.
- E. Only work included in the contract documents is authorized, and the Contractor shall do no work other than that described therein or in accordance with appropriately authorized and approved contract changes.

## ARTICLE 1.3 - COMPLIANCE WITH LAWS, PERMITS, REGULATIONS AND INSPECTIONS

- A. Since the Owner is the State of Missouri, municipal or political subdivisions, zoning ordinances, construction codes (other than licensing of trades), and other like ordinances are not applicable to construction on Owner's property, and Contractor will not be required to submit drawings and specifications to any municipal or political subdivision, authority, obtain construction permits or any other licenses (other than licensing of trades) or permits from or submit to inspections by any municipality or political subdivision relating to the construction for this project. All permits or licenses required by municipality or political subdivision for operation on property not belonging to Owner shall be obtained by and paid for by Contractor. Each Contractor shall comply with all applicable laws, ordinances, rules and regulations that pertain to the work of this contract.
- B. Contractors, subcontractors and their employees engaged in the businesses of electrical, mechanical, plumbing, carpentry, sprinkler system work, and other construction related trades shall be licensed to perform such work by the municipal or political subdivision where the project is located, if such licensure is required by local code. Local codes shall dictate the level (master, journeyman, and apprentice) and the number, type and ratio of licensed tradesmen required for this project within the jurisdiction of such municipal or political subdivision.
- C. Equipment and controls manufacturers and their authorized service and installation technicians that do not maintain an office within the jurisdiction of the municipal or political subdivision but are a listed or specified contractor or subcontractor on this project are exempt from Paragraph 1.3 B above.
- D. The Contractor shall post a copy of the wage determination issued for the project and included as a part of the contract documents, in a prominent and easily accessible location at the site of construction for the duration of the project.
- E. Any contractor or subcontractor to such contractor at any tier signing a contract to work on this project shall provide a ten-hour Occupational Safety and Health Administration (OSHA) construction safety program for their on-site employees which includes a course in construction safety and health approved by OSHA or a similar program approved by the Department of Labor and Industrial Relations which is at least as stringent as an approved OSHA program. The contractor shall forfeit as a penalty to the public body on whose

behalf the contract is made or awarded, two thousand five hundred dollars plus one hundred dollars for each employee employed by the contractor or subcontractor, for each calendar day, or portion thereof, such employee is employed without the required training.

#### **ARTICLE 1.4 - NONDISCRIMINATION IN EMPLOYMENT**

A. The Contractor and his subcontractors will not discriminate against individuals based on race, color, religion, national origin, sex, disability, or age, but may use restrictions which relate to bona fide occupational qualifications. Specifically, the Contractor and his subcontractors shall not discriminate:

1. Against recipients of service on the basis of race, color, religion, national origin, sex, disability or age.
2. Against any employee or applicant, for employment on the basis of race, color, religion, national origin, sex or otherwise qualified disability status.
3. Against any applicant for employment or employee on the basis of age, where such applicant or employee is between ages 40 and 70 and where such Contractor employs at least 20 persons.
4. Against any applicant for employment or employee on the basis of that person's status as a disabled or Vietnam-era veteran.

The Contractor and his Subcontractors will ensure applicants for employment and employees are treated equally without regard to race, color, religion, national origin, sex, disability, or age. Such action shall include, but not be limited to, the following: employment, upgrading, demotion and transfer; recruitment or recruitment advertising; and selection for training, including apprenticeship. The Contractor and his Subcontractors will give written notice of their commitments under this clause to any labor union with which they have bargaining or other agreements under this clause to any labor union with which they have bargaining or other agreements.

B. In the event of the Contractor's or his subcontractor's noncompliance with any provisions of this Article of the Contract, the Owner may cancel this contract in whole or in part or require the Contractor to terminate his contract with the subcontractor.

#### **ARTICLE 1.5 - ANTI-KICKBACK**

No employee of the division, shall have or acquire any pecuniary interest, whether direct or indirect, in this contract or in any part hereof. No officer, employee, designer, attorney, or administrator of or for the Owner who is authorized in such capacity and on behalf of the Owner to exercise any legislative, executive, supervisory or other similar functions in connection with the construction of the project, shall have or acquire any pecuniary interest, whether direct or indirect, in this contract, any material supply contract, subcontract, insurance contract, or any other contract pertaining to the project.

#### **ARTICLE 1.6 - PATENTS AND ROYALTIES**

- A. The Contractor shall hold and save the Owner and its officers, agents, servants, and employees harmless from liabilities of any nature or kind, including cost and expenses, for, or on account of, any patented or unpatented invention, process, article or appliance manufactured or used in the performance of this contract, including its use by the Owner, unless otherwise specifically stipulated in the contract documents.
- B. If the Contractor uses any design, device or materials covered by letters, patent or copyright, the Contractor shall provide for such use by suitable agreement with the Owner of such patented or copyrighted design, device or material. It is mutually agreed and understood, without exception, that the contract prices shall include all royalties or costs arising from the use of such design, device or materials, in any way involved in the work. The Contractor and/or his sureties shall indemnify and save harmless the Owner of the project from any and all claims for infringement by reason of the use of such patented or copyrighted design, device or materials or any trademark or copyright in connection with work agreed to be performed under this contract and shall indemnify the Owner for any cost, expense or damage it may be obliged to pay by reason of such infringement at any time during the prosecution of the work or after completion of the work.

## **ARTICLE 1.7 - PREFERENCE FOR AMERICAN AND MISSOURI PRODUCTS AND SERVICES**

- A. By virtue of statutory authority a preference will be given to Missouri labor and to products of mines, forests and quarries of the state of Missouri when they are found in marketable quantities in the state, and all such materials shall be of the best quality and suitable character that can be obtained at reasonable market prices, all as provided for in Section 8.280, Missouri Revised Statutes and Cumulative Supplements.
- B. Furthermore, pursuant to Section 34.076 Missouri Revised Statutes and Cumulative Supplements, a preference shall be given to those persons doing business as Missouri firms, corporations, or individuals, or which maintain Missouri offices or places of business, when the quality of performance promised is equal or better and the price quoted is the same or less. In addition, in order for a non-domiciliary bidder to be successful, his bid must be that same percentage lower than a domiciliary Missouri bidder's bid, as would be required for a Missouri bidder to successfully bid in the non-domiciliary state.
- C. In accordance with the Missouri Domestic Products Procurement Act Section 34.350 RSMo and Cumulative Supplements any manufactured goods or commodities used or supplied in the performance of this contract or any subcontract thereto shall be manufactured, assembled or produced in the United States, unless the specified products are not manufactured, assembled or produced in the United States in sufficient quantities to meet the agency's requirements or cannot be manufactured, assembled or produced in the United States within the necessary time in sufficient quantities to meet the contract requirements, or if obtaining the specified products manufactured, assembled or produced in the United States would increase the cost of this contract for purchase of the product by more than ten percent.

## **ARTICLE 1.8 - COMMUNICATIONS**

- A. All notices, requests, instructions, approvals, and claims must be in writing and shall be delivered to the Designer and copied to the Construction Representative for the project except as required by Article 1.12 Disputes and Disagreements, or as otherwise specified by the Owner in writing as stated in Section 012600. Any such notice shall be deemed to have been given as of the time of actual receipt.
- B. The Contractor shall attend on-site progress and coordination meetings, as scheduled by the Construction Representative, no less than once a month.

- C. The Contractor shall ensure that major subcontractors and suppliers shall attend monthly progress meetings as necessary to coordinate the work, and as specifically requested by the Construction Representative.

## **ARTICLE 1.9 - SEPARATE CONTRACTS AND COOPERATION**

- A. The Owner reserves the right to let other contracts in connection with this work. The Contractor shall afford other contractors reasonable opportunity for the introduction and storage of their materials and the execution of their work and shall properly connect and coordinate his work with theirs.
- B. The Contractor shall consult the drawings for all other contractors in connection with this work. Any work conflicting with the above shall be brought to the attention of the Owner's Representative before the work is performed. If the Contractor fails to do this, and constructs any work which interferes with the work of another contractor, the Contractor shall remove any part so conflicting and rebuild same, as directed by the Owner's Representative at no additional cost to the Owner.
- C. Each contractor shall be required to coordinate his work with other contractors so as to afford others reasonable opportunity for execution of their work. No contractor shall delay any other contractor by neglecting to perform contract work at the proper time. If any contractor causes delay to another, they shall be liable directly to that contractor for such delay in addition to any liquidated damages which might be due the Owner.
- D. Should the Contractor or project associated subcontractors refuse to cooperate with the instructions and reasonable requests of other Contractors or other subcontractors in the overall coordinating of the work, the Owner may take such appropriate action and issue directions, as required, to avoid unnecessary and unwarranted delays.
- E. Each Contractor shall be responsible for damage done to Owner's or other Contractor's property by him/her or workers in his employ through their fault or negligence.
- F. Should a Contractor sustain any damage through any act or omission of any other Contractor having a contract with the Owner, the Contractor so damaged shall have no claim or cause of action against the Owner for such damage, but shall have a claim or cause of action against the other Contractor to recover any and all damages sustained by reason of the acts or omissions of such Contractor. The phrase "acts or omissions" as used in this section shall be defined to include, but

not be limited to, any unreasonable delay on the part of any such contractors.

#### **ARTICLE 1.10 - ASSIGNMENT OF CONTRACT**

- A. No assignment by Contractor of any amount or any part of this contract or of the funds to be received there under will be recognized unless such assignment has had the written approval of the Director and the surety has been given due notice of such assignment and has furnished written consent thereto. In addition to the usual recitals in assignment contracts, the following language must be set forth: "It is agreed that the funds to be paid to the assignee under this assignment are subject to performance by the Contractor of this contract and to claims or liens for services rendered or materials supplied for the performance of the work called for in said contract in favor of all persons, firms or corporations rendering such services or supplying such materials."

#### **ARTICLE 1.11 - INDEMNIFICATION**

- A. Contractor agrees to indemnify and save harmless Owner and its respective commissioners, officers, officials, agents, consultants and employees and Designer, their agents, servants and employees, from and against any and all liability for damage arising from injuries to persons or damage to property occasioned by any acts or omissions of Contractor, any subcontractors, agents, servants or employees, including any and all expense, legal or otherwise, which may be incurred by Owner or Designer, its agents, servants or employees, in defense of any claim, action or suit.
- B. The obligations of the Contractor under this paragraph shall not extend to the liability of the Designer, his agents or employees, arising out of (1) the preparation or approval of maps, drawings, opinions, reports, surveys, contract changes, design or specifications, or (2) giving of or the failure to give directions or instructions by the Designer, his agents or employees as required by this contract documents provided such giving or failure to give is the primary cause of the injury or damage.

#### **ARTICLE 1.12 - DISPUTES AND DISAGREEMENTS**

It is hereby expressly agreed and understood that in case any controversy or difference of opinion arises during construction, best efforts will be given to resolution at the field level. Should those efforts be unsuccessful, the Contractor has the right to appeal in writing, the decision of the Director's Designee to the Director at Room 730 Truman Building, P.O. Box 809, Jefferson City, Missouri 65102. The decision of the Director shall be final and binding on all parties.

#### **ARTICLE 2 -- OWNER/DESIGNER RESPONSIBILITIES**

- A. The Owner shall give all orders and directions contemplated under this contract relative to the execution of the work. During progress of work the Owner will be represented at the project site by the Construction Representative and/or Designer, whose responsibilities are to see that this contract is properly fulfilled.
- B. The Owner shall at all times have access to the work whenever it is in preparation or progress. The Contractors shall provide proper facilities for such access and for inspection and supervision.
- C. All materials and workmanship used in the work shall be subject to the inspection of the Designer and Construction Representative, and any work which is deemed defective shall be removed, rebuilt or made good immediately upon notice. The cost of such correction shall be borne by the Contractor. Contractor shall not be entitled to an extension of the contract completion date in order to remedy defective work. All rejected materials shall be immediately removed from the site of the work.
- D. If the Contractor fails to proceed at once with the correction of rejected defective materials or workmanship, the Owner may, by separate contract or otherwise, have the defects remedied or rejected. Materials removed from the site and charge the cost of the same against any monies which may be due the Contractor, without prejudice to any other rights or remedies of the Owner.
- E. Failure or neglect on the part of Owner to observe faulty work, or work done which is not in accordance with the drawings and specifications shall not relieve the Contractor from responsibility for correcting such work without additional compensation.
- F. The Owner shall have the right to direct the Contractor to uncover any completed work.
  - 1. If the Contractor fails to adequately notify the Construction Representative and/or Designer of an inspection as required by the Contract Documents, the Contractor shall, upon written request, uncover the work. The Contractor shall bear all costs associated with uncovering and again covering the work exposed.
  - 2. If the Contractor is directed to uncover work, which was not otherwise required by the Contract Documents to be inspected, and the work is found to be defective in any respect, no compensation shall be allowed for this work. If, however, such work is found to meet

the requirements of this contract, the actual cost of labor and material necessarily involved in the examination and replacement plus 10% shall be allowed the Contractor.

- G. The Designer shall give all orders and directions contemplated under this contract relative to the scope of the work and shall give the initial interpretation of the contract documents.
- H. The Owner may file a written notice to the Contractor to dismiss immediately any subcontractors, project managers, superintendents, foremen, workers, watchmen or other employees whom the Owner may deem incompetent, careless or a hindrance to proper or timely execution of the work. The Contractor shall comply with such notice as promptly as practicable without detriment to the work or its progress.
- I. If in the Owner's judgment it becomes necessary at any time to accelerate work, when ordered by the Owner in writing, the Contractor shall redirect resources to such work items and execute such portions of the work as may be required to complete the work within the current approved contract schedule.

### **ARTICLE 3 -- CONTRACTOR RESPONSIBILITIES**

The Contractor shall register and utilize the Owner's eBuilder digital project management system for submission of documents described in the following sections. This includes but is not limited to submittals as required by designer, payment applications, Request for Information (RFI), construction change orders, Request for Proposals (RFP), Designer Supplemental Instructions (DSI), etc.

#### **ARTICLE 3.1 -- ACCEPTABLE SUBSTITUTIONS**

- A. The Contractor may request use of any article, device, product, material, fixture, form or type of construction which in the judgment of the Owner and Designer is equal in all respects to that named. Standard products of manufacturers other than those specified will be accepted when, prior to the ordering or use thereof, it is proven to the satisfaction of the Owner and Designer that they are equal in design, strength, durability, usefulness and convenience for the purpose intended.
- B. Any changes required in the details and dimensions indicated on the drawings for the substitution of products other than those specified shall be properly made at the expense of the Contractor requesting the substitution or change.
- C. The Contractor shall submit a request for such substitutions in writing to the Owner and Designer within twenty (20) working days after the date of

the "Notice to Proceed." Thereafter no consideration will be given to alternate forms of accomplishing the work. This Article does not preclude the Owner from exercising the provisions of Article 4 hereof.

- D. Any request for substitution by the Contractor shall be submitted in accordance with SECTION 002113 - INSTRUCTIONS TO BIDDERS.
- E. When a material has been approved, no change in brand or make will be permitted unless:
  - 1. Written verification is received from the manufacturer stating they cannot make delivery on the date previously agreed, or
  - 2. Material delivered fails to comply with contract requirements.

#### **ARTICLE 3.2 -- SUBMITTALS**

- A. The Contractor's submittals must be submitted with such promptness as to allow for review and approval so as not to cause delay in the work. The Contractor shall coordinate preparation and processing of submittals with performance of construction activities.

Coordinate each submittal with fabrication, = purchasing, testing, delivery, other submittals, and related activities that require sequential activity.

Submit four (4) copies to the Designer and additional copies as required for the subcontractors and material suppliers. Also provide copies to meet the requirements for maintenance manuals.

- B. All subcontractors' shop drawings and schedules shall be submitted by the Contractor and shall bear evidence that Contractor has received, reviewed, and approved them. Any shop drawings and schedules submitted without this evidence will be returned to the Contractor for resubmission.
- C. The Contractor shall include with the shop drawing, a letter indicating any and all deviations from the drawings and/or specifications. Failure to notify the Designer of such deviations will be grounds for subsequent rejection of the related work or materials. If, in the opinion of the Designer, the deviations are not acceptable, the Contractor will be required to furnish the item as specified and indicated on the drawings.
- D. The Designer shall check shop drawings and schedules with reasonable promptness and approve them only if they conform to the design concept of the project and comply with the information given in the contract documents. The approval shall not relieve the Contractor from the responsibility to comply with the drawings and specifications, unless the Contractor has called the Designer's attention to the deviation, in writing, at the time of

submission and the Designer has knowingly approved thereof. An approval of any such modification will be given only under the following conditions:

1. It is in the best interest of the Owner
  2. It does not increase the contract sum and/or completion time
  3. It does not deviate from the design intent
  4. It is without prejudice to any and all rights under the surety bond.
- E. No extension of time will be granted because of the Contractor's failure to submit shop drawings and schedules in ample time to allow for review, possible resubmission, and approval. Fabrication of work shall not commence until the Contractor has received approval. The Contractor shall furnish prints of approved shop drawings and schedules to all subcontractors whose work is in any way related to the work under this contract. Only prints bearing this approval will be allowed on the site of construction
- F. The Contractor shall maintain a complete file on-site of approved shop drawings available for use by the Construction Representative.

#### **ARTICLE 3.3 – AS-BUILT DRAWINGS**

- A. The Contractor shall update a complete set of the construction drawings, shop drawings and schedules of all work monthly by marking changes, and at the completion of their work (prior to submission of request for final payment) note all changes and turn the set over to the Construction Representative. The updates shall show all addenda, all field changes that were made to adapt to field conditions, changes resulting from contract changes or supplemental instructions, and all locations of structures, buried installations of piping, conduit, and utility services. All buried and concealed items both inside and outside shall be accurately located as to depth and referenced to permanent features such as interior or exterior wall faces and dimensions shall be given in a neat and legible manner in a contrasting colored pencil or ink. If approved by the Designer, an electronic file format may be provided.

#### **ARTICLE 3.4 – GUARANTY AND WARRANTIES**

- A. General Guaranty
1. Neither the final certificate of payment nor any provision in the contract documents nor partial use or occupancy of the premises by the Owner shall constitute an acceptance of work not done in accordance with contract requirements.

2. The Contractor or surety shall remedy any defects in the work and pay for any damage to property resulting there from which shall appear within a period of one (1) year from the date of substantial completion unless a longer period is otherwise specified or a differing guaranty period has been established in the substantial completion certificate. The Owner will give notice of observed defects with reasonable promptness.
3. In case of default on the part of the Contractor in fulfilling this part of this contract, the Owner may correct the work or repair the damage and the cost and expense incurred in such event shall be paid by or recoverable from the Contractor or surety.
4. The work will be free from defects not inherent in the quality required or permitted, and that the Work will conform to the requirements of the Contract Documents. Work not conforming to these requirements, including substitutions not properly approved and authorized, may be considered defective. The Contractor's guaranty excludes remedy for damage or defect caused by abuse, modifications not executed by the Contractor, improper or insufficient maintenance, improper operation, or normal wear and tear under normal usage. If required by the Owner, the Contractor shall furnish satisfactory evidence as to the kind and quality of materials and equipment

#### **B. Extended Warranty**

Manufacturer's certificates of warranty shall be obtained for all major equipment. Warranty shall be obtained for at least one year. Where a longer period is offered at no additional cost or called for in the specific equipment specifications, the longer period shall govern.

#### **ARTICLE 3.5 -- OPERATION AND MAINTENANCE MANUALS**

- A. Immediately after equipment submittals are approved and no later than ten (10) working days prior to the substantial completion inspection, the Contractor shall provide to the Designer three (3) copies of operating instructions and service manuals, containing the following:
1. Start-up and Shut-down Procedures: Provide a step-by-step write up of all major equipment. When manufacturer's printed start-up, trouble shooting and shut-down procedures are available; they may be incorporated into the operating manual for reference.

2. Operating Instructions: Written operating instructions shall be included for the efficient and safe operation of all equipment.
  3. Equipment List: List of all major equipment as installed shall be prepared to include model number, capacities, flow rate, name plate data, shop drawings and air and water balance reports.
  4. Service Instructions: Provide the following information for all pieces of equipment.
    - a. Recommended spare parts including catalog number and name of local supplier or factory representative.
    - b. Belt sizes, types, and lengths.
    - c. Wiring diagrams.
  5. Manufacturer's Certificate of Warranty as described in Article 3.4.
  6. Prior to the final payment, furnish to the Designer three (4) copies of parts catalogs for each piece of equipment furnished by him/her on the project with the components identified by number for replacement ordering.
- B. Submission of operating instructions shall be done in the following manner.
1. Manuals shall be in quadruplicate, and all materials shall be bound into volumes of standard 8½" x 11" hard binders. Large drawings too bulky to be folded into 8½" x 11" shall be separately bound or folded and in envelopes, cross referenced and indexed with the manuals.
  2. The manuals shall identify project name, project number, and include the name and address of the Contractor, subcontractors and manufacturers who were involved with the activity described in that particular manual.
  3. Internally subdivide the binder contents with permanent page dividers, logically organized with tab titles clearly printed under reinforced laminated plastic tabs.
  4. Contents: Prepare a Table of Contents for each volume, with each product or system description identified.

#### **ARTICLE 3.6 – OTHER CONTRACTOR RESPONSIBILITIES**

- A. The Contractor shall keep on site, during progress of the work, a competent superintendent satisfactory to the Construction Representative. The superintendent shall represent the Contractor and all agreements made by the superintendent shall be binding. The superintendent shall

carefully study and compare all drawings, specifications and other instructions and shall promptly notify the Construction Representative and Designer, in writing, any error, inconsistency or omission which may be discovered. The superintendent shall coordinate all work on the project. Any change of the superintendent shall be approved by the Construction Representative.

- B. Contractor shall, at all times, enforce strict discipline and good order among his employees, and shall not employ on the work any unfit person or anyone not skilled in the work assigned to him/her.
- C. The Contractor shall supply sufficient labor, material, plant and equipment and pay when due any laborer, subcontractor or supplier for supplies furnished and otherwise prosecute the work with diligence to prevent work stoppage and ensure completion thereof within the time specified.
- D. The Contractor and each of his subcontractors shall submit to the Construction Representative, through the Designer such schedules of quantities and costs, progress schedules, payrolls, reports, estimates, records and other data as the Owner may request concerning work performed or to be performed under this contract.
- E. The Contractor, subcontractors, and material suppliers shall upon written request, give the Owner access to all time cards, material invoices, payrolls, estimates, profit and loss statements, and all other direct or indirect costs related to this work.
- F. The Contractor shall be responsible for laying out all contract work such as layout of architectural, structural, mechanical and electrical work, which shall be coordinated with layouts of subcontractors for general construction work. The Contractor is also responsible for unloading, uncrating and handling of all materials and equipment to be erected or placed by him/her, whether furnished by Contractor or others. No extra charges or compensation will be allowed as a result of failure to verify dimensions before ordering materials or fabricating items.
- G. The Contractor must notify the Construction Representative at least one working day before placing concrete or burying underground utilities, pipelines, etc.
- H. Contractors shall prearrange time with the Construction Representative for the interruption of any facility operation. Unless otherwise specified in these documents, all connections, alterations or relocations as well as all other portions of the work will be performed during normal working hours.

- I. The Contractor shall coordinate all work so there will not be prolonged interruptions of existing equipment operation. Any existing plumbing, heating, ventilating, air conditioning or electrical disconnections necessary for the project, which affect portions of this construction or building or any other building must be scheduled with the Construction Representative to minimize or avoid any disruption of facility operations. In no case, unless previously approved in writing by the Construction Representative, shall utilities be left disconnected at the end of a work day or over a weekend. Any interruption of utilities either intentionally or accidentally shall not relieve the Contractor responsible for the interruption from the responsibility to repair and restore the utility to normal service. Repairs and restoration shall be made before the workers responsible for the repair and restoration leave the job.
- J. Contractors shall limit operations and storage of materials to the area within the project, except as necessary to connect to existing utilities, and shall not encroach on neighboring property. The Contractor shall be responsible for repair of their damage to property on or off the project site occurring during construction of project. All such repairs shall be made to the satisfaction of the property owner.
- K. Unless otherwise permitted, all materials shall be new and both workmanship and materials shall be of the best quality.
- L. Unless otherwise provided and stipulated within these specifications, the Contractor shall furnish, construct, and/or install and pay for materials, devices, mechanisms, equipment, all necessary personnel, utilities including, but not limited to water, heat, light and electric power, transportation services, applicable taxes of every nature, and all other facilities necessary for the proper execution and completion of the work.
- M. Contractor shall carefully examine the plans and drawings and shall be responsible for the proper fitting of his material, equipment and apparatus into the building.
- N. The Contractor or subcontractors shall not overload, or permit others to overload, any part of any structure during the performance of this contract.
- O. All temporary shoring, bracing, etc., required for the removal of existing work and/or for the installation of new work shall be included in this contract. The Contractor shall make good, at no cost to the Owner, any damage caused by improper support or failure of shoring in any respect. Each Contractor shall be responsible for shoring required to protect his work or adjacent property and improvements of Owner and shall be responsible for shoring or for giving written notice to adjacent property owners. Shoring shall be removed only after completion of permanent supports.
- P. The Contractor shall provide at the proper time such material as is required for support of the work. If openings are required, whether shown on drawings or not, the Contractor shall see that they are properly constructed.
- Q. During the performance of work the Contractor shall be responsible for providing and maintaining warning signs, lights, signal devices, barricades, guard rails, fences and other devices appropriately located on site which will give proper and understandable warning to all persons of danger of entry onto land, structure or equipment.
- R. The Contractor shall be responsible for protection, including weather protection, and proper maintenance of all equipment and materials.
- S. The Contractor shall be responsible for care of the finished work and shall protect same from damage or defacement until substantial completion by the Owner. If the work is damaged by any cause, the Contractor shall immediately begin to make repairs in accordance with the drawings and specifications. Contractor shall be liable for all damage or loss unless attributable to the acts or omissions of the Owner or Designer. Any claim for reimbursement shall be submitted in accordance with Article 4. After substantial completion the Contractor will only be responsible for damage resulting from acts or omissions of the Contractor or subcontractors through final warranty.
- T. In the event the Contractor encounters an unforeseen hazardous material, the Contractor shall immediately stop work in the area affected and report the condition to the Owner and Designer in writing. The Contractor shall not be required, pursuant to Article 4, to perform, any work relating to hazardous materials.
- U. In an emergency affecting safety of persons or property, the Contractor shall act, at the Contractor's discretion, to prevent threatened damage, injury or loss. Additional compensation or extension of time claimed by the Contractor on account of an emergency shall be determined as provided in Article 4.
- V. Before commencing work, Contractors shall confer with the Construction Representative and facility representative and review any facility rules and regulations which may affect the conduct of the work.

- W. Project signs will only be erected on major projects and only as described in the specifications. If no sign is specified, none shall be erected.

#### **ARTICLE 3.7 -- SUBCONTRACTS**

- A. Subcontractor assignments as identified in the bid form shall not be changed without written approval of the Owner. The Owner will not approve changes of a listed subcontractor unless the Contractor documents, to the satisfaction of the Owner that the subcontractor cannot or will not perform the work as specified.
- B. The Contractor is fully responsible to the Owner for the acts and omissions of all subcontractors and of persons either directly or indirectly employed by them.
- C. Every subcontractor shall be bound by the applicable terms and provisions of these contract documents, but no contractual relationship shall exist between any subcontractor and the Owner unless the right of the Contractor to proceed with the work is suspended or this contract is terminated as herein provided, and the Owner in writing elects to assume the subcontract.
- D. The Contractor shall upon receipt of "Notice to Proceed" and prior to submission of the first payment request, notify the Designer and Construction Representative in writing of the names of any subcontractors to be used in addition to those identified in the bid form and all major material suppliers proposed for all parts of the work.

#### **ARTICLE 4 -- CHANGES IN THE WORK**

##### **4.1 CHANGES IN THE WORK**

- A. The Construction Representative, without giving notice to the surety and without invalidating this contract, may order extra work or make changes by altering, adding to or deducting from the work, this contract sum being adjusted accordingly. All such work shall be executed under the conditions of the original contract. A claim for extension of time caused by any change must be adjusted at the time of ordering such change. No future request for time will be considered.
- B. Each Contract Change shall include all costs required to perform the work including all labor, material, equipment, overheads and profit, delay, disruptions, or other miscellaneous expenses. No subsequent requests for additional compensation including claims for delay, disruption, or reduced efficiency as a result of each change will be considered. Values from the Schedule of Values will not be binding as a basis for additions to or deductions from the contract price.

- C. The amount of any adjustment in this contract price for authorized changes shall be agreed upon before such changes become effective and shall be determined, through submission of a request for proposal, as follows:

1. By an acceptable fixed price proposal from the Contractor. Breakdowns shall include all takeoff sheets of each Contractor and subcontractor. Breakdown shall include a listing of each item of material with unit prices and number of hours of labor for each task. Labor costs per hour shall be included with labor burden identified, which shall be not less than the prevailing wage rate, etc. Overhead and profit shall be shown separately for each subcontractor and the Contractor.
2. By a cost-plus-fixed-fee (time and material) basis with maximum price, total cost not to exceed said maximum. Breakdown shall include a listing of each item of material with unit prices and number of hours of labor for each task. Labor costs per hour shall be included with labor burden identified, which shall be not less than the prevailing wage rate, etc. Overhead and profit shall be shown separately for each subcontractor and the Contractor.
3. By unit prices contained in Contractor's original bid form and incorporated in the construction contract.

- D. Overhead and Profit on Contract Changes shall be applied as follows:

1. The overhead and profit charge by the Contractor and all subcontractors shall be considered to include, but is not limited to: incidental job burdens, small truck (under 1 ton) expense, mileage, small hand tools, warranty costs, company benefits and general office overhead. Project supervision including field supervision and job site office expense shall be considered a part of overhead and profit unless a compensable time extension is granted.
2. The percentages for overhead and profit charged on Contract Changes shall be subject to the following limits: (a) the percentage mark-up for the Contractor shall be limited to the Contractor's fee; (b) fifteen percent (15%) maximum for Work directly performed by employees of a subcontractor, or sub-subcontractor; (c) five percent (5%) maximum for the Work performed or passed through to the Owner by the Contractor; (d) five percent (5%) maximum subcontractor's mark-up for

Work performed by a sub-subcontractor and passed through to the Owner by the subcontractor and Contractor; and (e) in no case shall the total overhead and profit paid by the Owner on any Contract Changes exceed twenty-five percent (25%) of the cost of materials, labor and equipment (exclusive of Contractor or any Subcontractor overhead and profit) necessary to put the contract change work in place.

3. The Contractor will be allowed to add the cost of Contractor's payment and performance bonding, builder's risk insurance, and general liability insurance to their cost of work. The above listed bonding and insurance cost shall not exceed two percent (2%) and shall be allowed on the total cost of the added work, including overhead and profit.
  4. On proposals covering both increases and decreases in the amount of this contract, the application of overhead and profit shall be on the net change in the cost of the work.
  5. The percentage(s) for overhead and profit to be credited to the Owner on Contract Changes that are solely decreases in the quantity of work or materials shall be the same as those for additive Contract Changes provided above.
- E. No claim for an addition to this contract sum shall be valid unless authorized as aforesaid in writing by the Owner. In the event that none of the foregoing methods are agreed upon, the Owner may order the Contractor to perform work on a time and material basis. The cost of such work shall be determined by the Contractor's actual labor and material cost to perform the work plus overhead and profit as outlined herein. The Designer and Construction Representative shall approve the Contractor's daily time and material invoices for the work involved.
- F. If the Contractor claims that any instructions involve extra cost under this contract, the Contractor shall give the Owner's Representative written notice thereof within a reasonable time after the receipt of such instructions, and in any event before proceeding to execute the work. No such claim shall be valid unless so made and authorized by the Owner, in writing.
- G. In an emergency affecting the safety of life or of the structure or of adjoining property, the Contractor, without special instruction or authorization from the Construction Representative, is hereby permitted to act at their discretion to prevent such threatened loss or injury. The Contractor shall submit a claim for compensation for such emergency work in writing to the Owner's Representative.

## ARTICLE 4.2 – CHANGES IN COMPLETION TIME

- A. Extension of the number of work days stipulated in the Contract for completion of the work with compensation may be made when:
1. The contractor documents that proposed Changes in the work, as provided in Article 4.1, extends construction activities critical to contract completion date, OR
  2. The Owner suspends all work for convenience of the Owner as provided in Article 7.3, OR
  3. An Owner caused delay extends construction activities critical to contract completion (except as provided elsewhere in these General Conditions). The Contractor is to review the work activities yet to begin and evaluate the possibility of rescheduling the work to minimize the overall project delay.
- B. Extension of the number of work days stipulated in the Contract for completion of the work without compensation may be made when:
1. Weather-related delays occur, subject to provisions for the inclusion of a specified number of "bad weather" days when provided for in Section 012100-Allowances, OR
  2. Labor strikes or acts of God occur, OR
  3. The work of the Contractor is delayed on account of conditions which were beyond the control of the Contractor, subcontractors or suppliers, and were not the result of their fault or negligence.
- C. No time extension or compensation will be provided for delays caused by or within the control of the Contractor, subcontractors or suppliers and for concurrent delays caused by the Owner.
- D. The Contractor shall notify the Owner promptly of any occurrence or conditions which in the Contractor's opinion results in a need for an extension of time. The notice shall be in writing and shall include all necessary supporting materials with details of any resultant costs and be submitted in time to permit full investigation and evaluation of the Contractor's claim. The Owner shall promptly acknowledge the Contractor's notice and, after recommendation from the Owner's Representative and/or Designer, shall provide a decision to the Contractor. Failure on the part of the Contractor to provide such notice and to detail the costs shall constitute a waiver by the Contractor of any claim. Requests for extensions of time shall be for working days only.

## **ARTICLE 5 - CONSTRUCTION AND COMPLETION**

### **ARTICLE 5.1 – CONSTRUCTION COMMENCEMENT**

A. Upon receipt of the "Intent to Award" letter, the Contractor must submit the following properly executed instruments to the Owner:

1. Contract;
2. Performance/payment bond as described in Article 6.1;
3. Certificates of Insurance, or the actual policies themselves, showing that the Contractor has obtained the insurance coverage required by Article 6.2.

Above referenced items must be received by the Owner within ten (10) working days after the effective date of the contract. If not received, the Owner may treat the failure to timely submit them as a refusal by the Contractor to accept a contract for this work and may retain as liquidated damages the Contractor's bid bond, cashier's check or certified check as provided in the Instructions to Bidders. Upon receipt the Owner will issue a "Notice to Proceed" with the work to the Contractor.

B. Within the time frame noted in Section 013200 - Schedules, following receipt of the "Notice to Proceed", the Contractor shall submit to the Owner a progress schedule and schedule of values, showing activities through the end of the contract period. Should the Contractor not receive written notification from the Owner of the disapproval of the schedule of values within fifteen (15) working days, the Contractor may consider it approved for purpose of determining when the first monthly Application and Certification for Payment may be submitted.

C. The Contractor may commence work upon receipt of the Division of Facilities Management, Design and Construction's "Notice to Proceed" letter. Contractor shall prosecute the work with faithfulness and energy, and shall complete the entire work on or before the completion time stated in the contract documents or pay to the Owner the damages resulting from the failure to timely complete the work as set out within Article 5.4.

### **ARTICLE 5.2 -- PROJECT CONSTRUCTION**

A. Each Contractor shall submit for the Owner's approval, in reproducible form, a progress schedule showing the rate of progress and the order of the work proposed to carry on various phases of the project. The schedule shall be in conformance

with the requirements outlined in Section 013200 – Schedules.

B. Contractor shall employ and supply a sufficient force of workers, material, and equipment and shall pay when due, any worker, subcontractor or supplier and otherwise prosecute the work with such diligence so as to maintain the rate of progress indicated on the progress schedule, prevent work stoppage, and insure completion of the project within the time specified.

### **ARTICLE 5.3 -- PROJECT COMPLETION**

A. Substantial Completion. A Project is substantially complete when construction is essentially complete and work items remaining to be completed can be done without interfering with the Owner's ability to use the Project for its intended purpose.

1. Once the Contractor has reached what they believe is Substantial Completion, the Contractor shall notify the Designer and the Construction Representative of the following:
  - a. That work is essentially complete with the exception of certain listed work items. The list shall be referred to as the "Contractor's Punch."
  - b. That all Operation and Maintenance Manuals have been assembled and submitted in accordance with Article 3.5A.
  - c. That the Work is ready for inspection by the Designer and Construction Representative. The Owner shall be entitled to a minimum of ten working days notice before the inspection shall be performed.
2. If the work is acceptable, the Owner shall issue a Certificate of Substantial Completion, which shall set forth the responsibilities of the Owner and the Contractor for utilities, security, maintenance, damage to the work and risk of loss. The Certificate shall also identify those remaining items of work to be performed by the Contractor. All such work items shall be complete within 30 working days of the date of the Certificate, unless the Certificate specifies a different time. If the Contractor shall be required to perform tests that must be delayed due to climatic conditions, it is understood that such tests and affected equipment will be identified on the Certificate and shall be accomplished by the Contractor at the earliest possible date. Performance of the tests may not be required before Substantial Completion can be issued. The date of the issuance of the Certificate of

Substantial Completion shall determine whether or not the work was completed within the contract time and whether or not Liquidated Damages are due.

3. If the work is not acceptable, and the Owner does not issue a Certificate of Substantial Completion, the Owner shall be entitled to charge the Contractor with the Designer's and Owner's costs of re-inspection, including time and travel.
- B. Partial Occupancy. Contractor agrees that the Owner shall be permitted to occupy and use any completed or partially completed portions of the Project, when such occupancy and use is in the Owner's best interest. Owner shall notify Contractor of its desire and intention to take Partial Occupancy as soon as possible but at least ten (10) working days before the Owner intends to occupy. If the Contractor believes that the portion of the work the Owner intends to occupy is not ready for occupancy, the Contractor shall notify the Owner immediately. The Designer shall inspect the work in accordance with the procedures above. If the Contractor claims increased cost of the project or delay in completion as a result of the occupancy, he shall notify the Owner immediately but in all cases before occupancy occurs.
- C. Final Completion. The Project is finally complete when the Certificate of Substantial Completion has been issued and all work items identified therein as incomplete have been completed, and when all administrative items required by the contract have been completed. Final Completion entitles the Contractor to payment of the outstanding balance of the contract amount including all change orders and retainage. Within five (5) working days of the date of the Certificate of Substantial Completion, the Contractor shall identify the cost to complete any outstanding items of work. The Designer shall review the Contractor's estimate and either approve it or provide an independent estimate for all such items. If the Contractor fails to complete the remaining items within the time specified in the Certificate, the Owner may terminate the contract and go to the surety for project completion in accordance with Article 7.2 or release the contract balance to the Contractor less 150% of the approved estimate to complete the outstanding items. Upon completion of the outstanding items, when a final cost has been established, any monies remaining shall be paid to the Contractor. Failure to complete items of work does not relieve the Contractor from the obligation to complete the administrative requirements of the contract, such as the provisions of Article 5.3 FAILURE TO COMPLETE ALL ITEMS OF WORK UNDER THE CONTRACT SHALL BE CONSIDERED A

#### DEFAULT AND BE GROUNDS FOR CONTRACT TERMINATION AND DEBARMENT.

- D. Liquidated Damages. Contractor agrees that the Owner may deduct from the contract price and retain as liquidated damages, and not as penalty or forfeiture, the sum stipulated in this contract for each work day after the Contract Completion Day on which work is not Substantially Complete. Assessment of Liquidated Damages shall not relieve the Contractor or the surety of any responsibility or obligation under the Contract. In addition, the Owner may, without prejudice to any other rights, claims, or remedies the Owner may have including the right to Liquidated Damages, charge the Contractor for all additional expenses incurred by the Owner and/or Designer as the result of the extended contract period through Final Completion. Additional Expenses shall include but not be limited to the costs of additional inspections.
- E. Early Completion. The Contractor has the right to finish the work before the contract completion date; however, the Owner assumes no liability for any hindrances to the Contractor unless Owner caused delays result in a time extension to the contract completion date. The Contractor shall not be entitled to any claims for lost efficiencies or for delay if a Certificate of Substantial Completion is given on or before the Contract Completion Date.

#### ARTICLE 5.4 -- PAYMENT TO CONTRACTOR

- A. Payments on account of this contract will be made monthly in proportion to the work which has been completed. Request for payment must be submitted on the Owner's forms. No other pay request will be processed. Supporting breakdowns must be in the same format as Owner's forms and must provide the same level of detail. The Designer will, within 5 working days from receipt of the contractor's request for payment either issue a Certificate for Payment to the Owner, for such amount as the Designer determines is properly due, or notify the Contractor in writing of reasons for withholding a Certificate. The Owner shall make payment within 30 calendar days after the "Application and Certification for Payment" has been received and certified by the Designer. The following items are to be attached to the contractor's pay request:
  1. Updated construction schedule
  2. Certified payrolls consisting of name, occupation and craft, number of hours worked and actual wages paid for each individual employee, of the Contractor and all subcontractors working on the project

- B. The Owner shall retain 5 percent of the amount of each such payment application, except as allowed by Article 5.4, until final completion and acceptance of all work covered by this contract.
- C. Each payment made to Contractor shall be on account of the total amount payable to Contractor and all material and work covered by paid partial payment shall thereupon become the sole property of Owner. This provision shall not be construed as relieving Contractor from sole responsibility for care and protection of materials and work upon which payments have been made or restoration of any damaged work or as a waiver of the right of Owner to require fulfillment of all terms of this contract.
- D. Materials delivered to the work site and not incorporated in the work will be allowed in the Application and Certification for Payment on the basis of one hundred (100%) percent of value, subject to the 5% retainage providing that they are suitably stored on the site or in an approved warehouse in accordance with the following requirements:
  - 1. Material has previously been approved through submittal and acceptance of shop drawings conforming to requirements of Article 3.2 of General Conditions.
  - 2. Delivery is made in accordance with the time frame on the approved schedule.
  - 3. Materials, equipment, etc., are properly stored and protected from damage and deterioration and remain so - if not, previously approved amounts will be deleted from subsequent pay applications.
  - 4. The payment request is accompanied by a breakdown identifying the material equipment, etc. in sufficient detail to establish quantity and value.
- E. The Contractor shall be allowed to include in the Application and Certification for Payment, one hundred (100%) of the value, subject to retainage, of major equipment and material stored off the site if all of the following conditions are met:
  - 1. The request for consideration of payment for materials stored off site is made at least 15 working days prior to submittal of the Application for Payment including such material. Only materials inspected will be considered for inclusion on Application for Payment requests.
  - 2. Materials stored in one location off site are valued in excess of \$25,000.
  - 3. That a Certificate of Insurance is provided indicating adequate protection from loss, theft

conversion or damage for materials stored off site. This Certificate shall show the State of Missouri as an additional insured for this loss.

- 4. The materials are stored in a facility approved and inspected, by the Construction Representative.
- 5. Contractor shall be responsible for, Owner costs to inspect out of state facilities, and any delays in the completion of the work caused by damage to the material or for any other failure of the Contractor to have access to this material for the execution of the work.
- F. The Owner shall determine the amount, quality and acceptability of the work and materials which are to be paid for under this contract. In the event any questions shall arise between the parties, relative to this contract or specifications, determination or decision of the Owner or the Construction Representative and the Designer shall be a condition precedent to the right of the Contractor to receive any money or payment for work under this contract affected in any manner or to any extent by such question.
- G. Payments Withheld: The Owner may withhold or nullify in whole or part any certificate to such extent as may be necessary to protect the Owner from loss on account of:
  - 1. Defective work not remedied. When a notice of noncompliance is issued on an item or items, corrective action shall be undertaken immediately. Until corrective action is completed, no monies will be paid and no additional time will be allowed for the item or items. The cost of corrective action(s) shall be borne by the Contractor.
  - 2. A reasonable doubt that this contract can be completed for the unpaid balance.
  - 3. Failure of the Contractor to update as-built drawings monthly for review by the Construction Representative.
  - 4. Failure of the Contractor to update the construction schedule.When the Construction Representative is satisfied the Contractor has remedied above deficiencies, payment shall be released.
- H. Final Payment: Upon receipt of written notice from the Contractor to the Designer and Project Representative that the work is ready for final inspection and acceptance, the Designer and Project Representative, with the Contractor, shall promptly make such inspection. If the work is acceptable and the contract fully performed, the Construction Representative shall complete a final acceptance report and the Contractor will be

directed to submit a final Application and Certification for Payment. If the Owner approves the same, the entire balance shall be due and payable, with the exception of deductions as provided for under Article 5.4.

1. Where the specifications provide for the performance by the Contractor of (certain tests for the purpose of balancing and checking the air conditioning and heating equipment and the Contractor shall have furnished and installed all such equipment in accordance with the specifications, but said test cannot then be made because of climatic conditions, such test shall may be considered as required under the provisions of the specifications, Section 013300 and this contract may be substantial Full payment will not be made until the tests have been made and the equipment and system is finally accepted. If the tests are not completed when scheduled, the Owner may deduct 150% of the value of the tests from the final payment.
2. The final payment shall not become due until the Contractor delivers to the Construction Representative:
  - a) A complete file of releases, on the standard form included in the contract documents as "Final Receipt of Payment and Release Form", from subcontractors and material suppliers evidencing payment in full for services, equipment and materials, as the case may require, if the Owner approves, or a consent from the Surety to final payment accepting liability for any unpaid amounts.
  - b) An Affidavit of Compliance with Prevailing Wage Law, in the form as included in this contract specifications, properly executed by each subcontractor, and the Contractor
  - c) Certified copies of all payrolls
  - d) As-built drawings
3. If any claim remains unsatisfied after all payments are made, the Contractor shall refund to the Owner all monies that the latter may be compelled to pay in discharging such a claim including all costs and a reasonable attorney's fee.
4. Missouri statute requires prompt payment from the Owner to the Contractor within thirty calendar days and from the Contractor to his subcontractors within fifteen calendar days. Failure to make payments within the required

time frame entitles the receiving party to charge interest at the rate of one and one half percent per month calculated from the expiration of the statutory time period until paid.

5. The value of all unused unit price allowances and/or 150% of the value of the outstanding work items, and/or liquidated damages may be deducted from the final pay request without executing a Contract Change. Any unit price items which exceed the number of units in the contract may be added by Contract Change.

## **ARTICLE 6 -- INSURANCE AND BONDS**

### **ARTICLE 6.1 -- BOND**

- A. Contractor shall furnish a performance/payment bond in an amount equal to 100% of the contract price to guarantee faithful performance of the contract and 100% of the contract price to guarantee the payment of all persons performing labor on the project and furnishing materials in connection therewith under this contract as set forth in the standard form of performance and payment bond included in the contract documents. The surety on such bond shall be issued by a surety company authorized by the Missouri Department of Insurance to do business in the state of Missouri.
- B. All Performance/Payment Bonds furnished in response to this provision shall be provided by a bonding company with a rating of B+ or higher as established by A.M. Best Company, Inc. in their most recent publication.

## ARTICLE 6.2 – INSURANCE

A. The successful Contractor shall procure and maintain for the duration of the contract issued a policy or policies of insurance for the protection of both the Contractor and the Owner and their respective officers, officials, agents, consultants and employees. The Owner requires certification of insurance coverage from the Contractor prior to commencing work.

### B. Minimum Scope and Extent of Coverage

#### 1. General Liability

Commercial General Liability, ISO coverage form number or equivalent CG 00 01 ("occurrence" basis), or I-SO coverage form number CG 00 02, or ISO equivalent.

If ISO equivalent or manuscript general liability coverage forms are used, minimum coverage will be as follows: Premises/Operations; Independent Contractors; Products/Completed Operations; personal injury; Broad Form Property Damage including Completed Operations; Broad Form Contractual Liability Coverage to include Contractor's obligations under Article 1.11 Indemnification and any other Special Hazards required by the work of the contract.

#### 2. Automobile Liability

Business Automobile Liability Insurance, ISO Coverage form number or equivalent CA 00 01 covering automobile liability, code 1 "ANY AUTO".

#### 3. Workers' Compensation and Employer's Liability

Statutory Workers' Compensation Insurance for Missouri and standard Employer's Liability Insurance, or the authorization to self-insure for such liability from the Missouri Division of Workers' Compensation.

#### 4. Builder's Risk or Installation Floater Insurance

Insurance upon the work and all materials, equipment, supplies, temporary structures and similar items which may be incident to the performance of the work and located at or adjacent to the site, against loss or damage from fire and such other casualties as are included in extended coverage in broad "All Risk" form, including coverage for Flood and Earthquake, in an amount not less than the replacement cost of the work or this contract price, whichever is greater, with loss payable to Contractor and Owner as their respective interests may appear.

Contractor shall maintain sufficient insurance to cover the full value of the work and materials as the work progresses, and shall furnish Owner copies of all endorsements. If Builder's Risk Reporting- Form of Endorsement is used, Contractor shall make all reports as required therein so as to keep in force an amount of insurance which will equal the replacement cost of the work, materials, equipment, supplies, temporary structures, and other property covered thereby; and if, as a result of Contractor's failure to make any such report, the amount of insurance so recoverable shall be less than such replacement cost, Contractor's interest in the proceeds of such insurance, if any, shall be subordinated to Owner's interest to the end that Owner may receive full reimbursement for its loss.

### C. Minimum Limits of Insurance

#### 1. General Liability

Contractor

|             |                                                                                              |
|-------------|----------------------------------------------------------------------------------------------|
| \$2,000,000 | combined single limit per occurrence for bodily injury, personal injury, and property damage |
|-------------|----------------------------------------------------------------------------------------------|

|             |                  |
|-------------|------------------|
| \$2,000,000 | annual aggregate |
|-------------|------------------|

#### 2. Automobile Liability

|             |                                                                            |
|-------------|----------------------------------------------------------------------------|
| \$2,000,000 | combined single limit per occurrence for bodily injury and property damage |
|-------------|----------------------------------------------------------------------------|

#### 3. Workers' Compensation and Employers Liability

Workers' Compensation limits as required by applicable State Statutes (generally unlimited) and minimum of \$1,000,000 limit per accident for Employer's Liability.

General Liability and Automobile Liability insurance may be arranged under individual policies for the full limits required or by a combination of underlying policies with the balance provided by a form-following Excess or Umbrella Liability policy.

### D. Deductibles and Self-Insured Retentions

All deductibles, co-payment clauses, and self-insured retentions must be declared to and approved by the Owner. The Owner reserves the right to request the reduction or elimination of unacceptable deductibles or self-insured retentions, as they would apply to the Owner, and their respective officers, officials, agents, consultants and employees. Alternatively, the Owner may request Contractor to procure a bond guaranteeing

payment of losses and related investigations, claims administration, and defense expenses.

E. Other Insurance Provisions and Requirements

The respective insurance policies and coverage, as specified below, must contain, or be endorsed to contain the following conditions or provisions:

1. General Liability

The Owner, and its respective commissioners, officers, officials, agents, consultants and employees shall be endorsed as additional insured's by ISO form CG 20 26 Additional Insured - Designated Person or Organization. As additional insured's, they shall be covered as to work performed by or on behalf of the Contractor or as to liability which arises out of Contractor's activities or resulting from the performance of services or the delivery of goods called for by the Contract.

Contractor's insurance coverage shall be primary with respect to all additional insured's. Insurance of self-insurance programs maintained by the designated additional -insured's shall be excess of the Contractor's insurance and shall not contribute with it.

Additionally, the Contractor and Contractor's general liability insurer shall agree to waive all rights of subrogation against the Owner and any of their respective officers, officials, agents, consultants or employees for claims, losses, or expenses which arise out of Contractor's activities or result from the performance of services or the delivery of goods called for by the Contract.

Contractor's failure to comply with the terms and conditions of these insurance policies shall not affect or abridge coverage for the Owner, or for any of their officers, officials, agents, consultants or employees.

2. Automobile Insurance

The Owner, and their respective officers, officials, agents, consultants and employees shall be endorsed as additional insured's by ISO form CG 20 26 - Additional Insured Designated Person or Organization. As additional insured's, they shall be covered as to work performed by or on behalf of the Contractor or as to liability which arises out of Contractor's activities or resulting from the performance of services or the delivery of goods called for by the Contract.

Contractor's insurance coverage shall be primary with respect to all additional insured's. Insurance or self-insurance

programs maintained by the designated additional insured's shall be in excess of the Contractor's insurance and shall not contribute with it.

Additionally, the Contractor and Contractor's automobile insurer shall agree to waive all rights of subrogation against the Owner and any of their respective officers, officials, agents, consultants or employees for claims, losses, or expenses which arise out of Contractor's activities or result from the performance of services or the delivery of goods called for by the Contract.

Contractor's failure to comply with the terms and conditions of these insurance policies shall not affect or abridge coverage for the Owner or for any of its officers, officials, agents, consultants or employees.

3. Workers' Compensation/Employer's Liability

Contractor's workers' compensation insurance shall be endorsed with NCCI form WC 00 03 01 A - Alternative Employer Endorsement. The Alternative Employer Endorsement shall designate the Owner as "alternate employers."

4. All Coverages

Each insurance policy required by this section of the Contract shall contain a stipulation, endorsed if necessary, that the Owner will receive a minimum of a thirty (30) calendar day advance notice of any policy cancellation. Ten (10) calendar days advance notice is required for policy cancellation due to non-payment of premium.

F. Insurer Qualifications and Acceptability

Insurance required hereunder shall be issued by an A.M. Best, "B+" rated, Class IX insurance company approved to conduct insurance business in the state of Missouri.

G. Verification of Insurance Coverage

Prior to Owner issuing a Notice to Proceed, the Contractor shall furnish the Owner with Certificate(s) of Insurance and with any applicable original endorsements evidencing the required insurance coverage. The insurance certificates and endorsements are to be signed by a person authorized by that insurer to bind coverage on its behalf. All certificates and endorsements received by the Owner are subject to review and approval by the Owner. The Owner reserves the right to require certified copies of all required policies at any time. If the scope of this contract will exceed one (1) year - or, if any of Contractor's applicable insurance coverage expires prior to completion of the work or services required under this contract -

the Contractor will provide a renewal or replacement certificate before continuing work or services hereunder. If the Contractor fails to provide documentation of required insurance coverage, the Owner may issue a stop work order and no additional contract completion time and/or compensation shall be granted as a result thereof.

## **ARTICLE 7 – SUSPENSION OR TERMINATION OF CONTRACT**

### **ARTICLE 7.1 - FOR SITE CONDITIONS**

When conditions at the site of the proposed work are considered by the Owner to be unsatisfactory for prosecution of the work, the Contractor may be ordered in writing to suspend the work or any part thereof until reasonable conditions exist. When such suspension is not due to fault or negligence of the Contractor, time allowed for completion of such suspended work will be extended by a period of time equal to that lost due to delay occasioned by ordered suspension. This will be a no cost time extension.

### **ARTICLE 7.2 - FOR CAUSE**

#### **A. Termination or Suspension for Cause:**

1. If the Contractor shall file for bankruptcy, or should make a general assignment for the benefit of the creditors, or if a receiver should be appointed on account of insolvency, or if the contractor should persistently or repeatedly refuse or fail to supply enough properly skilled workers or proper materials, or if the contractor should fail to make prompt payment to subcontractors or for material or labor, or persistently disregard laws, ordinances or the instructions of the Owner, or otherwise be guilty of a substantial violation of any provision of this contract, then the Owner may serve notice on the Contractor and the surety setting forth the violations and demanding compliance with this contract. Unless within ten (10) consecutive calendar days after serving such notice, such violations shall cease and satisfactory arrangements for correction be made, the Owner may suspend the Contractor's right to proceed with the work or terminate this contract.
2. In the event the Owner suspends Contractor's right to proceed with the work or terminates the contract, the Owner may demand that the Contractor's surety take over and complete the work on this contract, after the surety submits a written proposal to the Owner and receives written approval and upon the surety's failure or refusal to do so within ten (10) consecutive

calendar days after demand therefore, the Owner may take over the work and prosecute the same to completion by bid or negotiated contract, or the Owner may elect to take possession of and utilize in completing the work such materials, supplies, appliances and plant as may be on the site of the work, and all subcontractors, if the Owner elects, shall be bound to perform their contracts.

- B. The Contractor and its surety shall be and remain liable to the Owner for any excess cost or damages occasioned to the Owner as a result of the actions above set forth.
- C. The Contractor in the event of such suspension or termination shall not be entitled to receive any further payments under this contract until the work is wholly finished. Then if the unpaid balance under this contract shall exceed all expenses of the Owner as certified by the Director, such excess shall be paid to the Contractor; but, if such expenses shall exceed the unpaid balance as certified by the Director, the Contractor and their surety shall be liable for and shall pay the difference and any damages to the Owner.
- D. In exercising Owner's right to secure completion of the work under any of the provisions hereof, the Director shall have the right to exercise Owner's sole discretion as to the manner, methods and reasonableness of costs of completing the work.
- E. The rights of the Owner to suspend or terminate as herein provided shall be cumulative and not exclusive and shall be in addition to any other remedy provided by law.
- F. The Contractor in the event of such suspension or termination may be declared ineligible for Owner contracts for a minimal period of twelve (12) months. Further, no contract will be awarded to any Contractor who lists in their bid form any subcontractor whose prior performance has contributed, as determined by the Owner, to a breach of a contract. In order to be considered for state-awarded contracts after this period, the Contractor/subcontractor will be required to forward acceptance reports to the Owner regarding successful completion of non-state projects during the intervening twelve (12) months from the date of default. No contracts will be awarded to a subcontractor/Contractor until the ability to perform responsibly in the private sector has been proven to the Owner.

### **ARTICLE 7.3 -- FOR CONVENIENCE**

- A. The Owner may terminate or suspend the Contract or any portion of the Work without cause at any time, and at the Owner's convenience. Notification of a termination or suspension shall be in writing

and shall be given to the Contractor and their surety. If the Contract is suspended, the notice will contain the anticipated duration of the suspension or the conditions under which work will be permitted to resume. If appropriate, the Contractor will be requested to demobilize and re-mobilize and will be reimbursed time and costs associated with the suspension.

B. Upon receipt of notification, the Contractor shall:

1. Cease operations when directed.
2. Take actions to protect the work and any stored materials.
3. Place no further subcontracts or orders for material, supplies, services or facilities except as may be necessary to complete the portion of the Contract that has not been terminated. No claim for payment of materials or supplies ordered after the termination date shall be considered.
4. Terminate all existing subcontracts, rentals, material, and equipment orders.

5. Settle all outstanding liabilities arising from termination with subcontractors and suppliers.

6. Transfer title and deliver to the Owner, work in progress, completed work, supplies and other material produced or acquire for the work terminated, and completed or partially completed plans, drawings information and other property that, if the Contract had been completed, would be required to be furnished to the Owner.

C. For termination without cause and at the Owner's convenience, in addition to payment for work completed prior to date of termination, the Contractor may be entitled to payment of other documented costs directly associated with the early termination of the contract. Payment for anticipated profit and unapplied overhead will not be allowed.

## **SECTION 007300 - SUPPLEMENTARY CONDITIONS**

### **1.0 GENERAL:**

A. These Supplementary General Conditions clarify, add, delete, or otherwise modify standard terms and conditions of DIVISION 0, BIDDING AND CONTRACTING REQUIREMENTS.

### **2.0 CONTACTS:**

Designer: Joy Coleman  
Treanor, Inc.  
1811 Baltimore Ave.  
Kansas City, MO 64108  
Telephone: 816-581-4027  
Email: [jcoleman@treanor.design](mailto:jcoleman@treanor.design)

Construction Representative: Robert Rehagen  
Division of Facilities Management, Design and Construction  
301 West High Street, Room 730  
Jefferson City, MO 65101  
Telephone: 573-616-6307  
Email: [robert.rehagen@oa.mo.gov](mailto:robert.rehagen@oa.mo.gov)

Project Manager: Andrew Friedmeyer  
Division of Facilities Management, Design and Construction  
301 West High Street, Room 730  
Jefferson City, Missouri 65101  
Telephone: 573-536-8019  
Email: [andrew.friedmeyer@oa.mo.gov](mailto:andrew.friedmeyer@oa.mo.gov)

Contract Specialist: April Howser  
Division of Facilities Management, Design and Construction  
301 West High Street, Room 730  
Jefferson City, Missouri 65101  
Telephone: 573-751-0053  
Email: [april.howser@oa.mo.gov](mailto:april.howser@oa.mo.gov)

### **3.0 NOTICE: ALL BID MATERIALS ARE DUE AT THE TIME OF BID SUBMITTAL. THERE IS NO SECOND SUBMITTAL FOR THIS PROJECT.**

### **4.0 FURNISHING CONSTRUCTION DOCUMENTS:**

- A. The Owner will furnish the Contractor with approximately 5 complete sets of drawings and specifications at no charge.
- B. The Owner will furnish the Contractor with approximately 5 sets of explanatory or change drawings at no charge.
- C. The Contractor may make copies of the documents as needed with no additional cost to the Owner.


### **5.0 SAFETY REQUIREMENTS**

Contractor and subcontractors at any tier shall comply with RSMo 292.675 and Article 1.3, E, of Section 007213, General Conditions.

# Missouri

## Division of Labor Standards

### WAGE AND HOUR SECTION

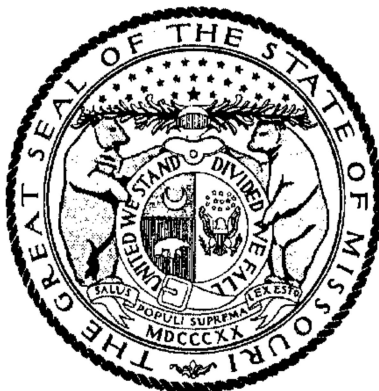

MIKE KEHOE, Governor

## Annual Wage Order No. 32

Section 026  
**COLE COUNTY**

In accordance with Section 290.262 RSMo 2000, within thirty (30) days after a certified copy of this Annual Wage Order has been filed with the Secretary of State as indicated below, any person who may be affected by this Annual Wage Order may object by filing an objection in triplicate with the Labor and Industrial Relations Commission, P.O. Box 599, Jefferson City, MO 65102-0599. Such objections must set forth in writing the specific grounds of objection. Each objection shall certify that a copy has been furnished to the Division of Labor Standards, P.O. Box 449, Jefferson City, MO 65102-0449 pursuant to 8 CSR 20-5.010(1). A certified copy of the Annual Wage Order has been filed with the Secretary of State of Missouri.

Original Signed by \_\_\_\_\_

Logan Hobbs, Director  
Division of Labor Standards

Filed With Secretary of State: \_\_\_\_\_ **March 10, 2025**

Last Date Objections May Be Filed: **April 9, 2025**

Prepared by Missouri Department of Labor and Industrial Relations

| OCCUPATIONAL TITLE           | **Prevailing<br>Hourly<br>Rate |
|------------------------------|--------------------------------|
| Asbestos Worker              | \$64.96                        |
| Boilermaker                  | \$32.28*                       |
| Bricklayer-Stone Mason       | \$32.28*                       |
| Carpenter                    | \$54.62                        |
| Lather                       |                                |
| Linoleum Layer               |                                |
| Millwright                   |                                |
| Pile Driver                  |                                |
| Cement Mason                 | \$32.28*                       |
| Plasterer                    |                                |
| Communication Technician     | \$61.08                        |
| Electrician (Inside Wireman) | \$61.85                        |
| Electrician Outside Lineman  | \$82.94                        |
| Lineman Operator             |                                |
| Lineman - Tree Trimmer       |                                |
| Groundman                    |                                |
| Groundman - Tree Trimmer     |                                |
| Elevator Constructor         | \$32.28*                       |
| Glazier                      | \$49.32                        |
| <b>Ironworker</b>            | <b>\$85.05</b>                 |
| Laborer                      | \$44.70                        |
| General Laborer              |                                |
| First Semi-Skilled           |                                |
| Second Semi-Skilled          |                                |
| Mason                        | \$62.12                        |
| Marble Mason                 |                                |
| Marble Finisher              |                                |
| Terrazzo Worker              |                                |
| Terrazzo Finisher            |                                |
| Tile Setter                  |                                |
| Tile Finisher                |                                |
| Operating Engineer           | \$68.28                        |
| Group I                      |                                |
| Group II                     |                                |
| Group III                    |                                |
| Group III-A                  |                                |
| Group IV                     |                                |
| Group V                      |                                |
| Painter                      | \$43.73                        |
| Plumber                      | \$73.50                        |
| Pipe Fitter                  |                                |
| Roofer                       | \$55.60                        |
| Sheet Metal Worker           | \$60.62                        |
| Sprinkler Fitter             | \$69.41                        |
| Truck Driver                 | \$32.28*                       |
| Truck Control Service Driver |                                |
| Group I                      |                                |
| Group II                     |                                |
| Group III                    |                                |
| Group IV                     |                                |

\*The Division of Labor Standards received fewer than 1,000 reportable hours for this occupational title. The public works contracting minimum wage is established for this occupational title using data provided by Missouri Economic Research and Information Center.

\*\*The Prevailing Hourly Rate includes any applicable fringe benefit amounts for each occupational title as defined in RSMo Section 290.210.

Heavy Construction Rates for  
COLE County

Section 026

| OCCUPATIONAL TITLE            | **Prevailing<br>Hourly<br>Rate |
|-------------------------------|--------------------------------|
| Carpenter                     | \$57.08                        |
| Millwright                    |                                |
| Pile Driver                   |                                |
| Electrician (Outside Lineman) | \$82.94                        |
| Lineman Operator              |                                |
| Lineman - Tree Trimmer        |                                |
| Groundman                     |                                |
| Groundman - Tree Trimmer      |                                |
| Laborer                       | \$52.43                        |
| General Laborer               |                                |
| Skilled Laborer               |                                |
| Operating Engineer            | \$69.38                        |
| Group I                       |                                |
| Group II                      |                                |
| Group III                     |                                |
| Group IV                      |                                |
| Truck Driver                  | \$32.28*                       |
| Truck Control Service Driver  |                                |
| Group I                       |                                |
| Group II                      |                                |
| Group III                     |                                |
| Group IV                      |                                |

Use Heavy Construction Rates on Highway and Heavy construction in accordance with the classifications of construction work established in 8 CSR 30-3.040(3).

Use Building Construction Rates on Building construction in accordance with the classifications of construction work established in 8 CSR 30-3.040(2).

If a worker is performing work on a heavy construction project within an occupational title that is not listed on the Heavy Construction Rate Sheet, use the rate for that occupational title as shown on the Building Construction Rate Sheet.

\*The Division of Labor Standards received fewer than 1,000 reportable hours for this occupational title. Public works contracting minimum wage is established for this occupational title using data provided by Missouri Economic Research and Information Center.

\*\*The Prevailing Hourly Rate includes any applicable fringe benefit amounts for each occupational title.

# OVERTIME and HOLIDAYS

## OVERTIME

For all work performed on a Sunday or a holiday, not less than twice (2x) the prevailing hourly rate of wages for work of a similar character in the locality in which the work is performed or the public works contracting minimum wage, whichever is applicable, shall be paid to all workers employed by or on behalf of any public body engaged in the construction of public works, exclusive of maintenance work.

For all overtime work performed, not less than one and one-half (1½) the prevailing hourly rate of wages for work of a similar character in the locality in which the work is performed or the public works contracting minimum wage, whichever is applicable, shall be paid to all workers employed by or on behalf of any public body engaged in the construction of public works, exclusive of maintenance work or contractual obligation. For purposes of this subdivision, **"overtime work"** shall include work that exceeds ten hours in one day and work in excess of forty hours in one calendar week; and

A thirty-minute lunch period on each calendar day shall be allowed for each worker on a public works project, provided that such time shall not be considered as time worked.

## HOLIDAYS

January first;  
The last Monday in May;  
July fourth;  
The first Monday in September;  
November eleventh;  
The fourth Thursday in November; and  
December twenty-fifth;

If any holiday falls on a Sunday, the following Monday shall be considered a holiday.

## SECTION 011000 – SUMMARY OF WORK

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and Division 1 Specification Sections apply to this Section.

#### 1.2 WORK COVERED BY CONTRACT DOCUMENTS

- A. The Project consists of **a custom bronze vestibule system.**
  - 1. Project Location: **201 W Capitol Ave, Jefferson City, MO 65101.**
  - 2. Owner: State of Missouri, Office of Administration, Division of Facilities Management, Design and Construction, Harry S Truman State Office Building, Post Office Box 809, 301 West High Street, Jefferson City, Missouri 65102.
- B. Contract Documents, dated **July 14, 2025** were prepared for the Project by **Treanor, 1811 Baltimore Ave, Kansas City MO 64108.**
- C. The Work consists of **the fabrication and installation of a custom bronze vestibule system inside the monumental bronze doors on the south portico of the Missouri State Capitol.**
  - 1. The Work includes: **Custom bronze vestibule system consisting of cast bronze components, including all sheets, plates, extruded shapes and castings, carbon steel structure and associated steel alloys, and a complete door system including all associated hardware. Installation of security glazing within the vestibule system. Replacement of historic stone pavers at the vestibule floor.**
- D. The Work will be constructed under a single prime contract.

#### 1.3 WORK SEQUENCE

- A. The Work will be conducted in **two (2) phases.**
  - 1. Phase 1: **Replacing the stone pavers inside the monumental bronze doors. Fabricating the vestibule system off-site.**
  - 2. Phase 2: **Installing the custom bronze vestibule system with security glazing and all other required electrical and access control components.**
- B. The Work shall be substantially complete, ready for occupancy within **240 days** of commencement of construction.

#### **1.4 CONTRACTOR USE OF PREMISES**

- A. General: During the construction period the Contractor shall have full use of the premises for construction operations, including use of the site. The Contractor's use of the premises limited only by the Owner's right to perform work or to retain other contractors on portions of the Project.
- B. Use of the Site: Limit use of the premises to work in areas indicated. Confine operations to areas within contract limits indicated. Do not disturb portions of the site beyond the areas in which the Work is indicated.
  - 1. Owner Occupancy: Allow for Owner occupancy and use by the public.
  - 2. Driveways and Entrances: Keep driveways and entrances serving the premises clear and available to the Owner, the Owner's employees, and emergency vehicles at all times. Do not use these areas for parking or storage of materials. Schedule deliveries to minimize space and time requirements for storage of materials and equipment on-site.
- C. Use of the Existing Building: Maintain the existing building in a weathertight condition throughout the construction period. Repair damage cause by construction operations. Take all precautions necessary to protect the building and its occupants during the construction period..

#### **1.5 OCCUPANCY REQUIREMENTS**

- A. Full Owner Occupancy: The Owner will occupy the site and existing building during the entire construction period. Cooperate with the Owner during construction operations to minimize conflicts and facilitate owner usage. Perform the Work so as not to interfere with the Owner's operations.

#### **1.6 OWNER-FURNISHED PRODUCTS**

- A. The Owner will furnish the security camera to be mounted on the vestibule. The Work includes providing support systems to receive Owner's equipment, and mechanical and electrical connections.
  - 1. The Owner will arrange for and deliver necessary shop drawings, product data, and samples to the Contractor.
  - 2. The Owner will arrange and pay for delivery of Owner-furnished items according to the contractor's Construction Schedule.
  - 3. The Contractor is responsible for receiving, unloading and handling Owner furnished items at the site.
  - 4. Following delivery, the Contractor will inspect items delivered for damage. The Contractor shall not accept damaged items and shall notify the Owner of rejection of damaged items.
  - 5. If Owner-furnished items are damaged, defective, or missing, the Owner will arrange for replacement.

6. The Owner will arrange for manufacturer's field services and for the delivery of manufacturer's warranties to the appropriate Contractor.
7. The Contractor shall designate delivery dates of Owner-furnished items in the Contractor's Construction Schedule.
8. The Contractor shall review shop drawings, product data and samples and return them to the Designer noting discrepancies or problems anticipated in use of the project.
9. The Contractor is responsible for protecting Owner-furnished items from damage, including damage from exposure to the elements. The Contractor shall repair or replace items damaged as a result of his operations.

**PART 2 - PRODUCTS (Not Applicable)**

**PART 3 - EXECUTION (Not Applicable)**

**END OF SECTION 011000**

## **SECTION 012100 – ALLOWANCES**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes administrative and procedural requirements governing allowances.
- B. Types of allowances include the following:
  - 1. Weather Allowances.
  - 2. Facility Interruption Allowances.
- C. Related Sections include the following:
  - 1. Division 1 Section "Contract Modification Procedures" for procedures for submitting and handling Change Orders for allowances.

#### **1.3 WEATHER ALLOWANCE**

- A. Included within the completion period for this project are a specified number of “bad weather” days (see Schedule of Allowances).
- B. The Contractor’s progress schedule shall clearly indicate the bad weather day allowance as an “activity” or “activities”. In the event weather conditions preclude performance of critical work activities for 50% or more of the Contractor’s scheduled workday, that day shall be declared unavailable for work due to weather (a “bad weather” day) and charged against the above allowance. Critical work activities will be determined by review of the Contractor’s current progress schedule.
- C. The Contractor’s Representative and the Construction Representative shall agree monthly on the number of “bad weather” days to be charged against the allowance. This determination will be documented in writing and be signed by the Contractor and the Construction Representatives. If there is a failure to agree on all or part of the “bad weather” days for a particular month, that disagreement shall be noted on this written document and signed by each party’s representative. Failure of the Contractor’s representative to sign the “bad weather” day documentation after it is presented, with or without the notes of disagreement, shall constitute agreement with the “bad weather” day determination contained in that document.
- D. There will be no modification to the time of contract performance due solely to the failure to deplete the “bad weather” day allowance.

- E. Once this allowance is depleted, a no-cost Change Order time extension will be executed for “bad weather” days, as defined above, encountered during the remainder of the Project.

#### **1.4 FACILITY INTERRUPTION ALLOWANCE**

- A. Included within the completion period for this project are a specified number of “Facility Interruption” days (see Schedule of Allowances).
- B. The Contractor’s progress schedule shall clearly indicate the facility interruption day allowance as an “activity” or “activities”. In the event facility interruptions preclude performance of critical work activities for 50% or more of the Contractor’s scheduled workday, that day shall be declared unavailable for work due to facility interruption and charged against the above allowance. Critical work activities will be determined by review of the Contractor’s current progress schedule.
- C. The Contractor’s Representative and the Construction Representative shall agree monthly on the number of “facility interruption” days to be charged against the allowance. This determination will be documented in writing and be signed by the Contractor and the Construction Representatives. If there is a failure to agree on all or part of the “facility interruption” days for a particular month, that disagreement shall be noted on this written document and signed by each party’s representative. Failure of the Contractor’s representative to sign the “facility interruption” day documentation after it is presented, with or without the notes of disagreement, shall constitute agreement with the “facility interruption” day determination contained in that document.
- D. There will be no modification to the time of contract performance due solely to the failure to deplete the “facility interruption” day allowance.
- E. Once this allowance is depleted, a no cost Change Order time extension will be executed for “facility interruption days” days, as defined above, encountered during the remainder of the Project.

#### **1.5 SUBMITTALS**

- A. Coordinate and process submittals for allowance items in same manner as for other portions of the Work.

#### **1.6 COORDINATION**

- A. Coordinate allowance items with other portions of the Work. Furnish templates as required to coordinate installation.

**PART 2 - PRODUCTS (Not Used)**

**PART 3 - EXECUTION**

**3.1 EXAMINATION**

- A. Examine products covered by an allowance promptly on delivery for damage or defects. Return damaged or defective products to manufacturer for replacement.

**3.2 PREPARATION**

- A. Coordinate materials and their installation for each allowance with related materials and installations to ensure that each allowance item is completely integrated and interfaced with related work.

**3.3 SCHEDULE OF ALLOWANCES**

- A. Weather Allowance: Included within the completion period for this Project, 5 “bad weather” days.
- B. Facility Interruption: Included within the completion period for this Project, 10 “facility interruption” days.

**END OF SECTION 012100**

## **SECTION 012600 – CONTRACT MODIFICATION PROCEDURES**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section specifies administrative and procedural requirements for handling and processing Contract Modifications.
- B. Related Sections include the following:
  - 1. Division 1, Section 012100 "Allowances" for procedural requirements for handling and processing Allowances.
  - 2. Division 1, Section 013115 "Project Management Communications" for administrative requirements for communications.
  - 3. Division 0, Section 007213, Article 3.1 "Acceptable Substitutions" for administrative procedures for handling Requests for Substitutions made after Contract award.
  - 4. Division 0, Section 007213, Article 4.0 "Changes in the Work" for Change Order requirements.

#### **1.3 REQUESTS FOR INFORMATION**

- A. In the event that the Contractor or Subcontractor, at any tier, determines that some portion of the Drawings, Specifications, or other Contract Documents requires clarification or interpretation, the Contractor shall submit a "Request for Information" (RFI) in writing to the Designer. A RFI may only be submitted by the Contractor and shall only be submitted on the RFI forms provided by the Owner. The Contractor shall clearly and concisely set forth the issue for which clarification or interpretation is sought and why a response is needed. In the RFI, the Contractor shall set forth an interpretation or understanding of the requirement along with reasons why such an understanding was reached.
- B. Responses to RFI shall be issued within ten (10) working days of receipt of the Request from the Contractor unless the Designer determines that a longer time is necessary to provide an adequate response. If a longer time is determined necessary by the Designer, the Designer will, within five (5) working days of receipt of the request, notify the Contractor of the anticipated response time. If the Contractor submits a RFI on a time sensitive activity on the current project schedule, the Contractor shall not be entitled to any

time extension due to the time it takes the Designer to respond to the request provided that the Designer responds within the ten (10) working days set forth above.

- C. Responses from the Designer will not change any requirement of the Contract Documents. In the event the Contractor believes that a response to a RFI will cause a change to the requirements of the Contract Document, the Contractor shall give written notice to the Designer requesting a Change Order for the work. Failure to give such written notice within ten (10) working days, shall waive the Contractor's right to seek additional time or cost under Article 4, "Changes in the Work" of the General Conditions.

#### **1.4 MINOR CHANGES IN THE WORK**

- A. Designer will issue supplemental instructions authorizing Minor Changes in the Work, not involving adjustment to the Contract Amount or the Contract Time, on "Designer's Supplemental Instructions" (DSI).

#### **1.5 PROPOSAL REQUESTS**

- A. The Designer or Owner Representative will issue a detailed description of proposed Changes in the Work that may require adjustment to the Contract Amount or the Contract Time. The proposed Change Description will be issued using the "Request for Proposal" (RFP) form. If necessary, the description will include supplemental or revised Drawings and Specifications.
  - 1. Proposal Requests issued by the Designer or Owner Representative are for information only. Do not consider them instructions either to stop work in progress or to execute the proposed change.
  - 2. Within ten (10) working days after receipt of Proposal Request, submit a proposal for the cost adjustments to the Contract Amount and the Contract Time necessary to execute the Change. The Contractor shall submit his proposal on the appropriate Change Order Detailed Breakdown form. Subcontractors may use the appropriate Change Order Detailed Breakdown form or submit their proposal on their letterhead provided the same level of detail is included. All proposals shall include:
    - a. A detailed breakdown of costs per Article 4.1 of the General Conditions.
    - b. If requesting additional time per Article 4.2 of the General Conditions, include an updated Contractor's Construction Schedule that indicates the effect of the Change including, but not limited to, changes in activity duration, start and finish times, and activity relationship.

#### **1.6 CHANGE ORDER PROCEDURES**

- A. On Owner's approval of a Proposal Request, the Designer or Owner Representative will issue a Change Order for signatures of Owner and Contractor on the "Change Order" form.

Treanor  
July 14, 2025

O2203-02 | HP1075.2101.00  
Missouri Capitol Bronze Doors - Vestibule

**PART 2 - PRODUCTS (Not Used)**

**PART 3 - EXECUTION (Not Used)**

**END OF SECTION 012600**

## **SECTION 013100 – COORDINATION**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes administrative provisions for coordinating construction operations on Projects including, but not limited to, the following:
  - 1. Coordination Drawings.
  - 2. Administrative and supervisory personnel.
  - 3. Project meetings.
- B. Each Contractor shall participate in coordination requirements. Certain areas of responsibility will be assigned to a specific Contractor.
- C. Related Sections include the following:
  - 1. Division 1, Section 013200 "Schedules" for preparing and submitting Contractor's Construction Schedule.
  - 2. Articles 1.8.B and 1.8.C of Section 007213 "General Conditions" for coordinating meetings onsite.
  - 3. Article 5.4.H of Section 007213 "General Conditions" for coordinating Closeout of the Contract.

#### **1.3 COORDINATION**

- A. Coordination: Coordinate construction operations included in different Sections of the Specifications to ensure efficient and orderly installation of each part of the Work. Coordinate construction operations included in different Sections, which depend on each other for proper installation, connection, and operation.
- B. Coordination: Each Contractor shall coordinate its construction operations with those of other contractors and entities to ensure efficient and orderly installation of each part of the Work. Each Contractor shall coordinate its operations with operations included in different Sections that depend on each other for proper installation, connection, and operation.
  - 1. Schedule construction operations in sequence required to obtain the best results where installation of one part of the Work depends on installation of other components, before or after its own installation.
  - 2. Coordinate installation of different components with other Contractors to ensure maximum accessibility for required maintenance, service, and repair.

3. Make adequate provisions to accommodate items scheduled for later installation.
  4. Where availability of space is limited, coordinate installation of different components to ensure maximum performance and accessibility for required maintenance, service, and repair of all components including mechanical and electrical.
- C. Prepare memoranda for distribution to each party involved outlining special procedures required for coordination. Include such items as required notices, reports, and list of attendees at meetings.
1. Prepare similar memoranda for Owner and separate Contractors if coordination of their Work is required.
- D. Administrative Procedures: Coordinate scheduling and timing of required administrative procedures with other construction activities and activities of other Contractors to avoid conflicts and to ensure orderly progress of the Work. Such administrative activities include, but are not limited to, the following:
1. Preparation of Contractor's Construction Schedule.
  2. Preparation of the Schedule of Values.
  3. Installation and removal of temporary facilities and controls.
  4. Delivery and processing of submittals.
  5. Progress meetings.
  6. Preinstallation conferences.
  7. Startup and adjustment of systems.
  8. Project Closeout activities.
- E. Conservation: Coordinate construction activities to ensure that operations are carried out with consideration given to conservation of energy, water, and materials.
1. Salvage materials and equipment involved in performance of, but not actually incorporated into, the Work. Refer to other Sections for disposition of salvaged materials that are designated as Owner's property.

#### **1.4 SUBMITTALS**

- A. Coordination Drawings: Prepare Coordination Drawings if limited space availability necessitates maximum utilization of space for efficient installation of different components or if coordination is required for installation of products and materials fabricated by separate entities.
- B. Key Personnel Names: Within fifteen (15) work days of starting construction operations, submit a list of key personnel assignments including superintendent and other personnel in attendance at Project site. Identify individuals and their duties and responsibilities; list addresses and telephone numbers including home and office telephone numbers. Provide names, addresses, and telephone numbers of individuals assigned as standbys in the absence of individuals assigned to Project.

1. Post copies of list in Project meeting room, in temporary field office, and by each temporary telephone. Keep list current at all times.

## **1.5 PROJECT MEETINGS**

- A. The Owner's Construction Representative will schedule a Pre-Construction Meeting prior to beginning of construction. The date, time, and exact place of this meeting will be determined after Contract Award and notification of all interested parties. The Contractor shall arrange to have the Job Superintendent and all prime Subcontractors present at the meeting. During the Pre-Construction Meeting, the construction procedures and information necessary for submitting payment requests will be discussed and materials distributed along with any other pertinent information.
  1. Minutes: Designer will record and distribute meeting minutes.
- B. Progress Meetings: The Owner's Construction Representative will conduct Monthly Progress Meetings as stated in Articles 1.8.B and 1.8.C of Section 007213 "General Conditions".
  1. Minutes: Designer will record and distribute to Contractor the meeting minutes.
- C. Preinstallation Conferences: Contractor shall conduct a preinstallation conference at Project site before each construction activity that requires coordination with other construction.
  1. Attendees: Installer and representatives of Manufacturers and Fabricators involved in or affected by the installation and its coordination or integration with other materials and installations that have preceded or will follow, shall attend the meeting. Advise Designer and Construction Representative of scheduled meeting dates.
  2. Agenda: Review progress of other construction activities and preparations for the particular activity under consideration including requirements for the following:
    - a. Contract Documents
    - b. Options
    - c. Related RFIs
    - d. Related Change Orders
    - e. Purchases
    - f. Deliveries
    - g. Submittals
    - h. Review of mockups
    - i. Possible conflicts
    - j. Compatibility problems
    - k. Time schedules
    - l. Weather limitations

- m. Manufacturer's written recommendations
  - n. Warranty requirements
  - o. Compatibility of materials
  - p. Acceptability of substrates
  - q. Temporary facilities and controls
  - r. Space and access limitations
  - s. Regulations of authorities having jurisdiction
  - t. Testing and inspecting requirements
  - u. Installation procedures
  - v. Coordination with other Work
  - w. Required performance results
  - x. Protection of adjacent Work
  - y. Protection of construction and personnel
- 3. Contractor shall record significant conference discussions, agreements, and disagreements including required corrective measures and actions.
  - 4. Reporting: Distribute minutes of the meeting to each party present and to parties who should have been present.
  - 5. Do not proceed with installation if the conference cannot be successfully concluded. Initiate whatever actions are necessary to resolve impediments to performance of the Work and reconvene the conference at earliest feasible date.
  - 6. Revise paragraph below if Project requires holding progress meetings at different intervals. Insert special intervals such as "every third Tuesday" to suit special circumstances.
  - 7. Project name
  - 8. Name and address of Contractor
  - 9. Name and address of Designer
  - 10. RFI number including RFIs that were dropped and not submitted
  - 11. RFI description
  - 12. Date the RFI was submitted
  - 13. Date Designer's response was received
  - 14. Identification of related DSI or Proposal Request, as appropriate

Treanor  
July 14, 2025

O2203-02 | HP1075.2101.00  
Missouri Capitol Bronze Doors - Vestibule

**PART 2 - PRODUCTS (Not Used)**

**PART 3 - EXECUTION (Not Used)**

**END OF SECTION 013100**

## **SECTION 013115 - PROJECT MANAGEMENT COMMUNICATIONS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.
- B. Division 1, Section 013300 - Submittals
- C. Division 1, Section 012600 – Contract Modification Procedures

#### **1.2 SUMMARY**

- A. Project Management Communications: The Contractor shall use the Internet web-based project management communications tool, Trimble Unity Construct<sup>®</sup> (Formerly eBuilder) ASP software, and protocols included in that software during this project. The use of project management communications as herein described does not replace or change any contractual responsibilities of the participants.
  - 1. Project management communications is available through Trimble Unity Construct<sup>®</sup> (Formerly eBuilder) as provided by "Trimble Unity Construct<sup>®</sup>" in the form and manner required by the Owner.
  - 2. The project communications database is on-line and fully functional. User registration, electronic and computer equipment, and Internet connections are the responsibility of each project participant. The sharing of user accounts is prohibited
- B. Support: Trimble Unity Construct<sup>®</sup> (Formerly eBuilder) will provide on-going support through on-line help files.
- C. Copyrights and Ownership: Nothing in this specification or the subsequent communications supersedes the parties' obligations and rights for copyright or document ownership as established by the Contract Documents. The use of CAD/BIM files, processes or design information distributed in this system is intended only for the project specified herein.
- D. Purpose: The intent of using Trimble Unity Construct<sup>®</sup> (Formerly eBuilder) is to improve project work efforts by promoting timely initial communications and responses. Secondly, to reduce the number of paper documents while providing improved record keeping by creation of electronic document files
- E. Authorized Users: Access to the web site will be by individuals who are authorized users.

1. Individuals shall complete the Trimble Unity Construct (Formerly eBuilder) New Company/User Request Form located at the following web site: <https://oa.mo.gov/facilities/vendor-links/contractor-forms>. Completed forms shall be emailed to the following email address: [OA.FMDCE-BuilderSupport@oa.mo.gov](mailto:OA.FMDCE-BuilderSupport@oa.mo.gov).
  2. Authorized users will be contacted directly and assigned a temporary user password.
  3. Individuals shall be responsible for the proper use of their passwords and access to data as agents of the company in which they are employed.
- F. Administrative Users: Administrative users have access and control of user licenses and all posted items. DO NOT POST PRIVATE OR YOUR COMPANY CONFIDENTIAL ITEMS IN THE DATABASE! Improper or abusive language toward any party or repeated posting of items intended to deceive or disrupt the work of the project will not be tolerated and will result in deletion of the offensive items and revocation of user license at the sole discretion of the Administrative User(s).
- G. Communications: The use of fax, email and courier communication for this project is discouraged in favor of using Trimble Unity Construct® (Formerly eBuilder) to send messages. Communication functions are as follows:
1. Document Integrity and Revisions:
    - a. Documents, comments, drawings and other records posted to the system shall remain for the project record. The authorship time and date shall be recorded for each document submitted to the system. Submitting a new document or record with a unique ID, authorship, and time stamp shall be the method used to make modifications or corrections.
    - b. The system shall make it easy to identify revised or superseded documents and their predecessors.
    - c. Server or Client-side software enhancements during the life of the project shall not alter or restrict the content of data published by the system. System upgrades shall not affect access to older documents or software.
  2. Document Security:
    - a. The system shall provide a method for communication of documents. Documents shall allow security group assignment to respect the contractual parties communication except for Administrative Users. DO NOT POST PRIVATE OR YOUR COMPANY CONFIDENTIAL ITEMS IN THE DATABASE!
  3. Document Integration:
    - a. Documents of various types shall be logically related to one another and discoverable. For example, requests for information, daily field reports, supplemental sketches and photographs shall be capable of reference as related records.
  4. Reporting:
    - a. The system shall be capable of generating reports for work in progress, and logs for each document type. Summary reports generated by the system shall be available for team members.
  5. Notifications and Distribution:

- a. Document distribution to project members shall be accomplished both within the extranet system and via email as appropriate. Project document distribution to parties outside of the project communication system shall be accomplished by secure email of outgoing documents and attachments, readable by a standard email client.
- 6. Required Document Types:
  - a. RFI, Request for Information.
  - b. Submittals, including record numbering by drawing and specification section.
  - c. Transmittals, including record of documents and materials delivered in hard copy.
  - d. Meeting Minutes.
  - e. Application for Payments (Draft or Pencil).
  - f. Review Comments.
  - g. Field Reports.
  - h. Construction Photographs.
  - i. Drawings.
  - j. Supplemental Sketches.
  - k. Schedules.
  - l. Specifications.
  - m. Request for Proposals
  - n. Designer's Supplemental Instructions
  - o. Punch Lists
- H. Record Keeping: Except for paper documents, which require original signatures and large format documents (greater than 8½ x 11 inches), all other 8½ x 11 inches documents shall be submitted by transmission in electronic form to the Trimble Unity Construct® (Formerly eBuilder) web site by licensed users.
  - a. The Owner and his representatives, the Designer and his consultants, and the Contractor and his Subcontractors and suppliers at every tier shall respond to documents received in electronic form on the web site and consider them as if received in paper document form.
  - b. The Owner and his representatives, the Designer and his consultants, and the Contractor and his Subcontractors and suppliers at every tier reserves the right to and shall reply or respond by transmissions in electronic form on the web site to documents actually received in paper document form.
  - c. The Owner and his representatives, the Designer and his consultants, and the Contractor and his Subcontractors and suppliers at every tier reserves the right to and shall copy any paper document into electronic form and make same available on the web site.
- I. Minimum Equipment and Internet Connection: In addition to other requirements specified in this Section, the Owner and his representatives, the Construction Manager and his representatives, the Architect and his consultants, and the Contractor and his sub-

contractors and suppliers at every tier required to have a user license(s) shall be responsible for the following:

1. Providing suitable computer systems for each licensed user at the users normal work location<sup>1</sup> with high-speed Internet access, i.e. DSL, local cable company's Internet connection, or T1 connection.
2. Each of the above referenced computer systems shall have the following minimum system<sup>2</sup> and software requirements:
  - a. Desktop configuration (Laptop configurations are similar and should be equal to or exceed desktop system.)
    - 1) Operating System: Windows XP or newer
    - 2) Internet Browser: Internet Explorer 6.01SP2+ (Recommend IE7.0+)
    - 3) Minimum Recommend Connection Speed: 256K or above
    - 4) Processor Speed: 1 Gigahertz and above
    - 5) RAM: 512 mb
    - 6) Operating system and software shall be properly licensed.
    - 7) Internet Explorer version 7 (current version is a free distribution for download). This specification is not intended to restrict the host server or client computers provided that industry standard HTTP clients may access the published content.
    - 8) Adobe Acrobat Reader (current version is a free distribution for download).
    - 9) Users should have the standard Microsoft Office Suite (current version must be purchased) or the equivalent.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION (Not Applicable.)

END OF SECTION 013115

---

<sup>1</sup> The normal work location is the place where the user is assigned for more than one-half of his time working on this project.

<sup>2</sup> The minimum system herein will not be sufficient for many tasks and may not be able to process all documents and files stored in the Trimble Unity Construct® (Formerly eBuilder) Documents area.

## **SECTION 013200 – SCHEDULES**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes requirements for a Bar Chart Schedule for the project construction activities, schedule of submittals, and schedule for testing.

### **PART 2 - PRODUCTS – (Not Applicable)**

### **PART 3 - EXECUTION**

#### **3.1 SUBMITTAL PROCEDURES**

- A. The Contractor shall submit to the Designer, within ten (10) working days following the Notice to Proceed, a Progress Schedule including Schedule of Values showing the rate of progress the Contractor agrees to maintain and the order in which he proposed to carry out the various phases of Work. No payments shall be made to the Contractor until the Progress Schedule has been approved by the Owner.
  - 1. The Schedule of Values must have the following line items included with the value of the item as indicated below:
    - a. O&M's (Owner's Manual)
      - 1) \$1,000,000.00 (One million) and under – 2% of the total contract amount
      - 2) Over \$1,000,000.00 (One million) – 1% of the total contract amount
    - b. Close Out Documents
      - 1) \$1,000,000.00 (One million) and under – 2% of the total contract amount
      - 2) Over \$1,000,000.00 (One million) – 1% of the total contract amount
    - c. General Conditions
      - 1) No more than 10%
- B. The Contractor shall submit an updated Schedule for presentation at each Monthly Progress Meeting. The Schedule shall be updated by the Contractor as necessary to reflect the

current Schedule and its relationship to the original Schedule. The updated Schedule shall reflect any changes in the logic, sequence, durations, or completion date. Payments to the Contractor shall be suspended if the Progress Schedule is not adequately updated to reflect actual conditions.

- C. The Contractor shall submit Progress Schedules to Subcontractors to permit coordinating their Progress Schedules to the general construction Work. The Contractor shall coordinate preparation and processing of Schedules and reports with performance of other construction activities.

### **3.2 CONSTRUCTION PROGRESS SCHEDULE – BAR CHART SCHEDULE**

- A. Bar-Chart Schedule: The Contractor shall prepare a comprehensive, fully developed, horizontal bar chart-type Contractor's Construction Schedule. The Contractor for general construction shall prepare the Construction Schedule for the entire Project. The Schedule shall show the percentage of work to be completed at any time, anticipated monthly payments by Owner, as well as significant dates (such as completion of excavation, concrete foundation work, underground lines, superstructure, rough-ins, enclosure, hanging of fixtures, etc.) which shall serve as check points to determine compliance with the approved Schedule. The Schedule shall also include an activity for the number of "bad" weather days specified in Section 012100 – Allowances.
  - 1. The Contractor shall provide a separate time bar for each significant construction activity. Provide a continuous vertical line to identify the first working day of each week.
    - a. If practical, use the same Schedule of Values breakdown for schedule time bars.
  - 2. The Contractor shall provide a base activity time bar showing duration for each construction activity. Each bar is to indicate start and completion dates for the activity. The Contractor is to place a contrasting bar below each original schedule activity time for indicating actual progress and planned remaining duration for the activity.
  - 3. The Contractor shall prepare the Schedule on a minimal number of separate sheets to readily show the data for the entire construction period.
  - 4. Secure time commitments for performing critical elements of the Work from parties involved. Coordinate each element on schedule with other construction activities. Include minor elements involved in the overall sequence of the Work. Show each activity in proper sequence. Indicate graphically the sequences necessary for completion of related portions of the Work.
  - 5. Coordinate the Contractor's Construction Schedule with the Schedule of Values, list of subcontracts, Submittal Schedule, progress reports, payment requests, and other required schedules and reports.
  - 6. Indicate the Intent to Award and the Contract Substantial Completion dates on the schedule.
- B. Phasing: Provide notations on the schedule to show how the sequence of the Work is affected by the following:

1. Requirement for Phased completion
  2. Work by separate Contractors
  3. Work by the Owner
  4. Pre-purchased materials
  5. Coordination with existing construction
  6. Limitations of continued occupancies
  7. Un-interruptible services
  8. Partial Occupancy prior to Substantial Completion
  9. Site restrictions
  10. Provisions for future construction
  11. Seasonal variations
  12. Environmental control
- C. Work Stages: Use crosshatched bars to indicate important stages of construction for each major portion of the Work. Such stages include, but are not necessarily limited to, the following:
1. Subcontract awards
  2. Submittals
  3. Purchases
  4. Mockups
  5. Fabrication
  6. Sample testing
  7. Deliveries
  8. Installation
  9. Testing
  10. Adjusting
  11. Curing
  12. Startup and placement into final use and operation
- D. Area Separations: Provide a separate time bar to identify each major area of construction for each major portion of the Work. For the purposes of this Article, a “major area” is a story of construction, a separate building, or a similar significant construction element.
1. Indicate where each construction activity within a major area must be sequenced or integrated with other construction activities to provide for the following:
    - a. Structural completion.
    - b. Permanent space enclosure

- c. Completion of mechanical installation
- d. Completion of the electrical portion of the Work
- e. Substantial Completion

### **3.3 SCHEDULE OF SUBMITTALS**

- A. Upon acceptance of the Construction Progress Schedule, prepare and submit a complete schedule of submittals. Coordinate the submittal schedule with Section 013300 SUBMITTALS, the approved Construction Progress Schedule, list of subcontracts, Schedule of Values and the list of products.
- B. Prepare the schedule in chronological order. Provide the following information
  - 1. Scheduled date for the first submittal
  - 2. Related Section number
  - 3. Submittal category
  - 4. Name of the Subcontractor
  - 5. Description of the part of the Work covered
  - 6. Scheduled date for resubmittal
  - 7. Scheduled date for the Designer's final release or approval
- C. Distribution: Following the Designer's response to the initial submittal schedule, print and distribute copies to the Designer, Owner, subcontractors, and other parties required to comply with submittal dates indicated.
  - 1. Post copies in the Project meeting room and temporary field office.
  - 2. When revisions are made, distribute to the same parties and post in the same locations. Delete parties from distribution when they have completed their assigned part of the Work and are no longer involved in construction activities.
- D. Schedule Updating: Revise the schedule after each meeting or other activity where revisions have been recognized or made. Issue the updated schedule concurrently with the report of each meeting.

### **3.4 SCHEDULE OF INSPECTIONS AND TESTS**

- A. Prepare a schedule of inspections, tests, and similar services required by the Contract Documents. Submit the schedule with (15) days of the date established for commencement of the Contract Work. The Contractor is to notify the testing agency at least (5) working days in advance of the required tests unless otherwise specified.
- B. Form: This schedule shall be in tabular form and shall include, but not be limited to, the following:
  - 1. Specification Section number
  - 2. Description of the test

3. Identification of applicable standards
  4. Identification of test methods
  5. Number of tests required
  6. Time schedule or time span for tests
  7. Entity responsible for performing tests
  8. Requirements for taking samples
  9. Unique characteristics of each service
- C. Distribution: Distribute the schedule to the Owner, Architect, and each party involved in performance of portions of the Work where inspections and tests are required.

**END OF SECTION 013200**

## **SECTION 013233 - PHOTOGRAPHIC DOCUMENTATION**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section includes administrative and procedural requirements for the following:
  - 1. Preconstruction photographs.
  - 2. Concealed Work photographs.
  - 3. Periodic construction photographs.
  - 4. Final Completion construction photographs.
  - 5. Preconstruction video recordings.
- B. Related Requirements:
  - 1. Section 024119 "Selective Demolition" for photographic documentation before selective demolition operations commence.

#### **1.3 INFORMATIONAL SUBMITTALS**

- A. Key Plan: Submit key plan of Project site and building with notation of vantage points marked for location and direction of each photograph and video recording. Indicate elevation or story of construction. Include same information as corresponding photographic documentation.
- B. Digital Photographs: Submit image files within three days of taking photographs.
  - 1. Submit photos on E-BUILDER, the State of Missouri's project management web portal. Include copy of key plan indicating each photograph's location and direction.
  - 2. Identification: Provide the following information with each image description in the file name, in the metadata tag, and/or in a description field in E-BUILDER:
    - a. Name of Project.
    - b. Name and contact information for photographer.
    - c. Name of Architect.
    - d. Name of General Contractor and applicable Sub-Contractor.
    - e. Date photograph was taken.
    - f. Description of location, vantage point, and direction.
    - g. Unique sequential identifier keyed to accompanying key plan.
- C. Video Recordings: Submit video recordings within seven days of recording.
  - 1. Submit video recordings on E-BUILDER, the State of Missouri's project management web portal . Include copy of key plan indicating each video's location and direction.

2. Identification: With each submittal, provide the following information in the file name, in the metadata tag, and/or in a description field in E-BUILDER:
  - a. Name of Project.
  - b. Name and address of photographer.
  - c. Name of Architect.
  - d. Name of General Contractor and applicable Sub-Contractor.
  - e. Date video recording was recorded.
  - f. Description of vantage point, indicating location, direction (by compass point), and elevation or story of construction.

#### **1.4 QUALITY ASSURANCE**

- A. Photographer Qualifications: An individual who has been regularly engaged as a professional photographer of construction projects for not less than three years.
- B. Videographer Qualifications: An individual who has been regularly engaged as a professional photographer of construction projects for not less than three years.

#### **1.5 FORMATS AND MEDIA**

- A. Digital Photographs: Provide color images in JPG format, produced by a digital camera with minimum sensor size of 12 megapixels, and at an image resolution of not less than 3200 x 2400 pixels. Use flash in low light levels or backlit conditions.
- B. Digital Video Recordings: Provide high-resolution, digital video in .MP4, .HEVC, .MOV or other common high-resolution format, produced by a digital camera with minimum sensor resolution of 12 megapixels and capable of recording in full high-definition mode with vibration and motion reduction technology. Provide supplemental lighting in low light levels or backlit conditions.
- C. Digital Images: Submit digital media as originally recorded in the digital camera, without alteration, manipulation, editing, or modifications using image-editing software.

#### **1.6 CONSTRUCTION PHOTOGRAPHS**

- A. Photographer: Engage a qualified photographer to take construction photographs.
- B. General: Take photographs with maximum depth of field and in focus.
  1. Maintain key plan with each set of construction photographs that identifies each photographic location.
- C. Preconstruction Photographs: Before commencement of the Work, take photographs of Project site and surrounding properties, including existing items to remain during construction, from different vantage points, as directed by Architect.
  1. Take 20 photographs to show existing conditions adjacent to the area of work and hauling routes before starting the Work.
  2. Take 20 photographs of existing conditions of vestibule location inside bi-fold bronze door, to accurately record physical conditions at start of construction.

3. Take additional photographs as required to record settlement or cracking of adjacent structures, flooring, or other locations.
- D. Periodic Construction Photographs: Take 20 photographs weekly coinciding with the cutoff date associated with the upcoming Application for Payment. Select vantage points to show status of construction and progress since last photographs were taken.
- E. Additional Photographs: Architect may request photographs in addition to periodic photographs specified. Additional photographs will be paid for by Change Order and are not included in the Contract Sum.
  1. Three days' notice will be given, where feasible.
  2. In emergency situations, take additional photographs within 24 hours of request.
  3. Circumstances that could require additional photographs include, but are not limited to, the following:
    - a. Special events planned at Project site.
    - b. Immediate follow-up when on-site events result in construction damage or losses.
    - c. Photographs shall be taken at fabrication locations away from Project site. These photographs are not subject to unit prices or unit-cost allowances.
    - d. Substantial Completion of a major phase or component of the Work.
    - e. Extra record photographs at time of final acceptance.
    - f. Owner's request for special publicity photographs.

## **1.7 CONSTRUCTION VIDEO RECORDINGS**

- A. Periodic Construction Video Recording: Take video recording weekly coinciding with the cutoff date associated with the upcoming Application for Payment. Select vantage points to show status of construction and progress since last video recording was taken.
- B. Time-Lapse Video: Provide time-lapse sequence video of the installation of the Vestibule and related components on site including any activities involving cranes and/or lifts hauling to and from the South Portico.

## **PART 2 - PRODUCTS (Not Used)**

## **PART 3 - EXECUTION (Not Used)**

## **END OF SECTION 013233**

## **SECTION 013300 – SUBMITTALS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.
- B. Division 1, Section 013115 “Project Management Communications” for administrative requirements for communications.

#### **1.2 SUMMARY**

- A. This Section includes administrative and procedural requirements for submittals required for performance of the Work including the following:
  - 1. Shop Drawings
  - 2. Product Data
  - 3. Samples
  - 4. Quality Assurance Submittals
  - 5. Construction Photographs
  - 6. Operating and Maintenance Manuals
  - 7. Warranties
- B. Administrative Submittals: Refer to General and Supplementary Conditions other applicable Division 1 Sections and other Contract Documents for requirements for administrative submittals. Such submittals include, but are not limited to, the following:
  - 1. Construction Progress Schedule including Schedule of Values
  - 2. Performance and Payment Bonds
  - 3. Insurance Certificates
  - 4. Applications for Payment
  - 5. Certified Payroll Reports
  - 6. Partial and Final Receipt of Payment and Release Forms
  - 7. Affidavit – Compliance with Prevailing Wage Law
  - 8. Record Drawings
  - 9. Notifications, Permits, etc.
- C. The Contractor is obliged and responsible to check all shop drawings and schedules to assure compliance with contract plans and specifications. The Contractor is responsible for the content of the shop drawings and coordination with other contract work. Shop

drawings and schedules shall indicate, in detail, all parts of an Item or Work including erection and setting instructions and integration with the Work of other trades.

- D. The Contractor shall at all times make a copy, of all approved submittals, available on site to the Construction Representative.

### **1.3 SUBMITTAL PROCEDURES**

- A. The Contractor shall comply with the General and Supplementary Conditions and other applicable sections of the Contract Documents. The Contractor shall submit, with such promptness as to cause no delay in his work or in that of any other contractors, all required submittals indicated in Part 3.1 of this section and elsewhere in the Contract Documents. Coordinate preparation and processing of submittals with performance of construction activities. Transmit each submittal sufficiently in advance of performance of related construction activities to avoid delay.
  - 1. Coordinate each submittal with fabrication, purchasing, testing, delivery, other submittals, and related activities that require sequential activity.
  - 2. Coordinate transmittal of different types of submittals for related elements of the Work so processing will not be delayed by the need to review submittals concurrently for coordination.
    - a. The Designer reserves the right to withhold action on a submittal requiring coordination with other submittals until all related submittals are received.
- B. Each drawing and/or series of drawings submitted must be accompanied by a letter of transmittal giving a list of the titles and numbers of the drawings. Each series shall be numbered consecutively for ready reference and each drawing shall be marked with the following information:
  - 1. Date of Submission
  - 2. Name of Project
  - 3. Location
  - 4. Section Number of Specification
  - 5. State Project Number
  - 6. Name of Submitting Contractor
  - 7. Name of Subcontractor
  - 8. Indicate if Item is submitted as specified or as a substitution

### **1.4 SHOP DRAWINGS**

- A. Comply with the General Conditions, Article 3.2.
- B. The Contractor shall submit newly prepared information drawn accurately to scale. Highlight, encircle, or otherwise indicate deviations from the Contract Documents. Do not reproduce Contract Documents or copy standard information as the basis of Shop

Drawings. Standard information prepared without specific reference to the Project is not a Shop Drawing.

- C. Shop Drawings include fabrication and installation drawings, setting diagrams, schedules, patterns, templates, and similar drawings including the following information:
  - 1. Dimensions
  - 2. Identification of products and materials included by sheet and detail number
  - 3. Compliance with specified standards
  - 4. Notation of coordination requirements
  - 5. Notation of dimensions established by field measurement
  - 6. Sheet Size: Except for templates, patterns and similar full-size Drawings, submit Shop Drawings on sheets at least 8½"x11" but no larger than 36"x48".

## **1.5 PRODUCT DATA**

- A. The Contractor shall comply with the General Conditions, Article 3.2.
- B. The Contractor shall collect Product Data into a single submittal for each element of construction or system. Product Data includes printed information, such as manufacturer's installation instructions, catalog cuts, standard color charts, roughing-in diagrams and templates, standard wiring diagrams, and performance curves.
  - 1. Mark each copy to show applicable choices and options. Where printed Product Data includes information on several products that are not required, mark copies to indicate the applicable information including the following information:
    - a. Manufacturer's printed recommendations
    - b. Compliance with Trade Association standards
    - c. Compliance with recognized Testing Agency standards
    - d. Application of Testing Agency labels and seals
    - e. Notation of dimensions verified by field measurement
    - f. Notation of coordination requirements
  - 2. Do not submit Product Data until compliance with requirements of the Contract Documents has been confirmed.

## **1.6 SAMPLES**

- A. The Contractor shall comply with the General Conditions, Article 3.2.
- B. The Contractor shall submit full-size, fully fabricated samples, cured and finished as specified, and physically identical with the material or product proposed. Samples include partial sections of manufactured or fabricated components, cuts or containers of materials, color range sets, and swatches showing color, texture, and pattern.

1. The Contractor shall mount or display samples in the manner to facilitate review of qualities indicated. Prepare samples to match the Designer's sample including the following:
  - a. Specification Section number and reference
  - b. Generic description of the Sample
  - c. Sample source
  - d. Product name or name of the Manufacturer
  - e. Compliance with recognized standards
  - f. Availability and delivery time
2. The Contractor shall submit samples for review of size, kind, color, pattern, and texture. Submit samples for a final check of these characteristics with other elements and a comparison of these characteristics between the final submittal and the actual component as delivered and installed.
  - a. Where variation in color, pattern, texture, or other characteristic is inherent in the material or product represented, submit at least three (3) multiple units that show approximate limits of the variations.
  - b. Refer to other Specification Sections for requirements for samples that illustrate workmanship, fabrication techniques, details of assembly, connections, operation, and similar construction characteristics.
  - c. Refer to other Sections for samples to be returned to the Contractor for incorporation in the Work. Such samples must be undamaged at time of use. On the transmittal, indicate special requests regarding disposition of sample submittals.
  - d. Samples not incorporated into the Work, or otherwise designated as the Owner's property, are the property of the Contractor and shall be removed from the site prior to Substantial Completion.
3. Field samples are full-size examples erected onsite to illustrate finishes, coatings, or finish materials and to establish the Project standard.
  - a. The Contractor shall comply with submittal requirements to the fullest extent possible. The Contractor shall process transmittal forms to provide a record of activity.

## **1.7 QUALITY ASSURANCE DOCUMENTS**

- A. The Contractor shall comply with the General Conditions, Article 3.2
- B. The Contractor shall submit quality control submittals including design data, certifications, manufacturer's instructions, manufacturer's field reports, and other quality-control submittals as required under other Sections of the Specifications.
- C. Certifications: Where other Sections of the Specifications require certification that a product, material, or installation complies with specified requirements, submit a notarized certification from the Manufacturer certifying compliance with specified requirements.

1. Signature: Certification shall be signed by an officer of the Manufacturer or other individual authorized to contractually bind the Company.
- D. Inspection and Test Reports: The Contractor shall submit the required inspection and test reports from independent testing agencies as specified in this Section and in other Sections of the Contract Documents.
- E. Construction Photographs: The Contractor shall submit record construction photographs as specified in this Section and in other Sections of the Contract Documents.
  1. The Contractor shall submit digital photographs. The Construction Administrator shall determine the quantity and naming convention at the preconstruction meeting.
  2. The Contractor shall identify each photograph with project name, location, number, date, time, and orientation.
  3. The Contractor shall submit progress photographs monthly unless specified otherwise. Photographs shall be taken one (1) week prior to submitting.
  4. The Contractor shall take four (4) site photographs from differing directions and a minimum of five (5) interior photographs indicating the relative progress of the Work.

## 1.8 OPERATING AND MAINTENANCE MANUALS AND WARRANTIES

- A. The Contractor shall submit all required manufacturer's operating instructions, maintenance/service manuals, and warranties in accordance with the General Conditions, Article 3.5, and Supplementary Conditions along with this and other Sections of the Contract Documents.

## PART 2 - PRODUCTS (Not Applicable)

## PART 3 - EXECUTION

### 3.1 REQUIRED SUBMITTALS

- A. Contractor shall submit the following information for materials and equipment to be provided under this contract:

| <u>SECTION</u> | <u>TITLE</u>                          | <u>CATEGORY</u>          |
|----------------|---------------------------------------|--------------------------|
| 013200         | Schedules                             | Construction Schedule    |
| 013200         | Schedules                             | Schedule of Values       |
| 013200         | Schedules                             | List of Subcontractors   |
| 013200         | Schedules                             | Major Material Suppliers |
| 013233         | Photographic Documentation            | Shop Drawings            |
| 013233         | Photographic Documentation            | Mock up                  |
| 013233         | Photographic Documentation            | Mock up                  |
| 013515.10      | Site Security and Health Requirements | List of Subcontractors   |
| 013591         | Historic Treatment Procedures         | Product Data             |

|        |                                              |                                |
|--------|----------------------------------------------|--------------------------------|
| 013591 | Historic Treatment Procedures                | Construction Schedule          |
| 013591 | Historic Treatment Procedures                | Shop Drawings                  |
| 017900 | Demonstration and Training                   | Operation / Maintenance Manual |
| 040342 | Treatment of Historic Stone Masonry Flooring | Product Data                   |
| 040342 | Treatment of Historic Stone Masonry Flooring | Shop Drawings                  |
| 040342 | Treatment of Historic Stone Masonry Flooring | Sample                         |
| 057001 | Custom Bronze Vestibule                      | Certification                  |
| 057001 | Custom Bronze Vestibule                      | Product Data                   |
| 057001 | Custom Bronze Vestibule                      | Shop Drawings                  |
| 057001 | Custom Bronze Vestibule                      | Construction Schedule          |
| 057001 | Custom Bronze Vestibule                      | Sample                         |
| 079200 | Joint Sealants                               | Product Data                   |
| 079200 | Joint Sealants                               | Sample                         |
| 088853 | Security Glazing                             | Product Data                   |
| 088853 | Security Glazing                             | Shop Drawings                  |
| 088853 | Security Glazing                             | Sample                         |

**END OF SECTION 013300**

## **SECTION 013513.10 - SITE SECURITY AND HEALTH REQUIREMENTS (OA)**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes general Institution rules.
- B. This Section includes requirements for environments that employees are domiciled in, or public participation in program activities in or adjacent to the Scope of Work area:
  - 1. The Contractor shall have the applicable measures specified below in-place any time demolition or construction activities occur in occupied or non-occupied project work areas.
  - 2. The Contractor shall complete all specified cleaning procedures and receive clearance from the Construction Representative prior to removing any barriers and other precautionary measures – even for areas that the employees or public do not occupy during construction.

#### **1.3 SUBMITTALS**

- A. List of required submittals:
  - 1. Materials Safety Data Sheets for all hazardous materials to be brought onsite.
  - 2. Schedule of proposed shutdowns, if applicable.
  - 3. A list of the names of all employees who will submit fingerprints for a background check, and the signed privacy documents identified below for each employee.

### **PART 2 - PRODUCTS (Not Applicable)**

### **PART 3 - EXECUTION**

#### **3.1 ACCESS TO THE SITE**

- A. The Contractor shall arrange with Facility Representatives to establish procedures for the controlled entry of workers and materials into the work areas at the Facility.
- B. The Contractor shall establish regular working hours with Facility Representatives. The Contractor must report changes in working hours or overtime to Facility Representatives and

obtain approval twenty-four (24) hours ahead of time. The Contractor shall report emergency overtime to Facility Representatives as soon as it is evident that overtime is needed. The Contractor must obtain approval from Facility Representatives for all work performed after dark.

- C. The Contractor shall provide the name and phone number of the Contractor's employee or agent who is in charge onsite; this individual must be able to be contacted in case of emergency. The Contractor must be able to furnish names and address of all employees upon request.
- D. All construction personnel shall visibly display issued identification badges.

### **3.2 FIRE PROTECTION, SAFETY, AND HEALTH CONTROLS**

- A. The Contractor shall take all necessary precautions to guard against and eliminate possible fire hazards.
  - 1. Onsite burning is prohibited.
  - 2. The Contractor shall store all flammable or hazardous materials in proper containers located outside the buildings or offsite, if possible.
  - 3. The Contractor shall provide and maintain, in good order, during construction fire extinguishers as required by the National Fire Protection Association. In areas of flammable liquids, asphalt, or electrical hazards, 15-pound carbon dioxide or 20-pound dry chemical extinguishers shall be provided.
- B. The Contractor shall not obstruct streets or walks without permission from the Owner's Construction Representative and Facility Representatives.
- C. The Contractor's personnel shall not exceed the speed limit of 15 mph while at the Facility unless otherwise posted.
- D. The Contractor shall take all necessary, reasonable measures to reduce air and water pollution by any material or equipment used during construction. The Contractor shall keep volatile wastes in covered containers and shall not dispose of volatile wastes or oils in storm or sanitary drains.
- E. The Contractor shall keep the project site neat, orderly, and in a safe condition at all times. The Contractor shall immediately remove all hazardous waste and shall not allow rubbish to accumulate. The Contractor shall provide onsite containers for collection of rubbish and shall dispose of it at frequent intervals during the progress of the Work.
- F. Fire exits, alarm systems, and sprinkler systems shall remain fully operational at all times, unless written approval is received from the Owner's Construction Representative and the appropriate Facility Representative at least twenty-four (24) hours in advance. The Contractor shall submit a written time schedule for any proposed shutdowns.
- G. For all hazardous materials brought onsite, Material Safety Data Sheets shall be on site and readily available upon request at least a day before delivery.

- H. Alcoholic beverages or illegal substances shall not be brought upon the Facility premises. The Contractor's workers shall not be under the influence of any intoxicating substances while on the Facility premises.

### **3.3 SECURITY CLEARANCES AND RESTRICTIONS**

#### **A. FMDC CONTRACTOR BACKGROUND AND ID BADGE PROCESS**

1. All employees of the Contractor are required to submit fingerprints to the Missouri State Highway Patrol to enable the Office of Administration, Division of Facilities Management, Design and Construction (FMDC) to receive state and national criminal background checks on such employees. FMDC reserves the right to prohibit any employee of the Contractor from performing work in or on the premises of any facility owned, operated, or utilized by the State of Missouri for any reason.
2. The Contractor shall ensure all of its employees submit fingerprints to the Missouri State Highway Patrol and pay for the cost of such background checks. The Contractor shall submit to FMDC via email to [FMDCSecurity@oa.mo.gov](mailto:FMDCSecurity@oa.mo.gov) a list of the names of the Contractor's employees who will be fingerprinted and a signed Missouri Applicant Fingerprint Privacy Notice, Authorization For Release Of Information Confidentiality Oath and State Identification Badge Agreement for each employee. All employees of the Contractor approved by FMDC to work at a State facility must obtain a contractor ID badge from FMDC prior to beginning work on-site, unless the Director of FMDC, at the Director's discretion, waives the requirement for a contractor ID badge. The Contractor and its employees must comply with the process for background checks and contractor ID badges found on FMDC's website at: <https://oa.mo.gov/fmdc-contractor-id-badges>.
3. Pursuant to section 43.540, RSMo, FMDC participates in the Missouri Rap Back and National Rap Back programs as of August 28, 2018. This means that the Missouri State Highway Patrol, Central Records Repository, and the Federal Bureau of Investigation will retain the fingerprints submitted by each of the Contractor's employees, and those fingerprints will be searched against other fingerprints on file, including latent fingerprints. While retained, an employee's fingerprints may continue to be compared against other fingerprints submitted or retained by the Federal Bureau of Investigation, including latent fingerprints.
4. As part of the Missouri and National Rap Back programs, FMDC will receive notification if a new arrest is reported for an employee whose fingerprints have been submitted for FMDC after August 28, 2018. If the employee is performing work on a State contract at the time of the arrest notification, FMDC will request and receive the employee's updated criminal history records. If the employee is no longer performing work on a State contract, FMDC will not obtain updated criminal records.
5. Pursuant to section 43.540, RSMo, the Missouri State Highway Patrol will provide the results of the employee's background check directly to FMDC. FMDC may NOT release the results of a background check to the Contractor or provide the Contractor any information obtained from a background check, either verbally or in writing. FMDC will notify the Contractor only whether an employee is approved to work on State property.
6. Each employee who submits fingerprints to the Missouri State Highway Patrol has a right to obtain a copy of the results of his or her background check. The employee may challenge the accuracy and completeness of the information contained in a background check report and obtain a determination from the Missouri State Highway Patrol and/or

- the FBI regarding the validity of such challenge prior to FMDC making a final decision about his or her eligibility to perform work under a State contract.
7. The Contractor shall notify FMDC via email to [FMDCSecurity@oa.mo.gov](mailto:FMDCSecurity@oa.mo.gov) if an employee is terminated or resigns from employment with the Contractor. If the Contractor does not anticipate performing work on a State contract in the future, the Contractor may request that FMDC remove its employees from the Rap Back programs. However, if removed from the Rap Back programs, employees will be required to submit new fingerprints should the contractor be awarded another State contract.
  8. Upon award of a Contract, the Contractor should contact FMDC at [FMDCSecurity@oa.mo.gov](mailto:FMDCSecurity@oa.mo.gov) to determine if its employees need to provide a new background check. If a Contractor's employee has previously submitted a fingerprint background check to FMDC as part of the Missouri and National Rap Back programs, the employee may not need to submit another fingerprint search for a period of three to six years, depending upon the circumstances. The Contractor understands and agrees that FMDC may require more frequent background checks without providing any explanation to the Contractor. The fact that an additional background check is requested by FMDC does not indicate that the employee has a criminal record.

### **3.4 DISRUPTION OF UTILITIES**

- A. The Contractor shall give a minimum of seventy-two (72) hours written notice to the Construction Representative and the Facility Representative before disconnecting electric, gas, water, fire protection, or sewer service to any building.
- B. The Contractor shall give a minimum of seventy-two (72) hours written notice to the Construction Representative and Facility Representative before closing any access drives, and shall make temporary access available, if possible. The Contractor shall not obstruct streets, walks, or parking.

### **3.5 PROTECTION OF PERSONS AND PROPERTY**

#### **A. SAFETY PRECAUTIONS AND PROGRAMS**

1. The Contractor shall at all times conduct operations under this Contract in a manner to avoid the risk of bodily harm to persons or risk of damage to any property. The Contractor shall promptly take precautions which are necessary and adequate against conditions created during the progress of the Contractor's activities hereunder which involve a risk of bodily harm to persons or a risk of damage to property. The Contractor shall continuously inspect Work, materials, and equipment to discover and determine any such conditions and shall be solely responsible for discovery, determination, and correction of any such conditions. The Contractor shall comply with applicable safety laws, standards, codes, and regulations in the jurisdiction where the Work is being performed, specifically, but without limiting the generality of the foregoing, with rules regulations, and standards adopted pursuant to the Williams-Steiger Occupational Safety and Health Act of 1970 and applicable amendments.
2. All contractors, subcontractors and workers on this project are subject to the Construction Safety Training provisions 292.675 RSMo.

3. In the event the Contractor encounters on the site, material reasonably believed to be asbestos, polychlorinated biphenyl (PCB), lead, mercury, or other material known to be hazardous, which has not been rendered harmless, the Contractor shall immediately stop Work in the area affected and report the condition to the Owner's Representative and the Architect in writing. The Work in the affected area shall not thereafter be resumed except by written agreement of the Owner's Representative and Contractor if in fact the material is asbestos or polychlorinated biphenyl (PCB) and has not been rendered harmless. The Work in the affected area shall be resumed in the absence of asbestos or polychlorinated biphenyl (PCB), or when it has been rendered harmless by written agreement of the Owner's Representative and the Contractor. "Rendered Harmless" shall mean that levels of such materials are less than any applicable exposure standards, including but limited to OSHA regulations.

**B. SAFETY OF PERSONS AND PROPERTY**

1. The Contractor shall take reasonable precautions for safety of, and shall provide protection to prevent damage, injury, or loss to:
  - a. clients, staff, the public, construction personnel, and other persons who may be affected thereby;
  - b. the Work and materials and equipment to be incorporated therein, whether in storage on or off the site, under care, custody, or control of the Contractor or the Contractor's Subcontractors of any tier; and
  - c. other property at the site or adjacent thereto, such as trees, shrubs, lawns, walks, pavements, roadways, structures, and utilities not designated for removal, relocation, or replacement in the course of construction.
2. The Contractor shall give notices and comply with applicable laws, standards, codes, ordinances, rules, regulations, and lawful orders of public authorities bearing on safety of persons or property or their protection from damage, injury, or loss.
3. The Contractor shall erect and maintain, as required by existing conditions and performance of the Contract, safeguards for safety and protection, including, but not limited to, posting danger signs and other warnings against hazards, promulgating safety regulations, and notifying owners and users of adjacent sites and utilities.
4. When use or storage of explosives or other hazardous materials or equipment or unusual methods are necessary for execution of the Work, the Contractor shall exercise the highest degree of care and carry on such activities under supervision of properly qualified personnel.
5. The Contractor shall promptly remedy damage and loss (other than damage or loss insured under property insurance required by the Contract Documents) to property referred to in this Section caused in whole or in part by the Contractor, a Subcontractor of any tier, or anyone directly or indirectly employed by any of them, or by anyone for whose acts they may be liable, and for which the Contractor is responsible under this Section, except damage or loss attributable solely to acts or omissions of Owner or the Architect or anyone directly or indirectly employed by either of them, or by anyone for whose acts either of them may be liable, and not attributable to the fault or negligence of the Contractor. The foregoing obligations of the Contractor are in addition to the Contractor's other obligations stated elsewhere in the Contract.
6. The Contractor shall designate a responsible member of the Contractor's organization at

the site whose duty shall be the prevention of accidents, and the maintaining, enforcing and supervising of safety precautions and programs. This person shall be the Contractor's superintendent unless otherwise designated by the Contractor in writing to the Owner's Representative and Architect. The Contractor shall hold regularly scheduled safety meetings to instruct Contractor personnel on safety practices, accident avoidance and prevention, and the Project Safety Program. The Contractor shall furnish safety equipment and enforce the use of such equipment by its employees and its subcontractors of any tier.

7. The Contractor shall not load or permit any part of the construction or site to be loaded so as to endanger its safety.
8. The Contractor shall promptly report in writing to the Owner all accidents arising out of or in connection with the Work which cause death, lost time injury, personal injury, or property damage, giving full details and statements of any witnesses. In addition, if death, serious personal injuries, or serious property damages are caused, the accident shall be reported immediately.
9. The Contractor shall promptly notify in writing to the Owner of any claims for injury or damage to personal property related to the work, either by or against the Contractor.
10. The Owner assumes no responsibility or liability for the physical condition or safety of the Work site, or any improvements located on the Work site. The Contractor shall be solely responsible for providing a safe place for the performance of the Work. The Owner shall not be required to make any adjustment in either the Contract Sum or Contract Time concerning any failure by the Contractor or any Subcontractor to comply with the requirements of this Paragraph.
11. In no event shall the Owner have control over, charge of, or any responsibility for construction means, methods, techniques, sequences or procedures or for safety precautions and programs in connection with the Work, notwithstanding any of the rights and authority granted the Owner in the Contract Documents.
12. The Contractor shall maintain at his own cost and expense, adequate, safe and sufficient walkways, platforms, scaffolds, ladders, hoists and all necessary, proper, and adequate equipment, apparatus, and appliances useful in carrying on the Work and which are necessary to make the place of Work safe and free from avoidable danger for clients, staff, the public and construction personnel, and as may be required by safety provisions of applicable laws, ordinances, rules regulations and building and construction codes.

**END OF SECTION 013513.10**

## SECTION 013591 - HISTORIC TREATMENT PROCEDURES

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. Section includes general protection and treatment procedures for designated historic spaces, areas, rooms, and surfaces in Project.

#### 1.2 DEFINITIONS

- A. Consolidate: To strengthen loose or deteriorated materials in place.
- B. Design Reference Sample: A sample that represents Architect's prebid selection of work to be matched; it may be existing work or work specially produced for Project.
- C. Dismantle: To disassemble or detach a historic item from a surface, or a nonhistoric item from a historic surface, using gentle methods and equipment to prevent damage to historic items and surfaces; disposing of items unless indicated to be salvaged or reinstalled.
- D. Historic: Spaces, areas, rooms, surfaces, materials, finishes, doors, door components, and overall appearance that are important to the successful restoration as determined by Architect. Designated historic doors, door components, and surfaces are indicated on Drawings.
  - 1. Monumental Center Bi-fold Doors: Doors of greatest architectural importance, integrity, and visibility.
  - 2. Foyer: Area inside Bi-fold Doors where the vestibule will be located including all adjacent materials.
- E. Match: To blend with adjacent construction and manifest no apparent difference in material type, species, cut, form, detail, color, grain, texture, or finish; as approved by Architect.
- F. Refinish: To remove existing finishes to base material and apply new finish to match original, or as otherwise indicated.
- G. Reinstall: To protect removed or dismantled item, repair and clean it as indicated for reuse, and reinstall it in original position, or where indicated.
- H. Remove: To take down or detach a non-historic item located within a historic space, area, or room, using methods and equipment to prevent damage to historic items and surfaces; disposing of items unless indicated to be salvaged or reinstalled.
- I. Repair: To correct damage and defects, retaining existing materials, features, and finishes while employing as little new material as possible. This includes patching, piecing-in, splicing, consolidating, or otherwise reinforcing or upgrading materials.

- J. Replace: To remove, duplicate, and reinstall entire item with new material. The original item is the pattern for creating duplicates unless otherwise indicated.
- K. Replicate: To reproduce in exact detail, materials, and finish unless otherwise indicated.
- L. Reproduce: To fabricate a new item, accurate in detail to the original, and from either the same or a similar material as the original, unless otherwise indicated.
- M. Restore: To consolidate, replicate, reproduce, repair, and refinish as required to achieve the indicated results.
- N. Retain: To keep an element or detail secure and intact.
- O. Reversible: New construction work, treatments, or processes that can be removed or undone in the future without damaging historic materials unless otherwise indicated.
- P. Salvage: To protect removed or dismantled items and deliver them to Owner ready for reuse.
- Q. Stabilize: To provide structural reinforcement of unsafe or deteriorated items while maintaining the essential form as it exists at present; also, to reestablish a weather-resistant enclosure.
- R. Strip: To remove existing finish down to base material unless otherwise indicated.

### 1.3 SUBMITTALS

- A. Historic Treatment Sub-schedule: A construction schedule coordinating the sequencing and scheduling of historic treatment work for entire Project, including each activity to be performed in historic spaces, areas, and rooms and on doors and door components, and on historic surfaces; and based on Contractor's Construction Schedule. Secure time commitments for performing critical construction activities from separate entities responsible for historic treatment work.
  - 1. Schedule construction operations in sequence required to obtain best historic treatment results.
  - 2. Coordinate sequence of historic treatment work activities to accommodate the following:
    - a. Owner's continuing occupancy of portions of existing building.
    - b. Other known work in progress.
    - c. Tests and inspections.
  - 3. Detail sequence of historic treatment work, with start and end dates.
  - 4. Use of elevator and stairs.
  - 5. Submit historic treatment sub-schedule within ten (10) working days of data established for commencement of historic treatment work.
- B. Equipment Data: List gross loaded weight, axle-load distribution, and wheel-base dimension data for mobile and heavy equipment proposed for use. Do not use such equipment without certification from Contractor's professional engineer that the structure can support the imposed loadings without damage.

- C. Pedestrian and Vehicular Circulation: Coordinate historic treatment work with circulation patterns within Project building and site. Some work is near circulation patterns and work should be carefully coordinated with schedules of the legislative session and work of other construction contracts. Circulation patterns cannot be closed off entirely, and in places can be only temporarily redirected around small areas of work. Plan and execute the Work accordingly. Submit plan showing circulation.
- D. Historic Treatment Program: Submit 30 days before work begins.
- E. Fire-Prevention Plan: Submit 30 days before work begins.

#### 1.4 PROJECT MEETINGS FOR HISTORIC TREATMENT

- A. Preliminary Historic Treatment Conference: Before starting historic treatment work, conduct conference at Project Site located at 201 W Capitol Ave, Jefferson City, MO 65101.
  - 1. Attendees: In addition to representatives of Owner, Architect, and Contractor, Specialty Contractor, and other subcontractors whose work interfaces with or affects historic treatment shall be represented at the meeting.
  - 2. Agenda: Discuss items of significance that could affect progress of historic treatment work, including review of the following:
    - a. Historic Treatment Sub-schedule: Discuss and finalize; verify availability of materials, historic treatment specialists' personnel, equipment, and facilities needed to make progress and avoid delays.
    - b. Fire-prevention plan.
    - c. Governing regulations.
    - d. Areas where existing construction requires protection.
    - e. Description of protection.
    - f. Hauling routes.
    - g. Sequence of historic treatment work operations.
    - h. Storage, protection, and accounting for salvaged and specially fabricated items.
    - i. Existing conditions, staging, and structural loading limitations of areas where materials are stored.
    - j. Qualifications of personnel assigned to historic treatment work and assigned duties.
    - k. Requirements for extent and quality of work, tolerances, and required clearances.
    - l. Embedded work such as flashings and lintels, special details, collection of wastes, protection of occupants and the public, and condition of other construction that affect the Work or will affect the work.
  - 3. Reporting: Record conference results and distribute copies to everyone in attendance and to others affected by decisions or actions resulting from conference.
- B. Preconstruction Documentation: Show preexisting conditions of adjoining construction and site improvements, including finish surfaces, that might be misconstrued as damage caused by Contractor's historic treatment operations.

## 1.5 QUALITY ASSURANCE

- A. Specialty Contractor: An experienced firm regularly engaged in restoration similar in nature, materials, design, and extent to the work as specified in each Section and that has completed a minimum of five recent projects with a record of successful in-service performance that demonstrates the firm's qualifications to perform this work.
  - 1. Field Supervisor Qualifications: Full-time supervisors experienced in restoration work similar in nature, material, design, and extent to that indicated for this Project. Supervisors shall be on site when historic treatment work begins and during its progress. Supervisors shall not be changed during Project except for causes beyond control of the specialist firm.
- B. Historic Treatment Program: Prepare a written plan for historic treatment for whole Project, including each phase or process and protection of surrounding materials during operations. Describe in detail the materials, methods, and equipment to be used for each phase of work. Show compliance with indicated methods and procedures specified in this and other Sections. Coordinate this whole-Project historic treatment program with specific requirements of programs required in other historic treatment Sections.
  - 1. Dust and Noise Control: Include locations of proposed temporary dust- and noise-control partitions and means of egress from occupied areas coordinated with continuing on-site operations and other known work in progress.
  - 2. Debris Hauling: Include plans clearly marked to show debris hauling routes, turning radii, and locations and details of temporary protective barriers.
- C. Fire-Prevention Plan: Prepare a written plan for preventing fires during the Work, including placement of fire extinguishers, fire blankets, rag buckets, and other fire-control devices during each phase or process. Coordinate plan with Owner's fire-protection equipment and requirements. Include fire-watch personnel's training, duties, and authority to enforce fire safety.
- D. Safety and Health Standard: ANSI/ASSP A10.6.

## 1.6 STORAGE AND HANDLING OF HISTORIC MATERIALS

- A. Identification: Photograph, tag, and catalog historic items to be removed and reinstalled.
  - 1. Identify each item with a nonpermanent location identification tag indicating item name or use, location, and location identification number to document its original location. Indicate original locations on plans, elevations, sections, or photographs by annotating the identifying tag.
- B. Existing Historic Materials to Remain: Protect construction indicated to remain against damage and soiling from construction work. Protect finish floor materials beneath exterior portico, interior space at the base of the stair, and all vestibules. Where permitted by Architect, items may be dismantled and taken to a suitable, protected storage location during construction work and reinstalled in their original locations after historic treatment and construction work in the vicinity is complete.

## 1.7 FIELD CONDITIONS

- A. Size Limitations in Historic Spaces: Materials, products, and equipment used for performing the Work and for transporting debris, materials, and products shall be of sizes that clear surfaces within historic spaces, areas, rooms, and openings, including temporary protection, by 36 inches or more. Particular attention should be given to the stone exterior walls, portico columns, balustrades, historic floor materials of exterior portico and interior vestibules and spaces, and adjacent bronze statue(s) when hoisting materials using a crane.

## PART 2 - PRODUCTS - (Not Used)

## PART 3 - EXECUTION

### 3.1 PROTECTION

- A. Protect persons, motor vehicles, surrounding surfaces of building, building site, plants, and surrounding buildings from harm resulting from historic treatment procedures.
  - 1. Use only proven protection methods, appropriate to each area and surface being protected.
  - 2. Provide temporary barricades, barriers, and directional signage to exclude the public from areas where historic treatment work is being performed.
  - 3. Erect temporary barriers to form and maintain fire-egress routes.
  - 4. Erect temporary protective covers over walkways and at points of pedestrian and vehicular entrance and exit that must remain in service during historic treatment work.
  - 5. Contain dust and debris generated by historic treatment work and prevent it from reaching the public or adjacent surfaces.
  - 6. Provide shoring, bracing, and supports as necessary. Do not overload structural elements.
  - 7. Protect floors and other surfaces along hauling routes from damage, wear, and staining.
  - 8. Provide supplemental sound-control treatment to isolate removal and dismantling work from other areas of the building.
- B. Temporary Protection of Historic Materials:
  - 1. Protect existing historic materials with temporary protections and construction. Do not remove existing materials unless otherwise indicated.
  - 2. Do not attach temporary protection to historic surfaces except as indicated as part of the historic treatment program and approved by Architect.
- C. Comply with each product manufacturer's written instructions for protections and precautions. Protect against adverse effects of products and procedures on people and adjacent materials, components, and vegetation.
- D. Utility and Communications Services:
  - 1. Notify Owner, Architect, authorities having jurisdiction, and entities owning or controlling wires, conduits, pipes, and other services affected by historic treatment work before commencing operations.

2. Maintain existing services unless otherwise indicated; keep in service, and protect against damage during operations. Provide temporary services during interruptions to existing utilities.

### 3.2 PROTECTION FROM FIRE

#### A. Follow fire-prevention plan and the following:

1. Comply with NFPA 241 requirements unless otherwise indicated. Perform duties titled "Owner's Responsibility for Fire Protection."
2. Remove and keep area free of combustibles, including rubbish, paper, waste, and chemicals, unless necessary for the immediate work.
  - a. If combustible material cannot be removed, provide fire blankets to cover such materials.
3. Prohibit smoking by all persons within Project work and staging areas.

#### B. Heat-Generating Equipment and Combustible Materials: Comply with the following procedures while performing work with heat-generating equipment or combustible materials, including welding, torch-cutting, soldering, brazing, removing paint with heat, or other operations where open flames or implements using high heat or combustible solvents and chemicals are anticipated:

1. Obtain Owner's approval for operations involving use of open-flame or welding or other high-heat equipment. Notify Owner at least 72 hours before each occurrence, indicating location of such work.
2. As far as practicable, restrict heat-generating equipment to shop areas or outside the building.
3. Do not perform work with heat-generating equipment in or near rooms or in areas where flammable liquids or explosive vapors are present or thought to be present. Use a combustible gas indicator test to ensure that area is safe.
4. Use fireproof baffles to prevent flames, sparks, hot gases, or other high-temperature material from reaching surrounding combustible material.
5. Prevent the spread of sparks and particles of hot metal through open windows, doors, holes, and cracks in floors, walls, ceilings, roofs, and other openings.
6. Fire Watch: Before working with heat-generating equipment or combustible materials, station personnel to serve as a fire watch at each location where such work is performed. Fire-watch personnel shall have the authority to enforce fire safety. Station fire watch according to NFPA 51B, NFPA 241, and as follows:
  - a. Train each fire watch in proper operation of fire-control equipment and alarms.
  - b. Prohibit fire-watch personnel from other work that would distract from fire-watch duties.
  - c. Cease work with heat-generating equipment whenever fire-watch personnel are not present.
  - d. Have fire-watch personnel perform final fire-safety inspection each day beginning no sooner than 30 minutes after conclusion of work in each area to detect hidden or smoldering fires and to ensure that proper fire prevention is maintained.

- e. Maintain fire-watch personnel at each area of Project site until 60 minutes after conclusion of daily work.
- C. Fire-Control Devices: Provide and maintain fire extinguishers, fire blankets, and rag buckets for disposal of rags with combustible liquids. Maintain each as suitable for type of fire risk in each work area. Ensure that nearby personnel and fire-watch personnel are trained in fire-extinguisher and blanket use.
- D. Sprinklers: Where sprinkler protection exists and is functional, maintain it without interruption while operations are being performed. If operations are performed close to sprinklers, shield them temporarily with guards.
  - 1. Remove temporary guards at the end of work shifts, whenever operations are paused, and when nearby work is complete.

### 3.3 PROTECTION DURING APPLICATION OF CHEMICALS

- A. Protect motor vehicles, surrounding surfaces of building being restored, building site, plants, and surrounding buildings from harm or spillage resulting from applications of chemicals and adhesives.
- B. Cover adjacent surfaces with protective materials that are proven to resist chemicals selected for Project unless chemicals being used will not damage adjacent surfaces as indicated in historic treatment program. Use covering materials and masking agents that are waterproof and UV resistant and that will not stain or leave residue on surfaces to which they are applied. Apply protective materials according to manufacturer's written instructions. Do not apply liquid masking agents or adhesives to painted or porous surfaces. When no longer needed, promptly remove protective materials.
- C. Do not apply chemicals during winds of sufficient force to spread them to unprotected surfaces.
- D. Neutralize alkaline and acid wastes and legally dispose of off Owner's property.
- E. Collect and dispose of runoff from chemical operations by legal means and in a manner that prevents soil contamination, soil erosion, undermining of paving and foundations, damage to landscaping, or water penetration into building interior.

### 3.4 GENERAL HISTORIC TREATMENT

- A. Have historic treatment work performed only by qualified historic treatment specialists.
- B. Ensure that supervisory personnel are present when historic treatment work begins and during its progress.
- C. Record existing work before each procedure (preconstruction), and record progress during the work. Use digital preconstruction documentation photographs or video recordings. Comply with requirements in Section 013233 "Photographic Documentation."

- D. Perform regular inspections of Project site as the Work progresses to detect hazards resulting from historic treatment procedures.
- E. Follow the procedures in subparagraphs below and procedures approved in historic treatment program unless otherwise indicated:
  - 1. Retain as much existing material as possible; repair and consolidate rather than replace.
  - 2. Use additional material or structure to reinforce, strengthen, prop, tie, and support existing material or structure.
  - 3. Use reversible processes wherever possible.
  - 4. Use historically accurate repair and replacement materials and techniques unless otherwise indicated.
- F. Notify Architect of visible changes in the integrity of material or components whether from environmental causes including biological attack, UV degradation, freezing, or thawing or from structural defects including cracks, movement, or distortion.
  - 1. Do not proceed with the work in question until directed by Architect.
- G. Where missing features are indicated to be repaired or replaced, provide work with appearance based on accurate duplications rather than on conjecture, subject to approval of Architect.
- H. Where work requires existing features to be removed or dismantled and reinstalled, perform these operations without damage to the material itself, to adjacent materials, or to the substrate.
- I. Identify new and replacement materials and features with permanent marks hidden in the completed Work to distinguish them from original materials. Record a legend of identification marks and the locations of the items on record Drawings.

### 3.5 HISTORIC TREATMENT SCHEDULE

- A. Spaces, areas, rooms, and surfaces requiring special care and treatment to ensure successful project are indicated on Drawings.

END OF SECTION 013591

## **SECTION 015000 – CONSTRUCTION FACILITIES AND TEMPORARY CONTROLS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes requirements for construction facilities and temporary controls including temporary utilities, support facilities, security, and protection.
- B. Temporary utilities include, but are not limited to, the following:
  - 1. Water service and distribution
  - 2. Temporary electric power and light
  - 3. Temporary heat
  - 4. Ventilation
  - 5. Telephone service
  - 6. Sanitary facilities, including drinking water
  - 7. Storm and sanitary sewer
- C. Support facilities include, but are not limited to, the following:
  - 1. Field offices and storage sheds
  - 2. Temporary roads and paving
  - 3. Dewatering facilities and drains
  - 4. Temporary enclosures
  - 5. Hoists and temporary elevator use
  - 6. Temporary project identification signs and bulletin boards
  - 7. Waste disposal services
  - 8. Rodent and pest control
  - 9. Construction aids and miscellaneous services and facilities
- D. Security and protection facilities include, but are not limited to, the following:
  - 1. Temporary fire protection
  - 2. Barricades, warning signs, and lights
  - 3. Sidewalk bridge or enclosure fence for the site
  - 4. Environmental protection

#### **1.3 SUBMITTALS**

- A. Temporary Utilities: Submit reports of tests, inspections, meter readings, and similar procedures performed on temporary utilities.

- B. Implementation and Termination Schedule: Within (15) days of the date established for commencement of the Work, submit a schedule indicating implementation and termination of each temporary utility.

## **1.4 QUALITY ASSURANCE**

- A. Regulations: Comply with industry standards and applicable laws and regulations including, but not limited to, the following:
  - 1. Building code requirements
  - 2. Health and safety regulations
  - 3. Utility company regulations
  - 4. Police, fire department, and rescue squad rules
  - 5. Environmental protection regulations
- B. Standards: Comply with NFPA 241 “Standard for Safeguarding Construction, Alterations, and Demolition Operations”. ANSI A10 Series standards for “Safety Requirements for Construction and Demolition”, and NECA Electrical Design Library “Temporary Electrical Facilities”.
  - 1. Electrical Service: Comply with NEMA, NECA, and UL standards and regulations for temporary electric service. Install service in compliance with NFPA 70 “National Electric Code”.
- C. Inspections: Arrange for authorities having jurisdiction to inspect and test each temporary utility before use. Obtain required certifications and permits.

## **1.5 PROJECT CONDITIONS**

- A. Temporary Utilities: Prepare a schedule indicating dates for implementation and termination of each temporary utility. At the earliest feasible time, when acceptable to the Owner, change over from use of temporary service to use of permanent service.
- B. Conditions of Use: Keep temporary services and facilities clean and neat in appearance. Operate in a safe and efficient manner. Relocate temporary services and facilities as the Work progresses. Do not overload facilities or permit them to interfere with progress. Take necessary fire-prevention measures. Do not allow hazardous, dangerous, or unsanitary conditions, or public nuisances to develop or persist onsite.

## **PART 2 - PRODUCTS**

### **2.1 MATERIALS**

- A. General: Provide new materials. If acceptable to the Designer, the Contractor may use undamaged, previously used materials in serviceable condition. Provide materials suitable for use intended.
- B. Lumber and Plywood: Comply with requirements in Division 6 Section “Rough Carpentry”.
  - 1. For job-built temporary office, shops, and sheds within the construction area, provide UL-labeled, fire-treated lumber and plywood for framing, sheathing, and siding.

2. For signs and directory boards, provide exterior-type, Grade B-B high-density concrete form overlay plywood of sized and thicknesses indicated.
  3. For fences and vision barriers, provide minimum 3/9" (9.5mm) thick exterior plywood.
  4. For safety barriers, sidewalk bridges, and similar uses, provide minimum 5/8" (16mm) thick exterior plywood.
- C. Paint: Comply with requirements of Division 9 Section "Painting".
1. For job-built temporary offices, shops, sheds, fences, and other exposed lumber and plywood, provide exterior-grade acrylic-latex emulsion over exterior primer.
  2. For sign panels and applying graphics, provide exterior-grade alkyd gloss enamel over exterior primer.
- D. Tarpaulins: Provide waterproof, fire-resistant, UL-labeled tarpaulins with flame-spread rating of (15) or less. For temporary enclosures, provide translucent, nylon-reinforced laminated polyethylene or polyvinyl chloride, fire-retardant tarpaulins.
- E. Water: Provide potable water approved by local health authorities.
- F. Open-Mesh Fencing: Provide 0.120" (3mm) thick, galvanized 2" (50mm) chainlink fabric fencing 6' (2m) high with galvanized steel pipe posts, 1½" (38mm) ID for line posts and 2½" (64mm) ID for corner posts.

## 2.2 EQUIPMENT

- A. General: Provide new equipment. If acceptable to the Designer, the Contractor may use undamaged, previously used equipment in serviceable condition. Provide equipment suitable for use intended.
- B. Electrical Outlets: Provide properly configured, NEMA-polarized outlets to prevent insertion of 110 to 120V plugs into higher voltage outlets. Provide receptacle outlets equipped with ground-fault circuit interrupters, reset button, and pilot light for connection of power tools and equipment.
- C. Electrical Power Cords: Provide grounded extension cords. Use hard-service cords where exposed to abrasion and traffic. Provide waterproof connectors to connect separate lengths of electric cords if single lengths will not reach areas where construction activities are in progress. Do not exceed safe length-voltage rating.
- D. Lamps and Light Fixtures: Provide general service incandescent lamps of wattage required for adequate illumination. Provide guard cages or tempered-glass enclosures where exposed to breakage. Provide exterior fixture where exposed to moisture.
- E. Heating Units: Provide temporary heating units that have been tested and labeled by UL, FM, or another recognized trade association related to the type of fuel being consumed.
- F. Fire Extinguishers: Provide hand-carried, portable, UL-rated, Class A fire extinguishers for temporary offices and similar spaces. In other locations, provide hand-carried, portable, UL-rated, Class ABC, dry-chemical extinguishers, or a combination of extinguishers of NFPA-recommended classes for the exposures.
1. Comply with NFPA 10 and NFPA 241 for classification, extinguishing agent, and size required by location and class of fire exposure.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Use qualified personnel for installation of temporary facilities. Locate facilities where they will serve the Project adequately and result in minimum interference with performance of the Work. Relocate and modify facilities as required.
- B. Provide each Facility ready for use when needed to avoid delay. Maintain and modify as required. Do not remove until facilities are no longer needed or are replaced by authorized use of completed permanent facilities.

### **3.2 TEMPORARY UTILITY INSTALLATION**

- A. General: Engage the appropriate local utility company to install temporary service or connect to existing service. Where company provides only part of the service, provide the remainder with matching, compatible materials and equipment. Comply with company recommendations.
  - 1. Arrange with company and existing users for a time when service can be interrupted, if necessary, to make connections for temporary services.
  - 2. Provide adequate capacity at each stage of construction. Prior to temporary utility availability, provide trucked-in services.
  - 3. Obtain easements to bring temporary utilities to the site where the Owner's easements cannot be used for that purpose.
  - 4. Use Charges: Cost or use charges for temporary facilities are not chargeable to the Owner or Designer. Neither the Owner nor Designer will accept cost or use charges as a basis of claims for Change Order.
- B. Temporary Water Service: The Owner will provide water for construction purposes from the existing building system. All required temporary extensions shall be provided and removed by the Contractor. Connection points and methods of connection shall be designated and approved by the Construction Representative.
- C. Temporary Electric Power Service: The Owner will provide electric power for construction lighting and power tools. Contractors using such services shall pay all costs of temporary services, circuits, outlet, extensions, etc.
- D. Temporary Heating and Cooling: The normal heating and/or cooling system of the building shall be maintained in operation during the construction. Should the Contractor find it necessary to interrupt the normal HVAC service to spaces, which have not been vacated for construction, such interruptions shall be pre-scheduled with the Construction Representative.
- E. Temporary Toilets: The Owner will provide toilets and associated facilities within the building. All construction personnel will be allowed access only to those specific facilities designated by the Construction Representative.
- F. Wash Facilities: The Owner will provide wash facilities within the building. All construction personnel will be allowed access only to those specific facilities designated by the Construction Representative.

- G. Drinking-Water Facilities: The Owner will provide drinking water facilities within the building. All construction personnel will be allowed access only to those specific facilities designated by the Construction Representative.

### **3.3 SUPPORT FACILITIES INSTALLATION**

- A. General: Locate field offices, storage sheds, and other temporary construction and support facilities for easy access.
  - 1. Maintain support facilities until near Substantial Completion. Remove prior to Substantial Completion. Personnel remaining after Substantial Completion will be permitted to use permanent facilities, under conditions acceptable to the Owner.
- B. Storage Facilities: Limited areas for storage of building materials are available onsite. Available storage areas are shown on the drawings. The Contractor shall provide his own security. Specific locations for storage and craning operations will be discussed at the Pre-Bid Meeting and the Pre-Construction Meeting.
- C. Construction Parking: Contractors must be prepared to discuss their storage and parking needs at the Pre-Bid Meeting. Parking for construction personnel cannot be provided onsite. All parking will be offsite. The Contractor will have to park on the street, in city-owned lots, or in commercial lots. Under no circumstances will any vehicle be parked in a fire lane. Parking on lawns shall be prohibited.
- D. Temporary Enclosures: Provide temporary enclosures for protection of construction, in progress and completed, from exposure, foul weather, other construction operations, and similar activities.
  - 1. Where heat is needed and the permanent building enclosure is not complete, provide temporary enclosures where there is no other provision for containment of heat. Coordinate enclosure with ventilating and materials drying or curing requirements to avoid dangerous conditions and effects.
  - 2. Install tarpaulins securely with incombustible wood framing and other materials. Close openings of 25SqFt (2.3SqM) or less with plywood or similar materials.
  - 3. Where temporary wood or plywood enclosure exceeds 100SqFt (9.2SqM) in area, use UL-labeled, fire-retardant-treated material for framing and main sheathing.
- E. Temporary Lifts and Hoists: Provide facilities for hoisting materials and employees. Truck cranes and similar devices used for hoisting materials are considered “tools and equipment” and not temporary facilities.
- F. Temporary Elevator Use: The Owner will allow use of elevators within the building. All construction personnel will be allowed access only to those specific elevators designated by the Construction Representative.
- G. Project Identification and Temporary Signs: Prepare project identification and other signs of size indicated. Install signs where indicated to inform the public and persons seeking entrance to the Project. Support on posts or framing of preservative-treated wood or steel. Do not permit installation of unauthorized signs.
  - 1. Temporary Signs: Prepare signs to provide directional information to construction personnel and visitors.

- H. Collection and Disposal of Waste: Collect waste from construction areas and elsewhere daily. Comply with requirements of NFPA 241 for removal of combustible waste material and debris. Enforce requirements strictly. Do not hold materials more than seven (7) days during normal weather or three (3) days when the temperature is expected to rise above 80°F (27°C). Handle hazardous, dangerous, or unsanitary waste materials separately from other waste by containerizing properly. Dispose of material lawfully.

### **3.4 SECURITY AND PROTECTION FACILITIES INSTALLATION**

- A. Except for use of permanent fire protection as soon as available, do not change over from use of temporary security and protection facilities to permanent facilities until Substantial Completion, or longer, as requested by the Designer.
- B. Temporary Fire Protection: Until fire-protection needs are supplied by permanent facilities, install and maintain temporary fire-protection facilities of the types needed to protect against reasonable predictable and controllable fire losses. Comply with NFPA 10 “Standard for Portable Fire Extinguishers” and NFPA 241 “Standard for Safeguarding Construction, Alterations, and Demolition Operations”.
  - 1. Locate fire extinguishers where convenient and effective for their intended purpose, but not less than one (1) extinguisher on each floor at or near each usable stairwell.
  - 2. Store combustible materials in containers in fire-safe locations.
  - 3. Maintain unobstructed access to fire extinguishers, fire hydrants, temporary fire-protection facilities, stairways, and other access routes for fighting fires. Prohibit smoking in hazardous fire-exposure areas.
  - 4. Provide supervision of welding operations, combustion-type temporary heating units, and similar sources of fire ignition.
- C. Barricades, Warning Signs, and Lights: Comply with standards and code requirements for erection of structurally adequate barricades. Paint with appropriate colors, graphics, and warning signs to inform personnel and the public of the hazard being protected against. Where appropriate and needed, provide lighting including flashing red or amber lights.
- D. Security Enclosure and Lockup: Install substantial temporary enclosure of partially completed areas of construction. Provide locking entrances to prevent unauthorized entrance, vandalism, theft, and similar violations of security.
- E. Storage: Where materials and equipment must be stored and are of value or attractive for theft, provide a secure lockup. Enforce discipline in connection with the installation and release of material to minimize the opportunity for theft and vandalism.
- F. Environmental Protection: Provide protection, operate temporary facilities, and conduct construction in ways and by methods that comply with environmental regulations and minimize the possibility that air, waterways, and subsoil might be contaminated or polluted or that other undesirable effects might result. Avoid use of tools and equipment that produce harmful noise. Restrict use of noisemaking tools and equipment to hours that will minimize complaints from persons or firms near the site.

### **3.5 OPERATION, TERMINATION AND REMOVAL**

- A. Supervision: Enforce strict discipline in use of temporary facilities. Limit availability of temporary facilities to essential and intended uses to minimize waste and abuse.
- B. Maintenance: Maintain facilities in good operating condition until removal. Protect from damage by freezing temperatures and similar elements.
  - 1. Maintain operation of temporary enclosures, heating, cooling, humidity control, ventilation, and similar facilities on a 24-hour basis where required to achieve indicated results and to avoid possibility of damage.
- C. Termination and Removal: Unless the Designer requests that it be maintained longer, remove each temporary facility when the need has ended, when replaced by authorized use of a permanent facility, or no later than Substantial Completion. Complete or, if necessary, restore permanent construction that may have been delayed because of interference with the temporary facility. Repair damaged Work, clean exposed surfaces, and replace construction that cannot be satisfactorily repaired.
  - 1. Materials and facilities that constitute temporary facilities are the Contractor's property. The Owner reserves the right to take possession of project identification signs.
  - 2. At Substantial Completion, clean and renovate permanent facilities used during the construction period including, but not limited to, the following:
    - a. Replace significantly worn parts and parts subject to unusual operating conditions.

**END OF SECTION 015000**

## **SECTION 017400 – CLEANING**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes administrative and procedural requirements for cleaning during the Project.
- B. Environmental Requirements: Conduct cleaning and waste-disposal operations in compliance with local laws and ordinances. Comply fully with federal and local environmental and anti-pollution regulations.
  - 1. Do not dispose of volatile wastes such as mineral spirits, oil, or paint thinner in storm or sanitary drains.
  - 2. Burning or burying of debris, rubbish, or other waste material on the premises is not permitted.

### **PART 2 - PRODUCTS**

#### **2.1 MATERIALS**

- A. Cleaning Agents: Use cleaning materials and agents recommended by the manufacturer or fabricator for the surface to be cleaned. Do not use cleaning agents that are potentially hazardous to health or property or that might damage finished surfaces.

### **PART 3 - EXECUTION**

#### **3.1 PROGRESS CLEANING**

- A. General
  - 1. Retain all stored items in an orderly arrangement allowing maximum access, not impeding drainage or traffic, and providing the required protection of materials.
  - 2. Do not allow the accumulation of scrap, debris, waste material, and other items not required for construction of this Work.
  - 3. At least once each month, and more often if necessary, completely remove all scrap, debris, and waste material from the jobsite.
  - 4. Provide adequate storage for all items awaiting removal from the jobsite, observing all requirements for fire protection and protection of the ecology.

B. Site

1. Daily, inspect the site and pick up all scrap, debris, and waste material. Remove all such items to the place designated for their storage.
2. Weekly, inspect all arrangements of materials stored onsite. Re-stack, tidy, or otherwise service all material arrangements.
3. Maintain the site in a neat and orderly condition at all times.

C. Structures

1. Daily, inspect the structures and pick up all scrap, debris, and waste material. Remove all such items to the place designated for their storage.
2. Weekly, sweep all interior spaces clean. "Clean" for the purposes of this paragraph, shall be interpreted as meaning free from dust and other material capable of being removed by use of reasonable effort and handheld broom.
3. In preparation for installation of succeeding materials, clean the structures or pertinent portions thereof to the degree of cleanliness recommended by the manufacturer of the succeeding material, using all equipment and materials required to achieve the required cleanliness.
4. Following the installation of finish floor materials, clean the finish floor daily while work is being performed in the space in which finish materials have been installed. "Clean" for the purposes of this subparagraph, shall be interpreted as meaning free from all foreign material which, in the opinion of the Construction Representative, may be injurious to the finish of the finish floor material.

### 3.2 FINAL CLEANING

- A. General: Provide final cleaning operations when indicated. Employ experienced workers or professional cleaners for final cleaning. Clean each surface or unit of Work to the condition expected from a commercial building cleaning and maintenance program. Comply with manufacturer's instructions.
- B. Complete the following cleaning operations before requesting inspection for certification of Substantial Completion for the entire Project or a portion of the Project.
  1. Clean the Project Site, yard and grounds, in areas disturbed by construction activities including landscape development areas, of rubbish, waste material, litter, and foreign substances.
  2. Sweep paved areas broom clean. Rake grounds that are neither planted nor paved to a smooth, even-textured surface.
  3. Remove petrochemical spills, stains, and other foreign deposits.
  4. Remove tools, construction equipment, machinery, and surplus material from the site.
  5. Remove snow and ice to provide safe access to the building.

6. Clean exposed exterior and interior hard-surfaced finishes to a dirt-free condition, free of stains, films, and similar foreign substances. Avoid disturbing natural weathering of exterior surfaces. Restore reflective surfaces to their original condition.
  7. Remove debris and surface dust from limited access spaces, including roofs, plenums, shafts, trenches, equipment vaults, manholes, attics, and similar spaces.
  8. Broom clean concrete floors in unoccupied spaces.
  9. Vacuum clean carpet and similar soft surfaces removing debris and excess nap. Shampoo, if required.
  10. Clean transparent material, including mirrors and glass in doors and windows. Remove glazing compounds and other substances that are noticeable vision-obscuring materials. Replace chipped or broken glass and other damaged transparent materials. Polish mirrors and glass, taking care not to scratch surfaces.
  11. Remove labels that are not permanent labels.
  12. Touch up and otherwise repair and restore marred, exposed finishes and surfaces. Replace finishes and surfaces that cannot be satisfactorily repaired or restored or that already show evidence of repair or restoration.
    - a. Do not paint over "UL" and similar labels, including mechanical and electrical nameplates.
  13. Wipe surfaces of mechanical and electrical equipment, elevator equipment, and similar equipment. Remove excess lubrication, paint and mortar droppings, and other foreign substances.
  14. Clean plumbing fixtures to a sanitary condition free of stains, including stains resulting from water exposure.
  15. Replace disposable air filters and clean permanent air filters. Clean exposed surfaces of diffusers, registers, and grills.
  16. Clean ducts, blowers, and coils if units were operated without filters during construction
  17. Clean food-service equipment to a sanitary condition, ready and acceptable for its intended use.
  18. Clean light fixtures, lamps, globes, and reflectors to function with full efficiency. Replace burned-out bulbs and defective and noisy starters in fluorescent and mercury vapor fixtures.
  19. Leave the Project clean and ready for occupancy.
- C. Pest Control: Engage an experienced, licensed exterminator to make a final inspection and rid the Project of rodents, insects, and other pests. Comply with regulations of local authorities.
- D. Removal of Protection: Remove temporary protection and facilities installed during construction to protect previously completed installations during the remainder of the construction period.

- E. Compliances: Comply with governing regulations and safety standards for cleaning operations. Remove waste materials from the site and dispose of lawfully.
  - 1. Where extra materials of value remain after Final Acceptance by the Owner, they become the Owner's property.

**END OF SECTION 017400**

## **SECTION 017900 - DEMONSTRATION AND TRAINING**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section includes administrative and procedural requirements for instructing Owner's personnel, including the following:
  - 1. Demonstration of operation of systems, subsystems, and equipment.
  - 2. Training in operation and maintenance of systems, subsystems, and equipment.
  - 3. Demonstration and training video recordings.

#### **1.3 INFORMATIONAL SUBMITTALS**

- A. Instruction Program: Submit outline of instructional program for demonstration and training, including a list of training modules and a schedule of proposed dates, times, length of instruction time, and instructors' names for each training module. Include learning objective and outline for each training module.
- B. Attendance Record: For each training module, submit list of participants and length of instruction time.
- C. Evaluations: For each participant and for each training module, submit results and documentation of performance-based test.

#### **1.4 CLOSEOUT SUBMITTALS**

- A. Demonstration and Training Video Recordings: Submit two copies within seven days of end of each training module.
  - 1. Identification: On each copy, provide an applied label with the following information:
    - a. Name of Project.
    - b. Name and address of videographer.
    - c. Name of Architect.
    - d. Name of Construction Manager.
    - e. Name of Contractor.
    - f. Date of video recording.
  - 2. Transcript: Prepared in PDF electronic format. Include a cover sheet with same label information as the corresponding video recording and a table of contents with links to

corresponding training components. Include name of Project and date of video recording on each page.

3. At completion of training, submit complete training manual(s) for Owner's use in PDF electronic file format on compact disc.

## **1.5 QUALITY ASSURANCE**

- A. Facilitator Qualifications: A firm or individual experienced in training or educating maintenance personnel in a training program similar in content and extent to that indicated for this Project, and whose work has resulted in training or education with a record of successful learning performance.
- B. Instructor Qualifications: A factory-authorized service representative experienced in operation and maintenance procedures and training.
- C. Preinstruction Conference: Conduct conference at Project site to comply with requirements in Section 013100 "Coordination". Review methods and procedures related to demonstration and training including, but not limited to, the following:
  1. Inspect and discuss locations and other facilities required for instruction.
  2. Review and finalize instruction schedule and verify availability of educational materials, instructors' personnel, audiovisual equipment, and facilities needed to avoid delays.
  3. Review required content of instruction.
  4. For instruction that must occur outside, review weather and forecasted weather conditions and procedures to follow if conditions are unfavorable.

## **1.6 COORDINATION**

- A. Coordinate instruction schedule with Owner's operations. Adjust schedule as required to minimize disrupting Owner's operations and to ensure availability of Owner's personnel.
- B. Coordinate instructors, including providing notification of dates, times, length of instruction time, and course content.
- C. Coordinate content of training modules with content of approved emergency, operation, and maintenance manuals. Do not submit instruction program until operation and maintenance data has been reviewed and approved by Architect.

## **PART 2 - PRODUCTS**

### **2.1 INSTRUCTION PROGRAM**

- A. Program Structure: Develop an instruction program that includes individual training modules for each system and for equipment not part of a system, as required by individual Specification Sections.
- B. Training Modules: Develop a learning objective and teaching outline for each module. Include a description of specific skills and knowledge that participant is expected to master. For each

module, include instruction for the following as applicable to the system, equipment, or component:

1. Basis of System Design, Operational Requirements, and Criteria: Include the following:
  - a. System, subsystem, and equipment descriptions.
  - b. Performance and design criteria if Contractor is delegated design responsibility.
  - c. Operating standards.
  - d. Regulatory requirements.
  - e. Equipment function.
  - f. Operating characteristics.
  - g. Limiting conditions.
  - h. Performance curves.
2. Documentation: Review the following items in detail:
  - a. Emergency manuals.
  - b. Operations manuals.
  - c. Maintenance manuals.
  - d. Project record documents.
  - e. Identification systems.
  - f. Warranties and bonds.
  - g. Maintenance service agreements and similar continuing commitments.
3. Emergencies: Include the following, as applicable:
  - a. Instructions on meaning of warnings, trouble indications, and error messages.
  - b. Instructions on stopping.
  - c. Shutdown instructions for each type of emergency.
  - d. Operating instructions for conditions outside of normal operating limits.
  - e. Sequences for electric or electronic systems.
  - f. Special operating instructions and procedures.
4. Operations: Include the following, as applicable:
  - a. Startup procedures.
  - b. Equipment or system break-in procedures.
  - c. Routine and normal operating instructions.
  - d. Regulation and control procedures.
  - e. Control sequences.
  - f. Safety procedures.
  - g. Instructions on stopping.
  - h. Normal shutdown instructions.
  - i. Operating procedures for emergencies.
  - j. Operating procedures for system, subsystem, or equipment failure.
  - k. Seasonal and weekend operating instructions.
  - l. Required sequences for electric or electronic systems.
  - m. Special operating instructions and procedures.
5. Adjustments: Include the following:

- a. Alignments.
  - b. Checking adjustments.
  - c. Noise and vibration adjustments.
  - d. Economy and efficiency adjustments.
- 6. Troubleshooting: Include the following:
  - a. Diagnostic instructions.
  - b. Test and inspection procedures.
- 7. Maintenance: Include the following:
  - a. Inspection procedures.
  - b. Types of cleaning agents to be used and methods of cleaning.
  - c. List of cleaning agents and methods of cleaning detrimental to product.
  - d. Procedures for routine cleaning
  - e. Procedures for preventive maintenance.
  - f. Procedures for routine maintenance.
  - g. Instruction on use of special tools.
- 8. Repairs: Include the following:
  - a. Diagnosis instructions.
  - b. Repair instructions.
  - c. Disassembly; component removal, repair, and replacement; and reassembly instructions.
  - d. Instructions for identifying parts and components.
  - e. Review of spare parts needed for operation and maintenance.

### **PART 3 - EXECUTION**

#### **3.1 PREPARATION**

- A. Assemble educational materials necessary for instruction, including documentation and training module. Assemble training modules into a training manual organized in coordination with requirements in Section 007213 "General Conditions".
- B. Set up instructional equipment at instruction location.

#### **3.2 INSTRUCTION**

- A. Engage qualified instructors to instruct Owner's personnel to adjust, operate, and maintain systems, subsystems, and equipment not part of a system.
  - 1. Architect will furnish an instructor to describe basis of system design, operational requirements, criteria, and regulatory requirements.
  - 2. Owner will furnish an instructor to describe Owner's operational philosophy.
  - 3. Owner will furnish Contractor with names and positions of participants.

- B. Scheduling: Provide instruction at mutually agreed on times. For equipment that requires seasonal operation, provide similar instruction at start of each season.
  - 1. Schedule training with Owner with at least seven days' advance notice.
- C. Training Location and Reference Material: Conduct training on-site in the completed and fully operational facility using the actual equipment in-place. Conduct training using final operation and maintenance data submittals.
- D. Cleanup: Collect used and leftover educational materials and remove from Project site. Remove instructional equipment. Restore systems and equipment to condition existing before initial training use.

### **3.3 DEMONSTRATION AND TRAINING VIDEO RECORDINGS**

- A. General: Engage a qualified commercial videographer to record demonstration and training video recordings. Record each training module separately. Include classroom instructions and demonstrations, board diagrams, and other visual aids, but not student practice.
  - 1. At beginning of each training module, record each chart containing learning objective and lesson outline.
- B. Video: Provide minimum 640 x 480 video resolution converted to format file type acceptable to Owner, on electronic media.
  - 1. Electronic Media: Read-only format compact disc acceptable to Owner, with commercial-grade graphic label.
  - 2. File Hierarchy: Organize folder structure and file locations according to project manual table of contents. Provide complete screen-based menu.
  - 3. File Names: Utilize file names based upon name of equipment generally described in video segment, as identified in Project specifications.
  - 4. Contractor and Installer Contact File: Using appropriate software, create a file for inclusion on the Equipment Demonstration and Training DVD that describes the following for each Contractor involved on the Project, arranged according to Project table of contents:
    - a. Name of Contractor/Installer.
    - b. Business address.
    - c. Business phone number.
    - d. Point of contact.
    - e. E-mail address.
- C. Recording: Mount camera on tripod before starting recording, unless otherwise necessary to adequately cover area of demonstration and training. Display continuous running time.
  - 1. Film training session(s) in segments not to exceed 15 minutes.
    - a. Produce segments to present a single significant piece of equipment per segment.
    - b. Organize segments with multiple pieces of equipment to follow order of Project Manual table of contents.

- c. Where a training session on a particular piece of equipment exceeds 15 minutes, stop filming and pause training session. Begin training session again upon commencement of new filming segment.
- D. Light Levels: Verify light levels are adequate to properly light equipment. Verify equipment markings are clearly visible prior to recording.
  - 1. Furnish additional portable lighting as required.
- E. Narration: Describe scenes on video recording by audio narration by microphone while video recording is recorded. Include description of items being viewed.
- F. Transcript: Provide a transcript of the narration. Display images and running time captured from videotape opposite the corresponding narration segment.
- G. Preproduced Video Recordings: Provide video recordings used as a component of training modules in same format as recordings of live training.

**END OF SECTION 017900**

## **SECTION 040342 – TREATMENT OF HISTORIC STONE MASONRY FLOORING**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section includes historic treatment work consisting of repairing historic stone assemblies as follows:
  - 1. Replacement of Phenix Marble floor stone units.
  - 2. Careful removal of select areas of damaged or severely worn limestone for repair of floor by replacement of full units to match historic configuration and finishes.
  - 3. Coordination of installation of door hardware in floor.
  - 4. Polishing and/or honing of patches and replaced units to match appearance of historic adjacent limestone and to provide level surface.
- B. Related Requirements:
  - 1. Section 013591 "Historic Treatment Procedures."
  - 2. Section 057001 "Custom Bronze Vestibule."

#### **1.3 REFERENCES**

- A. Marble Institute of America
  - 1. MIA Design Manual, Current Edition.

#### **1.4 DEFINITIONS**

- A. Face Bedding: Setting of stone with the rift or natural bedding planes (strata) vertical and parallel to the wall plane rather than horizontal or "naturally bedded," which holds bedding planes together by gravity.
- B. Rebuilding (Setting) Mortar: Mortar used to set and anchor masonry in a structure, distinct from pointing mortar installed after masonry is set in place.
- C. Rift: The most pronounced direction of splitting or cleavage of a stone.

- D. Stone Terminology: ASTM C 119.

## **1.5 PREINSTALLATION MEETINGS**

- A. Preinstallation Conference: Conduct conference at Project site.
1. Review methods and procedures related to repairing historic stone masonry including, but not limited to, the following:
    - a. Verify historic treatment specialist's personnel, equipment, and facilities needed to make progress and avoid delays.
    - b. Materials, material application, sequencing, tolerances, and required clearances.
    - c. Quality-control program.
    - d. Coordination with building occupants.

## **1.6 SEQUENCING AND SCHEDULING**

- A. Work Sequence: Perform stone historic treatment work in the following sequence, which includes work specified in this and other Sections:
1. Clean stone.
  2. Rake out mortar with hand tools from joints surrounding stone to be replaced and from joints adjacent to stone repairs along joints.
  3. Repair stonework, including replacing existing stone with new or salvaged stone. If required, repair backup masonry and setting mortar/setting bed.
  4. Rake out mortar with hand tools from joints to be repointed.
  5. Point mortar and sealant joints.
  6. After repairs and repointing have been completed and cured, perform a final cleaning to remove residues from this work

## **1.7 ACTION SUBMITTALS**

- A. Product Data: For each type of product.
1. Include recommendations for product application and use. Include test data substantiating that products comply with requirements.
- B. Shop Drawings: Submit fabrication and setting drawings for each type and size of new stone element. Show details, dimensions and cross section, and location and relationship to adjacent materials in sufficient detail to cover handling and installation. Show existing bedding plane direction, as well as new stone bedding plane direction. Include size, type and location of reinforcement and any special reinforcement and lifting devices necessary for handling and installation. Assign each new element a separate identification mark on the shop drawings to show the location for installation.
1. Show replacement units length, width, and thickness.

2. Show locations of stone floor units to be replaced, in context of those to remain. Describe method of removal and replacement to ensure existing historic materials are not damaged.
3. Include plans, elevations, sections, and locations of stone repair work on the structure.
4. Indicate complete dimensions for each stone unit and its jointing, showing relation of existing to new units.
5. Show existing direction of veining, grain, or other directional patterns, and match new to existing.

C. Samples for Initial Selection: For the following:

1. Colored Mortar: Submit sets of mortar that will be left exposed in the form of sample mortar strips, **6 inches (150 mm)** long by [**1/4 inch (6 mm)**] [**1/2 inch (13 mm)**] wide, set in aluminum or plastic channels.
  - a. Have each set contain a close color range of at least **six (6)** samples of custom mixes of colored sands and cements that produce a mortar matching existing, cleaned mortar when cured and dry.
  - b. Submit with precise measurements on ingredients, proportions, gradations, and sources of colored sands from which each Sample was made.
2. Include similar Samples of accessories involving color selection.

D. Samples for Verification: For the following:

1. Replacement stone. Include sets of Samples to show full range of color, texture, grain, veining, and finish to be expected. Provide sets of at least **three (3) 12-by-12-inch (300-by-300-mm)** samples
2. Accessories: Each type of anchor, accessory, and miscellaneous support.

## 1.8 INFORMATIONAL SUBMITTALS

- A. Qualification Data: For historic treatment specialists including field supervisors and workers and testing service.
- B. Quality-control program.

## 1.9 QUALITY ASSURANCE

- A. Quality-Control Program: Prepare a written quality-control program for this Project to systematically demonstrate the ability of personnel to properly follow methods and use materials and tools without damaging masonry. Include provisions for supervising worker performance and preventing damage.
- B. All work is to be done by first-class workmen experienced in the best and accepted methods of masonry.

## **PART 2 - PRODUCTS**

### **2.1 PERFORMANCE REQUIREMENTS**

- A. Stone masonry repairs to be completed using gentlest means possible to achieve desired results. Repairs to existing stone masonry to match existing adjacent in composition and appearance. Stone masonry replacement to match existing adjacent in color, texture and finish including slip resistance at walking surfaces, if applicable. Restoration of finishes to a "like-new" appearance is not the desired result. Stone masonry cleaning to achieve removal of staining, miscellaneous adhesives and paint coatings, and general surface cleaning without damage to existing finishes.

### **2.2 MASONRY MATERIALS**

- A. Stone Matching Existing: Provide natural building stone of variety, color, texture, grain, pore structure/sizes, veining, finish, size, thickness, and shape to match existing stone and with physical properties as listed below:
  - 1. For existing stone that exhibits a range of colors, textures, grains, veining, finishes, sizes, or shapes, provide stone that proportionally matches that range rather than stone that matches an individual color, texture, grain, veining, finish, size, or shape within that range. Dutchman to be selected from range to match mother stone.
  - 2. Quarry: Subject to compliance with requirements, provide stone from a quarry that can provide matching stone.
    - a. Limestone Quarries, subject to compliance and ability to exactly match existing stone.
      - 1) Phenix Marble Company, Ashgrove, Missouri
      - 2) Contractors may submit potential sources and samples for approval within one week of notice to proceed.
- B. Quarrying Stone: Have quarry clearly label the direction of rift or bedding planes when rough stone is quarried, to facilitate cutting stones so that natural bedding planes are as required in "Cutting Stone" Paragraph.
- C. Cutting Stone: Cut each stone so that, when it is set in final position, the rift or natural bedding planes, veining, pattern, and other characteristics match that of the stone in which it is being set or when replacing an entire stone match that of the stone being replaced.
- D. Date Identification: Stamp with permanent, nonbleeding ink on a concealed, interior surface of each stone in easily read 1/4-inch- ((6-mm-))high characters, "MADE 2025 [or date as appropriate]."

### **2.3 COATING FOR FERROUS ANCHORS OR METAL ATTACHMENTS**

- A. Chembuild 135 Prime Coat and 740 Endura-Shield Top Coat by Tnemec Company, Inc. P.O. Box 411749, Kansas City, MO, 64141-1749, or approved equal.

## **2.4 ACCESSORY MATERIALS**

- A. Protection Materials: Protect all adjacent surfaces from harmful effects of masonry restoration work, including other masonry materials.
  - 1. Liquid Strippable Masking Agent: Manufacturer's standard liquid, film-forming, strippable masking material for protecting glass, metal, and other adjacent materials to be protected from damaging effects of cleaning agents. Ensure compatibility with all materials prior to use, to prevent damage and ensure complete removal from substrates.
    - a. Sure Klean Strippable Masking, manufactured by ProSoCo, Inc., Kansas City, KS
    - b. Or approved equal.
  - 2. Polyethylene film, minimum 4 mil and masking tape can be used as temporary protection. Ensure that temporary measures are adequate to prevent damage to materials.
  - 3. Protection materials to contain all materials. Properly dispose of all materials, overspray, and runoff.
- B. Water for Cleaning: Clean, potable, free of oils, acids, alkalis, salts, and organic matter. Provide all hoses, valve connections, pumps, nozzles and other necessary water conveying components to provide water where needed.
- C. Brushes: Natural or fiber bristle only.
- D. Scrapers: Plastic or wood only. Do not use metallic scrapers.
- E. Coloring Pastes for use with Limestone repair composites:
  - 1. AKEMI Coloring Pastes, or approved equal.
- F. Miscellaneous Anchors and Attachments:
  - 1. Stainless Steel unless otherwise approved, as needed for complete installation of replacement stone elements and panels.

## **2.5 MORTAR MATERIALS**

- A. Portland Cement: ASTM C 150/C 150M, Type I; white or gray where required for color matching of mortar. Free of contaminants, alkalis, and organic matter.
- B. Hydrated Lime: ASTM C 207, Type S Autoclaved
- C. Mortar Sand: ASTM C 144 unless otherwise indicated.
  - 1. Match size, texture, and gradation of existing mortar sand as closely as possible. Blend several sands if necessary to achieve suitable match.
  - 2. Colored Mortar: Provide natural sand or ground limestone, granite, or other sound stone of color necessary to produce required mortar color.
  - 3. For exposed mortar, provide sand with rounded edges.

- D. Mortar Pigments: ASTM C 979/C 979M, compounded for use in mortar mixes, and having a record of satisfactory performance in masonry mortars.
  - 1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Davis Colors; True Tone Mortar Colors.
    - b. Lanxess Corporation; Bayferrox Iron Oxide Pigments.
    - c. Solomon Colors, Inc.; SGS Mortar Colors.
    - d. Or approved equal.
- E. Water: Potable and free of contaminants, alkalis, and organic matter.

## 2.6 MORTAR MIXES

- A. Measurement and Mixing: Measure cementitious materials and sand in a dry condition by volume or equivalent weight. Do not measure by shovel; use known measure. Mix materials in a clean, mechanical batch mixer.
- B. Colored Mortar: Produce mortar of color required by using specified ingredients. Do not alter specified proportions without Architect's approval.
  - 1. Mortar Pigments: Oxide pigments as needed to match original mortar color. Where mortar pigments are indicated, do not add pigment exceeding 10 percent by weight of the cementitious or binder materials, except for carbon black which is limited to 2 percent, unless otherwise demonstrated by a satisfactory history of performance.
- C. Do not use admixtures in mortar unless otherwise indicated or approved.
- D. Mixes: Mix mortar materials as indicated below to match existing (subject to the results of mortar analysis and mixes approved by the Architect):
  - 1. Setting Mortar:
    - a. 1 part Portland Cement
    - b. 2 parts Mortar Sand
    - c. Tempered with Hydrated Lime as necessary.
  - 2. Pointing Mortar
    - a. 1 part Portland Cement
    - b. 1 part Mortar Sand

## PART 3 - EXECUTION

### 3.1 HISTORIC TREATMENT SPECIALIST

- A. For historic treatment specialists with experience in masonry restoration, including field supervisors and workers and testing service.

### **3.2 PROTECTION**

- A. Prevent mortar from staining face of surrounding stone and other surfaces.
  - 1. Cover existing items to protect them from mortar droppings.
  - 2. Immediately remove mortar splatters in contact with exposed masonry and other surfaces.
  - 3. Use grout sponges, brushes and clear water to remove uncured or partly cured mortar smears.
  - 4. It is not the intent of this Work to apply acidic cleaners to remove mortar smears.

### **3.3 STONE REPAIR, GENERAL**

- A. Repair Appearance Standard: Areas of replaced units are to have a uniform appearance as viewed from 20 feet (6 m) away by Architect. Maintain established joint widths, veining, and coloring patterns.

### **3.4 STONE REMOVAL AND REPLACEMENT**

- A. At locations indicated, remove stone that has deteriorated or is damaged beyond repair. Remove, catalogue, salvage, and store stone that is scheduled for demolition for potential reuse. Carefully remove entire units from joint to joint, without damaging stone to be removed or surrounding masonry, in a manner that permits replacement with full-size units.
- B. Notify Architect of unforeseen detrimental conditions including voids, cracks, bulges, loose units in existing stone or unit masonry backup, rotted wood, rusted metal, and other deteriorated items.
- C. Remove in an undamaged condition as many whole stone units as possible.
  - 1. Remove mortar, loose particles, and soil from stone by cleaning with hand chisels, brushes, and water.
  - 2. Remove sealants by cutting close to stone with utility knife and cleaning with solvents.
  - 3. Store stone for reuse. Store off ground, on skids, and protected from weather.
  - 4. Deliver cleaned stone not required for reuse to State unless otherwise indicated.
- D. Clean masonry surrounding removal areas by removing mortar, dust, and loose particles in preparation for stone replacement.
- E. Replace removed damaged stone with salvaged stone in good condition, where possible, or with new stone matching existing stone. Do not use broken units unless they can be cut to usable size.
- F. Rift: Do not allow face bedding of stone. Before setting, inspect to verify that each stone has been cut so that, when it is set in final position, the rift or natural bedding planes are predominantly horizontal. Reject stone with vertical bedding planes except as required for arches, lintels, and copings.
- G. Install replacement stone into bonding and coursing pattern of existing stone. If cutting is required, use a motor-driven saw designed to cut stone with clean, sharp, unchipped edges. Finish edges to blend with appearance of edges of existing stone.

1. Maintain joint width for replacement stone to match existing joints.
  2. Use setting buttons or shims to set stone accurately spaced with uniform joints to match original joint sizes.
- H. Set replacement stone with rebuilding (setting) mortar and with completely filled bed, head, and collar joints. Butter vertical joints for full width before setting and set units in full bed of mortar unless otherwise indicated. Replace existing anchors with new anchors as indicated or matching existing configuration.
1. Tool exposed mortar joints in repaired areas to match joints of surrounding existing stonework.
  2. Rake out mortar used for laying stone before mortar sets. Point at same time as repointing of surrounding area.
  3. When mortar is sufficiently hard to support units, remove shims and other devices interfering with pointing of joints.
- I. Curing: Cure mortar by maintaining in thoroughly damp condition for at least 72 consecutive hours, including weekends and holidays.
1. Hairline cracking within the mortar or mortar separation at edge of a joint is unacceptable. Completely remove such mortar and repoint.
  2. Allow for the placement of door hardware in stone units as determined by the vestibule system specialty manufacturer/installer.

### **3.5 FINAL CLEANING**

- A. After mortar has fully hardened, thoroughly clean exposed stone surfaces of excess mortar and foreign matter; use wood scrapers, stiff-nylon or -fiber brushes, and clean water applied by low-pressure spray.
1. Do not use metal scrapers or brushes.
  2. Do not use acidic or alkaline cleaners.
- B. Clean adjacent nonstone surfaces. Use detergent and soft brushes or cloths.
- C. Clean mortar and debris from roof; remove debris from gutters and downspouts. Rinse off roof and flush gutters and downspouts.
- D. Remove masking materials, leaving no residues that could trap dirt.
- E. Sweep and rake adjacent pavement and grounds to remove mortar and debris. Where necessary, pressure wash pavement surfaces to remove mortar, dust, dirt, and stains.

END OF SECTION 040342

## **SECTION 057001 – CUSTOM BRONZE VESTIBULE**

### **PART 1 - PART 1 – GENERAL**

#### **1.1 SCOPE**

- A. Work Included:
  - 1. Custom Cast Bronze Components
  - 2. Custom Vestibule Steel Structure and Anchors
  - 3. Custom Bronze Clad Doors and associated custom hardware
- B. Related Requirements:
  - 1. Section 04 0342 – “Treatment of Historic Stone Masonry Flooring”
  - 2. Section 07 9200 – “Joint Sealants.”
  - 3. Section 08 8853 – “Security Glazing.”

#### **1.2 REFERENCE STANDARDS**

- A. Except as otherwise specified, comply with documents listed below:
  - 1. AISI – American Iron and Steel Institute
  - 2. ANSI – American National Standards Institute
  - 3. ASTM – American Society for Testing and Materials
  - 4. AWS – American Welding Society
  - 5. FS – Federal Specifications
  - 6. MIL – Military Specifications
  - 7. NAAMM – National Association of Architectural Metal Manufacturers
  - 8. OSHA – Occupational Safety and Health Administration
  - 9. Local Codes

#### **1.3 DEFINITIONS**

- A. “Custom Bronze Vestibule System”: Consisting of cast bronze components, including all sheets, plates, extruded shapes and castings, carbon steel structure and associated steel alloys, and a complete door system including all associated hardware.

#### **1.4 PREFABRICATION MEETINGS**

- A. Prefabrication Conference: Conduct conference virtually.
  - 1. Review minutes of Preliminary Historic Treatment Conference that pertain to replication and installation of historic decorative metal items and whole assemblies.
  - 2. Review methods and procedures related to fabrication and installation of decorative custom bronze vestibule system items and whole assemblies including, but not limited to, the following:
    - a. Custom bronze castings.
    - b. Steel Structure.
    - c. Custom Doors and Custom Door Hardware.

d. Materials, material application, sequencing, tolerances, and required clearances.

B. Field Quality Control Conference: Conduct conference at the manufacturer's shop in accordance with Article 1.8 Field Quality Control.

## **1.5 QUALITY ASSURANCE**

A. Contractor's Responsibilities:

1. Prior to submission of a bid, examine and study the Drawings and Specifications to ensure that the work as described is complete and, if not, submit written notifications to the Architect noting the discrepancies.
2. Prior to submission of bid, coordinate and verify, by measurement at the job site, dimensions affecting the Work. Submit written notification documenting field dimensions and conditions which are at variance with the Contract Drawings or are detrimental to the proper and timely installation of job site materials. Decisions regarding corrective measures shall be provided prior to the bid date.
3. Accommodate deviation or change in the development of shop drawings and in the erection sequence without altering the design profiles.
4. Ensure the compatibility of adjacent architectural elements and accommodate proper connections in relation to this work.
5. Facilitate access to manufacturer's shop and assembly point to allow the Architect and Owner's designated representatives to view, inspect, and verify the process and methods employed in the fabrication, finishing, and preassembling of vestibule system including cast bronze components, steel structure, and doors with associated hardware.

B. Design Responsibility:

1. Criteria for custom cast bronze components as indicated on the drawings and herein specified are for the sole purpose of defining the design intent, acceptable profiles and performance requirements, including but not limited to: accommodation of shear stresses and movement in sealant joints and the opening of joinery during dynamic movements. Metal joinery within, adjacent, and common to the ornamental metal work shall maintain structural weathering integrity when subjected to the performance criteria. Submissions of the design, fabrication erection or performance of the work is the responsibility of the contractor.
2. Arrange for access to the manufacturer's shop and assembly point to allow the Owner's designated representatives to view, inspect, and verify the process and methods employed in the fabrication, finishing, and preassembling of vestibule system including cast bronze components, steel structure, and doors with associated hardware. The Architect will have the right to reject components and assemblies during shop assembly and erection prior to delivery to site if the workmanship and intent are not in strict accordance with the approved shop drawings, structural calculations, documentation, and samples as herein specified.

C. Fabrication/Manufacture and Erection: Execute work using skilled workmen, specially trained and experienced in the applicable trades employed in full conformity and applicable provisions of the listed References and Standards and as otherwise indicated on the drawings and in conformance with final shop drawings and samples and related data.

D. Manufacturer Qualifications: Approved manufacturer(s) included in Article 2.2. A firm or contractor not currently listed as an approved manufacturer that is experienced in bronze casting

and vestibule systems who have completed vestibule systems similar in material and scale to that indicated for this Project with a record of at least ten (10) years of successful custom bronze architectural metalwork performance must submit substitution request and qualifications per Article 1.5.E. Fabricators assigned to the project must have ten (10) years of experience in custom bronze architectural metalwork.

- E. Qualifications of welders and welding operators, filler metals, welding techniques and procedures shall be in accordance with AISC Specifications for the Design, Fabrication, and Erection of Structural Steel Building, and the AWS Code for Welding in Building Construction.
- F. All Field welders shall be certified by the Testing Laboratory. Certifications shall be no more than six (6) months old during the time of welding in the erection period.
- G. Source Limitations: All vestibule system components shall be assembled by and installed under the control and responsibility of the approved manufacturer.

## **1.6 SUBMITTALS**

- A. Shop Drawings:
  - 1. Shop drawings shall incorporate plans, elevations, sections and details, including details of cast bronze components and adjoining work (N.I.C.) for coordination purposes. The details shall indicate: metal thicknesses, types and finishes, sealant materials and locations, direction and magnitude of thermal expansion and applicable building movement, type of construction (joinery, fasteners, welds, anchorage assemblies and components), the casting fabrication and erection tolerance, and adjoining related work, and the layout of inserts. The shop drawing details shall make reference to the detail numbers and drawing numbers.
    - a. Coordinate with Section 08 8853 "Security Glazing" and Section 04 0342 "Treatment of Historic Stone Masonry Flooring"
  - 2. Indicate hardware, types of bolts, toggles, connectors and assembly materials on shop drawings, including size, material, spacing and torque tightening requirements.
  - 3. Dimension all joint gaps which shall depend upon dynamic movement function of joint.
  - 4. Prepare schedule, sealants, primers, back-up, tapes, separators, and related instructions.
- B. Samples: Submit sets of samples showing color, texture, finish, and other characteristics. Approval of samples shall be obtained from the Architect/Owner prior to the casting and finishing of components.
- C. Patterns, Models, or Plaster Castings: Made from proposed patterns for each design of custom castings required.
- D. Structural Calculations:
  - 1. Structural Calculations shall be prepared, stamped and signed by a Structural Engineer registered in the State of Missouri. Calculations shall include, but not be limited to, the justification of ornamental elements, assemblies, connections and anchorage in static and dynamic modes.
  - 2. Cross-reference structural calculation to the applicable shop drawing details.
- E. In-plant and jobsite quality control procedures: Document in writing and submit for review. Documentation shall include schedules, details, isometric or explanatory sketches cross-

referenced to the shop drawings as required to ensure that both fabrication and installation are in accordance with the Contract Documents. In-plant quality control procedures will include, but are not necessarily limited to the following:

1. Finishing Fabrication: Procedures and controls, tolerance, joinery, sleeves, contour clips, etc.
2. Finish and Match: Procedures required for the match of exposed surfaces.
3. Assembly (and preassembled units): Welds, fasteners, sealants, gasket for separators, etc.
4. Sealing (and preassembled units): As recommended by the sealant manufacturers. Include sealant documentation.
5. Material Handling: Procedures, care, protection, shipping storage, etc.

F. Qualification Data: For firms and contractors specified in the “Quality Assurance” Article to demonstrate their capabilities and experience. Contractor/manufacturers seeking approval as a qualified substitution shall provide the following Statement of Qualifications.

1. Vestibule Systems manufacturer shall provide:
  - a. Documentation of expertise in cast bronze, structural steel, ballistic ratings, custom bronze door manufacturing and operation.
  - b. Documentation of expertise in accurately assessing statuary bronze finishes.
  - c. Documentation of assembling complete vestibule systems, excluding glazing, in shop for inspection and verification.
  - d. Documentation of manpower necessary to execute the work within the duration allowed in the project schedule.
  - e. Period of time the company has been performing the type of work required in this Section as a contractor/manufacturer.
  - f. Complete lists of comparable completed projects and scope of work. Identify for each project the name, address, architect, facility contact person and telephone number, type of work installed, and special project conditions and requirements. Photographs of cast bronze and vestibule systems of similar scale to that required for this project on a historical structure will also be furnished.
  - g. Drawing details and written data illustrating the compatibility to document completed work for a comparable completed project.
  - h. Furnish evidence of current workload, and evidence of personnel and facilities available to perform the work required for the timely completion of the work of this project.
  - i. Failure to meet these requirements and qualification will be sufficient causes for rejection as an approved substitution.

## 1.7 MOCKUPS

A. General: Build mockups of approved patterns, models, or plaster castings to verify selections made under samples submittals and to demonstrate aesthetic effects and set quality standards for fabrication and installation.

1. Build mockups for the following components of the custom bronze vestibule system:
  - a. Ornamental Push Plate
  - b. Ornamental Pull Handle
  - c. Corner Mullion with Ornamental Vestibule Base Assembly - 12” x 12” x 16”
  - d. Door stile and rail corner – 12” x 12”
2. Locate mockups in manufacturer’s shop. Mockups to be full size.
3. Retain and maintain mock-ups during construction in an undisturbed condition as a standard for judging completed work.

4. Approved mock-ups in an undisturbed condition at Date of Substantial Completion may become part of completed work.

## **1.8 FIELD QUALITY CONTROL**

- A. Prior to final approval of shop drawings and commencement of fabrication, the Contractor shall coordinate a visit to the fabrication facility by the Architect and the Owner's designated representative. The purpose of this visit is to verify compliance with specified materials, fabrication methods, and quality standards. The Contractor shall provide a minimum of 10 working days' notice to schedule the visit and ensure that representative samples, mock-ups, and fabrication processes are available for review.
  1. This visit shall not relieve the Contractor of responsibility for compliance with the Contract Documents, nor shall it constitute acceptance of materials or workmanship.

## **1.9 PRODUCT DELIVERY, STORAGE AND HANDLING**

- A. Preassemble items in the shop to the greatest extent possible, including cast bronze components, steel structure, and doors with associated hardware, so as to minimize field splicing and assembly of units at the Project. Disassemble units only to the extent necessary for shipping and handling. Clearly mark units for re-assembly and coordinated installation.
- B. Provide effective protection for finishes during shipping and erection.
- C. Remove delivered materials from the site which are not suitable for installation and replace with new materials.

## **PART 2 - PART 2 – PRODUCTS**

### **2.1 PERFORMANCE CRITERIA**

- A. Comply with applicable Codes, including the latest supplements and jurisdictional authorities. When applicable codes differ, or where more restrictive provisions are indicated, the loads shall act in combinations that provide the most unfavorable conditions, and the more restrictive provisions shall govern. The performance requirements shall include, but not necessarily be limited to the following items:
  1. Thermal Movement: Provide and/or make allowances for free and noiseless vertical and horizontal thermal movement due to the contraction and expansion of component parts, for an operations temperature from 10F to 108F. Buckling, opening of joints, undue stress on fasteners, failure of sealants or any other detrimental effects due to thermal movement of component parts shall not be permitted. Fabrication, assembly and erection procedures should take into account the ambient temperature range at the time of the respective operation.
  2. Structural Design Loads: Ornamental metal assemblies shall be designed for axial, flexural, shear and torsional stresses, and any combination thereof, due to wind, seismic, thermal and gravity loads. Design for these loads shall comply with the applicable requirements of the local codes.
    - a. Vertical deflection of members supporting glazing: L/600
    - b. Horizontal deflection of members supporting wind load: L/360

3. Wind Loads (Positive Pressures and Negative Suctions): The wind loads on the cast bronze components and their connections shall be as indicated on the Architectural Drawings.
  - a. Tributary Area 20 SQ SF or less; -44.3psf/34.2psf
  - b. Tributary Area 50 SQ SF; -42.3psf/31.2psf
  - c. Tributary Area 100 SQ SF; -40.2psf/29.7psf
  - d. Tributary Area 200 SQ SF; -38.2psf/28.2psf
  - e. Tributary Area 500 SQ SF or more; -36.1psf/25.3psf

## 2.2 MANUFACTURER

- A. General: Custom Bronze Vestibule system work shall be performed by a single manufacturer in conformance with Contract Documents.
  1. Manufacturers:
    - a. Historical Arts and Castings Inc. (Basis-of-design)  
5580 West Bagley Park Road, West Jordan, UT 84081  
1-800-225-1414
    - b. Robinson Iron  
1856 Robinson Road, Alexander City, AL 35010  
1-800-824-2157
    - c. Allen Architectural Metals  
248 Homer Drive, Talladega, AL 35160  
256-761-2609
    - d. Substitutions: See Section 012600 – CONTRACT MODIFICATION PROCEDURES
  2. Substitutions: Requests for substitution and manufacturer approval for the vestibule system, in compliance with the specifications, must be submitted in accordance with the procedures and time frames outlined in 002113 “Instructions to Bidders” and Article 1.6-F “Qualifications Data” of this specification.
- B. Metals
  1. Metals shall be produced by Clark Metals, Julius Blum, Federated Metals Corporation, or equivalent.
    - a. Bronze Alloys:
      - 1) Bronze shall be a minimum 1/4” thickness.
      - 2) Casting Alloy: CDA 875
      - 3)
      - 4) Sheet and Plate: 464 Naval Brass
      - 5) Extruded Shapes: ASTM B-221, architectural 385 bronze alloy, 360 yellow brass.
      - 6) Welding Rods and Bare Electrodes: AWA A5.10 Everdur 501 alloy, custom welding rods by manufacturer to match alloy.
    - b. Carbon Steel:
      - 1) American Iron and Steel Institute’s “Steel Products Manual.”
      - 2) Rolled Shapes, Plates and Bars: ASTM A-36 or ASTM A-283.
    - c. Steel Alloys:
      - 1) Armor Plate: AR500.

C. Custom Bronze Doors

1. Doors:
  - a. Door thickness: As indicated on Drawings.
  - b. Stiles: As indicated on Drawings.
  - c. Top rail: As indicated on Drawings.
  - d. Bottom rail: As indicated on Drawings.
  - e. Glass: As specified in Section 08 8853 "Security Glazing."
  - f. Infill Panel: Install AR500 steel armor plate as indicated on Drawings.
2. Hardware:
  - a. Floor Closer: Provided and installed by door manufacturer.
    - 1) ¾" Offset Heavy Duty Concealed Single-acting Floor Closer.
    - 2) Capable of functioning with a door weight of up to 1500 lbs.
    - 3) Selective hold open function.
    - 4) Sealed for interior/exterior use.
  - b. Ornamental Push Plate: Provided and installed by door manufacturer.
    - 1) Custom cast bronze. Design to be approved by Architect.
  - c. Ornamental Pull Handle: Provided and installed by door manufacturer.
    - 1) Custom cast bronze. Design to be approved by Architect.
  - d. Cylindrical Lock and Dead Bolt: Provided and installed by door manufacturer.
    - 1) To match owner's standard. Verify with owner.
    - 2) Installed in active leaf bottom rail. Receiver with dust cover to be installed recessed in finish floor.
  - e. Concealed Flushbolts: Provided and installed by door manufacturer.
    - 1) Installed on inactive leaf, top & bottom.
  - f. Electromagnetic Lock: Provided and installed by door manufacturer.
    - 1) Fully concealed shear lock mortise design.
    - 2) 3000 lb. hold force rating.
    - 3) Built-in automatic relock switch.
      - a) Adjustable time delay on relock.
    - 4) Door position switch.
    - 5) Battery back-up.
    - 6) ANSI/BHMA 156.23.
  - g. Weatherstripping: Provided and installed by the door manufacturer.
    - 1) Prevent the flow of air between interior and exterior.

**2.3 MISCELLANEOUS ITEMS**

A. Metal Protection:

1. Epoxy for Steel: 2-part polyamide epoxy.
  - a. Volume Solids:  $56.0 \pm 2.0\%$  (mixed).
  - b. Volatile Organic Compounds (VOC):
    - 1) Maximum unthinned: 3.02 lbs/gallon (362 grams/litre).
  - c. 2.0 to 6.0 (50 to 150 microns) per coat as recommended by manufacturer's instructions.
  - d. Concealed Parts: Install epoxy coating per manufacturer's instructions.

B. Fasteners

1. Type, size, alloy, quantity and spacing of the fasteners and anchorage devices shall be as required for performance.
2. Unless specifically indicated otherwise, bolts, and other fastening devices, including their

accessory items (washers, nuts, etc.): Cadmium plated on colored chromate incorporating self-locking devices and torque tightening, as required, to achieve the maximum torque tension relationship in the fasteners.

3. Fastening devices between bronze and bronze: brass fasteners, as recommended by manufacturer.
4. Fastening devices between bronze and dissimilar materials shall be 300 series non-magnetic stainless steel, as recommended by manufacturer.

C. Shims, Blocking and Spacers:

1. Unless specifically indicated otherwise, metals used for shims, and blocking at spacers shall be stainless steel and shall incorporate separators for dissimilar materials, and at dynamic connections where required.
2. Do not use plastic shims at structural connections or horseshoe (U) shaped shims at dynamic or other connections where they could work free.
3. Metals used for shims shall be galvanized steel (ASTM A-36 or A0283) where noted as steel and stainless steel (300 series) where noted as stainless steel. Use bronze or plastic shims only as approved by the Architect.

D. Tapes and Separators:

1. Separators between dissimilar materials and at dynamic connections shall be 10 Mil thick, self-adhesive sheet vinyl.
2. Shim/separators around bolts and screws shall be minimum 70 Durometer Commercial Grade neoprene washers.

## 2.4 METAL FINISHES

A. Exposed Bronze:

1. General: All bronze finishes shall match in appearance, quality and color the samples on file and approved by the Architect.
  - a. Statuary Bronze Finish per architect's approved sample.

## 2.5 FABRICATION AND MANUFACTURE

A. General:

1. All work shall be fabricated by an approved manufacturer in accordance with Article 1.3 "Quality Assurance".
2. No work shall be fabricated until the shop drawings, structural calculations and other related submittals, documentation and samples have been approved.
3. Work shall be carefully fabricated and assembled with provision for noiseless thermal expansion and contraction, fabrication and erection tolerances, adjoining building component tolerances and dynamic movements.
4. Work shall be true to detail with sharp, clean profiles, straight and free from defects, dents, marks, indentations, waves, or flaws of any nature impairing strength or appearance as compared to approved sample; fitted with proper joints and intersections and with specified finishes.
5. Provide bronze components with weep holes and other required internal slots and/or openings which shall be designed to promote the positive discharge of water and/or condensate.

- B. Welding: TIG (tungsten arc inert gas shielded) method or MIG (metal arc inert gas shielded) method may be used.
  - 1. Moderate strength welds: Everdur 501 filler alloy.
  - 2. High strength welds: Everdur 501 filler alloy.
- C. Casting Methods: Chemical bonded sand, Green sand:
  - 1. Casting alloy shall not be contaminated with other metals.
  - 2. Alloys shall be heated to 1,950 F. to 2,100 F, and skimmed before pouring.
  - 3. When removed from molds, castings shall be cleaned of foreign matter. Rough surfaces where gates, sprues, risers or other imperfections occur shall be ground and filed flush with adjacent surfaces. Imperfections shall not interfere with ornament. Fillers shall not be used except with the permission of Architect. Castings shall be hand smoothed.
  - 4. Castings shall be made in as large of sections as practicable. Joint locations shall be indicated on approved shop drawings.
  - 5. Provide necessary rebates, lugs, and brackets for assembly of units. Use concealed fasteners wherever possible.
  - 6. Castings which are not rebated shall be cast with integral lugs for connections to adjoining sections and abutting work. Sections shall be fitted together with shoulders and brackets. Large sections shall be reinforced on the backside with integrally cast ribs.
  - 7. Make provisions for shrinkage of castings so that finished pieces fit accurately.
- D. Workmanship
  - 1. Design all components for expansion and contraction without buckling, excessive opening or squeezing of joints, or over stressing of castings, welds and fasteners.
  - 2. Screws, rivets, and other fasteners shall be countersunk and finished flush with surfaces to which they are applied. Where fasteners must be available for disassembly in the future, they shall be countersunk and puttied over, with paint to match adjacent surfaces.
  - 3. Joints shall be as-cast finish 1/4" wide joints within 3/32" of true width and alignment, unless otherwise indicated. Cope or miter joints. Form joints to exclude water penetration.
  - 4. Welds behind finished surfaces shall not cause distortion or discoloration of the exposed side. Clean exposed welds of all flux and dress on exposed and contact surfaces.
  - 5. Completed assemblies shall have true curves, lines, and angles.
  - 6. Protection against galvanic action shall be provided wherever dissimilar metals are in contact.

## **PART 3 - PART 3 – EXECUTION**

### **3.1 INSPECTION**

- A. Examine surfaces and conditions to which this work is to be attached or applied to and notify the Architect if conditions or surfaces exist which are detrimental to the proper and expeditious installation of the work. Starting on the work shall imply acceptance of the surfaces and conditions to perform the work as specified.

### **3.2 INSTALLATION**

- A. Install materials specified herein within the temperature and humidity criteria recommended by the manufacture of each material. Under no circumstances shall materials be installed on

surfaces which contain frost, condensation, dirt, grime or other foreign encountered materials which will hinder or create a set of circumstances which will prevent the materials from properly being installed; and, once installed, from functioning for use intended.

- B. Sealant Application: Provide primers, back-up and sealants for exterior joints between bronze and bronze as part of the work of this contract. Work shall be performed in accordance with the applicable requirements of Section 079200 Joint Sealers.
- C. Protection and Cleaning:
  - 1. Upon completion of work, remove protective coverings from exposed surfaces, and clean surfaces of soil and discoloration. Cleaners shall be acceptable to bronze, glass, polycarbonate, gasket, and bronze finishing manufacturers.
  - 2. Care shall be exercised when cleaning the exterior portions of the building to protect the adjacent work, including sealants.
  - 3. Final Adjustment: The finished installation of the work included herein shall be free of defects as compared to approved sample. Before final completion and acceptance of the building, Contractor shall repair and/or replace, at his own expense, defective work to the satisfaction of the Architect.

**END OF SECTION 057001**

## **SECTION 079200 - JOINT SEALANTS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section Includes:
  - 1. Silicone joint sealants (Non-staining).
  - 2. Urethane joint sealants.
- B. Related Requirements:
  - 1. Section 057001 "Custom Bronze Vestibule"

#### **1.3 PREINSTALLATION MEETINGS**

- A. Preinstallation Conference: Conduct conference at Project site.
  - 1. Review minutes of Preliminary Historic Treatment Conference that pertain to stone historic treatment and repair.
  - 2. Review methods and procedures related to repairing historic stone masonry including, but not limited to, the following:
    - a. Verify historic treatment specialist's personnel, equipment, and facilities needed to make progress and avoid delays.
    - b. Materials, material application, sequencing, tolerances, and required clearances.
    - c. Quality-control program.
    - d. Fire-protection plan.
    - e. Coordination with building occupants.

#### **1.4 ACTION SUBMITTALS**

- A. Product Data: For each joint-sealant product.
- B. Samples for Initial Selection: Manufacturer's color charts consisting of strips of cured sealants showing the full range of colors available for each product exposed to view.
- C. Samples for Verification: For each kind and color of joint sealant required, provide a minimum of five Samples (per colors as selected in the Samples for Initial Selection) in the field as directed by the Architect in 12 inch long strips.

## **1.5 INFORMATIONAL SUBMITTALS**

- A. Qualification Data: For historic treatment specialists with experience in bronze replication, including field supervisors and workers and testing service.
- B. Product Test Reports: For each kind of joint sealant, for tests performed by manufacturer and witnessed by a qualified testing agency.
- C. Preconstruction Laboratory Test Reports: From sealant manufacturer, indicating the following:
  - 1. Materials forming joint substrates and joint-sealant backings have been tested for compatibility and adhesion with joint sealants.
  - 2. Interpretation of test results and written recommendations for primers and substrate preparation are needed for adhesion.

## **1.6 QUALITY ASSURANCE**

- A. Installer Qualifications: Contractor shall have a minimum of five (5) years of experience in installation of similar sealants on projects of similar size. The Contractor shall be approved by the Manufacturer of the sealant and written evidence of this approval shall be submitted to the Architect.
- B. Product Validation: Sealants must be tested and validated in accordance with the Sealant, Waterproofing, Restoration Institute's (SWRI) Product Validation. Manufacturer must provide up to date Product Validation from SWRI.
- C. Product Testing: Test joint sealants using a qualified testing agency.
  - 1. Testing Agency Qualifications: Qualified according to ASTM C 1021 to conduct the testing indicated and independent of the manufacturer
- D. Mockups: Install sealant in mockups of assemblies specified in other Sections that are indicated to receive joint sealants specified in this Section. Use materials and installation methods specified in this Section.

## **1.7 PRECONSTRUCTION TESTING**

- A. Preconstruction Laboratory Testing: Submit to joint-sealant manufacturers, for testing indicated below, samples of materials that will contact or affect joint sealants.
  - 1. Adhesion Testing: Use ASTM C 794 to determine whether priming and other specific joint preparation techniques are required to obtain rapid, optimum adhesion of joint sealants to joint substrates.
  - 2. Stain Testing: Use ASTM C 1248 to determine stain potential of sealant when in contact with stone and masonry substrates.
  - 3. Submit manufacturer's recommended number of pieces (minimum three each) of each type of stone material(s) to be supplied for the Work.
  - 4. Schedule sufficient time for testing and analyzing results to prevent delaying the Work.

5. For materials failing tests, obtain joint-sealant manufacturer's written instructions for corrective measures, including use of specially formulated primers. Retest with corrective recommendations.
- B. Preconstruction Field-Adhesion Testing: Before installing sealants, field test their adhesion to Project joint substrates as follows:
1. Locate test joints as directed by Architect.
  2. Conduct field tests for each kind of sealant and joint substrate, including each variety of stone both existing and provided as part of the Work.
  3. Notify Architect and Construction Representative seven days in advance of dates and times when test joints will be erected.
  4. Arrange for tests to take place with joint-sealant manufacturer's technical representative present.
    - a. Test Method: Test joint sealants according to Method A, Field-Applied Sealant Joint Hand Pull Tab, in Appendix X1.1 in ASTM C 1193 or Method A, Tail Procedure, in ASTM C 1521.
      - 1) For joints with dissimilar substrates, verify adhesion to each substrate separately; extend cut along one side, verifying adhesion to opposite side. Repeat procedure for opposite side.
  5. Report whether sealant failed to adhere to joint substrates or tore cohesively. Include data on pull distance used to test each kind of product and joint substrate. For sealants that fail adhesively, retest until satisfactory adhesion is obtained.
  6. Evaluation of Preconstruction Field-Adhesion-Test Results: Sealants not evidencing adhesive failure from testing, in absence of other indications of noncompliance with requirements, will be considered satisfactory. Do not use sealants that fail to adhere to joint substrates during testing.

## **1.8 FIELD CONDITIONS**

- A. Do not proceed with installation of joint sealants under the following conditions:
1. When ambient and substrate temperature conditions are outside limits permitted by joint-sealant manufacturer or are below 40 deg F (5 deg C).
  2. When joint substrates are wet.
  3. Where joint widths are less than those allowed by joint-sealant manufacturer for applications indicated.
  4. Where contaminants capable of interfering with adhesion have not yet been removed from joint substrates.

## **1.9 WARRANTY**

- A. Special Installer's Warranty: Installer agrees to repair or replace joint sealants that do not comply with performance and other requirements specified in this Section within specified warranty period. The Contractor shall warrant the workmanship on the sealant for a five-year (5) period

and that any corrective work (including all labor and material) necessary to maintain the watertight performance shall be performed at no cost to the Owner.

1. Warranty Period: Two (2) years from date of Substantial Completion.
- B. Special Manufacturer's Warranty: Manufacturer agrees to furnish joint sealants to repair or replace those joint sealants that do not comply with performance and other requirements specified in this Section within specified warranty period. The Sealant Manufacturer shall warrant their sealant will provide a watertight weatherseal and will not discolor or cause substrates to discolor or change their appearance due to fluid migration for ten (10) years. Warranty to include cost of replacement sealant material and cost of all labor to remove and replace sealant. Sealant Manufacturer or authorized representative to perform required testing (including field adhesion tests) to satisfy requirements for Manufacturer's warranty.
  1. Warranty Period: Ten (10) years from date of Substantial Completion.

## **PART 2 - PRODUCTS**

### **2.1 JOINT SEALANTS, GENERAL**

- A. Compatibility: Provide joint sealants, backings, and other related materials that are compatible with one another and with joint substrates under conditions of service and application, as demonstrated by joint-sealant manufacturer, based on testing and field experience.
- B. Stain-Test-Response Characteristics: Where sealants are specified to be non-staining to porous substrates, provide testing according to ASTM C 1248 with porous joint substrates to be included in Project.
- C. Products utilized are to meet the following testing criteria:
  - a. ASTM C661 – Indentation Hardness of Elastomeric Type Sealants, shore hardness of 35 minimum for horizontal traffic applications.
  - b. ASTM C719 – Adhesion & Cohesion of Elastomeric Joint Sealants Under Cyclic Movement.
  - c. ASTM C793 – Weathering Standard Test Method for Effects of Laboratory-accelerated Weathering on Elastomeric Joint Sealants.
- D. Colors of Exposed Joint Sealants: As selected by Architect from manufacturer's full range.

### **2.2 SILICONE JOINT SEALANTS**

- A. Silicone, S, NS, 100/50, NT: Single-component, nonsag, plus 100 percent and minus 50 percent movement capability, nontraffic-use, neutral-curing silicone joint sealant; ASTM C 920, Type S, Grade NS, Class 100/50, Use NT.
  1. Subject to compliance with requirements and preconstruction testing, available products that may be incorporated into the Work include, but are not limited to, the following:
    - a. Dow Corning Corporation: 790 Silicone Building Sealant

- b. GE Construction Sealants; Momentive Performance Materials Inc.: SilPruf LM SCS2700
  - c. Pecora Corporation: 890
  - d. Sika Corporation; Joint Sealants: SikaSil-C 990
  - e. Tremco Incorporated: Spectrem 800
  - f. Tremco Incorporated: Spectrem 1
  - g. Or approved equal
- B. Silicone, S, NS, 50, T: Single-component, nonsag, plus 50 percent and minus 50 percent movement capability, traffic- and nontraffic-use, neutral-curing silicone joint sealant; ASTM C 920, Type S, Grade NS, Class 50, Uses T.
  - 1. Subject to compliance with requirements and preconstruction testing, available products that may be incorporated into the Work include, but are not limited to, the following:
    - a. Dow Corning Corporation: 795
    - b. Tremco Incorporated: Spectrem 2
    - c. Or approved equal
- C. Silicone, S, NS, 50, NT: Single-component, nonsag, plus 50 percent and minus 50 percent movement capability, traffic- and nontraffic-use, neutral-curing silicone joint sealant; ASTM C 920, Type S, Grade NS, Class 50, Uses NT.
  - 1. Subject to compliance with requirements and preconstruction testing, available products that may be incorporated into the Work include, but are not limited to, the following:
    - a. GE Construction Sealants; Momentive Performance Materials Inc.: SilPruf NB SCS9000
    - b. Dow Corning Corporation: 756 SMS
    - c. Dow Corning Corporation: 795
    - d. Tremco Incorporated: Spectrem 3 and Spectrem 4
    - e. Sika Corporation: Sikasil WS-295
    - f. Or approved equal

## **2.3 URETHANE JOINT SEALANTS**

- A. Urethane, S, NS, 100/50, NT: Single-component, nonsag, plus 100 percent and minus 50 percent movement capability, nontraffic-use, urethane joint sealant; ASTM C 920, Type S, Grade NS, Class 100/50, Uses NT.
  - 1. Subject to compliance with requirements and preconstruction testing, available products that may be incorporated into the Work include, but are not limited to, the following:
    - a. Sika Corporation: Sikaflex 15LM
    - b. Tremco Incorporated: Vulkem 921
    - c. Or approved equal
- B. Urethane, M, NS, 50, NT: Multicomponent, nonsag, plus 50 percent and minus 50 percent movement capability nontraffic-use, urethane joint sealant; ASTM C 920, Type M, Grade NS, Class 50, Use NT.

1. Subject to compliance with requirements and preconstruction testing, available products that may be incorporated into the Work include, but are not limited to, the following:
  - a. Pecora Corporation: Dynatrol II
  - b. Tremco Incorporated: Dymeric 240
  - c. Or approved equal

## **2.4 JOINT-SEALANT BACKING**

- A. Sealant Backing Material, General: Nonstaining; compatible with joint substrates, sealants, primers, and other joint fillers; and approved for applications indicated by sealant manufacturer based on field experience and laboratory testing.
- B. Cylindrical Sealant Backings: ASTM C 1330, Type C (closed-cell material with a surface skin), and of size and density to control sealant depth and otherwise contribute to producing optimum sealant performance.
- C. Bond-Breaker Tape: Polyethylene tape or other plastic tape recommended by sealant manufacturer for preventing sealant from adhering to rigid, inflexible joint-filler materials or joint surfaces at back of joint. Provide self-adhesive tape where applicable.
- D. Expansion Joint Filler: Pre-formed, closed-cell polyethylene foam filler strips suitable for exterior traffic-bearing surfaces at-grade.

## **2.5 MISCELLANEOUS MATERIALS**

- A. Primer: Material recommended by joint-sealant manufacturer for adhesion of sealant to joint substrates indicated.
- B. Cleaners for Nonporous Surfaces: Chemical cleaners acceptable to manufacturers of sealants and sealant backing materials, free of oily residues or other substances capable of staining or harming joint substrates and adjacent nonporous surfaces in any way, and formulated to promote optimum adhesion of sealants to joint substrates.
- C. Masking Tape: Nonstaining, nonabsorbent material compatible with joint sealants and surfaces adjacent to joints.

## **PART 3 - EXECUTION**

### **3.1 GENERAL**

- A. Comply with installation recommendations in ASTM C1193 - Standard Guide for Use of Joint Sealants.

### **3.2 EXAMINATION**

- A. Examine joints indicated to receive joint sealants, with Installer present, for compliance with requirements for joint configuration, installation tolerances, and other conditions affecting performance of the Work.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

### **3.3 PREPARATION**

- A. Surface Cleaning of Joints: Clean out joints immediately before installing joint sealants to comply with joint-sealant manufacturer's written instructions and the following requirements:
  - 1. Remove all foreign material from joint substrates that could interfere with adhesion of joint sealant, including dust, paints (except for permanent, protective coatings tested and approved for sealant adhesion and compatibility by sealant manufacturer), old joint sealants, oil, grease, waterproofing, water repellents, water, surface dirt, and frost.
  - 2. Clean porous joint substrate surfaces by brushing or an approved mechanical abrading process (approved by Architect prior to work commencing), or a combination of these methods to produce a clean, sound substrate capable of developing optimum bond with joint sealants. Remove loose particles remaining after cleaning operations above by vacuuming or blowing out joints with oil-free compressed air. Porous joint substrates include the following:
    - a. Concrete.
    - b. Masonry (including Stone).
    - c. Previous Repairs of Mortar Compound Patching.
    - d. Wood.
  - 3. Remove laitance and form-release agents from concrete.
  - 4. Clean nonporous joint substrate surfaces that have not previously received sealant with chemical cleaners or other means that do not stain, harm substrates, or leave residues capable of interfering with adhesion of joint sealants. Nonporous joint substrates include the following:
    - a. Metal.
  - 5. For copper metal that has been previously sealed against, clean to bright metal.
- B. Joint Priming: Prime all joint. Apply primer to comply with joint-sealant manufacturer's written instructions. Confine primers to areas of joint-sealant bond; do not allow spillage or migration onto adjoining surfaces.
- C. Masking Tape: Use masking tape where required to prevent contact of sealant or primer with adjoining surfaces that otherwise would be permanently stained or damaged by such contact or by cleaning methods required to remove sealant smears. Remove tape immediately after tooling without disturbing joint seal.

### **3.4 INSTALLATION OF JOINT SEALANTS**

- A. General: Comply with joint-sealant manufacturer's written installation instructions for products and applications indicated, unless more stringent requirements apply.
- B. Sealant Installation Standard: Comply with recommendations in ASTM C 1193 for use of joint sealants as applicable to materials, applications, and conditions indicated.
- C. Install sealant backings of kind indicated to support sealants during application and at position required to produce cross-sectional shapes and depths of installed sealants relative to joint widths that allow optimum sealant movement capability.
  - 1. Do not leave gaps between ends of sealant backings.
  - 2. Do not stretch, twist, puncture, or tear sealant backings.
  - 3. Remove absorbent sealant backings that have become wet before sealant application, and replace them with dry materials.
- D. Install bond-breaker tape behind sealants where sealant backings are not used between sealants and backs of joints.
- E. Apply primer to all joints unless specifically not recommended by sealant manufacturer.
- F. Install sealants using proven techniques that comply with the following and at the same time backings are installed:
  - 1. Place sealants so they directly contact and fully wet joint substrates.
  - 2. Completely fill recesses in each joint configuration.
  - 3. Produce uniform, cross-sectional shapes and depths relative to joint widths that allow optimum sealant movement capability.
- G. Tooling of Nonsag Sealants: Immediately after sealant application and before skinning or curing begins, tool sealants according to requirements specified in subparagraphs below to form smooth, uniform beads of configuration indicated; to eliminate air pockets; and to ensure contact and adhesion of sealant with sides of joint.
  - 1. Remove excess sealant from surfaces adjacent to joints.
  - 2. Use tooling agents that are approved in writing by sealant manufacturer and that do not discolor sealants or adjacent surfaces.
  - 3. Provide joint profile to match the existing adjacent mortar joint tooling or concave joint profile per Figure 8A in ASTM C 1193 unless otherwise indicated.

### **3.5 FIELD QUALITY CONTROL**

- A. Field-Adhesion Testing: Field test joint-sealant adhesion to joint substrates as follows:
  - 1. Extent of Testing: Test completed and cured sealant joints as follows:
    - a. Perform 1 test for each kind of sealant and substrate of joint length as directed by Architect in the field. Existing and new stone provided as part of the Work shall be considered different, even when the type provided is the same.

- b. Perform one test for each 500 feet (150 m) of joint length thereafter. Perform a minimum of two additional tests for each failed test result.
  2. Test Method: Test joint sealants according to Method A, Field-Applied Sealant Joint Hand Pull Tab, in Appendix X1 in ASTM C 1193 or Method A, Tail Procedure, in ASTM C 1521.
  3. Inspect tested joints and report on the following:
    - a. Whether sealants filled joint cavities and are free of voids.
    - b. Whether sealant dimensions and configurations comply with specified requirements.
    - c. Whether sealants in joints connected to pulled-out portion failed to adhere to joint substrates or tore cohesively. Include data on pull distance used to test each kind of product and joint substrate. Compare these results to determine if adhesion complies with sealant manufacturer's field-adhesion hand-pull test criteria.
  4. Record test results in a field-adhesion-test log. Include dates when sealants were installed, names of persons who installed sealants, test dates, test locations, whether joints were primed, adhesion results and percent elongations, sealant material, sealant configuration, and sealant dimensions.
  5. Repair sealants pulled from test area by applying new sealants following same procedures used originally to seal joints. Ensure that original sealant surfaces are clean and that new sealant contacts original sealant.
- B. Evaluation of Field-Adhesion-Test Results: Sealants not evidencing adhesive failure from testing or noncompliance with other indicated requirements will be considered satisfactory. Remove sealants that fail to adhere to joint substrates during testing or to comply with other requirements. Retest failed applications until test results prove sealants comply with indicated requirements.

### **3.6 CLEANING**

- A. Clean off excess sealant or sealant smears adjacent to joints as the Work progresses by methods and with cleaning materials approved in writing by manufacturers of joint sealants and of products in which joints occur.

### **3.7 PROTECTION**

- A. Protect joint sealants during and after curing period from contact with contaminating substances and from damage resulting from construction operations or other causes so sealants are without deterioration or damage at time of Substantial Completion. If, despite such protection, damage or deterioration occurs, cut out, remove, and repair damaged or deteriorated joint sealants immediately so installations with repaired areas are indistinguishable from original work.

### **3.8 JOINT-SEALANT SCHEDULE**

- A. General:
  1. Products provided must have passed lab and field preconstruction testing and be compatible with adjacent materials.

2. Joints at or above the floor of the portico having generally been previously sealed with silicone joint sealants.
  3. Sealants will be applied to existing surfaces porous surfaces to remain (concrete and multiple varieties of stone) as well as porous substrates (stone and concrete) provided as part of the Work.
- B. Joint-Sealant Application: Exterior joints in horizontal traffic surfaces **JS-1**.
1. Joint Locations:
    - a. Joints between stone pavers and other materials.
    - b. Other joints as indicated on Drawings.
  2. Joint Sealant: Silicone, S, NS, 50, T.
  3. Joint-Sealant Color: As selected by Architect from manufacturer's full range of colors.
- C. Joint-Sealant Application: Exterior joints in vertical and non-traffic horizontal surfaces between different materials and exterior joints that have previously received silicone sealant **JS-2**.
1. Joint Locations:
    - a. Joints at perimeter of metal doors.
    - b. Joints at perimeter of wood doors and glazing.
    - c. Joints at the perimeter of metal transom.
    - d. Other joints as indicated on Drawings.
  2. Joint Sealant: Silicone, nonstaining, S, NS, 50 or 100/50, NT.
  3. Joint-Sealant Color: As selected by Architect from manufacturer's full range of colors.
- D. Joint-Sealant Application: Exterior joints in vertical surfaces and horizontal non-traffic surfaces that have not previously received silicone sealant **JS-3**.
1. Joint Locations:
    - a. Joints between bronze or other metal and masonry (where not previously sealed with silicone).
    - b. Other joints as indicated on Drawings.
  2. Joint Sealant: Urethane, S or M, NS, 100/50, NT.
  3. Joint-Sealant Color: As selected by Architect from manufacturer's full range of colors.
- E. Joint-Sealant Application: Exterior joints in vertical surfaces and horizontal non-traffic surfaces that have previously received silicone sealant **JS-4**.
1. Joint Locations:
    - a. Joints between bronze or other metal and masonry (where previously sealed with silicone).
    - b. Other joints as indicated on Drawings.
  2. Joint Sealant: Silicone, nonstaining, S, NS, 100/50, NT.
  3. Joint-Sealant Color: As selected by Architect from manufacturer's full range of colors.

**END OF SECTION 079200**

## **SECTION 088853 - SECURITY GLAZING**

### **PART 1 - GENERAL**

#### **1.1 SUMMARY**

- A. Section includes:
  - 1. Vestibule wall and ceiling glazing.
  - 2. Bronze Door Glazing.
- B. Related Requirements:
  - 1. Section 057001 "Custom Bronze Vestibule."

#### **1.2 DEFINITIONS**

- A. Glazing Manufacturers: Firms that produce primary glass, monolithic plastic glazing, or fabricated security glazing, as defined in referenced glazing publications.
- B. Interspace: Space between lites of air-gap security glazing or insulating security glazing.

#### **1.3 COORDINATION**

- A. Coordinate glazing channel dimensions to provide necessary bite on security glazing, minimum edge and face clearances, and adequate sealant thicknesses, with reasonable tolerances.

#### **1.4 ACTION SUBMITTALS**

- A. Product Data: For each type of product.
- B. Samples for Initial Selection: The manufacturer's standard color sheets show the full range of available colors for each type of glass tint, glass coating, sealant, and colored spacer.
- C. Samples for Verification:
  - 1. Glazing: Actual sample of finished products for each type of security glazing.
    - a. Size: 12 inches square.
- D. Security Glazing Schedule: List security glazing types and thicknesses for each size opening and location. Use same designations indicated on Drawings. Indicate coordinated dimensions of security glazing and construction that receives security glazing, including clearances and glazing channel dimensions.

#### **1.5 INFORMATIONAL SUBMITTALS**

- A. Test and Evaluation Reports:

1. Product Test Reports:
  - a. For each type of product indicated, from manufacturer.

B. Qualification Statements: For installers.

C. Sample warranties.

## **1.6 QUALITY ASSURANCE**

A. Qualifications:

1. Manufacturers: For insulating or air-gap security glazing units with sputter-coated, low-e coatings, a qualified insulating glazing manufacturer who is approved by coated-glass manufacturer.
2. Installers: Entity that employs installers and supervisors who are trained and approved by manufacturer.
3. Security Glazing Testing Agency: Subject to compliance with requirements, testing agency is one of the following:
  - a. Intertek.
  - b. Underwriters Laboratories, Inc.
  - c. Wiss, Janney, Elstner Associates, Inc.

## **1.7 DELIVERY, STORAGE, AND HANDLING**

- A. Protect security glazing and glazing materials according to manufacturer's written instructions. Prevent damage from condensation, temperature changes, direct exposure to sun, or other causes.
- B. Comply with insulating security glazing and with air-gap security glazing manufacturers' written recommendations for venting and sealing units to avoid hermetic seal ruptures due to altitude change.

## **1.8 FIELD CONDITIONS**

- A. Environmental Limitations: Do not proceed with glazing when ambient and substrate temperature conditions are outside limits permitted by glazing material manufacturers and when glazing channel substrates are wet from rain, frost, condensation, or other causes.
  1. Do not install glazing sealants when ambient and substrate temperature conditions are outside limits permitted by sealant manufacturer or below 40 deg F (4.4 deg C).

## **1.9 WARRANTY**

- A. Special Warranty, Coated Glass: Manufacturer agrees to replace coated glass that fails in materials or workmanship within specified warranty period.
  1. Failures include, but are not limited to, the following:

- a. Defects developed in coated glass from normal use that is not attributed to glass breakage or to maintaining and cleaning coated glass contrary to manufacturer's written instructions. Defects include peeling, cracking, and other indications of deterioration in coating.
  2. Warranty Period: 10 years from date of Substantial Completion.
- B. Special Warranty, Glass-Clad Polycarbonate Security Glazing: Manufacturer agrees to replace glass-clad polycarbonate security glazing that fails in materials or workmanship within specified warranty period.
  1. Failures include, but are not limited to, the following:
    - a. Defects developed from normal use that are not attributed to glass breakage or to maintaining and cleaning glass-clad polycarbonate security glazing contrary to manufacturer's written instructions. Defects include edge separation, delamination materially obstructing vision through glazing, blemishes exceeding those allowed by referenced polycarbonate standard, yellowing, and loss of light transmission.
  2. Warranty Period: 5 years from date of Substantial Completion.
- C. Special Warranty, Insulating Security Glazing: Manufacturer agrees to replace insulating security glazing that fails in materials and workmanship within specified warranty period.
  1. Failures include, but are not limited to, the following:
    - a. Defects in individual lites developed from normal use or failure of hermetic seal under normal use. Defects in individual lites or failure of hermetic seal that is attributed to glass breakage or to maintaining and cleaning insulating security glazing contrary to manufacturer's written instructions are not included.
    - b. Defects in coated-glass lites include peeling, cracking, and other indications of deterioration in coating.
    - c. Defects in laminated-glass lites include edge separation, delamination materially obstructing vision through glass, and blemishes exceeding those allowed by referenced laminated-glass standard.
    - d. Defects in glass-clad polycarbonate lites include edge separation, delamination materially obstructing vision through glazing, blemishes exceeding those allowed by referenced glass-clad polycarbonate standard, yellowing, and loss of light transmission.
    - e. Evidence of hermetic seal failure is the obstruction of vision by dust, moisture, or film on interior surfaces of glazing.
  2. Warranty Period: 10 years from date of Substantial Completion.

## **PART 2 - PRODUCTS**

### **2.1 SOURCE LIMITATIONS**

- A. Obtain each type of security glazing from single source from single manufacturer.

1. Obtain coated glass from single source from single manufacturer.
- B. Obtain glazing sealants and gaskets from single source from single manufacturer for each product and installation method.

## **2.2 PERFORMANCE REQUIREMENTS**

- A. General:
  1. Installed security glazing will withstand normal thermal movement and wind and impact loads (where applicable) without failure, including loss or breakage attributable to defective manufacture, fabrication, or installation; failure of sealants or gaskets to remain watertight and airtight; deterioration of glazing materials; or other defects in construction.
  2. Installed security glazing will withstand security-related loads and forces without damage to the glazing beyond that allowed by referenced standards.
- B. Structural Performance: Glazing will withstand the following design loads within limits and under conditions indicated.
  1. Design Procedure for Glass: ASTM E1300 and the IBC.
  2. Design Wind Pressures: Design glazing to withstand ultimate (LRFD) wind loads as indicated below.
    - a. Tributary area 20 sq ft or less; -44.3psf/34.2 psf
    - b. Tributary Area 50 sq ft; -42.3 psf/31.2 psf
    - c. Tributary Area 100 sq ft; -40.2 psf/29.7 psf
    - d. Tributary Area 200 sq ft; -38.2 psf/28.2 psf
    - e. Tributary Area 500 sq ft or more; -36.1 psf/25.3 psf
- C. Thermal Movements: Allow for thermal movements from ambient and surface temperature changes.
  1. Temperature Change: 120 deg F, ambient; 180 deg F, material surfaces.
- D. Safety Glazing: Where safety glazing is indicated, provide glazing that complies with 16 CFR 1201, Category II.

## **2.3 SECURITY GLAZING, GENERAL**

- A. Glazing Publications: Comply with published recommendations of security glazing and glazing material manufacturers and organizations below unless more stringent requirements are indicated. Refer to these publications for glazing terms not otherwise defined in this Section or in referenced standards.
  1. AAMA Publications: AAMA GDSG-1 and AAMA TIR-A7.
  2. IGMA Publication for Insulating Glass: SIGMA TM-3000.
  3. NGA Publications: "Laminated Glazing Reference Manual" and "GANA Glazing Manual."
- B. Insulating Glazing Certification Program: Permanently marked either on spacers or on at least one component lite of units with appropriate certification label of the Insulating Glass Certification Council.

- C. Thermal and Optical Performance Properties: Provide security glazing with performance properties specified, as indicated in manufacturer's published test data, based on construction products indicated and on procedures indicated below:
1. U-Factors: Center-of-glazing values, in accordance with NFRC 100 and based on most current non-beta version of LBL's WINDOW computer program, expressed as  $\text{Btu/sq. ft.} \times \text{h} \times \text{deg F} / (\text{W/sq. m} \times \text{K})$ .
  2. SHGC and Visible Transmittance: Center-of-glazing values, in accordance with NFRC 200 and based on most current non-beta version of LBL's WINDOW 7.7 computer program.
  3. Visible Reflectance: Center-of-glazing values, in accordance with NFRC 300.

## 2.4 GLASS PRODUCTS

- A. Float Glass: ASTM C1036, Type I, Quality-Q3, Class I (clear) unless otherwise indicated.
- B. Heat-Treated Float Glass: ASTM C1048; Type I; Quality-Q3; Class I (clear) unless otherwise indicated; of kind and condition indicated.
1. Fabrication Process: By horizontal (roller-hearth) process with roll-wave distortion parallel to bottom edge of glass as installed unless otherwise indicated.
  2. For heat-strengthened float glass, comply with requirements for Kind HS.
  3. For fully tempered float glass, comply with requirements for Kind FT.
  4. For uncoated glass, comply with requirements for Condition A.
  5. For coated vision glass, comply with requirements for Condition C (other coated glass).

## 2.5 LAMINATED-GLASS SECURITY GLAZING

- A. Laminated-Glass Security Glazing: ASTM C1172. Two or more glass lites bonded with interlayer. Use materials that have a proven record of no tendency to bubble, discolor, or lose physical and mechanical properties after fabrication and installation.
1. Interlayer Thickness: Provide thickness not less than that indicated and as needed to comply with requirements.
  2. Interlayer Color: Clear unless otherwise indicated.

## 2.6 POLYCARBONATE SECURITY GLAZING

- A. Glass-Clad Polycarbonate Security Glazing: ASTM C1349. One or more cores of polycarbonate sheet, clad with glass, bonded with clear urethane interlayer. Use materials that have a proven record of no tendency to bubble, discolor, or lose physical and mechanical properties after fabrication and installation.
- B. Laminated Glass and Polycarbonate: ASTM C1349. Two or more glass lites and polycarbonate bonded with interlayer. Use materials that have a proven record of no tendency to bubble, discolor, or lose physical and mechanical properties after fabrication and installation.

## **2.7 INSULATING SECURITY GLAZING**

- A. Insulating Security Glazing: Factory-assembled units, consisting of sealed lites of glazing material indicated separated by a dehydrated interspace, qualified in accordance with ASTM E2190
1. Sealing System: Dual seal, with manufacturer's standard primary and secondary sealants.
  2. Spacer: Manufacturer's standard spacer material and construction selected by Architect.
  3. Desiccant: Molecular sieve or silica gel, or blend of both.

## **2.8 GLAZING SEALANTS**

- A. General:
1. Compatibility: Provide glazing sealants that are compatible with one another and with other materials they contact, including security glazing, seals of insulating security glazing and air-gap security glazing, and glazing channel substrates, under conditions of service and application, as demonstrated by sealant manufacturer based on testing and field experience.
  2. Suitability: Comply with sealant and security glazing manufacturers' written instructions for selecting glazing sealants suitable for applications indicated and for conditions existing at time of installation.
  3. Colors of Exposed Glazing Sealants: As selected by Architect from manufacturer's full range of Industry colors.
- B. Glazing Sealant:
1. Neutral-Curing Silicone Glazing Sealant, Class 100/50: Complying with ASTM C920, Type S, Grade NS, Use NT.
    - a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
      - 1) Dow Corning Corporation.
      - 2) GE Construction Sealants; Momentive Performance Materials Inc.
      - 3) May National Associates, Inc.; a subsidiary of Sika Corporation.
      - 4) Pecora Corporation.
      - 5) Sika Corporation.

## **2.9 GLAZING TAPES**

- A. Back-Bedding Mastic Glazing Tapes: Preformed, butyl-based, 100 percent solids elastomeric tape; nonstaining and nonmigrating in contact with nonporous surfaces; with or without spacer rod as recommended in writing by tape and security glazing manufacturers for application indicated; and complying with ASTM C1281 and AAMA 800 for products indicated below:
1. AAMA 806.3 tape, for glazing applications in which tape is subject to continuous pressure.
  2. AAMA 807.3 tape, for glazing applications in which tape is not subject to continuous pressure.
- B. Expanded Cellular Glazing Tapes: Closed-cell, PVC foam tapes; factory coated with adhesive on both surfaces; and complying with AAMA 800 for the following types:

1. AAMA 810.1, Type 1, for glazing applications in which tape acts as the primary sealant.
2. AAMA 810.1, Type 2, for glazing applications in which tape is used in combination with a full bead of liquid sealant.

## **2.10 MISCELLANEOUS GLAZING MATERIALS**

- A. General: Provide products of material, size, and shape complying with referenced glazing standard, recommended in writing by manufacturers of security glazing and other glazing materials for application indicated, and with a proven record of compatibility with surfaces contacted in installation.
- B. Cleaners, Primers, and Sealers: Types recommended by sealant or gasket manufacturer.
- C. Setting Blocks:
  1. Elastomeric material with Shore A durometer hardness of 85, plus or minus 5.
  2. Type recommended in writing by sealant or glass manufacturer.
- D. Spacers:
  1. Elastomeric blocks or continuous extrusions of hardness required by security glazing manufacturer to maintain security glazing lites in place for installation indicated.
  2. Type recommended in writing by sealant or security glazing manufacturer.
- E. Edge Blocks:
  1. Elastomeric material with Shore A durometer hardness in accordance with manufacturer's written instructions.
  2. Type recommended in writing by sealant or security glazing manufacturer.

## **2.11 FABRICATION OF SECURITY GLAZING**

- A. Fabricate security glazing in sizes required to fit openings indicated for Project, with edge and face clearances, edge and surface conditions, and bite complying with written instructions of product manufacturer and referenced glazing publications, to comply with system performance requirements.

## **PART 3 - EXECUTION**

### **3.1 EXAMINATION**

- A. Examine framing for security glazing, with Installer present, for compliance with the following:
  1. Manufacturing and installation tolerances, including those for size, squareness, and offsets at corners.
  2. Presence and functioning of weep system.
  3. Minimum required face or edge clearances.
  4. Minimum required bite.
  5. Effective sealing between joints of framing members.

- B. Proceed with installation only after unsatisfactory conditions have been corrected.

### **3.2 PREPARATION**

- A. Clean glazing channels and other framing members receiving security glazing immediately before glazing. Remove coatings not firmly bonded to substrates.
- B. Examine glazing units to locate exterior and interior surfaces. Label or mark units as needed so that exterior and interior surfaces are readily identifiable. Do not use materials that will leave visible marks in the completed work.

### **3.3 GLAZING, GENERAL**

- A. Comply with combined written instructions of manufacturers of security glazing, sealants, gaskets, and other glazing materials unless more stringent requirements are indicated, including those in referenced glazing publications.
- B. Protect edges of security glazing from damage during handling and installation. Remove damaged security glazing from Project site and legally dispose of it off Project site. Damaged security glazing includes units with edge or face damage or other imperfections that, when installed, could weaken security glazing and impair performance and appearance.
- C. Apply primers to joint surfaces where required for adhesion of sealants, as determined by preconstruction testing.
- D. Install setting blocks in sill rabbets, sized and located to comply with referenced glazing publications unless otherwise required by glazing unit manufacturer. Set blocks in thin course of compatible sealant suitable for heel bead.
- E. Do not exceed edge pressures stipulated by security glazing manufacturers for installing lites.
- F. Provide spacers for security glazing lites where the length plus width is larger than 50 inches.
  - 1. Locate spacers directly opposite each other on both inside and outside faces of security glazing. Install correct size and spacing to preserve required face clearances unless gaskets and glazing tapes are used that have demonstrated ability to maintain required face clearances and to comply with performance requirements.
  - 2. Provide 1/8-inch minimum bite of spacers on glazing lites and use thickness equal to sealant width. With glazing tape, use thickness of slightly less than final compressed thickness of tape.
- G. Provide edge blocking where indicated or needed to prevent security glazing from moving sideways in glazing channel created by steel angles, as recommended in writing by security glazing manufacturer and in accordance with requirements in referenced glazing publications.
- H. Set security glazing in each series with uniform pattern, draw, bow, and similar characteristics.
- I. Set coated security glazing with proper orientation so that coatings and films face exterior or interior as specified.

- J. Where wedge-shaped gaskets are driven into one side of channel to pressurize sealant or gasket on opposite side, provide adequate anchorage so gasket cannot walk out when installation is subjected to movement.
- K. Square cut wedge-shaped gaskets at corners and install gaskets in a manner recommended by gasket manufacturer to prevent corners from pulling away; seal corner joints and butt joints with sealant recommended in writing by gasket manufacturer.

### **3.4 TAPE GLAZING**

- A. Position tapes on fixed stops so that, when compressed by security glazing, their exposed edges are flush with or protrude slightly above sightline of stops.
- B. Install tapes continuously, but not necessarily in one continuous length. Do not stretch tapes to make them fit opening.
- C. Cover vertical framing joints by applying tapes to heads and sills first and then to jambs. Cover horizontal framing joints by applying tapes to jambs and then to heads and sills.
- D. Place joints in tapes at corners of opening with adjoining lengths butted together, not lapped. Seal joints in tapes with compatible sealant approved by tape manufacturer.
- E. Do not remove release paper from tape until just before each glazing unit is installed.
- F. Apply heel bead of elastomeric sealant.
- G. Center security glazing in openings on setting blocks and press firmly against tape by inserting dense compression gaskets formed and installed to lock in place against faces of removable stops. Start gasket applications at corners and work toward centers of openings.
- H. Apply cap bead of elastomeric sealant over exposed edge of tape.

### **3.5 SEALANT GLAZING (WET)**

- A. Install continuous spacers, or spacers combined with cylindrical sealant backing, between security glazing and glazing stops to maintain face clearances and to prevent sealant from extruding into glazing channel and blocking weep systems. Secure spacers, or spacers and backings, in place and in position to control depth of installed sealant relative to edge clearance for optimum sealant performance.
- B. Force sealants into glazing channels to eliminate voids and to ensure complete wetting or bond of sealant to security glazing and channel surfaces.
- C. Tool exposed surfaces of sealants to provide a substantial wash away from security glazing.

### **3.6 CLEANING AND PROTECTION**

- A. Immediately after installation remove nonpermanent labels and clean surfaces.

- B. Protect security glazing from contact with contaminating substances resulting from construction operations, including weld splatter. Examine security glazing surfaces adjacent to or below exterior concrete and other masonry surfaces at frequent intervals during construction, but not less than once a month, for buildup of dirt, scum, alkaline deposits, or stains.
  - 1. If, despite such protection, contaminating substances do contact with security glazing, remove substances immediately as recommended in writing by security glazing manufacturer. Remove and replace security glazing that cannot be cleaned without damage.
- C. Wash security glazing on both exposed surfaces not more than four days before date scheduled for inspections that establish date of Substantial Completion. Wash security glazing as recommended in writing by security glazing manufacturer.

### **3.7 SECURITY GLAZING SCHEDULE**

- A. Security Glazing Type SG1: Level 3 Bullet Resistant
  - 1. Basis of Design Product: McGrory Glass, AttackDefend 60 Plus
  - 2. Makeup: ¼" Glass on exposed surfaces, polycarbonate core
  - 3. Performance Characteristics: HP White TP .0500.03 Ballistic Level C & ASTM F1915 Grade 1 Forced Entry
  - 4. Nominal Thickness: 1-1/4"
- B. Security Glazing Type SG2: Level 3 Bullet Resistant, Low-E Insulating
  - 1. Basis of Design Product: McGrory Glass, AttackDefend 60 Plus IGU
  - 2. Makeup: Type SG1 Insulated to Vitro Solarban 70 Tempered #2
  - 3. Performance Characteristics: HP White TP .0500.03 Ballistic Level C & ASTM F1915 Grade 1 Forced Entry
  - 4. Nominal Thickness: 2"
- C. Security Glazing Type SG3: Forced Entry Resistant, Low-E Insulating
  - 1. Basis of Design Product: McGrory Glass, DefendEntry IGU
  - 2. Makeup: DefendEntry Insulated to Vitro Solarban 70 Tempered #2
  - 3. Performance Characteristics: ASTM F1233 Class 1.4 & UL972
  - 4. Nominal Thickness: 1-1/8"

**END OF SECTION 088853**