

# PROJECT MANUAL

*Re-Bid*

*Renovate Interior & Exterior*

*Kennett Readiness Center Building*

*Kennett, Missouri*

Designed By: Dille Pollard Architecture  
266 S. Mount Auburn Road  
Cape Girardeau, MO 63703

Date Issued: January 30, 2023

Project No.: T2209-01

STATE *of* MISSOURI

---

OFFICE *of* ADMINISTRATION  
Facilities Management, Design & Construction

---

SECTION 000107.10 - PROFESSIONAL SEALS AND CERTIFICATIONS – ARCHITECTURAL DOCUMENTS

**Project Number: T2209-01 “RE-BID Renovate Interior and Exterior” – Kennett Readiness Center**

The Following Design Professional Has Signed and Sealed the Original Plans and Specifications for this project, which are on file with the Division of Facilities Management, Design and Construction:

**Project Architect:**

KRISTEN RAE UHRHAN, MO A-2009027298

Dille Pollard Architecture  
266 South Mount Auburn Road  
Cape Girardeau, Missouri 63703

Drawing Sheets:

G-001; G-002; A-001, A-100; A-101, A-102, A-200, A-201, A-202, A-300, A-400, A-500 and A-501.

Specifications:

Division 00 Sections 000107.10, 000115 and 002600; Division 01 Sections; Division 02 Sections; Division 03 Sections; Division 04 Sections; Division 05 Sections; Division 06 Sections; Division 07 Sections; Division 08 Sections; Division 09 Sections; Division 10 Sections; Division 12 Sections; Division 31 Sections; and Division 32 Sections.

**Project Mechanical Engineer:**

RYAN JEROD DIEDIKER, MO PE-2015006511

Smith & Boucher Engineers  
25618 W. 103<sup>rd</sup> St.  
Olathe, KS 66061

Drawing Sheets:

ME-100, ME-200, ME-201, ME-300, ME-301, ME-302, DM-100, M-100, M-200, DP-100, P-100, P-200, DE-100, E-100, E-200, E-300.

Specifications:

Division 22 Sections  
Division 23 Sections  
Division 26 Sections  
Division 28 Sections

END OF SECTION 000107.10



**TABLE OF CONTENTS**

SECTION	TITLE	NUMBER OF PAGES
---------	-------	-----------------

**DIVISION 00 – PROCUREMENT AND CONTRACTING INFORMATION**

**000000 INTRODUCTORY INFORMATION**

000101	Project Manual Cover	1
000107	Professional Seals and Certifications	1
000110	Table of Contents	3
000115	List of Drawings	2

<b>001116</b>	<b>INVITATION FOR BID (IFB) plus Missouri Buys instructions and special notice</b>	<b>3</b>
---------------	--	----------

<b>002113</b>	<b>INSTRUCTIONS TO BIDDERS (Includes MBE/WBE/SDVE Information)</b>	<b>8</b>
---------------	--	----------

003144	MBE/WBE/SDVE Directory	1
--------	------------------------	---

**\*\*The following documents may be found on MissouriBUYS at <https://missouribuys.mo.gov/>\*\***

**004000 PROCUREMENT FORMS & SUPPLEMENTS**

004113	Bid Form	*
004322	Unit Prices Form	*
004336	Proposed Subcontractors Form	*
004337	MBE/WBE/SDVE Compliance Evaluation Form	*
004338	MBE/WBE/SDVE Eligibility Determination Form for Joint Ventures	*
004339	MBE/WBE/SDVE Good Faith Effort (GFE) Determination Forms	*
004340	SDVE Business Form	*
004541	Affidavit of Work Authorization	*
004545	Anti-Discrimination Against Israel Act Certification form	*

**005000 CONTRACTING FORMS AND SUPPLEMENTS**

005213	Construction Contract	4
005414	Affidavit for Affirmative Action	1

**006000 PROJECT FORMS**

006113	Performance and Payment Bond	2
006325	Product Substitution Request	2
006519.16	Final Receipt of Payment and Release Form	1
006519.18	MBE/WBE/SDVE Progress Report	2
006519.21	Affidavit of Compliance with Prevailing Wage Law	1

**007000 CONDITIONS OF THE CONTRACT**

007213	General Conditions	20
007300	Supplementary Conditions	1
007346	Wage Rate	4

**DIVISION 1 - GENERAL REQUIREMENTS**

011000	Summary of Work	2
011200	Existing Condition Information	1
012100	Allowances	2
012200	Unit Prices	2
012300	Alternates	2
012600	Contract Modification Procedures	3
013100	Coordination	4
013115	Project Management Communications	4
013200	Schedules	4
013300	Submittals	12
013513.28	Site Security and Health Requirements (DNR, Veterans, State Fair, MONG)	4
015000	Construction Facilities and Temporary Controls	9
017400	Cleaning	3
017419	Construction Waste Management and Disposal	3
017900	Demonstration and Training	6

## TECHNICAL SPECIFICATIONS INDEX:

### DIVISION 2 – EXISTING CONDITIONS

024119	Selective Demolition	6
--------	----------------------	---

### DIVISION 3 – CONCRETE

033000	Cast-In-Place Concrete	14
--------	------------------------	----

### DIVISION 4 – MASONRY

042000	Unit Masonry	13
--------	--------------	----

### DIVISION 5 – METALS

055000	Metal Fabrications	3
--------	--------------------	---

### DIVISION 6 – WOOD, PLASTICS & COMPOSITES

061000	Rough Carpentry	4
--------	-----------------	---

### DIVISION 7 – THERMAL & MOISTURE PROTECTION

075423	Thermoplastic Polyolefin Roofing	7
076200	Sheet Metal Flashing and Trim	5
078413	Penetrating Firestopping	6
079200	Joint Sealants	2

### DIVISION 8 – OPENINGS

081100	Hollow Metal Doors and Frames	7
082110	Flush Wood Doors	5
084113	Aluminum Framed Entrances and Storefronts	9
085113	Aluminum Windows	7
087100	Door Hardware	9
088000	Glazing	7

### DIVISION 9 – FINISHES

092116	Gypsum Board Assemblies	4
092216	Non-Structural Metal Framing	5
095113	Acoustical Panel Ceilings	7
096200	Seamless Resinous Flooring and Coved Seamless Wall Base	4
096513	Resilient Wall Base and Accessories	3
096813	Tile Carpeting	5
096850	Luxury Vinyl Tile	5
099100	Painting	5

### DIVISION 10 – SPECIALTIES

101550	Toilet Compartments	4
102213	Wire Mesh Partitions	8
102800	Toilet and Bath Accessories	3
104310	Signs	2

### DIVISION 12 – FURNISHINGS

122413	Roller Window Shades	4
--------	----------------------	---

### DIVISION 22 - PLUMBING

220500	Common Work Results for Plumbing	11
220513	Common Motor Requirements for Plumbing Equipment	3
220519	Meters and Gages for Plumbing Piping	6
220523	General-Duty Valves for Plumbing Piping	5
220529	Hangers and Supports for Plumbing Piping and Equipment	9
220553	Identification for Plumbing Piping and Equipment	3

SECTION 000110 – TABLE OF CONTENTS

9/9/20

220719	Plumbing Piping Insulation	10
221116	Domestic Water Piping	15
221119	Domestic Water Piping Specialties	5
221123	Domestic Water Pumps	5
221316	Sanitary Waste and Vent Piping	8
221319	Sanitary Waste Piping Specialties	8
223400	Fuel-Fired, Domestic Water Heaters	7
224000	Plumbing Fixtures	10
224700	Drinking Fountains/Water Coolers	5

### **DIVISION 23 - HEATING VENTILATING AND AIR CONDITIONING**

230500	Common Work Results for HVAC	8
230529	Hangers and Supports for HVAC Piping and Equipment	4
230553	HVAC System Identification	2
230593	Testing, Adjusting, and Balancing for HVAC	7
230713	Duct Insulation	9
231123	Facility Natural-Gas Piping	12
232300	Refrigerant Piping	9
233113	Metal Ducts	9
233300	Duct Accessories	7
233713	Diffusers, Registers, and Grilles	2
235416	Gas-Fired Furnaces	7
237413	Packaged, Outdoor, Central-Station Air-Handling Unit	13
238126	Split-System Air-Conditioners	6

### **DIVISION 26 - ELECTRICAL**

260500	Common Work Results for Electrical	3
260519	Low-Voltage Electrical Power Conductors and Cables	3
260523	Control-Voltage Electrical Power Cables	4
260526	Grounding and Bonding for Electrical Systems	2
260529	Hangers and Supports for Electrical Systems	5
260533	Raceway and Boxes for Electrical Systems	5
260553	Identification for Electrical Systems	4
260923	Lighting Control Devices	3
262416	Panelboards	4
262726	Wiring Devices	4
263600	Transfer Switches	5
265119	LED Interior Lighting	5
265619	LED Exterior Lighting	5

### **DIVISION 28 - ELECTRONIC SAFETY AND SECURITY**

280500	Common Work Results for Electronic Safety and Security	3
280513	Conductors and Cables for Electronic Safety and Security	5
283111	Digital, Addressable Fire-Alarm System	10

### **DIVISION 31 - EARTHWORK**

311000	Site Clearing	4
312011	Earthwork	9

### **DIVISION 32 – EXTERIOR IMPROVEMENTS**

321313	Concrete Paving	12
321373	Concrete Paving Joint Sealant	3
329200	Turf and Grasses	2

## SECTION 000115 – LIST OF DRAWINGS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

#### 1.2 SUMMARY

- A. This Section provides a comprehensive list of the drawings that comprise the Bid Documents for this project.

### PART 2 - PRODUCTS (NOT APPLICABLE)

### PART 3 - EXECUTION

#### 3.1 LIST OF DRAWINGS

- A. The following list of drawings is a part of the Bid Documents:

	<u>TITLE</u>	<u>SHEET #</u>	<u>DATE</u>
1.	Title Sheet	Sheet G-001	01/30/2023
2.	Sheet Index, Site Location Plans, Legend and Abbrev.	Sheet G-002	01/30/2023
3.	Site Plans and Site Details – Alt. #3	Sheet A-001	01/30/2023
4.	Demolition Plan – Floor Plan	Sheet A-100	01/30/2023
5.	Demolition Plan – Reflected Ceiling	Sheet A-101	01/30/2023
6.	Demolition Plan – Roof Plan	Sheet A-102	01/30/2023
7.	Alterations Plan – Floor Plan	Sheet A-200	01/30/2023
8.	Alterations Plan – Reflected Ceiling	Sheet A-201	01/30/2023
9.	Alterations Plan – Roof Plan	Sheet A-202	01/30/2023
10.	Alterations – Elevations Alt. #1	Sheet A-300	01/30/2023
11.	Detail Plans, Elevations and Details	Sheet A-400	01/30/2023
12.	Schedules and Details	Sheet A-500	01/30/2023
13.	Schedules and Details	Sheet A-501	01/30/2023
14.	Symbols, Abbreviations – Mechanical and Electrical	Sheet ME-100	01/30/2023
15.	Site Plan – Mechanical and Electrical	Sheet ME-200	01/30/2023
16.	Roof Plan – Mechanical and Electrical	Sheet ME-201	01/30/2023

17. Schedules –		
Mechanical and Electrical	Sheet ME-300	01/30/2023
18. Schedules –		
Mechanical and Electrical	Sheet ME-301	01/30/2023
19. Details –		
Mechanical and Electrical	Sheet ME-302	01/30/2023
20. Demolition HVAC – Floor Plan	Sheet DM-100	01/30/2023
21. HVAC – Floor Plan	Sheet M-100	01/30/2023
22. HVAC Control Schematics	Sheet M-200	01/30/2023
23. Demolition Plumbing – Floor Plan	Sheet DP-100	01/30/2023
24. Plumbing – Floor Plan	Sheet P-100	01/30/2023
25. Riser Diagrams – Plumbing	Sheet P-200	01/30/2023
26. Demolition Electrical – Floor Plan	Sheet DE-100	01/30/2023
27. Lighting – Floor Plan	Sheet E-100	01/30/2023
28. Power – Floor Plan	Sheet E-200	01/30/2023
29. Electrical – Schedules and Detail	Sheet E-300	01/30/2023

END OF SECTION 000115

## SECTION 001116 - INVITATION FOR BID

### 1.0 OWNER:

- A. The State of Missouri  
Office of Administration,  
Division of Facilities Management, Design and Construction  
Jefferson City, Missouri

### 2.0 PROJECT TITLE AND NUMBER:

- A. Re-Bid Renovate Interior & Exterior  
Kennett Readiness Center Building  
Kennett, Missouri  
**Project No.: T2209-01**

### 3.0 BIDS WILL BE RECEIVED:

- A. Until: 1:30 PM, Tuesday, November 14, 2023
- B. **Only electronic bids on MissouriBUYS shall be accepted: <https://missouribuys.mo.gov>. Bidder must be registered to bid.**

### 4.0 DESCRIPTION:

- A. Scope: The project includes, but is not limited to, demolition of the men's and women's showers, latrines, and locker areas, including adjoining spaces for renovation of new latrines, showers, and locker areas. New finishes include resinous flooring and wall coverings, lay-in ceilings, and HPDE toilet partitions. Renovation of existing administrative areas with new wall coverings and flooring. New HVAC equipment for renovated spaces. New entry doors and windows by Alternate bid. The Exterior Work includes replacement of existing parking areas, new striping by Alternate Bid. New site lighting and transfer switch with generator by Alternate bid.
- B. MBE/WBE/SDVE Goals: MBE 10%, WBE 10%, and SDVE 3%. **NOTE: Only MBE/WBE firms certified by the State of Missouri Office of Equal Opportunity as of the date of bid opening, or SDVE(s) meeting the requirements of Section 34.074, RSMo and 1 CSR 30-5.010, can be used to satisfy the MBE/WBE/SDVE participation goals for this project.**
- C. **\*\*NOTE:** Bidders are provided new Good Faith Effort (GFE) forms on MissouriBUYS.

### 5.0 PRE-BID MEETING:

- A. Place/Time: 10:00 AM, Tuesday, October 31, 2023, at Kennett Readiness Center, 1450 N. Bypass, Kennett, MO, 63857.
- B. Access to State of Missouri property requires presentation of a photo ID by all persons

### 6.0 HOW TO GET PLANS & SPECIFICATIONS:

- A. View Only Electronic bid sets are available at no cost or paper bid sets for a deposit of \$100.00 from American Document Solutions (ADS). MAKE CHECKS PAYABLE TO: American Document Solutions. Mail to: American Document Solutions, 1400 Forum Blvd., Suite 7A, Columbia, Missouri 65203. Phone 573-446-7768, Fax 573-355-5433, <https://www.adsplanroom.net>. NOTE: Prime contractors will be allowed a maximum of two bid sets at the deposit rate shown above. Other requesters will be allowed only one bid set at this rate. Additional bid sets or parts thereof may be obtained by any bidder at the cost of printing and shipping by request to American Document Solutions at the address shown above. **Bidder must secure at least one bid set to become a planholder.**
- B. **Refunds: Return plans and specifications in unmarked condition within 15 working days of bid opening to American Document Solutions, 1400 Forum Blvd., Suite 7A, Columbia, Missouri 65203. Phone 573-446-7768, Fax 573-355-5433. Deposits for plans not returned within 15 working days shall be forfeited.**
- C. Information for upcoming bids, including downloadable plans, specifications, Invitation for Bid, bid tabulation, award, addenda, and access to the ADS planholders list, is available on the Division of Facilities Management, Design and Construction's web site: <https://oa.mo.gov/facilities/bid-opportunities/bid-listing-electronic-plans>.

### 7.0 POINT OF CONTACT:

- A. Designer: Dille Pollard Architecture, Kristen Uhrhan, 573-339-4536, email: [uhrhan@dillepollard.com](mailto:uhrhan@dillepollard.com)
- B. Project Manager: Christopher Lloyd, 5735260160, email: [Christopher.Lloyd@oa.mo.gov](mailto:Christopher.Lloyd@oa.mo.gov)

### 8.0 GENERAL INFORMATION:

- A. The State reserves the right to reject any and all bids and to waive all informalities in bids. No bid may be withdrawn for a period of 20 working days subsequent to the specified bid opening time. The contractor shall pay not less than the prevailing hourly rate of wages for work of a similar character in the locality in which the work is performed, as determined by the Missouri Department of Labor and Industrial Relations and as set out in the detailed plans and specifications.
- B. Bid results will be available at <https://oa.mo.gov/facilities/bid-opportunities/bid-listing-electronic-plans> after it is verified that at least one bid is awardable and affordable.



## Very Important MissouriBUYS Instructions to Help Submit a Bid Correctly

- A. The bidder shall submit his or her bid and all supporting documentation on MissouriBUYS eProcurement System. No hard copy bids shall be accepted. Go to <https://missouribuys.mo.gov> and register. The bidder must register and complete a profile fully with all required documents submitted prior to submitting a bid.
- B. Once registered, log in.
1. Under "Solicitation" select "View Current Solicitations."
  2. Under "Filter by Agency" select "OA-FMDC-Contracts Chapter 8", then click "Filter Solicitation" button.
  3. Select "Active Solicitations" tab.
  4. To see the Solicitation Summary, click on the Project Number and the summary will open. Click each heading to open detailed information.
- C. Here are simplified instructions for uploading the bid to MissouriBUYS:
1. Find the solicitation by completing Steps 1 through 4 above.
  2. Select the three dots under "Actions." Select "Add New Response."
  3. When the Quote box opens, give the response a title and select "OK."
  4. The detailed solicitation will open. Select "Check All" for the Original Solicitation Documents, open each document, and select "Accept." If this step is not completed, a bid cannot be uploaded. Scroll to the bottom of the page and select "Add Attachments." If you do not see this command, not all documents have been opened and accepted.
  5. The Supplier Attachments box will open. Select "Add Attachment" again.
  6. The Upload Documents box will open. Read the instructions for uploading. Disregard the "Confidential" check box.
  7. Browse and attach up to 5 files at a time. Scroll to bottom of box and select "Upload." The Supplier Attachments box will open. Repeat Steps 5 through 7 if more than 5 files are to be uploaded.
  8. When the Supplier Attachments box opens again and uploading is complete, select "Done."  
A message should appear that the upload is successful. If it does not, go to the Bidder Response tab and select "Submit."
  9. The detailed solicitation will open. At the bottom select "Close."
- D. Any time a bidder wants to modify the bid, he or she will have to submit a new one. FMDC will open the last response the bidder submits. The bidder may revise and submit the bid up to the close of the solicitation (bid date and time). Be sure to allow for uploading time so that the bid is successfully uploaded prior to the 1:30 PM deadline; we can only accept the bid if it is uploaded before the deadline.
- E. If you want to verify that you are uploading documents correctly, please contact Paul Girouard: 573-751-4797, [paul.girouard@oa.mo.gov](mailto:paul.girouard@oa.mo.gov) ; April Howser: 573-751-0053, [April.Howser@oa.mo.gov](mailto:April.Howser@oa.mo.gov) ; or Mandy Roberson: 573-522-0074, [Mandy.Roberson@oa.mo.gov](mailto:Mandy.Roberson@oa.mo.gov).
- F. If you are experiencing login issues, please contact Web Procure Support (Proactis) at 866-889-8533 anytime from 7:00 AM to 7:00 PM Central Time, Monday through Friday. If you try using a userid or password several times that is incorrect, the system will lock you out. Web Procure Support is the only option to unlock you! If you forget your userid or password, Web Procure Support will provide a temporary userid or password. Also, if it has been a while since your last successful login and you receive an "inactive" message, contact Web Procure (Proactis). If you are having a registration issue, you may contact Cathy Holliday at 573-751-3491 or by email: [cathy.holliday@oa.mo.gov](mailto:cathy.holliday@oa.mo.gov).

## IMPORTANT REMINDER REGARDING REQUIREMENT FOR OEO CERTIFICATION

A. SECTION 002113 – INSTRUCTIONS TO  
BIDDERS: Article 15.0, Section D1:

**As of July 1, 2020**, all MBE, WBE, and MBE/WBE contractors, subcontractors, and suppliers must be certified by the State of Missouri, Office of Equal Opportunity. No certifications from other Missouri certifying agencies will be accepted.

## **SECTION 002113 – INSTRUCTIONS TO BIDDERS**

### **1.0 - SPECIAL NOTICE TO BIDDERS**

- A. If awarded a contract, the Bidder's employees, and the employees of all subcontractors, who perform the work on the project must adhere to requirements in Section 013513 – Site Security and Health Requirements as applicable per Agency.
- B. The Bidder's prices shall include all city, state, and federal sales, excise, and similar taxes that may lawfully be assessed in connection with the performance of work, and the purchased of materials to be incorporated in the work. THIS PROJECT IS NOT TAX EXEMPT.

### **2.0 - BID DOCUMENTS**

- A. The number of sets obtainable by any one (1) party may be limited in accordance with available supply.
- B. For the convenience of contractors, sub-contractors and suppliers, copies of construction documents are on file at the office of the Director, Division of Facilities Management, Design and Construction and on the Division's web site - <https://oa.mo.gov/facilities/bid-opportunities/bid-listing-electronic-plans>.

### **3.0 - BIDDERS' OBLIGATIONS**

- A. Bidders must carefully examine the entire site of the work and shall make all reasonable and necessary investigations to inform themselves thoroughly as to the facilities available as well as to all the difficulties involved in the completion of all work in accordance with the specifications and the plans. Bidders are also required to examine all maps, plans and data mentioned in the specifications. No plea of ignorance concerning observable existing conditions or difficulties that may be encountered in the execution of the work under this contract will be accepted as an excuse for any failure or omission on the part of the contractor to fulfill in every detail all of the requirements of the contract, nor accepted as a basis for any claims for extra compensation.
- B. Under no circumstances will contractors give their plans and specifications to another contractor. Any bid received from a contractor whose name does not appear on the list of plan holders may be subject to rejection.

### **4.0 - INTERPRETATIONS**

- A. No bidder shall be entitled to rely on oral interpretations as to the meaning of the plans and specifications or the acceptability of alternate products, materials, form or type of construction. Every request for interpretation shall be made in writing and submitted with all supporting documents not less than five (5) working days before opening of bids. Every interpretation made to a bidder will be in the form of an addendum and will be sent as promptly as is practicable to all persons to whom plans and specifications have been issued. All such addenda shall become part of the contract documents.
- B. Approval for an "acceptable substitution" issued in the form of an addendum as per Paragraph 4A above, and as per Article 3.1 of the General Conditions; ACCEPTABLE SUBSTITUTIONS shall constitute approval for use in the project of the product.
- C. An "acceptable substitution" requested after the award of bid shall be approved if proven to the satisfaction of the Owner and the Designer as per Article 3.1, that the product is acceptable in design, strength, durability, usefulness, and convenience for the purpose intended. Approval of the substitution after award is at the sole discretion of the Owner.
- D. A request for "Acceptable Substitutions" shall be made on the Section 006325 Substitution Request Form. The request shall be sent directly to the project Designer. A copy of said request should also be mailed to the Owner, Division of Facilities Management, Design and Construction, Post Office Box 809, Jefferson City, Missouri 65102.

## **5.0 - BIDS AND BIDDING PROCEDURE**

- A. Bidders shall submit all submission forms and accompanying documents listed in SECTION 004113 – BID FORM, Article 5.0, ATTACHMENTS TO BID by the stated time or their bid will be rejected for being non-responsive.

Depending on the specific project requirements, **the following is a GENERIC list** of all possible bid forms that may be due with bid submittals and times when they may be due. Please check for specific project requirements on the proposal form (Section 004113). ***Not all of the following bid forms may be required to be submitted.***

### **Bid Submittal – due before stated date and time of bid opening (see IFB):**

004113	Bid Form (all pages are always required)
004322	Unit Prices Form
004336	Proposed Subcontractors Form
004337	MBE/WBE/SDVE Compliance Evaluation Form
004338	MBE/WBE/SDVE Eligibility Determination for Joint Ventures
004339	MBE/WBE/SDVE GFE Determination
004340	SDVE Business Form
004541	Affidavit of Work Authorization
004545	Anti-Discrimination Against Israel Act Certification form

- B. All bids shall be submitted without additional terms and conditions, modification or reservation on the bid forms with each space properly filled. Bids not on these forms will be rejected.
- C. All bids shall be accompanied by a bid bond executed by the bidder and a duly authorized surety company, certified check, cashier's check or bank draft made payable to the Division of Facilities Management, Design and Construction, State of Missouri, in the amount indicated on the bid form, Section 004113. Failure of the contractor to submit the full amount required shall be sufficient cause to reject his bid. The bidder agrees that the proceeds of the check, draft or bond shall become the property of the State of Missouri, if for any reason the bidder withdraws his bid after closing, or if on notification of award refuses or is unable to execute tendered contract, provide an acceptable performance and payment bond, provide evidence of required insurance coverage and/or provide required copies of affirmative action plans within ten (10) working days after such tender.
- D. The check or draft submitted by the successful bidder will be returned after the receipt of an acceptable performance and payment bond and execution of the formal contract. Checks or drafts of all other bidders will be returned within a reasonable time after it is determined that the bid represented by same will receive no further consideration by the State of Missouri. Bid bonds will only be returned upon request.

## **6.0 - SIGNING OF BIDS**

- A. A bid from an individual shall be signed as noted on the Bid Form.
- B. A bid from a partnership or joint venture shall require only one signature of a partner, an officer of the joint venture authorized to bind the venture or an attorney-in-fact. If the bid is signed by an officer of a joint venture or an attorney-in-fact, a document evidencing the individual's authority to execute contracts should be included with the bid form.
- C. A bid from a limited liability company (LLC) shall be signed by a manager or a managing member of the LLC.
- D. A bid from a corporation shall have the correct corporate name thereon and the signature of an authorized officer of the corporation manually written. Title of office held by the person signing for the corporation shall appear, along with typed name of said individual. Corporate license number shall be provided and, if a corporation organized in a state other than Missouri, a Certificate of Authority to do business in the State of Missouri shall be attached. In addition, for corporate proposals, the President or Vice-President should sign as the bidder. If the signator is other than the corporate president or vice president, the bidder must provide satisfactory evidence that the signator has the legal authority to bind the corporation.

- E. A bid should contain the full and correct legal name of the Bidder. If the Bidder is an entity registered with the Missouri Secretary of State, the Bidder's name on the bid form should appear as shown in the Secretary of State's records.
- F. The Bidder should include its corporate license number on the Bid Form and, if the corporation is organized in a state other than Missouri, a Certificate of Authority to do business in the State of Missouri shall be attached to the bid form.

#### **7.0 - RECEIVING BID SUBMITTALS**

- A. It is the bidder's sole responsibility to assure receipt by Owner of bid submittals by the date and time specified in the Invitation for Bid. Bids received after the date and time specified shall not be considered by the Owner.
- B. Bids must be submitted through the MissouriBUYS statewide eProcurement system (<https://www.missouribuys.mo.gov/>) in accordance with the instructions for that system. The Owner shall only accept bids submitted through MissouriBUYS. Bids received by the Owner through any other means, including hard copies, shall not be considered and will be discarded by the Owner unopened.
- C. To respond to an Invitation for Bid, the Bidder must first register with MissouriBUYS by going through the MissouriBUYS Home Page (<https://www.missouribuys.mo.gov/>), clicking the "Register" button at the top of the page, and completing the Vendor Registration. Once registered, the Bidder accesses its account by clicking the "Login" button at the top of the MissouriBUYS Home Page. Enter your USERID and PASSWORD, which the Bidder will select. Under Solicitations, select "View Current Solicitations." A new screen will open. Under "Filter by Agency" select "OA-FMDC-Contracts Chapter 8." Under "Filter by Opp. No." type in the State Project Number. Select "Submit." Above the dark blue bar, select "Other Active Opportunities." To see the Solicitation Summary, single click the Opp. No. (Project Number) and the summary will open. Single quick click each blue bar to open detailed information. The Bidder must read and accept the Original Solicitation Documents and complete all identified requirements. The Bidder should download and save all of the Original Solicitation Documents on its computer so that the Bidder can prepare its response to these documents. The Bidder should upload its completed response to the downloaded documents as an attachment to the electronic solicitation response.
- D. Step-by-step instructions for how a registered vendor responds to a solicitation electronically are provided in Section 001116 – Invitation For Bid.
- E. The Bidder shall submit its bid on the forms provided by the Owner on MissouriBUYS with each space fully and properly completed, including all amounts required for alternate bids, unit prices, cost accounting data, etc. The Owner may reject bids that are not on the Owner's forms or that do not contain all requested information.
- F. No Contractor shall stipulate in his bid any conditions not contained in the specifications or standard bid form contained in the contract documents. To do so may subject the Contractor's bid to rejection.
- G. The completed forms shall be without interlineations, alterations or erasures.

#### **8.0 - MODIFICATION AND WITHDRAWAL OF BIDS**

- A. Bidder may withdraw his bid at any time prior to scheduled closing time for receipt of bids, but no bidder may withdraw his bid for a period of twenty (20) working days after the scheduled closing time for receipt of bids.
- B. The Bidder shall modify his or her original bid by submitting a revised bid on MissouriBUYS.

#### **9.0 - AWARD OF CONTRACT**

- A. The Owner reserves the right to reject any and/or all bids and further to waive all informalities in bidding when deemed in the best interest of the State of Missouri.
- B. The Owner reserves the right to let other contracts in connection with the work, including but not by way of limitation, contracts for the furnishing and installation of furniture, equipment, machines, appliances and other apparatus.

- C. The Owner shall award a contract to the lowest, responsive, responsible Bidder in accordance with Section 8.250, RSMo. No contract will be awarded to any Bidder who has had a contract with the Owner terminated within the preceding twelve months for material breach of contract or who has been suspended or debarred by the Owner.
- D. Award of alternates, if any, will be made in numerical order unless all bids received are such that the order of acceptance of alternates does not affect the determination of the lowest, responsive, responsible bidder.
- E. No bid shall be considered binding upon the Owner until the written contract has been properly executed, a satisfactory bond has been furnished, evidence of required insurance coverage, submittal of executed Section 004541, Affidavit of Work Authorization form, documentation evidencing enrollment and participation in a federal work authorization program has been received and an affirmative action plan submitted. Failure to execute and return the contract and associated documents within the prescribed period of time shall be treated, at the option of the Owner, as a breach of bidder's obligation and the Owner shall be under no further obligation to bidder.
- F. If the successful bidder is doing business in the State of Missouri under a fictitious name, he shall furnish to Owner, attached to the Bid Form, a properly certified copy of the certificate of Registration of Fictitious Name from the State of Missouri, and such certificate shall remain on file with the Owner.
- G. Any successful bidder which is a corporation organized in a state other than Missouri shall furnish to the Owner, attached to the Bid Form, a properly certified copy of its current Certificate of Authority to do business in the State of Missouri, such certificate to remain on file with the Owner. No contract will be awarded by the Owner unless such certificate is furnished by the bidder.
- H. Any successful bidder which is a corporation organized in the State of Missouri shall furnish at its own cost to the Owner, if requested, a Certificate of Good Standing issued by the Secretary of State, such certificate to remain on file with the Owner.
- I. Transient employers subject to Sections 285.230 and 285.234, RSMo, (out-of-state employers who temporarily transact any business in the State of Missouri) may be required to file a bond with the Missouri Department of Revenue. No contract will be awarded by the Owner unless the successful bidder certifies that he has complied with all applicable provisions of Section 285.230-234.
- J. Sections 285.525 and 285.530, RSMo, require business entities to enroll and participate in a federal work authorization program in order to be eligible to receive award of any state contract in excess of \$5,000. Bidders should submit with their bid an Affidavit of Work Authorization (Section 004541) along with appropriate documentation evidencing such enrollment and participation. Section-004541, Affidavit of Work Authorization is located on the MissouriBUYS solicitation for this project. Bidders must also submit an E-Verify Memorandum before the Owner may award a contract to the Bidder. Information regarding an E-Verify is located at <https://www.uscis.gov/e-verify/>. The contractor shall be responsible for ensuring that all subcontractors and suppliers associated with this contract enroll in E-Verify.

#### **10.0 - CONTRACT SECURITY**

- A. The successful bidder shall furnish a performance/payment bond as set forth in General Conditions Article 6.1 on a condition prior to the State executing the contract and issuing a notice to proceed.

#### **11.0 - LIST OF SUBCONTRACTORS**

- A. If required by "Section 004113 – Bid Form," each bidder must submit as part of their bid a list of subcontractors to be used in performing the work (Section 004336). The list must specify the name of the single designated subcontractor, for each category of work listed in "Section 004336 - Proposed Subcontractors Form." If work within a category will be performed by more than one subcontractor, the bidder must provide the name of each subcontractor and specify the exact portion of the work to be done by each. Failure to list the Bidder's firm, or a subcontractor for each category of work identified on the Bid Form or the listing of more than one subcontractor for any category without designating the portion of work to be performed by each shall be cause for rejection of the bid. If the bidder intends to perform any of the designated subcontract work with the use of his own employees, the bidder shall make that fact clear, by listing his own firm for the subject category. **If any category of work is left vacant, the bid shall be rejected.**

## **12.0 - WORKING DAYS**

- A. Contract duration time is stated in working days and will use the following definition in determining the actual calendar date for contract completion:
  - 1. Working days are defined as all calendar days except Saturdays, Sundays and the following State of Missouri observed holidays: New Year's Day, Martin Luther King, Jr. Day, Lincoln Day, Washington's Birthday, Truman Day, Memorial Day, Juneteenth, Independence Day, Labor Day, Columbus Day, Veterans Day, Thanksgiving Day and Christmas Day.

## **13.0 - AMERICAN AND MISSOURI - MADE PRODUCTS AND FIRMS**

- A. By signing the bid form and submitting a bid on this project, the Bidder certifies that it will use American and Missouri products as set forth in Article 1.7 of the General Conditions. Bidders are advised to review those requirements carefully prior to bidding.
- B. A preference shall be given to Missouri firms, corporations or individuals, or firms, corporations or individuals that maintain Missouri offices or places of business, when the quality of performance promised is equal or better and the price quoted is the same or less.
- C. Pursuant to Section 34.076, RSMo, a contractor or Bidder domiciled outside the boundaries of the State of Missouri shall be required, in order to be successful, to submit a bid the same percent less than the lowest bid submitted by a responsible contractor or Bidder domiciled in Missouri as would be required for such a Missouri domiciled contractor or Bidder to succeed over the bidding contractor or Bidder domiciled outside Missouri on a like contract or bid being let in the person's domiciliary state and, further, the contractor or Bidder domiciled outside the boundaries of Missouri shall be required to submit an audited financial statement as would be required of a Missouri domiciled contractor or Bidder on a like contract or bid being let in the domiciliary state of that contractor or Bidder.

## **14.0 – ANTI-DISCRIMINATION AGAINST ISRAEL ACT CERTIFICATION:**

- A. Pursuant to section 34.600, RSMo, if the Bidder meets the section 34.600, RSMo, definition of a “company” and the Bidder has ten or more employees, the Bidder must certify in writing that the Bidder is not currently engaged in a boycott of goods or services from the State of Israel as defined in section 34.600, RSMo, and shall not engage in a boycott of goods or services from the State of Israel, if awarded a contract, for the duration of the contract. The Bidder is requested to complete and submit the applicable portion of Section 004545 - Anti-Discrimination Against Israel Act Certification with their Bid Form. The applicable portion of the exhibit must be submitted prior to execution of a contract by the Owner and issuance of Notice to Proceed. If the exhibit is not submitted, the Owner shall rescind its Intent to Award and move to the next lowest, responsive, responsible bidder.

## **15.0 - MBE/WBE/SDVE INSTRUCTIONS**

- A. Definitions:
  - 1. “**MBE**” means a Minority Business Enterprise.
  - 2. “**MINORITY**” has the same meaning as set forth in 1 C.S.R. 10-17.010.
  - 3. “**MINORITY BUSINESS ENTERPRISE**” has the same meaning as set forth in section 37.020, RSMo.
  - 4. “**WBE**” means a Women’s Business Enterprise.
  - 5. “**WOMEN’S BUSINESS ENTERPRISE**” has the same meaning as set forth in section 37.020, RSMo.
  - 6. “**SDVE**” means a Service-Disabled Veterans Enterprise.
  - 7. “**SERVICE-DISABLED VETERAN**” has the same meaning as set forth in section 34.074, RSMo.
  - 8. “**SERVICE-DISABLED VETERAN ENTERPRISE**” has the same meaning as “Service-Disabled Veteran Business” set forth in section 34.074, RSMo.

B. MBE/WBE/SDVE General Requirements:

1. For all bids greater than \$100,000, the Bidder shall obtain MBE, WBE and SDVE participation in an amount equal to or greater than the percentage goals set forth in the Invitation for Bid and the Bid Form, unless the Bidder is granted a Good Faith Effort waiver by the Director of the Division, as set forth below. If the Bidder does not meet the MBE, WBE and SDVE goals, or make a good faith effort to do so, the Bidder shall be non-responsive, and its bid shall be rejected.
2. The Bidder should submit with its bid all of the information requested in the MBE/WBE/SDVE Compliance Evaluation Form for every MBE, WBE, or SDVE subcontractor or material supplier the Bidder intends to use for the contract work. The Bidder is required to submit all appropriate MBE/WBE/SDVE documentation before the stated time and date set forth in the Invitation for Bid. If the Bidder fails to provide such information by the specified date and time, the Owner shall reject the bid.
3. The Director reserves the right to request additional information from a Bidder to clarify the Bidder's proposed MBE, WBE, and/or SDVE participation. The Bidder shall submit the clarifying information requested by the Owner within two (2) Working Days of receiving the request for clarification.
4. Pursuant to section 34.074, RSMo, a Bidder that is a SDVE doing business as Missouri firm, corporation, or individual, or that maintains a Missouri office or place of business, shall receive a three-point bonus preference in the contract award evaluation process. The bonus preference will be calculated and applied by reducing the bid amount of the eligible SDVE by three percent of the apparent low responsive bidder's bid. Based on this calculation, if the eligible SDVE's evaluation is less than the apparent low responsive bidder's bid, the eligible SDVE's bid becomes the apparent low responsive bid. This reduction is for evaluation purposes only, and will have no impact on the actual amount(s) of the bid or the amount(s) of any contract awarded. In order to be eligible for the SDVE preference, the Bidder must complete and submit with its bid the Missouri Service Disabled Veteran Business Form, and any information required by the form. The form is available on the MissouriBUYS solicitation for this project.

C. Computation of MBE/WBE/SDVE Goal Participation:

1. A Bidder who is a MBE, WBE, or SDVE may count 100% of the contract towards the MBE, WBE or SDVE goal, less any amounts awarded to another MBE, WBE or SDVE. (NOTE: A MBE firm that bids as general contractor must obtain WBE and SDVE participation; a WBE firm that bids as a general contractor must obtain MBE and SDVE participation; and a SDVE firm that bids as general contractor must obtain MBE and WBE participation.) In order for the remaining contract amount to be counted towards the MBE, WBE or SDVE goal, the Bidder must complete the MBE/WBE/SDVE Compliance Evaluation Form (Section 004337) identifying itself as an MBE, WBE or SDVE.
2. The total dollar value of the work granted to a certified MBE, WBE or SDVE by the Bidder shall be counted towards the applicable goal.
3. Expenditures for materials and supplies obtained from a certified MBE, WBE, or SDVE supplier or manufacturer may be counted towards the MBE, WBE and SDVE goals, if the MBE, WBE, or SDVE assumes the actual and contractual responsibility for the provision of the materials and supplies.
4. The total dollar value of the work granted to a second or subsequent tier subcontractor or a supplier may be counted towards a Bidder's MBE, WBE and SDVE goals, if the MBE, WBE, or SDVE properly assumes the actual and contractual responsibility for the work.
5. The total dollar value of work granted to a certified joint venture equal to the percentage of the ownership and control of the MBE, WBE, or SDVE partner in the joint venture may be counted towards the MBE/WBE/SDVE goals.
6. Only expenditures to a MBE, WBE, or SDVE that performs a commercially useful function in the work may be counted towards the MBE, WBE and SDVE goals. A MBE, WBE, or SDVE performs a commercially useful function when it is responsible for executing a distinct element of the work and carrying out its responsibilities by actually performing, managing and supervising the work or providing supplies or manufactured materials.



D. Certification of MBE/WBE/SDVE Subcontractors:

1. In order to be counted towards the goals, an MBE or WBE must be certified by the State of Missouri Office of Equal Opportunity and an SDVE must be certified by the State of Missouri, Office of Administration, Division of Purchasing and Material Management or by the Department of Veterans Affairs.
2. The Bidder may determine the certification status of a proposed MBE or WBE subcontractor or supplier by referring to the Office of Equal Opportunity (OEO)'s online MBE/WBE directory (<https://apps1.mo.gov/MWBCertifiedFirms/>). The Bidder may determine the eligibility of a SDVE subcontractor or supplier by referring to the Division of Purchasing and Materials Management's online SDVE directory (<https://oa.mo.gov/sites/default/files/sdvelisting.pdf>) or the Department of Veterans Affairs' directory (<https://vetbiz.va.gov/basic-search/>).
3. Additional information, clarifications, etc., regarding the listings in the directories may be obtained by calling the Division at (573)751-3339 and asking to speak to the Contract Specialist of record as shown in the Supplementary Conditions (Section 007300).

E. Waiver of MBE/WBE/SDVE Participation:

1. If a Bidder has made a good faith effort to secure the required MBE, WBE and/or SDVE participation and has failed, the Bidder shall submit with its bid the information requested in MBE/WBE/SDVE Good Faith Effort (GFE) Determination form. The GFE forms are located on the MissouriBUYS solicitation for this project. The Director will determine if the Bidder made a good faith effort to meet the applicable goals. If the Director determines that the Bidder did not make a good faith effort, the bid shall be rejected as being nonresponsive to the bid requirements. Bidders who demonstrate that they have made a good faith effort to include MBE, WBE, and/or SDVE participation will be determined to be responsive to the applicable participation goals, regardless of the percent of actual participation obtained, if the bid is otherwise acceptable.
2. In determining whether a Bidder has made a good faith effort to obtain MBE, WBE and/or SDVE participation, the Director may evaluate the factors set forth in 1 CSR 30-5.010(6)(C) and the following:
  - a. The amount of actual participation obtained;
  - b. How and when the Bidder contacted potential MBE, WBE, and SDVE subcontractors and suppliers;
  - c. The documentation provided by the Bidder to support its contacts, including whether the Bidder provided the names, addresses, phone numbers, and dates of contact for MBE/WBE/SDVE firms contacted for specific categories of work;
  - d. If project information, including plans and specifications, were provided to MBE/WBE/SDVE subcontractors;
  - e. Whether the Bidder made any attempts to follow-up with MBE, WBE or SDVE firms prior to bid;
  - f. Amount of bids received from any of the subcontractors and/or suppliers that the Bidder contacted;
  - g. The Bidder's stated reasons for rejecting any bids;
3. If no bidder has obtained any participation in a particular category (MBE/WBE/SDVE) or made a good faith effort to do so, the Director may waive that goal rather than rebid.

F. Contractor MBE/WBE/SDVE Obligations

1. If awarded a contract, the Bidder will be contractually required to subcontract with or obtain materials from the MBE, WBE, and SDVE firms listed in its bid, in amounts equal to or greater than the dollar amount bid, unless the amount is modified in writing by the Owner.
2. If the Contractor fails to meet or maintain the participation requirements contained in the Contractor's bid, the Contractor must satisfactorily explain to the Director why it cannot comply with the requirement and why failing meeting the requirement was beyond the Contractor's control. If the Director finds the Contractor's explanation unsatisfactory, the Director may take any appropriate action including, but not limited to:
  - a. Declaring the Contractor ineligible to participate in any contracts with the Division for up to twelve (12) months (suspension); and/or
  - b. Declaring the Contractor be non-responsive to the Invitation for Bid, or in breach of contract and rejecting the bid or terminating the contract.
3. If the Contractor replaces an MBE, WBE, or SDVE during the course of this contract, the Contractor shall replace it with another MBE, WBE, or SDVE or make a good faith effort to do so. All MBE, WBE and SDVE substitutions must be approved by the Director.
4. The Contractor shall provide the Owner with regular reports on its progress in meeting its MBE/WBE/SDVE obligations. At a minimum, the Contractor shall report the dollar-value of work completed by each MBE, WBE, or SDVE during the preceding month and the cumulative total of work completed by each MBE, WBE or SDVE to date with each monthly application for payment. The Contractor shall also make a final report, which shall include the total dollar-value of work completed by each MBE, WBE, and SDVE during the entire contract.

**STATE OF MISSOURI  
DIVISION OF FACILITIES MANAGEMENT,  
DESIGN AND CONSTRUCTION  
*MBE/WBE/SDVE DIRECTORIES***

---

---

The MBE/WBE Directory for goods and services is maintained by the Office of Equal Opportunity (OEO) and is located at the following web address:

<https://apps1.mo.gov/MWBCertifiedFirms/>

The SERVICE DISABLED VETERAN ENTERPRISE (SDVE) Directories may be accessed at the following web addresses:

<https://o eo.mo.gov/wp-content/uploads/2023/07/list-certified-missouri-service-disabled-veteran-business-enterprises-sdves.pdf>

<https://veterans.certify.sba.gov/#search>



# State of Missouri Construction Contract

THIS AGREEMENT is made (DATE) by and between:

## *Contractor Name and Address*

hereinafter called the "Contractor,"

and the **State of Missouri**, hereinafter called the "**Owner**", represented by the Office of Administration, Division of Facilities Management, Design and Construction, on behalf of the Department of Public Safety/National Guard.

WITNESSETH, that the Contractor and the Owner, for the consideration stated herein agree as follows:

## **ARTICLE 1. STATEMENT OF WORK**

The Contractor shall furnish all labor and materials and perform all work required for furnishing and installing all labor, materials, equipment and transportation and everything necessarily inferred from the general nature and tendency of the plans and specifications for the proper execution of the work for:

**Project Name:**                    **Re-Bid Renovate Interior & Exterior  
Kennett Readiness Center Building  
Kennett, Missouri**

**Project Number:**                **T2209-01 Re-bid**

in strict accordance with the Contract Documents as enumerated in Article 7, all of which are made a part hereof.

## **ARTICLE 2. TIME OF COMPLETION**

The contract performance time is **180 working days** from the transmittal date of this agreement. The contract completion date is **MONTH, DAY, YEAR**. This time includes ten (10) working days for the Contractor to receive, sign and return the contract form along with required bonding and insurance certificates. Failure of the Contractor to provide correct bonding and insurance within the ten (10) working days shall not be grounds for a time extension. Receipt of proper bonding and insurance is a condition precedent to the formation of the contract and if not timely received, may result in forfeiture of the Contractor's bid security. Work may not commence until the Owner issues a written Notice to Proceed and must commence within seven (7) working days thereafter.

## **ARTICLE 3. LIQUIDATED DAMAGES**

Whenever time is mentioned in this contract, time shall be and is of the essence of this contract. The Owner would suffer a loss should the Contractor fail to have the work embraced in this contract fully completed on or before the time above specified. THEREFORE, the parties hereto realize in order to adjust satisfactorily the damages on account of such failure that it might be impossible to compute accurately or estimate the amount of such loss or damages which the Owner would sustain by reason of failure to complete fully said work within the time required by this contract. The Contractor hereby covenants and agrees to pay the Owner, as and for **liquidated damages, the sum of \$700** per day for each and every day, Sunday and legal holidays excepted, during which the work remains incomplete and unfinished. Any sum which may be due the Owner for such damages shall be deducted and retained by the Owner from any balance which may be due the Contractor when said work shall have been finished and accepted. But such provisions shall not release the Bond of the Contractor from liability according to its terms. In case of failure to complete, the Owner will be under no obligation to show or prove any actual or specific loss or damage.

**ARTICLE 4. CONTRACT SUM**

The Owner shall pay the Contractor for the prompt, faithful and efficient performance of the conditions and undertakings of this contract, subject to additions, and deductions as provided herein, in current funds the sum of:

Base Bid: \$  
Alternate No. 1: \$  
Alternate No. 2: \$  
Alternate No. 3: \$

**TOTAL CONTRACT AMOUNT: (\$CONTRACT AMOUNT)**

**UNIT PRICES:** The Owner accepts the following Unit Prices:

For changing specified quantities of work from those indicated by the contract drawings and specifications, upon written instructions of Owner, the following unit prices shall prevail. The unit prices include all labor, overhead and profit, materials, equipment, appliances, bailing, shoring, shoring removal, etc., to cover the finished work of the several kinds of work called for. Only a single unit price shall be given and it shall apply for either MORE or LESS work than that shown on the drawings and called for in the specifications or included in the Base Bid. In the event of more or less units than so indicated or included, change orders may be issued for the increased or decreased amount.

**ARTICLE 5. PREVAILING WAGE RATE**

**MISSOURI PREVAILING WAGE LAW (Sections 290.210 to 290.340, RSMo):** The Contractor shall pay not less than the specified hourly rate of wages, as set out in the wage order attached to and made part of the specifications for work under this contract, to all workers performing work under the contract, in accordance with sections 290.210 to 290.340, RSMo. The Contractor shall forfeit a penalty to the Owner of one hundred dollars per day (or portion of a day) for each worker that is paid less than the specified rates for any work done under the contract by the Contractor or by any subcontractor, in accordance with section 290.250, RSMo.

**DAVIS-BACON ACT:** If this Project is financed in whole or in part from Federal funds (as indicated in the Instructions to Bidders or other bid or contract documents for this Project), then this contract shall be subject to all applicable federal labor statutes, rules and regulations, including provisions of the Davis-Bacon Act, 40 U.S.C. §3141 et seq., and the “Federal Labor Standards Provisions,” as further set forth in Section 007333 – Supplementary General Conditions for Federally Funded/Assisted Construction Projects, which is incorporated into the contract by reference. Where the Missouri Prevailing Wage Law and the Davis-Bacon Act require payment of different wages for work performed under this contract, the Contractor and all Subcontractors shall pay the greater of the wages required under either law, on a classification by classification basis.

**ARTICLE 6. MINORITY/WOMEN/SERVICE DISABLED VETERAN BUSINESS ENTERPRISE PARTICIPATION**

The Contractor has been granted a waiver of the 10% MBE and 10% WBE and 3% SDVE participation goals. The Contractor agrees to secure the MBE/WBE/SDVE participation amounts for this project as follows: (OR)

The Contractor has met the MBE/WBE/SDVE participation goals and agrees to secure the MBE/WBE/SDVE participation amounts for this project as follows:

MBE/WBE/SDVE Firm: Subcontract Amt:\$  
MBE/WBE/SDVE Firm: Subcontract Amt:\$  
MBE/WBE/SDVE Firm: Subcontract Amt:\$

Total \$

MBE/WBE/SDVE assignments identified above shall not be changed without a contract change signed by the Owner.

The Director of the Division of Facilities Management, Design and Construction or his Designee shall be the final authority to resolve disputes and disagreements between the Contractor and the MBE/WBE/SDVE firms listed above when such disputes impact the subcontract amounts shown above.

## **ARTICLE 7. CONTRACT DOCUMENTS**

The following documents are hereby incorporated into this contract by reference (all division/section numbers and titles are as utilized in the Project Manual published by the Owner for this Project):

1. Division 0 – Procurement and Contracting Information, including, but not limited to:
  - a. Invitation for Bid (Section 001116)
  - b. Instructions to Bidders (Section 002113)
  - c. Supplementary Instructions to Bidders (if applicable) (Section 002213)
  - d. The following documents as completed and executed by the Contractor and accepted by the Owner, if applicable:
    - i. Bid Form (Section 004113)
    - ii. Unit Prices (Section 004322)
    - iii. Proposed Contractors Form (Section 004336)
    - iv. MBE, WBE, SDVE Compliance Evaluation Form(s) (Section 004337)
    - v. MBE, WBE, SDVE Eligibility Determination Form for Joint Ventures (Section 004338)
    - vi. MBE, WBE, SDVE Good Faith Effort (GFE) Determination Form (Section 004339)
    - vii. Missouri Service Disabled Veteran Business Form (Section 004340)
    - viii. Affidavit of Work Authorization (Section 004541)
    - ix. Affidavit for Affirmative Action (Section 005414)
  - e. Performance and Payment Bond, completed and executed by the Contractor and surety (Section 006113)
  - f. General Conditions (Section 007213)
  - g. Supplementary Conditions (Section 007300)
  - h. Supplementary General Conditions for Federally Funded/Assisted Construction Projects (Section 007333)
  - i. Wage Rate(s) (Section 007346)
2. Division 1 – General Requirements
3. All Drawings identified in the Project Manual
4. All Technical Specifications included in the Project Manual
5. Addenda, if applicable

## **ARTICLE 8 – CERTIFICATION**

By signing this contract, the Contractor hereby re-certifies compliance with all legal requirements set forth in Section 6.0, Bidder’s Certifications of the Bid Form.

Further, if the Contractor provides any “personal information” as defined in §105.1500, RSMo concerning an entity exempt from federal income tax under Section 501(c) of the Internal Revenue Code of 1986, as amended, the Contractor understands and agrees that it is voluntarily choosing to enter into a state contract and providing such information for that purpose. The state will treat such personal information in accord with §105.1500, RSMo.

By signature below, the parties hereby execute this contract document.

**APPROVED:**

\_\_\_\_\_  
Brian Yansen, Director  
Division of Facilities Management,  
Design and Construction

\_\_\_\_\_  
Contractor's Authorized Signature

I, Corporate Secretary, certify that I am Secretary of the corporation named above and that (CONTRACTOR NAME), who signed said contract on behalf of the corporation, was then (TITLE) of said corporation and that said contract was duly signed for and in behalf of the corporation by authority of its governing body, and is within the scope of its corporate powers.

\_\_\_\_\_  
*Corporate Secretary*



STATE OF MISSOURI  
 OFFICE OF ADMINISTRATION  
 DIVISION OF FACILITIES MANAGEMENT, DESIGN AND CONSTRUCTION  
**AFFIDAVIT FOR AFFIRMATIVE ACTION**

PROJECT NUMBER
----------------

NAME
------

First being duly sworn on oath states: that

he/she is the  sole proprietor  partner  officer or  manager or managing member of

NAME
------

a  sole proprietorship  partnership  
 limited liability company (LLC)

or  corporation, and as such, said proprietor, partner, or officer is duly authorized to make this

affidavit on behalf of said sole proprietorship, partnership, or corporation; that under the contract known as

PROJECT TITLE
---------------

Less than 50 persons in the aggregate will be employed and therefore, the applicable Affirmative Action requirements as set forth in Article 1.4 of the General Conditions of the State of Missouri have been met.

PRINT NAME & SIGNATURE
------------------------

DATE
------

--

**NOTARY INFORMATION**

NOTARY PUBLIC EMBOSSER SEAL	STATE OF	COUNTY (OR CITY OF ST. LOUIS)	USE RUBBER STAMP IN CLEAR AREA BELOW
	SUBSCRIBED AND SWORN BEFORE ME, THIS		
	DAY OF	YEAR	
	NOTARY PUBLIC SIGNATURE	MY COMMISSION EXPIRES	
NOTARY PUBLIC NAME (TYPED OR PRINTED)			



**SECTION 006113 - PERFORMANCE AND PAYMENT BOND FORM**

KNOW ALL MEN BY THESE PRESENTS, THAT we \_\_\_\_\_

as principal, and \_\_\_\_\_

\_\_\_\_\_ as Surety, are held and firmly bound unto the

STATE OF MISSOURI. in the sum of \_\_\_\_\_ Dollars (\$ \_\_\_\_\_ )

for payment whereof the Principal and Surety bind themselves, their heirs, executors, administrators and successors, jointly and severally, firmly by these presents.

WHEREAS, the Principal has, by means of a written agreement dated the \_\_\_\_\_

day of \_\_\_\_\_, 20\_\_\_\_\_, enter into a contract with the State of Missouri for

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

(Insert Project Title and Number)

NOW, THEREFORE, if the Principal shall faithfully perform and fulfill all the undertakings, covenants, terms, conditions and agreements of said contract during the original term of said contract and any extensions thereof that may be granted by the State of Missouri, with or without notice to the Surety and during the life of any guaranty required under the contract; and shall also faithfully perform and fulfill all undertakings, covenants, terms, conditions and agreements of any and all duly authorized modifications of said contract that may hereafter be made with or without notice to the Surety; and shall also promptly make payment for materials incorporated, consumed or used in connection with the work set forth in the contract referred to above, and all insurance premiums, both compensation and all other kinds of insurance, on said work, and for all labor performed on such work, whether by subcontractor or otherwise, at not less than the prevailing hourly rate of wages for work of a similar character (exclusive of maintenance work) in the locality in which the work is performed and not less than the prevailing hourly rate of wages for legal holiday and overtime work (exclusive of maintenance work) in the locality in which the work is performed both as determined by the Department of Labor and Industrial Relations or determined by the Court of Appeal, as provided for in said contract and in any and all duly authorized modifications of said contract that may be hereafter made, with or without notice to the Surety, then, this obligation shall be void and of no effect, but it is expressly understood that if the Principal should make default in or should fail to strictly, faithfully and efficiently do, perform and comply with any or more of the covenants, agreements, stipulations, conditions, requirements or undertakings, as specified in or by the terms of said contract, and with the time therein named, then this obligation shall be valid and binding upon each of the parties hereto and this bond shall remain in full force and effect; and the same may be sued on at the instance of any material man, laborer, mechanic, subcontractor, individual, or otherwise to whom such payment is due, in the name of the State of Missouri, to the use of any such person.

AND, IT IS FURTHER specifically provided that any modifications which may hereinafter be made in the terms of the contract or in the work to be done under it or the giving by the Owner of any extension of the time for the performance of the contract or any other forbearance on the part of either the Owner or the Principal to the other, shall not in any way release the Principal and the Surety, or either or any of them, their heirs, executors, administrators and successors, from their liability hereunder, notice to the Surety of any such extension, modifications or forbearance being hereby waived.

IN WITNESS WHEREOF, the above bounden parties have executed the within instrument this \_\_\_\_\_ day of \_\_\_\_\_, 20 \_\_\_\_.

**AS APPLICABLE:**

**AN INDIVIDUAL**

Name: \_\_\_\_\_

Signature: \_\_\_\_\_

**A PARTNERSHIP**

Name of Partner: \_\_\_\_\_

Signature of Partner: \_\_\_\_\_

Name of Partner: \_\_\_\_\_

Signature of Partner: \_\_\_\_\_

**CORPORATION**

Firm Name: \_\_\_\_\_

Signature of President: \_\_\_\_\_

**SURETY**

Surety Name: \_\_\_\_\_

Attorney-in-Fact: \_\_\_\_\_

Address of Attorney-in-Fact: \_\_\_\_\_

Telephone Number of Attorney-in-Fact: \_\_\_\_\_

Signature Attorney-in-Fact: \_\_\_\_\_

**NOTE:** Surety shall attach Power of Attorney



STATE OF MISSOURI  
 OFFICE OF ADMINISTRATION  
 DIVISION OF FACILITIES MANAGEMENT, DESIGN AND CONSTRUCTION  
**PRODUCT SUBSTITUTION REQUEST**

PROJECT NUMBER

PROJECT TITLE AND LOCATION

CHECK APPROPRIATE BOX

- SUBSTITUTION PRIOR TO BID OPENING**  
 (Minimum of (5) working days prior to receipt of Bids as per Article 4 – Instructions to Bidders)
- SUBSTITUTION FOLLOWING AWARD**  
 (Maximum of (20) working days from Notice to Proceed as per Article 3 – General Conditions)

FROM: BIDDER/CONTRACTOR (PRINT COMPANY NAME)

TO: ARCHITECT/ENGINEER (PRINT COMPANY NAME)

Bidder/Contractor hereby requests acceptance of the following product or systems as a substitution in accordance with provisions of Division One of the Bidding Documents:

SPECIFIED PRODUCT OR SYSTEM

SPECIFICATION SECTION NO.

SUPPORTING DATA

- Product data for proposed substitution is attached (include description of product, standards, performance, and test data)
- Sample  Sample will be sent, if requested

**QUALITY COMPARISON**

	SPECIFIED PRODUCT	SUBSTITUTION REQUEST
NAME, BRAND		
CATALOG NO.		
MANUFACTURER		
VENDOR		

**PREVIOUS INSTALLATIONS**

PROJECT	ARCHITECT/ENGINEER	DATE INSTALLED
LOCATION		

**SIGNIFICANT VARIATIONS FROM SPECIFIED PRODUCT**

---

---

---

---

---

---

---

---

---

---

**REASON FOR SUBSTITUTION**

---

---

---

---

---

---

**DOES PROPOSED SUBSTITUTION AFFECT OTHER PARTS OF WORK?**

YES     NO

IF YES, EXPLAIN

---

---

---

---

---

---

**SUBSTITUTION REQUIRES DIMENSIONAL REVISION OR REDESIGN OF STRUCTURE OR A/E WORK**

YES     NO

**BIDDER'S/CONTRACTOR'S STATEMENT OF CONFORMANCE OF PROPOSED SUBSTITUTION TO CONTRACT REQUIREMENT:**

We have investigated the proposed substitution. We believe that it is equal or superior in all respects to specified product, except as stated above; that it will provide the same Warranty as specified product; that we have included complete implications of the substitution; that we will pay redesign and other costs caused by the substitution which subsequently become apparent; and that we will pay costs to modify other parts of the Work as may be needed, to make all parts of the Work complete and functioning as a result of the substitution.

BIDDER/CONTRACTOR

DATE

**REVIEW AND ACTION**

Resubmit Substitution Request with the following additional information:

---

Substitution is accepted.

Substitution is accepted with the following comments:

---

Substitution is not accepted.

ARCHITECT/ENGINEER

DATE



PROJECT NUMBER
----------------

KNOW ALL MEN BY THESE PRESENT THAT:                    hereinafter called "Subcontractor" who heretofore entered into an agreement with                    hereinafter called "Contractor", for the performance of work and/or furnishing of material for the construction of the project entitled

(PROJECT TITLE, PROJECT LOCATION, AND PROJECT NUMBER)

at

(ADDRESS OF PROJECT)

for the State of Missouri (Owner) which said subcontract is by this reference incorporated herein, in consideration of such final payment by Contractor.

DOES HEREBY:

1. ACKNOWLEDGE that they have been **PAID IN FULL** all sums due for work and materials contracted or done by their Subcontractors, Material Vendors, Equipment and Fixture Suppliers, Agents and Employees, or otherwise in the performance of the Work called for by the aforesaid Contract and all modifications or extras or additions thereto, for the construction of said project or otherwise.
2. RELEASE and fully, finally, and forever discharge the Owner from any and all suits, actions, claims, and demands for payment for work performed or materials supplied by Subcontractor in accordance with the requirements of the above referenced Contract.
1. REPRESENT that all of their Employees, Subcontractors, Material Vendors, Equipment and Fixture Suppliers, and everyone else has been **paid in full** all sums due them, or any of them, in connection with performance of said Work, or anything done or omitted by them, or any of them in connection with the construction of said improvements, or otherwise.

DATED this                    day of                    , 20                    .

NAME OF SUBCONTRACTOR

BY (TYPED OR PRINTED NAME)

SIGNATURE

TITLE

ORIGINAL: FILE/Closeout Documents



STATE OF MISSOURI  
 OFFICE OF ADMINISTRATION  
 DIVISION OF FACILITIES MANAGEMENT,  
 DESIGN AND CONSTRUCTION

**MBE/WBE/SDVE PROGRESS REPORT**

Remit with **ALL** Progress and Final Payments

(Please check appropriate box) CONSULTANT CONSTRUCTION

PAY APP NO.	PROJECT NUMBER
CHECK IF FINAL <input checked="" type="checkbox"/> <b>FINAL</b>	DATE

PROJECT TITLE

PROJECT LOCATION

FIRM

ORIGINAL CONTRACT SUM (Same as Line Item 1. on Form A of Application for Payment) \$	TOTAL CONTRACT SUM TO DATE (Same as Line Item 3. on Form A of Application for Payment) \$
---	--

THE TOTAL MBE/WBE/SDVE PARTICIPATION DOLLAR AMOUNT OF THIS PROJECT AS INDICATED IN THE ORIGINAL CONTRACT: \$

SELECT MBE, WBE, SDVE	ORIGINAL CONTRACT PARTICIPATION AMOUNT	PARTICIPATION AMOUNT PAID-TO-DATE (includes approved contract changes)	CONSULTANT/SUBCONSULTANT OR CONTRACTOR/SUBCONTRACTOR/SUPPLIER COMPANY NAME
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	

## **INSTRUCTIONS FOR MBE/WBE/SDVE PROGRESS REPORT**

### **CONTRACTOR OR CONSULTANT TO FILL OUT AND REMIT WITH EACH PAY APPLICATION:**

The MBE/WBE/SDVE Progress Report for the project is issued with the contract comprising values reported in the consultant's Proposal or on the successful contractor's Section 004337 Compliance Evaluation Forms.

At Initial Pay Application fill in the following:

1. Pay App No. Start with 1.
2. Fill in the Project Number and Date.
3. Enter Project Title, Project Location, and Firm.
4. Fill in the "Original Contract Sum" and "Total Contract Sum To Date" (Reference applicable Line Items on Form A of Application for Payment).
5. Indicate the Total Participation Dollar Amount from the Original Contract.
6. Select MBE, WBE, or SDVE for each Consultant/Subconsultant or Contractor/Subcontractor/Supplier.
7. Enter the "Total Amount of Subcontract", "\$ Amount (Paid-To-Date)", and Company Name.

For all subsequent Pay Applications fill in the following:

1. Pay App No.
2. If Final Pay App, check box.
3. Fill in the Project Number and Date.
4. Enter Project Title, Project Location, and Firm
5. At each Pay App fill in the "Original Contract Sum" and "Total Contract Sum To Date" (reference applicable Line Items on Form A of Application for Payment).
6. Indicate the Total Participation Dollar Amount from the Original Contract.
7. Select MBE, WBE, or SDVE for each Consultant/Subconsultant or Contractor/Subcontractor/Supplier
8. Enter the "Total Amount of Subcontract", "\$ Amount (Paid-To-Date)", and Company Name.



STATE OF MISSOURI  
 OFFICE OF ADMINISTRATION  
 DIVISION OF FACILITIES MANAGEMENT, DESIGN AND CONSTRUCTION  
**AFFIDAVIT – COMPLIANCE WITH PREVAILING WAGE LAW**

PROJECT NUMBER
----------------

Before me, the undersigned Notary Public, in and for the County of \_\_\_\_\_

State of \_\_\_\_\_ personally came and appeared \_\_\_\_\_

(NAME)

\_\_\_\_\_ of the \_\_\_\_\_

(POSITION) (NAME OF THE COMPANY)

(a corporation) (a partnership) (a proprietorship) and after being duly sworn did depose and say that all provisions and requirements set out in Chapter 290, Sections 290.210 through and including 290.340, Missouri Revised Statutes, pertaining to the payment of wages to workmen employed on public works project have been fully satisfied and there has been no exception to the full and completed compliance with said provisions and requirements and with Wage Determination No: \_\_\_\_\_ issued by the Department of Labor and Industrial Relations, State of Missouri on the \_\_\_\_\_ day of \_\_\_\_\_ 20 \_\_\_\_\_ in carrying out the contract and working in connection with \_\_\_\_\_

(NAME OF PROJECT)

Located at \_\_\_\_\_ in \_\_\_\_\_ County

(NAME OF THE INSTITUTION)

Missouri, and completed on the \_\_\_\_\_ day of \_\_\_\_\_ 20 \_\_\_\_\_

SIGNATURE

**NOTARY INFORMATION**

NOTARY PUBLIC EMBOSSEY OR BLACK INK RUBBER STAMP SEAL	STATE	COUNTY (OR CITY OF ST. LOUIS)
	SUBSCRIBED AND SWORN BEFORE ME, THIS	
	DAY OF	YEAR
	NOTARY PUBLIC SIGNATURE	MY COMMISSION EXPIRES
NOTARY PUBLIC NAME (TYPED OR PRINTED)		<b>USE RUBBER STAMP IN CLEAR AREA BELOW</b>

FILE: Closeout Documents



# GENERAL CONDITIONS

## INDEX

ARTICLE:

**1. General Provisions**

- 1.1. Definitions
- 1.2. Drawings and Specifications
- 1.3. Compliance with Laws, Permits, Regulations and Inspections
- 1.4. Nondiscrimination in Employment
- 1.5. Anti-Kickback
- 1.6. Patents and Royalties
- 1.7. Preference for American and Missouri Products and Services
- 1.8. Communications
- 1.9. Separate Contracts and Cooperation
- 1.10. Assignment of Contract
- 1.11. Indemnification
- 1.12. Disputes and Disagreements

**2. Owner/Designer Responsibilities**

**3. Contractor Responsibilities**

- 3.1. Acceptable Substitutions
- 3.2. Submittals
- 3.3. As-Built Drawings
- 3.4. Guaranty and Warranties
- 3.5. Operation and Maintenance Manuals
- 3.6. Other Contractor Responsibilities
- 3.7. Subcontracts

**4. Changes in the Work**

- 4.1. Changes in the Work
- 4.2. Changes in Completion Time

**5. Construction and Completion**

- 5.1. Construction Commencement
- 5.2. Project Construction
- 5.3. Project Completion
- 5.4. Payments

**6. Bond and Insurance**

- 6.1. Bond
- 6.2. Insurance

**7. Termination or Suspension of Contract**

- 7.1. For Site Conditions
- 7.2. For Cause
- 7.3. For Convenience

## SECTION 007213 - GENERAL CONDITIONS

- A. These General Conditions apply to each section of these specifications. The Contractor is subject to the provisions contained herein.
- B. The General Conditions are intended to define the relationship of the Owner, the Designer and the Contractor thereby establishing certain rules and provisions governing the operation and performance of the work so that the work may be performed in a safe, orderly, expeditious and workmanlike manner.

## ARTICLE 1 – GENERAL PROVISIONS

### ARTICLE 1.1 - DEFINITIONS

As used in these contract documents, the following terms shall have the meanings and refer to the parties designated in these definitions.

1. **"COMMISSIONER"**: The Commissioner of the Office of Administration.
2. **"CONSTRUCTION DOCUMENTS"**: The "Construction Documents" shall consist of the Project Manual, Drawings and Addenda.
3. **"CONSTRUCTION REPRESENTATIVE"**: Whenever the term "Construction Representative" is used, it shall mean the Owner's Representative at the work site.
4. **"CONTRACTOR"**: Party or parties who have entered into a contract with the Owner to furnish work under these specifications and drawings.
5. **"DESIGNER"**: When the term "Designer" is used herein, it shall refer to the Architect, Engineer, or Consultant of Record specified and defined in Paragraph 2.0 of the Supplemental Conditions, or his duly authorized representative. The Designer may be either a consultant or state employee.
6. **"DIRECTOR"**: Whenever the term "Director" is used, it shall mean the Director of the Division of Facilities Management, Design and Construction or his Designee, representing the Office of Administration, State of Missouri. The Director is the agent of the Owner.
7. **"DIVISION"**: Shall mean the Division of Facilities Management, Design and Construction, State of Missouri.

8. **"INCIDENTAL JOB BURDENS"**: Shall mean those expenses relating to the cost of work, incurred either in the home office or on the job-site, which are necessary in the course of doing business but are incidental to the job. Such costs include office supplies and equipment, postage, courier services, telephone expenses including long distance, water and ice and other similar expenses.
9. **"JOINT VENTURE"**: An association of two (2) or more businesses to carry out a single business enterprise for profit for which purpose they combine their property, capital, efforts, skills and knowledge.
10. **"OWNER"**: Whenever the term "Owner" is used, it shall mean the State of Missouri, acting by and through the Office of Administration, Division of Facilities Management, Design and Construction.
11. **"PROJECT"**: Wherever the term "Project" is used, it shall mean the work required to be completed by the construction contract.
12. **"PROJECT MANUAL"**: The "Project Manual" shall consist of Introductory Information, Invitation for Bid, Instructions to Bidders, Bid Documents, Additional Information, Standard Forms, General Conditions, Supplemental General Conditions, General Requirements and Technical Specifications.
13. **"SUBCONTRACTOR"**: Party or parties who contract under, or for the performance of part or this entire Contract between the Owner and Contractor. The subcontract may or may not be direct with the Contractor.
14. **"WORK"**: All supervision, labor, materials, tool, supplies, equipment, and any incidental operations and/or activities required by or reasonably inferable from the Contract Documents necessary to construct the Project and to produce the results intended by the Contract Documents in a safe, expeditious, orderly, and workmanlike manner, and in the best manner known to each respective trade.
15. **"WORKING DAYS"**: are all calendar days except Saturdays, Sundays and the following holidays: New Year's Day, Martin Luther King, Jr. Day, Lincoln Day, Washington's Birthday (observed), Truman Day, Memorial Day, Juneteenth, Independence Day, Labor Day, Columbus Day, Veterans Day (observed), Thanksgiving Day, Christmas Day.

## ARTICLE 1.2 DRAWINGS AND SPECIFICATIONS

- A. In case of discrepancy between drawings and specifications, specifications shall govern. Should discrepancies in architectural drawings, structural drawings and mechanical drawings occur, architectural drawings shall govern and, in case of conflict between structural and mechanical drawings, structural drawings shall govern.
- B. Specifications are separated into titled divisions for convenience of reference only and to facilitate letting of contracts and subcontracts. The Contractor is responsible for establishing the scope of work for subcontractors, which may cross titled divisions. Neither the Owner nor Designer will establish limits and jurisdiction of subcontracts.
- C. Figured dimensions take precedence over scaled measurements and details over smaller scale general drawings. In the event of conflict between any of the documents contained within the contract, the documents shall take precedence and be controlling in the following sequence: addenda, supplementary general conditions, general conditions, division 1 specifications, technical division specifications, drawings, bid form and instructions to bidders.
- D. Anything shown on drawings and not mentioned in these specifications or vice versa, as well as any incidental work which is obviously necessary to complete the project within the limits established by the drawings and specifications, although not shown on or described therein, shall be performed by the Contractor at no additional cost as a part of his contract.
- E. Upon encountering conditions differing materially from those indicated in the contract documents, the Contractor shall promptly notify the Designer and Construction Representative in writing before such conditions are disturbed. The Designer shall promptly investigate said conditions and report to the Owner, with a recommended course of action. If conditions do materially differ and cause an increase or decrease in contract cost or time required for completion of any portion of the work, a contract change will be initiated as outlined in Article 4 of these General Conditions.
- E. Only work included in the contract documents is authorized, and the Contractor shall do no work other than that described therein or in accordance with appropriately authorized and approved contract changes.

## ARTICLE 1.3 - COMPLIANCE WITH LAWS, PERMITS, REGULATIONS AND INSPECTIONS

- A. Since the Owner is the State of Missouri, municipal or political subdivisions, zoning ordinances, construction codes (other than licensing of trades), and other like ordinances are not applicable to construction on Owner's property, and Contractor will not be required to submit drawings and specifications to any municipal or political subdivision, authority, obtain construction permits or any other licenses (other than licensing of trades) or permits from or submit to inspections by any municipality or political subdivision relating to the construction for this project. All permits or licenses required by municipality or political subdivision for operation on property not belonging to Owner shall be obtained by and paid for by Contractor. Each Contractor shall comply with all applicable laws, ordinances, rules and regulations that pertain to the work of this contract.
- B. Contractors, subcontractors and their employees engaged in the businesses of electrical, mechanical, plumbing, carpentry, sprinkler system work, and other construction related trades shall be licensed to perform such work by the municipal or political subdivision where the project is located, if such licensure is required by local code. Local codes shall dictate the level (master, journeyman, and apprentice) and the number, type and ratio of licensed tradesmen required for this project within the jurisdiction of such municipal or political subdivision.
- C. Equipment and controls manufacturers and their authorized service and installation technicians that do not maintain an office within the jurisdiction of the municipal or political subdivision but are a listed or specified contractor or subcontractor on this project are exempt from Paragraph 1.3 B above.
- D. The Contractor shall post a copy of the wage determination issued for the project and included as a part of the contract documents, in a prominent and easily accessible location at the site of construction for the duration of the project.
- E. Any contractor or subcontractor to such contractor at any tier signing a contract to work on this project shall provide a ten-hour Occupational Safety and Health Administration (OSHA) construction safety program for their on-site employees which includes a course in construction safety and health approved by OSHA or a similar program approved by the Department of Labor and Industrial Relations which is at least as stringent as an approved OSHA program. The contractor shall

forfeit as a penalty to the public body on whose behalf the contract is made or awarded, two thousand five hundred dollars plus one hundred dollars for each employee employed by the contractor or subcontractor, for each calendar day, or portion thereof, such employee is employed without the required training.

#### **ARTICLE 1.4 - NONDISCRIMINATION IN EMPLOYMENT**

A. The Contractor and his subcontractors will not discriminate against individuals based on race, color, religion, national origin, sex, disability, or age, but may use restrictions which relate to bona fide occupational qualifications. Specifically, the Contractor and his subcontractors shall not discriminate:

1. Against recipients of service on the basis of race, color, religion, national origin, sex, disability or age.
2. Against any employee or applicant, for employment on the basis of race, color, religion, national origin, sex or otherwise qualified disability status.
3. Against any applicant for employment or employee on the basis of age, where such applicant or employee is between ages 40 and 70 and where such Contractor employs at least 20 persons.
4. Against any applicant for employment or employee on the basis of that person's status as a disabled or Vietnam-era veteran.

The Contractor and his Subcontractors will take affirmative action to insure applicants for employment and employees are treated equally without regard to race, color, religion, national origin, sex, disability, or age. Such action shall include, but not be limited to, the following: employment, upgrading, demotion and transfer; recruitment or recruitment advertising; and selection for training, including apprenticeship. The Contractor and his Subcontractors will give written notice of their commitments under this clause to any labor union with which they have bargaining or other agreements.

B. The Contractor and his subcontractors shall develop, implement, maintain and submit in writing to the Owner an affirmative action program if at least fifty (50) persons in the aggregate are employed under this contract. If less than fifty (50) persons in the aggregate are to be employed under this contract, the Contractor shall submit, in lieu of the written affirmative action program, a properly executed Affidavit for Affirmative Action

in the form included in the contract specifications. For the purpose of this section, an "affirmative action program" means positive action to influence all employment practices (including, but not limited to, recruiting, hiring, promoting and training) in providing equal employment opportunity regardless of race, color, sex, national origin, religion, age (where the person affected is between age 40 and 70), disabled and Vietnam-era veteran status, and disability. Such "affirmative action program" shall include:

1. A written policy statement committing the total organization to affirmative action and assigning management responsibilities and procedures for evaluation and dissemination;
2. The identification of a person designated to handle affirmative action;
3. The establishment of non-discriminatory selection standards, objective measures to analyze recruitment, an upward mobility system, a wage and salary structure, and standards applicable to lay-off, recall, discharge, demotion and discipline;
4. The exclusion of discrimination from all collective bargaining agreements; and
5. Performance of an internal audit of the reporting system to monitor execution and to provide for future planning.

In the enforcement of this non-discrimination clause, the Owner may use any reasonable procedures available, including, but not limited to: requests, reports, site visits and inspection of relevant documents of contractors and subcontractors.

C. In the event of the Contractor's or his subcontractor's noncompliance with any provisions of this Article of the Contract, the Owner may cancel this contract in whole or in part or require the Contractor to terminate his contract with the subcontractor.

#### **ARTICLE 1.5 - ANTI-KICKBACK**

No employee of the division, shall have or acquire any pecuniary interest, whether direct or indirect, in this contract or in any part hereof. No officer, employee, designer, attorney, or administrator of or for the Owner who is authorized in such capacity and on behalf of the Owner to exercise any legislative, executive, supervisory or other similar functions in connection with the construction of the project, shall have or acquire any pecuniary interest, whether direct or indirect, in this contract, any material supply contract, subcontract,

insurance contract, or any other contract pertaining to the project.

#### **ARTICLE 1.6 - PATENTS AND ROYALTIES**

- A. The Contractor shall hold and save the Owner and its officers, agents, servants and employees harmless from liabilities of any nature or kind, including cost and expenses, for, or on account of, any patented or unpatented invention, process, article or appliance manufactured or used in the performance of this contract, including its use by the Owner, unless otherwise specifically stipulated in the contract documents.
- B. If the Contractor uses any design, device or materials covered by letters, patent or copyright, the Contractor shall provide for such use by suitable agreement with the Owner of such patented or copyrighted design, device or material. It is mutually agreed and understood, without exception, that the contract prices shall include all royalties or costs arising from the use of such design, device or materials, in any way involved in the work. The Contractor and/or his sureties shall indemnify and save harmless the Owner of the project from any and all claims for infringement by reason of the use of such patented or copyrighted design, device or materials or any trademark or copyright in connection with work agreed to be performed under this contract and shall indemnify the Owner for any cost, expense or damage it may be obliged to pay by reason of such infringement at any time during the prosecution of the work or after completion of the work.

#### **ARTICLE 1.7 - PREFERENCE FOR AMERICAN AND MISSOURI PRODUCTS AND SERVICES**

- A. By virtue of statutory authority a preference will be given to Missouri labor and to products of mines, forests and quarries of the state of Missouri when they are found in marketable quantities in the state, and all such materials shall be of the best quality and suitable character that can be obtained at reasonable market prices, all as provided for in Section 8.280, Missouri Revised Statutes and Cumulative Supplements.
- B. Furthermore, pursuant to Section 34.076 Missouri Revised Statutes and Cumulative Supplements, a preference shall be given to those persons doing business as Missouri firms, corporations, or individuals, or which maintain Missouri offices or places of business, when the quality of performance promised is equal or better and the price quoted is the same or less. In addition, in order for a non-domiciliary bidder to be successful, his bid must be that same percentage lower than a domiciliary Missouri bidder's bid, as would be

required for a Missouri bidder to successfully bid in the non-domiciliary state.

- C. In accordance with the Missouri Domestic Products Procurement Act Section 34.350 RSMo and Cumulative Supplements any manufactured goods or commodities used or supplied in the performance of this contract or any subcontract thereto shall be manufactured, assembled or produced in the United States, unless the specified products are not manufactured, assembled or produced in the United States in sufficient quantities to meet the agency's requirements or cannot be manufactured, assembled or produced in the United States within the necessary time in sufficient quantities to meet the contract requirements, or if obtaining the specified products manufactured, assembled or produced in the United States would increase the cost of this contract for purchase of the product by more than ten percent.

#### **ARTICLE 1.8 - COMMUNICATIONS**

- A. All notices, requests, instructions, approvals and claims must be in writing and shall be delivered to the Designer and copied to the Construction Representative for the project except as required by Article 1.12 Disputes and Disagreements, or as otherwise specified by the Owner in writing as stated in Section 012600. Any such notice shall be deemed to have been given as of the time of actual receipt.
- B. The Contractor shall attend on-site progress and coordination meetings, as scheduled by the Construction Representative, no less than once a month.
- C. The Contractor shall ensure that major subcontractors and suppliers shall attend monthly progress meetings as necessary to coordinate the work, and as specifically requested by the Construction Representative.

#### **ARTICLE 1.9 - SEPARATE CONTRACTS AND COOPERATION**

- A. The Owner reserves the right to let other contracts in connection with this work. The Contractor shall afford other contractors reasonable opportunity for the introduction and storage of their materials and the execution of their work and shall properly connect and coordinate his work with theirs.
- B. The Contractor shall consult the drawings for all other contractors in connection with this work. Any work conflicting with the above shall be brought to the attention of the Owner's Representative before the work is performed. If the Contractor fails to do this, and constructs any

work which interferes with the work of another contractor, the Contractor shall remove any part so conflicting and rebuild same, as directed by the Owner's Representative at no additional cost to the Owner.

- C. Each contractor shall be required to coordinate his work with other contractors so as to afford others reasonable opportunity for execution of their work. No contractor shall delay any other contractor by neglecting to perform contract work at the proper time. If any contractor causes delay to another, they shall be liable directly to that contractor for such delay in addition to any liquidated damages which might be due the Owner.
- D. Should the Contractor or project associated subcontractors refuse to cooperate with the instructions and reasonable requests of other Contractors or other subcontractors in the overall coordinating of the work, the Owner may take such appropriate action and issue directions, as required, to avoid unnecessary and unwarranted delays.
- E. Each Contractor shall be responsible for damage done to Owner's or other Contractor's property by him/her or workers in his employ through their fault or negligence.
- F. Should a Contractor sustain any damage through any act or omission of any other Contractor having a contract with the Owner, the Contractor so damaged shall have no claim or cause of action against the Owner for such damage, but shall have a claim or cause of action against the other Contractor to recover any and all damages sustained by reason of the acts or omissions of such Contractor. The phrase "acts or omissions" as used in this section shall be defined to include, but not be limited to, any unreasonable delay on the part of any such contractors.

#### **ARTICLE 1.10 - ASSIGNMENT OF CONTRACT**

- A. No assignment by Contractor of any amount or any part of this contract or of the funds to be received there under will be recognized unless such assignment has had the written approval of the Director and the surety has been given due notice of such assignment and has furnished written consent thereto. In addition to the usual recitals in assignment contracts, the following language must be set forth: "It is agreed that the funds to be paid to the assignee under this assignment are subject to performance by the Contractor of this contract and to claims or liens for services rendered or materials supplied for the performance of the work called for in said contract in favor of all persons, firms or corporations rendering such services or supplying such materials."

#### **ARTICLE 1.11 - INDEMNIFICATION**

- A. Contractor agrees to indemnify and save harmless Owner and its respective commissioners, officers, officials, agents, consultants and employees and Designer, their agents, servants and employees, from and against any and all liability for damage arising from injuries to persons or damage to property occasioned by any acts or omissions of Contractor, any subcontractors, agents, servants or employees, including any and all expense, legal or otherwise, which may be incurred by Owner or Designer, its agents, servants or employees, in defense of any claim, action or suit.
- B. The obligations of the Contractor under this paragraph shall not extend to the liability of the Designer, his agents or employees, arising out of (1) the preparation or approval of maps, drawings, opinions, reports, surveys, contract changes, design or specifications, or (2) giving of or the failure to give directions or instructions by the Designer, his agents or employees as required by this contract documents provided such giving or failure to give is the primary cause of the injury or damage.

#### **ARTICLE 1.12 - DISPUTES AND DISAGREEMENTS**

It is hereby expressly agreed and understood that in case any controversy or difference of opinion arises during construction, best efforts will be given to resolution at the field level. Should those efforts be unsuccessful, the Contractor has the right to appeal in writing, the decision of the Director's Designee to the Director at Room 730 Truman Building, P.O. Box 809, Jefferson City, Missouri 65102. The decision of the Director shall be final and binding on all parties.

#### **ARTICLE 2 -- OWNER/DESIGNER RESPONSIBILITIES**

- A. The Owner shall give all orders and directions contemplated under this contract relative to the execution of the work. During progress of work the Owner will be represented at the project site by the Construction Representative and/or Designer, whose responsibilities are to see that this contract is properly fulfilled.
- B. The Owner shall at all times have access to the work whenever it is in preparation or progress. The Contractors shall provide proper facilities for such access and for inspection and supervision.
- C. All materials and workmanship used in the work shall be subject to the inspection of the Designer and Construction Representative, and any work which is deemed defective shall be removed, rebuilt or made good immediately upon notice.

The cost of such correction shall be borne by the Contractor. Contractor shall not be entitled to an extension of the contract completion date in order to remedy defective work. All rejected materials shall be immediately removed from the site of the work.

- D. If the Contractor fails to proceed at once with the correction of rejected defective materials or workmanship, the Owner may, by separate contract or otherwise, have the defects remedied or rejected. Materials removed from the site and charge the cost of the same against any monies which may be due the Contractor, without prejudice to any other rights or remedies of the Owner.
- E. Failure or neglect on the part of Owner to observe faulty work, or work done which is not in accordance with the drawings and specifications shall not relieve the Contractor from responsibility for correcting such work without additional compensation.
- F. The Owner shall have the right to direct the Contractor to uncover any completed work.
  - 1. If the Contractor fails to adequately notify the Construction Representative and/or Designer of an inspection as required by the Contract Documents, the Contractor shall, upon written request, uncover the work. The Contractor shall bear all costs associated with uncovering and again covering the work exposed.
  - 2. If the Contractor is directed to uncover work, which was not otherwise required by the Contract Documents to be inspected, and the work is found to be defective in any respect, no compensation shall be allowed for this work. If, however, such work is found to meet the requirements of this contract, the actual cost of labor and material necessarily involved in the examination and replacement plus 10% shall be allowed the Contractor.
- G. The Designer shall give all orders and directions contemplated under this contract relative to the scope of the work and shall give the initial interpretation of the contract documents.
- H. The Owner may file a written notice to the Contractor to dismiss immediately any subcontractors, project managers, superintendents, foremen, workers, watchmen or other employees whom the Owner may deem incompetent, careless or a hindrance to proper or timely execution of the work. The Contractor shall comply with such notice as promptly as practicable without detriment to the work or its progress.

- I. If in the Owner's judgment it becomes necessary at any time to accelerate work, when ordered by the Owner in writing, the Contractor shall redirect resources to such work items and execute such portions of the work as may be required to complete the work within the current approved contract schedule.

### **ARTICLE 3 -- CONTRACTOR RESPONSIBILITIES**

The Contractor shall register and utilize the Owner's eBuilder digital project management system for submission of documents described in the following sections. This includes but is not limited to submittals as required by designer, payment applications, Request for Information (RFI), construction change orders, Request for Proposals (RFP), Designer Supplemental Instructions (DSI), etc.

#### **ARTICLE 3.1 -- ACCEPTABLE SUBSTITUTIONS**

- A. The Contractor may request use of any article, device, product, material, fixture, form or type of construction which in the judgment of the Owner and Designer is equal in all respects to that named. Standard products of manufacturers other than those specified will be accepted when, prior to the ordering or use thereof, it is proven to the satisfaction of the Owner and Designer that they are equal in design, strength, durability, usefulness and convenience for the purpose intended.
- B. Any changes required in the details and dimensions indicated on the drawings for the substitution of products other than those specified shall be properly made at the expense of the Contractor requesting the substitution or change.
- C. The Contractor shall submit a request for such substitutions in writing to the Owner and Designer within twenty (20) working days after the date of the "Notice to Proceed." Thereafter no consideration will be given to alternate forms of accomplishing the work. This Article does not preclude the Owner from exercising the provisions of Article 4 hereof.
- D. Any request for substitution by the Contractor shall be submitted in accordance with SECTION 002113 - INSTRUCTIONS TO BIDDERS.
- E. When a material has been approved, no change in brand or make will be permitted unless:
  - 1. Written verification is received from the manufacturer stating they cannot make delivery on the date previously agreed, or
  - 2. Material delivered fails to comply with contract requirements.

**ARTICLE 3.2 -- SUBMITTALS**

- A. The Contractor’s submittals must be submitted with such promptness as to allow for review and approval so as not to cause delay in the work. The Contractor shall coordinate preparation and processing of submittals with performance of construction activities.

Coordinate each submittal with fabrication, purchasing, testing, delivery, other submittals, and related activities that require sequential activity.

Submit four (4) copies to the Designer and additional copies as required for the subcontractors and material suppliers. Also provide copies to meet the requirements for maintenance manuals.

- B. All subcontractors' shop drawings and schedules shall be submitted by the Contractor and shall bear evidence that Contractor has received, reviewed, and approved them. Any shop drawings and schedules submitted without this evidence will be returned to the Contractor for resubmission.
- C. The Contractor shall include with the shop drawing, a letter indicating any and all deviations from the drawings and/or specifications. Failure to notify the Designer of such deviations will be grounds for subsequent rejection of the related work or materials. If, in the opinion of the Designer, the deviations are not acceptable, the Contractor will be required to furnish the item as specified and indicated on the drawings.
- D. The Designer shall check shop drawings and schedules with reasonable promptness and approve them only if they conform to the design concept of the project and comply with the information given in the contract documents. The approval shall not relieve the Contractor from the responsibility to comply with the drawings and specifications, unless the Contractor has called the Designer's attention to the deviation, in writing, at the time of submission and the Designer has knowingly approved thereof. An approval of any such modification will be given only under the following conditions:
  - 1. It is in the best interest of the Owner
  - 2. It does not increase the contract sum and/or completion time
  - 3. It does not deviate from the design intent
  - 4. It is without prejudice to any and all rights under the surety bond.
- E. No extension of time will be granted because of the Contractor's failure to submit shop drawings and schedules in ample time to allow for review,

possible resubmission, and approval. Fabrication of work shall not commence until the Contractor has received approval. The Contractor shall furnish prints of approved shop drawings and schedules to all subcontractors whose work is in any way related to the work under this contract. Only prints bearing this approval will be allowed on the site of construction

- F. The Contractor shall maintain a complete file on-site of approved shop drawings available for use by the Construction Representative.

**ARTICLE 3.3 – AS-BUILT DRAWINGS**

- A. The Contractor shall update a complete set of the construction drawings, shop drawings and schedules of all work monthly by marking changes, and at the completion of their work (prior to submission of request for final payment) note all changes and turn the set over to the Construction Representative. The updates shall show all addenda, all field changes that were made to adapt to field conditions, changes resulting from contract changes or supplemental instructions, and all locations of structures, buried installations of piping, conduit, and utility services. All buried and concealed items both inside and outside shall be accurately located as to depth and referenced to permanent features such as interior or exterior wall faces and dimensions shall be given in a neat and legible manner in a contrasting colored pencil or ink. If approved by the Designer, an electronic file format may be provided.

**ARTICLE 3.4 – GUARANTY AND WARRANTIES**

- A. General Guaranty
  - 1. Neither the final certificate of payment nor any provision in the contract documents nor partial use or occupancy of the premises by the Owner shall constitute an acceptance of work not done in accordance with contract requirements.
  - 2. The Contractor or surety shall remedy any defects in the work and pay for any damage to property resulting there from which shall appear within a period of one (1) year from the date of substantial completion unless a longer period is otherwise specified or a differing guaranty period has been established in the substantial completion certificate. The Owner will give notice of observed defects with reasonable promptness.
  - 3. In case of default on the part of the Contractor in fulfilling this part of this contract, the Owner may correct the work or repair the



damage and the cost and expense incurred in such event shall be paid by or recoverable from the Contractor or surety.

4. The work will be free from defects not inherent in the quality required or permitted, and that the Work will conform to the requirements of the Contract Documents. Work not conforming to these requirements, including substitutions not properly approved and authorized, may be considered defective. The Contractor's guaranty excludes remedy for damage or defect caused by abuse, modifications not executed by the Contractor, improper or insufficient maintenance, improper operation, or normal wear and tear under normal usage. If required by the Owner, the Contractor shall furnish satisfactory evidence as to the kind and quality of materials and equipment

**B. Extended Warranty**

Manufacturer's certificates of warranty shall be obtained for all major equipment. Warranty shall be obtained for at least one year. Where a longer period is offered at no additional cost or called for in the specific equipment specifications, the longer period shall govern.

**ARTICLE 3.5 -- OPERATION AND MAINTENANCE MANUALS**

- A. Immediately after equipment submittals are approved and no later than ten (10) working days prior to the substantial completion inspection, the Contractor shall provide to the Designer three (3) copies of operating instructions and service manuals, containing the following:

1. Start-up and Shut-down Procedures: Provide a step-by-step write up of all major equipment. When manufacturer's printed start-up, trouble shooting and shut-down procedures are available; they may be incorporated into the operating manual for reference.
2. Operating Instructions: Written operating instructions shall be included for the efficient and safe operation of all equipment.
3. Equipment List: List of all major equipment as installed shall be prepared to include model number, capacities, flow rate, name place data, shop drawings and air and water balance reports.
4. Service Instructions: Provide the following information for all pieces of equipment.

- a. Recommended spare parts including catalog number and name of local supplier or factory representative.
- b. Belt sizes, types, and lengths.
- c. Wiring diagrams.

5. Manufacturer's Certificate of Warranty as described in Article 3.4.

6. Prior to the final payment, furnish to the Designer three (4) copies of parts catalogs for each piece of equipment furnished by him/her on the project with the components identified by number for replacement ordering.

- B. Submission of operating instructions shall be done in the following manner.

1. Manuals shall be in quadruplicate, and all materials shall be bound into volumes of standard 8½" x 11" hard binders. Large drawings too bulky to be folded into 8½" x 11" shall be separately bound or folded and in envelopes, cross referenced and indexed with the manuals.

2. The manuals shall identify project name, project number, and include the name and address of the Contractor, subcontractors and manufacturers who were involved with the activity described in that particular manual.

3. Internally subdivide the binder contents with permanent page dividers, logically organized with tab titles clearly printed under reinforced laminated plastic tabs.

4. Contents: Prepare a Table of Contents for each volume, with each product or system description identified.

**ARTICLE 3.6 – OTHER CONTRACTOR RESPONSIBILITIES**

- A. The Contractor shall keep on site, during progress of the work, a competent superintendent satisfactory to the Construction Representative. The superintendent shall represent the Contractor and all agreements made by the superintendent shall be binding. The superintendent shall carefully study and compare all drawings, specifications and other instructions and shall promptly notify the Construction Representative and Designer, in writing, any error, inconsistency or omission which may be discovered. The superintendent shall coordinate all work on the project. Any change of the superintendent shall be approved by the Construction Representative.
- B. Contractor shall, at all times, enforce strict discipline and good order among his employees,

and shall not employ on the work any unfit person or anyone not skilled in the work assigned to him/her.

- C. The Contractor shall supply sufficient labor, material, plant and equipment and pay when due any laborer, subcontractor or supplier for supplies furnished and otherwise prosecute the work with diligence to prevent work stoppage and insure completion thereof within the time specified.
- D. The Contractor and each of his subcontractors shall submit to the Construction Representative, through the Designer such schedules of quantities and costs, progress schedules, payrolls, reports, estimates, records and other data as the Owner may request concerning work performed or to be performed under this contract.
- E. The Contractor, subcontractors, and material suppliers shall upon written request, give the Owner access to all time cards, material invoices, payrolls, estimates, profit and loss statements, and all other direct or indirect costs related to this work.
- F. The Contractor shall be responsible for laying out all contract work such as layout of architectural, structural, mechanical and electrical work, which shall be coordinated with layouts of subcontractors for general construction work. The Contractor is also responsible for unloading, uncrating and handling of all materials and equipment to be erected or placed by him/her, whether furnished by Contractor or others. No extra charges or compensation will be allowed as a result of failure to verify dimensions before ordering materials or fabricating items.
- G. The Contractor must notify the Construction Representative at least one working day before placing concrete or burying underground utilities, pipelines, etc.
- H. Contractors shall prearrange time with the Construction Representative for the interruption of any facility operation. Unless otherwise specified in these documents, all connections, alterations or relocations as well as all other portions of the work will be performed during normal working hours.
- I. The Contractor shall coordinate all work so there will not be prolonged interruptions of existing equipment operation. Any existing plumbing, heating, ventilating, air conditioning or electrical disconnections necessary for the project, which affect portions of this construction or building or any other building must be scheduled with the Construction Representative to minimize or avoid any disruption of facility operations. In no case,

unless previously approved in writing by the Construction Representative, shall utilities be left disconnected at the end of a work day or over a weekend. Any interruption of utilities either intentionally or accidentally shall not relieve the Contractor responsible for the interruption from the responsibility to repair and restore the utility to normal service. Repairs and restoration shall be made before the workers responsible for the repair and restoration leave the job.

- J. Contractors shall limit operations and storage of materials to the area within the project, except as necessary to connect to existing utilities, and shall not encroach on neighboring property. The Contractor shall be responsible for repair of their damage to property on or off the project site occurring during construction of project. All such repairs shall be made to the satisfaction of the property owner.
- K. Unless otherwise permitted, all materials shall be new and both workmanship and materials shall be of the best quality.
- L. Unless otherwise provided and stipulated within these specifications, the Contractor shall furnish, construct, and/or install and pay for materials, devices, mechanisms, equipment, all necessary personnel, utilities including, but not limited to water, heat, light and electric power, transportation services, applicable taxes of every nature, and all other facilities necessary for the proper execution and completion of the work.
- M. Contractor shall carefully examine the plans and drawings and shall be responsible for the proper fitting of his material, equipment and apparatus into the building.
- N. The Contractor or subcontractors shall not overload, or permit others to overload, any part of any structure during the performance of this contract.
- O. All temporary shoring, bracing, etc., required for the removal of existing work and/or for the installation of new work shall be included in this contract. The Contractor shall make good, at no cost to the Owner, any damage caused by improper support or failure of shoring in any respect. Each Contractor shall be responsible for shoring required to protect his work or adjacent property and improvements of Owner and shall be responsible for shoring or for giving written notice to adjacent property owners. Shoring shall be removed only after completion of permanent supports.

- P. The Contractor shall provide at the proper time such material as is required for support of the work. If openings are required, whether shown on drawings or not, the Contractor shall see that they are properly constructed.
- Q. During the performance of work the Contractor shall be responsible for providing and maintaining warning signs, lights, signal devices, barricades, guard rails, fences and other devices appropriately located on site which will give proper and understandable warning to all persons of danger of entry onto land, structure or equipment.
- R. The Contractor shall be responsible for protection, including weather protection, and proper maintenance of all equipment and materials.
- S. The Contractor shall be responsible for care of the finished work and shall protect same from damage or defacement until substantial completion by the Owner. If the work is damaged by any cause, the Contractor shall immediately begin to make repairs in accordance with the drawings and specifications. Contractor shall be liable for all damage or loss unless attributable to the acts or omissions of the Owner or Designer. Any claim for reimbursement shall be submitted in accordance with Article 4. After substantial completion the Contractor will only be responsible for damage resulting from acts or omissions of the Contractor or subcontractors through final warranty.
- T. In the event the Contractor encounters an unforeseen hazardous material, the Contractor shall immediately stop work in the area affected and report the condition to the Owner and Designer in writing. The Contractor shall not be required, pursuant to Article 4, to perform, any work relating to hazardous materials.
- U. In an emergency affecting safety of persons or property, the Contractor shall act, at the Contractor's discretion, to prevent threatened damage, injury or loss. Additional compensation or extension of time claimed by the Contractor on account of an emergency shall be determined as provided in Article 4.
- V. Before commencing work, Contractors shall confer with the Construction Representative and facility representative and review any facility rules and regulations which may affect the conduct of the work.
- W. Project signs will only be erected on major projects and only as described in the specifications. If no sign is specified, none shall be erected.

## **ARTICLE 3.7 -- SUBCONTRACTS**

- A. Subcontractor assignments as identified in the bid form shall not be changed without written approval of the Owner. The Owner will not approve changes of a listed subcontractor unless the Contractor documents, to the satisfaction of the Owner that the subcontractor cannot or will not perform the work as specified.
- B. The Contractor is fully responsible to the Owner for the acts and omissions of all subcontractors and of persons either directly or indirectly employed by them.
- C. Every subcontractor shall be bound by the applicable terms and provisions of these contract documents, but no contractual relationship shall exist between any subcontractor and the Owner unless the right of the Contractor to proceed with the work is suspended or this contract is terminated as herein provided, and the Owner in writing elects to assume the subcontract.
- D. The Contractor shall upon receipt of "Notice to Proceed" and prior to submission of the first payment request, notify the Designer and Construction Representative in writing of the names of any subcontractors to be used in addition to those identified in the bid form and all major material suppliers proposed for all parts of the work.

## **ARTICLE 4 -- CHANGES IN THE WORK**

### **4.1 CHANGES IN THE WORK**

- A. The Construction Representative, without giving notice to the surety and without invalidating this contract, may order extra work or make changes by altering, adding to or deducting from the work, this contract sum being adjusted accordingly. All such work shall be executed under the conditions of the original contract. A claim for extension of time caused by any change must be adjusted at the time of ordering such change. No future request for time will be considered.
- B. Each Contract Change shall include all costs required to perform the work including all labor, material, equipment, overheads and profit, delay, disruptions, or other miscellaneous expenses. No subsequent requests for additional compensation including claims for delay, disruption, or reduced efficiency as a result of each change will be considered. Values from the Schedule of Values will not be binding as a basis for additions to or deductions from the contract price.
- C. The amount of any adjustment in this contract price for authorized changes shall be agreed upon

before such changes become effective and shall be determined, through submission of a request for proposal, as follows:

1. By an acceptable fixed price proposal from the Contractor. Breakdowns shall include all takeoff sheets of each Contractor and subcontractor. Breakdown shall include a listing of each item of material with unit prices and number of hours of labor for each task. Labor costs per hour shall be included with labor burden identified, which shall be not less than the prevailing wage rate, etc. Overhead and profit shall be shown separately for each subcontractor and the Contractor.
2. By a cost-plus-fixed-fee (time and material) basis with maximum price, total cost not to exceed said maximum. Breakdown shall include a listing of each item of material with unit prices and number of hours of labor for each task. Labor costs per hour shall be included with labor burden identified, which shall be not less than the prevailing wage rate, etc. Overhead and profit shall be shown separately for each subcontractor and the Contractor.
3. By unit prices contained in Contractor's original bid form and incorporated in the construction contract.

D. Overhead and Profit on Contract Changes shall be applied as follows:

1. The overhead and profit charge by the Contractor and all subcontractors shall be considered to include, but is not limited to: incidental job burdens, small truck (under 1 ton) expense, mileage, small hand tools, warranty costs, company benefits and general office overhead. Project supervision including field supervision and job site office expense shall be considered a part of overhead and profit unless a compensable time extension is granted.
2. The percentages for overhead and profit charged on Contract Changes shall be subject to the following limits: (a) the percentage mark-up for the Contractor shall be limited to the Contractor's fee; (b) fifteen percent (15%) maximum for Work directly performed by employees of a subcontractor, or sub-subcontractor; (c) five percent (5%) maximum for the Work performed or passed through to the Owner by the Contractor; (d) five percent (5%) maximum subcontractor's mark-up for Work performed by a sub-subcontractor and

passed through to the Owner by the subcontractor and Contractor; and (e) in no case shall the total overhead and profit paid by the Owner on any Contract Changes exceed twenty-five percent (25%) of the cost of materials, labor and equipment (exclusive of Contractor or any Subcontractor overhead and profit) necessary to put the contract change work in place.

3. The Contractor will be allowed to add the cost of Contractor's payment and performance bonding, builder's risk insurance, and general liability insurance to their cost of work. The above listed bonding and insurance cost shall not exceed 2% and shall be allowed on the total cost of the added work, including overhead and profit.
  4. On proposals covering both increases and decreases in the amount of this contract, the application of overhead and profit shall be on the net change in the cost of the work.
  5. The percentage(s) for overhead and profit to be credited to the Owner on Contract Changes that are solely decreases in the quantity of work or materials shall be the same as those for additive Contract Changes provided above.
- E. No claim for an addition to this contract sum shall be valid unless authorized as aforesaid in writing by the Owner. In the event that none of the foregoing methods are agreed upon, the Owner may order the Contractor to perform work on a time and material basis. The cost of such work shall be determined by the Contractor's actual labor and material cost to perform the work plus overhead and profit as outlined herein. The Designer and Construction Representative shall approve the Contractor's daily time and material invoices for the work involved.
- F. If the Contractor claims that any instructions involve extra cost under this contract, the Contractor shall give the Owner's Representative written notice thereof within a reasonable time after the receipt of such instructions, and in any event before proceeding to execute the work. No such claim shall be valid unless so made and authorized by the Owner, in writing.
- G. In an emergency affecting the safety of life or of the structure or of adjoining property, the Contractor, without special instruction or authorization from the Construction Representative, is hereby permitted to act at their discretion to prevent such threatened loss or injury. The Contractor shall submit a claim for

compensation for such emergency work in writing to the Owner's Representative.

#### **ARTICLE 4.2 – CHANGES IN COMPLETION TIME**

- A. Extension of the number of work days stipulated in the Contract for completion of the work with compensation may be made when:
  - 1. The contractor documents that proposed Changes in the work, as provided in Article 4.1, extends construction activities critical to contract completion date, OR
  - 2. The Owner suspends all work for convenience of the Owner as provided in Article 7.3, OR
  - 3. An Owner caused delay extends construction activities critical to contract completion (except as provided elsewhere in these General Conditions). The Contractor is to review the work activities yet to begin and evaluate the possibility of rescheduling the work to minimize the overall project delay.
- B. Extension of the number of work days stipulated in the Contract for completion of the work without compensation may be made when:
  - 1. Weather-related delays occur, subject to provisions for the inclusion of a specified number of "bad weather" days when provided for in Section 012100-Allowances, OR
  - 2. Labor strikes or acts of God occur, OR
  - 3. The work of the Contractor is delayed on account of conditions which were beyond the control of the Contractor, subcontractors or suppliers, and were not the result of their fault or negligence.
- C. No time extension or compensation will be provided for delays caused by or within the control of the Contractor, subcontractors or suppliers and for concurrent delays caused by the Owner.
- D. The Contractor shall notify the Owner promptly of any occurrence or conditions which in the Contractor's opinion results in a need for an extension of time. The notice shall be in writing and shall include all necessary supporting materials with details of any resultant costs and be submitted in time to permit full investigation and evaluation of the Contractor's claim. The Owner shall promptly acknowledge the Contractor's notice and, after recommendation from the Owner's Representative and/or Designer, shall provide a decision to the Contractor. Failure on the part of the Contractor to provide such notice and to detail the costs shall constitute a waiver by

the Contractor of any claim. Requests for extensions of time shall be for working days only.

#### **ARTICLE 5 - CONSTRUCTION AND COMPLETION**

##### **ARTICLE 5.1 – CONSTRUCTION COMMENCEMENT**

- A. Upon receipt of the "Intent to Award" letter, the Contractor must submit the following properly executed instruments to the Owner:
    - 1. Contract;
    - 2. Performance/payment bond as described in Article 6.1;
    - 3. Certificates of Insurance, or the actual policies themselves, showing that the Contractor has obtained the insurance coverage required by Article 6.2.
    - 4. Written Affirmative Action Plans as required in Article 1.4.
- Above referenced items must be received by the Owner within ten (10) working days after the effective date of the contract. If not received, the Owner may treat the failure to timely submit them as a refusal by the Contractor to accept a contract for this work and may retain as liquidated damages the Contractor's bid bond, cashier's check or certified check as provided in the Instructions to Bidders. Upon receipt the Owner will issue a "Notice to Proceed" with the work to the Contractor.
- B. Within the time frame noted in Section 013200 - Schedules, following receipt of the "Notice to Proceed", the Contractor shall submit to the Owner a progress schedule and schedule of values, showing activities through the end of the contract period. Should the Contractor not receive written notification from the Owner of the disapproval of the schedule of values within fifteen (15) working days, the Contractor may consider it approved for purpose of determining when the first monthly Application and Certification for Payment may be submitted.
  - C. The Contractor may commence work upon receipt of the Division of Facilities Management, Design and Construction's "Notice to Proceed" letter. Contractor shall prosecute the work with faithfulness and energy, and shall complete the entire work on or before the completion time stated in the contract documents or pay to the Owner the damages resulting from the failure to timely complete the work as set out within Article 5.4.

## ARTICLE 5.2 -- PROJECT CONSTRUCTION

- A. Each Contractor shall submit for the Owner's approval, in reproducible form, a progress schedule showing the rate of progress and the order of the work proposed to carry on various phases of the project. The schedule shall be in conformance with the requirements outlined in Section 013200 – Schedules.
- B. Contractor shall employ and supply a sufficient force of workers, material, and equipment and shall pay when due, any worker, subcontractor or supplier and otherwise prosecute the work with such diligence so as to maintain the rate of progress indicated on the progress schedule, prevent work stoppage, and insure completion of the project within the time specified.

## ARTICLE 5.3 -- PROJECT COMPLETION

- A. Substantial Completion. A Project is substantially complete when construction is essentially complete and work items remaining to be completed can be done without interfering with the Owner's ability to use the Project for its intended purpose.
  1. Once the Contractor has reached what they believe is Substantial Completion, the Contractor shall notify the Designer and the Construction Representative of the following:
    - a. That work is essentially complete with the exception of certain listed work items. The list shall be referred to as the "Contractor's Punch."
    - b. That all Operation and Maintenance Manuals have been assembled and submitted in accordance with Article 3.5A.
    - c. That the Work is ready for inspection by the Designer and Construction Representative. The Owner shall be entitled to a minimum of ten working days notice before the inspection shall be performed.
  2. If the work is acceptable, the Owner shall issue a Certificate of Substantial Completion, which shall set forth the responsibilities of the Owner and the Contractor for utilities, security, maintenance, damage to the work and risk of loss. The Certificate shall also identify those remaining items of work to be performed by the Contractor. All such work items shall be complete within 30 working days of the date of the Certificate, unless the Certificate specifies a different time. If the

Contractor shall be required to perform tests that must be delayed due to climatic conditions, it is understood that such tests and affected equipment will be identified on the Certificate and shall be accomplished by the Contractor at the earliest possible date. Performance of the tests may not be required before Substantial Completion can be issued. The date of the issuance of the Certificate of Substantial Completion shall determine whether or not the work was completed within the contract time and whether or not Liquidated Damages are due.

3. If the work is not acceptable, and the Owner does not issue a Certificate of Substantial Completion, the Owner shall be entitled to charge the Contractor with the Designer's and Owner's costs of re-inspection, including time and travel.
- B. Partial Occupancy. Contractor agrees that the Owner shall be permitted to occupy and use any completed or partially completed portions of the Project, when such occupancy and use is in the Owner's best interest. Owner shall notify Contractor of its desire and intention to take Partial Occupancy as soon as possible but at least ten (10) working days before the Owner intends to occupy. If the Contractor believes that the portion of the work the Owner intends to occupy is not ready for occupancy, the Contractor shall notify the Owner immediately. The Designer shall inspect the work in accordance with the procedures above. If the Contractor claims increased cost of the project or delay in completion as a result of the occupancy, he shall notify the Owner immediately but in all cases before occupancy occurs.
- C. Final Completion. The Project is finally complete when the Certificate of Substantial Completion has been issued and all work items identified therein as incomplete have been completed, and when all administrative items required by the contract have been completed. Final Completion entitles the Contractor to payment of the outstanding balance of the contract amount including all change orders and retainage. Within five (5) working days of the date of the Certificate of Substantial Completion, the Contractor shall identify the cost to complete any outstanding items of work. The Designer shall review the Contractor's estimate and either approve it or provide an independent estimate for all such items. If the Contractor fails to complete the remaining items within the time specified in the Certificate, the Owner may terminate the contract and go to the surety for project completion in accordance with Article 7.2 or release the contract balance to the Contractor less 150% of the

approved estimate to complete the outstanding items. Upon completion of the outstanding items, when a final cost has been established, any monies remaining shall be paid to the Contractor. Failure to complete items of work does not relieve the Contractor from the obligation to complete the administrative requirements of the contract, such as the provisions of Article 5.3 FAILURE TO COMPLETE ALL ITEMS OF WORK UNDER THE CONTRACT SHALL BE CONSIDERED A DEFAULT AND BE GROUNDS FOR CONTRACT TERMINATION AND DEBARMENT.

- D. Liquidated Damages. Contractor agrees that the Owner may deduct from the contract price and retain as liquidated damages, and not as penalty or forfeiture, the sum stipulated in this contract for each work day after the Contract Completion Day on which work is not Substantially Complete. Assessment of Liquidated Damages shall not relieve the Contractor or the surety of any responsibility or obligation under the Contract. In addition, the Owner may, without prejudice to any other rights, claims, or remedies the Owner may have including the right to Liquidated Damages, charge the Contractor for all additional expenses incurred by the Owner and/or Designer as the result of the extended contract period through Final Completion. Additional Expenses shall include but not be limited to the costs of additional inspections.
- E. Early Completion. The Contractor has the right to finish the work before the contract completion date; however, the Owner assumes no liability for any hindrances to the Contractor unless Owner caused delays result in a time extension to the contract completion date. The Contractor shall not be entitled to any claims for lost efficiencies or for delay if a Certificate of Substantial Completion is given on or before the Contract Completion Date.

#### **ARTICLE 5.4 -- PAYMENT TO CONTRACTOR**

- A. Payments on account of this contract will be made monthly in proportion to the work which has been completed. Request for payment must be submitted on the Owner's forms. No other pay request will be processed. Supporting breakdowns must be in the same format as Owner's forms and must provide the same level of detail. The Designer will, within 5 working days from receipt of the contractor's request for payment either issue a Certificate for Payment to the Owner, for such amount as the Designer determines is properly due, or notify the Contractor in writing of reasons for withholding a Certificate. The Owner shall make payment within 30 calendar days after the

"Application and Certification for Payment" has been received and certified by the Designer. The following items are to be attached to the contractor's pay request:

1. Updated construction schedule
  2. Certified payrolls consisting of name, occupation and craft, number of hours worked and actual wages paid for each individual employee, of the Contractor and all subcontractors working on the project
- B. The Owner shall retain 5 percent of the amount of each such payment application, except as allowed by Article 5.4, until final completion and acceptance of all work covered by this contract.
- C. Each payment made to Contractor shall be on account of the total amount payable to Contractor and all material and work covered by paid partial payment shall thereupon become the sole property of Owner. This provision shall not be construed as relieving Contractor from sole responsibility for care and protection of materials and work upon which payments have been made or restoration of any damaged work or as a waiver of the right of Owner to require fulfillment of all terms of this contract.
- D. Materials delivered to the work site and not incorporated in the work will be allowed in the Application and Certification for Payment on the basis of one hundred (100%) percent of value, subject to the 5% retainage providing that they are suitably stored on the site or in an approved warehouse in accordance with the following requirements:
1. Material has previously been approved through submittal and acceptance of shop drawings conforming to requirements of Article 3.2 of General Conditions.
  2. Delivery is made in accordance with the time frame on the approved schedule.
  3. Materials, equipment, etc., are properly stored and protected from damage and deterioration and remain so - if not, previously approved amounts will be deleted from subsequent pay applications.
  4. The payment request is accompanied by a breakdown identifying the material equipment, etc. in sufficient detail to establish quantity and value.
- E. The Contractor shall be allowed to include in the Application and Certification for Payment, one hundred (100%) of the value, subject to retainage,

of major equipment and material stored off the site if all of the following conditions are met:

1. The request for consideration of payment for materials stored off site is made at least 15 working days prior to submittal of the Application for Payment including such material. Only materials inspected will be considered for inclusion on Application for Payment requests.
  2. Materials stored in one location off site are valued in excess of \$25,000.
  3. That a Certificate of Insurance is provided indicating adequate protection from loss, theft conversion or damage for materials stored off site. This Certificate shall show the State of Missouri as an additional insured for this loss.
  4. The materials are stored in a facility approved and inspected, by the Construction Representative.
  5. Contractor shall be responsible for, Owner costs to inspect out of state facilities, and any delays in the completion of the work caused by damage to the material or for any other failure of the Contractor to have access to this material for the execution of the work.
- F. The Owner shall determine the amount, quality and acceptability of the work and materials which are to be paid for under this contract. In the event any questions shall arise between the parties, relative to this contract or specifications, determination or decision of the Owner or the Construction Representative and the Designer shall be a condition precedent to the right of the Contractor to receive any money or payment for work under this contract affected in any manner or to any extent by such question.
- G. Payments Withheld: The Owner may withhold or nullify in whole or part any certificate to such extent as may be necessary to protect the Owner from loss on account of:
1. Defective work not remedied. When a notice of noncompliance is issued on an item or items, corrective action shall be undertaken immediately. Until corrective action is completed, no monies will be paid and no additional time will be allowed for the item or items. The cost of corrective action(s) shall be borne by the Contractor.
  2. A reasonable doubt that this contract can be completed for the unpaid balance.

3. Failure of the Contractor to update as-built drawings monthly for review by the Construction Representative.
4. Failure of the Contractor to update the construction schedule.

When the Construction Representative is satisfied the Contractor has remedied above deficiencies, payment shall be released.

- H. Final Payment: Upon receipt of written notice from the Contractor to the Designer and Project Representative that the work is ready for final inspection and acceptance, the Designer and Project Representative, with the Contractor, shall promptly make such inspection. If the work is acceptable and the contract fully performed, the Construction Representative shall complete a final acceptance report and the Contractor will be directed to submit a final Application and Certification for Payment. If the Owner approves the same, the entire balance shall be due and payable, with the exception of deductions as provided for under Article 5.4.
1. Where the specifications provide for the performance by the Contractor of (certain tests for the purpose of balancing and checking the air conditioning and heating equipment and the Contractor shall have furnished and installed all such equipment in accordance with the specifications, but said test cannot then be made because of climatic conditions, such test shall may be considered as required under the provisions of the specifications, Section 013300 and this contract may be substantial Full payment will not be made until the tests have been made and the equipment and system is finally accepted. If the tests are not completed when scheduled, the Owner may deduct 150% of the value of the tests from the final payment.
  2. The final payment shall not become due until the Contractor delivers to the Construction Representative:
    - a) A complete file of releases, on the standard form included in the contract documents as "Final Receipt of Payment and Release Form", from subcontractors and material suppliers evidencing payment in full for services, equipment and materials, as the case may require, if the Owner approves, or a consent from the Surety to final payment accepting liability for any unpaid amounts.



- b) An Affidavit of Compliance with Prevailing Wage Law, in the form as included in this contract specifications, properly executed by each subcontractor, and the Contractor
  - c) Certified copies of all payrolls
  - d) As-built drawings
3. If any claim remains unsatisfied after all payments are made, the Contractor shall refund to the Owner all monies that the latter may be compelled to pay in discharging such a claim including all costs and a reasonable attorney's fee.
  4. Missouri statute requires prompt payment from the Owner to the Contractor within thirty calendar days and from the Contractor to his subcontractors within fifteen calendar days. Failure to make payments within the required time frame entitles the receiving party to charge interest at the rate of one and one half percent per month calculated from the expiration of the statutory time period until paid.
  5. The value of all unused unit price allowances and/or 150% of the value of the outstanding work items, and/or liquidated damages may be deducted from the final pay request without executing a Contract Change. Any unit price items which exceed the number of units in the contract may be added by Contract Change.

**ARTICLE 6 -- INSURANCE AND BONDS**

**ARTICLE 6.1 -- BOND**

- A. Contractor shall furnish a performance/payment bond in an amount equal to 100% of the contract price to guarantee faithful performance of the contract and 100% of the contract price to guarantee the payment of all persons performing labor on the project and furnishing materials in connection therewith under this contract as set forth in the standard form of performance and payment bond included in the contract documents. The surety on such bond shall be issued by a surety company authorized by the Missouri Department of Insurance to do business in the state of Missouri.
- B. All Performance/Payment Bonds furnished in response to this provision shall be provided by a bonding company with a rating of B+ or higher as established by A.M. Best Company, Inc. in their most recent publication.

**ARTICLE 6.2 – INSURANCE**

- A. The successful Contractor shall procure and maintain for the duration of the contract issued a policy or policies of insurance for the protection of both the Contractor and the Owner and their respective officers, officials, agents, consultants and employees. The Owner requires certification of insurance coverage from the Contractor prior to commencing work.
- B. Minimum Scope and Extent of Coverage
  1. General Liability
 

Commercial General Liability, ISO coverage form number or equivalent CG 00 01 ("occurrence" basis), or I-SO coverage form number CG 00 02, or ISO equivalent.

If ISO equivalent or manuscript general liability coverage forms are used, minimum coverage will be as follows: Premises/Operations; Independent Contractors; Products/Completed Operations; personal Injury; Broad Form Property Damage including Completed Operations; Broad Form Contractual Liability Coverage to include Contractor's obligations under Article 1.11 Indemnification and any other Special Hazards required by the work of the contract.
  2. Automobile Liability
 

Business Automobile Liability Insurance, ISO Coverage form number or equivalent CA 00 01 covering automobile liability, code 1 "ANY AUTO".
  3. Workers' Compensation and Employer's Liability
 

Statutory Workers' Compensation Insurance for Missouri and standard Employer's Liability Insurance, or the authorization to self-insure for such liability from the Missouri Division of Workers' Compensation.
  4. Builder's Risk or Installation Floater Insurance
 

Insurance upon the work and all materials, equipment, supplies, temporary structures and similar items which may be incident to the performance of the work and located at or adjacent to the site, against loss or damage from fire and such other casualties as are included in extended coverage in broad "All Risk" form, including coverage for Flood and Earthquake, in an amount not less than the replacement cost of the work or this contract price, whichever is greater, with loss payable

to Contractor and Owner as their respective interests may appear.

Contractor shall maintain sufficient insurance to cover the full value of the work and materials as the work progresses, and shall furnish Owner copies of all endorsements. If Builder's Risk Reporting- Form of Endorsement is used, Contractor shall make all reports as required therein so as to keep in force an amount of insurance which will equal the replacement cost of the work, materials, equipment, supplies, temporary structures, and other property covered thereby; and if, as a result of Contractor's failure to make any such report, the amount of insurance so recoverable shall be less than such replacement cost, Contractor's interest in the proceeds of such insurance, if any, shall be subordinated to Owner's interest to the end that Owner may receive full reimbursement for its loss.

C. Minimum Limits of Insurance

1. General Liability

Contractor

\$2,000,000 combined single limit per occurrence for bodily injury, personal injury, and property damage

\$2,000,000 annual aggregate

2. Automobile Liability

\$2,000,000 combined single limit per occurrence for bodily injury and property damage

3. Workers' Compensation and Employers Liability

Workers' Compensation limits as required by applicable State Statutes (generally unlimited) and minimum of \$1,000,000 limit per accident for Employer's Liability.

General Liability and Automobile Liability insurance may be arranged under individual policies for the full limits required or by a combination of underlying policies with the balance provided by a form-following Excess or Umbrella Liability policy.

D. Deductibles and Self-Insured Retentions

All deductibles, co-payment clauses, and self-insured retentions must be declared to and approved by the Owner. The Owner reserves the right to request the reduction or elimination of unacceptable deductibles or self-insured retentions,

as they would apply to the Owner, and their respective officers, officials, agents, consultants and employees. Alternatively, the Owner may request Contractor to procure a bond guaranteeing payment of losses and related investigations, claims administration, and defense expenses.

E. Other Insurance Provisions and Requirements

The respective insurance policies and coverage, as specified below, must contain, or be endorsed to contain the following conditions or provisions:

1. General Liability

The Owner, and its respective commissioners, officers, officials, agents, consultants and employees shall be endorsed as additional insured's by ISO form CG 20 26 Additional Insured - Designated Person or Organization. As additional insured's, they shall be covered as to work performed by or on behalf of the Contractor or as to liability which arises out of Contractor's activities or resulting from the performance of services or the delivery of goods called for by the Contract.

Contractor's insurance coverage shall be primary with respect to all additional insured's. Insurance of self-insurance programs maintained by the designated additional -insured's shall be excess of the Contractor's insurance and shall not contribute with it.

Additionally, the Contractor and Contractor's general liability insurer shall agree to waive all rights of subrogation against the Owner and any of their respective officers, officials, agents, consultants or employees for claims, losses, or expenses which arise out of Contractor's activities or result from the performance of services or the delivery of goods called for by the Contract.

Contractor's failure to comply with the terms and conditions of these insurance policies shall not affect or abridge coverage for the Owner, or for any of their officers, officials, agents, consultants or employees.

2. Automobile Insurance

The Owner, and their respective officers, officials, agents, consultants and employees shall be endorsed as additional insured's by ISO form CG 20 26 - Additional Insured Designated Person or Organization. As additional insured's, they shall be covered as to work performed by or on behalf of the Contractor or as to liability which arises out of Contractor's activities or resulting from the

performance of services or the delivery of goods called for by the Contract.

Contractor's insurance coverage shall be primary with respect to all additional insured's. Insurance or self-insurance programs maintained by the designated additional insured's shall be in excess of the Contractor's insurance and shall not contribute with it.

Additionally, the Contractor and Contractor's automobile insurer shall agree to waive all rights of subrogation against the Owner and any of their respective officers, officials, agents, consultants or employees for claims, losses, or expenses which arise out of Contractor's activities or result from the performance of services or the delivery of goods called for by the Contract.

Contractor's failure to comply with the terms and conditions of these insurance policies shall not affect or abridge coverage for the Owner or for any of its officers, officials, agents, consultants or employees.

3. Workers' Compensation/Employer's Liability

Contractor's workers' compensation insurance shall be endorsed with NCCI form WC 00 03 01 A - Alternative Employer Endorsement. The Alternative Employer Endorsement shall designate the Owner as "alternate employers."

4. All Coverages

Each insurance policy required by this section of the Contract shall contain a stipulation, endorsed if necessary, that the Owner will receive a minimum of a thirty (30) calendar day advance notice of any policy cancellation. Ten (10) calendar days advance notice is required for policy cancellation due to non-payment of premium.

F. Insurer Qualifications and Acceptability

Insurance required hereunder shall be issued by an A.M. Best, "B+" rated, Class IX insurance company approved to conduct insurance business in the state of Missouri.

G. Verification of Insurance Coverage

Prior to Owner issuing a Notice to Proceed, the Contractor shall furnish the Owner with Certificate(s) of Insurance and with any applicable original endorsements evidencing the required insurance coverage. The insurance certificates and endorsements are to be signed by a person authorized by that insurer to bind coverage on its

behalf. All certificates and endorsements received by the Owner are subject to review and approval by the Owner. The Owner reserves the right to require certified copies of all required policies at any time. If the scope of this contract will exceed one (1) year - or, if any of Contractor's applicable insurance coverage expires prior to completion of the work or services required under this contract - the Contractor will provide a renewal or replacement certificate before continuing work or services hereunder. If the Contractor fails to provide documentation of required insurance coverage, the Owner may issue a stop work order and no additional contract completion time and/or compensation shall be granted as a result thereof.

**ARTICLE 7 – SUSPENSION OR TERMINATION OF CONTRACT**

**ARTICLE 7.1 - FOR SITE CONDITIONS**

When conditions at the site of the proposed work are considered by the Owner to be unsatisfactory for prosecution of the work, the Contractor may be ordered in writing to suspend the work or any part thereof until reasonable conditions exist. When such suspension is not due to fault or negligence of the Contractor, time allowed for completion of such suspended work will be extended by a period of time equal to that lost due to delay occasioned by ordered suspension. This will be a no cost time extension.

**ARTICLE 7.2 - FOR CAUSE**

A. Termination or Suspension for Cause:

1. If the Contractor shall file for bankruptcy, or should make a general assignment for the benefit of the creditors, or if a receiver should be appointed on account of insolvency, or if the contractor should persistently or repeatedly refuse or fail to supply enough properly skilled workers or proper materials, or if the contractor should fail to make prompt payment to subcontractors or for material or labor, or persistently disregard laws, ordinances or the instructions of the Owner, or otherwise be guilty of a substantial violation of any provision of this contract, then the Owner may serve notice on the Contractor and the surety setting forth the violations and demanding compliance with this contract. Unless within ten (10) consecutive calendar days after serving such notice, such violations shall cease and satisfactory arrangements for correction be made, the Owner may suspend the Contractor's right to proceed with the work or terminate this contract.

2. In the event the Owner suspends Contractor's right to proceed with the work or terminates the contract, the Owner may demand that the Contractor's surety take over and complete the work on this contract, after the surety submits a written proposal to the Owner and receives written approval and upon the surety's failure or refusal to do so within ten (10) consecutive calendar days after demand therefore, the Owner may take over the work and prosecute the same to completion by bid or negotiated contract, or the Owner may elect to take possession of and utilize in completing the work such materials, supplies, appliances and plant as may be on the site of the work, and all subcontractors, if the Owner elects, shall be bound to perform their contracts.
- B. The Contractor and its surety shall be and remain liable to the Owner for any excess cost or damages occasioned to the Owner as a result of the actions above set forth.
- C. The Contractor in the event of such suspension or termination shall not be entitled to receive any further payments under this contract until the work is wholly finished. Then if the unpaid balance under this contract shall exceed all expenses of the Owner as certified by the Director, such excess shall be paid to the Contractor; but, if such expenses shall exceed the unpaid balance as certified by the Director, the Contractor and their surety shall be liable for and shall pay the difference and any damages to the Owner.
- D. In exercising Owner's right to secure completion of the work under any of the provisions hereof, the Director shall have the right to exercise Owner's sole discretion as to the manner, methods and reasonableness of costs of completing the work.
- E. The rights of the Owner to suspend or terminate as herein provided shall be cumulative and not exclusive and shall be in addition to any other remedy provided by law.
- F. The Contractor in the event of such suspension or termination may be declared ineligible for Owner contracts for a minimal period of twelve (12) months. Further, no contract will be awarded to any Contractor who lists in their bid form any subcontractor whose prior performance has contributed, as determined by the Owner, to a breach of a contract. In order to be considered for state-awarded contracts after this period, the Contractor/subcontractor will be required to forward acceptance reports to the Owner regarding successful completion of non-state projects during the intervening twelve (12) months from the date

of default. No contracts will be awarded to a subcontractor/Contractor until the ability to perform responsibly in the private sector has been proven to the Owner.

#### **ARTICLE 7.3 -- FOR CONVENIENCE**

- A. The Owner may terminate or suspend the Contract or any portion of the Work without cause at any time, and at the Owner's convenience. Notification of a termination or suspension shall be in writing and shall be given to the Contractor and their surety. If the Contract is suspended, the notice will contain the anticipated duration of the suspension or the conditions under which work will be permitted to resume. If appropriate, the Contractor will be requested to demobilize and re-mobilize and will be reimbursed time and costs associated with the suspension.
- B. Upon receipt of notification, the Contractor shall:
  1. Cease operations when directed.
  2. Take actions to protect the work and any stored materials.
  3. Place no further subcontracts or orders for material, supplies, services or facilities except as may be necessary to complete the portion of the Contract that has not been terminated. No claim for payment of materials or supplies ordered after the termination date shall be considered.
  4. Terminate all existing subcontracts, rentals, material, and equipment orders.
  5. Settle all outstanding liabilities arising from termination with subcontractors and suppliers.
  6. Transfer title and deliver to the Owner, work in progress, completed work, supplies and other material produced or acquire for the work terminated, and completed or partially completed plans, drawings information and other property that, if the Contract had been completed, would be required to be furnished to the Owner.
- C. For termination without cause and at the Owner's convenience, in addition to payment for work completed prior to date of termination, the Contractor may be entitled to payment of other documented costs directly associated with the early termination of the contract. Payment for anticipated profit and unapplied overhead will not be allowed.

## SECTION 007300 - SUPPLEMENTARY CONDITIONS

### 1.0 GENERAL:

- A. These Supplementary General Conditions clarify, add, delete, or otherwise modify standard terms and conditions of DIVISION 0, BIDDING AND CONTRACTING REQUIREMENTS.

### 2.0 CONTACTS:

Designer: Kristen Uhrhan  
Dille Pollard Architecture  
266 S. Mount Auburn Road  
Cape Girardeau, MO 63703  
Telephone: 573-339-4536  
Email: [uhrhan@dillepollard.com](mailto:uhrhan@dillepollard.com)

Construction Representative: Randy Duncan  
Division of Facilities Management, Design and Construction  
301 West High Street, Room 730  
Jefferson City, MO, 65102  
Telephone: 573-526-0582  
Email: [randy.duncan@oa.mo.gov](mailto:randy.duncan@oa.mo.gov)

Project Manager: Christopher Lloyd  
Division of Facilities Management, Design and Construction  
301 West High Street, Room 730  
Jefferson City, Missouri 65101  
Telephone: 5735260160  
Email: [Christopher.Lloyd@oa.mo.gov](mailto:Christopher.Lloyd@oa.mo.gov)

Contract Specialist: April Howser  
Division of Facilities Management, Design and Construction  
301 West High Street, Room 730  
Jefferson City, Missouri 65101  
Telephone: 573-751-0053  
Email: [April.Howser@oa.mo.gov](mailto:April.Howser@oa.mo.gov)

### 3.0 NOTICE: ALL BID MATERIALS ARE DUE AT THE TIME OF BID SUBMITTAL. THERE IS NO SECOND SUBMITTAL FOR THIS PROJECT.

### 4.0 FURNISHING CONSTRUCTION DOCUMENTS:

- A. The Owner will furnish the Contractor with approximately 5 complete sets of drawings and specifications at no charge.
- B. The Owner will furnish the Contractor with approximately 5 sets of explanatory or change drawings at no charge.
- C. The Contractor may make copies of the documents as needed with no additional cost to the Owner.

### 5.0 SAFETY REQUIREMENTS

Contractor and subcontractors at any tier shall comply with RSMo 292.675 and Article 1.3, E, of Section 007213, General Conditions.


### 6.0 ENVIRONMENTAL MANAGEMENT SYSTEM (eMS):

The Missouri Army National Guard (MOARNG) has implemented an Environmental Management System (eMS). One of the key components of the eMS is the establishment of an Environmental Policy that must be communicated to all persons working for or on behalf of the organization including all suppliers and contractors. This policy stresses commitment to compliance with accepted environmental practices, and meeting or exceeding applicable environmental requirements, legal and otherwise. This policy also stresses commitment to waste minimization, pollution prevention, and management of personnel, processes, real property, and materials in a manner to reduce environmental impacts. The policy is available upon request to all parties by contacting the Environmental Management Office at (573) 638-9514.

# Missouri

## Division of Labor Standards

### WAGE AND HOUR SECTION

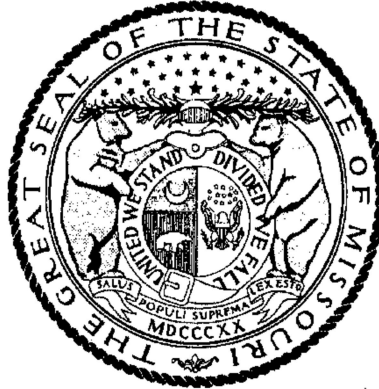

MICHAEL L. PARSON, Governor

# Annual Wage Order No. 30

Section 035  
**DUNKLIN COUNTY**

In accordance with Section 290.262 RSMo 2000, within thirty (30) days after a certified copy of this Annual Wage Order has been filed with the Secretary of State as indicated below, any person who may be affected by this Annual Wage Order may object by filing an objection in triplicate with the Labor and Industrial Relations Commission, P.O. Box 599, Jefferson City, MO 65102-0599. Such objections must set forth in writing the specific grounds of objection. Each objection shall certify that a copy has been furnished to the Division of Labor Standards, P.O. Box 449, Jefferson City, MO 65102-0449 pursuant to 8 CSR 20-5.010(1). A certified copy of the Annual Wage Order has been filed with the Secretary of State of Missouri.

Original Signed by \_\_\_\_\_

Todd Smith, Director  
Division of Labor Standards

Filed With Secretary of State: \_\_\_\_\_ **March 10, 2023**

Last Date Objections May Be Filed: **April 10, 2023**

Prepared by Missouri Department of Labor and Industrial Relations

OCCUPATIONAL TITLE	**Prevailing Hourly Rate
Asbestos Worker	\$19.14*
Boilermaker	\$19.14*
Bricklayer	\$19.14*
Carpenter	\$52.75
Lather	
Linoleum Layer	
Millwright	
Pile Driver	
Cement Mason	\$19.14*
Plasterer	
Communications Technician	\$19.14*
Electrician (Inside Wireman)	\$19.14*
Electrician Outside Lineman	\$19.14*
Lineman Operator	
Lineman - Tree Trimmer	
Groundman	
Groundman - Tree Trimmer	
Elevator Constructor	\$19.14*
Glazier	\$19.14*
Ironworker	\$19.14*
Laborer	\$19.14*
General Laborer	
First Semi-Skilled	
Second Semi-Skilled	
Mason	\$19.14*
Marble Mason	
Marble Finisher	
Terrazzo Worker	
Terrazzo Finisher	
Tile Setter	
Tile Finisher	
Operating Engineer	\$19.14*
Group I	
Group II	
Group III	
Group III-A	
Group IV	
Group V	
Painter	\$41.38
Plumber	\$66.26
Pipe Fitter	
Roofer	\$40.25
Sheet Metal Worker	\$19.14*
Sprinkler Fitter	\$19.14*
Truck Driver	\$19.14*
Truck Control Service Driver	
Group I	
Group II	
Group III	
Group IV	

\*The Division of Labor Standards received fewer than 1,000 reportable hours for this occupational title. The public works contracting minimum wage is established for this occupational title using data provided by Missouri Economic Research and Information Center.

\*\*The Prevailing Hourly Rate includes any applicable fringe benefit amounts for each occupational title as defined in RSMO Section 290.210.

Heavy Construction Rates for  
DUNKLIN County

Section 035

OCCUPATIONAL TITLE	**Prevailing Hourly Rate
Carpenter	\$53.27
Millwright	
Pile Driver	
Electrician (Outside Lineman)	\$19.14*
Lineman Operator	
Lineman - Tree Trimmer	
Groundman	
Groundman - Tree Trimmer	
Laborer	\$45.39
General Laborer	
Skilled Laborer	
Operating Engineer	\$60.91
Group I	
Group II	
Group III	
Group IV	
Truck Driver	\$19.14*
Truck Control Service Driver	
Group I	
Group II	
Group III	
Group IV	

Use Heavy Construction Rates on Highway and Heavy construction in accordance with the classifications of construction work established in 8 CSR 30-3.040(3).

Use Building Construction Rates on Building construction in accordance with the classifications of construction work established in 8 CSR 30-3.040(2).

If a worker is performing work on a heavy construction project within an occupational title that is not listed on the Heavy Construction Rate Sheet, use the rate for that occupational title as shown on the Building Construction Rate Sheet.

\*The Division of Labor Standards received fewer than 1,000 reportable hours for this occupational title. Public works contracting minimum wage is established for this occupational title using data provided by Missouri Economic Research and Information Center.

\*\*The Prevailing Hourly Rate includes any applicable fringe benefit amounts for each occupational title.



# OVERTIME and HOLIDAYS

## OVERTIME

For all work performed on a Sunday or a holiday, not less than twice (2x) the prevailing hourly rate of wages for work of a similar character in the locality in which the work is performed or the public works contracting minimum wage, whichever is applicable, shall be paid to all workers employed by or on behalf of any public body engaged in the construction of public works, exclusive of maintenance work.

For all overtime work performed, not less than one and one-half (1½) the prevailing hourly rate of wages for work of a similar character in the locality in which the work is performed or the public works contracting minimum wage, whichever is applicable, shall be paid to all workers employed by or on behalf of any public body engaged in the construction of public works, exclusive of maintenance work or contractual obligation. For purposes of this subdivision, "**overtime work**" shall include work that exceeds ten hours in one day and work in excess of forty hours in one calendar week; and

A thirty-minute lunch period on each calendar day shall be allowed for each worker on a public works project, provided that such time shall not be considered as time worked.

## HOLIDAYS

January first;  
The last Monday in May;  
July fourth;  
The first Monday in September;  
November eleventh;  
The fourth Thursday in November; and  
December twenty-fifth;

If any holiday falls on a Sunday, the following Monday shall be considered a holiday.

## SECTION 011000 – SUMMARY OF WORK

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and Division 1 Specification Sections apply to this Section.

#### 1.2 WORK COVERED BY CONTRACT DOCUMENTS

- A. The Project consists of INTERIOR AND EXTERIOR RENOVATIONS.
  - 1. Project Location: 1450 N. BYPASS, KENNETT, MO 63857
  - 2. Owner: State of Missouri, Office of Administration, Division of Facilities Management, Design and Construction, Harry S Truman State Office Building, Post Office Box 809, 301 West High Street, Jefferson City, Missouri 65102.
- B. Contract Documents, dated January 30, 2023 were prepared for the Project by Dille Pollard Architecture, 266 S. Mount Auburn Road, Cape Girardeau, MO 63703.
- C. The Work consists of interior and exterior renovations of the existing Kennett Readiness Center (RC).
  - 1. The Interior Work includes, but is not limited to, demolition of the men's and women's showers, latrines, and locker areas, including adjoining spaces for renovation of new latrines, showers, and locker areas. New finishes include resinous flooring and wall coverings, lay-in ceilings, and HPDE toilet partitions. Renovation of existing administrative areas with new wall coverings and flooring. New HVAC equipment for renovated spaces. New entry doors and windows by Alternate bid. The Exterior Work includes replacement of existing parking areas, new striping by Alternate Bid. New site lighting and transfer switch by Alternate bid.
- D. The Work will be constructed under a single prime contract.
  - 1. Work will be substantially complete within 120 working days from the intent to award.

#### 1.3 CONTRACTOR USE OF PREMISES

- A. Use of the Site: Limit use of the premises to work in areas indicated. Confine operations to areas within contract limits indicated. Do not disturb portions of the site beyond the areas in which the Work is indicated.
  - 1. Owner Occupancy: Allow for Owner occupancy and use by the public.
  - 2. Driveways and Entrances: Keep driveways and entrances serving the premises clear and available to the Owner, the Owner's employees, and emergency vehicles at all times. Do not use these areas for parking or storage of materials. Schedule deliveries to minimize space and time requirements for storage of materials and equipment on-site.
- B. Use of the Existing Building: Maintain the existing building in a weathertight condition throughout the construction period. Repair damage cause by construction operations. Take all precautions necessary to protect the building and its occupants during the construction period.

#### 1.4 OCCUPANCY REQUIREMENTS

- A. Full Owner Occupancy: The Owner will occupy the site and existing building during the entire construction period. Cooperate with the Owner during construction operations to minimize conflicts and facilitate owner usage. Perform the Work so as not to interfere with the Owner's operations.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION (Not Applicable)

END OF SECTION 011000

## SECTION 011200 – EXISTING CONDITIONS INFORMATION

### 1.1 EXISTING CONDITION INFORMATION

- A. This Document with its referenced attachments is part of the Procurement and Contracting Requirements for Project. They provide Owner's information for Bidders' convenience and are intended to supplement rather than serve in lieu of the Bidders' own investigations. They are made available for Bidders' convenience and information; but are not a warranty of existing conditions. This Document and its attachments are not part of the Contract Documents.
- B. Existing drawings that include information on existing conditions including previous construction at Project site are available for viewing at the office of Architect. These documents were provided by the Owner. No original or previous work Project Manuals or technical specifications are available.
- C. Survey Information: None available.

END OF DOCUMENT 011200

## SECTION 012100 – ALLOWANCES

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and other Division 1 Specification Sections apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes administrative and procedural requirements governing allowances.
  - 1. Certain items are specified in the Contract Documents by allowances. Allowances have been established in lieu of additional requirements and to defer selection of actual materials and equipment to a later date when additional information is available for evaluation. If necessary, additional requirements will be issued by Change Order.
- B. Types of allowances include the following:
  - 1. Weather allowances.
- C. Related Sections include the following:
  - 1. Division 1 Section "Contract Modification Procedures" for procedures for submitting and handling Change Orders for allowances.
  - 2. Division 1 Section "Unit Prices" for procedures for using unit prices.

#### 1.3 WEATHER ALLOWANCE

- A. Included within the completion period for this project are a specified number of “bad weather” days (see Schedule of Allowances).
- B. The Contractor’s progress schedule shall clearly indicate the bad weather day allowance as an “activity” or “activities”. In the event weather conditions preclude performance of critical work activities for 50% or more of the Contractor’s scheduled workday, that day shall be declared unavailable for work due to weather (a “bad weather” day) and charged against the above allowance. Critical work activities will be determined by review of the Contractor’s current progress schedule.
- C. The Contractor’s Representative and the Construction Representative shall agree monthly on the number of “bad weather” days to be charged against the allowance. This determination will be documented in writing and be signed by the Contractor and the Construction Representatives. If there is a failure to agree on all or part of the “bad weather” days for a particular month, that disagreement shall be noted on this written document and signed by each party’s representative. Failure of the Contractor’s representative to sign the “bad weather” day documentation after it is presented, with or without the notes of disagreement, shall constitute agreement with the “bad weather” day determination contained in that document.
- D. There will be no modification to the time of contract performance due solely to the failure to deplete the “bad weather” day allowance.

- E. Once this allowance is depleted, a no cost Change Order time extension will be executed for “bad weather” days, as defined above, encountered during the remainder of the Project.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION

3.1 SCHEDULE OF ALLOWANCES

- A. Weather Allowance: Included within the completion period for this Project TEN (10) “bad weather” days.

END OF SECTION 012100

## SECTION 012200 – UNIT PRICES

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and other Division 1 Specification Sections apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes administrative and procedural requirements for Unit Prices.
- B. Related Sections include the following:
  - 1. Division 1 Section "Contract Modification Procedures" for procedures for submitting and handling Change Orders.

#### 1.3 DEFINITIONS

- A. Unit Price is an amount proposed by bidders, stated on the Bid Form Attachment 004322 a price per unit of measurement for materials or services added to or deducted from the Contract Sum by appropriate modification, if estimated quantities of Work required by the Contract Documents are increased or decreased.

#### 1.4 PROCEDURES

- A. Unit Prices include all necessary material plus cost for delivery, installation, insurance, applicable taxes, overhead, and profit.
- B. Measurement and Payment: Refer to individual Specification Sections for work that requires establishment of Unit Prices. Methods of measurement and payment for Unit Prices are specified in those Sections.
- C. Owner reserves the right to reject Contractor's measurement of Work in-place that involves use of established Unit Prices and to have this work measured, at Owner's expense, by an independent surveyor acceptable to Contractor.
- D. List of Unit Prices: A list of Unit Prices is included in Part 3. Specification Sections referenced in the schedule contain requirements for materials described under each Unit Price.

### PART 2 - PRODUCTS (Not Used)

### PART 3 - EXECUTION

#### 3.1 LIST OF UNIT PRICES

- A. Unit Price No. 1 – Replacing damaged or deteriorated paving at drives and parking areas.
  - 1. Description: Per square foot price for removal of existing asphalt paving and replacement with new reinforced 4,000 psi concrete paving. New rigid concrete paving construction to be 6” thick with 6x6/W2.0xW2.0 W.W.F. at mid-depth

over 4" compacted aggregate base on compacted subgrade. according to Division 03 Section "033000 Cast-In-Place Concrete".

2. Unit of Measurement: square feet
3. Base Bid Quantity: 1 square foot

END OF SECTION 012200



## SECTION 012300 - ALTERNATES

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions, Bid Form and other Division 1 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes administrative and procedural requirements governing Alternates.

#### 1.3 DEFINITIONS

- A. Definition: An alternate is an amount proposed by bidders and stated on the Bid Form for certain work defined in the Bidding Requirements that may be added to the Base Bid amount if the Owner decides to accept a corresponding change in either the amount of construction to be completed, or in the products, materials, equipment, systems, or installation methods described in the Contract Documents.

- 1. The cost for each alternate is the net addition to the Contract Sum to incorporate the Alternate into the Work. No other adjustments are made to the Contract Sum.

- B. No additional time will be allowed for alternate work unless the number of work days is so stated on the bid form.

#### 1.4 PROCEDURES

- A. Coordination: Modify or adjust affected adjacent Work as necessary to completely and fully integrate the Alternate Work into the Project.

- 1. Include as part of each alternate, miscellaneous devices, accessory objects, and similar items incidental to or required for a complete installation whether or not mentioned as part of the Alternate.

- B. Notification: The award of the Contract will indicate whether alternates have been accepted or rejected.

- C. Execute accepted alternates under the same conditions as other Work of this Contract.

- D. Schedule: A "Schedule of Alternates" is included at the end of this Section. Specification Sections referenced in the Schedule contain requirements for materials necessary to achieve the Work described under each alternate.

### PART 2 - PRODUCTS (Not Applicable)

### PART 3 - EXECUTION

#### 3.1 SCHEDULE OF ALTERNATES

- A. Alternate No. 1: *Replacement of existing aluminum storefront entrance and aluminum windows as indicated on the Drawings. Include all labor, materials, equipment, cleanup and removal of material in bid.*

1. *In addition to notations on the Drawings, Specification Sections that include requirements for this Alternate include, but are not limited to, Sections in Division 7 for Joint Sealants and Division 8 for Aluminum Framed Entrances and Storefronts, Aluminum Windows, Door Hardware, and Glazing requirements.*
- B. *Alternate No. 2: Replacement of Manual Transfer Switch with Generator Connection Cabinet as indicated on the Drawings. Include all labor, materials, equipment, cleanup and removal of material in bid.*
  1. *In addition to notations on the Drawings, Specification Sections that include requirements for this Alternate include, but are not limited to, Sections in Division 26 for Transfer Switch and electrical requirements.*
- C. *Alternate No. 3: Replacement of existing paving with new concrete drive and parking slabs. Refer to Division 3 Sections for primary work requirements. Note: Alternate No. 3 shall include striping of all parking areas as indicated. Alternate also includes parking lighting. Also reference Unit Costs for potential increase in extents of concrete paving work.*

END OF SECTION 012300

## SECTION 012600 – CONTRACT MODIFICATION PROCEDURES

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and other Division 1 Specification Sections apply to this Section.

#### 1.2 SUMMARY

- A. This Section specifies administrative and procedural requirements for handling and processing Contract Modifications.
- B. Related Sections include the following:
  - 1. Division 1, Section 012100 "Allowances" for procedural requirements for handling and processing Allowances.
  - 2. Division 1, Section 012200 "Unit Prices" for administrative requirements for using Unit Prices.
  - 3. Division 1, Section 013115 "Project Management Communications" for administrative requirements for communications.
  - 4. Division 0, Section 007213, Article 3.1 "Acceptable Substitutions" for administrative procedures for handling Requests for Substitutions made after Contract award.
  - 5. Division 0, Section 007213, Article 4.0 "Changes in the Work" for Change Order requirements.

#### 1.3 REQUESTS FOR INFORMATION

- A. In the event that the Contractor or Subcontractor, at any tier, determines that some portion of the Drawings, Specifications, or other Contract Documents requires clarification or interpretation, the Contractor shall submit a "Request for Information" (RFI) in writing to the Designer. A RFI may only be submitted by the Contractor and shall only be submitted on the RFI forms provided by the Owner. The Contractor shall clearly and concisely set forth the issue for which clarification or interpretation is sought and why a response is needed. In the RFI, the Contractor shall set forth an interpretation or understanding of the requirement along with reasons why such an understanding was reached.
- B. Responses to RFI shall be issued within ten (10) working days of receipt of the Request from the Contractor unless the Designer determines that a longer time is necessary to provide an adequate response. If a longer time is determined necessary by the Designer, the Designer will, within five (5) working days of receipt of the request, notify the Contractor of the anticipated response time. If the Contractor submits a RFI on a time sensitive activity on the current project schedule, the Contractor shall not be entitled to any time extension due to the time it takes the Designer to respond to the request provided that the Designer responds within the ten (10) working days set forth above.
- C. Responses from the Designer will not change any requirement of the Contract Documents. In the event the Contractor believes that a response to a RFI will cause a change to the requirements of the Contract Document, the Contractor shall give written

notice to the Designer requesting a Change Order for the work. Failure to give such written notice within ten (10) working days, shall waive the Contractor's right to seek additional time or cost under Article 4, "Changes in the Work" of the General Conditions.

#### 1.4 MINOR CHANGES IN THE WORK

- A. Designer will issue supplemental instructions authorizing Minor Changes in the Work, not involving adjustment to the Contract Amount or the Contract Time, on "Designer's Supplemental Instructions" (DSI).

#### 1.5 PROPOSAL REQUESTS

- A. The Designer or Owner Representative will issue a detailed description of proposed Changes in the Work that may require adjustment to the Contract Amount or the Contract Time. The proposed Change Description will be issued using the "Request for Proposal" (RFP) form. If necessary, the description will include supplemental or revised Drawings and Specifications.
  - 1. Proposal Requests issued by the Designer or Owner Representative are for information only. Do not consider them instructions either to stop work in progress or to execute the proposed change.
  - 2. Within ten (10) working days after receipt of Proposal Request, submit a proposal for the cost adjustments to the Contract Amount and the Contract Time necessary to execute the Change. The Contractor shall submit his proposal on the appropriate Change Order Detailed Breakdown form. Subcontractors may use the appropriate Change Order Detailed Breakdown form or submit their proposal on their letterhead provided the same level of detail is included. All proposals shall include:
    - a. A detailed breakdown of costs per Article 4.1 of the General Conditions.
    - b. If requesting additional time per Article 4.2 of the General Conditions, include an updated Contractor's Construction Schedule that indicates the effect of the Change including, but not limited to, changes in activity duration, start and finish times, and activity relationship.

#### 1.6 CHANGE ORDER PROCEDURES

- A. On Owner's approval of a Proposal Request, the Designer or Owner Representative will issue a Change Order for signatures of Owner and Contractor on the "Change Order" form.

### PART 2 - PRODUCTS (Not Used)

### PART 3 - EXECUTION

#### 3.1 REFERENCED FORMS

- A. The following forms can be found on our website at <https://oa.mo.gov/facilities/vendor-links/architectengineering-forms> or <https://oa.mo.gov/facilities/vendor-links/contractor-forms>:
  - 1. Request for Information
  - 2. Designer's Supplemental Instructions
  - 3. Request for Proposal

4. Contract Change
5. Contract Change Detailed Breakdown – SAMPLES
6. Contract Change Detailed Breakdown – General Contractor (GC)
7. Contract Change Detailed Breakdown – Subcontractor (SUB)

END OF SECTION 012600

## SECTION 013100 – COORDINATION

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and other Division 1 Specification Sections apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes administrative provisions for coordinating construction operations on Projects including, but not limited to, the following:
  - 1. Coordination Drawings.
  - 2. Administrative and supervisory personnel.
  - 3. Project meetings.
- B. Each Contractor shall participate in coordination requirements. Certain areas of responsibility will be assigned to a specific Contractor.
- C. Related Sections include the following:
  - 1. Division 1, Section 013200 "Schedules" for preparing and submitting Contractor's Construction Schedule.
  - 2. Articles 1.8.B and 1.8.C of Section 007213 "General Conditions" for coordinating meetings onsite.
  - 3. Article 5.4.H of Section 007213 "General Conditions" for coordinating Closeout of the Contract.

#### 1.3 COORDINATION

- A. Coordination: Coordinate construction operations included in different Sections of the Specifications to ensure efficient and orderly installation of each part of the Work. Coordinate construction operations included in different Sections, which depend on each other for proper installation, connection, and operation.
- B. Coordination: Each Contractor shall coordinate its construction operations with those of other contractors and entities to ensure efficient and orderly installation of each part of the Work. Each Contractor shall coordinate its operations with operations included in different Sections that depend on each other for proper installation, connection, and operation.
  - 1. Schedule construction operations in sequence required to obtain the best results where installation of one part of the Work depends on installation of other components, before or after its own installation.
  - 2. Coordinate installation of different components with other Contractors to ensure maximum accessibility for required maintenance, service, and repair.
  - 3. Make adequate provisions to accommodate items scheduled for later installation.
  - 4. Where availability of space is limited, coordinate installation of different components to ensure maximum performance and accessibility for required

maintenance, service, and repair of all components including mechanical and electrical.

- C. Prepare memoranda for distribution to each party involved outlining special procedures required for coordination. Include such items as required notices, reports, and list of attendees at meetings.
  - 1. Prepare similar memoranda for Owner and separate Contractors if coordination of their Work is required.
  
- D. Administrative Procedures: Coordinate scheduling and timing of required administrative procedures with other construction activities and activities of other Contractors to avoid conflicts and to ensure orderly progress of the Work. Such administrative activities include, but are not limited to, the following:
  - 1. Preparation of Contractor's Construction Schedule.
  - 2. Preparation of the Schedule of Values.
  - 3. Installation and removal of temporary facilities and controls.
  - 4. Delivery and processing of submittals.
  - 5. Progress meetings.
  - 6. Preinstallation conferences.
  - 7. Startup and adjustment of systems.
  - 8. Project Closeout activities.
  
- E. Conservation: Coordinate construction activities to ensure that operations are carried out with consideration given to conservation of energy, water, and materials.
  - 1. Salvage materials and equipment involved in performance of, but not actually incorporated into, the Work. Refer to other Sections for disposition of salvaged materials that are designated as Owner's property.

#### 1.4 SUBMITTALS

- A. Coordination Drawings: Prepare Coordination Drawings if limited space availability necessitates maximum utilization of space for efficient installation of different components or if coordination is required for installation of products and materials fabricated by separate entities.
  
- B. Key Personnel Names: Within fifteen (15) work days of starting construction operations, submit a list of key personnel assignments including superintendent and other personnel in attendance at Project site. Identify individuals and their duties and responsibilities; list addresses and telephone numbers including home and office telephone numbers. Provide names, addresses, and telephone numbers of individuals assigned as standbys in the absence of individuals assigned to Project.
  - 1. Post copies of list in Project meeting room, in temporary field office, and by each temporary telephone. Keep list current at all times.

#### 1.5 PROJECT MEETINGS

- A. The Owner's Construction Representative will schedule a Pre-Construction Meeting prior to beginning of construction. The date, time, and exact place of this meeting will be determined after Contract Award and notification of all interested parties. The

Contractor shall arrange to have the Job Superintendent and all prime Subcontractors present at the meeting. During the Pre-Construction Meeting, the construction procedures and information necessary for submitting payment requests will be discussed and materials distributed along with any other pertinent information.

1. Minutes: Designer will record and distribute meeting minutes.
- B. Progress Meetings: The Owner's Construction Representative will conduct Monthly Progress Meetings as stated in Articles 1.8.B and 1.8.C of Section 007213 "General Conditions".
1. Minutes: Designer will record and distribute to Contractor the meeting minutes.
- C. Preinstallation Conferences: Contractor shall conduct a preinstallation conference at Project site before each construction activity that requires coordination with other construction.
1. Attendees: Installer and representatives of Manufacturers and Fabricators involved in or affected by the installation and its coordination or integration with other materials and installations that have preceded or will follow, shall attend the meeting. Advise Designer and Construction Representative of scheduled meeting dates.
  2. Agenda: Review progress of other construction activities and preparations for the particular activity under consideration including requirements for the following:
    - a. Contract Documents
    - b. Options
    - c. Related RFIs
    - d. Related Change Orders
    - e. Purchases
    - f. Deliveries
    - g. Submittals
    - h. Review of mockups
    - i. Possible conflicts
    - j. Compatibility problems
    - k. Time schedules
    - l. Weather limitations
    - m. Manufacturer's written recommendations
    - n. Warranty requirements
    - o. Compatibility of materials
    - p. Acceptability of substrates
    - q. Temporary facilities and controls
    - r. Space and access limitations
    - s. Regulations of authorities having jurisdiction
    - t. Testing and inspecting requirements



- u. Installation procedures
  - v. Coordination with other Work
  - w. Required performance results
  - x. Protection of adjacent Work
  - y. Protection of construction and personnel
3. Contractor shall record significant conference discussions, agreements, and disagreements including required corrective measures and actions.
  4. Reporting: Distribute minutes of the meeting to each party present and to parties who should have been present.
  5. Do not proceed with installation if the conference cannot be successfully concluded. Initiate whatever actions are necessary to resolve impediments to performance of the Work and reconvene the conference at earliest feasible date.
  6. Revise paragraph below if Project requires holding progress meetings at different intervals. Insert special intervals such as "every third Tuesday" to suit special circumstances.
  7. Project name
  8. Name and address of Contractor
  9. Name and address of Designer
  10. RFI number including RFIs that were dropped and not submitted
  11. RFI description
  12. Date the RFI was submitted
  13. Date Designer's response was received
  14. Identification of related DSI or Proposal Request, as appropriate

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF SECTION 013100

## SECTION 013115 - PROJECT MANAGEMENT COMMUNICATIONS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.
- B. Division 1, Section 013300 - Submittals
- C. Division 1, Section 012600 – Contract Modification Procedures

#### 1.2 SUMMARY

- A. Project Management Communications: The Contractor shall use the Internet web based project management communications tool, E-Builder® ASP software, and protocols included in that software during this project. The use of project management communications as herein described does not replace or change any contractual responsibilities of the participants.
  - 1. Project management communications is available through E-Builder® as provided by "e-Builder®" in the form and manner required by the Owner.
  - 2. The project communications database is on-line and fully functional. User registration, electronic and computer equipment, and Internet connections are the responsibility of each project participant. The sharing of user accounts is prohibited
- B. Support: E-Builder® will provide on-going support through on-line help files.
- C. Copyrights and Ownership: Nothing in this specification or the subsequent communications supersedes the parties' obligations and rights for copyright or document ownership as established by the Contract Documents. The use of CAD files, processes or design information distributed in this system is intended only for the project specified herein.
- D. Purpose: The intent of using E-Builder® is to improve project work efforts by promoting timely initial communications and responses. Secondly, to reduce the number of paper documents while providing improved record keeping by creation of electronic document files
- E. Authorized Users: Access to the web site will be by individuals who are authorized users.
  - 1. Individuals shall complete the E-Builder New Company/User Request Form located at the following web site: <https://oa.mo.gov/facilities/vendor-links/contractor-forms>. Completed forms shall be emailed to the following email address: [OA.FMDCE-BuilderSupport@oa.mo.gov](mailto:OA.FMDCE-BuilderSupport@oa.mo.gov).
  - 2. Authorized users will be contacted directly and assigned a temporary user password.
  - 3. Individuals shall be responsible for the proper use of their passwords and access to data as agents of the company in which they are employed.
- F. Administrative Users: Administrative users have access and control of user licenses and all posted items. DO NOT POST PRIVATE OR YOUR COMPANY CONFIDENTIAL ITEMS IN THE DATABASE! Improper or abusive language toward any party or repeated posting of items

intended to deceive or disrupt the work of the project will not be tolerated and will result in deletion of the offensive items and revocation of user license at the sole discretion of the Administrative User(s).

- G. Communications: The use of fax, email and courier communication for this project is discouraged in favor of using E-Builder® to send messages. Communication functions are as follows:
1. Document Integrity and Revisions:
    - a. Documents, comments, drawings and other records posted to the system shall remain for the project record. The authorship time and date shall be recorded for each document submitted to the system. Submitting a new document or record with a unique ID, authorship, and time stamp shall be the method used to make modifications or corrections.
    - b. The system shall make it easy to identify revised or superseded documents and their predecessors.
    - c. Server or Client side software enhancements during the life of the project shall not alter or restrict the content of data published by the system. System upgrades shall not affect access to older documents or software.
  2. Document Security:
    - a. The system shall provide a method for communication of documents. Documents shall allow security group assignment to respect the contractual parties communication except for Administrative Users. **DO NOT POST PRIVATE OR YOUR COMPANY CONFIDENTIAL ITEMS IN THE DATABASE!**
  3. Document Integration:
    - a. Documents of various types shall be logically related to one another and discoverable. For example, requests for information, daily field reports, supplemental sketches and photographs shall be capable of reference as related records.
  4. Reporting:
    - a. The system shall be capable of generating reports for work in progress, and logs for each document type. Summary reports generated by the system shall be available for team members.
  5. Notifications and Distribution:
    - a. Document distribution to project members shall be accomplished both within the extranet system and via email as appropriate. Project document distribution to parties outside of the project communication system shall be accomplished by secure email of outgoing documents and attachments, readable by a standard email client.
  6. Required Document Types:
    - a. RFI, Request for Information.
    - b. Submittals, including record numbering by drawing and specification section.
    - c. Transmittals, including record of documents and materials delivered in hard copy.
    - d. Meeting Minutes.
    - e. Application for Payments (Draft or Pencil).
    - f. Review Comments.
    - g. Field Reports.
    - h. Construction Photographs.
    - i. Drawings.
    - j. Supplemental Sketches.
    - k. Schedules.
    - l. Specifications.

- m. Request for Proposals
  - n. Designer's Supplemental Instructions
  - o. Punch Lists
- H. Record Keeping: Except for paper documents, which require original signatures and large format documents (greater than 8½ x 11 inches), all other 8½ x 11 inches documents shall be submitted by transmission in electronic form to the E-Builder® web site by licensed users.
- a. The Owner and his representatives, the Designer and his consultants, and the Contractor and his Sub Contractors and suppliers at every tier shall respond to documents received in electronic form on the web site, and consider them as if received in paper document form.
  - b. The Owner and his representatives, the Designer and his consultants, and the Contractor and his Sub Contractors and suppliers at every tier reserves the right to and shall reply or respond by transmissions in electronic form on the web site to documents actually received in paper document form.
  - c. The Owner and his representatives, the Designer and his consultants, and the Contractor and his Sub Contractors and suppliers at every tier reserves the right to and shall copy any paper document into electronic form and make same available on the web site.
- I. Minimum Equipment and Internet Connection: In addition to other requirements specified in this Section, the Owner and his representatives, the Construction Manager and his representatives, the Architect and his consultants, and the Contractor and his sub-contractors and suppliers at every tier required to have a user license(s) shall be responsible for the following:
- 1. Providing suitable computer systems for each licensed user at the users normal work location<sup>1</sup> with high-speed Internet access, i.e. DSL, local cable company's Internet connection, or T1 connection.
  - 2. Each of the above referenced computer systems shall have the following minimum system<sup>2</sup> and software requirements:
    - a. Desktop configuration (Laptop configurations are similar and should be equal to or exceed desktop system.)
      - 1) Operating System: Windows XP or newer
      - 2) Internet Browser: Internet Explorer 6.01SP2+ (Recommend IE7.0+)
      - 3) Minimum Recommend Connection Speed: 256K or above
      - 4) Processor Speed: 1 Gigahertz and above
      - 5) RAM: 512 mb
      - 6) Operating system and software shall be properly licensed.
      - 7) Internet Explorer version 7 (current version is a free distribution for download). This specification is not intended to restrict the host server or client computers provided that industry standard HTTP clients may access the published content.
      - 8) Adobe Acrobat Reader (current version is a free distribution for download).
      - 9) Users should have the standard Microsoft Office Suite (current version must be purchased) or the equivalent.

---

<sup>1</sup> The normal work location is the place where the user is assigned for more than one-half of his time working on this project.

<sup>2</sup> The minimum system herein will not be sufficient for many tasks and may not be able to process all documents and files stored in the E-Builder® Documents area.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION (Not Applicable.)

END OF SECTION 013115

## SECTION 013200 – SCHEDULE – BAR CHART

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes requirements for a Bar Chart Schedule for the project construction activities, schedule of submittals, and schedule for testing.

### PART 2 - PRODUCTS – (Not Applicable)

### PART 3 - EXECUTION

#### 3.1 SUBMITTAL PROCEDURES

- A. The Contractor shall submit to the Designer, within ten (10) working days following the Notice to Proceed, a Progress Schedule including Schedule of Values showing the rate of progress the Contractor agrees to maintain and the order in which he proposed to carry out the various phases of Work. No payments shall be made to the Contractor until the Progress Schedule has been approved by the Owner.
  - 1. The Schedule of Values must have the following line items included with the value of the item as indicated below:
    - a. O&M's (Owner's Manual)
      - 1) \$1,000,000.00 (One million) and under – 2% of the total contract amount
      - 2) Over \$1,000,000.00 (One million) – 1% of the total contract amount
    - b. Close Out Documents
      - 1) \$1,000,000.00 (One million) and under – 2% of the total contract amount
      - 2) Over \$1,000,000.00 (One million) – 1% of the total contract amount
    - c. General Conditions
      - 1) No more than 10%
- B. The Contractor shall submit an updated Schedule for presentation at each Monthly Progress Meeting. The Schedule shall be updated by the Contractor as necessary to reflect the current Schedule and its relationship to the original Schedule. The updated Schedule shall reflect any changes in the logic, sequence, durations, or completion date. Payments to the Contractor shall be suspended if the Progress Schedule is not adequately updated to reflect actual conditions.

- C. The Contractor shall submit Progress Schedules to Subcontractors to permit coordinating their Progress Schedules to the general construction Work. The Contractor shall coordinate preparation and processing of Schedules and reports with performance of other construction activities.

### 3.2 CONSTRUCTION PROGRESS SCHEDULE – BAR CHART SCHEDULE

- A. Bar-Chart Schedule: The Contractor shall prepare a comprehensive, fully developed, horizontal bar chart-type Contractor’s Construction Schedule. The Contractor for general construction shall prepare the Construction Schedule for the entire Project. The Schedule shall show the percentage of work to be completed at any time, anticipated monthly payments by Owner, as well as significant dates (such as completion of excavation, concrete foundation work, underground lines, superstructure, rough-ins, enclosure, hanging of fixtures, etc.) which shall serve as check points to determine compliance with the approved Schedule. The Schedule shall also include an activity for the number of “bad” weather days specified in Section 012100 – Allowances.
  - 1. The Contractor shall provide a separate time bar for each significant construction activity. Provide a continuous vertical line to identify the first working day of each week.
    - a. If practical, use the same Schedule of Values breakdown for schedule time bars.
  - 2. The Contractor shall provide a base activity time bar showing duration for each construction activity. Each bar is to indicate start and completion dates for the activity. The Contractor is to place a contrasting bar below each original schedule activity time for indicating actual progress and planned remaining duration for the activity.
  - 3. The Contractor shall prepare the Schedule on a minimal number of separate sheets to readily show the data for the entire construction period.
  - 4. Secure time commitments for performing critical elements of the Work from parties involved. Coordinate each element on schedule with other construction activities. Include minor elements involved in the overall sequence of the Work. Show each activity in proper sequence. Indicate graphically the sequences necessary for completion of related portions of the Work.
  - 5. Coordinate the Contractor’s Construction Schedule with the Schedule of Values, list of subcontracts, Submittal Schedule, progress reports, payment requests, and other required schedules and reports.
  - 6. Indicate the Intent to Award and the Contract Substantial Completion dates on the schedule.
- B. Phasing: Provide notations on the schedule to show how the sequence of the Work is affected by the following:
  - 1. Requirement for Phased completion
  - 2. Work by separate Contractors
  - 3. Work by the Owner
  - 4. Pre-purchased materials
  - 5. Coordination with existing construction
  - 6. Limitations of continued occupancies

7. Un-interruptible services
  8. Partial Occupancy prior to Substantial Completion
  9. Site restrictions
  10. Provisions for future construction
  11. Seasonal variations
  12. Environmental control
- C. Work Stages: Use crosshatched bars to indicate important stages of construction for each major portion of the Work. Such stages include, but are not necessarily limited to, the following:
1. Subcontract awards
  2. Submittals
  3. Purchases
  4. Mockups
  5. Fabrication
  6. Sample testing
  7. Deliveries
  8. Installation
  9. Testing
  10. Adjusting
  11. Curing
  12. Startup and placement into final use and operation
- D. Area Separations: Provide a separate time bar to identify each major area of construction for each major portion of the Work. For the purposes of this Article, a “major area” is a story of construction, a separate building, or a similar significant construction element.
1. Indicate where each construction activity within a major area must be sequenced or integrated with other construction activities to provide for the following:
    - a. Structural completion.
    - b. Permanent space enclosure
    - c. Completion of mechanical installation
    - d. Completion of the electrical portion of the Work
    - e. Substantial Completion

### 3.3 SCHEDULE OF SUBMITTALS

- A. Upon acceptance of the Construction Progress Schedule, prepare and submit a complete schedule of submittals. Coordinate the submittal schedule with Section 013300 SUBMITTALS, the approved Construction Progress Schedule, list of subcontracts, Schedule of Values and the list of products.
- B. Prepare the schedule in chronological order. Provide the following information



1. Scheduled date for the first submittal
  2. Related Section number
  3. Submittal category
  4. Name of the Subcontractor
  5. Description of the part of the Work covered
  6. Scheduled date for resubmittal
  7. Scheduled date for the Designer's final release or approval
- C. Distribution: Following the Designer's response to the initial submittal schedule, print and distribute copies to the Designer, Owner, subcontractors, and other parties required to comply with submittal dates indicated.
1. Post copies in the Project meeting room and temporary field office.
  2. When revisions are made, distribute to the same parties and post in the same locations. Delete parties from distribution when they have completed their assigned part of the Work and are no longer involved in construction activities.
- D. Schedule Updating: Revise the schedule after each meeting or other activity where revisions have been recognized or made. Issue the updated schedule concurrently with the report of each meeting.

#### 3.4 SCHEDULE OF INSPECTIONS AND TESTS

- A. Prepare a schedule of inspections, tests, and similar services required by the Contract Documents. Submit the schedule with (15) days of the date established for commencement of the Contract Work. The Contractor is to notify the testing agency at least (5) working days in advance of the required tests unless otherwise specified.
- B. Form: This schedule shall be in tabular form and shall include, but not be limited to, the following:
1. Specification Section number
  2. Description of the test
  3. Identification of applicable standards
  4. Identification of test methods
  5. Number of tests required
  6. Time schedule or time span for tests
  7. Entity responsible for performing tests
  8. Requirements for taking samples
  9. Unique characteristics of each service
- C. Distribution: Distribute the schedule to the Owner, Architect, and each party involved in performance of portions of the Work where inspections and tests are required.

END OF SECTION 013200

## SECTION 013300 – SUBMITTALS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.
- B. Division 1, Section 013115 “Project Management Communications” for administrative requirements for communications.

#### 1.2 SUMMARY

- A. This Section includes administrative and procedural requirements for submittals required for performance of the Work including the following:
  - 1. Shop Drawings
  - 2. Product Data
  - 3. Samples
  - 4. Quality Assurance Submittals
  - 5. Construction Photographs
  - 6. Operating and Maintenance Manuals
  - 7. Warranties
- B. Administrative Submittals: Refer to General and Supplementary Conditions other applicable Division 1 Sections and other Contract Documents for requirements for administrative submittals. Such submittals include, but are not limited to, the following:
  - 1. Construction Progress Schedule including Schedule of Values
  - 2. Performance and Payment Bonds
  - 3. Insurance Certificates
  - 4. Applications for Payment
  - 5. Certified Payroll Reports
  - 6. Partial and Final Receipt of Payment and Release Forms
  - 7. Affidavit – Compliance with Prevailing Wage Law
  - 8. Record Drawings
  - 9. Notifications, Permits, etc.
- C. The Contractor is obliged and responsible to check all shop drawings and schedules to assure compliance with contract plans and specifications. The Contractor is responsible for the content of the shop drawings and coordination with other contract work. Shop drawings and schedules shall indicate, in detail, all parts of an Item or Work including erection and setting instructions and integration with the Work of other trades.
- D. The Contractor shall at all times make a copy, of all approved submittals, available on site to the Construction Representative.

### 1.3 SUBMITTAL PROCEDURES

- A. The Contractor shall comply with the General and Supplementary Conditions and other applicable sections of the Contract Documents. The Contractor shall submit, with such promptness as to cause no delay in his work or in that of any other contractors, all required submittals indicated in Part 3.1 of this section and elsewhere in the Contract Documents. Coordinate preparation and processing of submittals with performance of construction activities. Transmit each submittal sufficiently in advance of performance of related construction activities to avoid delay.
  - 1. Coordinate each submittal with fabrication, purchasing, testing, delivery, other submittals, and related activities that require sequential activity.
  - 2. Coordinate transmittal of different types of submittals for related elements of the Work so processing will not be delayed by the need to review submittals concurrently for coordination.
    - a. The Designer reserves the right to withhold action on a submittal requiring coordination with other submittals until all related submittals are received.
- B. Each drawing and/or series of drawings submitted must be accompanied by a letter of transmittal giving a list of the titles and numbers of the drawings. Each series shall be numbered consecutively for ready reference and each drawing shall be marked with the following information:
  - 1. Date of Submission
  - 2. Name of Project
  - 3. Location
  - 4. Section Number of Specification
  - 5. State Project Number
  - 6. Name of Submitting Contractor
  - 7. Name of Subcontractor
  - 8. Indicate if Item is submitted as specified or as a substitution

### 1.4 SHOP DRAWINGS

- A. Comply with the General Conditions, Article 3.2.
- B. The Contractor shall submit newly prepared information drawn accurately to scale. Highlight, encircle, or otherwise indicate deviations from the Contract Documents. Do not reproduce Contract Documents or copy standard information as the basis of Shop Drawings. Standard information prepared without specific reference to the Project is not a Shop Drawing.
- C. Shop Drawings include fabrication and installation drawings, setting diagrams, schedules, patterns, templates, and similar drawings including the following information:
  - 1. Dimensions
  - 2. Identification of products and materials included by sheet and detail number
  - 3. Compliance with specified standards
  - 4. Notation of coordination requirements

5. Notation of dimensions established by field measurement
6. Sheet Size: Except for templates, patterns and similar full-size Drawings, submit Shop Drawings on sheets at least 8½"x11" but no larger than 36"x48".

## 1.5 PRODUCT DATA

- A. The Contractor shall comply with the General Conditions, Article 3.2.
- B. The Contractor shall collect Product Data into a single submittal for each element of construction or system. Product Data includes printed information, such as manufacturer's installation instructions, catalog cuts, standard color charts, roughing-in diagrams and templates, standard wiring diagrams, and performance curves.
  1. Mark each copy to show applicable choices and options. Where printed Product Data includes information on several products that are not required, mark copies to indicate the applicable information including the following information:
    - a. Manufacturer's printed recommendations
    - b. Compliance with Trade Association standards
    - c. Compliance with recognized Testing Agency standards
    - d. Application of Testing Agency labels and seals
    - e. Notation of dimensions verified by field measurement
    - f. Notation of coordination requirements
  2. Do not submit Product Data until compliance with requirements of the Contract Documents has been confirmed.

## 1.6 SAMPLES

- A. The Contractor shall comply with the General Conditions, Article 3.2.
- B. The Contractor shall submit full-size, fully fabricated samples, cured and finished as specified, and physically identical with the material or product proposed. Samples include partial sections of manufactured or fabricated components, cuts or containers of materials, color range sets, and swatches showing color, texture, and pattern.
  1. The Contractor shall mount or display samples in the manner to facilitate review of qualities indicated. Prepare samples to match the Designer's sample including the following:
    - a. Specification Section number and reference
    - b. Generic description of the Sample
    - c. Sample source
    - d. Product name or name of the Manufacturer
    - e. Compliance with recognized standards
    - f. Availability and delivery time
  2. The Contractor shall submit samples for review of size, kind, color, pattern, and texture. Submit samples for a final check of these characteristics with other elements and a comparison of these characteristics between the final submittal and the actual component as delivered and installed.

- a. Where variation in color, pattern, texture, or other characteristic is inherent in the material or product represented, submit at least three (3) multiple units that show approximate limits of the variations.
  - b. Refer to other Specification Sections for requirements for samples that illustrate workmanship, fabrication techniques, details of assembly, connections, operation, and similar construction characteristics.
  - c. Refer to other Sections for samples to be returned to the Contractor for incorporation in the Work. Such samples must be undamaged at time of use. On the transmittal, indicate special requests regarding disposition of sample submittals.
  - d. Samples not incorporated into the Work, or otherwise designated as the Owner's property, are the property of the Contractor and shall be removed from the site prior to Substantial Completion.
3. Field samples are full-size examples erected onsite to illustrate finishes, coatings, or finish materials and to establish the Project standard.
- a. The Contractor shall comply with submittal requirements to the fullest extent possible. The Contractor shall process transmittal forms to provide a record of activity.

## 1.7 QUALITY ASSURANCE DOCUMENTS

- A. The Contractor shall comply with the General Conditions, Article 3.2
- B. The Contractor shall submit quality control submittals including design data, certifications, manufacturer's instructions, manufacturer's field reports, and other quality-control submittals as required under other Sections of the Specifications.
- C. Certifications: Where other Sections of the Specifications require certification that a product, material, or installation complies with specified requirements, submit a notarized certification from the Manufacturer certifying compliance with specified requirements.
  1. Signature: Certification shall be signed by an officer of the Manufacturer or other individual authorized to contractually bind the Company.
- D. Inspection and Test Reports: The Contractor shall submit the required inspection and test reports from independent testing agencies as specified in this Section and in other Sections of the Contract Documents.
- E. Construction Photographs: The Contractor shall submit record construction photographs as specified in this Section and in other Sections of the Contract Documents.
  1. The Contractor shall submit digital photographs. The Construction Administrator shall determine the quantity and naming convention at the preconstruction meeting.
  2. The Contractor shall identify each photograph with project name, location, number, date, time, and orientation.
  3. The Contractor shall submit progress photographs monthly unless specified otherwise. Photographs shall be taken one (1) week prior to submitting.
  4. The Contractor shall take four (4) site photographs from differing directions and a minimum of five (5) interior photographs indicating the relative progress of the Work.

## 1.8 OPERATING AND MAINTENANCE MANUALS AND WARRANTIES

- A. The Contractor shall submit all required manufacturer's operating instructions, maintenance/service manuals, and warranties in accordance with the General Conditions, Article 3.5, and Supplementary Conditions along with this and other Sections of the Contract Documents.

## PART 2 - PRODUCTS (Not Applicable)

## PART 3 - EXECUTION

### 3.1 REQUIRED SUBMITTALS

- A. Contractor shall submit the following information for materials and equipment to be provided under this contract.

<b>SPEC SECTION</b>	<b>TITLE</b>	<b>CATEGORY</b>
013100	Coordination	Shop Drawings
013100	Coordination	List of Subcontractors
013200	Schedules	Construction Schedule
013200	Schedules	Schedule of Values
013200	Schedules	List of Subcontractors
013200	Schedules	Major Material Suppliers
0131513.28	Site Security and Health Requirements	Certification
0131513.28	Site Security and Health Requirements	Construction Schedule
0131513.28	Site Security and Health Requirements	List of Subcontractors
024119	Selective Demolition	Certification
024119	Selective Demolition	Construction Schedule
024119	Selective Demolition	Warranty
024119	Selective Demolition	Operation / Maintenance Manual
033000	Cast-In-Place Concrete	Product Data
033000	Cast-In-Place Concrete	Shop Drawings
033000	Cast-In-Place Concrete	Sample
033000	Cast-In-Place Concrete	Test Report
042000	Unit Masonry	Product Data
042000	Unit Masonry	Shop Drawings
042000	Unit Masonry	Sample
042000	Unit Masonry	Certification
042000	Unit Masonry	Test Report
075423	Thermoplastic Polyolefin (TPO) Roofing	Product Data
075423	Thermoplastic Polyolefin (TPO) Roofing	Shop Drawings
075423	Thermoplastic Polyolefin (TPO) Roofing	Sample
075423	Thermoplastic Polyolefin (TPO) Roofing	Certification
075423	Thermoplastic Polyolefin (TPO) Roofing	Warranty
078413	Penetration Firestopping	Product Data
078413	Penetration Firestopping	Test Report
078413	Penetration Firestopping	Operation / Maintenance Manual
079200	Joint Sealants	Product Data
079200	Joint Sealants	Sample
081110	Hollow Metal Doors and Frames	Product Data
081110	Hollow Metal Doors and Frames	Shop Drawings
081110	Hollow Metal Doors and Frames	Warranty
082110	Flush Wood Doors	Product Data
082110	Flush Wood Doors	Shop Drawings
082110	Flush Wood Doors	Sample
082110	Flush Wood Doors	Warranty

<b>SPEC SECTION</b>	<b>TITLE</b>	<b>CATEGORY</b>
084113	Aluminum-Framed Entrances and Storefronts	Product Data
084113	Aluminum-Framed Entrances and Storefronts	Shop Drawings
084113	Aluminum-Framed Entrances and Storefronts	Operation / Maintenance Manual
084113	Aluminum-Framed Entrances and Storefronts	Warranty
085113	Aluminum Windows	Product Data
085113	Aluminum Windows	Shop Drawings
085113	Aluminum Windows	Operation / Maintenance Manual
085113	Aluminum Windows	Warranty
087100	Door Hardware	Shop Drawings
087100	Door Hardware	Warranty
088000	Glazing	Product Data
088000	Glazing	Test Report
088000	Glazing	Warranty
092116	Gypsum Board Assemblies	Product Data
092116	Gypsum Board Assemblies	Shop Drawings
092216	Non-Structural Metal Framing	Product Data
095113	Acoustical Ceilings	Shop Drawings
095113	Acoustical Ceilings	Product Data
095113	Acoustical Ceilings	Sample
095113	Acoustical Ceilings	Operation / Maintenance Manual
096200	Resinous Flooring	Product Data
096200	Resinous Flooring	Mock up
096200	Resinous Flooring	Sample
096200	Resinous Flooring	Warranty
096513	Resilient Wall Base and Accessories	Product Data
096513	Resilient Wall Base and Accessories	Sample
096813	Tile Carpeting	Product Data
096813	Tile Carpeting	Shop Drawings
096813	Tile Carpeting	Sample
096813	Tile Carpeting	Certification
096813	Tile Carpeting	Warranty
096850	Luxury Vinyl Tile	Product Data
096850	Luxury Vinyl Tile	Test Report
096850	Luxury Vinyl Tile	Sample
096850	Luxury Vinyl Tile	Certification
096850	Luxury Vinyl Tile	Warranty
099100	Painting	Product Data



<b>SPEC SECTION</b>	<b>TITLE</b>	<b>CATEGORY</b>
099100	Painting	Sample
099100	Painting	Operation / Maintenance Manual
101550	Toilet Compartments	Product Data
101550	Toilet Compartments	Shop Drawings
101550	Toilet Compartments	Sample
101550	Toilet Compartments	Certification
101550	Toilet Compartments	Warranty
102213	Wire Mesh Partitions	Product Data
102213	Wire Mesh Partitions	Shop Drawings
102213	Wire Mesh Partitions	Sample
102213	Wire Mesh Partitions	Operation / Maintenance Manual
102800	Toilet Accessories	Product Data
104310	Signs	Product Data
104310	Signs	Sample
122413	Roller Window Shades	Product Data
122413	Roller Window Shades	Shop Drawings
122413	Roller Window Shades	Sample
122413	Roller Window Shades	Operation / Maintenance Manual
122413	Roller Window Shades	Warranty
220500	Common Work Results for Plumbing	Product Data
220500	Common Work Results for Plumbing	Certification
220519	Meters and Gages for Plumbing Piping	Product Data
220519	Meters and Gages for Plumbing Piping	Operation / Maintenance Manual
220519	Meters and Gages for Plumbing Piping	Certification
220523	General Duty Valves for Plumbing Piping	Product Data
220529	Hangers and Supports for Plumbing Piping and Equipment	Product Data
220529	Hangers and Supports for Plumbing Piping and Equipment	Shop Drawings
220529	Hangers and Supports for Plumbing Piping and Equipment	Certification
220553	Identification for Plumbing Piping and Equipment	Product Data
220553	Identification for Plumbing Piping and Equipment	Sample
220553	Identification for Plumbing Piping and Equipment	Construction Schedule
220553	Identification for Plumbing Piping and Equipment	Operation / Maintenance Manual
220719	Plumbing Piping Insulation	Shop Drawings

<b>SPEC SECTION</b>	<b>TITLE</b>	<b>CATEGORY</b>
220719	Plumbing Piping Insulation	Product Data
221116	Domestic Water Piping	Product Data
221116	Domestic Water Piping	Test Report
221119	Domestic Water Piping Specialties	Product Data
221119	Domestic Water Piping Specialties	Shop Drawings
221119	Domestic Water Piping Specialties	Operation / Maintenance Manual
221119	Domestic Water Piping Specialties	Test Report
221123	Domestic Water Pumps	Product Data
221123	Domestic Water Pumps	Operation / Maintenance Manual
221316	Sanitary Waste and Vent Piping	Product Data
221316	Sanitary Waste and Vent Piping	Test Report
221319	Sanitary Waste Piping Specialties	Product Data
221319	Sanitary Waste Piping Specialties	Test Report
221319	Sanitary Waste Piping Specialties	Operation / Maintenance Manual
223400	Fuel-Fired Domestic Water Heaters	Product Data
223400	Fuel-Fired Domestic Water Heaters	Shop Drawings
223400	Fuel-Fired Domestic Water Heaters	Warranty
223400	Fuel-Fired Domestic Water Heaters	Operation / Maintenance Manual
224000	Plumbing Fixtures	Product Data
224000	Plumbing Fixtures	Shop Drawings
224000	Plumbing Fixtures	Operation / Maintenance Manual
224000	Plumbing Fixtures	Warranty
224700	Drinking Fountain/Water Coolers	Product Data
224700	Drinking Fountain/Water Coolers	Shop Drawings
224700	Drinking Fountain/Water Coolers	Test Report
224700	Drinking Fountain/Water Coolers	Operation / Maintenance Manual
230500	Common Work Results for HVAC	Product Data
230500	Common Work Results for HVAC	Certification
230529	Hangers and Supports for HVAC	Shop Drawings
230529	Hangers and Supports for HVAC	Product Data
230529	Hangers and Supports for HVAC	Certification
230553	HVAC Identification System	Product Data
230593	Testing, Adjusting, and Balancing for HVAC	Test Report
230593	Testing, Adjusting, and Balancing for HVAC	Sample
230713	Duct Insulation	Product Data
231123	Facility Natural-Gas Distribution	Product Data

<b>SPEC SECTION</b>	<b>TITLE</b>	<b>CATEGORY</b>
231123	Facility Natural-Gas Distribution	Shop Drawings
231123	Facility Natural-Gas Distribution	Test Report
231123	Facility Natural-Gas Distribution	Certification
231123	Facility Natural-Gas Distribution	Operation / Maintenance Manual
232300	Refrigerant Piping	Product Data
232300	Refrigerant Piping	Shop Drawings
232300	Refrigerant Piping	Test Report
232300	Refrigerant Piping	Operation / Maintenance Manual
233113	Metal Ducts	Product Data
233113	Metal Ducts	Shop Drawings
233300	Duct Accessories	Product Data
233300	Duct Accessories	Shop Drawings
233713	Diffusers, Registers, and Grilles	Product Data
235416	Gas-Fired Furnaces	Product Data
235416	Gas-Fired Furnaces	Shop Drawings
235416	Gas-Fired Furnaces	Warranty
235416	Gas-Fired Furnaces	Operation / Maintenance Manual
237413	Packaged Outdoor Central-Station Air Handling Units	Product Data
237413	Packaged Outdoor Central-Station Air Handling Units	Shop Drawings
238126	Split-System Air Conditioners	Product Data
238126	Split-System Air Conditioners	Shop Drawings
238126	Split-System Air Conditioners	Test Report
238126	Split-System Air Conditioners	Warranty
238126	Split-System Air Conditioners	Operation / Maintenance Manual
260500	Common Work Results for Electrical	Product Data
260519	Low-Voltage Electrical Power Conductors and Cables	Product Data
260519	Low-Voltage Electrical Power Conductors and Cables	Test Report
260523	Control Voltage Electrical Power Cables	Product Data
260523	Control Voltage Electrical Power Cables	Test Report
260523	Control Voltage Electrical Power Cables	Operation / Maintenance Manual
260526	Grounding and Bonding for Electrical Systems	Product Data
260526	Grounding and Bonding for Electrical Systems	Test Report

<b>SPEC SECTION</b>	<b>TITLE</b>	<b>CATEGORY</b>
260529	Hangers and Supports for Electrical Systems	Product Data
260529	Hangers and Supports for Electrical Systems	Shop Drawings
260529	Hangers and Supports for Electrical Systems	Certification
260533	Raceway and Boxes for Electrical Systems	Product Data
260533	Raceway and Boxes for Electrical Systems	Shop Drawings
260553	Identification for Electrical Systems	Product Data
260923	Lighting Control Devices	Product Data
260923	Lighting Control Devices	Test Report
260923	Lighting Control Devices	Operation / Maintenance Manual
262416	Panelboards	Product Data
262416	Panelboards	Shop Drawings
262416	Panelboards	Test Report
262416	Panelboards	Warranty
262416	Panelboards	Operation / Maintenance Manual
262726	Wiring Devices	Shop Drawings
262726	Wiring Devices	Product Data
262726	Wiring Devices	Operation / Maintenance Manual
263600	Transfer Switches	Product Data
263600	Transfer Switches	Shop Drawings
263600	Transfer Switches	Test Report
263600	Transfer Switches	Warranty
262416	Transfer Switches	Operation / Maintenance Manual
265119	LED Interior Lighting	Product Data
265119	LED Interior Lighting	Shop Drawings
265119	LED Interior Lighting	Certification
265119	LED Interior Lighting	Warranty
265119	LED Interior Lighting	Operation / Maintenance Manual
265619	LED Exterior Lighting	Product Data
265619	LED Exterior Lighting	Shop Drawings
265619	LED Exterior Lighting	Certification
265619	LED Exterior Lighting	Warranty
265619	LED Exterior Lighting	Operation / Maintenance Manual

<b>SPEC SECTION</b>	<b>TITLE</b>	<b>CATEGORY</b>
280500	Common Work Results for Electronic Safety and Security	Product Data
280513	Conductors and Cables for Electronic Safety and Security	Product Data
280513	Conductors and Cables for Electronic Safety and Security	Certification
280513	Conductors and Cables for Electronic Safety and Security	Test Report
280513	Conductors and Cables for Electronic Safety and Security	Operation / Maintenance Manual
283111	Digital, Addressable Fire-Alarm System	Product Data
283111	Digital, Addressable Fire-Alarm System	Shop Drawings
283111	Digital, Addressable Fire-Alarm System	Certification
283111	Digital, Addressable Fire-Alarm System	Operation / Maintenance Manual
311000	Site Clearing	As-Builts
321313	Concrete Paving	Product Data
321313	Concrete Paving	Test Report
321373	Concrete Paving Joint Sealant	Product Data
321373	Concrete Paving Joint Sealant	Sample
321373	Concrete Paving Joint Sealant	Certification
321373	Concrete Paving Joint Sealant	Test Report

END OF SECTION 013300

SECTION 013513.28 – SITE SECURITY AND HEALTH REQUIREMENTS (Veterans, State Fair, MONG)

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

1.2 SUBMITTALS

- A. List of required submittals:
  - 1. Materials Safety Data Sheets for all hazardous materials to be brought onsite.
  - 2. Schedule of proposed shutdowns, if applicable.
  - 3. A list of the names of all employees who will submit fingerprints for a background check, and the signed privacy documents identified below for each employee.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION

3.1 ACCESS TO THE SITE

- A. The Contractor shall arrange with Facility Representatives to establish procedures for the controlled entry of workers and materials into the work areas at the Facility.
- B. The Contractor shall establish regular working hours with Facility Representatives. The Contractor must report changes in working hours or overtime to Facility Representatives and obtain approval twenty-four (24) hours ahead of time. The Contractor shall report emergency overtime to Facility Representatives as soon as it is evident that overtime is needed. The Contractor must obtain approval from Facility Representatives for all work performed after dark.
- C. The Contractor shall provide the name and phone number of the Contractor's employee or agent who is in charge onsite; this individual must be able to be contacted in case of emergency. The Contractor must be able to furnish names and address of all employees upon request.
- D. All construction personnel shall visibly display issued identification cards.

3.2 FIRE PROTECTION, SAFETY, AND HEALTH CONTROLS

- A. The Contractor shall take all necessary precautions to guard against and eliminate possible fire hazards.
  - 1. Onsite burning is prohibited.
  - 2. The Contractor shall store all flammable or hazardous materials in proper containers located outside the buildings or offsite, if possible.
  - 3. The Contractor shall provide and maintain, in good order, during construction fire extinguishers as required by the National Fire Protection Association. In areas of

flammable liquids, asphalt, or electrical hazards, 15-pound carbon dioxide or 20-pound dry chemical extinguishers shall be provided.

- B. The Contractor shall not obstruct streets or walks without permission from the Owner's Construction Representative and Facility Representatives.
- C. The Contractor's personnel shall not exceed the speed limit of 15 mph while at the Facility unless otherwise posted.
- D. The Contractor shall take all necessary, reasonable measures to reduce air and water pollution by any material or equipment used during construction. The Contractor shall keep volatile wastes in covered containers, and shall not dispose of volatile wastes or oils in storm or sanitary drains.
- E. The Contractor shall keep the project site neat, orderly, and in a safe condition at all times. The Contractor shall immediately remove all hazardous waste, and shall not allow rubbish to accumulate. The Contractor shall provide onsite containers for collection of rubbish and shall dispose of it at frequent intervals during the progress of the Work.
- F. Fire exits, alarm systems, and sprinkler systems shall remain fully operational at all times, unless written approval is received from the Owner's Construction Representative and the appropriate Facility Representative at least twenty-four (24) hours in advance. The Contractor shall submit a written time schedule for any proposed shutdowns.
- G. For all hazardous materials brought onsite, Material Safety Data Sheets shall be on site and readily available upon request at least a day before delivery.
- H. Alcoholic beverages or illegal substances shall not be brought upon the Facility premises. The Contractor's workers shall not be under the influence of any intoxicating substances while on the Facility premises.

### 3.3 SECURITY CLEARANCES AND RESTRICTIONS

- A. FMDC REQUIRED FINGERPRINTING FOR CRIMINAL BACKGROUND AND WARRANTS CHECK
  - 1. All employees of the Contractor are required to submit fingerprints to the Missouri State Highway Patrol to enable the Office of Administration, Division of Facilities Management, Design and Construction (FMDC) to receive state and national criminal background checks on such employees. FMDC reserves the right to prohibit any employee of the Contractor from performing work in or on the premises of any facility owned, operated, or utilized by the State of Missouri for any reason.
  - 2. The Contractor shall ensure all of its employees submit fingerprints to the Missouri State Highway Patrol and pay for the cost of such background checks. The Contractor shall submit to FMDC via email to [FMDCSecurity@oa.mo.gov](mailto:FMDCSecurity@oa.mo.gov) a list of the names of the Contractor's employees who will be fingerprinted and a signed Missouri Applicant Fingerprint Privacy Notice, Applicant Privacy Rights and Privacy Act Statement for each employee. All employees of the Contractor approved by FMDC to work at a State facility must obtain a contractor ID badge from FMDC prior to beginning work on-site, unless the Director of FMDC, at the Director's discretion, waives the requirement for a contractor ID badge. The Contractor and its employees must comply with the process for background checks

and contractor ID badges found on FMDC's website at: <https://oa.mo.gov/fmdc-contractor-id-badges>.

3. Pursuant to section 43.540, RSMo, FMDC participates in the Missouri Rap Back and National Rap Back programs as of August 28, 2018. This means that the Missouri State Highway Patrol, Central Records Repository, and the Federal Bureau of Investigation will retain the fingerprints submitted by each of the Contractor's employees, and those fingerprints will be searched against other fingerprints on file, including latent fingerprints. While retained, an employee's fingerprints may continue to be compared against other fingerprints submitted or retained by the Federal Bureau of Investigation, including latent fingerprints.
4. As part of the Missouri and National Rap Back programs, FMDC will receive notification if a new arrest is reported for an employee whose fingerprints have been submitted for FMDC after August 28, 2018. If the employee is performing work on a State contract at the time of the arrest notification, FMDC will request and receive the employee's updated criminal history records. If the employee is no longer performing work on a State contract, FMDC will not obtain updated criminal records.
5. Pursuant to section 43.540, RSMo, the Missouri State Highway Patrol will provide the results of the employee's background check directly to FMDC. FMDC may NOT release the results of a background check to the Contractor or provide the Contractor any information obtained from a background check, either verbally or in writing. FMDC will notify the Contractor only whether an employee is approved to work on State property.
6. Each employee who submits fingerprints to the Missouri State Highway Patrol has a right to obtain a copy of the results of his or her background check. The employee may challenge the accuracy and completeness of the information contained in a background check report and obtain a determination from the Missouri State Highway Patrol and/or the FBI regarding the validity of such challenge prior to FMDC making a final decision about his or her eligibility to perform work under a State contract.
7. The Contractor shall notify FMDC via email to [FMDCSecurity@oa.mo.gov](mailto:FMDCSecurity@oa.mo.gov) if an employee is terminated or resigns from employment with the Contractor. If the Contractor does not anticipate performing work on a State contract in the future, the Contractor may request that FMDC remove its employees from the Rap Back programs. However, if removed from the Rap Back programs, employees will be required to submit new fingerprints should the contractor be awarded another State contract.
8. Upon award of a Contract, the Contractor should contact FMDC at [FMDCSecurity@oa.mo.gov](mailto:FMDCSecurity@oa.mo.gov) to determine if its employees need to provide a new background check. If a Contractor's employee has previously submitted a fingerprint background check to FMDC as part of the Missouri and National Rap Back programs, the employee may not need to submit another fingerprint search for a period of three to six years, depending upon the circumstances. The Contractor understands and agrees that FMDC may require more frequent background checks without providing any explanation to the Contractor. The fact that an additional background check is requested by FMDC does not indicate that the employee has a criminal record.



### 3.4 DISRUPTION OF UTILITIES

- A. The Contractor shall give a minimum of seventy-two (72) hours written notice to the Construction Representative and the Facility Representative before disconnecting electric, gas, water, fire protection, or sewer service to any building.
- B. The Contractor shall give a minimum of seventy-two (72) hours written notice to the Construction Representative and Facility Representative before closing any access drives, and shall make temporary access available, if possible. The Contractor shall not obstruct streets, walks, or parking.

END OF SECTION 013513.28

## SECTION 015000 – CONSTRUCTION FACILITIES AND TEMPORARY CONTROLS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes requirements for construction facilities and temporary controls including temporary utilities, support facilities, security, and protection.
- B. Temporary utilities include, but are not limited to, the following:
  - 1. Water service and distribution
  - 2. Temporary electric power and light
  - 3. Temporary heat
  - 4. Ventilation
  - 5. Telephone service
  - 6. Sanitary facilities, including drinking water
  - 7. Storm and sanitary sewer
- C. Support facilities include, but are not limited to, the following:
  - 1. Field offices and storage sheds
  - 2. Temporary roads and paving
  - 3. Dewatering facilities and drains
  - 4. Temporary enclosures
  - 5. Hoists and temporary elevator use
  - 6. Temporary project identification signs and bulletin boards
  - 7. Waste disposal services
  - 8. Rodent and pest control
  - 9. Construction aids and miscellaneous services and facilities
- D. Security and protection facilities include, but are not limited to, the following:
  - 1. Temporary fire protection
  - 2. Barricades, warning signs, and lights
  - 3. Sidewalk bridge or enclosure fence for the site
  - 4. Environmental protection

#### 1.3 SUBMITTALS

- A. Temporary Utilities: Submit reports of tests, inspections, meter readings, and similar procedures performed on temporary utilities.

- B. Implementation and Termination Schedule: Within (15) days of the date established for commencement of the Work, submit a schedule indicating implementation and termination of each temporary utility.

#### 1.4 QUALITY ASSURANCE

- A. Regulations: Comply with industry standards and applicable laws and regulations including, but not limited to, the following:
  - 1. Building code requirements
  - 2. Health and safety regulations
  - 3. Utility company regulations
  - 4. Police, fire department, and rescue squad rules
  - 5. Environmental protection regulations
- B. Standards: Comply with NFPA 241 “Standard for Safeguarding Construction, Alterations, and Demolition Operations”. ANSI A10 Series standards for “Safety Requirements for Construction and Demolition”, and NECA Electrical Design Library “Temporary Electrical Facilities”.
  - 1. Electrical Service: Comply with NEMA, NECA, and UL standards and regulations for temporary electric service. Install service in compliance with NFPA 70 “National Electric Code”.
- C. Inspections: Arrange for authorities having jurisdiction to inspect and test each temporary utility before use. Obtain required certifications and permits.

#### 1.5 PROJECT CONDITIONS

- A. Temporary Utilities: Prepare a schedule indicating dates for implementation and termination of each temporary utility. At the earliest feasible time, when acceptable to the Owner, change over from use of temporary service to use of permanent service.
- B. Conditions of Use: Keep temporary services and facilities clean and neat in appearance. Operate in a safe and efficient manner. Relocate temporary services and facilities as the Work progresses. Do not overload facilities or permit them to interfere with progress. Take necessary fire-prevention measures. Do not allow hazardous, dangerous, or unsanitary conditions, or public nuisances to develop or persist onsite.

### PART 2 - PRODUCTS

#### 2.1 MATERIALS

- A. General: Provide new materials. If acceptable to the Designer, the Contractor may use undamaged, previously used materials in serviceable condition. Provide materials suitable for use intended.
- B. Lumber and Plywood: Comply with requirements in Division 6 Section “Rough Carpentry”.
  - 1. For job-built temporary office, shops, and sheds within the construction area, provide UL-labeled, fire-treated lumber and plywood for framing, sheathing, and siding.

2. For signs and directory boards, provide exterior-type, Grade B-B high-density concrete form overlay plywood of sized and thicknesses indicated.
  3. For fences and vision barriers, provide minimum 3/9" (9.5mm) thick exterior plywood.
  4. For safety barriers, sidewalk bridges, and similar uses, provide minimum 5/8" (16mm) thick exterior plywood.
- C. Gypsum Wallboard: Provide gypsum wallboard on interior walls of temporary offices.
- D. Roofing Materials: Provide UL Class A standard-weight asphalt shingles or UL Class C mineral-surfaced roll roofing on roofs of job-built temporary office, shops, and shed.
- E. Paint: Comply with requirements of Division 9 Section "Painting".
1. For job-built temporary offices, shops, sheds, fences, and other exposed lumber and plywood, provide exterior-grade acrylic-latex emulsion over exterior primer.
  2. For sign panels and applying graphics, provide exterior-grade alkyd gloss enamel over exterior primer.
  3. For interior walls of temporary offices, provide two (2) quarts interior latex-flat wall paint.
- F. Tarpaulins: Provide waterproof, fire-resistant, UL-labeled tarpaulins with flame-spread rating of (15) or less. For temporary enclosures, provide translucent, nylon-reinforced laminated polyethylene or polyvinyl chloride, fire-retardant tarpaulins.
- G. Water: Provide potable water approved by local health authorities.
- H. Open-Mesh Fencing: Provide 0.120" (3mm) thick, galvanized 2" (50mm) chainlink fabric fencing 6' (2m) high with galvanized steel pipe posts, 1½" (38mm) ID for line posts and 2½" (64mm) ID for corner posts.

## 2.2 EQUIPMENT

- A. General: Provide new equipment. If acceptable to the Designer, the Contractor may use undamaged, previously used equipment in serviceable condition. Provide equipment suitable for use intended.
- B. Water Hoses: Provide ¾" (19mm), heavy-duty, abrasion-resistant, flexible rubber hoses 100' (30m) long, with pressure rating greater than the maximum pressure of the water distribution system. Provide adjustable shutoff nozzles at hose discharge.
- C. Electrical Outlets: Provide properly configured, NEMA-polarized outlets to prevent insertion of 110 to 120V plugs into higher voltage outlets. Provide receptacle outlets equipped with ground-fault circuit interrupters, reset button, and pilot light for connection of power tools and equipment.
- D. Electrical Power Cords: Provide grounded extension cords. Use hard-service cords where exposed to abrasion and traffic. Provide waterproof connectors to connect separate lengths of electric cords if single lengths will not reach areas where construction activities are in progress. Do not exceed safe length-voltage rating.

- E. Lamps and Light Fixtures: Provide general service incandescent lamps of wattage required for adequate illumination. Provide guard cages or tempered-glass enclosures where exposed to breakage. Provide exterior fixture where exposed to moisture.
- F. Heating Units: Provide temporary heating units that have been tested and labeled by UL, FM, or another recognized trade association related to the type of fuel being consumed.
- G. Temporary Offices: Provide prefabricated or mobile units or similar job-built construction with lockable entrances, operable windows, and serviceable finishes. Provide heated and air-conditioned units on foundations adequate for normal loading.
- H. Temporary Toilet Units: Provide self-contained, single-occupant toilet units of the chemical, aerated re-circulation, or combustion type. Provide units properly vented and fully enclosed with a glass-fiber-reinforced polyester shell or similar nonabsorbent material.
  - 1. Two (2) units for Contractor use.
  - 2. Four (4) units for owner use only. One (1) of which shall be ADA accessible.
- I. Fire Extinguishers: Provide hand-carried, portable, UL-rated, Class A fire extinguishers for temporary offices and similar spaces. In other locations, provide hand-carried, portable, UL-rated, Class ABC, dry-chemical extinguishers, or a combination of extinguishers of NFPA-recommended classes for the exposures.
  - 1. Comply with NFPA 10 and NFPA 241 for classification, extinguishing agent, and size required by location and class of fire exposure.

## PART 3 - EXECUTION

### 3.1 INSTALLATION

- A. Use qualified personnel for installation of temporary facilities. Locate facilities where they will serve the Project adequately and result in minimum interference with performance of the Work. Relocate and modify facilities as required.
- B. Provide each Facility ready for use when needed to avoid delay. Maintain and modify as required. Do not remove until facilities are no longer needed or are replaced by authorized use of completed permanent facilities.

### 3.2 TEMPORARY UTILITY INSTALLATION

- A. General: Engage the appropriate local utility company to install temporary service or connect to existing service. Where company provides only part of the service, provide the remainder with matching, compatible materials and equipment. Comply with company recommendations.
  - 1. Arrange with company and existing users for a time when service can be interrupted, if necessary, to make connections for temporary services.
  - 2. Provide adequate capacity at each stage of construction. Prior to temporary utility availability, provide trucked-in services.
  - 3. Obtain easements to bring temporary utilities to the site where the Owner's easements cannot be used for that purpose.

4. Use Charges: Cost or use charges for temporary facilities are not chargeable to the Owner or Designer. Neither the Owner nor Designer will accept cost or use charges as a basis of claims for Change Order.
- B. Temporary Water Service: The Owner will provide water for construction purposes from the existing building system. All required temporary extensions shall be provided and removed by the Contractor. Connection points and methods of connection shall be designated and approved by the Construction Representative.
- C. Temporary Electric Power Service: The Owner will provide electric power for construction lighting and power tools. Contractors using such services shall pay all costs of temporary services, circuits, outlet, extensions, etc.
- D. Temporary Lighting: When overhead floor or roof deck has been installed, provide temporary lighting with local switching.
  1. Install and operate temporary lighting that will fulfill security and protection requirements without operating the entire system. Provide temporary lighting that will provide adequate illumination for construction operations and traffic conditions.
- E. Temporary Heating and Cooling: The normal heating and/or cooling system of the building shall be maintained in operation during the construction. Should the Contractor find it necessary to interrupt the normal HVAC service to spaces, which have not been vacated for construction, such interruptions shall be pre-scheduled with the Construction Representative.
- F. Temporary Telephones: The Owner will provide telephones within the facility. All construction personnel will be allowed access only to those specific telephones designated by the Construction Representative.
- G. Temporary Toilets: Install self-contained toilet units. Use of pit-type privies will not be permitted. Comply with regulations and health codes for the type, number, location, operation, and maintenance of fixtures and facilities. Install where facilities will best serve the Project's needs.
  1. Shield toilets to ensure privacy.
  2. Provide separate facilities for male and female personnel.
  3. Provide toilet tissue materials for each facility.
- A. Temporary Toilets: Install self-contained toilet units. Use of pit-type privies will not be permitted. Comply with regulations and health codes for the type, number, location, operation, and maintenance of fixtures and facilities. Install where facilities will best serve the Project's needs.
  1. Shield toilets to ensure privacy.
  2. Provide separate facilities for male and female personnel.
  3. Provide toilet tissue materials for each facility.
- B. Wash Facilities: Install wash facilities supplied with potable water at convenient locations for personnel involved in handling materials that require wash-up for a health and sanitary condition. Dispose of drainage properly. Supply cleaning compounds appropriate for each condition.

1. Provide paper towels or similar disposable materials for each facility.
  2. Provide covered waste containers for used material.
  3. Provide safety showers, eyewash fountains, and similar facilities for convenience, safety, and sanitation of personnel.
- C. Drinking-Water Facilities: The Owner will provide drinking water facilities within the building. All construction personnel will be allowed access only to those specific facilities designated by the Construction Representative.
- D. Provide earthen embankments and similar barriers in and around excavations and subgrade construction, sufficient to prevent flooding by runoff of storm water from heavy rains.

### 3.3 SUPPORT FACILITIES INSTALLATION

- A. General: Locate field offices, storage sheds, and other temporary construction and support facilities for easy access.
1. Maintain support facilities until near Substantial Completion. Remove prior to Substantial Completion. Personnel remaining after Substantial Completion will be permitted to use permanent facilities, under conditions acceptable to the Owner.
- B. Storage Facilities: The Owner will provide storage onsite as designated by the Facility Representative or the Construction Representative. Areas for use by the Contractor for storage will be identified at the Pre-Bid Meeting.
- C. Construction Parking: Parking at the site will be provided in the areas designated at the Pre-Construction Meeting.
- D. Dewatering Facilities and Drains: For temporary drainage and dewatering facilities and operations not directly associated with construction activities included under individual Sections, comply with dewatering requirements of applicable Division 2 Sections. Where feasible, utilize the same facilities. Maintain the site, excavations, and construction free of water.
- E. Temporary Enclosures: Provide temporary enclosures for protection of construction, in progress and completed, from exposure, foul weather, other construction operations, and similar activities.
1. Where heat is needed and the permanent building enclosure is not complete, provide temporary enclosures where there is no other provision for containment of heat. Coordinate enclosure with ventilating and materials drying or curing requirements to avoid dangerous conditions and effects.
  2. Install tarpaulins securely with incombustible wood framing and other materials. Close openings of 25SqFt (2.3SqM) or less with plywood or similar materials.
  3. Close openings through floor or roof decks and horizontal surfaces with load-bearing, wood-framed construction.
  4. Where temporary wood or plywood enclosure exceeds 100SqFt (9.2SqM) in area, use UL-labeled, fire-retardant-treated material for framing and main sheathing.

- F. Temporary Lifts and Hoists: Provide facilities for hoisting materials and employees. Truck cranes and similar devices used for hoisting materials are considered “tools and equipment” and not temporary facilities.
- G. Temporary Exterior Lighting: Install exterior yard and sign lights so signs are visible when Work is being performed.
- H. Collection and Disposal of Waste: Collect waste from construction areas and elsewhere daily. Comply with requirements of NFPA 241 for removal of combustible waste material and debris. Enforce requirements strictly. Do not hold materials more than seven (7) days during normal weather or three (3) days when the temperature is expected to rise above 80°F (27°C). Handle hazardous, dangerous, or unsanitary waste materials separately from other waste by containerizing properly. Dispose of material lawfully.

### 3.4 SECURITY AND PROTECTION FACILITIES INSTALLATION

- A. Except for use of permanent fire protection as soon as available, do not change over from use of temporary security and protection facilities to permanent facilities until Substantial Completion, or longer, as requested by the Designer.
- B. Temporary Fire Protection: Until fire-protection needs are supplied by permanent facilities, install and maintain temporary fire-protection facilities of the types needed to protect against reasonable predictable and controllable fire losses. Comply with NFPA 10 “Standard for Portable Fire Extinguishers” and NFPA 241 “Standard for Safeguarding Construction, Alterations, and Demolition Operations”.
  - 1. Locate fire extinguishers where convenient and effective for their intended purpose, but not less than one (1) extinguisher on each floor at or near each usable stairwell.
  - 2. Store combustible materials in containers in fire-safe locations.
  - 3. Maintain unobstructed access to fire extinguishers, fire hydrants, temporary fire-protection facilities, stairways, and other access routes for fighting fires. Prohibit smoking in hazardous fire-exposure areas.
  - 4. Provide supervision of welding operations, combustion-type temporary heating units, and similar sources of fire ignition.
- C. Permanent Fire Protection: At the earliest feasible date in each area of the Project complete installation of the permanent fire-protection facility including connected services and place into operation and use. Instruct key personnel on use of facilities.
- D. Barricades, Warning Signs, and Lights: Comply with standards and code requirements for erection of structurally adequate barricades. Paint with appropriate colors, graphics, and warning signs to inform personnel and the public of the hazard being protected against. Where appropriate and needed, provide lighting including flashing red or amber lights.
- E. Enclosure Fence: Before excavation begins, install an enclosure fence with lockable entrance gates. Locate where indicated, or enclose the entire site or the portion determined sufficient to accommodate construction operations. Install in a manner that will prevent people, dogs, and other animals from easily entering the site, except by the entrance gates.
  - 1. Provide open-mesh, chainlink fencing with posts set in a compacted mixture of gravel and earth.



2. Provide plywood fence, 8' (2.5m) high, framed with (4) 2"x4" (50mm x 100mm) rails, and preservative-treated wood posts spaced not more than 8' (2.5m) apart.
- F. Security Enclosure and Lockup: Install substantial temporary enclosure of partially completed areas of construction. Provide locking entrances to prevent unauthorized entrance, vandalism, theft, and similar violations of security.
1. Storage: Where materials and equipment must be stored and are of value or attractive for theft, provide a secure lockup. Enforce discipline in connection with the installation and release of material to minimize the opportunity for theft and vandalism.
- G. Environmental Protection: Provide protection, operate temporary facilities, and conduct construction in ways and by methods that comply with environmental regulations and minimize the possibility that air, waterways, and subsoil might be contaminated or polluted or that other undesirable effects might result. Avoid use of tools and equipment that produce harmful noise. Restrict use of noisemaking tools and equipment to hours that will minimize complaints from persons or firms near the site.

### 3.5 OPERATION, TERMINATION AND REMOVAL

- A. Supervision: Enforce strict discipline in use of temporary facilities. Limit availability of temporary facilities to essential and intended uses to minimize waste and abuse.
- B. Maintenance: Maintain facilities in good operating condition until removal. Protect from damage by freezing temperatures and similar elements.
1. Maintain operation of temporary enclosures, heating, cooling, humidity control, ventilation, and similar facilities on a 24-hour basis where required to achieve indicated results and to avoid possibility of damage.
  2. Protection: Prevent water-filled piping from freezing. Maintain markers for underground lines. Protect from damage during excavation operations.
- C. Termination and Removal: Unless the Designer requests that it be maintained longer, remove each temporary facility when the need has ended, when replaced by authorized use of a permanent facility, or no later than Substantial Completion. Complete or, if necessary, restore permanent construction that may have been delayed because of interference with the temporary facility. Repair damaged Work, clean exposed surfaces, and replace construction that cannot be satisfactorily repaired.
1. Materials and facilities that constitute temporary facilities are the Contractor's property. The Owner reserves the right to take possession of project identification signs.
  2. Remove temporary paving not intended for or acceptable for integration into permanent paving. Where the area is intended for landscape development, remove soil and aggregate fill that do not comply with requirements for fill or subsoil in the area. Remove materials contaminated with road oil, asphalt and other petrochemical compounds, and other substances that might impair growth of plant materials or lawns. Repair or replace street paving, curbs, and sidewalks at the temporary entrances as required by the governing authority.
  3. At Substantial Completion, clean and renovate permanent facilities used during the construction period including, but not limited to, the following:
    - a. Replace air filters and clean inside of ductwork and housing.

- b. Replace significantly worn parts and parts subject to unusual operating conditions.
- c. Replace lamps burned out or noticeably dimmed by hours of use.

END OF SECTION 015000

## **SECTION 017400 – CLEANING**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes administrative and procedural requirements for cleaning during the Project.
- B. Environmental Requirements: Conduct cleaning and waste-disposal operations in compliance with local laws and ordinances. Comply fully with federal and local environmental and anti-pollution regulations.
  - 1. Do not dispose of volatile wastes such as mineral spirits, oil, or paint thinner in storm or sanitary drains.
  - 2. Burning or burying of debris, rubbish, or other waste material on the premises is not permitted.

### **PART 2 - PRODUCTS**

#### **2.1 MATERIALS**

- A. Cleaning Agents: Use cleaning materials and agents recommended by the manufacturer or fabricator for the surface to be cleaned. Do not use cleaning agents that are potentially hazardous to health or property or that might damage finished surfaces.

### **PART 3 - EXECUTION**

#### **3.1 PROGRESS CLEANING**

- A. General
  - 1. Retain all stored items in an orderly arrangement allowing maximum access, not impeding drainage or traffic, and providing the required protection of materials.
  - 2. Do not allow the accumulation of scrap, debris, waste material, and other items not required for construction of this Work.
  - 3. At least <once><twice> each month, and more often if necessary, completely remove all scrap, debris, and waste material from the jobsite.
  - 4. Provide adequate storage for all items awaiting removal from the jobsite, observing all requirements for fire protection and protection of the ecology.
- B. Site
  - 1. Daily, inspect the site and pick up all scrap, debris, and waste material. Remove all such items to the place designated for their storage.
  - 2. Weekly, inspect all arrangements of materials stored onsite. Re-stack, tidy, or otherwise service all material arrangements.

3. Maintain the site in a neat and orderly condition at all times.

C. Structures

1. Daily, inspect the structures and pick up all scrap, debris, and waste material. Remove all such items to the place designated for their storage.
2. Weekly, sweep all interior spaces clean. "Clean" for the purposes of this paragraph, shall be interpreted as meaning free from dust and other material capable of being removed by use of reasonable effort and handheld broom.
3. In preparation for installation of succeeding materials, clean the structures or pertinent portions thereof to the degree of cleanliness recommended by the manufacturer of the succeeding material, using all equipment and materials required to achieve the required cleanliness.
4. Following the installation of finish floor materials, clean the finish floor daily while work is being performed in the space in which finish materials have been installed. "Clean" for the purposes of this subparagraph, shall be interpreted as meaning free from all foreign material which, in the opinion of the Construction Representative, may be injurious to the finish of the finish floor material.

### 3.2 FINAL CLEANING

- A. General: Provide final cleaning operations when indicated. Employ experienced workers or professional cleaners for final cleaning. Clean each surface or unit of Work to the condition expected from a commercial building cleaning and maintenance program. Comply with manufacturer's instructions.
- B. Complete the following cleaning operations before requesting inspection for certification of Substantial Completion for the entire Project or a portion of the Project.
  1. Clean the Project Site, yard and grounds, in areas disturbed by construction activities including landscape development areas, of rubbish, waste material, litter, and foreign substances.
  2. Sweep paved areas broom clean. Rake grounds that are neither planted nor paved to a smooth, even-textured surface.
  3. Remove petrochemical spills, stains, and other foreign deposits.
  4. Remove tools, construction equipment, machinery, and surplus material from the site.
  5. Remove snow and ice to provide safe access to the building.
  6. Clean exposed exterior and interior hard-surfaced finishes to a dirt-free condition, free of stains, films, and similar foreign substances. Avoid disturbing natural weathering of exterior surfaces. Restore reflective surfaces to their original condition.
  7. Remove debris and surface dust from limited access spaces, including roofs, plenums, shafts, trenches, equipment vaults, manholes, attics, and similar spaces.
  8. Broom clean concrete floors in unoccupied spaces.
  9. Vacuum clean carpet and similar soft surfaces removing debris and excess nap. Shampoo, if required.
  10. Clean transparent material, including mirrors and glass in doors and windows. Remove glazing compounds and other substances that are noticeable vision-

obscuring materials. Replace chipped or broken glass and other damaged transparent materials. Polish mirrors and glass, taking care not to scratch surfaces.

11. Remove labels that are not permanent labels.
  12. Touch up and otherwise repair and restore marred, exposed finishes and surfaces. Replace finishes and surfaces that cannot be satisfactorily repaired or restored or that already show evidence of repair or restoration.
    - a. Do not paint over "UL" and similar labels, including mechanical and electrical nameplates.
  13. Wipe surfaces of mechanical and electrical equipment, elevator equipment, and similar equipment. Remove excess lubrication, paint and mortar droppings, and other foreign substances.
  14. Clean plumbing fixtures to a sanitary condition free of stains, including stains resulting from water exposure.
  15. Replace disposable air filters and clean permanent air filters. Clean exposed surfaces of diffusers, registers, and grills.
  16. Clean ducts, blowers, and coils if units were operated without filters during construction
  17. Clean food-service equipment to a sanitary condition, ready and acceptable for its intended use.
  18. Clean light fixtures, lamps, globes, and reflectors to function with full efficiency. Replace burned-out bulbs and defective and noisy starters in fluorescent and mercury vapor fixtures.
  19. Leave the Project clean and ready for occupancy.
- C. Pest Control: Engage an experienced, licensed exterminator to make a final inspection and rid the Project of rodents, insects, and other pests. Comply with regulations of local authorities.
- D. Removal of Protection: Remove temporary protection and facilities installed during construction to protect previously completed installations during the remainder of the construction period.
- E. Compliances: Comply with governing regulations and safety standards for cleaning operations. Remove waste materials from the site and dispose of lawfully.
1. Where extra materials of value remain after Final Acceptance by the Owner, they become the Owner's property.

**END OF SECTION 017400**

## SECTION 017419 - CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL

### PART 1 - GENERAL

#### 1.01 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.02 SUMMARY

- A. This Section includes administrative and procedural requirements for the following:
  - 1. Salvaging nonhazardous **demolition and construction** waste.
  - 2. Recycling nonhazardous **demolition and construction** waste.
  - 3. Disposing of nonhazardous **demolition and construction** waste.
- B. Related Sections include the following:
  - 1. Division 01 Section "Multiple Contract Summary" for coordination of responsibilities for waste management.
  - 2. Division 01 Section "Temporary Facilities and Controls" for environmental-protection measures during construction, **and location of waste containers at Project site.**
  - 3. Division 02 Section "Structure Demolition" for disposition of waste resulting from demolition of buildings, structures, and site improvements, **and for disposition of hazardous waste.**
  - 4. Division 02 Section "Selective Structure Demolition" for disposition of waste resulting from partial demolition of buildings, structures, and site improvements, **and for disposition of hazardous waste.**
  - 5. Division 04 Section "Unit Masonry" for disposal requirements for masonry waste.
  - 6. Division 04 Section "Stone Masonry" for disposal requirements for excess stone and stone waste.
  - 7. Division 31 Section "Site Clearing" for disposition of waste resulting from site clearing and removal of above- and below-grade improvements.

#### 1.03 DEFINITIONS

- A. Construction Waste: Building and site improvement materials and other solid waste resulting from construction, remodeling, renovation, or repair operations. Construction waste includes packaging.
- B. Demolition Waste: Building and site improvement materials resulting from demolition or selective demolition operations.

- C. Disposal: Removal off-site of demolition and construction waste and subsequent sale, recycling, reuse, or deposit in landfill or incinerator acceptable to authorities having jurisdiction.
- D. Recycle: Recovery of demolition or construction waste for subsequent processing in preparation for reuse.
- E. Salvage: Recovery of demolition or construction waste and subsequent sale or reuse in another facility.
- F. Salvage and Reuse: Recovery of demolition or construction waste and subsequent incorporation into the Work.

#### **1.04 QUALITY ASSURANCE**

- A. Waste Management Coordinator Qualifications: LEED Accredited Professional by U.S. Green Building Council. Waste management coordinator may also serve as LEED coordinator.
- B. Refrigerant Recovery Technician Qualifications: Certified by EPA-approved certification program.
- C. Regulatory Requirements: Comply with hauling and disposal regulations of federal, state, tribal and local authorities having jurisdiction.
- D. Waste Management Conference: Conduct conference at Project site to comply with requirements in Division 01 Section "Project Management and Coordination." Review methods and procedures related to waste management including, but not limited to, the following:
  1. Review and discuss waste management plan including responsibilities of Waste Management Coordinator.
  2. Review requirements for documenting quantities of each type of waste and its disposition.
  3. Review and finalize procedures for materials separation and verify availability of containers and bins needed to avoid delays.
  4. Review procedures for periodic waste collection and transportation to recycling and disposal facilities.
  5. Review waste management requirements for each trade.

#### **PART 2 - PRODUCTS (Not Used)**

#### **PART 3 - EXECUTION**

##### **3.01 DISPOSAL OF WASTE**

- A. General: Presidential Executive Order 13514 "Federal Leadership in Environmental, Energy, and Economic Performance", 8 October, 2009 requires the diversion of at least

50%, by weight of all construction and demolition materials and debris by the end of fiscal year 2015. Therefore, the contractor shall make all reasonable efforts to recycle and recover Construction and Demolition (C&D) waste from this project. Records shall be maintained to document the quantity of waste generated, the quantity of waste diverted through sale, reuse, or recycling, and the quantity of waste disposed of by landfill or incineration.

1. All records must be provided to the project manager upon project completion.
- B. Except for items or materials to be salvaged, recycled, or otherwise reused, remove waste materials from Project site and legally dispose of them in a landfill or incinerator acceptable to authorities having jurisdiction.
1. Except as otherwise specified, do not allow waste materials that are to be disposed of accumulate on-site.
  2. Remove and transport debris in a manner that will prevent spillage on adjacent surfaces and areas.
- C. Burning: Do not burn waste materials.
- D. Disposal: Transport waste materials off Owner's property and legally dispose of them.

**END OF SECTION 01 74 19**



## SECTION 017900 - DEMONSTRATION AND TRAINING

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section includes administrative and procedural requirements for instructing Owner's personnel, including the following:
  - 1. Demonstration of operation of systems, subsystems, and equipment.
  - 2. Training in operation and maintenance of systems, subsystems, and equipment.
  - 3. Demonstration and training video recordings.

#### 1.3 INFORMATIONAL SUBMITTALS

- A. Instruction Program: Submit outline of instructional program for demonstration and training, including a list of training modules and a schedule of proposed dates, times, length of instruction time, and instructors' names for each training module. Include learning objective and outline for each training module.
- B. Attendance Record: For each training module, submit list of participants and length of instruction time.
- C. Evaluations: For each participant and for each training module, submit results and documentation of performance-based test.

#### 1.4 CLOSEOUT SUBMITTALS

- A. Demonstration and Training Video Recordings: Submit two copies within seven days of end of each training module.
  - 1. Identification: On each copy, provide an applied label with the following information:
    - a. Name of Project.
    - b. Name and address of videographer.
    - c. Name of Architect.
    - d. Name of Construction Manager.
    - e. Name of Contractor.
    - f. Date of video recording.
  - 2. Transcript: Prepared in PDF electronic format. Include a cover sheet with same label information as the corresponding video recording and a table of contents with links to corresponding training components. Include name of Project and date of video recording on each page.

3. At completion of training, submit complete training manual(s) for Owner's use in PDF electronic file format on compact disc.

## 1.5 QUALITY ASSURANCE

- A. Facilitator Qualifications: A firm or individual experienced in training or educating maintenance personnel in a training program similar in content and extent to that indicated for this Project, and whose work has resulted in training or education with a record of successful learning performance.
- B. Instructor Qualifications: A factory-authorized service representative experienced in operation and maintenance procedures and training.
- C. Preinstruction Conference: Conduct conference at Project site to comply with requirements in Section 013100 "Coordination". Review methods and procedures related to demonstration and training including, but not limited to, the following:
  1. Inspect and discuss locations and other facilities required for instruction.
  2. Review and finalize instruction schedule and verify availability of educational materials, instructors' personnel, audiovisual equipment, and facilities needed to avoid delays.
  3. Review required content of instruction.
  4. For instruction that must occur outside, review weather and forecasted weather conditions and procedures to follow if conditions are unfavorable.

## 1.6 COORDINATION

- A. Coordinate instruction schedule with Owner's operations. Adjust schedule as required to minimize disrupting Owner's operations and to ensure availability of Owner's personnel.
- B. Coordinate instructors, including providing notification of dates, times, length of instruction time, and course content.
- C. Coordinate content of training modules with content of approved emergency, operation, and maintenance manuals. Do not submit instruction program until operation and maintenance data has been reviewed and approved by Architect.

## PART 2 - PRODUCTS

### 2.1 INSTRUCTION PROGRAM

- A. Program Structure: Develop an instruction program that includes individual training modules for each system and for equipment not part of a system, as required by individual Specification Sections.
- B. Training Modules: Develop a learning objective and teaching outline for each module. Include a description of specific skills and knowledge that participant is expected to master. For each module, include instruction for the following as applicable to the system, equipment, or component:
  1. Basis of System Design, Operational Requirements, and Criteria: Include the following:

- a. System, subsystem, and equipment descriptions.
  - b. Performance and design criteria if Contractor is delegated design responsibility.
  - c. Operating standards.
  - d. Regulatory requirements.
  - e. Equipment function.
  - f. Operating characteristics.
  - g. Limiting conditions.
  - h. Performance curves.
2. Documentation: Review the following items in detail:
- a. Emergency manuals.
  - b. Operations manuals.
  - c. Maintenance manuals.
  - d. Project record documents.
  - e. Identification systems.
  - f. Warranties and bonds.
  - g. Maintenance service agreements and similar continuing commitments.
3. Emergencies: Include the following, as applicable:
- a. Instructions on meaning of warnings, trouble indications, and error messages.
  - b. Instructions on stopping.
  - c. Shutdown instructions for each type of emergency.
  - d. Operating instructions for conditions outside of normal operating limits.
  - e. Sequences for electric or electronic systems.
  - f. Special operating instructions and procedures.
4. Operations: Include the following, as applicable:
- a. Startup procedures.
  - b. Equipment or system break-in procedures.
  - c. Routine and normal operating instructions.
  - d. Regulation and control procedures.
  - e. Control sequences.
  - f. Safety procedures.
  - g. Instructions on stopping.
  - h. Normal shutdown instructions.
  - i. Operating procedures for emergencies.
  - j. Operating procedures for system, subsystem, or equipment failure.
  - k. Seasonal and weekend operating instructions.
  - l. Required sequences for electric or electronic systems.
  - m. Special operating instructions and procedures.
5. Adjustments: Include the following:
- a. Alignments.
  - b. Checking adjustments.
  - c. Noise and vibration adjustments.
  - d. Economy and efficiency adjustments.

6. Troubleshooting: Include the following:
  - a. Diagnostic instructions.
  - b. Test and inspection procedures.
7. Maintenance: Include the following:
  - a. Inspection procedures.
  - b. Types of cleaning agents to be used and methods of cleaning.
  - c. List of cleaning agents and methods of cleaning detrimental to product.
  - d. Procedures for routine cleaning
  - e. Procedures for preventive maintenance.
  - f. Procedures for routine maintenance.
  - g. Instruction on use of special tools.
8. Repairs: Include the following:
  - a. Diagnosis instructions.
  - b. Repair instructions.
  - c. Disassembly; component removal, repair, and replacement; and reassembly instructions.
  - d. Instructions for identifying parts and components.
  - e. Review of spare parts needed for operation and maintenance.

## PART 3 - EXECUTION

### 3.1 PREPARATION

- A. Assemble educational materials necessary for instruction, including documentation and training module. Assemble training modules into a training manual organized in coordination with requirements in Section 007213 "General Conditions".
- B. Set up instructional equipment at instruction location.

### 3.2 INSTRUCTION

- A. Engage qualified instructors to instruct Owner's personnel to adjust, operate, and maintain systems, subsystems, and equipment not part of a system.
  1. Architect will furnish an instructor to describe basis of system design, operational requirements, criteria, and regulatory requirements.
  2. Owner will furnish an instructor to describe Owner's operational philosophy.
  3. Owner will furnish Contractor with names and positions of participants.
- B. Scheduling: Provide instruction at mutually agreed on times. For equipment that requires seasonal operation, provide similar instruction at start of each season.
  1. Schedule training with Owner with at least seven days' advance notice.

- C. Training Location and Reference Material: Conduct training on-site in the completed and fully operational facility using the actual equipment in-place. Conduct training using final operation and maintenance data submittals.
- D. Cleanup: Collect used and leftover educational materials and remove from Project site. Remove instructional equipment. Restore systems and equipment to condition existing before initial training use.

### 3.3 DEMONSTRATION AND TRAINING VIDEO RECORDINGS

- A. General: Engage a qualified commercial videographer to record demonstration and training video recordings. Record each training module separately. Include classroom instructions and demonstrations, board diagrams, and other visual aids, but not student practice.
  - 1. At beginning of each training module, record each chart containing learning objective and lesson outline.
- B. Video: Provide minimum 640 x 480 video resolution converted to format file type acceptable to Owner, on electronic media.
  - 1. Electronic Media: Read-only format compact disc acceptable to Owner, with commercial-grade graphic label.
  - 2. File Hierarchy: Organize folder structure and file locations according to project manual table of contents. Provide complete screen-based menu.
  - 3. File Names: Utilize file names based upon name of equipment generally described in video segment, as identified in Project specifications.
  - 4. Contractor and Installer Contact File: Using appropriate software, create a file for inclusion on the Equipment Demonstration and Training DVD that describes the following for each Contractor involved on the Project, arranged according to Project table of contents:
    - a. Name of Contractor/Installer.
    - b. Business address.
    - c. Business phone number.
    - d. Point of contact.
    - e. E-mail address.
- C. Recording: Mount camera on tripod before starting recording, unless otherwise necessary to adequately cover area of demonstration and training. Display continuous running time.
  - 1. Film training session(s) in segments not to exceed 15 minutes.
    - a. Produce segments to present a single significant piece of equipment per segment.
    - b. Organize segments with multiple pieces of equipment to follow order of Project Manual table of contents.
    - c. Where a training session on a particular piece of equipment exceeds 15 minutes, stop filming and pause training session. Begin training session again upon commencement of new filming segment.
- D. Light Levels: Verify light levels are adequate to properly light equipment. Verify equipment markings are clearly visible prior to recording.

1. Furnish additional portable lighting as required.
- E. Narration: Describe scenes on video recording by audio narration by microphone while video recording is recorded. Include description of items being viewed.
- F. Transcript: Provide a transcript of the narration. Display images and running time captured from videotape opposite the corresponding narration segment.
- G. Preproduced Video Recordings: Provide video recordings used as a component of training modules in same format as recordings of live training.

END OF SECTION 017900

## SECTION 024119 - SELECTIVE DEMOLITION

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:

1. Demolition and removal of selected portions of building or structure.
2. Demolition and removal of selected site elements.
3. Salvage of existing items to be reused or recycled.

- B. Related Requirements:

1. Section 011000 "Summary" for restrictions on use of the premises, Owner-occupancy requirements, and phasing requirements.

#### 1.3 DEFINITIONS

- A. Remove: Detach items from existing construction and dispose of them off-site unless indicated to be salvaged or reinstalled.
- B. Remove and Salvage: Detach items from existing construction, in a manner to prevent damage, and store.
- C. Remove and Reinstall: Detach items from existing construction, in a manner to prevent damage, prepare for reuse, and reinstall where indicated.
- D. Existing to Remain: Leave existing items that are not to be removed and that are not otherwise indicated to be salvaged or reinstalled.
- E. Dismantle: To remove by disassembling or detaching an item from a surface, using gentle methods and equipment to prevent damage to the item and surfaces; disposing of items unless indicated to be salvaged or reinstalled.

#### 1.4 MATERIALS OWNERSHIP

- A. Unless otherwise indicated, demolition waste becomes property of Contractor.
- B. Historic items, relics, antiques, and similar objects including, but not limited to, cornerstones and their contents, commemorative plaques and tablets, and other items of interest or value to Owner that may be uncovered during demolition remain the property of Owner.
  1. Carefully salvage in a manner to prevent damage and promptly return to Owner.

## 1.5 PREINSTALLATION MEETINGS

- A. Predemolition Conference: Conduct conference at Project site.
  - 1. Inspect and discuss condition of construction to be selectively demolished.
  - 2. Review structural load limitations of existing structure.
  - 3. Review and finalize selective demolition schedule and verify availability of materials, demolition personnel, equipment, and facilities needed to make progress and avoid delays.
  - 4. Review requirements of work performed by other trades that rely on substrates exposed by selective demolition operations.
  - 5. Review areas where existing construction is to remain and requires protection.

## 1.6 INFORMATIONAL SUBMITTALS

- A. Qualification Data: For refrigerant recovery technician.
- B. Schedule of Selective Demolition Activities: Indicate the following:
  - 1. Detailed sequence of selective demolition and removal work, with starting and ending dates for each activity. Ensure Owner's building manager's on-site operations are uninterrupted.
  - 2. Interruption of utility services. Indicate how long utility services will be interrupted.
  - 3. Coordination for shutoff, capping, and continuation of utility services.
  - 4. Use of elevator and stairs.
  - 5. Coordination of Owner's continuing occupancy of portions of existing building and of Owner's partial occupancy of completed Work.
- C. Statement of Refrigerant Recovery: Signed by refrigerant recovery technician responsible for recovering refrigerant, stating that all refrigerant that was present was recovered and that recovery was performed according to EPA regulations. Include name and address of technician and date refrigerant was recovered.
- D. Warranties: Documentation indicating that existing warranties are still in effect after completion of selective demolition.

## 1.7 CLOSEOUT SUBMITTALS

- A. Inventory: Submit a list of items that have been removed and salvaged.

## 1.8 QUALITY ASSURANCE

- A. Refrigerant Recovery Technician Qualifications: Certified by an EPA-approved certification program.

## 1.9 FIELD CONDITIONS

- A. Owner will occupy portions of building immediately adjacent to selective demolition area. Conduct selective demolition so Owner's operations will not be disrupted.



- B. Conditions existing at time of inspection for bidding purpose will be maintained by Owner as far as practical.
- C. Notify Architect of discrepancies between existing conditions and Drawings before proceeding with selective demolition.
- D. Hazardous Materials: It is not expected that hazardous materials will be encountered in the Work.
  - 1. Hazardous materials will be removed by Owner before start of the Work.
  - 2. If suspected hazardous materials are encountered, do not disturb; immediately notify Architect and Owner. Hazardous materials will be removed by Owner under a separate contract.
- E. Storage or sale of removed items or materials on-site is not permitted.
- F. Utility Service: Maintain existing utilities indicated to remain in service and protect them against damage during selective demolition operations.
  - 1. Maintain fire-protection facilities in service during selective demolition operations.

#### 1.10 WARRANTY

- A. Existing Warranties: Remove, replace, patch, and repair materials and surfaces cut or damaged during selective demolition, by methods and with materials and using approved contractors so as not to void existing warranties. Notify warrantor before proceeding.
- B. Notify warrantor on completion of selective demolition, and obtain documentation verifying that existing system has been inspected and warranty remains in effect. Submit documentation at Project closeout.

#### 1.11 COORDINATION

- A. Arrange selective demolition schedule so as not to interfere with Owner's operations.

### PART 2 - PRODUCTS

#### 2.1 PERFORMANCE REQUIREMENTS

- A. Regulatory Requirements: Comply with governing EPA notification regulations before beginning selective demolition. Comply with hauling and disposal regulations of authorities having jurisdiction.
- B. Standards: Comply with ASSE A10.6 and NFPA 241.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Verify that utilities have been disconnected and capped before starting selective demolition operations.
- B. Review Project Record Documents of existing construction or other existing condition and hazardous material information provided by Owner. Owner does not guarantee that existing conditions are same as those indicated in Project Record Documents.
- C. Verify that hazardous materials have been remediated before proceeding with building demolition operations.

### 3.2 PREPARATION

- A. Refrigerant: Before starting demolition, remove refrigerant from mechanical equipment according to 40 CFR 82 and regulations of authorities having jurisdiction.

### 3.3 UTILITY SERVICES AND MECHANICAL/ELECTRICAL SYSTEMS

- A. Existing Services/Systems to Remain: Maintain services/systems indicated to remain and protect them against damage.
- B. Existing Services/Systems to Be Removed, Relocated, or Abandoned: Locate, identify, disconnect, and seal or cap off utility services and mechanical/electrical systems serving areas to be selectively demolished.
  - 1. Arrange to shut off utilities with utility companies.
  - 2. If services/systems are required to be removed, relocated, or abandoned, provide temporary services/systems that bypass area of selective demolition and that maintain continuity of services/systems to other parts of building.
  - 3. Disconnect, demolish, and remove fire-suppression systems, plumbing, and HVAC systems, equipment, and components indicated on Drawings to be removed.
    - a. Piping to Be Removed: Remove portion of piping indicated to be removed and cap or plug remaining piping with same or compatible piping material.
    - b. Piping to Be Abandoned in Place: Drain piping and cap or plug piping with same or compatible piping material and leave in place.
    - c. Equipment to Be Removed: Disconnect and cap services and remove equipment.
    - d. Equipment to Be Removed and Reinstalled: Disconnect and cap services and remove, clean, and store equipment; when appropriate, reinstall, reconnect, and make equipment operational.
    - e. Equipment to Be Removed and Salvaged: Disconnect and cap services and remove equipment and deliver to Owner.
    - f. Ducts to Be Removed: Remove portion of ducts indicated to be removed and plug remaining ducts with same or compatible ductwork material.
    - g. Ducts to Be Abandoned in Place: Cap or plug ducts with same or compatible ductwork material and leave in place.

### 3.4 PROTECTION

- A. Temporary Protection: Provide temporary barricades and other protection required to prevent injury to people and damage to adjacent buildings and facilities to remain.
  - 1. Provide protection to ensure safe passage of people around selective demolition area and to and from occupied portions of building.
  - 2. Provide temporary weather protection, during interval between selective demolition of existing construction on exterior surfaces and new construction, to prevent water leakage and damage to structure and interior areas.
  - 3. Protect walls, ceilings, floors, and other existing finish work that are to remain or that are exposed during selective demolition operations.
  - 4. Cover and protect furniture, furnishings, and equipment that have not been removed.
  - 5. Comply with requirements for temporary enclosures, dust control, heating, and cooling specified in Section 015000 "Temporary Facilities and Controls."
- B. Temporary Shoring: Design, provide, and maintain shoring, bracing, and structural supports as required to preserve stability and prevent movement, settlement, or collapse of construction and finishes to remain, and to prevent unexpected or uncontrolled movement or collapse of construction being demolished.
  - 1. Strengthen or add new supports when required during progress of selective demolition.
- C. Remove temporary barricades and protections where hazards no longer exist.

### 3.5 SELECTIVE DEMOLITION, GENERAL

- A. General: Demolish and remove existing construction only to the extent required by new construction and as indicated. Use methods required to complete the Work within limitations of governing regulations and as follows:
  - 1. Proceed with selective demolition systematically, from higher to lower level. Complete selective demolition operations above each floor or tier before disturbing supporting members on the next lower level.
  - 2. Neatly cut openings and holes plumb, square, and true to dimensions required. Use cutting methods least likely to damage construction to remain or adjoining construction. Use hand tools or small power tools designed for sawing or grinding, not hammering and chopping. Temporarily cover openings to remain.
  - 3. Cut or drill from the exposed or finished side into concealed surfaces to avoid marring existing finished surfaces.
  - 4. Do not use cutting torches until work area is cleared of flammable materials. At concealed spaces, such as duct and pipe interiors, verify condition and contents of hidden space before starting flame-cutting operations. Maintain portable fire-suppression devices during flame-cutting operations.
  - 5. Maintain fire watch during and for at least 2 hours after flame-cutting operations.
  - 6. Maintain adequate ventilation when using cutting torches.
  - 7. Remove decayed, vermin-infested, or otherwise dangerous or unsuitable materials and promptly dispose of off-site.
  - 8. Remove structural framing members and lower to ground by method suitable to avoid free fall and to prevent ground impact or dust generation.
  - 9. Locate selective demolition equipment and remove debris and materials so as not to impose excessive loads on supporting walls, floors, or framing.

- B. Site Access and Temporary Controls: Conduct selective demolition and debris-removal operations to ensure minimum interference with roads, streets, walks, walkways, and other adjacent occupied and used facilities.

### 3.6 SELECTIVE DEMOLITION PROCEDURES FOR SPECIFIC MATERIALS

- A. Roofing: Remove no more existing roofing than what can be covered in one day by new roofing and so that building interior remains watertight and weathertight.
  - 1. Remove existing roof membrane, flashings, copings, and roof accessories.
  - 2. Remove existing roofing system down to substrate.

### 3.7 DISPOSAL OF DEMOLISHED MATERIALS

- A. Remove demolition waste materials from Project site and dispose of them in an EPA-approved construction and demolition waste landfill acceptable to authorities having jurisdiction.
  - 1. Do not allow demolished materials to accumulate on-site.
  - 2. Remove and transport debris in a manner that will prevent spillage on adjacent surfaces and areas.
  - 3. Remove debris from elevated portions of building by chute, hoist, or other device that will convey debris to grade level in a controlled descent.
- B. Burning: Do not burn demolished materials.

### 3.8 CLEANING

- A. Clean adjacent structures and improvements of dust, dirt, and debris caused by selective demolition operations. Return adjacent areas to condition existing before selective demolition operations began.

END OF SECTION 024119

## SECTION 03 30 00 - CAST-IN-PLACE CONCRETE

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. Section includes cast-in-place concrete, including formwork, reinforcement, concrete materials, mixture design, placement procedures, and finishes.

#### 1.2 DEFINITIONS

- A. Cementitious Materials: Portland cement alone or in combination with fly ash, subject to compliance with requirements.
- B. W/C Ratio: The ratio by weight of water to cementitious materials.

#### 1.3 SUBMITTALS

- A. Product Data: For each type of product.
- B. Design Mixtures: For each concrete mixture. Submit alternate design mixtures when characteristics of materials, Project conditions, weather, test results, or other circumstances warrant adjustments.
  - 1. Indicate amounts of mixing water to be withheld for later addition at Project site.
- C. Steel Reinforcement Shop Drawings: Placing Drawings that detail fabrication, bending, and placement. Include bar sizes, lengths, material, grade, bar schedules, stirrup spacing, bent bar diagrams, bar arrangement, splices and laps, mechanical connections, tie spacing, hoop spacing, and supports for concrete reinforcement.
- D. Field quality-control reports.

#### 1.4 DELIVERY, STORAGE, AND HANDLING

- A. Steel Reinforcement: Deliver, store, and handle steel reinforcement to prevent bending and damage.

#### 1.5 FIELD CONDITIONS

- A. Cold-Weather Placement: Comply with ACI 306.1 and as follows. Protect concrete work from physical damage or reduced strength that could be caused by frost, freezing actions, or low temperatures.
  - 1. When average high and low temperature is expected to fall below 40 deg F for three successive days, maintain delivered concrete mixture temperature within the temperature range required by ACI 301.

2. Do not use frozen materials or materials containing ice or snow. Do not place concrete on frozen subgrade or on subgrade containing frozen materials.
3. Do not use calcium chloride, salt, or other materials containing antifreeze agents or chemical accelerators unless otherwise specified and approved in mixture designs.

B. Hot-Weather Placement: Comply with ACI 301 and ACI 305.1, and as follows:

1. Maintain concrete temperature below 90 deg F at time of placement. Chilled mixing water or chopped ice may be used to control temperature, provided water equivalent of ice is calculated to total amount of mixing water. Using liquid nitrogen to cool concrete is Contractor's option.
2. Fog-spray forms, steel reinforcement, and subgrade just before placing concrete. Keep subgrade uniformly moist without standing water, soft spots, or dry areas.

## PART 2 - PRODUCTS

### 2.1 CONCRETE, GENERAL

- A. ACI Publications: Comply with the following unless modified by requirements in the Contract Documents:
1. ACI 301.
  2. ACI 117.

### 2.2 STEEL REINFORCEMENT

- A. Reinforcing Bars: ASTM A 615/A 615M, Grade 60, deformed.
- B. Low-Alloy-Steel Reinforcing Bars: ASTM A 706/A 706M, deformed.
- C. Plain-Steel Welded-Wire Reinforcement: ASTM A 1064/A 1064M, plain, fabricated from as-drawn steel wire into flat sheets.

### 2.3 REINFORCEMENT ACCESSORIES

- A. Joint Dowel Bars: ASTM A 615/A 615M, Grade 60, plain-steel bars, cut true to length with ends square and free of burrs.
- B. Bar Supports: Bolsters, chairs, spacers, and other devices for spacing, supporting, and fastening reinforcing bars and welded-wire reinforcement in place. Manufacture bar supports from steel wire, plastic, or precast concrete according to CRSI's "Manual of Standard Practice," of greater compressive strength than concrete and as follows:

### 2.4 CONCRETE MATERIALS

- A. Cementitious Materials:
1. Portland Cement: ASTM C 150/C 150M, Type I/II.
  2. Fly Ash: ASTM C 618, Class F or C.

- B. Normal-Weight Aggregates: ASTM C 33/C 33M, coarse aggregate or better, graded. Provide aggregates from a single source with documented service record data of at least 10 years' satisfactory service in similar applications and service conditions using similar aggregates and cementitious materials.
  - 1. Maximum Coarse-Aggregate Size: 1 inch nominal.
  - 2. Fine Aggregate: Free of materials with deleterious reactivity to alkali in cement.
- C. Air-Entraining Admixture: ASTM C 260/C 260M.
- D. Chemical Admixtures: Certified by manufacturer to be compatible with other admixtures and that do not contribute water-soluble chloride ions exceeding those permitted in hardened concrete. Do not use calcium chloride or admixtures containing calcium chloride.
  - 1. Water-Reducing Admixture: ASTM C 494/C 494M, Type A.
  - 2. Retarding Admixture: ASTM C 494/C 494M, Type B.
  - 3. Water-Reducing and Retarding Admixture: ASTM C 494/C 494M, Type D.
  - 4. High-Range, Water-Reducing Admixture: ASTM C 494/C 494M, Type F.
  - 5. High-Range, Water-Reducing and Retarding Admixture: ASTM C 494/C 494M, Type G.
  - 6. Plasticizing and Retarding Admixture: ASTM C 1017/C 1017M, Type II.
- E. Water: ASTM C 94/C 94M.

## 2.5 VAPOR RETARDERS

- A. Sheet Vapor Retarder: ASTM E 1745, Class A. Include manufacturer's recommended adhesive or pressure-sensitive tape.

## 2.6 CURING MATERIALS

- A. Evaporation Retarder: Waterborne, monomolecular film forming, manufactured for application to fresh concrete.
- B. Absorptive Cover: AASHTO M 182, Class 2, burlap cloth made from jute or kenaf, weighing approximately 9 oz./sq. yd. when dry.
- C. Moisture-Retaining Cover: ASTM C 171, polyethylene film or white burlap-polyethylene sheet.
- D. Water: Potable.
- E. Clear, Waterborne, Membrane-Forming Curing Compound: ASTM C 309, Type 1, Class B, non-dissipating, certified by curing compound manufacturer to not interfere with bonding of floor covering.
- F. Clear, Waterborne, Membrane-Forming Curing and Sealing Compound: ASTM C 1315, Type 1, Class A.

## 2.7 RELATED MATERIALS

- A. Expansion- and Isolation-Joint-Filler Strips: ASTM D 1751, asphalt-saturated cellulosic fiber or ASTM D 1752, cork or self-expanding cork.

- B. Semirigid Joint Filler: Two-component, semirigid, 100 percent solids, epoxy resin with a Type A shore durometer hardness of 80 or aromatic polyurea with a Type A shore durometer hardness range of 90 to 95 according to ASTM D 2240.
- C. Dovetail Anchor Slots: Hot-dip galvanized-steel sheet, not less than 0.034 inch thick, with bent tab anchors. Temporarily fill or cover face opening of slots to prevent intrusion of concrete or debris.
- D. Epoxy Bonding Adhesive: ASTM C 881, two-component epoxy resin, capable of humid curing and bonding to damp surfaces, of class suitable for application temperature and of grade to suit requirements, and as follows:
  - 1. Types IV and V, load bearing, for bonding hardened or freshly mixed concrete to hardened concrete.

## 2.8 REPAIR MATERIALS

- A. Repair Underlayment: Cement-based, polymer-modified, self-leveling product that can be applied in thicknesses from 1/8 inch and that can be feathered at edges to match adjacent floor elevations.
  - 1. Cement Binder: ASTM C 150/C 150M, portland cement or hydraulic or blended hydraulic cement as defined in ASTM C 219.
  - 2. Primer: Product of underlayment manufacturer recommended for substrate, conditions, and application.
  - 3. Aggregate: Well-graded, washed gravel, 1/8 to 1/4 inch or coarse sand as recommended by underlayment manufacturer.
  - 4. Compressive Strength: Not less than 4100 psi at 28 days when tested according to ASTM C 109/C 109M.
- B. Repair Overlayment: Cement-based, polymer-modified, self-leveling product that can be applied in thicknesses from 1/4 inch and that can be filled in over a scarified surface to match adjacent floor elevations.
  - 1. Cement Binder: ASTM C 150/C 150M, portland cement or hydraulic or blended hydraulic cement as defined in ASTM C 219.
  - 2. Primer: Product of topping manufacturer recommended for substrate, conditions, and application.
  - 3. Aggregate: Well-graded, washed gravel, 1/8 to 1/4 inch or coarse sand as recommended by topping manufacturer.
  - 4. Compressive Strength: Not less than 5000 psi at 28 days when tested according to ASTM C 109/C 109M.

## 2.9 CONCRETE MIXTURES, GENERAL

- A. Prepare design mixtures for each type and strength of concrete, proportioned on the basis of laboratory trial mixture or field test data, or both, according to ACI 301.
  - 1. Use a qualified independent testing agency for preparing and reporting proposed mixture designs based on laboratory trial mixtures.
- B. Cementitious Materials: Limit percentage, by weight, of cementitious materials other than portland cement in concrete as follows:



1. Fly Ash: 15 percent.
- C. Limit water-soluble, chloride-ion content in hardened concrete to 0.30 percent by weight of cement.
- D. Admixtures: Use admixtures according to manufacturer's written instructions.
1. Use water-reducing, high-range water-reducing, or plasticizing admixture in concrete, as required, for placement and workability.
  2. Use water-reducing and -retarding admixture when required by high temperatures, low humidity, or other adverse placement conditions.
  3. Use water-reducing admixture in pumped concrete, concrete for heavy-use industrial slabs and parking structure slabs, concrete required to be watertight, and concrete with a w/c ratio below 0.50.

## 2.10 CONCRETE MIXTURES FOR BUILDING ELEMENTS

A. Footings: Normal-weight concrete.

1. Minimum Compressive Strength: 4000 psi at 28 days.
2. Maximum W/C Ratio: 0.45.
3. Slump Limit: 4 inches, plus or minus 1 inch.
4. Air Content: 6 percent, plus or minus 1.5 percent at point of delivery for 1-inch nominal maximum aggregate size.

B. Foundation Walls: Normal-weight concrete.

1. Minimum Compressive Strength: 4000 psi at 28 days.
2. Maximum W/C Ratio: 0.45.
3. Slump Limit: 4 inches, plus or minus 1 inch.
4. Air Content: 6 percent, plus or minus 1.5 percent at point of delivery for 1-inch nominal maximum aggregate size.

C. Slabs-on-Grade: Normal-weight concrete.

1. Minimum Compressive Strength: 4000 psi at 28 days.
2. Maximum W/C Ratio: 0.45.
3. Minimum Cementitious Materials Content: 520 lb/cu. yd.
4. Slump Limit: 4 inches, plus or minus 1 inch.
5. Air Content: Do not allow air content of trowel-finished floors to exceed 3 percent.

## 2.11 FABRICATING REINFORCEMENT

- A. Fabricate steel reinforcement according to CRSI's "Manual of Standard Practice."

## 2.12 CONCRETE MIXING

- A. Ready-Mixed Concrete: Measure, batch, mix, and deliver concrete according to ASTM C 94/C 94M, and furnish batch ticket information.

1. When air temperature is between 85 and 90 deg F, reduce mixing and delivery time from 1-1/2 hours to 75 minutes; when air temperature is above 90 deg F, reduce mixing and delivery time to 60 minutes.

## PART 3 - EXECUTION

### 3.1 FORMWORK INSTALLATION

- A. Design, erect, shore, brace, and maintain formwork, according to ACI 301, to support vertical, lateral, static, and dynamic loads, and construction loads that might be applied, until structure can support such loads.
- B. Construct formwork so concrete members and structures are of size, shape, alignment, elevation, and position indicated, within tolerance limits of ACI 117.
- C. Limit concrete surface irregularities, designated by ACI 347 as abrupt or gradual, as follows:
  1. Class A, 1/8 inch for smooth-formed finished surfaces.
  2. Class C, 1/2 inch for rough-formed finished surfaces.
- D. Construct forms tight enough to prevent loss of concrete mortar.
- E. Construct forms for easy removal without hammering or prying against concrete surfaces. Provide crush or wrecking plates where stripping may damage cast-concrete surfaces. Provide top forms for inclined surfaces steeper than 1.5 horizontal to 1 vertical.
  1. Install keyways, recesses, and the like, for easy removal.
  2. Do not use rust-stained steel form-facing material.
- F. Set edge forms, bulkheads, and intermediate screed strips for slabs to achieve required elevations and slopes in finished concrete surfaces. Provide and secure units to support screed strips; use strike-off templates or compacting-type screeds.
- G. Provide temporary openings for cleanouts and inspection ports where interior area of formwork is inaccessible. Close openings with panels tightly fitted to forms and securely braced to prevent loss of concrete mortar. Locate temporary openings in forms at inconspicuous locations.
- H. Chamfer exterior corners and edges of permanently exposed concrete.
- I. Form openings, chases, offsets, sinkages, keyways, blocking, screeds, and bulkheads required in the Work. Determine sizes and locations from trades providing such items.
- J. Retighten forms and bracing before placing concrete, as required, to prevent mortar leaks and maintain proper alignment.
- K. Coat contact surfaces of forms with form-release agent, according to manufacturer's written instructions, before placing reinforcement.

### 3.2 EMBEDDED ITEM INSTALLATION

- A. Place and secure anchorage devices and other embedded items required for adjoining work that is attached to or supported by cast-in-place concrete. Use setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
  - 1. Install anchor rods, accurately located, to elevations required and complying with tolerances in Section 7.5 of AISC 303.
  - 2. Install dovetail anchor slots in concrete structures as indicated.

### 3.3 REMOVING AND REUSING FORMS

- A. General: Formwork for sides of beams, walls, columns, and similar parts of the Work that does not support weight of concrete may be removed after cumulatively curing at not less than 50 deg F for 24 hours after placing concrete. Concrete has to be hard enough to not be damaged by form-removal operations, and curing and protection operations need to be maintained.
- B. Clean and repair surfaces of forms to be reused in the Work. Split, frayed, delaminated, or otherwise damaged form-facing material are not acceptable for exposed surfaces. Apply new form-release agent.
- C. When forms are reused, clean surfaces, remove fins and laitance, and tighten to close joints. Align and secure joints to avoid offsets. Do not use patched forms for exposed concrete surfaces unless approved by Architect.

### 3.4 VAPOR-RETARDER INSTALLATION

- A. Sheet Vapor Retarders: Place, protect, and repair sheet vapor retarder according to ASTM E 1643 and manufacturer's written instructions.
  - 1. Lap joints 6 inches and seal with manufacturer's recommended tape.

### 3.5 STEEL REINFORCEMENT INSTALLATION

- A. General: Comply with CRSI's "Manual of Standard Practice" for fabricating, placing, and supporting reinforcement.
  - 1. Do not cut or puncture vapor retarder. Repair damage and reseal vapor retarder before placing concrete.
- B. Clean reinforcement of loose rust and mill scale, earth, ice, and other foreign materials that reduce bond to concrete.
- C. Accurately position, support, and secure reinforcement against displacement. Locate and support reinforcement with bar supports to maintain minimum concrete cover. Do not tack weld crossing reinforcing bars.
- D. Set wire ties with ends directed into concrete, not toward exposed concrete surfaces.
- E. Install welded-wire reinforcement in longest practicable lengths on bar supports spaced to minimize sagging. Lap edges and ends of adjoining sheets at least one mesh spacing. Offset laps of adjoining sheet widths to prevent continuous laps in either direction. Lace overlaps with wire.

### 3.6 JOINTS

- A. General: Construct joints true to line with faces perpendicular to surface plane of concrete.
- B. Construction Joints: Install so strength and appearance of concrete are not impaired, at locations indicated or as approved by Architect.
  - 1. Place joints perpendicular to main reinforcement. Continue reinforcement across construction joints unless otherwise indicated. Do not continue reinforcement through sides of strip placements of floors and slabs.
  - 2. Space vertical joints in walls as indicated. Locate joints beside piers integral with walls, near corners, and in concealed locations where possible.
  - 3. Use epoxy-bonding adhesive at locations where fresh concrete is placed against hardened or partially hardened concrete surfaces.
- C. Contraction Joints in Slabs-on-Grade: Form weakened-plane contraction joints, sectioning concrete into areas as indicated. Construct contraction joints for a depth equal to at least one-fourth of concrete thickness as follows:
  - 1. Grooved Joints: Form contraction joints after initial floating by grooving and finishing each edge of joint to a radius of 1/8 inch. Repeat grooving of contraction joints after applying surface finishes. Eliminate groover tool marks on concrete surfaces.
  - 2. Sawed Joints: Form contraction joints with power saws equipped with shatterproof abrasive or diamond-rimmed blades. Cut 1/8-inch-wide joints into concrete when cutting action does not tear, abrade, or otherwise damage surface and before concrete develops random contraction cracks.
- D. Isolation Joints in Slabs-on-Grade: After removing formwork, install joint-filler strips at slab junctions with vertical surfaces, such as column pedestals, foundation walls, grade beams, and other locations, as indicated.
  - 1. Terminate full-width joint-filler strips not less than 1/2 inch or more than 1 inch below finished concrete surface where joint sealants, specified in Section 079200 "Joint Sealants," are indicated.
  - 2. Install joint-filler strips in lengths as long as practicable. Where more than one length is required, lace or clip sections together.
- E. Doweled Joints: Install dowel bars and support assemblies at joints where indicated. Lubricate or asphalt coat one-half of dowel length to prevent concrete bonding to one side of joint.

### 3.7 CONCRETE PLACEMENT

- A. Before placing concrete, verify that installation of formwork, reinforcement, and embedded items is complete and that required inspections are completed.
- B. Before test sampling and placing concrete, water may be added at Project site, subject to limitations of ACI 301.
  - 1. Do not add water to concrete after adding high-range water-reducing admixtures to mixture.
- C. Deposit concrete continuously in one layer or in horizontal layers of such thickness that no new concrete is placed on concrete that has hardened enough to cause seams or planes of weakness. If a section cannot be placed continuously, provide construction joints as indicated. Deposit concrete to avoid segregation.

1. Deposit concrete in horizontal layers of depth not to exceed formwork design pressures and in a manner to avoid inclined construction joints.
  2. Consolidate placed concrete with mechanical vibrating equipment according to ACI 301.
  3. Do not use vibrators to transport concrete inside forms. Insert and withdraw vibrators vertically at uniformly spaced locations to rapidly penetrate placed layer and at least 6 inches into preceding layer. Do not insert vibrators into lower layers of concrete that have begun to lose plasticity. At each insertion, limit duration of vibration to time necessary to consolidate concrete and complete embedment of reinforcement and other embedded items without causing mixture constituents to segregate.
- D. Deposit and consolidate concrete for floors and slabs in a continuous operation, within limits of construction joints, until placement of a panel or section is complete.
1. Consolidate concrete during placement operations, so concrete is thoroughly worked around reinforcement and other embedded items and into corners.
  2. Maintain reinforcement in position on chairs during concrete placement.
  3. Screed slab surfaces with a straightedge and strike off to correct elevations.
  4. Slope surfaces uniformly to drains where required.
  5. Begin initial floating using bull floats or darbies to form a uniform and open-textured surface plane, before excess bleedwater appears on the surface. Do not further disturb slab surfaces before starting finishing operations.

### 3.8 FINISHING FORMED SURFACES

- A. Rough-Formed Finish: As-cast concrete texture imparted by form-facing material with tie holes and defects repaired and patched. Remove fins and other projections that exceed specified limits on formed-surface irregularities.
1. Apply to concrete surfaces not exposed to public view.
- B. Smooth-Formed Finish: As-cast concrete texture imparted by form-facing material, arranged in an orderly and symmetrical manner with a minimum of seams. Repair and patch tie holes and defects. Remove fins and other projections that exceed specified limits on formed-surface irregularities.
1. Apply to concrete surfaces exposed to public view, or to be covered with a coating or covering material applied directly to concrete.
- C. Related Unformed Surfaces: At tops of walls, horizontal offsets, and similar unformed surfaces adjacent to formed surfaces, strike off smooth and finish with a texture matching adjacent formed surfaces. Continue final surface treatment of formed surfaces uniformly across adjacent unformed surfaces unless otherwise indicated.

### 3.9 FINISHING FLOORS AND SLABS

- A. General: Comply with ACI 302.1R recommendations for screeding, restraighening, and finishing operations for concrete surfaces. Do not wet concrete surfaces.
- B. Float Finish: Consolidate surface with power-driven floats or by hand floating if area is small or inaccessible to power-driven floats. Restraighten, cut down high spots, and fill low spots. Repeat float passes and restraighening until surface is left with a uniform, smooth, granular texture.

1. Apply float finish to surfaces to receive trowel finish.
- C. Trowel Finish: After applying float finish, apply first troweling and consolidate concrete by hand or power-driven trowel. Continue troweling passes and restraighten until surface is free of trowel marks and uniform in texture and appearance. Grind smooth any surface defects that would telegraph through applied coatings or floor coverings.
1. Apply a trowel finish to surfaces exposed to view or to be covered with resilient flooring, carpet, and ceramic or quarry tile set over a cleavage membrane, paint, or another thin-film-finish coating system.
  2. Finish and measure surface, so gap at any point between concrete surface and an unveled, freestanding, 10-ft.- long straightedge resting on two high spots and placed anywhere on the surface does not exceed 1/8 inch.
- D. Trowel and Fine-Broom Finish: Apply a first trowel finish to surfaces indicated or where ceramic or quarry tile is to be installed by either thickset or thinset method. While concrete is still plastic, slightly scarify surface with a fine broom.
1. Comply with flatness and levelness tolerances for trowel-finished floor surfaces.
- E. Broom Finish: Apply a broom finish to exterior concrete platforms, steps, ramps, and elsewhere as indicated.
1. Immediately after float finishing, slightly roughen trafficked surface by brooming with fiber-bristle broom perpendicular to main traffic route. Coordinate required final finish with Architect before application.

### 3.10 MISCELLANEOUS CONCRETE ITEM INSTALLATION

- A. Filling In: Fill in holes and openings left in concrete structures after work of other trades is in place unless otherwise indicated. Mix, place, and cure concrete, as specified, to blend with in-place construction. Provide other miscellaneous concrete filling indicated or required to complete the Work.
- B. Equipment Bases and Foundations:
1. Coordinate sizes and locations of concrete bases with actual equipment provided.
  2. Construct concrete bases 4 inches high unless otherwise indicated, and extend base not less than 6 inches in each direction beyond the maximum dimensions of supported equipment unless otherwise indicated or unless required for seismic anchor support.
  3. Minimum Compressive Strength: 4000 psi at 28 days.
  4. Install dowel rods to connect concrete base to concrete floor. Unless otherwise indicated, install dowel rods on 18-inch centers around the full perimeter of concrete base.
  5. Prior to pouring concrete, place and secure anchorage devices. Use setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
  6. Cast anchor-bolt insert into bases. Install anchor bolts to elevations required for proper attachment to supported equipment.

### 3.11 CONCRETE PROTECTING AND CURING

- A. General: Protect freshly placed concrete from premature drying and excessive cold or hot temperatures. Comply with ACI 306.1 for cold-weather protection and ACI 305.1 for hot-weather protection during curing.
- B. Evaporation Retarder: Apply evaporation retarder to unformed concrete surfaces if hot, dry, or windy conditions cause moisture loss approaching 0.2 lb/sq. ft. x h before and during finishing operations. Apply according to manufacturer's written instructions after placing, screeding, and bull floating or darbying concrete, but before float finishing.
- C. Formed Surfaces: Cure formed concrete surfaces, including underside of beams, supported slabs, and other similar surfaces. If forms remain during curing period, moist cure after loosening forms. If removing forms before end of curing period, continue curing for remainder of curing period.
- D. Unformed Surfaces: Begin curing immediately after finishing concrete. Cure unformed surfaces, including floors and slabs, concrete floor toppings, and other surfaces.
- E. Cure concrete according to ACI 308.1, by one or a combination of the following methods:
  - 1. Moisture Curing: Keep surfaces continuously moist for not less than seven days with the following materials:
    - a. Water.
    - b. Continuous water-fog spray.
    - c. Absorptive cover, water saturated, and kept continuously wet. Cover concrete surfaces and edges with 12-inch lap over adjacent absorptive covers.
  - 2. Moisture-Retaining-Cover Curing: Cover concrete surfaces with moisture-retaining cover for curing concrete, placed in widest practicable width, with sides and ends lapped at least 12 inches, and sealed by waterproof tape or adhesive. Cure for not less than seven days. Immediately repair any holes or tears during curing period, using cover material and waterproof tape.
    - a. Cure concrete surfaces to receive floor coverings with either a moisture-retaining cover or a curing compound that the manufacturer certifies does not interfere with bonding of floor covering used on Project.
  - 3. Curing Compound: Apply uniformly in continuous operation by power spray or roller according to manufacturer's written instructions. Recoat areas subjected to heavy rainfall within three hours after initial application. Maintain continuity of coating and repair damage during curing period.
    - a. Removal: After curing period has elapsed, remove curing compound without damaging concrete surfaces by method recommended by curing compound manufacturer unless manufacturer certifies curing compound does not interfere with bonding of floor covering used on Project.
  - 4. Curing and Sealing Compound: Apply uniformly to floors and slabs indicated in a continuous operation by power spray or roller according to manufacturer's written instructions. Recoat areas subjected to heavy rainfall within three hours after initial application. Repeat process 24 hours later and apply a second coat. Maintain continuity of coating and repair damage during curing period.

### 3.12 JOINT FILLING

- A. Prepare, clean, and install joint filler according to manufacturer's written instructions.
  - 1. Defer joint filling until concrete has aged at least one month(s). Do not fill joints until construction traffic has permanently ceased.
- B. Remove dirt, debris, saw cuttings, curing compounds, and sealers from joints; leave contact faces of joints clean and dry.

### 3.13 CONCRETE SURFACE REPAIRS

- A. Defective Concrete: Repair and patch defective areas when approved by Architect. Remove and replace concrete that cannot be repaired and patched to Architect's approval.
- B. Patching Mortar: Mix dry-pack patching mortar, consisting of 1 part portland cement to 2-1/2 parts fine aggregate passing a No. 16 sieve, using only enough water for handling and placing.
- C. Repairing Formed Surfaces: Surface defects include color and texture irregularities, cracks, spalls, air bubbles, honeycombs, rock pockets, fins and other projections on the surface, and stains and other discolorations that cannot be removed by cleaning.
  - 1. Immediately after form removal, cut out honeycombs, rock pockets, and voids more than 1/2 inch in any dimension to solid concrete. Limit cut depth to 3/4 inch. Make edges of cuts perpendicular to concrete surface. Clean, dampen with water, and brush-coat holes and voids with bonding agent. Fill and compact with patching mortar before bonding agent has dried. Fill form-tie voids with patching mortar or cone plugs secured in place with bonding agent.
  - 2. Repair defects on surfaces exposed to view by blending white portland cement and standard portland cement so that, when dry, patching mortar matches surrounding color. Patch a test area at inconspicuous locations to verify mixture and color match before proceeding with patching. Compact mortar in place and strike off slightly higher than surrounding surface.
  - 3. Repair defects on concealed formed surfaces that affect concrete's durability and structural performance as determined by Architect.
- D. Repairing Unformed Surfaces: Test unformed surfaces, such as floors and slabs, for finish and verify surface tolerances specified for each surface. Correct low and high areas. Test surfaces sloped to drain for trueness of slope and smoothness; use a sloped template.
  - 1. Repair finished surfaces containing defects. Surface defects include spalls, popouts, honeycombs, rock pockets, crazing and cracks in excess of 0.01 inch wide or that penetrate to reinforcement or completely through unreinforced sections regardless of width, and other objectionable conditions.
  - 2. After concrete has cured at least 14 days, correct high areas by grinding.
  - 3. Correct localized low areas during or immediately after completing surface finishing operations by cutting out low areas and replacing with patching mortar. Finish repaired areas to blend into adjacent concrete.
  - 4. Correct other low areas scheduled to receive floor coverings with a repair underlayment. Prepare, mix, and apply repair underlayment and primer according to manufacturer's written instructions to produce a smooth, uniform, plane, and level surface. Feather edges to match adjacent floor elevations.
  - 5. Correct other low areas scheduled to remain exposed with a repair topping. Cut out low areas to ensure a minimum repair topping depth of 1/4 inch to match adjacent floor



- elevations. Prepare, mix, and apply repair topping and primer according to manufacturer's written instructions to produce a smooth, uniform, plane, and level surface.
6. Repair defective areas, except random cracks and single holes 1 inch or less in diameter, by cutting out and replacing with fresh concrete. Remove defective areas with clean, square cuts and expose steel reinforcement with at least a 3/4-inch clearance all around. Dampen concrete surfaces in contact with patching concrete and apply bonding agent. Mix patching concrete of same materials and mixture as original concrete, except without coarse aggregate. Place, compact, and finish to blend with adjacent finished concrete. Cure in same manner as adjacent concrete.
  7. Repair random cracks and single holes 1 inch or less in diameter with patching mortar. Groove top of cracks and cut out holes to sound concrete and clean off dust, dirt, and loose particles. Dampen cleaned concrete surfaces and apply bonding agent. Place patching mortar before bonding agent has dried. Compact patching mortar and finish to match adjacent concrete. Keep patched area continuously moist for at least 72 hours.
- E. Perform structural repairs of concrete, subject to Architect's approval, using epoxy adhesive and patching mortar.
- F. Repair materials and installation not specified above may be used, subject to Architect's approval.

### 3.14 FIELD QUALITY CONTROL

- A. Testing Agency: Engage a qualified testing and inspection agency to perform tests and inspections and to submit reports.
- B. Inspections:
1. Steel reinforcement placement.
- C. Concrete Tests: Testing of composite samples of fresh concrete obtained according to ASTM C 172/C 172M shall be performed according to the following requirements:
1. Testing Frequency: Obtain at least one composite sample for each 100 cu. yd. or fraction thereof of each concrete mixture placed each day.
    - a. When frequency of testing provides fewer than five compressive-strength tests for each concrete mixture, testing shall be conducted from at least five randomly selected batches or from each batch if fewer than five are used.
  2. Slump: ASTM C 143/C 143M; one test at point of placement for each composite sample, but not less than one test for each day's pour of each concrete mixture. Perform additional tests when concrete consistency appears to change.
  3. Air Content: ASTM C 231/C 231M, pressure method, for normal-weight concrete; one test for each composite sample, but not less than one test for each day's pour of each concrete mixture.
  4. Concrete Temperature: ASTM C 1064/C 1064M; one test hourly when air temperature is 40 deg F and below or 80 deg F and above, and one test for each composite sample.
  5. Compression Test Specimens: ASTM C 31/C 31M.
    - a. Cast and laboratory cure two sets of two standard cylinder specimens for each composite sample.
  6. Compressive-Strength Tests: ASTM C 39/C 39M; test one set of two laboratory-cured specimens at 7 days and one set of two specimens at 28 days.

- a. A compressive-strength test shall be the average compressive strength from a set of two specimens obtained from same composite sample and tested at age indicated.
7. When strength of field-cured cylinders is less than 85 percent of companion laboratory-cured cylinders, Contractor shall evaluate operations and provide corrective procedures for protecting and curing in-place concrete.
8. Strength of each concrete mixture will be satisfactory if every average of any three-consecutive compressive-strength tests equals or exceeds specified compressive strength and no compressive-strength test value falls below specified compressive strength by more than 500 psi.
9. Test results shall be reported in writing to Architect, concrete manufacturer, and Contractor within 48 hours of testing. Reports of compressive-strength tests shall contain Project identification name and number, date of concrete placement, name of concrete testing and inspecting agency, location of concrete batch in Work, design compressive strength at 28 days, concrete mixture proportions and materials, compressive breaking strength, and type of break for both 7- and 28-day tests.
10. Nondestructive Testing: Impact hammer, sonoscope, or other nondestructive device may be permitted by Architect but will not be used as sole basis for approval or rejection of concrete.
11. Additional Tests: Testing and inspecting agency shall make additional tests of concrete when test results indicate that slump, air entrainment, compressive strengths, or other requirements have not been met, as directed by Architect. Testing and inspecting agency may conduct tests to determine adequacy of concrete by cored cylinders complying with ASTM C 42/C 42M or by other methods as directed by Architect.
12. Additional testing and inspecting, at Contractor's expense, will be performed to determine compliance of replaced or additional work with specified requirements.
13. Correct deficiencies in the Work that test reports and inspections indicate do not comply with the Contract Documents.

END OF SECTION 03 30 00

## SECTION 042000 - UNIT MASONRY

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

##### A. Section Includes:

1. Concrete masonry units.
2. Face brick.
3. Thin Brick
4. Mortar and grout.
5. Steel reinforcing bars.
6. Masonry joint reinforcement.
7. Ties and anchors.
8. Embedded flashing.
9. Miscellaneous masonry accessories.
10. Cavity-wall insulation.

##### B. Related Sections:

1. Division 05 Section "Metal Fabrications" for furnishing steel lintels and shelf angles for unit masonry.
2. Division 07 Section "Water Repellents" for water repellents applied to unit masonry.

#### 1.3 DEFINITIONS

- A. CMU(s): Concrete masonry unit(s).
- B. Reinforced Masonry: Masonry containing reinforcing steel in grouted cells.

#### 1.4 PERFORMANCE REQUIREMENTS

- A. Provide structural unit masonry that develops indicated net-area compressive strengths at 28 days.
  1. Determine net-area compressive strength of masonry from average net-area compressive strengths
  2. of masonry units and mortar types (unit-strength method) according to Tables 1 and 2 in
  3. ACI 530.1/ASCE 6/TMS 602.
  4. Determine net-area compressive strength of masonry by testing masonry prisms according to
  5. ASTM C 1314.

#### 1.5 PRECONSTRUCTION TESTING

- A. Preconstruction Testing Service: Owner will engage a qualified independent testing agency to perform preconstruction testing indicated below. Retesting of materials that fail to comply with specified requirements shall be done at Contractor's expense.
  1. Concrete Masonry Unit Test: For each type of unit required, according to ASTM C 140 for
  2. compressive strength.
  3. Mortar Test (Property Specification): For each mix required, according to ASTM C 109/C 109M
  4. for compressive strength, ASTM C 1506 for water retention, and ASTM C 91 for air content.
  5. Mortar Test (Property Specification): For each mix required, according to ASTM C 780 for

6. compressive strength.
7. Grout Test (Compressive Strength): For each mix required, according to ASTM C 1019.
8. Prism Test: For each type of construction required, according to ASTM C 1314.

## 1.6 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: For the following:
  1. Masonry Units: Show sizes, profiles, coursing, and locations of special shapes..
  2. Reinforcing Steel: Detail bending and placement of unit masonry reinforcing bars. Comply with ACI 315, "Details and Detailing of Concrete Reinforcement."
  3. Fabricated Flashing: Detail corner units, end-dam units, and other special applications.
- C. Samples for Initial Selection:
  1. Face brick.
  2. Colored mortar
- D. Samples for Verification: For each type and color of the following:
  1. Submit actual samples of brick from the plant to be used on this project, along with verification that adequate quantities of same brick is available to complete the project.
  2. Colored mortar
- E. List of Materials Used in Constructing Mockups: List generic product names together with manufacturers, manufacturers' product names, model numbers, lot numbers, batch numbers, source of supply, and other information as required to identify materials used. Include mix proportions for mortar and grout and source of aggregates.
  - a. Submittal is for information only. Neither receipt of list nor approval of mockup constitutes approval of deviations from the Contract Documents unless such deviations are specifically brought to the attention of Architect and approved in writing.
- F. Material Certificates: For each type and size of the following:
  1. Masonry units.
    - a. Include data on material properties.
    - b. For exposed brick, include test report for efflorescence according to ASTM C 67.
    - c. For masonry units used in structural masonry, include data and calculations establishing average net-area compressive strength of units.
  2. Cementitious materials. Include brand, type, and name of manufacturer.
  3. Preblended, dry mortar mixes. Include description of type and proportions of ingredients.
  4. Grout mixes. Include description of type and proportions of ingredients.
  5. Reinforcing bars.
  6. Joint reinforcement.
  7. Anchors, ties, and metal accessories.
- G. Mix Designs: For each type of mortar and grout. Include description of type and proportions of ingredients.
  1. Include test reports for mortar mixes required to comply with property specification. Test
  2. according to ASTM C 109/C 109M for compressive strength, ASTM C 1506 for water retention, and ASTM C 91 for air content.
  3. Include test reports, according to ASTM C 1019, for grout mixes required to comply with compressive strength requirement.
- H. Statement of Compressive Strength of Masonry: For each combination of masonry unit type and mortar type, provide statement of average net-area compressive strength of masonry units, mortar type, and resulting net-area compressive strength of masonry determined according to Tables 1 and 2 in ACI 530.1/ASCE 6/TMS 602.
- I. Cold-Weather and Hot-Weather Procedures: Detailed description of methods, materials, and equipment to be used to comply with requirements.

## 1.7 QUALITY ASSURANCE

- A. Source Limitations for Masonry Units: Obtain exposed masonry units of a uniform texture and color, or a uniform blend within the ranges accepted for these characteristics, from single source from single manufacturer for each product required.
- B. Source Limitations for Mortar Materials: Obtain mortar ingredients of a uniform quality, including color for exposed masonry, from single manufacturer for each cementitious component and from single source or producer for each aggregate.
- C. Masonry Standard: Comply with ACI 530.1/ASCE 6/TMS 602 unless modified by requirements in the Contract Documents.
- D. Mockups: Build mockups to verify selections made under sample submittals and to demonstrate aesthetic effects and set quality standards for materials and execution.
  - 1. Build mockups for typical exterior wall 72 inches by 72 inches high by full thickness, including face and backup wythes and accessories.
    - a. Include a sealant-filled joint at least 16 inches long in each mockup.
    - b. Include metal studs, sheathing, air barrier, veneer anchors, flashing, cavity drainage material, and weep holes in exterior masonry-veneer wall mockup.
  - 2. Clean one-half of exposed faces of mockups with masonry cleaner as indicated.
  - 3. Protect accepted mockups from the elements with weather-resistant membrane.
  - 4. Approval of mockups is for color, texture, and blending of masonry units; relationship of mortar and sealant colors to masonry unit colors; tooling of joints; and aesthetic qualities of workmanship. If desired results are not achieved with mock up panel Contractor may be required to construct multiple mockup panels with varying materials until desired results are achieved.
    - a. Approval of mockups is also for other material and construction qualities specifically approved by Architect in writing.
    - b. Approval of mockups does not constitute approval of deviations from the Contract Documents contained in mockups unless such deviations are specifically approved by Architect in writing.
  - 5. Approved mockups may become part of the completed Work if undisturbed at time of Substantial Completion.
- E. Preinstallation Conference: Conduct conference at Project site to comply with requirements in Division 01 Section "Project Management and Coordination."

## 1.8 DELIVERY, STORAGE, AND HANDLING

- A. Store masonry units on elevated platforms in a dry location. If units are not stored in an enclosed location, cover tops and sides of stacks with waterproof sheeting, securely tied. If units become wet, do not install until they are dry.
- B. Store cementitious materials on elevated platforms, under cover, and in a dry location. Do not use cementitious materials that have become damp.
- C. Store aggregates where grading and other required characteristics can be maintained and contamination avoided.
- D. Deliver preblended, dry mortar mix in moisture-resistant containers designed for use with dispensing silos. Store preblended, dry mortar mix in delivery containers on elevated platforms, under cover, and in a dry location or in covered weatherproof dispensing silos.
- E. Store masonry accessories, including metal items, to prevent corrosion and accumulation of dirt and oil.

## 1.9 PROJECT CONDITIONS

- A. Stain Prevention: Prevent grout, mortar, and soil from staining the face of masonry to be left exposed or painted. Immediately remove grout, mortar, and soil that come in contact with such masonry.
  - 1. Protect base of walls from rain-splashed mud and from mortar splatter by spreading coverings on ground and over wall surface.

2. Protect sills, ledges, and projections from mortar droppings.
  3. Protect surfaces of window and door frames, as well as similar products with painted and integral finishes, from mortar droppings.
  4. Turn scaffold boards near the wall on edge at the end of each day to prevent rain from splashing mortar and dirt onto completed masonry.
- B. Hot-Weather Requirements: Comply with hot-weather construction requirements contained in ACI 530.1/ASCE 6/TMS 602.
- C. Protect unit masonry work when temperature and humidity conditions produce excessive evaporation of water from mortar and grout. Provide artificial shade and wind breaks and use cooled materials as required. Do not apply mortar to substrates with temperatures of 100 deg F and above.

## PART 2 - PRODUCTS

### 2.1 MASONRY UNITS, GENERAL

- A. Defective Units: Referenced masonry unit standards may allow a certain percentage of units to contain chips, cracks, or other defects exceeding limits stated in the standard. Do not use units where such defects will be exposed in the completed Work.
- B. Fire-Resistance Ratings: Where indicated, provide units that comply with requirements for fire-resistance ratings indicated as determined by testing according to ASTM E 119, by equivalent masonry thickness, or by other means, as acceptable to authorities having jurisdiction.

### 2.2 CONCRETE MASONRY UNITS

- A. Regional Materials: Provide CMUs that have been manufactured within 500 miles of Project site from aggregates that have been extracted, harvested, or recovered, as well as manufactured, within 500 miles of Project site.
- B. Shapes: Provide shapes indicated and as follows, with exposed surfaces matching exposed faces of adjacent units unless otherwise indicated.
1. Provide square-edged units for outside corners unless otherwise indicated.
- C. CMUs: ASTM C 90.
1. Unit Compressive Strength: Provide units with minimum average net-area compressive strength of 2800 psi.
  2. Density Classification: Normal weight (unless otherwise indicated)
  3. Size (Width): Manufactured to dimensions 3/8 inch less than nominal dimensions.
- D. SCHEDULE OF CMU TYPES:
1. Typical CMU: 4" x 8" x 16", 6" x 8" x 16" and 8"x8"x 16"

### 2.3 MASONRY LINTELS

- A. Masonry Lintels: Prefabricated or built-in-place masonry lintels made from bond beam CMUs with reinforcing bars placed as indicated and filled with coarse grout. Cure precast lintels before handling and installing. Temporarily support built-in-place lintels until cured.

### 2.4 MORTAR AND GROUT MATERIALS

- A. Regional Materials: Provide aggregate for mortar and grout that have been extracted, harvested, or recovered, as well as manufactured, within 500 miles of Project site.
- B. Portland Cement: ASTM C 150, Type I or II, except Type III may be used for cold-weather construction. Provide natural color.
- C. Hydrated Lime: ASTM C 207, Type S.
- D. Portland Cement-Lime Mix: Packaged blend of portland cement and hydrated lime containing no other ingredients.
- E. Masonry Cement: ASTM C 91.
1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Capital Materials Corporation; Flamingo Color Masonry Cement.

- b. Cemex S.A.B. de C.V.; Brikset Type N, Citadel Type S, Dixie Type S, Kosmortar Type N, Richmortar, Victor Plastic Cement.
  - c. Holcim (US) Inc.; Mortamix Masonry Cement, Rainbow Mortamix Custom Buff Masonry Cement.
  - d. Lafarge North America Inc.; Magnolia Masonry Cement, Lafarge Masonry Cement, Trinity White Masonry Cement.
  - e. Lehigh Cement Company; Lehigh Masonry Cement, Lehigh White Masonry Cement.
  - f. National Cement Company, Inc.; Coosa Masonry Cement.
- F. Mortar Cement: ASTM C 1329.
- 1. Products: Subject to compliance with requirements, provide the following
    - a. Lafarge North America Inc.; Lafarge Mortar Cement or Magnolia Superbond Mortar Cement.
- G. Mortar Pigments: Natural and synthetic iron oxides and chromium oxides, compounded for use in mortar mixes and complying with ASTM C 979. Use only pigments with a record of satisfactory performance in masonry mortar.
- 1. Products: Subject to compliance with requirements available products that may be incorporated into the Work include, but are not limited to, the following:
    - a. Davis Colors; True Tone Mortar Colors.
    - b. Lanxess Corporation; Bayferrox Iron Oxide Pigments.
    - c. Solomon Colors, Inc.; SGS Mortar Colors.
- H. Colored Cement Product: Packaged blend made from masonry cement or mortar cement and mortar pigments, all complying with specified requirements, and containing no other ingredients.
- 1. Products: Subject to compliance with requirements, provide one of the following products:
    - a. Colored Portland Cement-Lime Mix:
      - 1) Capital Materials Corporation; Riverton Portland Cement Lime Custom Color.
      - 2) Holcim (US) Inc.; Rainbow Mortamix Custom Color Cement/Lime.
      - 3) Lafarge North America Inc.; Eaglebond Portland & Lime.
      - 4) Lehigh Cement Company; Lehigh Custom Color Portland/Lime Cement.
  - 2. Products: Subject to compliance with requirements, provide one of the following products:
    - a. Colored Masonry Cement:
      - 1) Capital Materials Corporation; Flamingo Color Masonry Cement.
      - 2) Cemex S.A.B. de C.V.; Richcolor Masonry Cement.
      - 3) Essroc, Italcementi Group; Brixment-in-Color.
      - 4) Holcim (US) Inc.; Rainbow Mortamix Custom Color Masonry Cement.
      - 5) Lafarge North America Inc.; U.S. Cement Custom Color Masonry Cement.
      - 6) Lehigh Cement Company; Lehigh Custom Color Masonry Cement.
      - 7) National Cement Company, Inc.; Coosa Masonry Cement.
  - 3. Formulate blend as required to produce color indicated or, if not indicated, as selected from manufacturer's standard colors.
  - 4. Pigments shall not exceed 10 percent of portland cement by weight.
  - 5. Pigments shall not exceed 5 percent of masonry cement or mortar cement by weight.
- I. Aggregate for Mortar: ASTM C 144.
- 1. For mortar that is exposed to view, use washed aggregate consisting of natural sand or crushed stone.
  - 2. For joints less than 1/4 inch thick, use aggregate graded with 100 percent passing the No. 16 sieve.
  - 3. Colored-Mortar Aggregates: Natural sand or crushed stone of color necessary to produce required mortar color.
- J. Aggregate for Grout: ASTM C 404.

- K. Epoxy Pointing Mortar: ASTM C 395, epoxy-resin-based material formulated for use as pointing mortar for structural-clay tile facing units (and approved for such use by manufacturer of units); in color indicated or, if not otherwise indicated, as selected by Architect from manufacturer's colors.
- L. Cold-Weather Admixture: Nonchloride, noncorrosive, accelerating admixture complying with ASTM C 494/C 494M, Type C, and recommended by manufacturer for use in masonry mortar of composition indicated.
  - 1. Products: Subject to compliance with requirements available products that may be incorporated into the Work include, but are not limited to, the following:
    - a. Euclid Chemical Company (The); Accelguard 80.
    - b. Grace Construction Products, W. R. Grace & Co. - Conn.; Morset.
    - c. Sonneborn Products, BASF Aktiengesellschaft; Trimix-NCA.
- M. Water-Repellent Admixture: Liquid water-repellent mortar admixture intended for use with CMUs containing integral water repellent by same manufacturer.
  - 1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
    - a. ACM Chemistries; RainBloc for Mortar.
    - b. BASF Aktiengesellschaft; Rheopel Mortar Admixture.
    - c. Grace Construction Products, W. R. Grace & Co. - Conn.; Dry-Block Mortar Admixture.
- N. Water: Potable.

## 2.5 REINFORCEMENT

- A. Uncoated Steel Reinforcing Bars: ASTM A 615/A 615M or ASTM A 996/A 996M, Grade 60.
- B. Masonry Joint Reinforcement, General: ASTM A 951/A 951M.
  - 1. Interior Walls: Hot-dip galvanized, carbon steel.
  - 2. Exterior Walls: Hot-dip galvanized, carbon steel.
  - 3. Wire Size for Side Rods: 0.148-inch diameter.
  - 4. Wire Size for Cross Rods: 0.148-inch diameter.
  - 5. Wire Size for Veneer Ties: 0.148-inch diameter.
  - 6. Spacing of Cross Rods, Tabs, and Cross Ties: Not more than 16 inches o.c.
  - 7. Provide in lengths of not less than 10 feet, with prefabricated corner and tee units.
- C. Masonry Joint Reinforcement for Single-Wythe Masonry: Either ladder or truss type with single pair of side rods.

## 2.6 TIES AND ANCHORS

- A. Materials: Provide ties and anchors specified in this article that are made from materials that comply with the following unless otherwise indicated.
  - 1. Mill-Galvanized, Carbon-Steel Wire: ASTM A 82/A 82M; with ASTM A 641/A 641M, Class 1 coating.
  - 2. Hot-Dip Galvanized, Carbon-Steel Wire: ASTM A 82/A 82M; with ASTM A 153/A 153M, Class B-2 coating.
  - 3. Galvanized Steel Sheet: ASTM A 653/A 653M, Commercial Steel, G60 zinc coating.
  - 4. Steel Sheet, Galvanized after Fabrication: ASTM A 1008/A 1008M, Commercial Steel, with ASTM A 153/A 153M, Class B coating.
  - 5. Steel Plates, Shapes, and Bars: ASTM A 36/A 36M.
- B. Wire Ties, General: Unless otherwise indicated, size wire ties to extend at least halfway through veneer but with at least 5/8-inch cover on outside face. Outer ends of wires are bent 90 degrees and extend 2 inches parallel to face of veneer.
- C. Individual Wire Ties: Rectangular units with closed ends and not less than 4 inches wide.
  - 1. Z-shaped ties with ends bent 90 degrees to provide hooks not less than 2 inches long may be used for masonry constructed from solid units.



2. Where wythes do not align, use adjustable ties with pintle-and-eye connections having a maximum adjustment of 1-1/4 inches.
  3. Wire: Fabricate from 3/16-inch diameter, hot-dip galvanized steel wire. Mill-galvanized wire ties may be used in interior walls unless otherwise indicated.
- D. Adjustable Masonry-Veneer Anchors (at screen wall):
1. General: Provide anchors that allow vertical adjustment but resist tension and compression forces perpendicular to plane of wall, for attachment over sheathing to wood or metal studs, and as follows:
    - a. Structural Performance Characteristics: Capable of withstanding a 100-lbf load in both tension and compression without deforming or developing play in excess of 0.05 inch.
  2. Steel Drill Screws for Steel Studs: ASTM C 954 except manufactured with hex washer head and neoprene or EPDM washer, No. 12 diameter by length required to penetrate steel stud flange with not less than three exposed threads, and with hot dip galvanized finish.
    - a. Products: Subject to compliance with requirements, provide the following:
      - 1) Hohmann & Barnard Inc 2-Seal Tie, (to accommodate for 2" insulation over 5/8" sheathing over metal studs).

## 2.7 MISCELLANEOUS MASONRY ACCESSORIES

- A. Compressible Filler: Premolded filler strips complying with ASTM D 1056, Grade 2A1; compressible up to 35 percent; of width and thickness indicated; formulated from neoprene, urethane or PVC.
- B. Preformed Control-Joint Gaskets: Made from styrene-butadiene-rubber compound, complying with ASTM D 2000, Designation M2AA-805 or PVC, complying with ASTM D 2287, Type PVC-65406 and designed to fit standard sash block and to maintain lateral stability in masonry wall; size and configuration as indicated.
- C. Bond-Breaker Strips: Asphalt-saturated, organic roofing felt complying with ASTM D 226, Type I (No. 15 asphalt felt).
- D. Reinforcing Bar Positioners: Wire units designed to fit into mortar bed joints spanning masonry unit cells and hold reinforcing bars in center of cells. Units are formed from 0.148-inch steel wire, hot-dip galvanized after fabrication. Provide units designed for number of bars indicated.
  1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
    - a. Dayton Superior Corporation, Dur-O-Wal Division; D/A 810, D/A 812 or D/A 817.
    - b. Heckmann Building Products Inc.; No. 376 Rebar Positioner.
    - c. Hohmann & Barnard, Inc.; #RB or #RB-Twin Rebar Positioner.
    - d. Wire-Bond; O-Ring or Double O-Ring Rebar Positioner.

## 2.8 MASONRY CLEANERS

- A. Proprietary Acidic Cleaner: Manufacturer's standard-strength cleaner designed for removing mortar/grout stains, efflorescence, and other new construction stains from new masonry without discoloring or damaging masonry surfaces. Use product expressly approved for intended use by cleaner manufacturer and manufacturer of masonry units being cleaned.
  1. Manufacturers: Subject to compliance with requirements, provide products by one of the following
    - a. Diedrich Technologies, Inc.
    - b. EaCo Chem, Inc.
    - c. ProSoCo, Inc.

## 2.9 CMU BLOCK SEALER

- A. Provide/apply masonry sealer to all exterior exposed CMU block surfaces. Provide product equal to: Sure Klean Custom Masonry Sealer as manufactured by Prosoco, Inc. Apply product as recommended by the manufacturer.
- B. Provide sample of each color and type of cmu block fully treated and cured for Architects final approval before proceeding with the work.

## 2.10 MORTAR AND GROUT MIXES

- A. General: Do not use admixtures, including pigments, air-entraining agents, accelerators, retarders, water-repellent agents, antifreeze compounds, or other admixtures, unless otherwise indicated.
  - 1. Do not use calcium chloride in mortar or grout.
    - a. Allowable Accelerator: Accelgaurad 80, or equal.
  - 2. Use portland cement-lime, masonry cement or mortar cement mortar unless otherwise indicated.
  - 3. For exterior masonry, use portland cement-lime, masonry cement or mortar cement mortar.
  - 4. For reinforced masonry, use portland cement-lime,masonry cement or mortar cement mortar.
  - 5. Add cold-weather admixture (if used) at same rate for all mortar that will be exposed to view, regardless of weather conditions, to ensure that mortar color is consistent.
- B. Preblended, Dry Mortar Mix: Furnish dry mortar ingredients in form of a preblended mix. Measure quantities by weight to ensure accurate proportions, and thoroughly blend ingredients before delivering to Project site.
- C. Mortar for Unit Masonry: Comply with ASTM C 270, Proportion Specification. Provide the following types of mortar for applications stated unless another type is indicated.
  - 1. For masonry below grade or in contact with earth, use Type M.
  - 2. For reinforced masonry, use Type N.
  - 3. For exterior, above-grade, load-bearing and non-load-bearing walls and parapet walls; for interior load-bearing walls; for interior non-load-bearing partitions; and for other applications where another type is not indicated, use Type N.
  - 4. For interior non-load-bearing partitions, Type O may be used instead of Type N.
  - 5.
- D. Grout for Unit Masonry: Comply with ASTM C 476.
  - 1. Use grout of type indicated or, if not otherwise indicated, of type (fine or coarse) that will comply with Table 1.15.1 in ACI 530.1/ASCE 6/TMS 602 for dimensions of grout spaces and pour height.
  - 2. Proportion grout in accordance with ASTM C 476, paragraph 4.2.2 for specified 28-day compressive strength indicated, but not less than 2000 psi.
  - 3. Provide grout with a slump of 8 to 11 inches as measured according to ASTM C 143/C 143M.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of the Work.
  - 1. For the record, prepare written report, endorsed by Installer, listing conditions detrimental to performance of work.
  - 2. Verify that foundations are within tolerances specified.
  - 3. Verify that reinforcing dowels are properly placed.

- B. Before installation, examine rough-in and built-in construction for piping systems to verify actual locations of piping connections.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 INSTALLATION, GENERAL

- A. Thickness: Build cavity and composite walls and other masonry construction to full thickness shown. Build single-wythe walls to actual widths of masonry units, using units of widths indicated.
- B. Build chases and recesses to accommodate items specified in this and other Sections.
- C. Leave openings for equipment to be installed before completing masonry. After installing equipment, complete masonry to match the construction immediately adjacent to opening.
- D. Use full-size units without cutting if possible. If cutting is required to provide a continuous pattern or to fit adjoining construction, cut units with motor-driven saws; provide clean, sharp, unchipped edges. Allow units to dry before laying unless wetting of units is specified. Install cut units with cut surfaces and, where possible, cut edges concealed.
- E. Select and arrange units for exposed unit masonry to produce a uniform blend of colors and textures.
  - 1. Mix units from several pallets or cubes as they are placed.
- F. Matching Existing Masonry: Match coursing, bonding, color, and texture of existing masonry.
- G. Wetting of Brick: Wet brick before laying if initial rate of absorption exceeds 30 g/30 sq. in. per minute when tested per ASTM C 67. Allow units to absorb water so they are damp but not wet at time of laying.

### 3.3 TOLERANCES

- A. Dimensions and Locations of Elements:
  - 1. For dimensions in cross section or elevation do not vary by more than plus 1/2 inch or minus 1/4 inch.
  - 2. For location of elements in plan do not vary from that indicated by more than plus or minus 1/2 inch.
  - 3. For location of elements in elevation do not vary from that indicated by more than plus or minus 1/4 inch in a story height or 1/2 inch total.
- B. Lines and Levels:
  - 1. For bed joints and top surfaces of bearing walls do not vary from level by more than 1/4 inch in 10 feet, or 1/2 inch maximum.
  - 2. For conspicuous horizontal lines, such as lintels, sills, parapets, and reveals, do not vary from level by more than 1/8 inch in 10 feet, 1/4 inch in 20 feet, or 1/2 inch maximum.
  - 3. For vertical lines and surfaces do not vary from plumb by more than 1/4 inch in 10 feet, 3/8 inch in 20 feet, or 1/2 inch maximum.
  - 4. For conspicuous vertical lines, such as external corners, door jambs, reveals, and expansion and control joints, do not vary from plumb by more than 1/8 inch in 10 feet, 1/4 inch in 20 feet, or 1/2 inch maximum.
  - 5. For lines and surfaces do not vary from straight by more than 1/4 inch in 10 feet, 3/8 inch in 20 feet, or 1/2 inch maximum.
  - 6. For vertical alignment of exposed head joints, do not vary from plumb by more than 1/4 inch in 10 feet, or 1/2 inch maximum.
  - 7. For faces of adjacent exposed masonry units, do not vary from flush alignment by more than 1/16 inch except due to warpage of masonry units within tolerances specified for warpage of units.
- C. Joints:
  - 1. For bed joints, do not vary from thickness indicated by more than plus or minus 1/8 inch, with a maximum thickness limited to 1/2 inch.

2. For exposed bed joints, do not vary from bed-joint thickness of adjacent courses by more than 1/8 inch.
3. For head and collar joints, do not vary from thickness indicated by more than plus 3/8 inch or minus 1/4 inch.
4. For exposed head joints, do not vary from thickness indicated by more than plus or minus 1/8 inch. For exposed bed joints and head joints of stacked bond, do not vary from a straight line by more than 1/16 inch from one masonry unit to the next.

### 3.4 LAYING MASONRY WALLS

- A. Lay out walls in advance for accurate spacing of surface bond patterns with uniform joint thicknesses and for accurate location of openings, movement-type joints, returns, and offsets. Avoid using less-than-half-size units, particularly at corners, jambs, and, where possible, at other locations.
- B. Bond Pattern for Exposed Masonry: Unless otherwise indicated, lay exposed masonry in running bond; do not use units with less than nominal 4-inch horizontal face dimensions at corners or jambs.
- C. Lay concealed masonry with all units in a wythe in running bond or bonded by lapping not less than 2 inches. Bond and interlock each course of each wythe at corners. Do not use units with less than nominal 4-inch horizontal face dimensions at corners or jambs.
- D. Stopping and Resuming Work: Stop work by racking back units in each course from those in course below; do not tooth. When resuming work, clean masonry surfaces that are to receive mortar, remove loose masonry units and mortar, and wet brick if required before laying fresh masonry.
- E. Built-in Work: As construction progresses, build in items specified in this and other Sections. Fill in solidly with masonry around built-in items.
- F. Fill space between steel frames and masonry solidly with mortar unless otherwise indicated.
- G. Where built-in items are to be embedded in cores of hollow masonry units, place a layer of metal lath, wire mesh, or plastic mesh in the joint below and rod mortar or grout into core.
- H. Fill cores in hollow CMUs with grout 24 inches under bearing plates, beams, lintels, posts, and similar items unless otherwise indicated.
- I. Build non-load-bearing interior partitions full height of story to underside of solid floor or roof structure above unless otherwise indicated.
  1. Install compressible filler in joint between top of partition and underside of structure above.
  2. At fire-rated partitions, treat joint between top of partition and underside of structure above to comply with Division 07 Section "Fire-Resistive Joint Systems."

### 3.5 MORTAR BEDDING AND JOINTING

- A. Lay hollow CMUs as follows:
  1. With face shells fully bedded in mortar and with head joints of depth equal to bed joints.
  2. With webs fully bedded in mortar in all courses of piers, columns, and pilasters.
  3. With webs fully bedded in mortar in grouted masonry, including starting course on footings.
  4. With entire units, including areas under cells, fully bedded in mortar at starting course on footings where cells are not grouted.

### 3.6 MASONRY JOINT REINFORCEMENT

- A. General: Install entire length of longitudinal side rods in mortar with a minimum cover of 5/8 inch on exterior side of walls, 1/2 inch elsewhere. Lap reinforcement a minimum of 6 inches.
  1. Space reinforcement not more than 16 inches o.c.
- B. Interrupt joint reinforcement at control and expansion joints unless otherwise indicated.
- C. Provide continuity at wall intersections by using prefabricated T-shaped units.
- D. Provide continuity at corners by using prefabricated L-shaped units.

- E. Cut and bend reinforcing units as directed by manufacturer for continuity at corners, returns, offsets, column fireproofing, pipe enclosures, and other special conditions.

### 3.7 ANCHORING MASONRY TO STRUCTURAL STEEL AND CONCRETE

- A. Anchor masonry to structural steel and concrete where masonry abuts or faces structural steel or concrete to comply with the following:
  - 1. Provide an open space not less than 1 inch wide between masonry and structural steel or concrete unless otherwise indicated. Keep open space free of mortar and other rigid materials.
  - 2. Anchor masonry with anchors embedded in masonry joints and attached to structure.
  - 3. Space anchors as indicated, but not more than 24 inches o.c. vertically and 36 inches o.c. horizontally.

### 3.8 CONTROL AND EXPANSION JOINTS

- A. General: Install control and expansion joint materials in unit masonry as masonry progresses. Do not allow materials to span control and expansion joints without provision to allow for in-plane wall or partition movement.
- B. Form control joints in concrete masonry as follows using one of the following methods:
  - 1. Fit bond-breaker strips into hollow contour in ends of CMUs on one side of control joint. Fill resultant core with grout and rake out joints in exposed faces for application of sealant.
  - 2. Install preformed control-joint gaskets designed to fit standard sash block.
  - 3. Install interlocking units designed for control joints. Install bond-breaker strips at joint. Keep head joints free and clear of mortar or rake out joint for application of sealant.
  - 4. Install temporary foam-plastic filler in head joints and remove filler when unit masonry is complete for application of sealant.
- C. Form expansion joints in brick as follows:
  - 1. Build flanges of metal expansion strips into masonry. Lap each joint 4 inches in direction of water flow. Seal joints below grade and at junctures with horizontal expansion joints if any.
  - 2. Build flanges of factory-fabricated, expansion-joint units into masonry.
  - 3. Build in compressible joint fillers where indicated.
  - 4. Form open joint full depth of brick wythe and of width indicated, but not less than 3/8 inch for installation of sealant and backer rod specified in Division 07 Section "Joint Sealants."
- D. Provide horizontal, pressure-relieving joints by either leaving an air space or inserting a compressible filler of width required for installing sealant and backer rod specified in Division 07 Section "Joint Sealants," but not less than 3/8 inch .
  - 1. Locate horizontal, pressure-relieving joints beneath shelf angles supporting masonry.

### 3.9 LINTELS

- A. Install steel lintels where indicated and at all masonry openings in brick (galvanize). Paint **all** exposed steel lintels.
- B. Provide masonry lintels where shown and wherever openings of more than 1'-0" for brick size units and 2'-0" for block size units are shown without structural steel or other supporting lintels. Provide precast or formed-in-place masonry lintels. Cure precast lintels before handling and installation. Temporarily support formed-in-place lintels.
  - 1. For hollow concrete masonry unit walls, use specially formed bond beam units with reinforcement bars placed as indicated and filled with coarse grout.
- C. Provide minimum bearing of 8 inches at each jamb unless otherwise indicated.

### 3.10 REINFORCED UNIT MASONRY INSTALLATION

- A. Temporary Formwork and Shores: Construct formwork and shores as needed to support reinforced masonry elements during construction.

1. Construct formwork to provide shape, line, and dimensions of completed masonry as indicated. Make forms sufficiently tight to prevent leakage of mortar and grout. Brace, tie, and support forms to maintain position and shape during construction and curing of reinforced masonry.
  2. Do not remove forms and shores until reinforced masonry members have hardened sufficiently to carry their own weight and other loads that may be placed on them during construction.
- B. Placing Reinforcement: Comply with requirements in ACI 530.1/ASCE 6/TMS 602.
- C. Grouting: Do not place grout until entire height of masonry to be grouted has attained enough strength to resist grout pressure.
1. Comply with requirements in ACI 530.1/ASCE 6/TMS 602 for cleanouts and for grout placement, including minimum grout space and maximum pour height.
  2. Limit height of vertical grout pours to not more than 60 inches.

### 3.11 REPAIRING, POINTING, AND CLEANING

- A. Remove and replace masonry units that are loose, chipped, broken, stained, or otherwise damaged or that do not match adjoining units. Install new units to match adjoining units; install in fresh mortar, pointed to eliminate evidence of replacement.
- B. Pointing: During the tooling of joints, enlarge voids and holes, except weep holes, and completely fill with mortar. Point up joints, including corners, openings, and adjacent construction, to provide a neat, uniform appearance. Prepare joints for sealant application, where indicated.
- C. In-Progress Cleaning: Clean unit masonry as work progresses by dry brushing to remove mortar fins and smears before tooling joints.
- D. Final Cleaning: After mortar is thoroughly set and cured, clean exposed masonry as follows:
1. Remove large mortar particles by hand with wooden paddles and nonmetallic scrape hoes or chisels.
  2. Test cleaning methods on sample wall panel; leave one-half of panel uncleaned for comparison purposes. Obtain Architect's approval of sample cleaning before proceeding with cleaning of masonry.
  3. Protect adjacent stone and non-masonry surfaces from contact with cleaner by covering them with liquid strippable masking agent or polyethylene film and waterproof masking tape.
  4. Wet wall surfaces with water before applying cleaners; remove cleaners promptly by rinsing surfaces thoroughly with clear water.
  5. Clean brick by bucket-and-brush hand-cleaning method described in BIA Technical Notes 20.

### 3.12 MASONRY WASTE DISPOSAL

- A. Salvageable Materials: Unless otherwise indicated, excess masonry materials are Contractor's property. At completion of unit masonry work, remove from Project site.

## PART 4 - SCHEDULE OF MASONRY TYPES

- A. CMU: The following type members reference type indications shown on the drawings. See drawings also; schedule of types indicates only the primary types used as finish material; other sizes & types may also be required). The following are general types of block included in the work:
1. 8" x 8" x 16", natural color concrete.
  2. 4" x 8" x 16", natural color concrete.
  3. Provide corner units, jamb blocks, bullnose blocks as indicated on the drawings.
  4. Other sizes of standard block as may be detailed or required to complete the work.
  5. Lintel, bond beam, end blocks etc. as indicated and required.

**END OF SECTION 042000**

## SECTION 055000 - METAL FABRICATIONS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Steel framing and supports for Roof-top Units (RTUs)

#### 1.3 QUALITY ASSURANCE

- A. Welding Qualifications: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."
- B. Welding Qualifications: Qualify procedures and personnel according to the following:
  - 1. AWS D1.1/D1.1M, "Structural Welding Code - Steel."
  - 2. AWS D1.2/D1.2M, "Structural Welding Code - Aluminum."
  - 3. AWS D1.6/D1.6M, "Structural Welding Code - Stainless Steel."

#### 1.4 FIELD CONDITIONS

- A. Field Measurements: Verify actual locations of walls and other construction contiguous with metal fabrications by field measurements before fabrication.

### PART 2 - PRODUCTS

#### 2.1 METALS

- A. Metal Surfaces, General: Provide materials with smooth, flat surfaces unless otherwise indicated. For metal fabrications exposed to view in the completed Work, provide materials without seam marks, roller marks, rolled trade names, or blemishes.
- B. Steel Plates, Shapes, and Bars: ASTM A 36/A 36M.

#### 2.2 FASTENERS

- A. Steel Bolts and Nuts: Regular hexagon-head bolts, ASTM A 307, Grade A with hex nuts, ASTM A 563 and, where indicated, flat washers.



## 2.3 MISCELLANEOUS MATERIALS

- A. Universal Shop Primer: Fast-curing, lead- and chromate-free, universal modified-alkyd primer complying with MPI#79 and compatible with topcoat.

## 2.4 FABRICATION, GENERAL

- A. Shop Assembly: Preassemble items in the shop to greatest extent possible. Disassemble units only as necessary for shipping and handling limitations. Use connections that maintain structural value of joined pieces. Clearly mark units for reassembly and coordinated installation.
- B. Cut, drill, and punch metals cleanly and accurately. Remove burrs and ease edges to a radius of approximately 1/32 inch unless otherwise indicated. Remove sharp or rough areas on exposed surfaces.
- C. Form bent-metal corners to smallest radius possible without causing grain separation or otherwise impairing work.
- D. Form exposed work with accurate angles and surfaces and straight edges.
- E. Weld corners and seams continuously to comply with the following:
  - 1. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals.
  - 2. Obtain fusion without undercut or overlap.
  - 3. Remove welding flux immediately.
  - 4. At exposed connections, finish exposed welds and surfaces smooth and blended so no roughness shows after finishing.

## 2.5 MISCELLANEOUS FRAMING AND SUPPORTS

- A. General: Provide steel framing and supports not specified in other Sections as needed to complete the Work.
- B. Fabricate units from steel shapes, plates, and bars of welded construction unless otherwise indicated. Fabricate to sizes, shapes, and profiles indicated and as necessary to receive adjacent construction.
- C. Provide steel angle supports as indicated.

# PART 3 - EXECUTION

## 3.1 INSTALLATION, GENERAL

- A. Cutting, Fitting, and Placement: Perform cutting, drilling, and fitting required for installing metal fabrications. Set metal fabrications accurately in location, alignment, and elevation; with edges and surfaces level, plumb, true, and free of rack; and measured from established lines and levels.
- B. Fit exposed connections accurately together to form hairline joints. Weld connections that are not to be left as exposed joints but cannot be shop welded because of shipping size limitations.

Do not weld, cut, or abrade surfaces of exterior units that have been hot-dip galvanized after fabrication and are for bolted or screwed field connections.

- C. Field Welding: Comply with the following requirements:
1. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals.
  2. Obtain fusion without undercut or overlap.
  3. Remove welding flux immediately.
  4. At exposed connections, finish exposed welds and surfaces smooth and blended so no roughness shows after finishing and contour of welded surface matches that of adjacent surface.
- D. Fastening to In-Place Construction: Provide anchorage devices and fasteners where metal fabrications are required to be fastened to in-place construction. Provide threaded fasteners for use with concrete and masonry inserts, toggle bolts, through bolts, lag screws, wood screws, and other connectors.

### 3.2 INSTALLING MISCELLANEOUS FRAMING AND SUPPORTS

- A. General: Install framing and supports to comply with requirements of items being supported, including manufacturers' written instructions and requirements indicated on Shop Drawings.

### 3.3 ADJUSTING AND CLEANING

- A. Touchup Painting: Immediately after erection, clean field welds, bolted connections, and abraded areas. Paint uncoated and abraded areas with the same material as used for shop painting to comply with SSPC-PA 1 for touching up shop-painted surfaces.

END OF SECTION 055000

## SECTION 061000 - ROUGH CARPENTRY

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Framing with dimension lumber.
  - 2. Rooftop equipment bases and support curbs.
  - 3. Wood blocking, cants, and nailers.
  - 4. Wood furring and grounds.
  - 5. Wood sleepers.

#### 1.3 DEFINITIONS

- A. Boards or Strips: Lumber of less than 2 inches nominal size in least dimension.
- B. Dimension Lumber: Lumber of 2 inches nominal size or greater but less than 5 inches nominal) size in least dimension.

#### 1.4 ACTION SUBMITTALS

- A. Stack wood products flat with spacers beneath and between each bundle to provide air circulation. Protect wood products from weather by covering with waterproof sheeting, securely anchored. Provide for air circulation around stacks and under coverings.

### PART 2 - PRODUCTS

#### 2.1 WOOD PRODUCTS, GENERAL

- A. Lumber: DOC PS 20 and applicable rules of grading agencies indicated. If no grading agency is indicated, comply with the applicable rules of any rules-writing agency certified by the ALSC Board of Review. Grade lumber by an agency certified by the ALSC Board of Review to inspect and grade lumber under the rules indicated.
  - 1. Factory mark each piece of lumber with grade stamp of grading agency.
  - 2. Dress lumber, S4S, unless otherwise indicated.

- B. Maximum Moisture Content of Lumber: 15 percent for 2-inch nominal thickness or less; unless otherwise indicated.

## 2.2 MISCELLANEOUS LUMBER

- A. General: Provide miscellaneous lumber indicated and lumber for support or attachment of other construction, including the following:
  - 1. Blocking.
  - 2. Nailers.
  - 3. Rooftop equipment bases and support curbs.
  - 4. Cants.
  - 5. Furring.
  - 6. Grounds.
- B. Dimension Lumber Items: Construction or No. 2 grade lumber of any of the following species:
  - 1. Hem-fir (north); NLGA.
  - 2. Mixed southern pine or southern pine; SPIB.
  - 3. Spruce-pine-fir; NLGA.
  - 4. Hem-fir; WCLIB or WWPA.
  - 5. Spruce-pine-fir (south); NeLMA, WCLIB, or WWPA.
  - 6. Western woods; WCLIB or WWPA.
  - 7. Northern species; NLGA.
  - 8. Eastern softwoods; NeLMA.
- C. For blocking and nailers used for attachment of other construction, select and cut lumber to eliminate knots and other defects that will interfere with attachment of other work.
- D. For furring strips for installing plywood or hardboard paneling, select boards with no knots capable of producing bent-over nails and damage to paneling.

## 2.3 PLYWOOD BACKING PANELS

- A. Equipment Backing Panels: Plywood, DOC PS 1, Exterior, A-C in thickness indicated or, if not indicated, not less than 3/4-inch nominal thickness.

## 2.4 FASTENERS

- A. General: Fasteners shall be of size and type indicated and shall comply with requirements specified in this article for material and manufacture.
- B. Nails, Brads, and Staples: ASTM F 1667.
- C. Power-Driven Fasteners: Fastener systems with an evaluation report acceptable to authorities having jurisdiction, based on ICC-ES AC70.
- D. Post-Installed Anchors: Fastener systems with an evaluation report acceptable to authorities having jurisdiction, based on ICC-ES AC01, ICC-ES AC58, ICC-ES AC193, or ICC-ES AC308 as appropriate for the substrate.

1. Material: Carbon-steel components, zinc plated to comply with ASTM B 633, Class Fe/Zn 5.

## 2.5 MISCELLANEOUS MATERIALS

- A. Adhesives for Gluing Furring and Sleepers to Concrete or Masonry: Formulation complying with ASTM D 3498 that is approved for use indicated by adhesive manufacturer.

## PART 3 - EXECUTION

### 3.1 INSTALLATION, GENERAL

- A. Framing Standard: Comply with AF&PA's WCD 1, "Details for Conventional Wood Frame Construction," unless otherwise indicated.
- B. Set rough carpentry to required levels and lines, with members plumb, true to line, cut, and fitted. Fit rough carpentry accurately to other construction. Locate furring, nailers, blocking, grounds, and similar supports to comply with requirements for attaching other construction.
- C. Install plywood backing panels by fastening to C.M.U.; coordinate locations with utilities requiring backing panels.
- D. Provide blocking and framing as indicated and as required to support facing materials, fixtures, specialty items, and trim.
  1. Provide metal clips for fastening gypsum board or lath at corners and intersections where framing or blocking does not provide a surface for fastening edges of panels. Space clips not more than 16 inches o.c.
- E. Sort and select lumber so that natural characteristics do not interfere with installation or with fastening other materials to lumber. Do not use materials with defects that interfere with function of member or pieces that are too small to use with minimum number of joints or optimum joint arrangement.
- F. Securely attach rough carpentry work to substrate by anchoring and fastening as indicated, complying with the following:
  1. Table 2304.9.1, "Fastening Schedule," in ICC's International Building Code (IBC).
  2. Table R602.3(1), "Fastener Schedule for Structural Members," and Table R602.3(2), "Alternate Attachments," in ICC's International Residential Code for One- and Two-Family Dwellings.
  3. ICC-ES evaluation report for fastener.
- G. Use steel common nails unless otherwise indicated. Select fasteners of size that will not fully penetrate members where opposite side will be exposed to view or will receive finish materials. Make tight connections between members. Install fasteners without splitting wood. Drive nails snug but do not countersink nail heads unless otherwise indicated.

### 3.2 WOOD BLOCKING, AND NAILER INSTALLATION

- A. Install where indicated and where required for attaching other work. Form to shapes indicated and cut as required for true line and level of attached work. Coordinate locations with other work involved.
- B. Attach items to substrates to support applied loading. Recess bolts and nuts flush with surfaces unless otherwise indicated.

### 3.3 WOOD FURRING INSTALLATION

- A. Install level and plumb with closure strips at edges and openings. Shim with wood as required for tolerance of finish work.
- B. Furring to Receive Plywood or Hardboard Paneling: Install 1-by-3-inch nominal- size furring horizontally and vertically at 24 inches o.c.
- C. Furring to Receive Gypsum Board: Install 1-by-2-inch nominal- size furring vertically at 16 inches o.c.

END OF SECTION 061000

## SECTION 075423 - THERMOPLASTIC POLYOLEFIN (TPO) ROOFING

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:

1. Adhered TPO membrane roofing system repairs as required due to work under this contract.
2. Roof insulation – infill as required to meet existing conditions.

#### 1.3 PERFORMANCE REQUIREMENTS

- A. General Performance: Installed membrane roofing and base flashings shall withstand specified uplift pressures, thermally induced movement, and exposure to weather without failure due to defective manufacture, fabrication, installation, or other defects in construction. Membrane roofing and base flashings shall remain watertight.
- B. Material Compatibility: Provide roofing materials that are compatible with existing roof system as noted on the drawings under conditions of service and application required, as demonstrated by membrane roofing manufacturer based on testing, field experience and roof warranty.
- C. Roofing System Design: Provide membrane roofing system that is identical to systems that have been successfully tested by a qualified testing and inspecting agency to resist uplift pressure calculated according to ASCE/SEI 7.
- D. FM Approvals Listing: Provide membrane roofing, base flashings, and component materials that comply with requirements in FM Approvals 4450 and FM Approvals 4470 as part of a membrane roofing system, and that are listed in FM Approvals' "RoofNav" for Class 1 or noncombustible construction, as applicable. Identify materials with FM Approvals markings.
  1. Fire/Windstorm Classification: **Class 1A-90.**

#### 1.4 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: For roofing system. Include plans, sections, details, and attachments to other work.
  1. Base flashings and membrane terminations.
- C. Samples for Verification: For the following products:

1. Sheet roofing, of color specified, including T-shaped side and end lap seam.
2. Roof insulation.

- D. Qualification Data: For qualified Installer and manufacturer.
- E. Manufacturer Certificates: Signed by roofing manufacturer certifying that roofing system complies with requirements specified in "Performance Requirements" Article.
- F. Warranties: Sample of special warranties. Existing roof warranty shall not be compromised.

#### 1.5 QUALITY ASSURANCE

- A. Manufacturer Qualifications: A qualified manufacturer that is FM approved for membrane roofing system identical to that used for this Project.
- B. Installer Qualifications: A qualified firm that is approved, authorized, or licensed by membrane roofing system manufacturer to install manufacturer's product and that is eligible to receive manufacturer's special warranty.
- C. Exterior Fire-Test Exposure: ASTM E 108, Class A; for application and roof slopes indicated, as determined by testing identical membrane roofing materials by a qualified testing agency. Materials shall be identified with appropriate markings of applicable testing agency.

#### 1.6 DELIVERY, STORAGE, AND HANDLING

- A. Deliver roofing materials to Project site in original containers with seals unbroken and labeled with manufacturer's name, product brand name and type, date of manufacture, approval or listing agency markings, and directions for storing and mixing with other components.
- B. Store liquid materials in their original undamaged containers in a clean, dry, protected location and within the temperature range required by roofing system manufacturer. Protect stored liquid material from direct sunlight.
  1. Discard and legally dispose of liquid material that cannot be applied within its stated shelf life.
- C. Protect roof insulation materials from physical damage and from deterioration by sunlight, moisture, soiling, and other sources. Store in a dry location. Comply with insulation manufacturer's written instructions for handling, storing, and protecting during installation.
- D. Handle and store roofing materials and place equipment in a manner to avoid permanent deflection of deck.

#### 1.7 PROJECT CONDITIONS

- A. Weather Limitations: Proceed with installation only when existing and forecasted weather conditions permit roofing system to be installed according to manufacturer's written instructions and warranty requirements.



## 1.8 WARRANTY

- A. Special Warranty: Manufacturer's standard or customized form, without monetary limitation, in which manufacturer agrees to repair or replace components of membrane roofing system that fail in materials or workmanship within specified warranty period.
  - 1. Special warranty includes membrane roofing, base flashings, roof insulation, fasteners, cover boards, roofing accessories, and other components of membrane roofing system.
  - 2. Warranty Period: Existing Roof is under warranty. Provide documentation stating work is in compliance and does not void existing warranty.
- B. Special Project Warranty: Submit roofing Installer's warranty, on warranty form at end of this Section, signed by Installer, covering the Work of this Section, including all components of membrane roofing system such as membrane roofing, base flashing, roof insulation, fasteners, cover boards, substrate boards, vapor retarders, roof pavers, and walkway products, for the following warranty period:
  - 1. Warranty Period: Five years from date of Substantial Completion.

## PART 2 - PRODUCTS

### 2.1 TPO MEMBRANE ROOFING

- A. Fabric-Reinforced Thermoplastic Polyolefin Sheet: ASTM D 6878, internally fabric or scrim reinforced, uniform, flexible TPO sheet.
  - 1. Thickness 60 mils nominal.
  - 2. Exposed Face Color: White.

### 2.2 AUXILIARY MEMBRANE ROOFING MATERIALS

- A. General: Auxiliary membrane roofing materials recommended by roofing system manufacturer for intended use, and compatible with membrane roofing.
  - 1. Liquid-type auxiliary materials shall comply with VOC limits of authorities having jurisdiction.
- B. Sheet Flashing: Manufacturer's standard unreinforced thermoplastic polyolefin sheet flashing, 55 mils thick, minimum, of same color as sheet membrane.
- C. Bonding Adhesive: Manufacturer's standard.
- D. Metal Termination Bars: Manufacturer's standard, predrilled stainless-steel or aluminum bars, approximately 1 by 1/8 inch thick; with anchors.
- E. Fasteners: Factory-coated steel fasteners and metal or plastic plates complying with corrosion-resistance provisions in FM Approvals 4470, designed for fastening membrane to substrate, and acceptable to membrane roofing system manufacturer.
- F. Miscellaneous Accessories: Provide pourable sealers, preformed cone and vent sheet flashings, preformed inside and outside corner sheet flashings, T-joint covers, lap sealants, termination reglets, and other accessories.

## 2.3 ROOF INSULATION

- A. General: Preformed roof insulation boards manufactured or approved by TPO membrane roofing manufacturer, selected from manufacturer's standard sizes suitable for application, of thicknesses indicated and that produce FM Approvals-approved roof insulation.
- B. Polyisocyanurate Board Insulation: ASTM C 1289, Type II, Class 1, Grade 2, felt or glass-fiber mat facer on both major surfaces.
- C. Provide preformed saddles, crickets, tapered edge strips, and other insulation shapes where indicated for sloping to drain. Fabricate to slopes indicated.

## 2.4 INSULATION ACCESSORIES

- A. General: Furnish roof insulation accessories recommended by insulation manufacturer for intended use and compatibility with membrane roofing.
- B. Fasteners: Factory-coated steel fasteners and metal or plastic plates complying with corrosion-resistance provisions in FM Approvals 4470, designed for fastening roof insulation and cover boards to substrate, and acceptable to roofing system manufacturer.
- C. Cover Board: High Density Recovery Board; 1/2 inch thick, R.2.5.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Installer present, for compliance with the following requirements and other conditions affecting performance of roofing system:
  - 1. Verify that roof openings and penetrations are in place and curbs are set and braced and that roof drain bodies are securely clamped in place.
  - 2. Verify that wood blocking, curbs, and nailers are securely anchored to roof deck at penetrations and terminations and that nailers match thicknesses of insulation.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 PREPARATION

- A. Clean substrate of dust, debris, moisture, and other substances detrimental to roofing installation according to roofing system manufacturer's written instructions. Remove sharp projections.
- B. Prevent materials from entering and clogging roof drains and conductors and from spilling or migrating onto surfaces of other construction. Remove roof-drain plugs when no work is taking place or when rain is forecast.
- C. Complete terminations and base flashings and provide temporary seals to prevent water from entering completed sections of roofing system at the end of the workday or when rain is forecast. Remove and discard temporary seals before beginning work on adjoining roofing.

### 3.3 INSULATION INSTALLATION

- A. Coordinate installing membrane roofing system components so insulation is not exposed to precipitation or left exposed at the end of the workday.
- B. Comply with membrane roofing system and insulation manufacturer's written instructions for installing roof insulation.
- C. Install insulation under area of roofing to achieve required thickness. Where overall insulation thickness is 3 inches or greater, install two or more layers with joints of each succeeding layer staggered from joints of previous layer a minimum of 6 inches in each direction.
- D. Trim surface of insulation where necessary at roof drains so completed surface is flush and does not restrict flow of water.
- E. Install insulation with long joints of insulation in a continuous straight line with end joints staggered between rows, abutting edges and ends between boards. Fill gaps exceeding 1/4 inch with insulation.
  - 1. Cut and fit insulation within 1/4 inch of nailers, projections, and penetrations.
- F. Mechanically Fastened Insulation: Install each layer of insulation and secure to deck using mechanical fasteners specifically designed and sized for fastening specified board-type roof insulation to deck type.
  - 1. Fasten insulation according to requirements in FM Approvals' "RoofNav" for specified Windstorm Resistance Classification.
  - 2. Fasten insulation to resist uplift pressure at corners, perimeter, and field of roof.
- G. Install cover boards over insulation with long joints in continuous straight lines with end joints staggered between rows. Offset joints of insulation below a minimum of 6 inches in each direction. Loosely butt cover boards together and adhere to roof insulation.
  - 1. Fasten cover boards according to requirements in FM Approvals' "RoofNav" for specified Windstorm Resistance Classification.
  - 2. Fasten cover boards to resist uplift pressure at corners, perimeter, and field of roof.

### 3.4 ADHERED MEMBRANE ROOFING INSTALLATION

- A. Adhere membrane roofing over area to receive roofing and install according to membrane roofing system manufacturer's written instructions.
- B. Start installation of membrane roofing in presence of membrane roofing system manufacturer's technical personnel.
- C. Accurately align membrane roofing and maintain uniform side and end laps of minimum dimensions required by manufacturer. Stagger end laps.
- D. Bonding Adhesive: Apply to substrate and underside of membrane roofing at rate required by manufacturer and allow to partially dry before installing membrane roofing. Do not apply to splice area of membrane roofing.

- E. In addition to adhering, mechanically fasten membrane roofing securely at terminations, penetrations, and perimeter of roofing.
- F. Apply membrane roofing with side laps shingled with slope of roof deck where possible.
- G. Seams: Clean seam areas, overlap membrane roofing, and hot-air weld side and end laps of membrane roofing and sheet flashings according to manufacturer's written instructions to ensure a watertight seam installation.
  - 1. Test lap edges with probe to verify seam weld continuity. Apply lap sealant to seal cut edges of sheet membrane.
  - 2. Verify field strength of seams a minimum of twice daily and repair seam sample areas.
  - 3. Repair tears, voids, and lapped seams in roofing that does not comply with requirements.
- H. Spread sealant bed over deck drain flange at roof drains and securely seal membrane roofing in place with clamping ring.

### 3.5 BASE FLASHING INSTALLATION

- A. Install sheet flashings and preformed flashing accessories and adhere to substrates according to membrane roofing system manufacturer's written instructions.
- B. Apply bonding adhesive to substrate and underside of sheet flashing at required rate and allow to partially dry. Do not apply to seam area of flashing.
- C. Flash penetrations and field-formed inside and outside corners with cured or uncured sheet flashing.
- D. Clean seam areas, overlap, and firmly roll sheet flashings into the adhesive. Hot-air weld side and end laps to ensure a watertight seam installation.
- E. Terminate and seal top of sheet flashings.

### 3.6 FIELD QUALITY CONTROL

- A. Final Roof Inspection: Arrange for roofing system manufacturer's technical personnel to inspect roofing installation on completion.
- B. Repair or remove and replace components of membrane roofing system where inspections indicate that they do not comply with specified requirements.
- C. Additional inspections, at Contractor's expense, will be performed to determine compliance of replaced or additional work with specified requirements.

### 3.7 PROTECTING AND CLEANING

- A. Protect membrane roofing system from damage and wear during remainder of construction period. When remaining construction will not affect or endanger roofing, inspect roofing for deterioration and damage, describing its nature and extent in a written report, with copies to Architect and Owner.

- B. Correct deficiencies in or remove membrane roofing system that does not comply with requirements; repair substrates; and repair or reinstall membrane roofing system to a condition free of damage and deterioration at time of Substantial Completion and according to warranty requirements.

END OF SECTION 075423

## SECTION 076200 - SHEET METAL FLASHING AND TRIM

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. This Section includes sheet metal flashing and trim in the following categories:
  - 1. Roof-Flashing systems.

#### 1.2 PERFORMANCE REQUIREMENTS

- A. Install sheet metal flashing and trim to withstand wind loads, structural movement, thermally induced movement, and exposure to weather without failing.

#### 1.3 QUALITY ASSURANCE

- A. Installer Qualifications: Engage an experience Installer who has completed sheet metal flashing and trim work similar in material, design, and extent to that indicated for this Project and with a record of successful in-service performance.

#### 1.4 PROJECT CONDITIONS

- A. Coordinate Work of this Section with interfacing and adjoining Work for proper sequencing of each installation. Ensure best possible weather resistance, durability of Work, and protection of materials and finishes.

### PART 2 - PRODUCTS

#### 2.1 METALS

- A. Aluminum Sheet: ASTM B 209, alloy as standard with manufacturer for finish required, not less than 0.032 inch thick; and finished as follows:
  - 1. Finish: Manufacturer's standard epoxy primer and silicone-modified, polyester-enamel topcoat.
  - 2. Concealed Finish: Manufacturer's standard white or light-colored acrylic or polyester backer finish.
- B. Metallic-Coated Steel Sheet: Galvanized structural-steel sheet, ASTM A 653/A 653M, G90 , or aluminum-zinc alloy-coated structural-steel sheet, ASTM A 792/A 792M, Class AZ50 coating designation, Grade 40, 24 gauge.
  - 1. Finish: Manufacturer's standard epoxy primer and silicone-modified, polyester-enamel topcoat.
  - 2. Concealed Finish: Manufacturer's standard white or light-colored acrylic or polyester backer finish.

#### 2.2 MISCELLANEOUS MATERIALS AND ACCESSORIES

- A. Fasteners: Same metal as sheet metal flashing or other noncorrosive metal as recommended by sheet metal manufacturer. Match finish of exposed heads with material being fastened.

- B. Asphalt Mastic: SSPC-Paint 12, solvent-type asphalt mastic, nominally free of sulfur and containing no asbestos fibers, compounded for 15-mil dry film thickness per coat.
- C. Mastic Sealant: Polyisobutylene; non-hardening, non-skinning, non-drying, non-migrating sealant.
- D. Elastomeric Sealant: Generic type recommended by sheet metal manufacturer and fabricator of components being sealed and complying with requirements for elastomeric joint sealants as specified in ASTM C 920.
- E. Adhesives: Type recommended by flashing sheet metal manufacturer for waterproof and weather-resistant seaming and adhesive application of flashing sheet metal.
- F. Metal Accessories: Provide sheet metal clips, straps, anchoring devices, and similar accessory units as required for installation of Work, matching or compatible with material being installed; noncorrosive; size and thickness required for performance.
- G. Roofing Cement: ASTM D 4586, Type I, asbestos free, asphalt based.
- H. Splash Blocks: Commercially available precast concrete blocks having configuration appropriate to control drainage.

### 2.3 FABRICATION, GENERAL

- A. Sheet Metal Fabrication Standard: Fabricate sheet metal flashing and trim to comply with recommendations of SMACNA's "Architectural Sheet Metal Manual" that apply to the design, dimensions, metal, and other characteristics of the item indicated.
- B. Comply with details shown to fabricate sheet metal flashing and trim that fit substrates and result in waterproof and weather-resistant performance once installed. Verify shapes and dimensions of surfaces to be covered before fabricating sheet metal.
- C. Form exposed sheet metal Work that is without excessive oil canning, buckling, and tool marks and that is true to line and levels indicated, with exposed edges folded back to form hems.
- D. Seams: Fabricate nonmoving seams in sheet metal with flat-lock seams. Tin edges to be seamed, form seams, and solder.
- E. Expansion Provisions: Space movement joints at maximum of 10 feet with no joints allowed within 24 inches of corner or intersection. Where lapped or bayonet-type expansion provisions in Work cannot be used or would not be sufficiently weatherproof and waterproof, form expansion joints of intermeshing hooked flanges, not less than 1 inch deep, filled with mastic sealant (concealed within joints).
- F. Sealed Joints: Form non-expansion, but movable, joints in metal to accommodate elastomeric sealant to comply with SMACNA standards.
- G. Conceal fasteners and expansion provisions where possible. Exposed fasteners are not allowed on faces of sheet metal exposed to public view.
- H. Fabricate cleats and attachment devices from same material as sheet metal component being anchored or from compatible, noncorrosive metal recommended by sheet metal manufacturer.
  - 1. Size: As recommended by SMACNA manual or sheet metal manufacturer for application but never less than thickness of metal being secured.

## 2.4 SHEET METAL FABRICATIONS

- A. Base Flashing: Fabricate from the following material:
  - 1. Galvanized Steel: 0.0276 inch thick.
- B. Counterflashing: Fabricate from the following material:
  - 1. Galvanized Steel: 0.0217 inch thick.
- C. Flashing Receivers: Fabricate from the following material:
  - 1. Galvanized Steel: 0.0217 inch thick.
- D. Drip Edges: Fabricate from the following material:
  - 1. Galvanized Steel: 0.0217 inch thick.
- E. Equipment Support Flashing: Fabricate from the following material:
  - 1. Galvanized Steel: 0.0276 inch thick.
- F. Roof-Penetration Flashing: Fabricate from the following material:
  - 1. Lead: 4.0 lb/sq. ft., hard tempered.
  - 2. Galvanized Steel: 0.0276 inch thick.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine substrates and conditions under which sheet metal flashing and trim are to be installed and verify that Work may properly commence. Do not proceed with installation until unsatisfactory conditions have been corrected.

### 3.2 INSTALLATION

- A. General: Unless otherwise indicated, install sheet metal flashing and trim to comply with performance requirements, manufacturer's installation instructions, and SMACNA's "Architectural Sheet Metal Manual." Anchor units of Work securely in place by methods indicated, providing for thermal expansion of metal units; conceal fasteners where possible, and set units true to line and level as indicated. Install Work with laps, joints, and seams that will be permanently watertight and weatherproof.
- B. Install exposed sheet metal Work that is without excessive oil canning, buckling, and tool marks and that is true to line and levels indicated, with exposed edges folded back to form hems. Install sheet metal flashing and trim to fit substrates and to result in waterproof and weather-resistant performance. Verify shapes and dimensions of surfaces to be covered before fabricating sheet metal.
- C. Expansion Provisions: Provide for thermal expansion of exposed sheet metal Work. Space movement joints at maximum of 10 feet with no joints allowed within 24 inches of corner or intersection. Where lapped or bayonet-type expansion provisions in Work cannot be used or



would not be sufficiently weatherproof and waterproof, form expansion joints of intermeshing hooked flanges, not less than 1 inch deep, filled with mastic sealant (concealed within joints).

- D. Soldered Joints: Clean surfaces to be soldered, removing oils and foreign matter. Pre-tin edges of sheets to be soldered to a width of 1-1/2 inches, except where pre-tinned surface would show in finished Work.
  - 1. Do not use torches for soldering. Heat surfaces to receive solder and flow solder into joint. Fill joint completely. Completely remove flux and spatter from exposed surfaces.
- E. Sealed Joints: Form non-expansion, but movable, joints in metal to accommodate elastomeric sealant to comply with SMACNA standards. Fill joint with sealant and form metal to completely conceal sealant.
  - 1. Use joint adhesive for nonmoving joints specified not to be soldered.
- F. Seams: Fabricate nonmoving seams in sheet metal with flat-lock seams. Tin edges to be seamed, form seams, and solder.
- G. Counterflashing: Coordinate installation of counterflashing with installation of assemblies to be protected by counterflashing. Install counterflashing in reglets or receivers. Secure in a waterproof manner by means of snap-in installation and sealant, lead wedges and sealant, interlocking folded seam, or blind rivets and sealant. Lap counterflashing joints a minimum of 2 inches and bed with sealant.
- H. Roof-Drainage System: Install drainage items fabricated from sheet metal, with straps, adhesives, and anchors recommended by SMACNA's Manual or the item manufacturer, to drain roof in the most efficient manner. Coordinate roof-drain flashing installation with roof-drainage system installation. Coordinate flashing and sheet metal items with roofing installation.
- I. Equipment Support Flashing: Coordinate equipment support flashing installation with roofing and equipment installation. Weld or seal flashing to equipment support member.
- J. Roof-Penetration Flashing: Coordinate roof-penetration flashing installation with roofing and installation of items penetrating roof. Install flashing as follows:
  - 1. Turn lead flashing down inside vent piping, being careful not to block vent piping with flashing.
  - 2. Seal and clamp flashing to pipes penetrating roof, other than lead flashing on vent piping.
- K. Splash Blocks: Install where downspouts discharge at location indicated. Where placed on roofing, set in roof cement compatible with roofing membrane.

### 3.3 CLEANING AND PROTECTION

- A. Clean exposed metal surfaces, removing substances that might cause corrosion of metal or deterioration of finishes.
- B. Provide final protection and maintain conditions that ensure sheet metal flashing and trim Work during construction is without damage or deterioration other than natural weathering at the time of Substantial Completion.

END OF SECTION 076200

## SECTION 078413 - PENETRATION FIRESTOPPING

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Penetrations in fire-resistance-rated walls.

#### 1.3 PREINSTALLATION MEETINGS

- A. Preinstallation Conference: Conduct conference at Project site.

#### 1.4 ACTION SUBMITTALS

- A. Product Data: For each type of product.

#### 1.5 INFORMATIONAL SUBMITTALS

- A. Product Test Reports: For each penetration firestopping system, for tests performed by a qualified testing agency.

#### 1.6 CLOSEOUT SUBMITTALS

- A. Installer Certificates: From Installer indicating that penetration firestopping systems have been installed in compliance with requirements and manufacturer's written instructions.

#### 1.7 PROJECT CONDITIONS

- A. Environmental Limitations: Do not install penetration firestopping system when ambient or substrate temperatures are outside limits permitted by penetration firestopping system manufacturers or when substrates are wet because of rain, frost, condensation, or other causes.
- B. Install and cure penetration firestopping materials per manufacturer's written instructions using natural means of ventilations or, where this is inadequate, forced-air circulation.

## 1.8 COORDINATION

- A. Coordinate construction of openings and penetrating items to ensure that penetration firestopping systems can be installed according to specified firestopping system design.
- B. Coordinate sizing of sleeves, openings, core-drilled holes, or cut openings to accommodate penetration firestopping systems.

## PART 2 - PRODUCTS

### 2.1 PERFORMANCE REQUIREMENTS

- A. Fire-Test-Response Characteristics:
  - 1. Perform penetration firestopping system tests by a qualified testing agency acceptable to authorities having jurisdiction.
  - 2. Test per testing standards referenced in "Penetration Firestopping Systems" Article. Provide rated systems complying with the following requirements:
    - a. Penetration firestopping systems shall bear classification marking of a qualified testing agency.
      - 1) UL in its "Fire Resistance Directory."

### 2.2 PENETRATION FIRESTOPPING SYSTEMS

- A. Penetration Firestopping Systems: Systems that resist spread of fire, passage of smoke and other gases, and maintain original fire-resistance rating of construction penetrated. Penetration firestopping systems shall be compatible with one another, with the substrates forming openings, and with penetrating items if any.
  - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
    - a. 3M Fire Protection Products.
    - b. Construction Solutions.
    - c. Hilti, Inc.
- B. Penetrations in Fire-Resistance-Rated Walls: Penetration firestopping systems with ratings determined per ASTM E814 or UL 1479, based on testing at a positive pressure differential of 0.01-inch wg.
  - 1. F-Rating: Not less than the fire-resistance rating of constructions penetrated.
- C. Exposed Penetration Firestopping Systems: Flame-spread and smoke-developed indexes of less than 25 and 450, respectively, per ASTM E84.

- D. Accessories: Provide components for each penetration firestopping system that are needed to install fill materials and to maintain ratings required. Use only those components specified by penetration firestopping system manufacturer and approved by qualified testing and inspecting agency for conditions indicated.
  - 1. Permanent forming/damming/backing materials.
  - 2. Substrate primers.
  - 3. Collars.
  - 4. Steel sleeves.

## 2.3 FILL MATERIALS

- A. Firestop Devices: Factory-assembled collars formed from galvanized steel and lined with intumescent material sized to fit specific diameter of penetrant.
- B. Mortars: Prepackaged dry mixes consisting of a blend of inorganic binders, hydraulic cement, fillers and lightweight aggregate formulated for mixing with water at Project site to form a nonshrinking, homogeneous mortar.
- C. Silicone Foams: Multicomponent, silicone-based liquid elastomers that, when mixed, expand and cure in place to produce a flexible, nonshrinking foam.
- D. Silicone Sealants: Single-component, silicone-based, neutral-curing elastomeric sealants.

## 2.4 MIXING

- A. Penetration Firestopping Materials: For those products requiring mixing before application, comply with penetration firestopping system manufacturer's written instructions for accurate proportioning of materials, water (if required), type of mixing equipment, selection of mixer speeds, mixing containers, mixing time, and other items or procedures needed to produce products of uniform quality with optimum performance characteristics for application indicated.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine substrates and conditions, with Installer present, for compliance with requirements for opening configurations, penetrating items, substrates, and other conditions affecting performance of the Work.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 PREPARATION

- A. Surface Cleaning: Before installing penetration firestopping systems, clean out openings immediately to comply with manufacturer's written instructions and with the following requirements:

1. Remove from surfaces of opening substrates and from penetrating items foreign materials that could interfere with adhesion of penetration firestopping materials.
  2. Clean opening substrates and penetrating items to produce clean, sound surfaces capable of developing optimum bond with penetration firestopping materials. Remove loose particles remaining from cleaning operation.
  3. Remove laitance and form-release agents from concrete.
- B. Prime substrates where recommended in writing by manufacturer using that manufacturer's recommended products and methods. Confine primers to areas of bond; do not allow spillage and migration onto exposed surfaces.

### 3.3 INSTALLATION

- A. General: Install penetration firestopping systems to comply with manufacturer's written installation instructions and published drawings for products and applications.
- B. Install forming materials and other accessories of types required to support fill materials during their application and in the position needed to produce cross-sectional shapes and depths required to achieve fire ratings.
1. After installing fill materials and allowing them to fully cure, remove combustible forming materials and other accessories not forming permanent components of firestopping.
- C. Install fill materials by proven techniques to produce the following results:
1. Fill voids and cavities formed by openings, forming materials, accessories and penetrating items to achieve required fire-resistance ratings.
  2. Apply materials so they contact and adhere to substrates formed by openings and penetrating items.
  3. For fill materials that will remain exposed after completing the Work, finish to produce smooth, uniform surfaces that are flush with adjoining finishes.

### 3.4 IDENTIFICATION

- A. Wall Identification: Permanently label walls containing penetration firestopping systems with the words "FIRE AND/OR SMOKE BARRIER - PROTECT ALL OPENINGS," using lettering not less than 3 inches high and with minimum 0.375-inch strokes. Lettering Color to be "Red".
1. Locate in space at 15 feet from end of wall and at intervals not exceeding 30 feet.

### 3.5 FIELD QUALITY CONTROL

- A. Where deficiencies are found or penetration firestopping system is damaged or removed because of testing, repair or replace penetration firestopping system to comply with requirements.
- B. Proceed with enclosing penetration firestopping systems with other construction only after inspection reports are issued and installations comply with requirements.

### 3.6 CLEANING AND PROTECTION

- A. Clean off excess fill materials adjacent to openings as the Work progresses by methods and with cleaning materials that are approved in writing by penetration firestopping system manufacturers and that do not damage materials in which openings occur.
- B. Provide final protection and maintain conditions during and after installation that ensure that penetration firestopping systems are without damage or deterioration at time of Substantial Completion. If, despite such protection, damage or deterioration occurs, immediately cut out and remove damaged or deteriorated penetration firestopping material and install new materials to produce systems complying with specified requirements.

### 3.7 PENETRATION FIRESTOPPING SYSTEM SCHEDULE

- A. Where UL-classified systems are indicated, they refer to system numbers in UL's "Fire Resistance Directory" under product Category XHEZ.
- B. Penetration Firestopping Systems with No Penetrating Items:
  - 1. UL-Classified Systems: C-AJ- C-BJ- W-J- 0001-0999.
  - 2. F-Rating: 3 hours.
  - 3. Type of Fill Materials: As required to achieve rating.
- C. Penetration Firestopping Systems for Metallic Pipes, Conduit, or Tubing:
  - 1. UL-Classified Systems: C-AJ- C-BJ- W-J- 1001-1999.
  - 2. F-Rating: 3 hours.
  - 3. Type of Fill Materials: As required to achieve rating.
- D. Penetration Firestopping Systems for Nonmetallic Pipe, Conduit, or Tubing:
  - 1. UL-Classified Systems: C-AJ- C-BJ- W-J- 2001-2999.
  - 2. F-Rating: 3 hours.
  - 3. Type of Fill Materials: As required to achieve rating.
- E. Penetration Firestopping Systems for Electrical Cables:
  - 1. UL-Classified Systems: C-AJ- C-BJ- W-J- 3001-3999.
  - 2. F-Rating: 3 hour.
  - 3. Type of Fill Materials: As required to achieve rating.
- F. Penetration Firestopping Systems for Insulated Pipes:
  - 1. UL-Classified Systems: C-AJ- C-BJ- W-J- 5001-5999.
  - 2. F-Rating: 3 hours.
  - 3. Type of Fill Materials: As required to achieve rating.
- G. Penetration Firestopping Systems for Miscellaneous Electrical Penetrants:
  - 1. UL-Classified Systems: C-AJ- C-BJ- W-BJ- 6001-6999.
  - 2. F-Rating: 3 hours.

3. Type of Fill Materials: As required to achieve rating.

H. Penetration Firestopping Systems for Miscellaneous Mechanical Penetrants:

1. UL-Classified Systems: C-AJ- C-BJ- W-J- 7001-7999.
2. F-Rating: 3 hours.
3. Type of Fill Materials: As required to achieve rating.

END OF SECTION 078413



## SECTION 079200 - JOINT SEALANTS

### PART 1 - GENERAL

#### 1.1 SECTION REQUIREMENTS

- A. Submittals: Product Data and color Samples.
- B. Environmental Limitations: Do not proceed with installation of joint sealants when ambient and substrate temperature conditions are outside limits permitted by joint sealant manufacturer or are below 40 deg F

### PART 2 - PRODUCTS

#### 2.1 JOINT SEALANTS

- A. Compatibility: Provide joint sealants, joint fillers, and other related materials that are compatible with one another and with joint substrates under service and application conditions.
- B. Sealant for Use in Building Expansion Joints:
  - 1. Single-component, neutral-curing silicone sealant, ASTM C 920, Type S; Grade NS; Class 25; Uses T, M, and O, with the additional capability to withstand 50 percent movement in both extension and compression for a total of 100 percent movement.
- C. Sealant for General Exterior Use Where Another Type Is Not Specified[, One of the Following]:
  - 1. Single-component, nonsag polysulfide sealant, ASTM C 920, Type S; Grade NS; Class 12-1/2; Uses NT, M, G, A, and O.
  - 2. Single-component, neutral-curing silicone sealant, ASTM C 920, Type S; Grade NS; Class 25; Uses T, NT, M, G, A, and O.
  - 3. Single-component, nonsag urethane sealant, ASTM C 920, Type S; Grade NS; Class 25; and Uses NT, M, A, and O.
- D. Sealant for Exterior Traffic-Bearing Joints, Where Slope Precludes Use of Pourable Sealant:
  - 1. Single-component, nonsag urethane sealant, ASTM C 920, Type S; Grade NS; Class 25; Uses T, NT, M, G, A, and O.
- E. Sealant for Exterior Traffic-Bearing Joints, Where Slope Allows Use of Pourable Sealant:
  - 1. Single-component, pourable urethane sealant, ASTM C 920, Type S; Grade P; Class 25; Uses T, M, G, A, and O.
- F. Sealant for Use in Interior Joints in Ceramic Tile and Other Hard Surfaces in Kitchens and Toilet Rooms and Around Plumbing Fixtures:
  - 1. Single-component, mildew-resistant silicone sealant, ASTM C 920, Type S; Grade NS; Class 25; Uses NT, G, A, and O; formulated with fungicide.
- G. Sealant for Interior Use at Perimeters of Door and Window Frames:
  - 1. Latex sealant, single-component, nonsag, mildew-resistant, paintable, acrylic-emulsion sealant complying with ASTM C 834.

- H. Acoustical Sealant for Exposed Interior Joints:
  - 1. Nonsag, paintable, nonstaining, latex sealant complying with ASTM C 834.

## 2.2 JOINT-SEALANT BACKING

- A. General: Provide sealant backings of material and type that are nonstaining; are compatible with joint substrates, sealants, primers, and other joint fillers; and are approved for applications indicated by sealant manufacturer.
- B. Cylindrical Sealant Backings: ASTM C 1330, of size and density to control sealant depth and otherwise contribute to producing optimum sealant performance.
- C. Bond-Breaker Tape: Polyethylene tape or other plastic tape recommended by sealant manufacturer for preventing sealant from adhering to rigid, inflexible joint-filler materials or joint surfaces at back of joint.

## PART 3 - EXECUTION

### 3.1 INSTALLATION

- A. Comply with ASTM C 1193.
- B. Comply with ASTM C 919 for use of joint sealants in acoustical applications.

END OF SECTION 079200

## SECTION 08 11 10 - HOLLOW METAL DOORS AND FRAMES

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

##### A. Section Includes:

- 1. Standard and custom hollow metal doors and frames.

##### B. Related Sections:

- 1. Division 08 Section "Flush Wood Doors".
- 2. Division 09 Sections "Painting" for field painting hollow metal doors and frames.

##### C. Codes and References: Comply with the version year adopted by the Authority Having Jurisdiction.

- 1. ANSI/SDI A250.8 - Recommended Specifications for Standard Steel Doors and Frames.
- 2. ANSI/SDI A250.4 - Test Procedure and Acceptance Criteria for Physical Endurance for Steel Doors, Frames, Frames Anchors and Hardware Reinforcing.
- 3. ANSI/SDI A250.6 - Recommended Practice for Hardware Reinforcing on Standard Steel Doors and Frames.
- 4. ANSI/SDI A250.10 - Test Procedure and Acceptance Criteria for Prime Painted Steel Surfaces for Steel Doors and Frames.
- 5. ANSI/SDI A250.11 - Recommended Erection Instructions for Steel Frames.
- 6. ASTM A1008 - Standard Specification for Steel Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy and High-Strength Low-Alloy with Improved Formability.
- 7. ASTM A653 - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process.
- 8. ASTM A924 - Standard Specification for General Requirements for Steel Sheet, Metallic-Coated by the Hot-Dip Process.
- 9. ASTM C 1363 - Standard Test Method for Thermal Performance of Building Assemblies by Means of a Hot Box Apparatus.
- 10. ANSI/BHMA A156.115 - Hardware Preparation in Steel Doors and Frames.
- 11. ANSI/SDI 122 - Installation and Troubleshooting Guide for Standard Steel Doors and Frames.
- 12. ANSI/NFPA 80 - Standard for Fire Doors and Fire Windows; National Fire Protection Association.
- 13. ANSI/NFPA 105: Standard for the Installation of Smoke Door Assemblies.
- 14. NFPA 252 - Standard Methods of Fire Tests of Door Assemblies; National Fire Protection Association.
- 15. UL 10C - Positive Pressure Fire Tests of Door Assemblies.
- 16. UL 1784 - Standard for Air Leakage Tests of Door Assemblies.

### 1.3 SUBMITTALS

- A. Product Data: For each type of product indicated. Include construction details, material descriptions, core descriptions, hardware reinforcements, profiles, anchors, fire-resistance rating, and finishes.
- B. Door hardware supplier is to furnish templates, template reference number and/or physical hardware to the steel door and frame supplier in order to prepare the doors and frames to receive the finish hardware items.
- C. Shop Drawings: Include the following:
  - 1. Elevations of each door design.
  - 2. Details of doors, including vertical and horizontal edge details and metal thicknesses.
  - 3. Frame details for each frame type, including dimensioned profiles and metal thicknesses.
  - 4. Locations of reinforcement and preparations for hardware.
  - 5. Details of anchorages, joints, field splices, and connections.
  - 6. Details of accessories.
  - 7. Details of moldings, removable stops, and glazing.
  - 8. Details of conduit and preparations for power, signal, and control systems.
- D. Samples for Verification:
  - 1. Samples are only required by request of the architect and for manufacturers that are not current members of the Steel Door Institute.

### 1.4 QUALITY ASSURANCE

- A. Source Limitations: Obtain hollow metal doors and frames through one source from a single manufacturer wherever possible.
- B. Quality Standard: In addition to requirements specified, comply with ANSI/SDI A250.8, latest edition, "Recommended Specifications for Standard Steel Doors and Frames".

### 1.5 DELIVERY, STORAGE, AND HANDLING

- A. Deliver hollow metal work palletized, wrapped, or crated to provide protection during transit and Project site storage. Do not use non-vented plastic.
- B. Deliver welded frames with two removable spreader bars across bottom of frames, tack welded to jambs and mullions.
- C. Store hollow metal work under cover at Project site. Place in stacks of five units maximum in a vertical position with heads up, spaced by blocking, on minimum 4-inch high wood blocking. Do not store in a manner that traps excess humidity.
  - 1. Provide minimum 1/4-inch space between each stacked door to permit air circulation. Door and frames to be stacked in a vertical upright position.

## 1.6 PROJECT CONDITIONS

- A. Field Measurements: Verify actual dimensions of openings by field measurements before fabrication.

## 1.7 COORDINATION

- A. Coordinate installation of anchorages for hollow metal frames. Furnish setting drawings, templates, and directions for installing anchorages, including sleeves, concrete inserts, anchor bolts, and items with integral anchors. Deliver such items to Project site in time for installation.

## 1.8 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace doors that fail in materials or workmanship within specified warranty period.
- B. Warranty includes installation and finishing that may be required due to repair or replacement of defective doors.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. CECO Door Products.
  - 2. Curries Company.
  - 3. Steelcraft.

### 2.2 MATERIALS

- A. Cold-Rolled Steel Sheet: ASTM A 1008/A 1008M, Commercial Steel (CS), Type B; suitable for exposed applications.
- B. Metallic-Coated Steel Sheet: ASTM A 653/A 653M, Commercial Steel (CS), Type B; with minimum G60 (Z180) or A60 (ZF180) metallic coating.
- C. Frame Anchors: ASTM A 653/A 653M, Commercial Steel (CS), Commercial Steel (CS), Type B; with minimum G60 (Z180) or A60 (ZF180) metallic coating.

### 2.3 HOLLOW METAL DOORS

- A. General: Provide 1-3/4 inch doors of design indicated, not less than thickness indicated; fabricated with smooth surfaces, without visible joints or seams on exposed faces unless otherwise indicated. Comply with ANSI/SDI A250.8 and ANSI/NAAMM HMMA 867.

## 2.4 HOLLOW METAL FRAMES

- A. General: Comply with ANSI/SDI A250.8 and with details indicated for type and profile.
- B. Interior Frames: Fabricated from cold-rolled steel sheet that complies with ASTM A 1008/A 1008M.
  - 1. Fabricate frames with mitered or coped corners. Profile as indicated on drawings.
  - 2. Frames: Minimum 16 gauge (0.053-inch -1.3-mm) thick steel sheet.
  - 3. Manufacturers Basis of Design:
    - a. Curries Company M Series.
- C. Hardware Reinforcement: Fabricate according to ANSI/SDI A250.6 Table 4 with reinforcement plates from same material as frames.

## 2.5 FRAME ANCHORS

- A. Jamb Anchors:
  - 1. Stud Wall Type: Designed to engage stud and not less than 0.042 inch thick.
- B. Floor Anchors: Floor anchors to be provided at each jamb, formed from A60 metallic coated material, not less than 0.042 inches thick.

## 2.6 ACCESSORIES

- A. Mullions and Transom Bars: Join to adjacent members by welding or rigid mechanical anchors.

## 2.7 FABRICATION

- A. Fabricate hollow metal work to be rigid and free of defects, warp, or buckle. Accurately form metal to required sizes and profiles, with minimum radius for thickness of metal. Where practical, fit and assemble units in manufacturer's plant. When shipping limitations so dictate, frames for large openings are to be fabricated in sections for splicing or splining in the field by others.
- B. Tolerances: Fabricate hollow metal work to tolerances indicated in ANSI/SDI A250.8.
- C. Hollow Metal Frames:
  - 1. Shipping Limitations: Where frames are fabricated in sections due to shipping or handling limitations, provide alignment plates or angles at each joint, fabricated of same thickness metal as frames.
  - 2. Welded Frames: Weld flush face joints continuously; grind, fill, dress, and make smooth, flush, and invisible.
    - a. Welded frames are to be provided with two steel spreaders temporarily attached to the bottom of both jambs to serve as a brace during shipping and handling. Spreader bars are for bracing only and are not to be used to size the frame opening.

3. Sidelight and Transom Bar Frames: Provide closed tubular members with no visible face seams or joints, fabricated from same material as door frame. Fasten members at crossings and to jambs by butt welding.
  4. Provide countersunk, flat- or oval-head exposed screws and bolts for exposed fasteners unless otherwise indicated for removable stops, provide security screws at exterior locations.
  5. Floor Anchors: Weld anchors to bottom of jambs and mullions with at least four spot welds per anchor.
  6. Jamb Anchors: Provide number and spacing of anchors as follows:
    - a. Stud Wall Type: Locate anchors not more than 18 inches from top and bottom of frame. Space anchors not more than 32 inches o.c. and as follows:
      - 1) Three anchors per jamb up to 60 inches high.
      - 2) Four anchors per jamb from 60 to 90 inches high.
      - 3) Five anchors per jamb from 90 to 96 inches high.
      - 4) Five anchors per jamb plus 1 additional anchor per jamb for each 24 inches or fraction thereof above 96 inches high.
      - 5) Two anchors per head for frames above 42 inches wide and mounted in metal stud partitions.
  7. Door Silencers: Except on weatherstripped or gasketed doors, drill stops to receive door silencers. Silencers to be supplied by frame manufacturer regardless if specified in Division 08 Section "Door Hardware".
- D. Hardware Preparation: Factory prepare hollow metal work to receive template mortised hardware; include cutouts, reinforcement, mortising, drilling, and tapping according to the Door Hardware Schedule and templates furnished as specified in Division 08 Section "Door Hardware."
1. Locate hardware as indicated, or if not indicated, according to ANSI/SDI A250.8.
  2. Reinforce doors and frames to receive non-template, mortised and surface mounted door hardware.
  3. Comply with applicable requirements in ANSI/SDI A250.6 and ANSI/DHI A115 Series specifications for preparation of hollow metal work for hardware.
  4. Coordinate locations of conduit and wiring boxes for electrical connections with Division 26 Sections.

## 2.8 STEEL FINISHES

- A. Prime Finishes: Doors and frames to be cleaned, and chemically treated to insure maximum finish paint adhesion. Surfaces of the door and frame exposed to view to receive a factory applied coat of rust inhibiting shop primer.
  1. Shop Primer: Manufacturer's standard, fast-curing, lead and chromate free primer complying with ANSI/SDI A250.10 acceptance criteria; recommended by primer manufacturer for substrate; and compatible with substrate and field-applied coatings.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of the Work.
- B. General Contractor to verify the accuracy of dimensions given to the steel door and frame manufacturer for existing openings or existing frames (strike height, hinge spacing, hinge back set, etc.).
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 PREPARATION

- A. Remove welded in shipping spreaders installed at factory. Restore exposed finish by grinding, filling, and dressing, as required to make repaired area smooth, flush, and invisible on exposed faces.
- B. Prior to installation, adjust and securely brace welded hollow metal frames for square, level, twist, and plumb condition.
- C. Tolerances shall comply with SDI-117 "Manufacturing Tolerances Standard Steel Doors and Frames."
- D. Drill and tap doors and frames to receive non-template, mortised, and surface-mounted door hardware.

### 3.3 INSTALLATION

- A. General: Install hollow metal work plumb, rigid, properly aligned, and securely fastened in place; comply with Drawings and manufacturer's written instructions.
- B. Hollow Metal Frames: Install hollow metal frames of size and profile indicated. Comply with ANSI/SDI A250.11 and NFPA 80 at fire rated openings.
  - 1. Set frames accurately in position, plumbed, leveled, aligned, and braced securely until permanent anchors are set. After wall construction is complete and frames properly set and secured, remove temporary braces, leaving surfaces smooth and undamaged. Shim as necessary to comply with installation tolerances.
  - 2. Floor Anchors: Provide floor anchors for each jamb and mullion that extends to floor, and secure with post-installed expansion anchors.
  - 3. Masonry Walls: Coordinate installation of frames to allow for solidly filling space between frames and masonry with mortar.
  - 4. Grout Requirements: Do not grout head of frames unless reinforcing has been installed in head of frame. Do not grout vertical or horizontal closed mullion members.
- C. Hollow Metal Doors: Fit hollow metal doors accurately in frames, within clearances specified below. Shim as necessary.

- 1. Non-Fire-Rated Standard Steel Doors:



- a. Jambs and Head: 1/8 inch plus or minus 1/16 inch.
- b. Between Edges of Pairs of Doors: 1/8 inch plus or minus 1/16 inch.
- c. Between Bottom of Door and Top of Threshold: Maximum 3/8 inch.
- d. Between Bottom of Door and Top of Finish Floor (No Threshold): Maximum 3/4 inch.

#### 3.4 ADJUSTING AND CLEANING

- A. Final Adjustments: Check and readjust operating hardware items immediately before final inspection. Leave work in complete and proper operating condition. Remove and replace defective work, including hollow metal work that is warped, bowed, or otherwise unacceptable.
- B. Remove grout and other bonding material from hollow metal work immediately after installation.
- C. Prime-Coat and Painted Finish Touchup: Immediately after erection, sand smooth rusted or damaged areas of prime coat, or painted finishes, and apply touchup of compatible air drying, rust-inhibitive primer, zinc rich primer (exterior and galvanized openings) or finish paint.

END OF SECTION 081110

## +SECTION 08 21 10 - FLUSH WOOD DOORS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:

- 1. Solid core doors with wood veneer faces.
- 2. Factory finishing wood doors.
- 3. Factory fitting wood doors to frames and factory machining for hardware.

- B. Related Sections:

- 1. Division 08 Section "Hollow Metal Doors and Frames".
- 2. Division 08 Section "Door Hardware".

- C. Standards and References: Comply with the version year adopted by the Authority Having Jurisdiction.

- 1. ANSI A117.1 - Accessible and Usable Buildings and Facilities.
- 2. ANSI A208.1 – Wood Particleboard.
- 3. Intertek Testing Service (ITS Warnock Hersey) - Certification Listings for Fire Doors.
- 4. NFPA 80 - Standard for Fire Doors and Fire Windows; National Fire Protection Association.
- 5. NFPA 252 - Standard Methods of Fire Tests of Door Assemblies; National Fire Protection Association.
- 6. UL 10C - Positive Pressure Fire Tests of Door Assemblies; UL 1784 - Standard for Air Leakage Tests of Door Assemblies.
- 7. Window and Door Manufacturers Association - WDMA I.S.1-A Architectural Wood Flush Doors.

#### 1.3 SUBMITTALS

- A. Product Data: For each type of door indicated. Include details of core and edge construction, louvers, trim for openings, and WDMA I.S.1-A classifications. Include factory finishing specifications.

- B. Shop Drawings shall include:

- 1. Indicate location, size, and hand of each door.
- 2. Indicate dimensions and locations of mortises and holes for hardware.
- 3. Indicate dimensions and locations of cutouts.
- 4. Indicate requirements for veneer matching.
- 5. Indicate location and extent of hardware blocking.
- 6. Indicate construction details not covered in Product Data.
- 7. Indicate doors to be factory finished and finish requirements.

8. Indicate fire protection ratings for fire rated doors.
- C. Samples for Initial Selection: For factory finished doors.
1. Factory finishes applied to actual door face materials, approximately 8 by 10 inches, for each material and finish. For each wood species and transparent finish, provide set of three samples showing typical range of color and grain to be expected in the finished work.
  2. Corner sections of doors, 8 by 10 inches, with door faces and edges representing actual materials to be used.
    - a. Provide samples for each species of veneer and core material.
    - b. Finish veneer faced door samples with same materials proposed for factory finished doors.
- D. Warranty: Provide sample of manufacturer's warranty.

#### 1.4 QUALITY ASSURANCE

- A. Source Limitations: Obtain flush wood doors through one source from a single manufacturer wherever possible.
- B. Quality Standard: In addition to requirements specified, comply with WDMA I.S.1-A, latest edition, "Industry Standard for Architectural Wood Flush Doors'.
- C. Pre-Submittal Conference: Conduct conference in compliance with requirements in Division 01 Section "Project Meetings" with attendance by representatives of Supplier, Installer, and Contractor to review proper methods and procedures for receiving, handling, and installing flush wood doors.

#### 1.5 DELIVERY, STORAGE, AND HANDLING

- A. Comply with requirements of referenced standard and manufacturer's written instructions.
- B. Package pre-finished doors individually in plastic bags and wrap bundles of doors in plastic sheeting.
- C. Mark each door on top rail with opening number used on Shop Drawings.

#### 1.6 PROJECT CONDITIONS

- A. Environmental Limitations: Do not deliver or install doors until spaces are enclosed and weather tight, wet work in spaces is complete and dry, and HVAC system is operating and maintaining ambient temperature and humidity conditions at occupancy levels during the remainder of the construction period.

#### 1.7 WARRANTY

- A. Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace doors that fail in materials or workmanship within specified warranty period.

1. Failures include, but are not limited to, the following:
  - a. Warping (bow, cup, or twist) more than 1/4 inch in a 42-by-84-inch section.
  - b. Telegraphing of core construction in wood face veneers exceeding 0.01 inch in a 3-inch span.
2. Warranty includes installation and finishing that may be required due to repair or replacement of defective doors.
3. Warranty Period for Solid Core Interior Doors: Life of installation.

## PART 2 - PRODUCTS

### 2.1 DOOR CONSTRUCTION – GENERAL

- A. WDMA I.S.1-A Performance Grade: Extra Heavy Duty; Aesthetic Grade: Premium.

### 2.2 CORE CONSTRUCTION

- A. Particleboard Core Doors:

1. Particleboard: Wood fiber based materials complying with ANSI A208.1 Particleboard standard. Grade LD-2.
2. Adhesive: Fully bonded construction using Polyurethane (PUR) glue.
3. Blocking: As indicated under article “Blocking”.

### 2.3 VENEERED DOORS FOR TRANSPARENT FINISH

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Eggers Industries: Premium Series.
2. Masonite Architectural - Graham: Cendura Series.
3. VT Industries: Heritage Collection.

- B. Interior Solid Core Doors:

1. Grade: Premium.
2. Faces: Veneer grades as noted below; veneer minimum 1/50-inch (0.5mm) thickness at moisture content of 12% or less.
  - a. Match existing wood species and grain.
3. Vertical Edges: Matching same species as faces. Wood or composite material, one piece, laminated, or veneered. Minimum requirements per WDMA section P-1, Performance Standards for Architectural Wood Flush Doors.

4. Horizontal Edges: Solid wood or structural composite material meeting the minimum requirements per WDMA section P-1, Performance Standards for Architectural Wood Flush Doors
5. Construction: Five plies. Stiles and rails are bonded to core, then entire unit sanded before applying face veneers.

## 2.4 FABRICATION

- A. Factory fit doors to suit frame opening sizes indicated.
  1. Comply with requirements in NFPA 80 for fire rated doors.
  2. Undercut: As required per manufacturer's templates and sill condition.
- B. Factory machine doors for hardware that is not surface applied. Comply with final hardware schedules, door frame Shop Drawings, DHI A115-W series standards, and hardware templates.
  1. Coordinate with hardware mortises in metal frames to verify dimensions and alignment before factory machining.

## 2.5 FACTORY FINISHING

- A. General: Comply with referenced quality standard for factory finishing. Complete fabrication, including fitting doors for openings and machining for hardware that is not surface applied, before finishing.
  1. Finish faces, all four edges, edges of cutouts, and mortises. Stains and fillers may be omitted on top and bottom edges, edges of cutouts, and mortises.
- B. Transparent Finish: Provide a clear protective coating over the wood veneer allowing the natural color and grain of the selected wood species to provide the appearance specified. Stain is applied to the wood surface underneath the transparent finish to add color and design flexibility.
  1. Finish: Meet or exceed WDMA I.S. 1A TR8 UV Cured Acrylated Polyester finish performance requirements.
  2. Staining:
    - a. As selected by Architect from manufacturer's full range.
    - b. Custom stain to match architect's sample.
  3. Sheen: Satin.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine doors and installed door frames before hanging doors.
  1. Verify that frames comply with indicated requirements for type, size, location, and swing characteristics and have been installed with level heads and plumb jambs.
  2. Reject doors with defects.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 INSTALLATION

- A. Hardware: For installation, see Division 8 Section "Door Hardware."
- B. Installation Instructions: Install doors and frames to comply with manufacturer's written instructions and the referenced quality standard, and as indicated.
  - 1. Install fire rated doors in corresponding fire rated frames according to NFPA 80.
- C. Factory Fitted Doors: Align in frames for uniform clearance at each edge.
- D. Factory Finished Doors: Restore finish before installation if fitting or machining is required at Project site.
- E. Field modifications to doors shall not be permitted, except those specifically allowed by manufacturer or fire rating requirements.

### 3.3 ADJUSTING

- A. Operation: Re-hang or replace doors that do not swing or operate freely.
- B. Finished Doors: Replace doors that do not comply with requirements. Doors may be repaired or refinished if work complies with requirements and shows no evidence of repair or refinishing.

END OF SECTION 082110

## SECTION 084113 - ALUMINUM-FRAMED ENTRANCES AND STOREFRONTS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes the following:

- 1. Exterior and interior aluminum-framed storefronts.
  - a. Glazing is retained mechanically with gaskets on four sides.

- B. Related Sections include the following:

- 1. Division 7 Section "Building Insulation" for insulation materials field installed with aluminum-framed systems.
- 2. Division 7 Section "Joint Sealants" for installation of joint sealants installed with aluminum-framed systems and for sealants to the extent not specified in this Section.
- 3. Division 8 Section "Door Hardware" for hardware to the extent not specified in this Section.
- 4. Division 8 Section "Glazing" for glazing requirements to the extent not specified in this Section.

#### 1.3 PERFORMANCE REQUIREMENTS

- A. General: Provide aluminum-framed systems, including anchorage, capable of withstanding, without failure, the effects of the following:

- 1. Structural loads.
- 2. Thermal movements.
- 3. Movements of supporting structure indicated on Drawings including, but not limited to, story drift and deflection from uniformly distributed and concentrated live loads.
- 4. Dimensional tolerances of building frame and other adjacent construction.
- 5. Failure includes the following:
  - a. Deflection exceeding specified limits.
  - b. Thermal stresses transferred to building structure.
  - c. Framing members transferring stresses, including those caused by thermal and structural movements, to glazing.
  - d. Glazing-to-glazing contact.
  - e. Noise or vibration created by wind and thermal and structural movements.
  - f. Loosening or weakening of fasteners, attachments, and other components.
  - g. Sealant failure.
  - h. Failure of operating units to function properly.

- B. Structural Sealant: Capable of withstanding tensile and shear stresses imposed by aluminum-framed systems without failing adhesively or cohesively. Provide sealant that fails cohesively before sealant releases from substrate when tested for adhesive compatibility with each substrate and joint condition required.
  - 1. Adhesive failure occurs when sealant pulls away from substrate cleanly, leaving no sealant material behind.
  - 2. Cohesive failure occurs when sealant breaks or tears within itself but does not separate from each substrate because sealant-to-substrate bond strength exceeds sealant's internal strength.
- C. Structural-Sealant Joints: Designed to produce tensile or shear stress in structural-sealant joints of less than 20 psi.
- D. Structural Loads:
  - 1. Wind Loads: 25 pounds per square foot.
- E. Deflection of Framing Members:
  - 1. Deflection: Limited to 1/175 of clear span for spans up to 13 feet 6 inches and to 1/240 of clear span plus 1/4 inch for spans greater than 13 feet 6 inches or an amount that restricts edge deflection of individual glazing lites to 3/4 inch, whichever is less.
- F. Air Infiltration: Provide aluminum-framed systems with maximum air leakage through fixed glazing and framing areas of 0.06 cfm/sq. ft. of fixed wall area when tested according to ASTM E 283 at a minimum static-air-pressure difference of 1.57 lbf/sq. ft. .

#### 1.4 SUBMITTALS

- A. Product Data: Include construction details, material descriptions, dimensions of individual components and profiles, and finishes for each type of product indicated.
- B. Shop Drawings: For aluminum-framed systems. Include plans, elevations, sections, details, and attachments to other work.
  - 1. Include structural analysis data signed and sealed by the qualified professional engineer responsible for their preparation.
  - 2. Include details of provisions for system expansion and contraction and for draining moisture occurring within the system to the exterior.
  - 3. For entrances, include hardware schedule and indicate operating hardware types, functions, quantities, and locations.
- C. Maintenance Data: For aluminum-framed systems to include in maintenance manuals.
- D. Warranties: Special warranties specified in this Section.

#### 1.5 QUALITY ASSURANCE

- A. Installer Qualifications: Capable of assuming engineering responsibility and performing work of this Section and who is acceptable to manufacturer.



- B. Accessible Entrances: Comply with Accessibility Guidelines for Buildings and Facilities (ADAAG)."
- C. Welding: Qualify procedures and personnel according to AWS D1.2, "Structural Welding Code--Aluminum."
- D. Structural-Sealant Glazing: Comply with recommendations in ASTM C 1401, "Guide for Structural Sealant Glazing."
- E. Structural-Sealant Joints: Design reviewed and approved by structural-sealant manufacturer.

## 1.6 PROJECT CONDITIONS

- A. Field Measurements: Verify actual locations of structural supports for aluminum-framed systems by field measurements before fabrication and indicate measurements on Shop Drawings.

## 1.7 WARRANTY

- A. Special Assembly Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace components of aluminum-framed systems that do not comply with requirements or that deteriorate as defined in this Section within specified warranty period.
  - 1. Failures include, but are not limited to, the following:
    - a. Structural failures including, but not limited to, excessive deflection.
    - b. Noise or vibration caused by thermal movements.
    - c. Deterioration of metals, metal finishes, and other materials beyond normal weathering.
    - d. Adhesive or cohesive sealant failures.
    - e. Water leakage through fixed glazing and framing areas.
    - f. Failure of operating components to function properly.
  - 2. Warranty Period: Five years from date of Substantial Completion.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Arch Aluminum & Glass Co., Inc.
  - 2. EFCO Corporation.
  - 3. Kawneer.
  - 4. Tubelite Inc.
  - 5. United States Aluminum.
  - 6. Vistawall Architectural Products.

## 2.2 MATERIALS

- A. Aluminum: Alloy and temper recommended by manufacturer for type of use and finish indicated.
  - 1. Sheet and Plate: ASTM B 209 .
  - 2. Extruded Bars, Rods, Profiles, and Tubes: ASTM B 221.
  - 3. Extruded Structural Pipe and Tubes: ASTM B 429.
  - 4. Structural Profiles: ASTM B 308/B 308M.
  - 5. Welding Rods and Bare Electrodes: AWS A5.10/A5.10M.
  
- B. Steel Reinforcement: With manufacturer's standard corrosion-resistant primer complying with SSPC-PS Guide No. 12.00 applied immediately after surface preparation and pretreatment. Select surface preparation methods according to recommendations in SSPC-SP COM and prepare surfaces according to applicable SSPC standard.
  - 1. Structural Shapes, Plates, and Bars: ASTM A 36/A 36M.
  - 2. Cold-Rolled Sheet and Strip: ASTM A 1008/A 1008M.
  - 3. Hot-Rolled Sheet and Strip: ASTM A 1011/A 1011M.

## 2.3 FRAMING SYSTEMS

- A. Framing Members: Manufacturer's standard extruded-aluminum framing members of thickness required and reinforced as required to support imposed loads.
  
- B. Brackets and Reinforcements: Manufacturer's standard high-strength aluminum with nonstaining, nonferrous shims for aligning system components.
  
- C. Fasteners and Accessories: Manufacturer's standard corrosion-resistant, nonstaining, nonbleeding fasteners and accessories compatible with adjacent materials.
  - 1. Where fasteners are subject to loosening or turning out from thermal and structural movements, wind loads, or vibration, use self-locking devices.
  - 2. Reinforce members as required to receive fastener threads.
  - 3. Use exposed fasteners with countersunk Phillips screw heads, finished to match framing system.
  
- D. Concrete and Masonry Inserts: Hot-dip galvanized cast-iron, malleable-iron, or steel inserts complying with ASTM A 123/A 123M or ASTM A 153/A 153M requirements.
  
- E. Flashing: Manufacturer's standard corrosion-resistant, nonstaining, nonbleeding flashing compatible with adjacent materials. Form exposed flashing from sheet aluminum finished to match framing and of sufficient thickness to maintain a flat appearance without visible deflection.
  
- F. Framing System Gaskets and Sealants: Manufacturer's standard recommended by manufacturer for joint type.

## 2.4 GLAZING SYSTEMS

- A. Glazing: As specified in Division 8 Section "Glazing."

- B. Glazing Gaskets: Manufacturer's standard compression types, replaceable, molded or extruded, that maintain uniform pressure and watertight seal.
- C. Spacers and Setting Blocks: Manufacturer's standard elastomeric types.
- D. Bond-Breaker Tape: Manufacturer's standard TFE-fluorocarbon or polyethylene material to which sealants will not develop adhesion.
- E. Glazing Sealants: For structural-sealant-glazed systems, as recommended by manufacturer for joint type and as follows:
  - 1. Structural Sealant: ASTM C 1184, neutral-curing silicone formulation compatible with system components with which it comes in contact, specifically formulated and tested for use as structural sealant, and approved by structural-sealant manufacturer for use in aluminum-framed systems indicated.
    - a. Color: As selected by Architect from manufacturer's full range of colors.
  - 2. Weatherseal Sealant: ASTM C 920 for Type S, Grade NS, Class 25, Uses NT, G, A, and O; neutral-curing silicone formulation compatible with structural sealant and other system components with which it comes in contact; and recommended by structural- and weatherseal-sealant and aluminum-framed system manufacturers for this use.
    - a. Color: Matching structural sealant.

## 2.5 DOORS

- A. Doors: Manufacturer's standard glazed doors, for manual swing operation.
  - 1. Door Construction: 1-3/4-inch overall thickness, with minimum 0.125-inch-thick, extruded-aluminum tubular rail and stile members. Mechanically fasten corners with reinforcing brackets that are deep penetration and fillet welded or that incorporate concealed tie rods.
  - 2. Door Design: Wide stile; 5-inch nominal width.
  - 3. Glazing Stops and Gaskets: Beveled, snap-on, extruded-aluminum stops and preformed gaskets.
    - a. Provide nonremovable glazing stops on outside of door.

## 2.6 DOOR HARDWARE

- A. General: Provide heavy-duty units in sizes and types recommended by entrance system and hardware manufacturers for entrances and uses indicated.
  - 1. Opening-Force Requirements:
    - a. Egress Doors: Not more than 30 lbf required to set door in motion and not more than 15 lbf required to open door to minimum required width.
    - b. Accessible Interior Doors: Not more than 5 lbf .

- B. Continuous-Gear Hinges: Manufacturer's standard with stainless-steel bearings between knuckles; fabricated to full height of door and frame.
- C. Locking Devices, General: Do not require use of key, tool, or special knowledge for operation.
  - 1. Opening-Force Requirements:
    - a. Latches and Exit Devices: Not more than 15 lbf required to release latch.
- D. Mortise Auxiliary Locks: BHMA A156.5, Grade 1.
- E. Manual Flush Bolts: BHMA A156.16, Grade 1.
- F. Automatic and Self-Latching Flush Bolts: BHMA A156.3, Grade 1.
- G. Panic Exit Devices: Listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for panic protection, based on testing according to UL 305.
  - 1. Standard: BHMA A156.3, Grade 1.
- H. Cylinders: BHMA A156.5, Grade 1.
  - 1. Keying: Master key system.
- I. Strikes: Provide strike with black-plastic dust box for each latch or lock bolt; fabricated for aluminum framing.
- J. Operating Trim: BHMA A156.6.
- K. Closers: With accessories required for a complete installation, sized as required by door size, exposure to weather, and anticipated frequency of use, and adjustable to meet field conditions and requirements for opening force.
  - 1. Standard: BHMA A156.4, Grade 1.
- L. Concealed Overhead Holders: BHMA A156.8, Grade 1.
- M. Surface-Mounted Holders: BHMA A156.16, Grade 1.
- N. Door Stops: BHMA A156.16, Grade 1, floor or wall mounted, as appropriate for door location indicated, with integral rubber bumper.
- O. Weather Stripping: Manufacturer's standard replaceable components.
- P. Weather Sweeps: Manufacturer's standard exterior-door bottom sweep with concealed fasteners on mounting strip.
- Q. Silencers: BHMA A156.16, Grade 1.
- R. Thresholds: Raised thresholds beveled with a slope of not more than 1:2, with maximum height of 1/2 inch.
  - 1. Standard: BHMA A156.21.

## 2.7 ACCESSORY MATERIALS

- A. Insulating Materials: As specified in Division 7 Section "Building Insulation."
- B. Joint Sealants: For installation at perimeter of aluminum-framed systems, as specified in Division 7 Section "Joint Sealants."
- C. Bituminous Paint: Cold-applied asphalt-mastic paint complying with SSPC-Paint 12 requirements except containing no asbestos, formulated for 30-mil thickness per coat.

## 2.8 FABRICATION

- A. Form aluminum shapes before finishing.
- B. Weld in concealed locations to greatest extent possible to minimize distortion or discoloration of finish. Remove weld spatter and welding oxides from exposed surfaces by descaling or grinding.
- C. Framing Members, General: Fabricate components that, when assembled, have the following characteristics:
  - 1. Profiles that are sharp, straight, and free of defects or deformations.
  - 2. Accurately fitted joints with ends coped or mitered.
  - 3. Means to drain water passing joints, condensation occurring within framing members, and moisture migrating within the system to exterior.
  - 4. Physical and thermal isolation of glazing from framing members.
  - 5. Accommodations for thermal and mechanical movements of glazing and framing to maintain required glazing edge clearances.
  - 6. Fasteners, anchors, and connection devices that are concealed from view to greatest extent possible.
- D. Door Frames: Reinforce as required to support loads imposed by door operation and for installing hardware.
  - 1. At exterior doors, provide compression weather stripping at fixed stops.
  - 2. At interior doors, provide silencers at stops to prevent metal-to-metal contact. Install three silencers on strike jamb of single-door frames and two silencers on head of frames for pairs of doors.
- E. Doors: Reinforce doors as required for installing hardware.
  - 1. At pairs of exterior doors, provide sliding weather stripping retained in adjustable strip mortised into door edge.
  - 2. At exterior doors, provide weather sweeps applied to door bottoms.
- F. Hardware Installation: Factory install hardware to the greatest extent possible. Cut, drill, and tap for factory-installed hardware before applying finishes.

## 2.9 ALUMINUM FINISHES

- A. Finish of Aluminum Components

1. Finish of all exposed areas of aluminum windows and components shall be done in accordance with the appropriate AAMA Voluntary Guide Specification shown.
  - a. AA-M10C21A41, Class I, AAMA 611, Clear Anodized (match existing)

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine areas, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of work.
  1. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 INSTALLATION

- A. General:
  1. Comply with manufacturer's written instructions.
  2. Do not install damaged components.
  3. Fit joints to produce hairline joints free of burrs and distortion.
  4. Rigidly secure nonmovement joints.
  5. Install anchors with separators and isolators to prevent metal corrosion and electrolytic deterioration.
  6. Seal joints watertight, unless otherwise indicated.
- B. Metal Protection:
  1. Where aluminum will contact dissimilar metals, protect against galvanic action by painting contact surfaces with primer or by applying sealant or tape or installing nonconductive spacers as recommended by manufacturer for this purpose.
  2. Where aluminum will contact concrete or masonry, protect against corrosion by painting contact surfaces with bituminous paint.
- C. Install components to drain water passing joints, condensation occurring within framing members, and moisture migrating within the system to exterior.
- D. Set continuous sill members and flashing in full sealant bed as specified in Division 7 Section "Joint Sealants" and to produce weathertight installation.
- E. Install components plumb and true in alignment with established lines and grades, without warp or rack.
- F. Install glazing as specified in Division 8 Section "Glazing."
- G. Entrances: Install to produce smooth operation and tight fit at contact points.
  1. Exterior Entrances: Install to produce tight fit at weather stripping and weathertight closure.
  2. Field-Installed Hardware: Install surface-mounted hardware according to hardware manufacturers' written instructions using concealed fasteners to greatest extent possible.

- H. Install insulation materials as specified in Division 7 Section "Building Insulation."
- I. Install perimeter joint sealants as specified in Division 7 Section "Joint Sealants" and to produce weathertight installation.
- J. Erection Tolerances: Install aluminum-framed systems to comply with the following maximum tolerances:
  - 1. Location and Plane: Limit variation from true location and plane to 1/8 inch in 12 feet ; 1/4 inch over total length.
  - 2. Alignment:
    - a. Where surfaces abut in line, limit offset from true alignment to 1/16 inch.
    - b. Where surfaces meet at corners, limit offset from true alignment to 1/32 inch .
  - 3. Diagonal Measurements: Limit difference between diagonal measurement to 1/8 inch.

### 3.3 ADJUSTING

- A. Entrances: Adjust operating hardware for smooth operation according to hardware manufacturers' written instructions.

END OF SECTION 084313

## SECTION 085200 ALUMINUM WINDOWS

### PART 1 GENERAL

#### 1.01 SUMMARY

##### A. Section Includes:

1. All exterior windows furnished and installed as shown on drawings, specified in this section and designated in AAMA 101/I.S.2.
2. All labor, materials, tools, equipment and services needed to furnish and install Architectural Performance Class windows.
3. Components furnished with installed windows.
4. Installation accessories furnished and installed.

#### 1.02 SYSTEM PERFORMANCE REQUIREMENTS

##### A. Design Wind Loads

1. The design wind pressure for the project will be
  - a. 30.1/-33.1 psf positive and negative; -36.8 psf at corner zones.
  - b. Per wind pressure diagram.
  - c. Per local building codes.
2. All structural components, including meeting rails, mullions and anchors shall be designed accordingly, complying with deflection and stress requirements of Paragraph 1.02 B.

##### B. Air, Water and Structural Performance Requirements

1. When tested in accordance with cited test procedures, windows shall meet or exceed the following performance criteria, as well as those indicated in AAMA 101/I.S.2 for Architectural (AW) Performance Class windows, Performance Grade 80 (AW80) unless otherwise noted herein.
2. Air Test Performance Requirements
  - a. Air infiltration maximum 0.1 cfm per square foot at 6.24 psf pressure differential when tested in accordance with ASTM E283.
3. Water Test Performance Requirements
  - a. No uncontrolled water leakage at 12.00 psf static pressure differential, with water application rate of 5 gallons/hr/sq ft when tested in accordance with ASTM E331.
4. Structural Test Performance Requirements
  - a. Uniform Load Deflection Test
    - i. No deflection of any unsupported span L of test unit (framing rails, muntins, mullions, etc.) in excess of L/175 at both a positive and negative load of 80 psf (design test pressure) when tested in accordance with ASTM E330.
    - ii. Structural reinforcing that is not standard on units being furnished is not allowed.
  - b. Uniform Load Structural Test



- i. Unit to be tested at 1.5 x design test pressure (120 psf), both positive and negative, acting normal to plane of wall in accordance with ASTM E330.
- ii. No glass breakage; permanent damage to fasteners, hardware parts, or anchors; damage to make windows inoperable; or permanent deformation of any main frame or ventilator member in excess of 0.2% of its clear span.

C. Life Cycle Testing:

1. When tested in accordance with AAMA 910-93, there is to be no damage to fasteners, hardware parts, support arms, activating mechanisms or any other damage that would cause the window to be inoperable at the conclusion of testing. Air infiltration and water resistance tests shall meet the primary performance requirements specified.

D. Thermal Transmittance (U-Value):

1. Whole window U-Value based on NFRC 100 test sizes and calculated by using NFRC approved versions of Windows and Therm software. Thermal transmittance (U-Value) shall not exceed 0.43 BTU/hr/sf/degF for projected vents and casements, or 0.32 BTU/hr/sf/degF for fixed windows when calculated using a COG glass U-value of .24 BTU/hr/sf/degF. Glazing must be supported by Manko Window Systems, Inc. using EdgeTech "TriSeal Superspacer" to meet these requirements.

E. Solar Heat Gain (SHGC):

1. Whole window SHGC Value based on NFRC 200 test sizes and calculated by using NFRC approved versions of Windows and Therm software. SHGC shall not exceed 0.19 for projected vents and casements, or 0.24 for fixed windows when calculated using a Center of Glass (COG) SHGC of .26.

F. Condensation Resistance (CR)

1. Condensation resistance (CR) based on NFRC 500 test sizes and calculated by using NFRC approved Windows and Therm software, shall not be less than 49 for project in/out vents and casements, or 54 for fixed windows when calculated using a COG glass U-value of .24 BTU/hr/sf/degF.

1.03 SUBMITTALS

A. General Requirements

1. Provide all submittals in a timely manner to meet the required construction completion schedule.

## B. Shop Drawings

1. Shop drawings must be prepared wholly by the window manufacturer, or a qualified engineering services firm under the direction of the manufacturer. Shop drawings for pre-engineered configurations may be prepared by installers authorized per 1.04 QUALITY ASSURANCE.
2. Provide design details along with bid proposals to define system aesthetic and functional characteristics.
3. Provide submittals in compliance with Section 01 33 00 - Submittal Procedures.

## C. Samples

1. Components: Submit samples of anchors, fasteners, hardware, assembled corner sections and other materials and components as requested by Architect.
2. Finish: Submit physical color samples for Architect's approval as requested.

## D. Test Reports and Calculations

1. Submit certified independent laboratory test reports verifying compliance with all test requirements of 1.02 SYSTEM PERFORMANCE REQUIREMENTS as requested by Architect.

## 1.04 QUALITY ASSURANCE

### A. Qualifications

1. Upon request, the window manufacturer will provide written confirmation that the installer is authorized to install window products to be used on this project.

## 1.05 DELIVERY, STORAGE AND HANDLING

### A. Packing, Shipping, Handling and Unloading

1. Materials will be packed, loaded, shipped, unloaded, stored and protected in accordance with AAMA CW-10.

## 1.06 WARRANTY

### A. Aluminum Window Warranty

1. Products: Submit a written warranty, executed by the window manufacturer, for a period of 2 years (10 years for insulated glass seal failure) from the date of manufacture, against defective materials or workmanship, including substantial non-compliance with applicable specification requirements and industry standards, which results in premature failure of the windows, finish, factory-glazed glass, or parts, outside of normal wear.
  - a. In the event that windows or components are found defective, manufacturer will repair or provide replacements without charge at manufacturer's option.
  - b. Warranty for all components must be direct from the manufacturer (non-pass through) and non-prorated for the entire term. Warranty must be assignable to the non-residential owner, and transferable to subsequent owners through its length.

2. Installation: Submit a written warranty, executed by the window installer, for a period of 2 years from the date of substantial completion, against defective materials or workmanship, including substantial non-compliance with applicable specification requirements, which result in premature failure.
  - a. In the event that installation of windows or components is found to be defective, installer will repair or provide replacements without charge at the installer's option.

## PART 2 - PRODUCTS

### 2.01 MANUFACTURERS

#### A. Acceptable Manufacturer

1. Drawings and specifications are based on:
  - a. Manko Window Systems, Inc. 3527i Series Casement Windows.

### 2.02 MATERIALS

#### A. Aluminum Members

1. Extruded aluminum prime billet 6063-T5 or 6063-T6 alloy for primary components; 6063-T5, 6063-T6, or 6061-T6 for structural components; all meeting the requirements of ASTM B221.
  - a. Aluminum sheet alloy 5005 H 32 (for anodic finish), meeting the requirements of ASTM B209 or alloy 3003 H 14 (for painted or unfinished sheet).

### 2.03 MANUFACTURED UNITS

#### A. Materials

1. Principal window frame members will be a minimum 0.094" in thickness at all structural areas, hardware mounting webs, and section flanges.
2. Extruded or formed trim components will be a minimum 0.062" in thickness.

#### B. Fabrication

1. Frame depth 4" minimum.
2. Sash depth 2.75" minimum.

### 2.04 COMPONENTS

- A. All steel components including attachment fasteners to be 300 series stainless steel (or other corrosion resistant material) except as noted.

- B. Extruded aluminum components 6063-T5 or 6063-T6.
- C. Thermoplastic or thermo-set plastic caps, housings and other components to be injection-molded nylon, extruded PVC, or other suitable compound.
- D. Sealants
  - 1. All sealants shall comply with applicable provisions of AAMA 800 and/or Federal Specifications FS-TT-001 and 002 Series.
  - 2. Frame joinery sealants shall be suitable for application specified and as tested and approved by window manufacturer.
- E. Glass
  - 1. Provide 1" Sealed insulated glass meeting ASTM E 2190 in accordance with Section 08800.
- F. Glazing
  - 1. Provide in general accordance with Section 08800.
  - 2. Glazing method shall be in general accordance with the FGMA Glazing Manual for specified glass type, or as approved by the glass fabricator.
- G. Glazing Materials
  - 1. Setting Blocks/Edge Blocking: Provide in sizes and locations recommended by FGMA Glazing Manual.
  - 2. Back-bedding tapes, expanded cellular glazing tapes, toe beads, heel beads and cap beads shall meet the requirements of applicable specifications cited in AAMA 800.
  - 3. Glazing gaskets shall be non-shrinking, weather-resistant, and compatible with all materials in contact.
  - 4. Structural silicone sealant where used shall meet the requirements of ASTM C 1184.
  - 5. Spacer tape in continuous contact with structural silicone shall be tested for compatibility and approved by the sealant manufacturer for the intended application. Gaskets in continuous contact with structural silicone shall be extruded silicone or compatible material.
- H. Steel Components
  - 1. Provide steel reinforcements as necessary to meet the system performance requirements of 1.02.
  - 2. Concealed steel anchors and reinforcing shall be factory painted after fabrication with rust-inhibitive primer complying with Federal Specification TT-P-645.
- J. Thermal Break Construction:
  - 1. Structural Thermal Barrier
    - a. Structural thermal barriers shall consist of polyimide nylon 6.6 struts reinforced with glass fibers oriented in all three (3) axis.
      - i. Frame and sash members must include a thermal break applied in the manufacturer's facility, using a low conductance consisting of twin polyimide struts not less than 24mm in length.

## 2.05 FABRICATION

### A. General:

1. Finish, fabricate and shop assemble frame and sash members into complete windows under the responsibility of one manufacturer.
2. No bolts, screws or fastenings to bridge thermal barrier or impair independent frame movement.
3. Fabricate to allow for thermal movement of materials when subjected to a temperature differential from -30 degrees F to +180 degrees F.

### B. Frames:

1. Cope and mechanically fasten each corner, or miter all corners and mechanically stake over a solid extruded aluminum corner key leaving only hairline joinery, then seal weather tight.

## 2.06 FINISHES

### A. Finish of Aluminum Components

1. Finish of all exposed areas of aluminum windows and components shall be done in accordance with the appropriate AAMA Voluntary Guide Specification shown, as selected by Architect.

Designation	Description	Standard	Color
AAM12C21Axx	Electrolytically Deposited – Class I	AAMA 611	Champagne, Light Bronze, Medium Bronze, Dark Bronze

## PART 3 EXECUTION

### 3.01 EXAMINATION

#### A. Site Verification of Conditions

1. Verify that building substrates permit installation of windows according to the manufacturer's instructions, approved shop drawings, calculations and contract documents.
2. Do not install windows until unsatisfactory conditions are corrected.

### 3.02 INSTALLATION

#### A. Erection of Aluminum Windows

1. Install windows with skilled tradesman in exact accordance with approved shop drawings, installation instructions, specifications, and AAMA 101/I.S.2.
2. Windows must be installed plumb, square and level for proper weathering and operation. Jambs must not be “sprung”, bowed or warped during installation.
3. Aluminum that is not organically coated shall be insulated from direct contact with steel, masonry, concrete or other dissimilar metals by bituminous paint, zinc chromate primer, nonconductive shims or other suitable insulating material.

END OF SECTION

## SECTION 087100 - DOOR HARDWARE

### PART 1 - GENERAL

#### 1.1 SUMMARY

A. Section includes:

1. Mechanical door hardware for the following:

- a. Swinging doors.

B. Related Sections include the following:

1. Division 8 Section "Aluminum Framed Entrances and Storefronts" to the extent not specified in this section.
2. Division 8 Section "Glazing" for glazing requirements to extent not specified in this section.

#### 1.2 ACTION SUBMITTALS

A. Product Data: For each type of product indicated.

B. Other Action Submittals:

1. Door Hardware Schedule: Prepared by or under the supervision of Installer, detailing fabrication and assembly of door hardware, as well as installation procedures and diagrams. Coordinate final door hardware schedule with doors, frames, and related work to ensure proper size, thickness, hand, function, and finish of door hardware.

- a. Format: Use same scheduling sequence and format and use same door numbers as in the Contract Documents.
- b. Content: Include the following information:
  - 1) Identification number, location, hand, fire rating, size, and material of each door and frame.
  - 2) Locations of each door hardware set, cross-referenced to Drawings on floor plans and to door and frame schedule.
  - 3) Complete designations, including name and manufacturer, type, style, function, size, quantity, function, and finish of each door hardware product.
  - 4) Description of electrified door hardware sequences of operation and interfaces with other building control systems.

2. Keying Schedule: Prepared by or under the supervision of hardware consultant, detailing Owner's final keying instructions for locks.

#### 1.3 QUALITY ASSURANCE

A. Architectural Hardware Consultant Qualifications: A person who is experienced in providing consulting services for door hardware installations that are comparable in material, design, and extent to that indicated for this Project and who is currently certified by DHI as follows:

1. For door hardware, an Architectural Hardware Consultant (AHC).
- B. Source Limitations: Provide electrified door hardware from same manufacturer as mechanical door hardware, unless otherwise indicated. Manufacturers that perform electrical modifications and that are listed by a testing and inspecting agency acceptable to authorities having jurisdiction are acceptable.
- C. Means of Egress Doors: Latches do not require more than 15 lbf to release the latch. Locks do not require use of a key, tool, or special knowledge for operation.
- D. Accessibility Requirements: For door hardware on doors in an accessible route, comply with the U.S. Architectural & Transportation Barriers Compliance Board's ADA-ABA Accessibility Guidelines ICC/ANSI A117.1.
  1. Provide operating devices that do not require tight grasping, pinching, or twisting of the wrist and that operate with a force of not more than 5 lbf.
  2. Comply with the following maximum opening-force requirements:
    - a. Interior, Non-Fire-Rated Hinged Doors: 5 lbf applied perpendicular to door.
    - b. Fire Doors: Minimum opening force allowable by authorities having jurisdiction.
  3. Bevel raised thresholds with a slope of not more than 1:2. Provide thresholds not more than 1/2 inch high.
  4. Adjust door closer sweep periods so that, from an open position of 70 degrees, the door will take at least 3 seconds to move to a point 3 inches from the latch, measured to the leading edge of the door.

#### 1.4 DELIVERY, STORAGE, AND HANDLING

- A. Inventory door hardware on receipt and provide secure lock-up for door hardware delivered to Project site.
- B. Tag each item with identification related to the final door hardware sets, and include basic installation instructions, templates, and necessary fasteners with each item or package.
- C. Deliver keys to Owner by registered mail or overnight package service.

#### 1.5 COORDINATION

- A. Templates: Distribute door hardware templates for doors, frames, and other work specified to be factory prepared for installing door hardware. Check Shop Drawings of other work to confirm that adequate provisions are made for locating and installing door hardware to comply with indicated requirements.

#### 1.6 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace components of door hardware that fails in materials or workmanship within specified warranty period.
  1. Warranty Period: Two years from date of Substantial Completion, unless otherwise indicated.



- a. Locksets: Five years from date of substantial Completion.

## PART 2 - PRODUCTS

### 2.1 SCHEDULED DOOR HARDWARE

- A. Provide door hardware for each door as scheduled in Part 3 "Door Hardware Schedule" to comply with requirements in this Section.
  1. Door Hardware Sets: Provide quantity, item, size, finish or color indicated, and named manufacturers' products. Products complying with BHMA designations referenced.
  2. Sequence of Operation: Provide electrified door hardware function, sequence of operation, and interface with other building control systems indicated.
- B. Designations: Requirements for design, grade, function, finish, size, and other distinctive qualities of each type of door hardware are indicated in Part 3 "Door Hardware Schedule" Article. Products are identified by using door hardware designations, as follows:
  1. Named Manufacturers' Products: Manufacturer and product designation are listed for each door hardware type required for the purpose of establishing requirements. Manufacturers' names are abbreviated in Part 3 "Door Hardware Schedule" Article.

### 2.2 HINGES

- A. Hinges: BHMA A156.1. Provide template-produced hinges for hinges installed on hollow-metal doors and hollow-metal frames. Provide 5 knuckle ball bearing design. Provide with additional features as scheduled.
  1. Available Manufacturers:
    - a. Bommer Industries (BB)
    - b. Hager Hinge Co.; (BB)
    - c. Ives Hardware; an Allegion Company. (5BB)
    - d. McKinney Products Company; an Assa Abloy Group company (TB)
    - e. Stanley Commercial Hardware. (FBB)

### 2.1 LOCKS AND LATCHES, GENERAL

- A. Accessibility Requirements: Where indicated to comply with accessibility requirements, comply with ANSI A117.1. FED-STD-795, "Uniform Federal Accessibility Standards."
  1. Provide operating devices that do not require tight grasping, pinching, or twisting of the wrist and that operate with a force of not more than 5 lbf.
- B. Latches and Locks for Means of Egress Doors: Comply with NFPA 101. Latches shall not require more than 15 lbf to release the latch. Locks shall not require use of a key, tool, or special knowledge for operation.
- C. Lock Trim:
  1. Levers: Cast, plated to finish specified.

2. Escutcheons: Wrought
  3. Lockset Designs: Provide design indicated.
- D. Lock Throw: Comply with testing requirements for length of bolts required for labeled fire doors, and as follows:
1. Bored Locks: Minimum 1/2-inch (13-mm) latchbolt throw.
  2. Deadbolts: Minimum 1-inch (25-mm) bolt throw.
- E. Backset: 2-3/4 inches, unless otherwise indicated.
- F. Strikes: Manufacturer's standard strike with strike box for each latchbolt or lock bolt, with curved lip extended to protect frame, finished to match door hardware set, and as follows:
1. Strikes for Locks and Latches: BHMA A156.2.
- G. Lock Functions: Function numbers and descriptions indicated in door hardware sets comply with the following:
1. Bored Locks: BHMA A156.2.
- H. Bored Locks: BHMA A156.2, Grade 1; Series 4000
1. Required Manufacturer:
    - a. Yale Commercial; an Assa Abloy Group. 5400LN Series

## 2.2 AUXILIARY LOCKS AND LATCHES

- A. Auxiliary Locks: BHMA A156.5, Grade 1
1. Available Manufacturers:
    - a. Adams Rite Manufacturing Co.; an Assa Abloy Group company
    - b. Yale Commercial; an Assa Abloy Group company

## 2.3 LOCK CYLINDERS

- A. Cylinders: BHMA A156.5, Manufacturer's standard tumbler type, constructed from brass or bronze, stainless steel, or nickel silver, and complying with the following:
1. Number of Pins: As Required
  2. Mortise Type: Threaded cylinders with rings and straight- or clover-type cam.
  3. Rim Type: Cylinders with back plate, flat-type vertical or horizontal tailpiece, and raised trim ring.

## 2.4 KEYING

- A. Keying System: Factory registered, complying with guidelines in BHMA A156.28, Appendix A. Provide all cylinders and keys master keyed to the existing Keying system. Incorporate decisions made in keying conference, and as follows:

1. Grand Master Key System: Cylinders are operated by a change key, a master key, and a grand master key.

B. Keys: Nickel silver.

1. Quantity: Provide the following:

- a. Cylinder Change Keys: Three.
- b. Master Keys: Five, per suite
- c. Grand Master Keys: Five

## 2.5 SURFACE CLOSERS

A. Surface Closers: BHMA A156.4; Full rack-and-pinion hydraulic type with adjustable sweep and latch speeds controlled by key-operated valves and forged-steel main arm. Comply with manufacturer's written recommendations for size of door closers depending on size of door, exposure to weather, and anticipated frequency of use. Provide non-sized closers, adjustable to meet field conditions and requirements for opening force.

1. Available Manufacturers:

- a. LCN Closers. 1450 Series.
- b. Norton Door Controls. 8500 Series.
- c. Stanley Door Closers. CLD-3550 Series.

## 2.6 OPERATING TRIM

A. Standard: BHMA A156.6.

B. Materials: Fabricate from bronze, unless otherwise indicated.

1. Available Manufacturers:

- a. Burns Manufacturing Incorporated.
- b. Don-Jo Manufacturing
- c. Hiawatha, Inc.
- d. IVES Hardware; an Allegion Company.
- e. Rockwood Manufacturing Company.
- f. Trimco.

C. Push-Pull Design:

1. Manufacturers:

- a. Burns Manufacturing Incorporated (BM).
- b. Don-Jo Mfg., Inc. (DJO).
- c. Hager Companies (HAG).
- d. Ives, H. B. (IVS).
- e. NT Quality Hardware; an Ingersoll-Rand Company (NTQ).
- f. Rockwood Manufacturing Company (RM).
- g. Stanley Commercial Hardware; Div. of The Stanley Works (STH).

## 2.7 PROTECTIVE TRIM UNITS

- A. Size: 2 inches (51 mm) less than door width on push side and 1 inch (25 mm) less than door width on pull side, by height specified in door hardware sets.
- B. Fasteners: Manufacturer's standard self-tapping countersunk screws.
- C. Metal Protective Trim Units: BHMA A156.6; beveled top and 2 sides; fabricated from the following material:
  - 1. Material: 0.050-inch- (1.3-mm-) thick stainless steel.
  - 2. Available Manufacturers:
    - a. Burns Manufacturing Incorporated.
    - b. Don-Jo Manufacturing
    - c. Hiawatha, Inc.
    - d. IVES Hardware; an Allegion Company.
    - e. Rockwood Manufacturing Company.
    - f. Trimco.

## 2.8 STOPS

- A. Stops and Bumpers: BHMA A156.16 Grade 1 unless Grade 2 is indicated.
  - 1. Provide wall stop for doors unless floor or other type stops are scheduled or indicated. Do not mount floor stops where they will impede traffic. Where floor or wall stops are not appropriate, provide overhead holders.
- B. Silencers for Metal Door Frames: BHMA A156.16, Grade 1; neoprene or rubber, minimum diameter 1/2 inch (13 mm); fabricated for drilled-in application to frame.
  - 1. Available Manufacturers:
    - a. Burns Manufacturing Incorporated.
    - b. Don-Jo Manufacturing
    - c. Hiawatha, Inc.
    - d. IVES Hardware; an Allegion Company.
    - e. Rockwood Manufacturing Company.
    - f. Trimco.

## 2.9 FABRICATION

- A. Fasteners: Provide door hardware manufactured to comply with published templates prepared for machine, wood, and sheet metal screws. Provide screws that comply with commercially recognized industry standards for application intended, except aluminum fasteners are not permitted. Provide Phillips flat-head screws with finished heads to match surface of door hardware, unless otherwise indicated.
  - 1. Fire-Rated Applications:
    - a. Wood or Machine Screws: For the following:

- 1) Hinges mortised to doors or frames; use threaded-to-the-head wood screws for wood doors and frames.
  - 2) Strike plates to frames.
- b. Steel Through Bolts: For the following.
- 1) Closers to doors
2. Fasteners for Wood Doors: Comply with requirements in DHI WDHS.2, "Recommended Fasteners for Wood Doors."

## 2.10 FINISHES

- A. Provide finishes complying with BHMA A156.18 as indicated in door hardware schedule.
- B. Protect mechanical finishes on exposed surfaces from damage by applying a strippable, temporary protective covering before shipping.

## PART 3 - EXECUTION

### 3.1 INSTALLATION

- A. Steel Doors and Frames: For surface applied door hardware, drill and tap doors and frames according to ANSI/SDI A250.6.
- B. Wood Doors: Comply with DHI WDHS.5 "Recommended Hardware Reinforcement Locations for Mineral Core Wood Flush Doors."
- C. Mounting Heights: Mount door hardware units at to comply with the following unless otherwise indicated or required to comply with governing regulations.
  1. Standard Steel Doors and Frames: ANSI/SDI A250.8.
  2. Wood Doors: DHI WDHS.3, "Recommended Locations for Architectural Hardware for Wood Flush Doors."
- D. Install each door hardware item to comply with manufacturer's written instructions. Where cutting and fitting are required to install door hardware onto or into surfaces that are later to be painted or finished in another way, coordinate removal, storage, and reinstallation of surface protective trim units with finishing work. Do not install surface-mounted items until finishes have been completed on substrates involved.
  1. Set units level, plumb, and true to line and location. Adjust and reinforce attachment substrates as necessary for proper installation and operation.
  2. Drill and countersink units that are not factory prepared for anchorage fasteners. Space fasteners and anchors according to industry standards.
- E. Hinges: Install types and in quantities indicated in door hardware schedule but not fewer than the number recommended by manufacturer for application indicated or one hinge for every 30 inches of door height, whichever is more stringent, unless other equivalent means of support for door, such as spring hinges or pivots, are provided.
- F. Adjustment: Adjust and check each operating item of door hardware and each door to ensure proper operation or function of every unit. Replace units that cannot be adjusted to operate as

intended. Adjust door control devices to compensate for final operation of heating and ventilating equipment and to comply with referenced accessibility requirements.

### 3.2 DOOR HARDWARE SCHEDULE

#### **Manufacturer List:**

<u>Code</u>	<u>Name</u>
AB	ABH MANUFACTURING INC.
AD	ADAMS RITE
AL	ALARM LOCK
NA	NATIONAL GUARD
SD	STANLEY DOOR CLOSERS
ST	STANLEY
TR	TRIMCO
YA	YALE

#### **Option List:**

<u>Code</u>	<u>Description</u>
497	ASA STRIKE LIP 1 1/4"
693	SPRINGLATCH 2 3/4 BS - 1/2" THROW
694	DEADLATCH 2 3/4 BS - 1/2" THROW
CMK	CONSTRUCTION MASTERKEYED-SINGLE CYLINDER
CSK	COUNTER SINKING OF KICK and MOP PLATES
GMK	GRAND MASTERKEYED-SINGLE CYLINDER
NRP	NON REMOVEABLE PIN STD/HEAVY WT HINGE
F693	SPRINGLATCH FLAT 2 3/4 BS - 1/2" THROW
1161L	CAM FOR ADAMS RITE LOCK

#### **Finish List:**

<u>Code</u>	<u>Description</u>
AL	ALUMINUM
121	RITECOAT PAINTED - DARK BRONZE
313	DARK BRONZE DURANODIC
613	OXIDIZED SATIN BRONZE, OIL RUBBED
626	SATIN CHROMIUM PLATED
630	SATIN STAINLESS STEEL
689	ALUMINUM PAINTED
695	DARK BRONZE PAINTED
613E	DARK OXIDIZED SATIN BRONZE - EQUIVALENT
GREY	GREY
US10B	DARK OXIDIZED SATIN BRONZE (STEEL HINGES)
US26D	CHROMIUM PLATED, DULL
US32D	STAINLESS STEEL, DULL

#### **Hardware Sets**

##### **SET #1 –**

Doors: 106 A, 108 A

3 Hinges	FBB179 4 1/2 X 4 1/2	US26D	ST
1 Door Push Plate	1270WV	630	TR
1 Door Pull	1270WV	630	TR
1 Door Closer	CLD-4550 STD W/PA BRKT	689	SD
1 Wall Stop	1270WV	630	TR
3 Door Silencers	1229A	GREY	TR

**SET #2 –**

Doors: 102 A – Aluminum Door Manufacturer

**END OF SECTION**

## SECTION 088000 - GLAZING

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. This Section includes glazing for the following products and applications, including those specified in other Sections where glazing requirements are specified by reference to this Section:
  - 1. Windows

#### 1.2 DEFINITIONS

- A. Interspace: Space between lites of an insulating-glass unit that contains dehydrated air or a specified gas.
- B. Deterioration of Coated Glass: Defects developed from normal use that are attributed to the manufacturing process and not to causes other than glass breakage and practices for maintaining and cleaning coated glass contrary to manufacturer's written instructions. Defects include peeling, cracking, and other indications of deterioration in metallic coating.
- C. Deterioration of Insulating Glass: Failure of hermetic seal under normal use that is attributed to the manufacturing process and not to causes other than glass breakage and practices for maintaining and cleaning insulating glass contrary to manufacturer's written instructions. Evidence of failure is the obstruction of vision by dust, moisture, or film on interior surfaces of glass.

#### 1.3 PERFORMANCE REQUIREMENTS

- A. General: Provide glazing systems capable of withstanding normal thermal movement and wind and impact loads (where applicable) without failure, including loss or glass breakage attributable to the following: defective manufacture, fabrication, and installation; failure of sealants or gaskets to remain watertight and airtight; deterioration of glazing materials; or other defects in construction.
- B. Glass Design: Glass thickness designations indicated are minimums and are for detailing only. Confirm glass thicknesses by analyzing Project loads and in-service conditions. Provide glass lites in the thickness designations indicated for various size openings, but not less than thicknesses and in strengths (annealed or heat treated) required to meet or exceed the following criteria:
  - 1. Glass Thicknesses: Select minimum glass thicknesses to comply with ASTM E 1300, according to the following requirements:
    - a. Specified Design Wind Loads: Not less than wind loads applicable to Project as required by ASCE 7 "Minimum Design Loads for Buildings and Other Structures": Section 6.0 "Wind Loads."
    - b. Probability of Breakage for Vertical Glazing: 8 lites per 1000 for lites set vertically or not more than 15 degrees off vertical and under wind action.
      - 1) Load Duration: 3 seconds.



- c. Minimum Glass Thickness for Exterior Lites: Not less than 1"
  - d. Thickness of Tinted and Heat-Absorbing Glass: Provide the same thickness for each tint color indicated throughout Project.
- C. Thermal Movements: Provide glazing that allows for thermal movements resulting from the following maximum change (range) in ambient and surface temperatures acting on glass framing members and glazing components. Base engineering calculation on surface temperatures of materials due to both solar heat gain and nighttime-sky heat loss.
  - 1. Temperature Change (Range): 120 deg F, ambient; 180 deg F , material surfaces.
- D. Thermal and Optical Performance Properties: Provide glass with performance properties specified based on manufacturer's published test data, as determined according to procedures indicated below:
  - 1. For monolithic-glass lites, properties are based on units with lites of thickness indicated.
  - 2. For insulating-glass units, properties are based on units of thickness indicated for overall unit and for each lite 1 inch thick and a nominal wide interspace.
  - 3. Center-of-Glass Values: Based on using LBL-44789 WINDOW 5.0 computer program for the following methodologies:
    - a. U-Factors: NFRC 100 expressed as Btu/ sq. ft. x h x deg F.
    - b. Solar Heat Gain Coefficient: NFRC 200.
    - c. Solar Optical Properties: NFRC 300.

#### 1.4 SUBMITTALS

- A. Product Data: For each glass product and glazing material indicated.
- B. Glazing Schedule: Use same designations indicated on Drawings for glazed openings.
- C. Preconstruction Adhesion and Compatibility Test Report: From glazing sealant manufacturer.

#### 1.5 QUALITY ASSURANCE

- A. Glazing for Fire-Rated Assemblies: Glazing for assemblies that comply with NFPA 80 and that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire ratings indicated, based on testing according to NFPA 257.
- B. Safety Glazing Products: Comply with testing requirements in 16 CFR 1201
- C. Glazing Publications: Comply with published recommendations of glass product manufacturers and organizations below, unless more stringent requirements are indicated. Refer to these publications for glazing terms not otherwise defined in this Section or in referenced standards.
  - 1. GANA Publications: GANA Laminated Division's "Laminated Glass Design Guide" and GANA's "Glazing Manual."
  - 2. IGMA Publication for Insulating Glass: SIGMA TM-3000, "Glazing Guidelines for Sealed Insulating Glass Units."

- D. Insulating-Glass Certification Program: Permanently marked either on spacers or on at least one component lite of units with appropriate certification label of the following testing and inspecting agency:
1. Insulating Glass Certification Council.
  2. Associated Laboratories, Inc.

## 1.6 WARRANTY

- A. Manufacturer's Special Warranty for Coated-Glass Products: Manufacturer's standard form, made out to Owner and signed by coated-glass manufacturer agreeing to replace coated-glass units that deteriorate as defined in "Definitions" Article, f.o.b. the nearest shipping point to Project site, within specified warranty period indicated below.
1. Warranty Period: 10 years from date of Substantial Completion.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. In other Part 2 articles where titles below introduce lists, the following requirements apply to product selection:
1. Available Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to, products specified.
  2. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, manufacturers specified.

### 2.2 GLASS PRODUCTS

- A. Float Glass: ASTM C 1048 or 1036, Type I (transparent flat glass), Quality-Q3; of class,kind, and condition indicated.
1. Fabrication Process: By horizontal (roller-hearth) process with roll-wave distortion parallel to bottom edge of glass as installed, unless otherwise indicated.
  2. Provide Kind HS (heat-strengthened) float glass in place of annealed float glass where needed to resist thermal stresses induced by differential shading of individual glass lites and to comply with glass design requirements specified in Part 1 "Performance Requirements" Article.
  3. For uncoated glass, comply with requirements for Condition A.
  4. For coated vision glass, comply with requirements for Condition C (other uncoated glass).
  5. Provide Kind FT (fully tempered) float glass in place of annealed or Kind HS (heat-strengthened) float glass where safety glass is indicated.
- B. Low-E Insulating-Glass Units, General: Factory-assembled units consisting of sealed lites of glass separated by a dehydrated interspace, and complying with ASTM E 774 for Class CBA units and with requirements specified in this Article and in Part 2 "Insulating-Glass Units" Article.

1. Provide Kind HS (heat-strengthened) float glass in place of annealed glass where needed to resist thermal stresses induced by differential shading of individual glass lites and to comply with glass design requirements specified in Part 1 "Performance Requirements" Article.
2. Overall Unit Thickness and Thickness of Each Lite: Dimensions indicated for insulating-glass units are nominal and the overall thicknesses of units are measured perpendicularly from outer surfaces of glass lites at unit's edge.
3. Sealing System: Dual seal.
4. Spacer Specifications: Manufacturer's standard spacer material and construction complying with the following requirements:
  - a. Spacer Material: Aluminum with black, color anodic finish.
  - b. Corner Construction: Manufacturer's standard corner construction.

C. Laminated Glass: Clear laminated glass with two plies of clear fully tempered float glass.

1. Thickness of Each Glass Ply: 3.0 mm.
2. Provide safety glazing labeling.

## 2.3 FIRE-RATED GLAZING PRODUCTS

A. Fire-Protection Rating: As indicated for the assembly in which glazing material is installed, and permanently labeled by a testing and inspecting agency acceptable to authorities having jurisdiction.

## 2.4 GLAZING GASKETS

A. Dense Compression Gaskets: Molded or extruded gaskets of material indicated below, complying with standards referenced with name of elastomer indicated below, and of profile and hardness required to maintain watertight seal:

1. Neoprene, ASTM C 864.
2. EPDM, ASTM C 864.
3. Silicone, ASTM C 1115.
4. Thermoplastic polyolefin rubber, ASTM C 1115.
5. Any material indicated above.

B. Soft Compression Gaskets: Extruded or molded, closed-cell, integral-skinned gaskets of material indicated below; complying with ASTM C 509, Type II, black; and of profile and hardness required to maintain watertight seal:

1. Neoprene.
2. EPDM.
3. Silicone.
4. Thermoplastic polyolefin rubber.
5. Any material indicated above.

## 2.5 GLAZING SEALANTS

A. General: Provide products of type indicated, complying with the following requirements:

1. Compatibility: Select glazing sealants that are compatible with one another and with other materials they will contact, including glass products, seals of insulating-glass units, and glazing channel substrates, under conditions of service and application, as demonstrated by sealant manufacturer based on testing and field experience.
  2. Suitability: Comply with sealant and glass manufacturers' written instructions for selecting glazing sealants suitable for applications indicated and for conditions existing at time of installation.
  3. Colors of Exposed Glazing Sealants: As selected by Architect from manufacturer's full range.
- B. Elastomeric Glazing Sealants: Comply with ASTM C 920 and other requirements indicated for each liquid-applied chemically curing sealant specified, including those referencing ASTM C 920 classifications for type, grade, class, and uses related to exposure and joint substrates.
- C. Glazing Sealants for Fire-Resistive Glazing Products: Identical to products used in test assemblies to obtain fire-protection rating.

## 2.6 GLAZING TAPES

- A. Back-Bedding Mastic Glazing Tapes: Preformed, butyl-based elastomeric tape with a solids content of 100 percent; nonstaining and nonmigrating in contact with nonporous surfaces; with or without spacer rod as recommended in writing by tape and glass manufacturers for application indicated; packaged on rolls with a release paper backing; and complying with ASTM C 1281 and AAMA 800 for products indicated below:
1. AAMA 806.3 tape, for glazing applications in which tape is subject to continuous pressure.
  2. AAMA 807.3 tape, for glazing applications in which tape is not subject to continuous pressure.
- B. Expanded Cellular Glazing Tapes: Closed-cell, PVC foam tapes; factory coated with adhesive on both surfaces; packaged on rolls with release liner protecting adhesive; and complying with AAMA 800 for the following types:
1. Type 1, for glazing applications in which tape acts as the primary sealant.
  2. Type 2, for glazing applications in which tape is used in combination with a full bead of liquid sealant.

## 2.7 MISCELLANEOUS GLAZING MATERIALS

- A. General: Provide products of material, size, and shape complying with referenced glazing standard, requirements of manufacturers of glass and other glazing materials for application indicated, and with a proven record of compatibility with surfaces contacted in installation.
- B. Cleaners, Primers, and Sealers: Types recommended by sealant or gasket manufacturer.
- C. Setting Blocks: Elastomeric material with a Shore, Type A durometer hardness of 85, plus or minus 5.
- D. Spacers: Elastomeric blocks or continuous extrusions with a Shore, Type A durometer hardness required by glass manufacturer to maintain glass lites in place for installation indicated.

- E. Edge Blocks: Elastomeric material of hardness needed to limit glass lateral movement (side walking).
- F. Perimeter Insulation for Fire-Resistive Glazing: Identical to product used in test assembly to obtain fire-resistance rating.

## 2.8 FABRICATION OF GLAZING UNITS

- A. Fabricate glazing units in sizes required to glaze openings indicated for Project, with edge and face clearances, edge and surface conditions, and bite complying with written instructions of product manufacturer and referenced glazing publications, to comply with system performance requirements.

## PART 3 - EXECUTION

### 3.1 GLAZING

- A. General: Comply with combined written instructions of manufacturers of glass, sealants, gaskets, and other glazing materials, unless more stringent requirements are indicated, including those in referenced glazing publications.
  - 1. Glazing channel dimensions, as indicated on Drawings, provide necessary bite on glass, minimum edge and face clearances, and adequate sealant thicknesses, with reasonable tolerances. Adjust as required by Project conditions during installation.
  - 2. Protect glass edges from damage during handling and installation. Remove damaged glass from Project site and legally dispose of off Project site. Damaged glass is glass with edge damage or other imperfections that, when installed, could weaken glass and impair performance and appearance.
  - 3. Apply primers to joint surfaces where required for adhesion of sealants, as determined by preconstruction sealant-substrate testing.
  - 4. Install setting blocks in sill rabbets, sized and located to comply with referenced glazing publications, unless otherwise required by glass manufacturer. Set blocks in thin course of compatible sealant suitable for heel bead.
  - 5. Do not exceed edge pressures stipulated by glass manufacturers for installing glass lites.
  - 6. Provide spacers for glass lites where length plus width is larger than 50 inches.
  - 7. Provide edge blocking where indicated or needed to prevent glass lites from moving sideways in glazing channel, as recommended in writing by glass manufacturer and according to requirements in referenced glazing publications.
- B. Tape Glazing: Position tapes on fixed stops so that when compressed by glass, their exposed edges are flush with or protrude slightly above sightline of stops. Install tapes continuously, but not necessarily in one continuous length. Do not stretch tapes to make them fit opening.
  - 1. Cover vertical framing joints by applying tapes to heads and sills first and then to jambs. Cover horizontal framing joints by applying tapes to jambs and then to heads and sills.
  - 2. Place joints in tapes at corners of opening with adjoining lengths butted together, not lapped. Seal joints in tapes with compatible sealant approved by tape manufacturer.
  - 3. Apply heel bead of elastomeric sealant.

4. Center glass lites in openings on setting blocks and press firmly against tape by inserting dense compression gaskets formed and installed to lock in place against faces of removable stops. Start gasket applications at corners and work toward centers of openings.
  5. Apply cap bead of elastomeric sealant over exposed edge of tape.
- C. GASKET GLAZING (DRY) Fabricate compression gaskets in lengths recommended by gasket manufacturer to fit openings exactly, with allowance for stretch during installation.
1. Insert soft compression gasket between glass and frame or fixed stop so it is securely in place with joints miter cut and bonded together at corners.
  2. Center glass lites in openings on setting blocks and press firmly against soft compression gasket by inserting dense compression gaskets formed and installed to lock in place against faces of removable stops. Start gasket applications at corners and work toward centers of openings. Compress gaskets to produce a weathertight seal without developing bending stresses in glass. Seal gasket joints with sealant recommended by gasket manufacturer.
  3. Install gaskets so they protrude past face of glazing stops.
- 3.2 SEALANT GLAZING (WET): Install continuous spacers, or spacers combined with cylindrical sealant backing, between glass lites and glazing stops to maintain glass face clearances and to prevent sealant from extruding into glass channel and blocking weep systems until sealants cure. Secure spacers or spacers and backings in place and in position to control depth of installed sealant relative to edge clearance for optimum sealant performance.
1. Force sealants into glazing channels to eliminate voids and to ensure complete wetting or bond of sealant to glass and channel surfaces.
  2. Tool exposed surfaces of sealants to provide a substantial wash away from glass.
- 3.3 CLEANING AND PROTECTION
- A. Protect exterior glass from damage immediately after installation by attaching crossed streamers to framing held away from glass. Do not apply markers to glass surface. Remove nonpermanent labels, and clean surfaces. Protect glass from contact with contaminating substances resulting from construction operations, including weld splatter. If, despite such protection, contaminating substances do come into contact with glass, remove substances immediately as recommended by glass manufacturer.
  - B. Remove and replace glass that is broken, chipped, cracked, or abraded or that is damaged from natural causes, accidents, and vandalism, during construction period.

END OF SECTION 088000

## SECTION 092116 - GYPSUM BOARD ASSEMBLIES

### PART 1 GENERAL

#### 1.1 SECTION INCLUDES

- A. Performance criteria for gypsum board assemblies.
- B. Stud wall framing.
- C. Gypsum wallboard.
- D. Joint treatment and accessories.
- E. Sound Batt Insulation

#### 1.2 RELATED REQUIREMENTS

- A. Section 061000 - Rough Carpentry: Building framing and sheathing.
- B. Section 061000 - Rough Carpentry: Wood blocking product and execution requirements.

#### 1.3 REFERENCE STANDARDS

- A. ANSI A108.11 - American National Standard for Interior Installation of Cementitious Backer Units; 2010 (Revised).
- B. ANSI A118.9 - American National Standard Specifications for Test Methods and Specifications for Cementitious Backer Units; 1999 (Reaffirmed 2010).
- C. ASTM C475/C475M - Standard Specification for Joint Compound and Joint Tape for Finishing Gypsum Board; 2015.
- D. ASTM C514 - Standard Specification for Nails for the Application of Gypsum Board; 2004 (Reapproved 2014).
- E. ASTM C840 - Standard Specification for Application and Finishing of Gypsum Board; 2013.
- F. ASTM C1002 - Standard Specification for Steel Self-Piercing Tapping Screws for Application of Gypsum Panel Products or Metal Plaster Bases to Wood Studs or Steel Studs; 2014.
- G. ASTM C1047 - Standard Specification for Accessories For Gypsum Wallboard and Gypsum Veneer Base; 2014a.
- H. ASTM C1288 - Standard Specification for Discrete Non-Asbestos Fiber-Cement Interior Substrate Sheets; 2014.
- I. ASTM C1396/C1396M - Standard Specification for Gypsum Board; 2014a.
- J. ASTM C1658/C1658M - Standard Specification for Glass Mat Gypsum Panels; 2013.
- K. ASTM D3273 - Standard Test Method for Resistance to Growth of Mold on the Surface of Interior Coatings in an Environmental Chamber; 2016.
- L. ASTM E90 - Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and Elements; 2009 (Reapproved 2016).
- M. ASTM E413 - Classification for Rating Sound Insulation; 2016.
- N. GA-216 - Application and Finishing of Gypsum Board; 2013.

#### 1.4 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.

- B. Product Data: Provide manufacturer's data on partition head to structure connectors, showing compliance with requirements.
- C. Control joint layout.

## PART 2 PRODUCTS

### 2.1 GYPSUM BOARD ASSEMBLIES

- A. Provide completed assemblies complying with ASTM C840 and GA-216.
- B. Interior Partitions, Indicated as Acoustic: Provide completed assemblies with the following characteristics:
  - 1. Acoustic Attenuation: STC of 45-49 calculated in accordance with ASTM E413, based on tests conducted in accordance with ASTM E90.
- C. Interior Ceilings and Soffits.

### 2.2 BOARD MATERIALS

- A. Gypsum Wallboard: Paper-faced gypsum panels as defined in ASTM C1396/C1396M; sizes to minimize joints in place; ends square cut.
  - 1. Application: Use for vertical surfaces and soffits, unless otherwise indicated.
  - 2. Glass mat faced gypsum panels as defined in ASTM C1658/C1658M, suitable for paint finish, of the same core type and thickness may be substituted for paper-faced board.
  - 3. Mold Resistance: Score of 10, when tested in accordance with ASTM D3273.
    - a. Mold-resistant board is required whenever board is being installed before the building is enclosed and conditioned.
    - b. Mold resistant board is required as indicated by finish schedule.
  - 4. At Assemblies Indicated with Fire-Rating: Use type required by indicated tested assembly; if no tested assembly is indicated, use Type X board, UL or WH listed.
  - 5. Thickness:
    - a. Vertical Surfaces: 5/8 inch.
    - b. Ceilings: 5/8 inch.

### 2.3 ACCESSORIES

- A. Beads, Joint Accessories, and Other Trim: ASTM C1047, galvanized steel, unless noted otherwise.
  - 1. Rigid Corner Beads: Low profile, for 90 degree outside corners and archways.
  - 2. Architectural Reveal Beads:
  - 3. Wall Mounted Deflection Beads: Flexible gasket and bead with 1-1/8 inch flange.
  - 4. Expansion Joints: V-shaped PVC with tear away fins.
- B. Joint Materials: ASTM C475/C475M and as recommended by gypsum board manufacturer for project conditions.
  - 1. Tape: 2 inch wide, creased paper tape for joints and corners, except as otherwise indicated.
  - 2. Ready-mixed vinyl-based joint compound.
- C. Screws for Fastening of Gypsum Panel Products to Cold-Formed Steel Studs Less than 0.033 inch in Thickness and Wood Members: ASTM C1002; self-piercing tapping screws, corrosion resistant.
- D. Screws for Fastening of Gypsum Panel Products to Steel Members from 0.033 to 0.112 inch in Thickness: ASTM C954; steel drill screws, corrosion resistant.



- E. Nails for Attachment to Wood Members: Not allowed

## PART 3 EXECUTION

### 3.1 EXAMINATION

- A. Verify that project conditions are appropriate for work of this section to commence.

### 3.2 FRAMING INSTALLATION

- A. Metal Framing: Install in accordance with ASTM C754 and manufacturer's instructions.
- B. Studs: Space studs at 16 inches on center.
  - 1. Extend partition framing to structure in all locations, unless otherwise noted.
  - 2. Partitions Terminating at Structure: Attach extended leg top runner to structure, maintain clearance between top of studs and structure, and brace both flanges of studs with continuous bridging. Provide 2" slip track at structure.
- C. Blocking: Install wood blocking for support of:
  - 1. Framed openings.
  - 2. Wall mounted cabinets.
  - 3. Plumbing fixtures.
  - 4. Toilet partitions.
  - 5. Toilet accessories.
  - 6. Shower accessories.
  - 7. Wall mounted door hardware.

### 3.3 ACOUSTIC ACCESSORIES INSTALLATION

- A. Acoustic Insulation: Place tightly within spaces, around cut openings, behind and around electrical and mechanical items within partitions, and tight to items passing through partitions.
- B. Acoustic Sealant: Install in accordance with manufacturer's instructions.

### 3.4 BOARD INSTALLATION

- A. Comply with ASTM C840, GA-216, and manufacturer's instructions. Install to minimize butt end joints, especially in highly visible locations.
- B. Fire-Rated Construction: Install gypsum board in strict compliance with requirements of assembly listing.
- C. Exposed Gypsum Board in Interior Wet Areas: Seal joints, cut edges, and holes with water-resistant sealant.
- E. Installation on Metal Framing: For rated assemblies, comply with requirements of listing authority. For non-rated assemblies, install as follows:
  - 1. Single-Layer Applications: Screw attachment.

### 3.5 INSTALLATION OF TRIM AND ACCESSORIES

- A. Control Joints: Place control joints consistent with lines of building spaces and as follows:
  - 1. Not more than 25 feet apart on walls and ceilings over 30 feet long.
  - 2. Provide layout to architect for approval.
- B. Corner Beads: Install at external corners, using longest practical lengths.

### 3.6 JOINT TREATMENT

- A. Paper Faced Gypsum Board: Use paper joint tape, bedded with ready-mixed vinyl-based joint compound and finished with ready-mixed vinyl-based joint compound.
- B. Finish gypsum board in accordance with levels defined in ASTM C840, as follows:
  - 1. Level 4: Walls and ceilings to receive paint finish, resinous coating, or wall coverings.
  - 2. Level 1: Fire rated wall areas above finished ceilings, whether or not accessible in the completed construction.
- C. Tape, fill, and sand exposed joints, edges, and corners to produce smooth surface ready to receive finishes.
  - 1. Feather coats of joint compound so that camber is maximum 1/32 inch.
  - 2. Taping, filling and sanding is not required at base layer of double layer applications.

### 3.7 TOLERANCES

- A. Maximum Variation of Finished Gypsum Board Surface from True Flatness: 1/16 inch in 10 feet in any direction.

END OF SECTION 09 21 16

## 092216 - NON-STRUCTURAL METAL FRAMING

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Non-load-bearing steel framing systems for interior partitions.
  - 2. Suspension systems for interior ceilings and soffits.
  - 3. Grid suspension systems for gypsum board ceilings.

- B. Related Requirements:

#### 1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product.

#### 1.4 QUALITY ASSURANCE

- A. Code-Compliance Certification of Studs and Tracks: Provide documentation that framing members are certified according to the product-certification program of the Steel Framing Industry Association.

### PART 2 - PRODUCTS

#### 2.1 PERFORMANCE REQUIREMENTS

- A. Horizontal Deflection: For wall assemblies, limited to 1/240 of the wall height based on horizontal loading of 5 lbf/sq. ft. (239 Pa).

#### 2.2 FRAMING SYSTEMS

- A. Framing Members, General: Comply with ASTM C 754 for conditions indicated.
  - 1. Steel Sheet Components: Comply with ASTM C 645 requirements for metal unless otherwise indicated.
  - 2. Protective Coating: hot-dip galvanized unless otherwise indicated.
- B. Studs and Tracks: ASTM C 645. Use either steel studs and tracks or embossed steel studs and tracks.

1. Steel Studs and Tracks:
  - a. Minimum Base-Metal Thickness: As required by performance requirements for horizontal deflection
  - b. Depth: As indicated on Drawings.
- C. Flat Strap and Backing Plate: Steel sheet for blocking and bracing in length and width indicated.
  1. Minimum Base-Metal Thickness: 0.0269 inch (0.683 mm)
- D. Cold-Rolled Channel Bridging: Steel, 0.0538-inch (1.367-mm) minimum base-metal thickness, with minimum 1/2-inch- (13-mm-) wide flanges.
  1. Clip Angle: Not less than 1-1/2 by 1-1/2 inches (38 by 38 mm), 0.068-inch- (1.72-mm-) thick, galvanized steel.

## 2.3 SUSPENSION SYSTEMS

- A. Tie Wire: ASTM A 641/A 641M, Class 1 zinc coating, soft temper, 0.062-inch- (1.59-mm-) diameter wire, or double strand of 0.048-inch- (1.21-mm-) diameter wire.
- B. Wire Hangers: ASTM A 641/A 641M, Class 1 zinc coating, soft temper, 0.16 inch (4.12 mm) in diameter.
- C. Flat Hangers: Steel sheet, 1 by 3/16 inch (25 by 5 mm) by length required.
- D. Carrying Channels (Main Runners): Cold-rolled, commercial-steel sheet with a base-metal thickness of 0.0538 inch (1.367 mm) and minimum 1/2-inch- (13-mm-) wide flanges.
  1. Cold-Rolled Channels: 0.0538-inch (1.367-mm) uncoated-steel thickness, with minimum 1/2-inch- (13-mm-) wide flanges, 3/4 inch (19 mm) deep.
  2. Steel Studs and Tracks: ASTM C 645.
    - a. Minimum Base-Metal Thickness: As indicated on Drawings
    - b. Depth: As indicated on Drawings.
  3. Hat-Shaped, Rigid Furring Channels: ASTM C 645, 7/8 inch (22 mm) deep.
    - a. Minimum Base-Metal Thickness: 0.0296 inch (0.752 mm).
- E. Grid Suspension System for Gypsum Board Ceilings: ASTM C 645, direct-hung system composed of main beams and cross-furring members that interlock.

## 2.4 AUXILIARY MATERIALS

- A. General: Provide auxiliary materials that comply with referenced installation standards.
  1. Fasteners for Steel Framing: Of type, material, size, corrosion resistance, holding power, and other properties required to fasten steel members to substrates.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine areas and substrates, with Installer present, and including welded hollow-metal frames, cast-in anchors, and structural framing, for compliance with requirements and other conditions affecting performance of the Work.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 PREPARATION

- A. Suspended Assemblies: Coordinate installation of suspension systems with installation of overhead structure to ensure that inserts and other provisions for anchorages to building structure have been installed to receive hangers at spacing required to support the Work and that hangers will develop their full strength.
  - 1. Furnish concrete inserts and other devices indicated to other trades for installation in advance of time needed for coordination and construction.

### 3.3 INSTALLATION, GENERAL

- A. Installation Standard: ASTM C 754.
  - 1. Gypsum Board Assemblies: Also comply with requirements in ASTM C 840 that apply to framing installation.
- B. Install framing and accessories plumb, square, and true to line, with connections securely fastened.
- C. Install supplementary framing, and blocking to support fixtures, equipment services, heavy trim, grab bars, toilet accessories, furnishings, or similar construction.
- D. Install bracing at terminations in assemblies.
- E. Do not bridge building control and expansion joints with non-load-bearing steel framing members. Frame both sides of joints independently.

### 3.4 INSTALLING FRAMED ASSEMBLIES

- A. Install framing system components according to spacings indicated, but not greater than spacings required by referenced installation standards for assembly types.
  - 1. Single-Layer Application: 16 inches (406 mm) o.c. unless otherwise indicated.
  - 2. Tile Backing Panels: As required by horizontal deflection performance requirements.
- B. Install studs so flanges within framing system point in same direction.
- C. Install tracks at floors and overhead supports. Extend framing full height to structural supports or substrates above suspended ceilings except where partitions are indicated to terminate at suspended ceilings. Continue framing around ducts that penetrate partitions above ceiling.

1. Door Openings: Screw vertical studs at jambs to jamb anchor clips on door frames; install track section (for cripple studs) at head and secure to jamb studs.
    - a. Install two studs at each jamb unless otherwise indicated.
    - b. Install cripple studs at head adjacent to each jamb stud, with a minimum 1/2-inch (13-mm) clearance from jamb stud to allow for installation of control joint in finished assembly.
    - c. Extend jamb studs through suspended ceilings and attach to underside of overhead structure.
  2. Other Framed Openings: Frame openings other than door openings the same as required for door openings unless otherwise indicated. Install framing below sills of openings to match framing required above door heads.
  3. Curved Partitions:
    - a. Bend track to uniform curve and locate straight lengths so they are tangent to arcs.
    - b. Begin and end each arc with a stud, and space intermediate studs equally along arcs. On straight lengths of no fewer than two studs at ends of arcs, place studs 6 inches (150 mm) o.c.
- D. Installation Tolerance: Install each framing member so fastening surfaces vary not more than 1/8 inch (3 mm) from the plane formed by faces of adjacent framing.

### 3.5 INSTALLING CEILING SUSPENSION SYSTEMS

- A. Install suspension system components according to spacings indicated, but not greater than spacings required by referenced installation standards for assembly types.
1. Hangers: 48 inches (1219 mm) o.c.
  2. Carrying Channels (Main Runners): 48 inches (1219 mm) o.c.
  3. Furring Channels (Furring Members): 16 inches (406 mm) o.c.
- B. Isolate suspension systems from building structure where they abut or are penetrated by building structure to prevent transfer of loading imposed by structural movement.
- C. Suspend hangers from building structure as follows:
1. Install hangers plumb and free from contact with insulation or other objects within ceiling plenum that are not part of supporting structural or suspension system.
    - a. Splay hangers only where required to miss obstructions and offset resulting horizontal forces by bracing, countersplaying, or other equally effective means.
  2. Where width of ducts and other construction within ceiling plenum produces hanger spacings that interfere with locations of hangers required to support standard suspension system members, install supplemental suspension members and hangers in the form of trapezes or equivalent devices.
    - a. Size supplemental suspension members and hangers to support ceiling loads within performance limits established by referenced installation standards.

3. Wire Hangers: Secure by looping and wire tying, either directly to structures or to inserts, eye screws, or other devices and fasteners that are secure and appropriate for substrate, and in a manner that will not cause hangers to deteriorate or otherwise fail.
  4. Flat Hangers: Secure to structure, including intermediate framing members, by attaching to inserts, eye screws, or other devices and fasteners that are secure and appropriate for structure and hanger, and in a manner that will not cause hangers to deteriorate or otherwise fail.
  5. Do not attach hangers to permanent metal forms. Furnish cast-in-place hanger inserts that extend through forms.
  6. Do not attach hangers to rolled-in hanger tabs of composite steel floor deck.
  7. Do not connect or suspend steel framing from ducts, pipes, or conduit.
- D. Seismic Bracing: Sway-brace suspension systems with hangers used for support.
- E. Grid Suspension Systems: Attach perimeter wall track or angle where grid suspension systems meet vertical surfaces. Mechanically join main beam and cross-furring members to each other and butt-cut to fit into wall track.
- F. Installation Tolerances: Install suspension systems that are level to within 1/8 inch in 12 feet (3 mm in 3.6 m) measured lengthwise on each member that will receive finishes and transversely between parallel members that will receive finishes.

END OF SECTION 09 22 16

## SECTION 095113 - ACOUSTICAL PANEL CEILINGS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section includes acoustical panels and exposed suspension systems for interior ceilings.

#### 1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product.
- B. Samples: For each exposed product and for each color and texture specified, 6 inches in size.
- C. Samples for Initial Selection: For components with factory-applied finishes.
- D. Samples for Verification: For each component indicated and for each exposed finish required, prepared on Samples of sizes indicated below:
  - 1. Acoustical Panels: Set of 6-inch-square Samples of each type, color, pattern, and texture.
  - 2. Exposed Suspension-System Members, Moldings, and Trim: Set of 6-inch-long Samples of each type, finish, and color.
  - 3. Clips: Full-size seismic clips.

#### 1.4 CLOSEOUT SUBMITTALS

- A. Maintenance Data: For finishes to include in maintenance manuals.

#### 1.5 MAINTENANCE MATERIAL SUBMITTALS

- A. Furnish extra materials, from the same product run, that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
  - 1. Acoustical Ceiling Units: Full-size panels equal to 2 percent of quantity installed.
  - 2. Suspension-System Components: Quantity of each exposed component equal to 2 percent of quantity installed.
  - 3. Seismic Clips: Equal to 1 percent of quantity installed.



## 1.6 DELIVERY, STORAGE, AND HANDLING

- A. Deliver acoustical panels, suspension-system components, and accessories to Project site and store them in a fully enclosed, conditioned space where they will be protected against damage from moisture, humidity, temperature extremes, direct sunlight, surface contamination, and other causes.
- B. Before installing acoustical panels, permit them to reach room temperature and a stabilized moisture content.

## 1.7 FIELD CONDITIONS

- A. Environmental Limitations: Do not install acoustical panel ceilings until spaces are enclosed and weathertight, wet-work in spaces is complete and dry, work above ceilings is complete, and ambient temperature and humidity conditions are maintained at the levels indicated for Project when occupied for its intended use.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. Source Limitations: Obtain each type of acoustical ceiling panel and its supporting suspension system from single source from single manufacturer.

### 2.2 PERFORMANCE REQUIREMENTS

- A. Seismic Performance: Suspended ceilings shall withstand the effects of earthquake motions determined according to ASCE/SEI 7.
- B. Surface-Burning Characteristics: Comply with ASTM E 84; testing by a qualified testing agency. Identify products with appropriate markings of applicable testing agency.
  - 1. Flame-Spread Index: Class A according to ASTM E 1264.
  - 2. Smoke-Developed Index: 50 or less.

### 2.3 ACOUSTICAL PANELS

- A. Basis-of Design Product: Armstrong Ultima, #1910 Square Edge.
- B. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Armstrong World Industries, Inc.: [www.armstrong.com](http://www.armstrong.com)
  - 2. CertainTeed Corporation: [www.certainteed.com](http://www.certainteed.com)
  - 3. USG: [www.usg.com](http://www.usg.com)
- C. Acoustical Panel Standard: Provide manufacturer's standard panels according to ASTM E 1264 and designated by type, form, pattern, acoustical rating, and light reflectance unless otherwise indicated.

- D. Classification: Provide panels as follows:
  - 1. Type and Form: Type IV, mineral base with membrane-faced overlay; Form 2, water felted; with vinyl overlay on face.
  - 2. Pattern: E (lightly textured).
- E. Color: White.
- F. Light Reflectance (LR): Not less than 0.85 to 0.90.
- G. Ceiling Attenuation Class (CAC): 35.
- H. Noise Reduction Coefficient (NRC): 0.70.
- I. Edge/Joint Detail: Square edge sized to fit flange of exposed suspension-system members.
- J. Thickness: 3/4 inch.
- K. Modular Size: 24 by 24 inches.
- L. Antimicrobial Treatment: Manufacturer's standard broad spectrum, antimicrobial formulation that inhibits fungus, mold, mildew, and gram-positive and gram-negative bacteria and showing no mold, mildew, or bacterial growth when tested according to ASTM D 3273, ASTM D 3274, or ASTM G 21 and evaluated according to ASTM D 3274 or ASTM G 21.

#### 2.4 METAL SUSPENSION SYSTEM

- A. Basis-of-Design Product: Armstrong Prelude XL, Seismic Rx Suspension System.
- B. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. [Armstrong World Industries, Inc.](#)
  - 2. [CertainTeed Corporation.](#)
  - 3. [Chicago Metallic Corporation.](#)
- C. Metal Suspension-System Standard: Provide manufacturer's standard, direct-hung, metal suspension system and accessories according to ASTM C 635/C 635M and designated by type, structural classification, and finish indicated.
- D. Wide-Face, Capped, Double-Web, Steel Suspension System: Main and cross runners roll formed from cold-rolled steel sheet; prepainted, electrolytically zinc coated, or hot-dip galvanized, G30 coating designation; with prefinished 15/16-inch-wide metal caps on flanges.
  - 1. Structural Classification: Heavy-duty system.
  - 2. End Condition of Cross Runners: Override (stepped) type.
  - 3. Face Design: Flat, flush.
  - 4. Cap Material: Cold-rolled steel or aluminum.
  - 5. Cap Finish: Painted white.

## 2.5 ACCESSORIES

- A. Attachment Devices: Size for five times the design load indicated in ASTM C 635/C 635M, Table 1, "Direct Hung," unless otherwise indicated. Comply with seismic design requirements.
- B. Wire Hangers, Braces, and Ties: Provide wires as follows:
  - 1. Zinc-Coated, Carbon-Steel Wire: ASTM A 641/A 641M, Class 1 zinc coating, soft temper.
  - 2. Size: Wire diameter sufficient for its stress at three times hanger design load (ASTM C 635/C 635M, Table 1, "Direct Hung") will be less than yield stress of wire, but not less than 0.106-inch- diameter wire.
- C. Hanger Rods: Mild steel, zinc coated or protected with rust-inhibitive paint.
- D. Flat Hangers: Mild steel, zinc coated or protected with rust-inhibitive paint.
- E. Angle Hangers: Angles with legs not less than 7/8 inch wide; formed with 0.04-inch-thick, galvanized-steel sheet complying with ASTM A 653/A 653M, G90 coating designation; with bolted connections and 5/16-inch-diameter bolts.
- F. Seismic Clips: Manufacturer's standard seismic clips designed to secure acoustical panels in place during a seismic event.
- G. Seismic Stabilizer Bars: Manufacturer's standard perimeter stabilizers designed to accommodate seismic forces.
- H. Seismic Struts: Manufacturer's standard compression struts designed to accommodate seismic forces.

## 2.6 METAL EDGE MOLDINGS AND TRIM

- A. Manufacturer: Provide metal edge moldings and trim by same manufacturer as suspension system.
- B. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. [Armstrong World Industries, Inc.](#)
  - 2. [CertainTeed Corporation.](#)
  - 3. [Chicago Metallic Corporation.](#)
- C. Roll-Formed, Sheet-Metal Edge Moldings and Trim: Type and profile indicated or, if not indicated, manufacturer's standard moldings for edges and penetrations that comply with seismic design requirements; formed from sheet metal of same material, finish, and color as that used for exposed flanges of suspension-system runners.
  - 1. Edge moldings shall fit acoustical panel edge details and suspension systems indicated and match width and configuration of exposed runners unless otherwise indicated.
  - 2. For lay-in panels with reveal edge details, provide stepped edge molding that forms reveal of same depth and width as that formed between edge of panel and flange at exposed suspension member.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, including structural framing to which acoustical panel ceilings attach or abut, with Installer present, for compliance with requirements specified in this and other Sections that affect ceiling installation and anchorage and with requirements for installation tolerances and other conditions affecting performance of acoustical panel ceilings.
- B. Examine acoustical panels before installation. Reject acoustical panels that are wet, moisture damaged, or mold damaged.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 PREPARATION

- A. Measure each ceiling area and establish layout of acoustical panels to balance border widths at opposite edges of each ceiling. Avoid using less-than-half-width panels at borders unless otherwise indicated, and comply with layout shown on reflected ceiling plans.
- B. Layout openings for penetrations centered on the penetrating items.

### 3.3 INSTALLATION

- A. Install acoustical panel ceilings according to ASTM C 636/C 636M, seismic design requirements, and manufacturer's written instructions.
- B. Suspend ceiling hangers from building's structural members and as follows:
  - 1. Install hangers plumb and free from contact with insulation or other objects within ceiling plenum that are not part of supporting structure or of ceiling suspension system.
  - 2. Splay hangers only where required to miss obstructions; offset resulting horizontal forces by bracing, countersplaying, or other equally effective means.
  - 3. Where width of ducts and other construction within ceiling plenum produces hanger spacings that interfere with location of hangers at spacings required to support standard suspension-system members, install supplemental suspension members and hangers in form of trapezes or equivalent devices.
  - 4. Secure wire hangers to ceiling-suspension members and to supports above with a minimum of three tight turns. Connect hangers directly to structure or to inserts, eye screws, or other devices that are secure and appropriate for substrate and that will not deteriorate or otherwise fail due to age, corrosion, or elevated temperatures.
  - 5. Secure flat, angle, channel, and rod hangers to structure, including intermediate framing members, by attaching to inserts, eye screws, or other devices that are secure and appropriate for both the structure to which hangers are attached and the type of hanger involved. Install hangers in a manner that will not cause them to deteriorate or fail due to age, corrosion, or elevated temperatures.
  - 6. Do not support ceilings directly from permanent metal forms or floor deck. Fasten hangers to power-actuated fasteners that extend through forms into concrete.
  - 7. When steel framing does not permit installation of hanger wires at spacing required, install carrying channels or other supplemental support for attachment of hanger wires.

8. Do not attach hangers to steel deck tabs.
  9. Do not attach hangers to steel roof deck. Attach hangers to structural members.
  10. Space hangers not more than 48 inches o.c. along each member supported directly from hangers unless otherwise indicated; provide hangers not more than 8 inches from ends of each member.
  11. Size supplemental suspension members and hangers to support ceiling loads within performance limits established by referenced standards.
- C. Secure bracing wires to ceiling suspension members and to supports with a minimum of four tight turns. Suspend bracing from building's structural members as required for hangers, without attaching to permanent metal forms, steel deck, or steel deck tabs. Fasten bracing wires into concrete with cast-in-place or postinstalled anchors.
- D. Install edge moldings and trim of type indicated at perimeter of acoustical ceiling area and where necessary to conceal edges of acoustical panels.
1. Screw attach moldings to substrate at intervals not more than 16 inches o.c. and not more than 3 inches from ends. Miter corners accurately and connect securely.
  2. Do not use exposed fasteners, including pop rivets, on moldings and trim.
- E. Install suspension-system runners so they are square and securely interlocked with one another. Remove and replace dented, bent, or kinked members.
- F. Install acoustical panels with undamaged edges and fit accurately into suspension-system runners and edge moldings. Scribe and cut panels at borders and penetrations to provide precise fit.
1. Arrange directionally patterned acoustical panels as follows:
    - a. Install panels with pattern running in one direction parallel to axis of space.
  2. For square-edged panels, install panels with edges fully hidden from view by flanges of suspension-system runners and moldings.
  3. For reveal-edged panels on suspension-system runners, install panels with bottom of reveal in firm contact with top surface of runner flanges.
  4. Paint cut edges of panel remaining exposed after installation; match color of exposed panel surfaces using coating recommended in writing for this purpose by acoustical panel manufacturer.
  5. Install seismic clips in areas indicated; space according to panel manufacturer's written instructions unless otherwise indicated.

### 3.4 ERECTION TOLERANCES

- A. Suspended Ceilings: Install main and cross runners level to a tolerance of 1/8 inch in 12 feet, non-cumulative.
- B. Moldings and Trim: Install moldings and trim to substrate and level with ceiling suspension system to a tolerance of 1/8 inch in 12 feet, non-cumulative.

### 3.5 CLEANING

- A. Clean exposed surfaces of acoustical panel ceilings, including trim, edge moldings, and suspension-system members. Comply with manufacturer's written instructions for cleaning and touchup of minor finish damage.

- B. Remove and replace ceiling components that cannot be successfully cleaned and repaired to permanently eliminate evidence of damage.

END OF SECTION 095113

## SECTION 096200 - SEAMLESS RESINOUS FLOORING

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. The work consists of furnishing all plant, labor, materials and equipment necessary or incidental to complete the work as shown on the Drawings, and set forth in these Specifications, for seamless resinous flooring.

#### 1.2 SUBMITTALS

- A. Surfacing applicator shall submit samples of color and textures for Architect's approval.
- B. Prior to commencing work, at architect's discretion, applicator shall install a 100 square foot sample on the job of desired color and texture and when approved, this will serve as the standard for the entire project.

#### 1.3 QUALITY ASSURANCE

- A. All materials must be recommended and manufactured by a single supplier to insure compatibility and proper chemical and mechanical bond.
- B. Surfacing shall be applied by a surfacing applicator approved by the Architect, with a minimum of seven (7) years experience installing the brand of surfacing in similar size and function projects. A list of ten (10) completed projects using the specified materials must be submitted proving seven (7) years experience by the lead mechanic.
- C. Surfacing applicator shall provide to the architect a completed list of jobs including the names of the Architect, General Contractor, Owner, telephone numbers of all concerned, materials used, quantity installed and date completed on similar projects.
- D. Surfacing applicator must provide a written joint guarantee for materials and workmanship between applicator and surfacing manufacturer for one (1) year.
- E. Surfacing applicator or manufacturer seeking approval of products other than what is specified must supply samples, full product information, technical data with specifications, certification from an independent testing laboratory that the product being submitted for approval meets all requirements of the performance properties specified within this specification, installation instructions and comply with the above quality assurances in writing fourteen (14) days before bid letting. Omission of any item will result in an automatic rejection.
- F. Bidders will be notified by addendum of substitute surfacing materials, if approved.

#### 1.4 PRODUCT STORAGE AND ENVIRONMENTAL CONDITIONS:

- A. Material temperatures shall be a minimum of 55° F before use.

- B. Work on seamless flooring shall not commence until the building can be maintained at a minimum temperature of 55° F for 48 hours before, during and 48 hours after application. Areas shall also be broom clean and reasonably dust free and shall have adequately controlled ventilation with bright, uniform lighting.

## 1.5 TESTING OF CONCRETE SUBSTRATE

- A. One of the following three methods shall be used to determine moisture content of slab at time of application. These tests only measure the specific area tested at the time of the test and are not predictors of future substrate conditions.
  - 1. Using a Tramax concrete moisture detection device, firmly apply the test apparatus to concrete that has had sealers or other subsequent coatings removed. The readings shall be 4.5% or less. If readings are higher, use ASTM F-2170 for non conditional spaces and/or ASTM F1869 for conditioned spaces.
  - 2. ASTM F-2170 in sites Relative Humidity Test. Follow test procedures of manufacturer of testing equipment. Reading should be below 80%. If above 80%, use the next test method below. (Only if space is conditioned.)
  - 3. ASTM F-1869 Calcium Chloride Moisture Vapor Transmission Test. Follow test procedures of manufacturers of MVT kits. Results should be below 3 to 4 lbs/1,000 square feet/24 hours.

## 1.6 WARRANTY

- A. Applicator shall notify manufacturer of project requirements before bidding. Manufacturer shall provide single source warranty for entire installation including labor for two years. Warranty shall include removal and replacement if proven defective. Defective items are but not limited to debonding, discoloration, excessive wear and staining by bodily fluids.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. Desco Quartz Cremona TG Floor manufactured by Desco Coatings, Inc. 1-800-426-4164 or approved equal.
- B. Stonhard Flooring Co.
- C. Topcor Resinous Flooring Systems
- D. Or pre-approved equal by the Architect .

### 2.2 ACCESSORIES

- A. Provide 6" high turned up coved base with 1" radius cove as indicated on drawings.
- B. Provide elastomeric waterproof membrane.



- C. Binder and all successive grout and top coats shall be 100% solids clear/epoxy resin. Ceramic coated quartz aggregates as supplied by Desco Coatings are to be used to achieve all color. No pigmented epoxy base or top coats allowed.
- D. Minimum Performance Characteristics:
- |                                      |             |
|--------------------------------------|-------------|
| 1. Compressive Strength (ASTM C-579) | 9,200 psi   |
| 2. Tensile Strength (ASTM C-307)     | 1,650 psi   |
| 3. Flexural Strength                 | 4,000 psi   |
| 4. Shore D Hardness (ASTM D-2240)    | 85-90       |
| 5. Bond Strength (ASTM D-4541)       | 425 psi     |
| 6. Abrasion Resistance (ASTM D-460)  | 0.08 mg     |
| 7. Pot Life                          | 35 min      |
| 8. Cure Time @ 77°F                  | 10-12 hours |
- E. Epoxy top coats shall produce no color shift after exposure to fluorescent lighting on the “b” axis yellow index after 3 weeks exposure.
1. 20% Hydrochloric Acid
  2. 10% Lactic Acid
  3. Urine
  4. Tea
  5. Coffee
  6. Mustard
  7. Ethyl Alcohol
  8. Mercurochrome
  9. Betadyne

## PART 3 - EXECUTION

### 3.1 PROJECT CONDITIONS:

- A. Before commencing work, ensure environmental and site conditions are suitable for application and curing.
- B. Surfaces shall be acceptable in accordance with flooring manufacturer's recommendations.
- C. Notify Architect and Contractor in writing of unsuitable surfaces and conditions. Commencement of work shall imply acceptance of surfaces and working conditions.
- D. Recommended Moisture Vapor Transmission Considerations:
  1. Placement of on-grade slabs over a Class A vapor retarder as defined by ASTM E-145.
  2. A water cement ratio of 0.45 and 0.5.
  3. Curing by ASTM C-171 sheet materials for curing concrete.
  4. A slump in the range of 3 to 4 inches which can be increased by the use of super plasticizers.

### 3.2 FLOORING / WALL PREPARATION

- A. Surface must be clean, sound and dry.

- B. Effectively remove concrete laitance on accessible floor surfaces by mechanical shot blast. Acid etching is not acceptable.
- C. Areas where flooring is existing must be cleaned to remove all floor material, grease or any residue that might retard interfacial adhesion between substrate and surfacing.

### 3.3 FLOORING / WALL APPLICATION

- A. Apply flooring in accordance with manufacturer's printed instructions, employing lead mechanic qualified under the quality assurance portion of this specification, using equipment specifically designed for this purpose.
- B. Thickness varies with System selected. Choose one of the following.
- C. Desco Quartz Cremona TG is a hand troweled grade 11 Desco quartz aggregate with 20% of grade 28 as a filler. The system should be hand troweled to 3/16" thickness over epoxy primer.
- D. Install integral cove base to height of 6" with 1" radius cove.
  - 1. Trowel apply vertical cove base and flat floor.
  - 2. Hand sand cove base.
  - 3. Apply three coats of resin to assure a smooth surface and cove.
  - 4. Do not allow resin to puddle in cove.
- E. Install waterproof membrane to a dry mil thickness of 20 mils.
- F. Finished work shall match approved samples; be uniform in thickness, sheen, color, pattern, and texture; and be free from defects detrimental to performance.

### 3.4 PROTECTION

- A. Protect adjacent surfaces from damage resulting from work of this trade. If necessary, mask and/or cover adjacent surfaces, fixtures, cabinet work, equipment, etc. by suitable means.
- B. After completion of flooring the General Contractor/Owner shall protect flooring from damage by other trades.

END OF SECTION

## SECTION 096513 - RESILIENT WALL BASE AND ACCESSORIES

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes the following:
  - 1. Wall base.
  - 2. Molding accessories.

#### 1.3 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Samples for Verification: For each type of product indicated, in manufacturer's standard-size Samples but not less than 12 inches long, of each resilient product color, texture, and pattern required.

#### 1.4 EXTRA MATERIALS

- A. Furnish extra materials described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
  - 1. Furnish not less than 10 linear feet for every 500 linear feet or fraction thereof, of each type, color, pattern, and size of resilient product installed.

### PART 2 - PRODUCTS

#### 2.1 MANUFACTURERS

- A. Available Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to, products listed in other Part 2 articles.
- B. Products: Subject to compliance with requirements, provide one of the products listed in other Part 2 articles.

## 2.2 RESILIENT WALL BASE

- A. Wall Base: ASTM F 1861.
  - 1. Armstrong World Industries, Inc.;
  - 2. Azrock Commercial Flooring, DOMCO;
  - 3. Burke Mercer Flooring Products;
  - 4. Endura;
  - 5. Mondo Rubber International, Inc.;
  - 6. Roppe Corporation;
- B. Type (Material Requirement): TS (rubber, vulcanized thermoset) or TP (rubber, thermoplastic).
- C. Style: Cove (with top-set toe or Straight (toeless).
- D. Height: 4 inches.
- E. Lengths: Coils in manufacturer's standard length.
- F. Outside Corners: Job formed or pre-molded.
- G. Inside Corners: Job formed or pre-molded.
- H. Surface: Smooth.

## 2.3 INSTALLATION MATERIALS

- A. Trowelable Leveling and Patching Compounds: Latex-modified, portland cement based or blended hydraulic cement based formulation provided or approved by resilient product manufacturers for applications indicated.
- B. Adhesives: Water-resistant type recommended by manufacturer to suit resilient products and substrate conditions indicated.
- C. Stair-Tread-Nose Filler: Two-part epoxy compound recommended by resilient tread manufacturer to fill nosing substrates that do not conform to tread contours.

## PART 3 - EXECUTION

### 3.1 PREPARATION

- A. Prepare substrates according to manufacturer's written recommendations to ensure adhesion of resilient products.
- B. Concrete Substrates for Stair Accessories: Prepare according to ASTM F 710.
  - 1. Verify that substrates are dry and free of curing compounds, sealers, and hardeners.
- C. Remove substrate coatings and other substances that are incompatible with adhesives and that contain soap, wax, oil, or silicone, using mechanical methods recommended by manufacturer. Do not use solvents.

- D. Use trowelable leveling and patching compound to fill cracks, holes, and depressions in substrates.

### 3.2 RESILIENT WALL BASE INSTALLATION

- A. Apply wall base to walls, columns, pilasters, casework and cabinets in toe spaces, and other permanent fixtures in rooms and areas where base is required.
- B. Install wall base in lengths as long as practicable without gaps at seams and with tops of adjacent pieces aligned.
- C. Tightly adhere wall base to substrate throughout length of each piece, with base in continuous contact with horizontal and vertical substrates.
- D. Do not stretch wall base during installation.
- E. On masonry surfaces or other similar irregular substrates, fill voids along top edge of wall base with manufacturer's recommended adhesive filler material.
- F. Pre-molded Corners: Install pre-molded corners before installing straight pieces.
- G. Job-Formed Corners:
  - 1. Outside Corners: Use straight pieces of maximum lengths possible. Form without producing discoloration (whitening) at bends. Shave back of base at points where bends occur and remove strips perpendicular to length of base that are only deep enough to produce a snug fit without removing more than half the wall base thickness.
  - 2. Inside Corners: Use straight pieces of maximum lengths possible. Form by cutting an inverted V-shaped notch in toe of wall base at the point where corner is formed. Shave back of base where necessary to produce a snug fit to substrate.

END OF SECTION 096513

## SECTION 096813 –TILE CARPETING

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. Section Includes
  - 1. Modular Carpet Tile
  - 2. Recycled Content
  - 3. Installation & Floor Prep
- B. Related Documents: Drawings and general provisions of the Contract.

#### 1.2 SUBMITTALS

- A. Shop Drawing showing columns, doorways, enclosing walls or partitions, built-in cabinets, and locations where cutouts are required as well as direction of carpet pile and pattern, location of edge moldings and edge bindings shall be submitted to the Architect for approval prior to installation.
- B. Floor schedule using same room designations indicated on drawings.
- C. Product Data: Provide data on specified products, describing physical and performance characteristics, sizes, patterns, colors available, and method of installation.
- D. Verification Samples: Submit samples illustrating color and pattern for each carpet material specified.
- E. Manufacturer's Installation Instructions: Indicate special procedures and perimeter conditions requiring special attention.
- F. Maintenance Data: Include maintenance procedures, recommendations for maintenance materials and equipment, and suggested schedule for cleaning.
- G. Manufacturer's Product Warranty.
- H. Verification of product Recycled Content Certification and product Certification to NSF 140.
- I. Certifications: Manufacturer to submit copies of the following independent laboratory reports showing compliance with requirements per these methods outlined in Part 2 of this document. Submitted results shall represent average results for production goods of the specified style.
  - 1. ASTM E-648 Flooring Radiant Panel
  - 2. ASTM E-662: Smoke Density
  - 3. AATCC 134: Electrostatic Propensity
  - 4. CRI TM-102: Fluorine Analysis
  - 5. ASTM D-3936: Delamination
  - 6. Other from methods specified in Part 2

### 1.3 QUALITY ASSURANCE

#### A. Manufacturer Qualifications

1. Company specializing in manufacturing modular carpet tile with minimum 15 years documented experience. Manufactures operation must include yarn to backing process in lieu of sub-contracting this process to another company.
2. Upon request, manufacturer to provide representative to assist in project start-up and to inspect installation while in process and upon completion. Representative will notify designated contact if any installation instructions are not followed.
3. Single Source Responsibility: Obtain each type of product from one source and by a single manufacturer.

#### B. Installer Qualifications

1. Flooring contractor must be certified by the manufacturer prior to bid.
2. Flooring contractor to be a specialty contractor normally engaged in this type of work and shall have prior experience in the installation of these types of materials.
3. Certify payment of Prevailing Wage Rates to the installers.
4. Flooring contractor possessing Contract for the product installation shall not sub-contract the labor without written approval of the Project Manager.
5. Flooring contractor will be responsible for proper product installation, including floor testing and preparation as specified by the manufacturer and JOB CONDITIONS herein.
6. Flooring contractor to provide Owner a written installation warranty that guarantees the completed installation to be free from defects in materials and workmanship for a period of one year after job completion.

### 1.4 DELIVERY, STORAGE, & HANDLING

- A. Deliver materials to the site in manufacturer's original packaging listing manufacturer's name, product name, identification number, and related information.
- B. The temperature of the interior environment, including the sub floor should be no lower than 65°F and no higher than 90°F at least 72 hours prior to, during and after the tile installation. All Tandus Flooring products and installation materials should be stored between 65°F and 90°F for at least 48 hours prior to installation. Relative humidity should be no more than 65%.
- C. Make stored materials available for inspection by the Owner's representative.
- D. Store materials in area of installation for minimum period of 48 hours prior to installation.

### 1.5 REMOVAL OF EXISTING CARPET & CARPET RECLAMATION

- A. The Contractor(s) shall provide services to remove existing carpet and provide carpet reclamation.
- B. The Contractor(s) shall reclaim all carpet removed from the Customers installation location and ship to a reclamation facility for recycling; regardless of manufacturer, fiber type or construction (other than products containing asbestos).
- C. Cost for removal and recycling shall be provided by Contractor or Manufacturer .

- D. Manufacturer shall provide certificate verifying confirmation of carpet recycling.

## 1.6 PROJECT CONDITIONS

- A. Sub-floor preparation is to include all required work to prepare the existing floor for installation of the product as specified in this document and Manufacturer's installation instructions.
- B. The maximum amount of moisture evacuation from the floor is 3.0 pounds per 1,000 square feet in 24 hours. The acceptable pH level of the substrate is between 7.0 and 9.0. Flooring contractor is responsible for floor testing.
- C. All material used in sub-floor preparation and repair shall be recommended by the carpet manufacturer and shall be chemically and physically compatible with the carpet system being bid.
- D. Maintain minimum 65 degrees F ambient temperature and 65% Relative Humidity for 72 hours prior to, during, and 48 hours after installation.
- E. Do not install flooring until space is enclosed and weatherproof, wet-work in space is completed and nominally dry, work above ceilings is complete, and ambient temperature and humidity conditions are and will be continuously maintained at values near those indicated for final occupancy.

## 1.7 EXTRA MATERIALS

- A. Provide additional 5% of product for "attic stock."

## PART 2 - PRODUCTS

### 2.1 PRODUCT SPECIFICATIONS

- A. Manufactured by J&J Flooring Group
  - 1. STYLE NAME: Fractured Plaid Corded - (Color: To Be Confirmed)
    - a. Size: 24x24
    - b. Construction: Patterned Loop
    - c. Backing: Nexus Modular

### 2.2 ACCESSORIES

- A. Materials recommended by Manufacturer for patching, leveling, priming, etc.
- B. Base, Carpet Edge, and Transition Strips:
  - Schluter Systems L.P.
  - 194 Pleasant Ridge Road
  - Plattsburgh, NY 12901-5841



## PART 3 - EXECUTION

### 3.1 EXAMINATION / PREPARATION

- A. Prepare sub-floor to comply with criteria established in Manufacturer's installation instructions. Use only preparation materials that are acceptable to the Manufacturer.
  - 1. Remove all deleterious substances from substrate(s) that would interfere with or be harmful to the installation. Remove sub-floor ridges and bumps. Fill cracks, joints, holes, and other defects.
- B. Verify that sub-floor is smooth and flat within specified tolerances and ready to receive carpet.
- C. Verify that substrate surface is dust-free and free of substances that would impair bonding of product to floor.
- D. Verify that concrete surfaces are ready for installation by conducting moisture and pH testing. Results must be within limits recommended by Manufacturer.
- E. There will be no exceptions to the provisions stated in the Manufacturer's installation instructions.

### 3.2 INSTALLATION - GENERAL

- A. Install product in accordance with Manufacturer's installation instructions. Product must have low VOC, factory applied, "dry" adhesive. A peel & stick method applied to the back at the time of manufacture is preferred.
- B. Product as installed to be securely attached to the floor in compliance with Americans with Disabilities Act (ADA), Section 4.5.3.
- C. Where demountable partitions or other items are indicated for installation on top of finished carpet tile floor, install carpet tile before installation of these items.
- D. Cut and fit carpet tile to butt tightly to vertical surfaces, permanent fixtures, and built-in furniture including cabinets, pipes, outlets, edgings, thresholds, and nosings.
- E. Extend carpet tile into toe spaces, door reveals, closets, open-bottomed obstructions, removable flanges, alcoves, and similar openings.
- F. Roll with appropriate roller for complete contact of product with adhesive to sub-floor.
- G. Trim carpet neatly at walls and around interruptions. Completed product is to be smooth and free of bubbles, puckers, and other defects.

### 3.3 PROTECTION & CLEANING

- A. Remove excess adhesive and/or other from floor and wall surfaces without damage.

- B. All rubbish, wrappings, debris, trimmings, etc. to be removed from site and disposed of properly.
- C. Clean and vacuum surfaces using a beater brush/bar commercial vacuum.
- D. After each area is installed, protect from soiling and damage by other trades.

END OF SECTION

## SECTION 096850 – LUXURY VINYL TILE

### PART 1 GENERAL

#### 1.1 SUMMARY

- A. This section includes Luxury Vinyl Tile (LVT) flooring as shown on the drawings and schedules and as indicated by the requirements of this section.

#### 1.2 QUALITY ASSURANCE AND REGULATORY REQUIREMENTS

- A. Qualifications of Installers: All work shall be done by installation firms specializing in commercial LVT installation. It is required, that the firm or individual shall be a member of the Floor Covering Installation Contractors Association (FCICA) and/or certified by the Certified Floorcovering Installers Association (CFI). Flooring contractor to be specialty contractor normally engaged in this type of work and shall have three (3) years minimum documented experience in commercial installation of these materials and participation in manufacturer's environmental program including responsible carpet removal, recycling, and installation.
- B. Flooring contractor will be responsible for the proper product installation, including floor preparation in all the areas indicated in the drawings to receive LVT.
- C. Flooring contractor to provide owner a written warranty that guarantees the completed installation to be free from defects in materials and workmanship for a period of no less than two (2) years after job completion.
- D. All warranties must be issued by the manufacturer as standard published warranties on all types of LVT within this document. Second source warranties that involve parties other than the LVT manufacturer are unacceptable. If the product fails to perform as warranted when installed according to the J+J Flooring Group installation instructions and maintained according to J+J Flooring Group maintenance instructions, the affected area will be repaired or replaced at the expense of the manufacturer. The LVT manufacturer will provide standard published written performance warranties for the following:
  - 1. A Ten (10) Year warranty on manufacturing defects and a Ten (10) year wear warranty stating that product will not wear through (damage or affect) the printed film layer due to normal traffic. Manufacturer will pay all reasonable labor costs (these costs will be determined by manufacturer)
- E. LVT manufacturer to provide field service experts to assist in project start-up as required by the job. Manufacturer will notify owner, architect, general contractor, or another designated contact if any installation instructions are not followed.
- F. Provide flooring material to meet the following test performance criteria as tested by a recognized independent testing laboratory. Certified test reports shall be submitted by the carpet manufacturer for each test method. Requirements listed below must be met by all products being submitted for approval:
  - 1. Materials: Phthalates Free
  - 2. Indoor Air Quality: FloorScore® Certified
  - 3. End of Life: 100% Recyclable

4. Class / ASTM F1700: Class III Printed Film Vinyl Plank - Type B (embossed)
5. Flooring Radiant Panel: Class 1
6. ADA Compliance: Compliant For Accessible Routes
7. ASTM F2055 (Size and Tolerance): Passes
8. ASTM F386 (Thickness): Passes
9. ASTM F1914 (Residual Indentation): Passes
10. ASTM F137 (Flexibility): Passes
11. ASTM F2199 (Dimensional Stability): Passes
12. ASTM F925 (Chemical Resistance): Passes
13. ASTM F1514 (Resistance to Heat): Passes
14. ASTM F1515 (Resistance to Light): Passes
15. ASTM E648 (Critical Radiant Flux): Passes
16. ASTM E662 (Optical Smoke Density): Passes
17. ASTM C1028 (Slip Resistance): Passes
18. ASTM F970 (Static Load): Passes

### 1.3 SUBMITTALS

- A. Submit to architect and/or owner ten (10) days prior to bid, two (2) finished samples of the exact type of LVT proposed, including quality, pattern, and color.
- B. Submit manufacturer's warranties, installation instructions, and maintenance instructions before bid date
- C. Submit the manufacturer's certification that the flooring has been tested by an independent laboratory and complies with the required fire tests as well as the test listed under 1.04 F.
- D. Submit to architect and/or owner ten (10) days prior to bid, the manufacturers plan for recycling the specified flooring and related items at the end of the useful life of the flooring.

### 1.4 ENVIRONMENTAL/FIELD CONDITIONS

- A. Deliver all materials to the installation site in the manufacturer's original packaging and in good condition. Packaging to contain manufacturer's name and marks, identification number, shipping and handling instructions and related information
- B. Delivered and stored materials must be available for inspection as required by the owner, architect, general contractor, and/or the manufacturer.
- C. Sub-floor preparation is to include all required work to prepare the existing floor for installation of the product as specified in this document. Sub-floor preparation shall meet all conditions as specified in J+J Flooring Group's Luxury Vinyl Tile installation instructions.
- D. Sub-floor preparation will include, as required, the removal and repair of the existing floor surface. It is required that the floor of a renovation project be inspected before the bid date.

- E. The building must be enclosed and the HVAC in continuous operation. The LVT and adhesive must be conditioned to room temperature for 3 days prior to installation, during the installation and continuous following completion of the installation. The ambient air relative humidity must be between 10%-65% with the floor and room temperature between 55- 85 degrees Fahrenheit. The indoor temperature should never fall below 55 degrees Fahrenheit or above 85 degrees Fahrenheit regardless of the age of the installation.
- F. Store cartons of tile or plank products flat and squarely on top of one another. Preferably, locate material in the “center” of the installation area (i.e. away from vents, direct sun- light, etc.) Storing cartons in direct sunlight may affect proper acclimation by inducing thermal expansion/contraction.
- G. When palletizing on a jobsite, vinyl plank or tiles need to be stacked 2 rows high side by side with no airspace between. Then quarter turned for 2 rows side by side, not to exceed 12 boxes high. A 5/8” or thicker plywood must also be placed on the pallet first. Do not stack pallets 2 high unless utilizing a 3/4” thick plywood cap between pallets.

## PART 2 PRODUCTS

### 2.1 MANUFACTURERS

#### A. Acceptable Manufacturer:

- 1. A ten (10) year warranty on manufacturing defects and a ten (10) year wear warranty stating that product will not wear through (damage or affect) the printed film layer due to normal traffic. If a verified material failure occurs, the manufacturer will pay 100% of all reasonable labor costs for the warranty period (these costs will be determined by manufacturer).
  - a. J+J Flooring Group, P.O. Box 1287, Dalton, GA, 30722. (800) 241-4586. JJFLOORINGGROUP.COM. Please contact ERIKA EVANS, (314) 502-2325, [erika.evans@jjflooringgroup.com](mailto:erika.evans@jjflooringgroup.com)
- 2. Any manufacturer and/or product must meet or exceed those requirements specified under all sections of this document in pattern, color, and format. Any substitutions must be made in accordance with Section 1.00 of this document.

### 2.2 FLOORING MATERIALS

#### A. Luxury Vinyl Tile:

- 1. Product: Framework V5001
- 2. Color: As selected by Architect
- 3. Added Antimicrobial: ZPT (Zinc Protective Technology)
- 4. Thickness: 5mm
- 5. Finish / Coating: Enhanced UV Urethane w/ Ceramic Bead
- 6. Pattern Repeat: Random Wood Pattern
- 7. Dimensions: 9"x48"
- 8. Backing Class: Commercial Grade

## 9. Commercial Traffic: Heavy Commercial

### 2.3 ADHESIVES

- A. Commercialon® Premium Modular/LVT Pressure Sensitive Adhesive, a premium modular flooring adhesive specifically formulated for bonding J+J Flooring Group's Luxury Vinyl Tile to the floor.

### 2.4 ACCESSORIES

- A. Provide extruded aluminum (mill finish) transition, edge and reducing strips tapered to meet abutting materials as required.

## PART 3 EXECUTION

### 3.1 INSPECTION

- A. Examine and verify that sub-floor surfaces are smooth and flat within tolerances specified for that type of work and are ready to receive flooring.
- B. Verify that wall surfaces are smooth and flat within the tolerances specified for that type of work, are dust-free, and are ready to receive flooring.
- C. Verify that sub-floor surfaces are dust-free and free of substances that could impair bonding of adhesive materials to sub-floor surfaces.
- D. Verify that concrete sub-floor surfaces are dry enough and ready for flooring installation by testing for moisture emission rate and alkalinity in accordance with ASTM F 710; obtain instructions if test results are not within limits recommended by carpet manufacturer and adhesive materials manufacturer.
- E. Verify that required floor-mounted utilities are in correct location.
- F. J+J/Industries requires that the Luxury Vinyl Tile be inspected prior to installation for proper style, color and potential defects. No claims will be honored if the LVT is installed with visible defects. Should there be a problem, call J+J Customer Relations at 800.241.4586.

### 3.2 PREPARATION

- A. Starting installation constitutes acceptance of sub-floor conditions.
- B. SURFACE PREPARATION- Dust, dirt, debris and noncompatible adhesive must be removed before the installation begins. Surfaces must be smooth and level with all holes and cracks filled with Portland cement-based patch reinforced with polymers or primed with Commercialon Premium Sealer.
- C. LATEX OR OLD ADHESIVES - Must be mechanically scraped down to a bare residue flat with the concrete substrate or covered with a skim coat of Portland cement-based patch reinforced with polymers. Any old adhesive residue must also be covered with Commercialon Premium Sealer. Note: Failure to remove or seal old latex or cut back

adhesive may cause installation failure, plasticizer migration, shifting, buckling or edge curling; these conditions will not be covered under warranty.

- D. CUT BACK ADHESIVES - Must be wet mechanically scraped to a minimum residue and encapsulated with Commercial on Premium Sealer.
- E. CONCRETE MOISTURE TESTING and pH Testing - Substrate surfaces must be tested for moisture emission. It is the responsibility of the owner or owner's representative to perform moisture testing prior to starting the installation. ASTM-F2170-2 relative humidity probe moisture testing or ASTM-F1869 calcium chloride testing can be performed on the concrete to determine the surface moisture emission rate. Acceptable relative humidity probe testing results are up to 90% RH. An acceptable result for calcium chloride moisture testing is up to 5 lbs per 1,000 SF per 24 hours. Alkalinity tests should also be performed per ASTM-F710. The maximum acceptable pH is 9.0. J+J Flooring Group prefers relative humidity probe moisture testing over calcium chloride testing, as the results are more accurate and reliable. For test results that determine RH test readings of 90% - 95%, moisture emission rates of 5 lbs - 8 lbs, or pH readings of 9.0 - 11.00, Commercial on Premium Sealer is required.
- F. New Concrete - New concrete must be fully cured and free of moisture. New concrete requires a curing period of approximately 90 days.

### 3.3 INSTALLATION OF FLOORING

- A. Install J+J LVT using conventional tile and plank installation techniques. Plank products should have a minimum of 6-8" seam stagger.  
Carefully determine where to begin tile or plank installation; it is customary to center the rooms and hallways so borders are not less than half a tile or plank.  
Working out of multiple boxes at a time is recommended.  
Make sure cut edges are always against the wall. To properly cut LVT/LVP products score the top side of the material with a utility knife. Bend the product and finish the cut through the backside. This will ensure the cleanest cut. It may be necessary to use a heat gun to cut around vertical obstructions. Allow the heated LVT/LVP to return to room temperature before installation.  
Cutting the product into a fine point may lead to delamination. Use an ethyl cyanoacrylate based super glue to help fuse the LVT/LVP point together. Be sure to clean all glue from the decorative surface immediately. Alcohol based super glues may cause the vinyl to swell.  
Roll the plank/tile with a 3 section 100 lb. roller. Re-roll the entire glued floor area with the 100 lb. roller within the working time of the adhesive. Continue to roll the floor throughout the working day to ensure proper bond.

### 3.4 INSTALLATION OF ACCESSORIES

- A. Install accessories as required by drawings and per manufacturer's specifications.

### 3.5 CLEANING AND PROTECTION

- A. Remove excess adhesive without damage, from floor, base, and wall surfaces.
- B. Recommended to use floor protection after installation. DO NOT use plastic adhesive-based protection system.

## SECTION 09 91 00 - PAINTING

### PART 1 -GENERAL

#### 1.1 SUMMARY:

- A. Work of this section includes:
  - 1. Touching up of shop-applied prime coats.
  - 2. Preparation of surfaces to receive finishes.
  - 3. Painting, staining or otherwise finishing of all surfaces, except as otherwise indicated
- B. Related work specified elsewhere:
  - 1. Shop-applied primer coats.
  - 2. Sealants and caulking.
  - 3. Special finishes.
  - 4. Piping identification.
  - 5. Prefinished items.

#### 1.2 SUBMITTALS:

- A. Product data:
  - 1. Submit complete list of products proposed for use at least 30 days prior to commencement of painting work.
  - 2. Indicate manufacturer, brand name, quality, type, and sheen for each type of paint and for each surface to be finished. Indicate VOC rating and compliance with applicable regulations.
  - 3. indicate manufacturer's instructions regarding mixing, surface preparation and application. include application rates, film thickness and required primers.
  - 4. Intent of Contractor to use products specified does not relieve him from responsibility of submitting product list.
- B. Color samples: Submit two sets of color samples from paint manufacturers proposed for use, for color selections by Owner.
- C. Card stock brush-outs: Following issue of color schedule prepare two sets of color coat brush-outs for each paint, stain, color, sheen and texture scheduled, applying actual finish color coat and texture to standard sample card stock, minimum 80 sq. in. size,

#### 1.3 QUALITY ASSURANCE:

- A. Applicable standards, as referenced herein: Environmental Protection Agency (EPA), volatile organic compounds (VOC) standards as required by local codes and regulations.

#### 1.4 DELIVERY, STORAGE AND HANDLING:

- A. Delivery: Deliver materials to project site ready-mixed in original containers with labels



intact; labels bearing manufacturer's name, paint type, color and recommended installation and reducing procedures.

- B, Storage and handling:
  - 1. Store materials in location acceptable to Architect.
  - 2. Maintain neat, clean conditions in storage area; remove rags and waste materials at end of each day's work.
  - 3. Close containers at end of day's work. Leave no materials open,

#### 1.5 PROJECT SITE CONDITIONS:

- A. Environmental requirements:
  - 1. Comply with manufacturer's product data as to environmental conditions under which materials may be applied.
  - 2. Apply no materials in spaces where dust is being generated.
  - 3. Comply with applicable VOC regulations.
- B. Protection: Cover finished work of other trades and surfaces not being painted concurrently and prefinished items.
- C. Safety precautions:
  - 1. Provide temporary fire protection equipment in materials storage area
  - 2. Prohibit smoking in storage area,

### PART 2 - PRODUCTS

#### 2.1 PAINTING MATERIALS:

- A. Acceptable manufacturers: Except as otherwise noted, products specified as a standard of quality are manufactured by Benjamin Moore & Company. Products of the following manufacturers similar in type and quality are acceptable for use, subject to approval of product list:
  - 1. ICI Paints,
  - 2. Benjamin Moore Co.
  - 3. Duron Paint Co.
  - 4. PPG Architectural Finishes, Inc.
  - 5. Porter Paint Co.
  - 6. Sherwin-Williams Co.
- B. Where products other than those of the manufacturer listed as the standard of quality are specified in Painting Schedule, such products have been selected to achieve specific results and substitutions will be allowed only in accord with Product Options and Substitutions section.
- C. Miscellaneous materials:
  - 1. Paint thinners and tints shall be products of same manufacturer as paints or approved by him for use with his products,
  - 2. Shellac, turpentine, patching compounds and similar materials required for execution of work shall be pure, best quality products.
- D. Paint colors shall be as selected by Architect.

### PART 3 - EXECUTION

### 3.1 PREPARATION:

- A. Surfaces to receive finishes shall be dry and free of debris, oils, dust or other deleterious materials.
- B. Existing surfaces:
  - 1. For previously painted surfaces, remove dirt, debris, and chalk by washing with detergent and water. Sand glossy surfaces, remove loose paint and blisters by scraping and sanding. Apply bond coat when required by paint manufacturer's product data.
  - 2. Previously painted metal surfaces to remain shall be wire-brushed and cleaned of all existing paint and rust,
  - 3. Treat mildewed surfaces with a solution of one quart hypochlorite bleach to a half cup of detergent to one gallon water. Rinse and allow to dry prior to painting.
  - 4. Previously painted masonry:
    - a. Where existing paint is loose or blistered, remove by scraping or brushing.
    - b. Remove debris and chalking from surfaces by washing with detergent and water. Flush with clean water. Touch up with material specified for finish.
- C. Where finish materials abut or are abutted by dissimilar materials, caulk joints in accord with Sealants and Caulking section.
- D. Lumber, plywood and veneered wood surfaces:
  - 1. Apply shellac, maximum two pounds cut to knots, pitch and resinous sapwood prior to application of first paint or stain coat.
  - 2. For surfaces to receive opaque finish, fill nail holes, cracks, joints and defects with spackling compound. Apply after first coat of paint.
  - 3. For surfaces to receive transparent finish, fill nail holes, cracks and defects with wood filler matching finish color.
  - 4. Sand surfaces smooth except where rough sawn surfaces are indicated. Final step shall remove scuffs, handling marks and effects of moisture exposure. Dust to remove debris.
    - a. Sand plane surfaces using sanding block; touch sand moldings in manner preventing removal of sharp edges or obscuring profile.
    - b. Moldings cut with machine finish or minimum 16 knife cuts per inch shall not require further sanding except to correct irregularities.
    - c. Sand surfaces within normal visual range, including surfaces within 10'-0" of floor level, using not less than 80 grit abrasive exterior or 100 grit abrasive interior, except increase to 120 to 180 grit abrasive for transparent finished interior surfaces.
    - d. Install prefinished or pre-surfaced items following finishing or sanding of adjacent surfaces. Replace prefinished items damaged by finishing of adjacent work.
- E. Gypsum drywall:
  - 1. Fill narrow, shallow cracks and small holes with patching compound. Allow to dry and sand

- smooth without raising nap of wallboard paper.
2. Drywall shall be finished as specified in Gypsum Wallboard Systems section prior to painting.
- F. Galvanized metals:
1. Test for passivator or stabilizer using copper sulfate solution (20 grams of copper sulfate in one liter of water). If passivator or stabilizer is present, remove by brush blasting, sanding or chemical etching.
  2. Wash with xylol to remove grease, oil and contaminants. Wipe dry with clean cloth.
- G. Aluminum:
1. Sand or scrape to remove oxides.
  2. Wash with xylol to remove grease, oil and contaminants. Wipe dry with clean cloth.
- H. Ferrous metals:
1. Wire-brush or sandpaper to remove rust and mill scale.
  2. Solvent-clean with xylol to remove grease, oil and contaminants, Wipe dry with clean cloth.
- I. Ferrous and galvanized metals and aluminum to receive epoxy finish:
1. Ferrous metals: Brush sandblast, power tool clean, or hand tool clean to remove rust and mill scale.
  2. Ferrous and galvanized metals and aluminum:
    - a. Remove dirt and dust with stiff bristle brush or compressed air.
    - b. Solvent clean with xylol or mineral spirits to remove grease, oil and contaminants. Wipe dry with clean cloth.

### 3.3 APPLICATION:

- A. Apply paint only when moisture content of surfaces is within limits recommended in product data. Apply paint materials using clean brushes, rollers or spraying equipment
- B. Apply materials at rate not exceeding that recommended in product data for surface being painted, less ten percent for losses.
- C. Comply with product data for drying time between coats
- D. Sand and dust between coats to remove defects visible from a distance of 5'-0".
- E. Finish coats shall be smooth, free of brush marks, streaks, laps or pile-up of paint, skipped or missed areas.
- F. Do not apply additional coats until completed coat has been observed by Architect. Only these coats of paint will be considered in determining number of coats applied.
- G. Make edges of paint adjoining other materials or colors clean and sharp without overlapping.
- H. Primer coats may be omitted for surfaces specified to receive factory-applied primer, if primer is compatible with finish coats. If primer coats are not compatible, substitute a bond coat as recommended by paint manufacturer for specified primer coat.
- I. Where two-coat finish is specified, prime coat shall be tinted to approximate finish color
- J. Where portion of finish on drywall partition is damaged or unacceptable, refinish entire surface of partition.
- K. Seal tops and bottoms of interior doors with prime coat only; side edges same as faces,
- L. Back prime finish carpentry and millwork with material specified for prime coat, without runs

- on face. Finish cut edges prior to installation.
- M. Paint inside of ductwork flat black for entire area visible through ceiling and wall openings. Paint underside of ductwork and other above-ceiling items flat black for entire area visible through ceiling openings.
- N. through ceiling openings.
- O. Paint exposed piping and ductwork in painted spaces same as adjacent wall surfaces.
- P. Paint exposed grilles and registers in public spaces to match adjacent wall or ceiling surfaces,
- Q. Paint walls, exposed structure, handrails and exposed ductwork and piping in stairwells
- R. Remove and protect hardware, accessories, device plates, lighting fixtures, factory-finished work and similar items or provide in-place protection. Upon completion of each space, replace removed items.

### 3.4 INTERIOR PAINTING SCHEDULE:

- A. Surfaces not requiring painting:
  - 1. Prefinished surfaces and items, except where specifically indicated otherwise.
  - 2. Concealed ductwork, conduit and piping.
- B. Interior surfaces; number of coats specified are minimum:
  - 1. Gypsum wallboard, latex eggshell:
    - a. First coat: No. 253 Super Spec Acrylic Latex Primer Sealer.
    - b. Second coat: No. 274 Super Spec Acrylic Latex Eggshell Enamel.
    - c. Third coat: No. 274 Super Spec Acrylic Latex Eggshell Enamel.
  - 2. Ferrous and galvanized metals and aluminum, acrylic semi-gloss:
    - a. First coat: No. M07 IMC Universal Metal Primer.
    - b. Second coat: No. 276 Super Spec Acrylic Latex Semi-Gloss Enamel.
    - c. Third coat: No. 276 Super Spec Acrylic Latex Semi-Gloss Enamel.
  - 3. Concrete Masonry Units, lusterless (Flat) Emulsion Finish: Two finish coats over a properly filled surface. (at opening infills and disturbed areas)
    - a. Block Filler: S-W, Heavy Duty Block filler, B42W46.
    - b. First and Second Coats: S-W, ProMar 200 Interior Flat Latex, B30W200 Series.
  - 4. Concrete and Masonry (other than concrete masonry units), Lusterless (Flat) Latex Finish: coats over an alkali-resistant masonry primer. (at disturbed concrete floor/ceiling system at lower level)
    - a. Primer: Alkali resistant acrylic masonry primer, S-W, Preprite Masonry Primer, B28W300.
    - b. First and Second Coats: Interior, flat, latex-based paint, S-W, ProMar 200 Interior Flat Latex, B30W200 Series.

### 3.5 EXTERIOR PAINT SCHEDULE

- A. General: Provide the following paint systems for the various substrates indicated.
- B. Full-Gloss Acrylic Enamel: Two finish coats over an acrylic rust-inhibitive primer.
  - 1. Primer: Acrylic galvanized primer, S-W, DTM Acrylic Primer / Finish, B66W1.
  - 2. First and Second Coats: Gloss acrylic enamel, S-W, DTM Acrylic Gloss Enamel, B66 Series.

END OF SECTION 09 91 00

## SECTION 10 15 50 - TOILET COMPARTMENTS

### PART 1 GENERAL

#### 1.1 SECTION INCLUDES

- A. Solid polymer partitions as follows:

Toilet Enclosures: Overhead braced, Floor anchored.

Shower Partitions: Overhead braced, Floor anchored; secondary overhead brace for shower rod mount

#### 1.2 RELATED SECTIONS

Product Data: For each type of product indicated.

Shop Drawings: Include plans, elevations, sections, details, and attachments to other work.

Samples: For each exposed finish.

#### 1.3 REFERENCES

- A. ASTM International:
1. ASTM E 84 - Standard Test Method for Surface Burning Characteristics of Building Materials.
  2. ASTM D 1735 - Standard Practice for Testing Water Resistance of Coatings Using Water Fog Apparatus
  3. ASTM D 2247 - Standard Practice for Testing Water Resistance of Coatings in 100 percent Relative Humidity

#### 1.4 SUBMITTALS

- A. Submit under provisions of Section 013000.
- B. Manufacturer's data sheets on each product to be used, including:
1. Literature indicating typical panel, pilaster, door, hardware and fastening.
  2. Preparation instructions and recommendations.
  3. Storage and handling requirements and recommendations.
  4. Installation methods.
- C. Shop Drawings:
1. Dimensioned plans indicating layout of toilet compartments.
  2. Dimensioned elevations indicating heights of doors, pilasters, separation partitions, and other components; indicate locations and sizes of openings in compartment separation partitions for toilet and bath accessories to be installed in partitions; indicate floor and ceiling clearances.
  3. Details indicating anchoring components (bolt layouts) and methods for project conditions; indicate components required for installation, but not supplied by toilet compartment manufacturer.
- D. Selection Samples: For each finish product specified, one complete set of color selection guides representing manufacturer's full range of available colors, textures and patterns.

- E. Manufacturer's Certificates: Certify products meet or exceed specified requirements.

## 1.5 DELIVERY, STORAGE, AND HANDLING

- A. Deliver, store and handle materials and products in strict compliance with manufacturer's instructions and recommendations and industry standards.
- B. Store products indoors in manufacturer's or fabricator's original containers and packaging, with labels clearly identifying product name and manufacturer. Protect from damage.
- C. Lay cartons flat, with adequate support to ensure flatness and to prevent damage to pre-finished surfaces.
- D. Do not store where ambient temperature exceeds 120 degrees F (49 degrees C).

## 1.6 PROJECT CONDITIONS

- A. Maintain environmental conditions (temperature, humidity, and ventilation) within limits recommended by manufacturer for optimum results. Do not install products under environmental conditions outside manufacturer's absolute limits.
- B. Do not deliver materials or begin installation until building is enclosed, with complete protection from outside weather, and building temperature maintained at a minimum of 60 degrees F (15.6 degrees C).

## 1.7 WARRANTY

- A. Manufacturers Standard Warranty: Provide warranty for Solid polymer HDPE Material: Against breakage, corrosion, and delamination for 15 years.

## 1.8 COORDINATION

- A. Coordinate Work with placement of support framing and anchors in walls and ceilings.

## PART 2 PRODUCTS

### 2.1 MANUFACTURERS

- A. Acceptable Manufacturers:
  1. ASI Global Partitions, 900 Clary Connector, Eastanollee, Georgia 30538, PH. (706) 827-2700
  2. Scranton Products, 801 East Corey Street, Scranton, PA 18505, PH. (800) 445-5148
  3. Bradley, W142N9101 Fountain Boulevard, Menomonee Falls, WI 53051 (800) 272-3539
- B. Requests for substitutions will be considered in accordance with provisions of Section 002600.

### 2.2 COMPARTMENTS AND SCREENS

- A. Toilet Compartments: Floor anchored/overhead braced solid polymer.
  1. Compartment Depth and Width: As scheduled and indicated on Drawings.
  2. Door Width: 24 inches (610 mm), minimum; at ADA accessible compartments 36 inches (915 mm) minimum.
  3. Height Above Floor: 12 inches (305 mm).
  4. Door Height: 55 inches (1397 mm).

5. Panel Height: 66 inches (1677 mm).
6. Pilaster Height: 82 inches (2083 mm).

### 2.3 SOLID POLYMER TOILET COMPARTMENTS

- A. Doors, Panels, Screens, and Pilasters: Single sheet solid, homogenous HDPE plastic material formed from waterproof, non-absorbent, high-density polyethylene resins; mark-resistant self-lubricating surface; edges finished smooth.
  1. Material: Solid, homogenous HDPE; 1 inch (25 mm) thick.
  2. Rating: Class "B" Fire Rated per ASTM E 84.
  3. Edges: 1/4 inch (6 mm) radius machined edges.
  4. Heat Sink: Aluminum heat sink, to dissipate heat from incendiary devices used by vandals, attached to bottom of doors and panels.
- B. Finish: Pebble-textured homogenous color throughout material. Color as selected from manufacturer's standard colors.
- C. Door Hardware: 8 inch (203 mm) aluminum wrap-around hinge.
  1. Hinges: Hinges shall be 8 inches (203 mm) and fabricated from heavy-duty extruded aluminum (6463-T5 alloy) with a brushed anodized finish with wrap-around flanges, surface mounted and through bolted to doors and pilasters. Hinges operate and are field set with adjustable nylon cams. Cams can be set in 30 degree increments.
  2. Latch: Anodized extruded aluminum, with housing, slide bolt and button.
  3. Strike and Keeper: 6 inch (152 mm) wrap-around flanges fabricated from heavy-duty extruded aluminum (6463-T5 alloy) with a brushed anodized finish.
  4. Coat Hook and Bumper: Non-ferrous, chrome-plated, with black rubber tip for doorstop.
  5. Fastening Hardware: Manufacturer's standard, Type 304 stainless steel, No. 4 satin finish, theft-resistant barrel nuts and machine screws.
  6. Door Pulls: Non-ferrous, chrome-plated. Standard on ADA compartments. Two per ADA door.
- D. Mounting Brackets: Provide optional aluminum continuous brackets with theft resistant barrel nuts and shoulder screws.
- E. Pilaster Shoes: Type 304 Stainless Steel No. 4 satin finish. Easy Stall shoe shall be of a one piece design and integral to the mounting system and formed from 304 stainless steel 3 inch (76 mm) high with a No. 4 satin finish. Pilaster shoes are anchored to the pilaster with No. 10 stainless steel, vandal-resistant screws.
- F. Headrail: Manufacture's standard anodized aluminum rail with anti-grip profile.
- G. Pilaster Anchors: Floor Anchored/Overhead Braced.
  1. Easy Stall shoe system. 1/4 by 2 inch (6 by 51 mm) steel screws attach Easy Stall shoe to floor.
  2. Pilaster to be inserted into shoe and secured after height adjusted. Leveling adjustment to be concealed by pilaster shoe.
  3. Height/leveling adjustment to be made via machine thread bolts inserted into factory installed threaded insert in bottom of pilaster.
- H. Shower Curtains: (WxH): 42 x 72 inches
  1. White non-PVC, hung with aluminum curtain hooks with self-lubricating Delrin slides.

### 3.1 EXAMINATION AND PREPARATION

- A. Inspect and prepare substrates using the methods recommended by the manufacturer for achieving best result for the substrates under project conditions. Clean surfaces thoroughly prior to installation.
- B. Do not proceed with installation until substrates have been prepared using the methods recommended by the manufacturer and deviations from manufacturer's recommended tolerances are corrected. Commencement of installation constitutes acceptance of conditions.
- C. If preparation is the responsibility of another installer, notify Architect in writing of deviations from manufacturer's recommended installation tolerances and conditions.
  - 1. Verify dimensions of areas to receive compartments.
  - 2. Verify locations of built-in framing, anchorage, bracing, and plumbing fixtures.

### 3.2 INSTALLATION

- A. Install in accordance with approved shop drawings and manufacturer's instructions.
- B. Fasten components to adjacent materials and to other components using purpose-designed fastening devices.
- C. Adjust pilaster anchors for substrate variations; conceal anchors with pilaster shoes.
- D. Equip each compartment door with hinges and door latch.
- E. Install door strike keeper on pilasters in alignment with door latch.
- F. Equip each compartment door with one coat hook and bumper.
- G. Installation Tolerances:
  - 1. Maximum variations from plumb or level: 1/8 inch (3 mm).
  - 2. Clearance between wall surface and panels or pilasters: 1-1/2 inch (38 mm) maximum.

### 3.3 ADJUSTING

- A. Adjust and align hardware to uniform clearance at vertical edge of doors.
- B. Adjust adjacent components for consistency of line or plane.

### 3.4 PROTECTION

- A. Protect installed products until completion of project.
- B. Touch-up, repair or replace damaged products before Substantial Completion.
- C. Remove factory protective coverings and clean finish surfaces in accordance with manufacturer's instructions before substantial completion.

END OF SECTION 10 15 50



## **SECTION 102213 - WIRE MESH PARTITIONS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes the following items fabricated from wire mesh:
  - 1. Heavy-duty, interior wire mesh partitions.
  - 2. Heavy-duty interior wire mesh door
  - 3. Related accessories

#### **1.3 DEFINITIONS**

- A. Terms below shall be as defined in ASTM E 2016:
  - 1. Lock Crimp: Deep crimps at points of intersection that lock wires securely in place.

#### **1.4 PERFORMANCE REQUIREMENTS**

- A. Structural Performance of Wire Mesh Railing Insert Panels: Comply with requirements of ASTM E 985 for structural performance, based on testing performed according to ASTM E 935.
- B. Structural Performance of Wire Mesh Railing Insert Panels: Capable of withstanding a horizontally applied normal load of 50 lbf on an area not to exceed 1 sq. ft. at any point without exceeding allowable design working stresses of materials for railings, anchors, and connections.
- C. Seismic Performance: Provide wire mesh partitions capable of withstanding the effects of earthquake motions determined according to ASCE 7, "Minimum Design Loads for Buildings and Other Structures": Section 9, "Earthquake Loads."
- D. Thermal Movements: Provide wire mesh items that allow for thermal movements resulting from the following maximum change (range) in ambient and surface temperatures by preventing buckling, opening of joints, overstressing of components, failure of connections, and other detrimental effects. Base engineering calculation on surface temperatures of materials due to both solar heat gain and nighttime-sky heat loss.
  - 1. Temperature Change : 120 deg F, ambient; 180 deg F, material surfaces.

## **1.5 SUBMITTALS**

- A. Product Data: Include construction details, material descriptions, dimensions of individual components and profiles, and finishes for wire mesh items.
- B. Shop Drawings: Include plans, elevations, sections, details, and attachments to other work.
- C. Samples for Initial Selection: For units with factory-applied color finishes.
- D. Samples for Verification: 12-by-12-inch panel constructed of specified frame members and wire mesh. Show method of finishing members at intersections.
- E. Qualification Data: For Installer
- F. Maintenance Data: For wire mesh partition door hardware to include in maintenance manuals.

## **1.6 QUALITY ASSURANCE**

- A. Installer Qualifications: Firm experienced in the installation of systems similar in complexity to those required for the project, plus the following:
  - 1. Acceptable to or licensed by manufacturer.
  - 2. Not less than 3 years experience with system.
  - 3. Successfully completed not less than 5 comparable scale projects using this system.
- B. Source Limitations: Obtain wire mesh items through one source from a single manufacturer.
- C. Welding: Qualify procedures and personnel according to the following:
  - 1. AWS D1.1, "Structural Welding Code--Steel."

## **1.7 DELIVERY, STORAGE, AND HANDLING**

- A. Deliver wire mesh items with cardboard protectors on perimeters of panels and doors and with posts wrapped to provide protection during transit and Project-site storage. Do not use nonvented plastic.
- B. Inventory wire mesh partition door hardware on receipt and provide secure lockup for wire mesh partition door hardware delivered to Project site.
  - 1. Tag each item or package separately with identification and include basic installation instructions with each item or package.
  - 2. Deliver keys to Owner by registered mail or overnight package service.

## **1.8 PROJECT CONDITIONS**

- A. Field Measurements: Verify actual locations of construction contiguous with wire mesh items by field measurements before fabrication and indicate measurements on Shop Drawings.

## **1.9 COORDINATION**

- A. Coordinate installation of anchorages for wire mesh items supported or anchored to permanent construction. Furnish setting drawings, templates, and directions for installing anchorages, including sleeves, concrete inserts, anchor bolts, and items with integral anchors, that are to be embedded in concrete or masonry. Deliver such items to Project site in time for installation.

## **PART 2 - PRODUCTS**

### **2.1 MANUFACTURERS**

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Acorn Wire & Iron Works, Inc.
  - 2. California Wire Products Corporation.
  - 3. G-S Company (The).
  - 4. Indiana Wire Products, Inc.
  - 5. Jesco Industries, Inc.
  - 6. King Wire Partitions, Inc.
  - 7. Miller Wire Works, Inc.
  - 8. Newark Wire Works Inc.
  - 9. SpaceGuard Products.
  - 10. Standard Wire & Steel Works.
  - 11. Wire Crafters, Inc.

### **2.2 MATERIALS**

- A. Steel Wire: ASTM A 510.
- B. Steel Plates, Channels, Angles, and Bars: ASTM A 36/A 36M.
- C. Cold-Rolled Steel Sheet: ASTM A 1008/A 1008M, Commercial Steel (CS), Type B.
- D. Steel Pipe: ASTM A 53/A 53M, Schedule 40, unless another weight is indicated or required by structural loads.
- E. Square Steel Tubing: Cold-formed structural-steel tubing, ASTM A 500.
- F. Metallic-Coated Steel Sheet: ASTM A 653, Commercial Steel (CS), Type B; with G60 zinc (galvanized) or A60 zinc-iron-alloy (galvannealed) coating designation.
- G. Panel-to-Panel Fasteners: Manufacturer's standard steel bolts.

- H. Postinstalled Expansion Anchors in Concrete: With capability to sustain, without failure, load imposed within factors of safety indicated, as determined by testing per ASTM E 488, conducted by a qualified independent testing agency.
  - 1. Corrosion Protection: Stainless-steel components complying with ASTM F 593 and ASTM F 594, Alloy Group 1 or 2 for bolts and nuts; ASTM A 666 or ASTM A 276, Type 304 or 316, for anchors.
  - 2. For Postinstalled Anchors in Concrete: Capability to sustain, without failure, a load equal to four times the loads imposed.
- I. Seismic Bracing: Angles with legs not less than 1-1/4 inch wide, formed from 0.04-inch-thick, metallic-coated steel sheet; with bolted connections and 1/4-inch-diameter bolts.

### **2.3 PAINT**

- A. Shop Primer for Ferrous Metal: Fast-curing, lead- and chromate-free, universal modified-alkyd primer complying with performance requirements in FS TT-P-664; selected for good resistance to normal atmospheric corrosion, compatibility with finish paint systems indicated, and capability to provide a sound foundation for field-applied topcoats despite prolonged exposure.
- B. Shop Primer for Galvanized Steel: Zinc-dust, zinc-oxide primer formulated for priming zinc-coated steel and for compatibility with finish paint systems indicated, and complying with SSPC-Paint 5.

### **2.4 HEAVY-DUTY WIRE MESH PARTITIONS**

- A. Mesh: 0.135-inch-diameter, intermediate-crimp steel wire woven into 1 1/2-inch diamond mesh.
- B. Vertical and Horizontal Panel Framing: 1-1/2-by-3/4-by-0.0966-inch cold-rolled, C-shaped steel channels; with 3/8-inch-diameter bolt holes spaced not more than 18 inches o.c. along center of framing.
- C. Horizontal Panel Stiffeners: 1-1/2-by-3/4-by-1/8-inch cold-rolled steel channels with wire woven through, or two 1-by-1/2-by-1/8-inch cold-rolled steel channels bolted or riveted toe to toe through mesh.
- D. Ceiling Panels: Fabricated from same mesh and framing bars as panels above.
- E. Perimeter Angle: 1 1/4 inch by 1 1/4 inch by 1/8 inch hot rolled angle; punched for bolting to top of wire mesh panels and to sides of wire mesh ceiling.
- F. Wall Support: 1 1/2 inch by 1 1/2 inch by 14 gauge galvanized angle punched for securing to existing walls and supporting wire ceiling panels.
- G. Top Capping Bars: 3-inch-by-4.1-lb hot-rolled steel channels.
- H. Posts for 90-Degree Corners: 2-by-2-by-1/4-inch steel angles with 3/8-inch-diameter bolt holes aligning with bolt holes in vertical framing; with floor anchor clips.

- I. Posts for Other-Than-90-Degree Corners: Manufacturer's standard steel 2-inch- OD pipe or tubing with 3/8-inch- diameter bolt holes aligning with bolt holes in vertical framing.
- J. Line Posts: 3-inch-by-4.1-lb or 3-1/2-by-1-1/4-by-0.1265-inch steel channels; with 5-by-18-by-1/4-inch steel base plates punched for attachment to floor.
- K. Three-Way Intersection Posts: Manufacturers standard as required by design.
- L. Floor Shoes: Steel, cast iron, 2 inches high; sized to suit vertical framing, drilled for attachment to floor, and with set screws for leveling adjustment.
- M. Swinging Doors: Fabricated from same mesh as partitions, with framing fabricated from 1-1/2-by-3/4-by-1/8-inch steel channels or C-channels, banded with 1-1/2-by-1/8-inch flat steel bar cover plates on 3 sides, and with 1/8-inch- thick angle strike bar and cover on strike jamb.
  - 1. Hinges: Full-surface type, 3-1/2-by-3-1/2-inch steel, 1-1/2 pairs per door; bolted, riveted, or welded to door and jamb framing.
  - 2. Cylinder Lock: Mortise type with manufacturer's standard cylinder operated by key outside and recessed knob inside.
- N. Slide Doors: Constructed of the same materials as panels, hung by 4 wheel trolleys rolling in an enclosed track. Complete with all necessary mounting and locking hardware to install and operate.
  - 1. Jamb: Two 1 inch by 1 inch – 16 gauge .0598 inch structural tubing with slotted holes for securing to adjacent panels.
  - 2. Header Bar: One 1 inch by 1 inch by 16 gauge .0598 inch structural tube with an angle clip welded to each for securing to top of jambs.
  - 3. Hardware: Three track holder assemblies for supporting enclosed track; Two or 4 – wheel trolleys rolling in the enclosed track; bottom door guide, and heavy 30 inches lock receiver.
  - 4. Cylinder Lock: Mortise type with keyed different cylinder operated by key outside and recessed knob inside.
- O. Accessories:
  - 1. Sheet Metal Base: 0.0598-inch- thick, cold-rolled steel sheet.
  - 2. Adjustable Filler Panels: 0.0598-inch- thick, cold-rolled steel sheet; capable of filling openings from 2 to 12 inches.
  - 3. Wall Clips: Manufacturer's standard, cold-rolled steel sheet; allowing up to 1 inch of adjustment.
- P. Finishes for Interior Locations: Baked-enamel finish or Powder-coated finish.
  - 1. Color: As selected by Architect from manufacturer's full range.

## 2.5 FABRICATION

- A. General: Fabricate wire mesh items from components of sizes not less than those indicated. Use larger-size components as recommended by wire mesh item manufacturer. Provide bolts, hardware, and accessories as required for complete installation.
  - 1. Fabricate wire mesh items to be readily disassembled.
- B. Heavy-Duty Wire Mesh Partitions: Fabricate wire mesh partitions with cutouts for pipes, ducts, beams, and other items indicated. Finish edges of cutouts to provide a neat, protective edge.
  - 1. Mesh: Securely clinch mesh to framing.
  - 2. Framing: Fabricate framing with mortise and tenon corner construction.
    - a. Provide horizontal stiffeners as indicated or, if not indicated, as required by panel height and as recommended by wire mesh partition manufacturer. Weld horizontal stiffeners to vertical framing.
    - b. Fabricate [three-] [and] [four-]way intersections using [intersection posts] [manufacturer's standard connecting clips and fasteners].
    - c. Fabricate partition and door framing with slotted holes for connecting adjacent panels.
  - 3. Fabricate wire mesh partitions with 2 1/2 inches of clear space between finished floor and bottom horizontal framing.
  - 4. Doors: Align bottom of door with bottom of adjacent panels.
    - a. For doors that do not extend full height of partition, provide transom over door, fabricated from same mesh and framing as partition panels.
  - 5. Hardware Preparation: Mortise, reinforce, drill, and tap doors and framing as required to install hardware.

## 2.6 FINISHES

- A. General: Comply with NAAMM's "Metal Finishes Manual for Architectural and Metal Products" for recommendations for applying and designating finishes.
  - 1. Finish wire mesh items after assembly.
  - 2. Appearance of Finished Work: Variations in appearance of abutting or adjacent pieces are acceptable if they are within one-half of the range of approved Samples. Noticeable variations in the same piece are not acceptable. Variations in appearance of other components are acceptable if they are within the range of approved Samples and are assembled or installed to minimize contrast.
- B. Preparation for Shop Priming Nongalvanized Surfaces: Prepare nongalvanized surfaces to comply with minimum requirements indicated below for SSPC surface-preparation specifications and environmental exposure conditions of installed wire mesh items:
  - 1. Interiors (SSPC Zone 1A): SSPC-SP 3, "Power Tool Cleaning."

- C. Shop Priming: Apply shop primer to uncoated surfaces of wire mesh items, unless otherwise indicated. Comply with SSPC-PA 1, "Paint Application Specification No. 1," for shop painting.
  - 1. Do not apply primer to galvanized surfaces.
- D. Baked-Enamel Finish: Immediately after cleaning and pretreating, apply manufacturer's standard one-coat, baked-enamel finish. Comply with paint manufacturer's written instructions for applying and baking to achieve a minimum dry film thickness of 1 mil.
- E. Powder-Coated Finish: Apply manufacturer's standard baked finish, complying with manufacturer's written instructions for surface preparation including pretreatment, application, baking, and minimum dry film thickness.

## **PART 3 - EXECUTION**

### **3.1 EXAMINATION**

- A. Examine areas, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of work.
- B. Examine floors for suitable conditions where wire mesh items will be installed.
- C. Examine walls and ceilings to which wire mesh items will be attached for properly located blocking, grounds, and other solid backing for attachment of support fasteners.
- D. Proceed with installation only after unsatisfactory conditions have been corrected.

### **3.2 ERECTION**

- A. Wire Mesh Partitions:
  - 1. Anchor wire mesh partitions to floor with 3/8-inch- diameter, postinstalled expansion anchors at 12 inches o.c. through floor shoes located at each post and corner. Adjust wire mesh partition posts in floor shoes to achieve level and plumb installation.
  - 2. Secure top capping bars to top framing channels with 1/4-inch- diameter "U" bolts spaced not more than 28 inches o.c.
  - 3. Provide line posts at locations indicated or, if not indicated, as follows:
    - a. For partitions that are more than 12 feet high, located between each panel.
  - 4. Provide seismic supports and bracing as indicated or, if not indicated, as recommended by manufacturer and as required for stability, extending and fastening members to supporting structure.
  - 5. Install doors complete with door hardware.
  - 6. Bolt accessories to wire mesh partition framing.

### **3.3 ADJUSTING AND CLEANING**

- A. Adjust doors to operate easily without binding.

- B. Check and readjust operating hardware items just before final inspection. Leave work in complete and proper operating condition. Remove and replace defective work including doors and framing that are warped, bowed, or otherwise unacceptable.
- C. Touchup Painting: Immediately after erection, clean field welds, bolted connections, and abraded areas of shop paint; paint exposed areas with same material as used for shop painting to comply with SSPC-PA 1 for touching up shop-painted surfaces.
- D. Galvanized Surfaces: Clean field welds, bolted connections, and abraded areas; repair galvanizing to comply with ASTM A 780.

**END OF SECTION 102213**



## SECTION 102800 - TOILET ACCESSORIES

### PART 1 GENERAL

#### 1.1 SECTION INCLUDES

- A. Commercial toilet accessories.
- B. Accessories for toilet rooms.
- C. Accessories for shower areas.

#### 1.2 RELATED REQUIREMENTS

#### 1.3 REFERENCE STANDARDS

- A. ASTM C1036 - Standard Specification for Flat Glass; 2011.
- B. ASTM C1503 - Standard Specification for Silvered Flat Glass Mirror; 2008 (Reapproved 2013).

#### 1.4 ADMINISTRATIVE REQUIREMENTS

- A. Coordinate the work with the placement of internal wall reinforcement to receive anchor attachments.

#### 1.5 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Submit data on accessories describing size, finish, details of function, and attachment methods.
- C. Manufacturer's Installation Instructions: Indicate special procedures and conditions requiring special attention.

### PART 2 PRODUCTS

#### 2.1 MANUFACTURERS

- A. Commercial Toilet, Shower, and Bath Accessories:
  - 1. Bobrick
  - 2. Georgia Pacific
  - 3. Bradley Corporation
- B. All items of each type to be made by the same manufacturer.

#### 2.2 MATERIALS

- A. Accessories - General: Shop assembled, free of dents and scratches and packaged complete with anchors and fittings, steel anchor plates, adapters, and anchor components for installation.
- B. Mirror Glass: Annealed float glass, ASTM C1036 Type I, Class 1, Quality Q2, with silvering, protective and physical characteristics complying with ASTM C1503.
- C. Adhesive: Two component epoxy type, waterproof.

D. Fasteners, Screws, and Bolts: Hot dip galvanized; tamper-proof; security type.

## 2.3 FINISHES

A. Stainless Steel: Satin finish, unless otherwise noted.

## 2.4 COMMERCIAL TOILET ACCESSORIES

A. Toilet Paper Dispenser: Double roll, surface mounted bracket type, stainless steel.

1. Shelf:

- a. Concealed surface mounted, double roll, toilet tissue dispenser of stainless steel. Unit holds and dispenses two standard 5-1/4 inch diameter rolls of toilet tissue. Spindles are free-spinning for non-controlled delivery, chrome-plated plastic equipped with heavy-duty internal springs. Approximate size: 12 1/2" wide by 2 inches high.

Basis of Design - Bobrick B-686

B. Welded-Frame Mirror

1. 18" W x 30" H one-piece mirror, concealed fasteners, roll-formed 3/4"x 3/4" angle-frame. Type 304 stainless steel angle with satin finish. Welded corners, ground and polished smooth. Beveled frame edge at mirror. No.1 1/4" thick glass mirror with galvanized steel backing; 15-year warranty

Basis of Design – Bobrick B-290 1830

C. Stainless Framed Mirror Shelf Kit

1. Shelf:

- a. Surface mounted shelf of 1.27 mm 18 gauge stainless steel with all exposed surfaces in satin finish. Shelf has minimum depth of 5 inches. Center bracket and end brackets of stainless steel, welded to shelf. Shelf length 24 inches.

Basis of Design – Bobrick B-298 x24

D. Sanitary Napkin Dispenser:

1. Surface mounted sanitary napkin receptacle:

- a. Stainless steel with satin finish and all welded construction. Unit has piano hinge attached at the top and an integral finger depression for opening. For use with disposable paper liners, available separately. Unit may be attached to wall or toilet partition. Approximate size: 7 inches wide by 4 inches deep by 10 inches high.

Basis of Design – Bobrick B-270

E. Folding Shower Seat:

1. Surface mounted sanitary napkin receptacle:

- a. Description: Folding shower seat shall have a frame constructed of type-304, satin-finish stainless steel that consists of 16-gauge, 1-1/4" square tubing and 18-gauge, 1" diameter seamless tubing. Seat shall be one-piece, One-piece, 5/16" (8mm) thick, solidly fused plastic laminate with matte-finish melamine surfaces, ivory-colored face sheets, and black phenolic-resin core that are integrally bonded; secured to frame with stainless steel carriage bolts and acorn nuts.

Shower seat shall be equipped with two 3" diameter mounting flanges constructed of type-304, 3/16" thick, satin-finish stainless steel; a guide bracket constructed of type-304, 16-gauge, satin-finish stainless steel; and a spring constructed of type-301, 24-gauge stainless steel that is spot-welded to a baseplate of type-304, heavy gauge stainless steel. Seat shall remain in upright position when not in use.

Basis of Design – Bobrick B-5191

- E. Under-lavatory Guard:
  - 1. Insulating Piping Coverings: White, antimicrobial, molded-vinyl covering for supply and drain piping assemblies intended for use at accessible lavatories to prevent direct contact with and burns from piping. Provide components as required for applications indicated with flip tops at valves that allow service access without removing coverings.
  
- F. Grab Bar:
  - 1. 18-8, Type 304, 18 ga. Stainless steel tubing with satin-finish, peened slip resistant surface. 1 1/4" outside diameter x length noted on plans. 18-8, type 304, 11 ga. Thick stainless steel plate with holes for attachment to wall/partition. 18-8 type 304, 22 ga. Stainless steel, satin finish snap flange covers. Provide stainless steel screws as necessary for attachment. Basis of Design: Bobrick B-5806.99 series.
  
- G. Shower Curtain Rod:
  - 1. Refer to specification section 101550 Toilet Compartments for shower curtain rod and curtain.

## PART 3 EXECUTION

### 3.1 EXAMINATION

- A. Verify existing conditions before starting work.
- B. Verify exact location of accessories for installation.
- C. Verify that field measurements are as indicated on drawings.

### 3.2 PREPARATION

- A. Deliver inserts and rough-in frames to site for timely installation.
- B. Provide templates and rough-in measurements as required.

### 3.3 INSTALLATION

- A. Install accessories in accordance with manufacturers' instructions in locations indicated on the drawings.
- B. Install plumb and level, securely and rigidly anchored to substrate.
- C. Mounting Heights: As required by accessibility regulations, unless otherwise indicated.

### 3.4 PROTECTION

- A. Protect installed accessories from damage due to subsequent construction operations.

END OF SECTION 10 28 00

## SECTION 104310 - SIGNS

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. Section includes:
  - 1. Room signage at each room.

#### 1.2 SECTION REQUIREMENTS

- A. Submittals: Product Data, Shop Drawings, and Samples.
  - 1. Product Data
  - 2. Standard Color Samples for selection
- B. Regulatory Requirements: Comply with applicable provisions in the U.S. Architectural & Transportation Barriers Compliance Board's ADA-ABA Accessibility Guidelines and ICC/ANSI A117.1.

### PART 2 - PRODUCTS

#### 2.1 MATERIALS

- A. Plastic Laminate: High-pressure laminate engraving stock with face and core in contrasting colors.

#### 2.2 ROOM SIGNAGE

- A. Provide signs that include tactile letters, symbols and Braille for interior rooms or spaces where the sign is not likely to change over time. Tactile text descriptions are required for pictograms that are provided to identify a permanent room. Examples include interior signs that label restrooms, stairs, room numbers or letters, and room names. These permanent room signs can include paper inserts for updatable information. Obtain signage from a single manufacturer with edges and corners of finished letter forms and graphics true and clean.
  - 1. Tactile characters shall be raised the required 1/32" inches from sign face. Glue-on letters or etched backgrounds are not acceptable.
  - 2. All text shall be accompanied by Grade 2 braille. Braille shall be separated ½" from the corresponding raised characters or symbols. Grade 2 braille translation to be provided by signage manufacturer.
  - 3. All letters, numbers and/or symbols shall contrast with their background, either light characters on a dark background or dark characters on a light background.
  - 4. Characters and background shall have a non-glare finish.
  - 5. Plaque material shall be Special Purpose SP125 decorative thermosetting high pressure laminate. Material to be 1/8" thick laminate with a melamine resin surface and a phenolic

- resin core which provides resistance to abrasion, stains, alcohol, solvents, boiling water, and heat.
6. The material shall be NEMA rated and have flammability and smoke values that meet the standards for flammability of interior materials.
  7. Background color as selected by architect from manufacturer's actual color samples.
  8. Letterform shall be Gill Sans upper case letters and numbers
  9. Size of letters and numbers shall be as follows:
    - a. Room numbers shall be 1 ".
    - b. Lettering for room ID signs shall be 5/8" or as noted.
    - c. Symbol size shall be 4".
    - d. Standard Grade 2 braille shall be 1/2" below copy.
    - e. Corners: 1/2" radius
  10. Copy position: CC (centered/centered) or as indicated on drawings.

B. Provide ADA compliant signage for:

1. Women's Latrine
2. Men's Latrine

### PART 3 - EXECUTION

#### 3.1 INSTALLATION

A. Wall-Mounted Signs:

1. Silicone-Adhesive Mounting: Attach signs to irregular, porous, or vinyl-covered surfaces.
2. Mounting location and height: Signs shall be installed on the wall adjacent to the latch side of the door. Where there is no wall space to the latch side of the door, including at double leaf doors, signs shall be placed on the nearest adjacent wall. Mounting height shall be 60in. above the finish floor to the center line of the sign. Mounting location for such signage shall be so that a person may approach within 3 in of signage without encountering protruding objects or standing within the swing of a door.

B. Install signs level, plumb, and at heights indicated, with sign surfaces free from distortion and other defects in appearance at locations noted on the drawings.

END OF SECTION

## SECTION 122413 - ROLLER WINDOW SHADES

### PART 1 GENERAL

#### 1.1 SECTION INCLUDES

- A. Interior Solar Shading Systems:
  - 1. Manual solar shades.

#### 1.2 RELATED SECTIONS

- A. Section 061000 - Rough Carpentry.
- B. Section 092116 - Gypsum Board Assemblies.
- C. Section 095100 - Acoustical Panel Ceilings.
- D. Section 099100 - Painting.

#### 1.3 REFERENCES

- A. ASTM International (ASTM):
  - 1. ASTM E 21 - Standard Test Method for Elevated Temperature Tension Tests of Metallic Materials.
  - 2. ASTM E 22 - Recommended Practice for Conducting Long Time High Temperature Tension Test of Metallic Materials.
  - 3. ASTM G 21 - Standard Practice for Determining Resistance of Synthetic Polymeric Materials to Fungi.
  - 4. ASTM G 22 - Standard Practice for Determining Resistance of Plastics to Bacteria.
- B. National Fire Protection Association (NFPA):
  - 1. NFPA 70 - National Electrical Code.
  - 2. NFPA 701 - Fire Tests for Flame-Resistant Textiles and Films.
- C. Underwriters Laboratories Inc. (UL).

#### 1.4 SUBMITTALS

- A. Submit under provisions of Section 013300 - Submittals.
- B. Product Data: Submit manufacturer's product data sheets, including installation details, styles, material descriptions, profiles, features, finishes and operating instructions.
  - 1. Preparation instructions and recommendations.
  - 2. Storage and handling requirements and recommendations.
  - 3. Mounting details and Installation methods.
  - 4. Typical wiring diagrams if applicable.
- C. Shop Drawings: Submit manufacturer's shop drawings, including plans, elevations, sections, product details and finishes, installation details, operational clearances, wiring diagrams if applicable, and relationship to adjacent work.
- D. Window Treatment Schedule: Submit a schedule with same room designations indicated on the Drawings; including but not limited to opening sizes and key to typical mounting details.
- E. Maintenance Data: Submit instructions and precautions for cleaning and maintenance, operating hardware and controls as applicable.
- F. Selection Samples:
  - 1. Frame and Component Finishes: Submit 2 sets of samples, representing

- 2. manufacturer's standard range of finishes specified for aluminum.
- 2. Fabric: Submit 2 sets of samples, representing manufacturer's standard range of options for shade cloth.

G. Verification Samples:

- 1. Frame and Component Finishes: Submit 2 samples, representing actual finishes specified for aluminum.
- 2. Fabric: Submit 2 samples, representing actual products specified for shade cloth.

1.5 QUALITY ASSURANCE

- A. Manufacturer's Qualifications: Engaged in manufacturing of products of similar type to that specified, with a minimum of 10 years successful experience.
- B. Installer Qualifications: Minimum 2 years successful experience installing similar products.
- C. Single Source Requirements: To the greatest extent possible, provide products specified in this section from a single manufacturer.

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Delivery: Deliver materials to site protected from damage.
- B. Storage: Store materials in clean, dry area indoors in manufacturer's unopened packaging until ready for installation and in accordance with manufacturer's instructions. Store in a clean, dry area, laid flat to prevent sagging and twisting of packaging.
- C. Handling: Protect materials and finish from damage during handling and installation.

1.7 PROJECT CONDITIONS, COORDINATION AND SEQUENCING

- A. Maintain environmental conditions (temperature, humidity, and ventilation) within limits recommended by manufacturer for optimum results. Do not install products under environmental conditions outside manufacturer's recommended limits.
  - 1. Building shall be enclosed; windows, frames and sills shall be installed and glazed.
  - 2. Wet work shall be complete and dry.
  - 3. Ceilings, window pockets, electrical and mechanical work above window covering shall be complete.
- B. Conference: Convene a pre-installation conference to establish procedures to maintain optimum working conditions and to coordinate this work with related and adjacent work.

1.8 TYPE OF WARRANTY

- A. Manufacturer's Warranty:
  - 1. Provide Limited lifetime warranty

1.9 EXTRA MATERIALS

- A. Attic Stock: Provide two extra blinds of primary size used for Owner's replacement stock.

PART 2 PRODUCTS

2.1 MANUFACTURERS

- A. Acceptable Manufacturers:

1. Basis of Design: SWFcontract, 7549 Graber Rd.; Middleton, WI 53562-1096 ; Toll Free Tel: 800-327-9798; Web:[www.swfcontract.com](http://www.swfcontract.com)
  2. Draper, Inc., 411 South Pearl Street, Spiceland, IN 47385-0425, Toll Free Tel: 800-238-7999; Web:[www.draperinc.com](http://www.draperinc.com)
  3. Levolor Inc., 1400 Lavon Dr. McKinney, TX 75069, Toll Free Tel: 800-826-8021; Web: <https://commercial.levolor.com/>
- B. Requests for substitutions will be considered in accordance with provisions of Section 016000 - Product Requirements.

## 2.2 SHADING SYSTEMS - GENERAL

- A. Shade Configuration: Locate at each new window opening.

## 2.3 MANUALLY OPERATED SOLAR SHADING SYSTEMS

- A. Shading Systems: SWFcontract Manual Solar Shades as manufactured by SWFcontract.
- B. Fabric: Flame retardant, fade and stain resistant, anti-microbial.
1. Compliance: Pass NFPA 701 FR and ASTM G 21 and ASTM G 22.
  2. Seams: Shades with railroaded fabric will have heat-welded seams.
  3. Style: Crosshatch R300
  4. Color Name: White/Eggshell
  5. Color Number: C8209
- C. Components: Fabricate such that shade hangs flat without buckling or distortion.
1. TruePerformance Clutch Systems:
    - a. Clutch System: TruePerformance Clutch System from SWFcontract consisting of fiberglass filled nylon for wear resistance, smooth operation and corrosion resistance. The clutch is comprised Velvetrol internal spring arrangement for a smooth pulling force that locks the shade in any position when operating the control loop. The clutch mechanism is bi-directional and does not require adjustment or lubrication. Clutch to be factory installed in roller tube at manufacturing. Clutch size to be selected by manufacturer based on fabric selection and shade size.
  2. Control Loops: Bead stops attached to the chain protect shade from over rotation.
    - a. Materials: Standard, No. 10 stainless steel bead chain.
  3. Roller Tubes: Extruded-aluminum tubes engineered with a chamfered channel to accept fabric spline and allow fabric to lay across the tube without adding crease lines. The diameter and wall thickness to be determined by manufacturer based on fabric selection and shade size to provide minimal deflection and optimal performance.
  4. Idler Ends: high strength, fiberglass-filled nylon with spring-loaded pin-end technology
  5. Lift Assist Systems: Heavy-duty torsion spring located inside the roller tube. The mechanism reduces the pull force allowing easy lifting of larger shades.
  6. Spline Systems: Consist of PVC spline heat-welded to the shade fabric and inserted into a channel on the roller tube. Tape and other methods of attachment are not acceptable.
  7. Hem Bars: Standard, aluminum extrusion enclosed in a fabric hem pocket with heat-welded seams and ends, to coordinate with shade cloth selection.
- D. Accessories:
1. Closure Plates: Exposed, flush mounted, powder-coated extruded 6065-aluminum



alloy designed to provide access to shades when recessed in ceiling.

- a. Closure Mounts: Without a lip.
- b. Plate Size: 3 inches (76 mm).

## PART 3 EXECUTION

### 3.1 PREPARATION

- A. Inspect mounting surfaces, blocking for shade brackets or pocket assemblies, suspended acoustical or gypsum ceiling for recessed shades and verify field measurements. Prepare substrates using the methods recommended by the manufacturer for achieving the best result for the substrate under the project conditions.
- B. Do not proceed with installation until substrates have been prepared using the methods recommended by the manufacturer and deviations from manufacturer's recommended tolerances are corrected. Commencement of installation constitutes acceptance of conditions.
- C. If preparation is the responsibility of another installer, notify Architect in writing of deviations from manufacturer's recommended installation tolerances and conditions.

### 3.2 INSTALLATION

- A. Install window treatments in accordance with manufacturer's instructions including the following.
  - 1. Install with adequate clearance to permit smooth operation of the shades throughout entire operational range.
  - 2. Adjust and balance window coverings to operate smoothly, easily, safely, and free from binding or malfunction throughout entire operational range.

### 3.3 CLEANING AND PROTECTION

- A. Clean surfaces after installation in accordance with manufacturer's written instructions. Do not use cleaning methods involving heat, bleach, abrasives, or solvents.
- B. Protect installed products until completion of project. Repair damaged or improperly installed before Substantial Completion.

END OF SECTION

## SECTION 220500 - COMMON WORK RESULTS FOR PLUMBING

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes the following:
  - 1. Piping materials and installation instructions common to most piping systems.
  - 2. Transition fittings.
  - 3. Dielectric fittings.
  - 4. Mechanical sleeve seals.
  - 5. Sleeves.
  - 6. Escutcheons.
  - 7. Grout.
  - 8. Plumbing demolition.
  - 9. Equipment installation requirements common to equipment sections.
  - 10. Painting and finishing.

#### 1.3 DEFINITIONS

- A. Finished Spaces: Spaces other than mechanical and electrical equipment rooms, furred spaces, pipe chases, unheated spaces immediately below roof, spaces above ceilings, unexcavated spaces, crawlspace, and tunnels.
- B. Exposed, Interior Installations: Exposed to view indoors. Examples include finished occupied spaces and mechanical equipment rooms.
- C. Exposed, Exterior Installations: Exposed to view outdoors or subject to outdoor ambient temperatures and weather conditions. Examples include rooftop locations.
- D. Concealed, Interior Installations: Concealed from view and protected from physical contact by building occupants. Examples include above ceilings and in chases.
- E. Concealed, Exterior Installations: Concealed from view and protected from weather conditions and physical contact by building occupants but subject to outdoor ambient temperatures. Examples include installations within unheated shelters.
- F. The following are industry abbreviations for plastic materials:
  - 1. CPVC: Chlorinated polyvinyl chloride plastic.
  - 2. PE: Polyethylene plastic.
  - 3. PVC: Polyvinyl chloride plastic.
- G. The following are industry abbreviations for rubber materials:

1. EPDM: Ethylene-propylene-diene terpolymer rubber.
2. NBR: Acrylonitrile-butadiene rubber.

#### 1.4 SUBMITTALS

- A. Product Data: For the following:
  1. Transition fittings.
  2. Dielectric fittings.
  3. Escutcheons.
- B. Welding certificates.

#### 1.5 QUALITY ASSURANCE

- A. Steel Support Welding: Qualify processes and operators according to AWS D1.1, "Structural Welding Code--Steel."
- B. Steel Pipe Welding: Qualify processes and operators according to ASME Boiler and Pressure Vessel Code: Section IX, "Welding and Brazing Qualifications."
  1. Comply with provisions in ASME B31 Series, "Code for Pressure Piping."
  2. Certify that each welder has passed AWS qualification tests for welding processes involved and that certification is current.
- C. Electrical Characteristics for Plumbing Equipment: Equipment of higher electrical characteristics may be furnished provided such proposed equipment is approved in writing and connecting electrical services, circuit breakers, and conduit sizes are appropriately modified. If minimum energy ratings or efficiencies are specified, equipment shall comply with requirements.

#### 1.6 DELIVERY, STORAGE, AND HANDLING

- A. Deliver pipes and tubes with factory-applied end caps. Maintain end caps through shipping, storage, and handling to prevent pipe end damage and to prevent entrance of dirt, debris, and moisture.
- B. Store plastic pipes protected from direct sunlight. Support to prevent sagging and bending.

#### 1.7 COORDINATION

- A. Coordinate layout and installation with all other trades. Refer to section 230500 'Common Work Results for HVAC', paragraphs 1.3 and 1.4 for specific requirements regarding coordination procedures required.
- B. Arrange for pipe spaces, chases, slots, and openings in building structure during progress of construction, to allow for plumbing installations.
- C. Coordinate installation of required supporting devices and set sleeves in poured-in-place concrete and other structural components as they are constructed.

- D. Coordinate requirements for access panels and doors for plumbing items requiring access that are concealed behind finished surfaces. Access panels and doors are specified in Division 08 Section "Access Doors and Frames."

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. In other Part 2 articles where subparagraph titles below introduce lists, the following requirements apply for product selection:
  - 1. Manufacturers: Subject to compliance with requirements, provide products by the manufacturers specified.

### 2.2 PIPE, TUBE, AND FITTINGS

- A. Refer to individual Division 22 piping Sections for pipe, tube, and fitting materials and joining methods.
- B. Pipe Threads: ASME B1.20.1 for factory-threaded pipe and pipe fittings.

### 2.3 JOINING MATERIALS

- A. Refer to individual Division 22 piping Sections for special joining materials not listed below.
- B. Pipe-Flange Gasket Materials: Suitable for chemical and thermal conditions of piping system contents.
  - 1. ASME B16.21, nonmetallic, flat, asbestos-free, 1/8-inch maximum thickness unless thickness or specific material is indicated.
    - a. Full-Face Type: For flat-face, Class 125, cast-iron and cast-bronze flanges.
    - b. Narrow-Face Type: For raised-face, Class 250, cast-iron and steel flanges.
  - 2. AWWA C110, rubber, flat face, 1/8 inch thick, unless otherwise indicated; and full-face or ring type, unless otherwise indicated.
- C. Flange Bolts and Nuts: ASME B18.2.1, carbon steel, unless otherwise indicated.
- D. Plastic, Pipe-Flange Gasket, Bolts, and Nuts: Type and material recommended by piping system manufacturer, unless otherwise indicated.
- E. Solder Filler Metals: ASTM B 32, lead-free alloys. Include water-flushable flux according to ASTM B 813.
- F. Brazing Filler Metals: AWS A5.8, BCuP Series, copper-phosphorus alloys for general-duty brazing, unless otherwise indicated; and AWS A5.8, BAgl, silver alloy for refrigerant piping, unless otherwise indicated.
- G. Welding Filler Metals: Comply with AWS D10.12 for welding materials appropriate for wall thickness and chemical analysis of steel pipe being welded.

H. Solvent Cements for Joining Plastic Piping:

1. CPVC Piping: ASTM F 493.
2. PVC Piping: ASTM D 2564. Include primer according to ASTM F 656.
3. PVC to ABS Piping Transition: ASTM D 3138.

2.4 TRANSITION FITTINGS

A. AWWA Transition Couplings: Same size as, and with pressure rating at least equal to and with ends compatible with, piping to be joined.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Cascade Waterworks Mfg. Co.
  - b. Dresser Industries, Inc.; DMD Div.
  - c. Ford Meter Box Company, Incorporated (The); Pipe Products Div.
  - d. JCM Industries.
  - e. Smith-Blair, Inc.
  - f. Viking Johnson.
  - g. Pre-approved equal.
2. Underground Piping NPS 1-1/2 and Smaller: Manufactured fitting or coupling.
3. Underground Piping NPS 2 and Larger: AWWA C219, metal sleeve-type coupling.
4. Aboveground Pressure Piping: Pipe fitting.

B. Plastic-to-Metal Transition Fittings: CPVC and PVC one-piece fitting with manufacturer's Schedule 80 equivalent dimensions; one end with threaded brass insert, and one solvent-cement-joint end.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Eslon Thermoplastics.
  - b. Spears Manufacturing.
  - c. Genova Products.
  - d. Pre-approved equal.

C. Plastic-to-Metal Transition Unions: MSS SP-107, CPVC and PVC four-part union. Include brass end, solvent-cement-joint end, rubber O-ring, and union nut.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. NIBCO INC.
  - b. NIBCO, Inc.; Chemtrol Div.
  - c. Mueller
  - d. Pre-approved equal.

D. Flexible Transition Couplings for Underground Nonpressure Drainage Piping: ASTM C 1173 with elastomeric sleeve, ends same size as piping to be joined, and corrosion-resistant metal band on each end.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Cascade Waterworks Mfg. Co.
  - b. Fernco, Inc.
  - c. Mission Rubber Company.
  - d. Plastic Oddities, Inc.
  - e. Pre-approved equal.

## 2.5 DIELECTRIC FITTINGS

- A. Description: Combination fitting of copper alloy and ferrous materials with threaded, solder-joint, plain, or weld-neck end connections that match piping system materials.
- B. Insulating Material: Suitable for system fluid, pressure, and temperature.
- C. Dielectric Unions: Factory-fabricated, union assembly, for 250-psig minimum working pressure at 180 deg F.
  1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Capitol Manufacturing Co.
    - b. Central Plastics Company.
    - c. Eclipse, Inc.
    - d. Epcos Sales, Inc.
    - e. Hart Industries, International, Inc.
    - f. Watts Industries, Inc.; Water Products Div.
    - g. Zurn Industries, Inc.; Wilkins Div.
    - h. Pre-approved equal.
- D. Dielectric Flanges: Factory-fabricated, companion-flange assembly, for 150- or 300-psig minimum working pressure as required to suit system pressures.
  1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Capitol Manufacturing Co.
    - b. Central Plastics Company.
    - c. Epcos Sales, Inc.
    - d. Watts Industries, Inc.; Water Products Div.
    - e. Pre-approved equal.
- E. Dielectric-Flange Kits: Companion-flange assembly for field assembly. Include flanges, full-face- or ring-type neoprene or phenolic gasket, phenolic or polyethylene bolt sleeves, phenolic washers, and steel backing washers.
  1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Advance Products & Systems, Inc.
    - b. Calpico, Inc.
    - c. Central Plastics Company.

- d. Pipeline Seal and Insulator, Inc.
  - e. Pre-approved equal.
- 2. Separate companion flanges and steel bolts and nuts shall have 150- or 300-psig minimum working pressure where required to suit system pressures.
- F. Dielectric Couplings: Galvanized-steel coupling with inert and noncorrosive, thermoplastic lining; threaded ends; and 300-psig minimum working pressure at 225 deg F.
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Calpico, Inc.
    - b. Lochinvar Corp.
    - c. Sioux Chief Manufacturing Co., Inc.
    - d. Pre-approved equal.
- G. Dielectric Nipples: Electroplated steel nipple with inert and noncorrosive, thermoplastic lining; plain, threaded, or grooved ends; and 300-psig minimum working pressure at 225 deg F.
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Perfection Corp.
    - b. Precision Plumbing Products, Inc.
    - c. Sioux Chief Manufacturing Co., Inc.
    - d. Victaulic Co. of America.
    - e. Pre-approved equal.

## 2.6 SLEEVES

- A. Galvanized-Steel Sheet: 0.0239-inch minimum thickness; round tube closed with welded longitudinal joint.
- B. Steel Pipe: ASTM A 53, Type E, Grade B, Schedule 40, galvanized, plain ends.
- C. Cast Iron: Cast or fabricated "wall pipe" equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop, unless otherwise indicated.
- D. Stack Sleeve Fittings: Manufactured, cast-iron sleeve with integral clamping flange. Include clamping ring and bolts and nuts for membrane flashing.
  - 1. Underdeck Clamp: Clamping ring with set screws.
- E. Molded PVC: Permanent, with nailing flange for attaching to wooden forms.
- F. PVC Pipe: ASTM D 1785, Schedule 40.
- G. Molded PE: Reusable, PE, tapered-cup shaped, and smooth-outer surface with nailing flange for attaching to wooden forms.

## 2.7 ESCUTCHEONS

- A. Description: Manufactured wall and ceiling escutcheons and floor plates, with an ID to closely fit around pipe, tube, and insulation of insulated piping and an OD that completely covers opening.
- B. One-Piece, Deep-Pattern Type: Deep-drawn, box-shaped brass with polished chrome-plated finish.
- C. One-Piece, Cast-Brass Type: With set screw.
  - 1. Finish: Polished chrome-plated.
- D. Split-Casting, Cast-Brass Type: With concealed hinge and set screw.
  - 1. Finish: Polished chrome-plated.
- E. One-Piece, Stamped-Steel Type: With set screw and chrome-plated finish.
- F. Split-Plate, Stamped-Steel Type: With concealed hinge, set screw, and chrome-plated finish.
- G. One-Piece, Floor-Plate Type: Cast-iron floor plate.
- H. Split-Casting, Floor-Plate Type: Cast brass with concealed hinge and set screw.

## 2.8 GROUT

- A. Description: ASTM C 1107, Grade B, nonshrink and nonmetallic, dry hydraulic-cement grout.
  - 1. Characteristics: Post-hardening, volume-adjusting, nonstaining, noncorrosive, nongaseous, and recommended for interior and exterior applications.
  - 2. Design Mix: 5000-psi, 28-day compressive strength.
  - 3. Packaging: Premixed and factory packaged.

## PART 3 - EXECUTION

### 3.1 PLUMBING DEMOLITION

- A. Refer to Division 01 Section "Cutting and Patching" and Division 02 Section "Selective Structure Demolition" for general demolition requirements and procedures.
- B. Disconnect, demolish, and remove plumbing systems, equipment, and components indicated to be removed.
  - 1. Piping to Be Removed: Remove portion of piping indicated to be removed and cap or plug remaining piping with same or compatible piping material.
  - 2. Piping to Be Abandoned in Place: Drain piping and cap or plug piping with same or compatible piping material.
  - 3. Equipment to Be Removed: Disconnect and cap services and remove equipment.
  - 4. Equipment to Be Removed and Reinstalled: Disconnect and cap services and remove, clean, and store equipment; when appropriate, reinstall, reconnect, and make equipment operational.



5. Equipment to Be Removed and Salvaged: Disconnect and cap services and remove equipment and deliver to Owner.
- C. If pipe, insulation, or equipment to remain is damaged in appearance or is unserviceable, remove damaged or unserviceable portions and replace with new products of equal capacity and quality.

### 3.2 PIPING SYSTEMS - COMMON REQUIREMENTS

- A. Install piping according to the following requirements and Division 22 Sections specifying piping systems.
- B. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems. Indicated locations and arrangements were used to size pipe and calculate friction loss, expansion, pump sizing, and other design considerations. Install piping as indicated unless deviations to layout are approved on Coordination Drawings.
- C. Install piping in concealed locations, unless otherwise indicated and except in equipment rooms and service areas.
- D. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- E. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal.
- F. Install piping to permit valve servicing.
- G. Install piping at indicated slopes.
- H. Install piping free of sags and bends.
- I. Install fittings for changes in direction and branch connections.
- J. Install piping to allow application of insulation.
- K. Select system components with pressure rating equal to or greater than system operating pressure.
- L. Install escutcheons for penetrations of walls, ceilings, and floors according to the following:
  1. New Piping:
    - a. Piping with Fitting or Sleeve Protruding from Wall: One-piece, deep-pattern type.
    - b. Chrome-Plated Piping: One-piece, cast-brass type with polished chrome-plated finish.
    - c. Insulated Piping: One-piece, stamped-steel type with spring clips.
    - d. Bare Piping at Wall and Floor Penetrations in Finished Spaces: One-piece, cast-brass type with polished chrome-plated finish.
    - e. Bare Piping at Wall and Floor Penetrations in Finished Spaces: One-piece, stamped-steel type.
    - f. Bare Piping at Ceiling Penetrations in Finished Spaces: One-piece or split-casting, cast-brass type with polished chrome-plated finish.

- g. Bare Piping in Unfinished Service Spaces: One-piece, cast-brass type with polished chrome-plated finish.
  - h. Bare Piping in Equipment Rooms: One-piece, cast-brass type.
  - i. Bare Piping at Floor Penetrations in Equipment Rooms: One-piece, floor-plate type.
- M. Sleeves are not required for core-drilled holes.
- N. Permanent sleeves are not required for holes formed by removable PE sleeves.
- O. Install sleeves for pipes passing through concrete and masonry walls and concrete floor and roof slabs.
- P. Install sleeves for pipes passing through concrete and masonry walls, gypsum-board partitions, and concrete floor and roof slabs.
- 1. Cut sleeves to length for mounting flush with both surfaces.
    - a. Exception: Extend sleeves installed in floors of mechanical equipment areas or other wet areas 2 inches above finished floor level. Extend cast-iron sleeve fittings below floor slab as required to secure clamping ring if ring is specified.
  - 2. Install sleeves in new walls and slabs as new walls and slabs are constructed.
  - 3. Install sleeves that are large enough to provide 1/4-inch annular clear space between sleeve and pipe or pipe insulation. Use the following sleeve materials:
    - a. Steel Pipe Sleeves: For pipes smaller than NPS 6.
    - b. Stack Sleeve Fittings: For pipes penetrating floors with membrane waterproofing. Secure flashing between clamping flanges. Install section of cast-iron soil pipe to extend sleeve to 2 inches above finished floor level. Refer to Division 07 Section "Sheet Metal Flashing and Trim" for flashing.
      - 1) Seal space outside of sleeve fittings with grout.
  - 4. Except for underground wall penetrations, seal annular space between sleeve and pipe or pipe insulation, using joint sealants appropriate for size, depth, and location of joint. Refer to Division 07 Section "Joint Sealants" for materials and installation.
- Q. Fire-Barrier Penetrations: Maintain indicated fire rating of walls, partitions, ceilings, and floors at pipe penetrations. Seal pipe penetrations with firestop materials. Refer to Division 07 Section "Penetration Firestopping" for materials.
- R. Verify final equipment locations for roughing-in.
- S. Refer to equipment specifications in other Sections of these Specifications for roughing-in requirements.

### 3.3 PIPING JOINT CONSTRUCTION

- A. Join pipe and fittings according to the following requirements and Division 22 Sections specifying piping systems.
- B. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.

- C. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.
- D. Soldered Joints: Apply ASTM B 813, water-flushable flux, unless otherwise indicated, to tube end. Construct joints according to ASTM B 828 or CDA's "Copper Tube Handbook," using lead-free solder alloy complying with ASTM B 32.
- E. Brazed Joints: Construct joints according to AWS's "Brazing Handbook," "Pipe and Tube" Chapter, using copper-phosphorus brazing filler metal complying with AWS A5.8.
- F. Threaded Joints: Thread pipe with tapered pipe threads according to ASME B1.20.1. Cut threads full and clean using sharp dies. Ream threaded pipe ends to remove burrs and restore full ID. Join pipe fittings and valves as follows:
  - 1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is specified.
  - 2. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged. Do not use pipe sections that have cracked or open welds.
- G. Welded Joints: Construct joints according to AWS D10.12, using qualified processes and welding operators according to Part 1 "Quality Assurance" Article.
- H. Flanged Joints: Select appropriate gasket material, size, type, and thickness for service application. Install gasket concentrically positioned. Use suitable lubricants on bolt threads.
- I. Plastic Piping Solvent-Cement Joints: Clean and dry joining surfaces. Join pipe and fittings according to the following:
  - 1. Comply with ASTM F 402 for safe-handling practice of cleaners, primers, and solvent cements.
  - 2. CPVC Piping: Join according to ASTM D 2846/D 2846M Appendix.
  - 3. PVC Pressure Piping: Join schedule number ASTM D 1785, PVC pipe and PVC socket fittings according to ASTM D 2672. Join other-than-schedule-number PVC pipe and socket fittings according to ASTM D 2855.
  - 4. PVC Nonpressure Piping: Join according to ASTM D 2855.
- J. Plastic Pressure Piping Gasketed Joints: Join according to ASTM D 3139.
- K. Plastic Nonpressure Piping Gasketed Joints: Join according to ASTM D 3212.

### 3.4 PIPING CONNECTIONS

- A. Make connections according to the following, unless otherwise indicated:
  - 1. Install unions, in piping NPS 2 and smaller, adjacent to each valve and at final connection to each piece of equipment.
  - 2. Install flanges, in piping NPS 2-1/2 and larger, adjacent to flanged valves and at final connection to each piece of equipment.
  - 3. Dry Piping Systems: Install dielectric unions and flanges to connect piping materials of dissimilar metals.
  - 4. Wet Piping Systems: Install dielectric coupling and nipple fittings to connect piping materials of dissimilar metals.

### 3.5 EQUIPMENT INSTALLATION - COMMON REQUIREMENTS

- A. Install equipment to allow maximum possible headroom unless specific mounting heights are not indicated.
- B. Install equipment level and plumb, parallel and perpendicular to other building systems and components in exposed interior spaces, unless otherwise indicated.
- C. Install plumbing equipment to facilitate service, maintenance, and repair or replacement of components. Connect equipment for ease of disconnecting, with minimum interference to other installations. Extend grease fittings to accessible locations.
- D. Install equipment to allow right of way for piping installed at required slope.

### 3.6 PAINTING

- A. Painting of plumbing systems, equipment, and components is specified in Division 09 Sections "Interior Painting" and "Exterior Painting."
- B. Damage and Touchup: Repair marred and damaged factory-painted finishes with materials and procedures to match original factory finish.

### 3.7 GROUTING

- A. Mix and install grout for plumbing equipment base bearing surfaces, pump and other equipment base plates, and anchors.
- B. Clean surfaces that will come into contact with grout.
- C. Provide forms as required for placement of grout.
- D. Avoid air entrapment during placement of grout.
- E. Place grout, completely filling equipment bases.
- F. Place grout on concrete bases and provide smooth bearing surface for equipment.
- G. Place grout around anchors.
- H. Cure placed grout.

END OF SECTION 220500

## SECTION 220513 - COMMON MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section includes general requirements for single-phase and polyphase, general-purpose, horizontal, small and medium, squirrel-cage induction motors for use on ac power systems up to 600 V and installed at equipment manufacturer's factory or shipped separately by equipment manufacturer for field installation.

#### 1.3 COORDINATION

- A. Coordinate features of motors, installed units, and accessory devices to be compatible with the following:
  - 1. Motor controllers.
  - 2. Torque, speed, and horsepower requirements of the load.
  - 3. Ratings and characteristics of supply circuit and required control sequence.
  - 4. Ambient and environmental conditions of installation location.

### PART 2 - PRODUCTS

#### 2.1 GENERAL MOTOR REQUIREMENTS

- A. Comply with requirements in this Section except when stricter requirements are specified in plumbing equipment schedules or Sections.
- B. Comply with NEMA MG 1 unless otherwise indicated.
- C. Comply with IEEE 841 for severe-duty motors.

#### 2.2 MOTOR CHARACTERISTICS

- A. Duty: Continuous duty at ambient temperature of 40 deg C and at altitude of 3300 feet above sea level.
- B. Capacity and Torque Characteristics: Sufficient to start, accelerate, and operate connected loads at designated speeds, at installed altitude and environment, with indicated operating sequence, and without exceeding nameplate ratings or considering service factor.

## 2.3 POLYPHASE MOTORS

- A. Description: NEMA MG 1, Design B, medium induction motor.
- B. Efficiency: Energy efficient, as defined in NEMA MG 1.
- C. Service Factor: 1.15.
- D. Multispeed Motors: Variable torque.
  - 1. For motors with 2:1 speed ratio, consequent pole, single winding.
  - 2. For motors with other than 2:1 speed ratio, separate winding for each speed.
- E. Multispeed Motors: Separate winding for each speed.
- F. Rotor: Random-wound, squirrel cage.
- G. Bearings: Regreasable, shielded, antifriction ball bearings suitable for radial and thrust loading.
- H. Temperature Rise: Match insulation rating.
- I. Insulation: Class F.
- J. Code Letter Designation:
  - 1. Motors Smaller than 15 HP: Manufacturer's standard starting characteristic.
- K. Enclosure Material: Cast iron for motor frame sizes 324T and larger; rolled steel for motor frame sizes smaller than 324T.

## 2.4 POLYPHASE MOTORS WITH ADDITIONAL REQUIREMENTS

- A. Motors Used with Reduced-Voltage and Multispeed Controllers: Match wiring connection requirements for controller with required motor leads. Provide terminals in motor terminal box, suited to control method.
- B. Motors Used with Variable Frequency Controllers: Ratings, characteristics, and features coordinated with and approved by controller manufacturer.
  - 1. Windings: Copper magnet wire with moisture-resistant insulation varnish, designed and tested to resist transient spikes, high frequencies, and short time rise pulses produced by pulse-width modulated inverters.
  - 2. Energy- and Premium-Efficient Motors: Class B temperature rise; Class F insulation.
  - 3. Inverter-Duty Motors: Class F temperature rise; Class H insulation.
  - 4. Thermal Protection: Comply with NEMA MG 1 requirements for thermally protected motors.
- C. Severe-Duty Motors: Comply with IEEE 841, with 1.15 minimum service factor.

## 2.5 SINGLE-PHASE MOTORS

- A. Motors larger than 1/20 hp shall be one of the following, to suit starting torque and requirements of specific motor application:

1. Permanent-split capacitor.
  2. Split phase.
  3. Capacitor start, inductor run.
  4. Capacitor start, capacitor run.
- B. Multispeed Motors: Variable-torque, permanent-split-capacitor type.
- C. Bearings: Prelubricated, antifriction ball bearings or sleeve bearings suitable for radial and thrust loading.
- D. Motors 1/20 HP and Smaller: Shaded-pole type.
- E. Thermal Protection: Internal protection to automatically open power supply circuit to motor when winding temperature exceeds a safe value calibrated to temperature rating of motor insulation. Thermal-protection device shall automatically reset when motor temperature returns to normal range.

PART 3 - EXECUTION (Not Applicable)

END OF SECTION 220513

## SECTION 220519 - METERS AND GAGES FOR PLUMBING PIPING

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Bimetallic-actuated thermometers.
  - 2. Filled-system thermometers.
  - 3. Liquid-in-glass thermometers.
  - 4. Light-activated thermometers.
  - 5. Thermowells.
  - 6. Dial-type pressure gages.
  - 7. Gage attachments.
  - 8. Test plugs.
  - 9. Test-plug kits.

#### 1.3 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Product Certificates: For each type of meter and gage, from manufacturer.
- C. Operation and Maintenance Data: For meters and gages to include in operation and maintenance manuals.

### PART 2 - PRODUCTS

#### 2.1 BIMETALLIC-ACTUATED THERMOMETERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Terice, H. O. Co.
  - 2. Watts Regulator Co.; a div. of Watts Water Technologies, Inc.
  - 3. Weiss Instruments, Inc.
  - 4. Pre-approved equal.
- B. Standard: ASME B40.200.
- C. Case: Liquid-filled and sealed type(s); stainless steel with 3-inch nominal diameter.



- D. Dial: Nonreflective aluminum with permanently etched scale markings and scales in deg F.
- E. Connector Type(s): Union joint, adjustable angle, with unified-inch screw threads.
- F. Connector Size: 1/2 inch, with ASME B1.1 screw threads.
- G. Stem: 0.25 or 0.375 inch in diameter; stainless steel.
- H. Window: Plain glass or plastic.
- I. Ring: Stainless steel.
- J. Element: Bimetal coil.
- K. Pointer: Dark-colored metal.
- L. Accuracy: Plus or minus 1 percent of scale range.

## 2.2 FILLED-SYSTEM THERMOMETERS

### A. Direct-Mounted, Metal-Case, Vapor-Actuated Thermometers:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Ashcroft Inc.
  - b. Marsh Bellofram.
  - c. Miljoco Corporation.
  - d. Palmer Wahl Instrumentation Group.
  - e. REOTEMP Instrument Corporation.
  - f. Trerice, H. O. Co.
  - g. Weiss Instruments, Inc.
  - h. Pre-approved equal.
2. Standard: ASME B40.200.
3. Case: Sealed type, cast aluminum or drawn steel; 6-inch nominal diameter.
4. Element: Bourdon tube or other type of pressure element.
5. Movement: Mechanical, dampening type, with link to pressure element and connection to pointer.
6. Dial: Nonreflective aluminum with permanently etched scale markings graduated in deg F.
7. Pointer: Dark-colored metal.
8. Window: Glass.
9. Ring: Stainless steel.
10. Connector Type(s): Union joint, adjustable, 180 degrees in vertical plane, 360 degrees in horizontal plane, with locking device; with ASME B1.1 screw threads.
11. Thermal System: Liquid-filled bulb in copper-plated steel, aluminum, or brass stem and of length to suit installation.
  - a. Design for Thermowell Installation: Bare stem.
12. Accuracy: Plus or minus 1 percent of scale range.

B. Direct-Mounted, Plastic-Case, Vapor-Actuated Thermometers:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Ashcroft Inc.
  - b. Miljoco Corporation.
  - c. REOTEMP Instrument Corporation.
  - d. Pre-approved equal.
2. Standard: ASME B40.200.
3. Case: Sealed type, plastic; 4-1/2-inch nominal diameter.
4. Element: Bourdon tube or other type of pressure element.
5. Movement: Mechanical, with link to pressure element and connection to pointer.
6. Dial: Nonreflective aluminum with permanently etched scale markings graduated in deg F.
7. Pointer: Dark-colored metal.
8. Window: Glass.
9. Ring: Metal or plastic.
10. Connector Type(s): Union joint, adjustable, 180 degrees in vertical plane, 360 degrees in horizontal plane, with locking device; with ASME B1.1 screw threads.
11. Thermal System: Liquid-filled bulb in copper-plated steel, aluminum, or brass stem and of length to suit installation.
  - a. Design for Thermowell Installation: Bare stem.
12. Accuracy: Plus or minus 1 percent of scale range.

2.3 THERMOWELLS

A. Thermowells:

1. Standard: ASME B40.200.
2. Description: Pressure-tight, socket-type fitting made for insertion into piping tee fitting.
3. Material for Use with Copper Tubing: CNR or CUNI.
4. Material for Use with Steel Piping: CRES or CSA.
5. Type: Stepped shank unless straight or tapered shank is indicated.
6. External Threads: NPS 1/2, NPS 3/4, or NPS 1, ASME B1.20.1 pipe threads.
7. Internal Threads: 1/2, 3/4, and 1 inch, with ASME B1.1 screw threads.
8. Bore: Diameter required to match thermometer bulb or stem.
9. Insertion Length: Length required to match thermometer bulb or stem.
10. Lagging Extension: Include on thermowells for insulated piping and tubing.
11. Bushings: For converting size of thermowell's internal screw thread to size of thermometer connection.

B. Heat-Transfer Medium: Mixture of graphite and glycerin.

2.4 TEST PLUGS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Flow Design, Inc.
2. Miljoco Corporation.
3. National Meter, Inc.
4. Peterson Equipment Co., Inc.
5. Sisco Manufacturing Company, Inc.
6. Trerice, H. O. Co.
7. Watts Regulator Co.; a div. of Watts Water Technologies, Inc.
8. Weiss Instruments, Inc.
9. Pre-approved equal.

- B. Description: Test-station fitting made for insertion into piping tee fitting.
- C. Body: Brass or stainless steel with core inserts and gasketed and threaded cap. Include extended stem on units to be installed in insulated piping.
- D. Thread Size: NPS 1/4 or NPS 1/2, ASME B1.20.1 pipe thread.
- E. Minimum Pressure and Temperature Rating: 500 psig at 200 deg F.
- F. Core Inserts: Chlorosulfonated polyethylene synthetic and EPDM self-sealing rubber.

## 2.5 TEST-PLUG KITS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
1. Flow Design, Inc.
  2. Miljoco Corporation.
  3. National Meter, Inc.
  4. Peterson Equipment Co., Inc.
  5. Sisco Manufacturing Company, Inc.
  6. Trerice, H. O. Co.
  7. Watts Regulator Co.; a div. of Watts Water Technologies, Inc.
  8. Weiss Instruments, Inc.
  9. Pre-approved equal.
- B. Furnish one test-plug kit containing two thermometers, one pressure gage and adapter, and carrying case. Thermometer sensing elements, pressure gage, and adapter probes shall be of diameter to fit test plugs and of length to project into piping.
- C. Low-Range Thermometer: Small, bimetallic insertion type with 1- to 2-inch-diameter dial and tapered-end sensing element. Dial range shall be at least 25 to 125 deg F.
- D. High-Range Thermometer: Small, bimetallic insertion type with 1- to 2-inch-diameter dial and tapered-end sensing element. Dial range shall be at least 0 to 220 deg F.
- E. Pressure Gage: Small, Bourdon-tube insertion type with 2- to 3-inch-diameter dial and probe. Dial range shall be at least 0 to 200 psig.

## PART 3 - EXECUTION

### 3.1 INSTALLATION

- A. Install thermowells with socket extending a minimum of 2 inches into fluid and one-third of pipe diameter and in vertical position in piping tees.
- B. Install thermowells of sizes required to match thermometer connectors. Include bushings if required to match sizes.
- C. Install thermowells with extension on insulated piping.
- D. Fill thermowells with heat-transfer medium.
- E. Install direct-mounted thermometers in thermowells and adjust vertical and tilted positions.
- F. Install test plugs in piping tees.
- G. Install thermometers in the following locations:
  - 1. Inlet and outlet of each water heater.
  - 2. Inlet and outlet of each domestic hot-water storage tank.
- H. Install pressure gages in the following locations:
  - 1. Suction and discharge of each domestic water pump.

### 3.2 CONNECTIONS

- A. Install meters and gages adjacent to machines and equipment to allow service and maintenance of meters, gages, machines, and equipment.

### 3.3 ADJUSTING

- A. Adjust faces of meters and gages to proper angle for best visibility.

### 3.4 THERMOMETER SCHEDULE

- A. Thermometers at inlet and outlet of each domestic water heater shall be one of the following:
  - 1. Sealed, bimetallic-actuated type.
  - 2. Direct-mounted, metal- or plastic-case, vapor-actuated type.
  - 3. Test plug with EPDM self-sealing rubber inserts.
- B. Thermometers at inlet and outlet of each domestic hot-water storage tank shall be one of the following:
  - 1. Sealed, bimetallic-actuated type.
  - 2. Direct-mounted, metal or plastic-case, vapor-actuated type.
  - 3. Test plug with EPDM self-sealing rubber inserts.

- C. Thermometer stems shall be of length to match thermowell insertion length.

### 3.5 THERMOMETER SCALE-RANGE SCHEDULE

- A. Scale Range for Domestic Cold-Water Piping: 0 to 100 deg F.
- B. Scale Range for Domestic Hot-Water Piping: 30 to 240 deg F.

### 3.6 PRESSURE-GAGE SCHEDULE

- A. Pressure gages at suction and discharge of each domestic water pump shall be one of the following:
  - 1. Sealed, direct-mounted, metal case.
  - 2. Sealed, direct-mounted, plastic case.
  - 3. Test plug with EPDM self-sealing rubber inserts.

### 3.7 PRESSURE-GAGE SCALE-RANGE SCHEDULE

- A. Scale Range for Water Service Piping: 0 to 160 psi.
- B. Scale Range for Domestic Water Piping: 0 to 200 psi.

END OF SECTION 220519

## SECTION 220523 - GENERAL-DUTY VALVES FOR PLUMBING PIPING

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:

- 1. Bronze ball valves.
- 2. Bronze swing check valves.

- B. Related Sections:

- 1. Division 22 plumbing piping Sections for specialty valves applicable to those Sections only.
- 2. Division 22 Section "Identification for Plumbing Piping and Equipment" for valve tags and schedule

#### 1.3 DEFINITIONS

- A. CWP: Cold working pressure.
- B. EPDM: Ethylene propylene copolymer rubber.
- C. NBR: Acrylonitrile-butadiene, Buna-N, or nitrile rubber.
- D. NRS: Nonrising stem.
- E. OS&Y: Outside screw and yoke.
- F. RS: Rising stem.
- G. SWP: Steam working pressure.

#### 1.4 SUBMITTALS

- A. Product Data: For each type of valve indicated.

## 1.5 QUALITY ASSURANCE

- A. Source Limitations for Valves: Obtain each type of valve from single source from single manufacturer.
- B. ASME Compliance:
  - 1. ASME B16.10 and ASME B16.34 for ferrous valve dimensions and design criteria.
  - 2. ASME B31.1 for power piping valves.
  - 3. ASME B31.9 for building services piping valves.
- C. NSF Compliance: NSF 61 for valve materials for potable-water service.

## 1.6 DELIVERY, STORAGE, AND HANDLING

- A. Prepare valves for shipping as follows:
  - 1. Protect internal parts against rust and corrosion.
  - 2. Protect threads, flange faces, grooves, and weld ends.
  - 3. Set ball and plug valves open to minimize exposure of functional surfaces.
  - 4. Block check valves in either closed or open position.
- B. Use the following precautions during storage:
  - 1. Maintain valve end protection.
  - 2. Store valves indoors and maintain at higher than ambient dew point temperature. If outdoor storage is necessary, store valves off the ground in watertight enclosures.
- C. Use sling to handle large valves; rig sling to avoid damage to exposed parts. Do not use handwheels or stems as lifting or rigging points.

## PART 2 - PRODUCTS

### 2.1 GENERAL REQUIREMENTS FOR VALVES

- A. Refer to valve schedule articles for applications of valves.
- B. Valve Pressure and Temperature Ratings: Not less than indicated and as required for system pressures and temperatures.
- C. Valve Sizes: Same as upstream piping unless otherwise indicated.
- D. Valve Actuator Types:
  - 1. Handlever: For quarter-turn valves NPS 6 and smaller except plug valves.
  - 2. Wrench: For plug valves with square heads. Furnish Owner with 1 wrench for every 10 plug valves, for each size square plug-valve head.
- E. Valves in Insulated Piping: With 2-inch stem extensions and the following features:

1. Ball Valves: With extended operating handle of non-thermal-conductive material, and protective sleeve that allows operation of valve without breaking the vapor seal or disturbing insulation.

F. Valve-End Connections:

1. Flanged: With flanges according to ASME B16.1 for iron valves.
2. Grooved: With grooves according to AWWA C606.
3. Solder Joint: With sockets according to ASME B16.18.
4. Threaded: With threads according to ASME B1.20.1.

G. Valve Bypass and Drain Connections: MSS SP-45.

## 2.2 BRONZE BALL VALVES

A. One-Piece, Reduced-Port, Bronze Ball Valves with Bronze Trim:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. American Valve, Inc.
  - b. Conbraco Industries, Inc.; Apollo Valves.
  - c. NIBCO INC.
2. Description:
  - a. Standard: MSS SP-110.
  - b. CWP Rating: 400 psig.
  - c. Body Design: One piece.
  - d. Body Material: Bronze.
  - e. Ends: Threaded.
  - f. Seats: PTFE or TFE.
  - g. Stem: Bronze.
  - h. Ball: Chrome-plated brass.
  - i. Port: Reduced.

## 2.3 BRONZE SWING CHECK VALVES

A. Class 125, Bronze Swing Check Valves with Nonmetallic Disc:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Crane Co.; Crane Valve Group; Crane Valves.
  - b. Crane Co.; Crane Valve Group; Jenkins Valves.
  - c. Crane Co.; Crane Valve Group; Stockham Division.
  - d. Hammond Valve.
  - e. Kitz Corporation.
  - f. Milwaukee Valve Company.
  - g. NIBCO INC.
  - h. Red-White Valve Corporation.
  - i. Watts Regulator Co.; a division of Watts Water Technologies, Inc.



2. Description:
  - a. Standard: MSS SP-80, Type 4.
  - b. CWP Rating: 200 psig.
  - c. Body Design: Horizontal flow.
  - d. Body Material: ASTM B 62, bronze.
  - e. Ends: Threaded.
  - f. Disc: PTFE or TFE.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine valve interior for cleanliness, freedom from foreign matter, and corrosion. Remove special packing materials, such as blocks, used to prevent disc movement during shipping and handling.
- B. Operate valves in positions from fully open to fully closed. Examine guides and seats made accessible by such operations.
- C. Examine threads on valve and mating pipe for form and cleanliness.
- D. Examine mating flange faces for conditions that might cause leakage. Check bolting for proper size, length, and material. Verify that gasket is of proper size, that its material composition is suitable for service, and that it is free from defects and damage.
- E. Do not attempt to repair defective valves; replace with new valves.

### 3.2 VALVE INSTALLATION

- A. Install valves with unions or flanges at each piece of equipment arranged to allow service, maintenance, and equipment removal without system shutdown.
- B. Locate valves for easy access and provide separate support where necessary.
- C. Install valves in horizontal piping with stem at or above center of pipe.
- D. Install valves in position to allow full stem movement.
- E. Install check valves for proper direction of flow and as follows:
  1. Swing Check Valves: In horizontal position with hinge pin level.

### 3.3 ADJUSTING

- A. Adjust or replace valve packing after piping systems have been tested and put into service but before final adjusting and balancing. Replace valves if persistent leaking occurs.

### 3.4 GENERAL REQUIREMENTS FOR VALVE APPLICATIONS

- A. If valve applications are not indicated, use the following:
  - 1. Shutoff Service: Ball valves.
  - 2. Throttling Service: Ball valves.
  - 3. Pump-Discharge Check Valves:
    - a. NPS 2 and Smaller: Bronze swing check valves with nonmetallic disc.
- B. If valves with specified SWP classes or CWP ratings are not available, the same types of valves with higher SWP classes or CWP ratings may be substituted.
- C. Select valves, except wafer types, with the following end connections:
  - 1. For Copper Tubing, NPS 2 and Smaller: Threaded ends except where solder-joint valve-end option is indicated in valve schedules below.
  - 2. For Steel Piping, NPS 2 and Smaller: Threaded ends.
  - 3. For Grooved-End Copper Tubing and Steel Piping: Valve ends may be grooved.

### 3.5 DOMESTIC, HOT- AND COLD-WATER VALVE SCHEDULE

- A. Pipe NPS 2 and Smaller:
  - 1. Bronze and Brass Valves: May be provided with solder-joint ends instead of threaded ends. Solder joint ball valves allowed up to NPS 3.
  - 2. Ball Valves: One piece, reduced port, bronze with bronze trim.  
Bronze Swing Check Valves: Class 125, nonmetallic disc.

END OF SECTION 220523

## SECTION 220529 - HANGERS AND SUPPORTS FOR PLUMBING PIPING AND EQUIPMENT

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes the following hangers and supports for plumbing system piping and equipment:
  - 1. Steel pipe hangers and supports.
  - 2. Trapeze pipe hangers.
  - 3. Metal framing systems.
  - 4. Thermal-hanger shield inserts.
- B. Related Sections include the following:
  - 1. Division 05 Section "Metal Fabrications" for structural-steel shapes and plates for trapeze hangers for pipe and equipment supports.

#### 1.3 DEFINITIONS

- A. MSS: Manufacturers Standardization Society for The Valve and Fittings Industry Inc.
- B. Terminology: As defined in MSS SP-90, "Guidelines on Terminology for Pipe Hangers and Supports."

#### 1.4 PERFORMANCE REQUIREMENTS

- A. Design supports for multiple pipes, including pipe stands, capable of supporting combined weight of supported systems, system contents, and test water.
- B. Design equipment supports capable of supporting combined operating weight of supported equipment and connected systems and components.

#### 1.5 SUBMITTALS

- A. Product Data: For the following:
  - 1. Steel pipe hangers and supports.
  - 2. Fiberglass pipe hangers.
  - 3. Thermal-hanger shield inserts.
  - 4. Powder-actuated fastener systems.
  - 5. Pipe positioning systems.

- B. Shop Drawings: Signed and sealed by a qualified professional engineer. Show fabrication and installation details and include calculations for the following:
  - 1. Trapeze pipe hangers. Include Product Data for components.
  - 2. Metal framing systems. Include Product Data for components.
  - 3. Fiberglass strut systems. Include Product Data for components.
  - 4. Equipment supports.
- C. Welding certificates.

## 1.6 QUALITY ASSURANCE

- A. Welding: Qualify procedures and personnel according to AWS D1.1, "Structural Welding Code—Steel;" AWS D1.4, "Structural Welding Code--Reinforcing Steel;" and ASME Boiler and Pressure Vessel Code: Section IX.
- B. Welding: Qualify procedures and personnel according to the following:
  - 1. AWS D1.1, "Structural Welding Code--Steel."
  - 2. AWS D1.2, "Structural Welding Code--Aluminum."
  - 3. AWS D1.4, "Structural Welding Code--Reinforcing Steel."
  - 4. ASME Boiler and Pressure Vessel Code: Section IX.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. In other Part 2 articles where titles below introduce lists, the following requirements apply to product selection:
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the manufacturers specified.

### 2.2 STEEL PIPE HANGERS AND SUPPORTS

- A. Description: MSS SP-58, Types 1 through 58, factory-fabricated components. Refer to Part 3 "Hanger and Support Applications" Article for where to use specific hanger and support types.
- B. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. AAA Technology & Specialties Co., Inc.
  - 2. Bergen-Power Pipe Supports.
  - 3. B-Line Systems, Inc.; a division of Cooper Industries.
  - 4. Carpenter & Paterson, Inc.
  - 5. Empire Industries, Inc.
  - 6. ERICO/Michigan Hanger Co.
  - 7. Globe Pipe Hanger Products, Inc.
  - 8. Grinnell Corp.
  - 9. GS Metals Corp.

10. National Pipe Hanger Corporation.
11. PHD Manufacturing, Inc.
12. PHS Industries, Inc.
13. Piping Technology & Products, Inc.
14. Tolco Inc.
15. Pre-approved equal.

C. Galvanized, Metallic Coatings: Pregalvanized or hot dipped.

D. Nonmetallic Coatings: Plastic coating, jacket, or liner.

E. Padded Hangers: Hanger with fiberglass or other pipe insulation pad or cushion for support of bearing surface of piping.

### 2.3 TRAPEZE PIPE HANGERS

A. Description: MSS SP-69, Type 59, shop- or field-fabricated pipe-support assembly made from structural-steel shapes with MSS SP-58 hanger rods, nuts, saddles, and U-bolts.

### 2.4 METAL FRAMING SYSTEMS

A. Description: MFMA-3, shop- or field-fabricated pipe-support assembly made of steel channels and other components.

B. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. B-Line Systems, Inc.; a division of Cooper Industries.
2. ERICO/Michigan Hanger Co.; ERISTRUT Div.
3. GS Metals Corp.
4. Power-Strut Div.; Tyco International, Ltd.
5. Thomas & Betts Corporation.
6. Tolco Inc.
7. Unistrut Corp.; Tyco International, Ltd.
8. Pre-approved equal.

C. Coatings: Manufacturer's standard finish unless bare metal surfaces are indicated.

D. Nonmetallic Coatings: Plastic coating, jacket, or liner.

### 2.5 THERMAL-HANGER SHIELD INSERTS

A. Description: 100-psig-minimum, compressive-strength insulation insert encased in sheet metal shield.

B. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Carpenter & Paterson, Inc.
2. ERICO/Michigan Hanger Co.
3. PHS Industries, Inc.

4. Pipe Shields, Inc.
  5. Rilco Manufacturing Company, Inc.
  6. Value Engineered Products, Inc.
  7. Pre-approved equal.
- C. Insulation-Insert Material for Cold Piping: Water-repellent treated, ASTM C 533, Type I calcium silicate or ASTM C 552, Type II cellular glass with vapor barrier.
  - D. Insulation-Insert Material for Hot Piping: Water-repellent treated, ASTM C 533, Type I calcium silicate or ASTM C 552, Type II cellular glass.
  - E. For Trapeze or Clamped Systems: Insert and shield shall cover entire circumference of pipe.
  - F. For Clevis or Band Hangers: Insert and shield shall cover lower 180 degrees of pipe.
  - G. Insert Length: Extend 2 inches beyond sheet metal shield for piping operating below ambient air temperature.

## 2.6 MISCELLANEOUS MATERIALS

- A. Structural Steel: ASTM A 36/A 36M, steel plates, shapes, and bars; black and galvanized.
- B. Grout: ASTM C 1107, factory-mixed and -packaged, dry, hydraulic-cement, nonshrink and nonmetallic grout; suitable for interior and exterior applications.
  1. Properties: Nonstaining, noncorrosive, and nongaseous.
  2. Design Mix: 5000-psi, 28-day compressive strength.

## PART 3 - EXECUTION

### 3.1 HANGER AND SUPPORT APPLICATIONS

- A. Specific hanger and support requirements are specified in Sections specifying piping systems and equipment.
- B. Comply with MSS SP-69 for pipe hanger selections and applications that are not specified in piping system Sections.
- C. Use hangers and supports with galvanized, metallic coatings for piping and equipment that will not have field-applied finish.
- D. Use nonmetallic coatings on attachments for electrolytic protection where attachments are in direct contact with copper tubing.
- E. Use padded hangers for piping that is subject to scratching.
- F. Horizontal-Piping Hangers and Supports: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
  1. Adjustable, Steel Clevis Hangers (MSS Type 1): For suspension of noninsulated or insulated stationary pipes, NPS 1/2 to NPS 30.

2. Yoke-Type Pipe Clamps (MSS Type 2): For suspension of 120 to 450 deg F pipes, NPS 4 to NPS 16, requiring up to 4 inches of insulation.
  3. Carbon- or Alloy-Steel, Double-Bolt Pipe Clamps (MSS Type 3): For suspension of pipes, NPS 3/4 to NPS 24, requiring clamp flexibility and up to 4 inches of insulation.
  4. Steel Pipe Clamps (MSS Type 4): For suspension of cold and hot pipes, NPS 1/2 to NPS 24, if little or no insulation is required.
  5. Pipe Hangers (MSS Type 5): For suspension of pipes, NPS 1/2 to NPS 4, to allow off-center closure for hanger installation before pipe erection.
  6. Adjustable, Swivel Split- or Solid-Ring Hangers (MSS Type 6): For suspension of noninsulated stationary pipes, NPS 3/4 to NPS 8.
  7. Adjustable, Steel Band Hangers (MSS Type 7): For suspension of noninsulated stationary pipes, NPS 1/2 to NPS 8.
  8. Adjustable Band Hangers (MSS Type 9): For suspension of noninsulated stationary pipes, NPS 1/2 to NPS 8.
  9. Adjustable, Swivel-Ring Band Hangers (MSS Type 10): For suspension of noninsulated stationary pipes, NPS 1/2 to NPS 2.
  10. Split Pipe-Ring with or without Turnbuckle-Adjustment Hangers (MSS Type 11): For suspension of noninsulated stationary pipes, NPS 3/8 to NPS 8.
  11. Extension Hinged or 2-Bolt Split Pipe Clamps (MSS Type 12): For suspension of noninsulated stationary pipes, NPS 3/8 to NPS 3.
  12. U-Bolts (MSS Type 24): For support of heavy pipes, NPS 1/2 to NPS 30.
  13. Clips (MSS Type 26): For support of insulated pipes not subject to expansion or contraction.
  14. Adjustable, Pipe Saddle Supports (MSS Type 38): For stanchion-type support for pipes, NPS 2-1/2 to NPS 36, if vertical adjustment is required, with steel pipe base stanchion support and cast-iron floor flange.
  15. Single Pipe Rolls (MSS Type 41): For suspension of pipes, NPS 1 to NPS 30, from 2 rods if longitudinal movement caused by expansion and contraction might occur.
  16. Adjustable Roller Hangers (MSS Type 43): For suspension of pipes, NPS 2-1/2 to NPS 20, from single rod if horizontal movement caused by expansion and contraction might occur.
  17. Complete Pipe Rolls (MSS Type 44): For support of pipes, NPS 2 to NPS 42, if longitudinal movement caused by expansion and contraction might occur but vertical adjustment is not necessary.
  18. Pipe Roll and Plate Units (MSS Type 45): For support of pipes, NPS 2 to NPS 24, if small horizontal movement caused by expansion and contraction might occur and vertical adjustment is not necessary.
  19. Adjustable Pipe Roll and Base Units (MSS Type 46): For support of pipes, NPS 2 to NPS 30, if vertical and lateral adjustment during installation might be required in addition to expansion and contraction.
- G. Vertical-Piping Clamps: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Extension Pipe or Riser Clamps (MSS Type 8): For support of pipe risers, NPS 3/4 to NPS 20.
  2. Carbon- or Alloy-Steel Riser Clamps (MSS Type 42): For support of pipe risers, NPS 3/4 to NPS 20, if longer ends are required for riser clamps.
- H. Hanger-Rod Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Steel Turnbuckles (MSS Type 13): For adjustment up to 6 inches for heavy loads.
  2. Steel Clevises (MSS Type 14): For 120 to 450 deg F piping installations.

3. Swivel Turnbuckles (MSS Type 15): For use with MSS Type 11, split pipe rings.
  4. Malleable-Iron Sockets (MSS Type 16): For attaching hanger rods to various types of building attachments.
  5. Steel Weldless Eye Nuts (MSS Type 17): For 120 to 450 deg F piping installations.
- I. Building Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Top-Beam C-Clamps (MSS Type 19): For use under roof installations with bar-joint construction to attach to top flange of structural shape.
  2. Side-Beam or Channel Clamps (MSS Type 20): For attaching to bottom flange of beams, channels, or angles.
  3. Center-Beam Clamps (MSS Type 21): For attaching to center of bottom flange of beams.
  4. Welded Beam Attachments (MSS Type 22): For attaching to bottom of beams if loads are considerable and rod sizes are large.
  5. C-Clamps (MSS Type 23): For structural shapes.
  6. Top-Beam Clamps (MSS Type 25): For top of beams if hanger rod is required tangent to flange edge.
  7. Side-Beam Clamps (MSS Type 27): For bottom of steel I-beams.
  8. Steel-Beam Clamps with Eye Nuts (MSS Type 28): For attaching to bottom of steel I-beams for heavy loads.
  9. Linked-Steel Clamps with Eye Nuts (MSS Type 29): For attaching to bottom of steel I-beams for heavy loads, with link extensions.
  10. Malleable Beam Clamps with Extension Pieces (MSS Type 30): For attaching to structural steel.
  11. Welded-Steel Brackets: For support of pipes from below, or for suspending from above by using clip and rod. Use one of the following for indicated loads:
    - a. Light (MSS Type 31): 750 lb.
    - b. Medium (MSS Type 32): 1500 lb.
    - c. Heavy (MSS Type 33): 3000 lb.
  12. Side-Beam Brackets (MSS Type 34): For sides of steel or wooden beams.
  13. Plate Lugs (MSS Type 57): For attaching to steel beams if flexibility at beam is required.
  14. Horizontal Travelers (MSS Type 58): For supporting piping systems subject to linear horizontal movement where headroom is limited.
- J. Saddles and Shields: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Steel Pipe-Covering Protection Saddles (MSS Type 39): To fill interior voids with insulation that matches adjoining insulation.
  2. Protection Shields (MSS Type 40): Of length recommended in writing by manufacturer to prevent crushing insulation.
  3. Thermal-Hanger Shield Inserts: For supporting insulated pipe.
- K. Comply with MSS SP-69 for trapeze pipe hanger selections and applications that are not specified in piping system Sections.
- L. Comply with MFMA-102 for metal framing system selections and applications that are not specified in piping system Sections.
- M. Use pipe positioning systems in pipe spaces behind plumbing fixtures to support supply and waste piping for plumbing fixtures.



### 3.2 HANGER AND SUPPORT INSTALLATION

- A. Steel Pipe Hanger Installation: Comply with MSS SP-69 and MSS SP-89. Install hangers, supports, clamps, and attachments as required to properly support piping from building structure.
- B. Trapeze Pipe Hanger Installation: Comply with MSS SP-69 and MSS SP-89. Arrange for grouping of parallel runs of horizontal piping and support together on field-fabricated trapeze pipe hangers.
  - 1. Pipes of Various Sizes: Support together and space trapezes for smallest pipe size or install intermediate supports for smaller diameter pipes as specified above for individual pipe hangers.
  - 2. Field fabricate from ASTM A 36/A 36M, steel shapes selected for loads being supported. Weld steel according to AWS D1.1.
- C. Metal Framing System Installation: Arrange for grouping of parallel runs of piping and support together on field-assembled metal framing systems.
- D. Pipe Positioning System Installation: Install support devices to make rigid supply and waste piping connections to each plumbing fixture. Refer to Division 22 Section "Plumbing Fixtures" for plumbing fixtures.
- E. Install hangers and supports complete with necessary inserts, bolts, rods, nuts, washers, and other accessories.
- F. Equipment Support Installation: Fabricate from welded-structural-steel shapes.
- G. Install hangers and supports to allow controlled thermal movement of piping systems, to permit freedom of movement between pipe anchors, and to facilitate action of expansion joints, expansion loops, expansion bends, and similar units.
- H. Install lateral bracing with pipe hangers and supports to prevent swaying.
- I. Install building attachments within concrete slabs or attach to structural steel. Install additional attachments at concentrated loads, including valves, flanges, and strainers, NPS 2-1/2 and larger and at changes in direction of piping. Install concrete inserts before concrete is placed; fasten inserts to forms and install reinforcing bars through openings at top of inserts.
- J. Load Distribution: Install hangers and supports so piping live and dead loads and stresses from movement will not be transmitted to connected equipment.
- K. Pipe Slopes: Install hangers and supports to provide indicated pipe slopes and so maximum pipe deflections allowed by ASME B31.9 (for building services piping) are not exceeded.
- L. Insulated Piping: Comply with the following:
  - 1. Attach clamps and spacers to piping.
    - a. Piping Operating above Ambient Air Temperature: Clamp may project through insulation.
    - b. Piping Operating below Ambient Air Temperature: Use thermal-hanger shield insert with clamp sized to match OD of insert.

- c. Do not exceed pipe stress limits according to ASME B31.9 for building services piping.
2. Install MSS SP-58, Type 39, protection saddles if insulation without vapor barrier is indicated. Fill interior voids with insulation that matches adjoining insulation.
  - a. Option: Thermal-hanger shield inserts may be used. Include steel weight-distribution plate for pipe NPS 4 and larger if pipe is installed on rollers.
3. Install MSS SP-58, Type 40, protective shields on cold piping with vapor barrier. Shields shall span an arc of 180 degrees.
  - a. Option: Thermal-hanger shield inserts may be used. Include steel weight-distribution plate for pipe NPS 4 and larger if pipe is installed on rollers.
4. Shield Dimensions for Pipe: Not less than the following:
  - a. NPS 1/4 to NPS 3-1/2: 12 inches long and 0.048 inch thick.
  - b. NPS 4: 12 inches long and 0.06 inch thick.
5. Insert Material: Length at least as long as protective shield.
6. Thermal-Hanger Shields: Install with insulation same thickness as piping insulation.

### 3.3 METAL FABRICATIONS

- A. Cut, drill, and fit miscellaneous metal fabrications for trapeze pipe hangers and equipment supports.
- B. Fit exposed connections together to form hairline joints. Field weld connections that cannot be shop welded because of shipping size limitations.
- C. Field Welding: Comply with AWS D1.1 procedures for shielded metal arc welding, appearance and quality of welds, and methods used in correcting welding work, and with the following:
  1. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals.
  2. Obtain fusion without undercut or overlap.
  3. Remove welding flux immediately.
  4. Finish welds at exposed connections so no roughness shows after finishing and contours of welded surfaces match adjacent contours.

### 3.4 ADJUSTING

- A. Hanger Adjustments: Adjust hangers to distribute loads equally on attachments and to achieve indicated slope of pipe.
- B. Trim excess length of continuous-thread hanger and support rods to 1-1/2 inches.

### 3.5 PAINTING

- A. Touch Up: Clean field welds and abraded areas of shop paint. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting. Comply with SSPC-PA 1 requirements for touching up field-painted surfaces.
  - 1. Apply paint by brush or spray to provide minimum dry film thickness of 2.0 mils.
- B. Touch Up: Cleaning and touchup painting of field welds, bolted connections, and abraded areas of shop paint on miscellaneous metal are specified in Division 09 painting Sections.
- C. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A 780.

END OF SECTION 220529

## SECTION 220553 - IDENTIFICATION FOR PLUMBING PIPING AND EQUIPMENT

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Equipment labels.
  - 2. Pipe labels.

#### 1.3 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Samples: For color, letter style, and graphic representation required for each identification material and device.
- C. Equipment Label Schedule: Include a listing of all equipment to be labeled with the proposed content for each label.

#### 1.4 COORDINATION

- A. Coordinate installation of identifying devices with completion of covering and painting of surfaces where devices are to be applied.
- B. Coordinate installation of identifying devices with locations of access panels and doors.
- C. Install identifying devices before installing acoustical ceilings and similar concealment.

### PART 2 - PRODUCTS

#### 2.1 EQUIPMENT LABELS

- A. Metal Labels for Equipment:
  - 1. Material and Thickness: Brass, 0.032-inch; stainless steel, 0.025-inch; aluminum, 0.032-inch; or anodized aluminum, 0.032-inch minimum thickness, and having predrilled or stamped holes for attachment hardware.
  - 2. Minimum Label Size: Length and width vary for required label content, but not less than 2-1/2 by 3/4 inch.

3. Minimum Letter Size: 1/4 inch for name of units if viewing distance is less than 24 inches, 1/2 inch for viewing distances up to 72 inches, and proportionately larger lettering for greater viewing distances. Include secondary lettering two-thirds to three-fourths the size of principal lettering.
4. Fasteners: Stainless-steel rivets or self-tapping screws.
5. Adhesive: Contact-type permanent adhesive, compatible with label and with substrate.

B. Plastic Labels for Equipment:

1. Material and Thickness: Multilayer, multicolor, plastic labels for mechanical engraving, 1/8 inch thick, and having predrilled holes for attachment hardware.
2. Letter Color: White.
3. Background Color: Black.
4. Maximum Temperature: Able to withstand temperatures up to 160 deg F.
5. Minimum Label Size: Length and width vary for required label content, but not less than 2-1/2 by 3/4 inch (.
6. Minimum Letter Size: 1/4 inch for name of units if viewing distance is less than 24 inches, 1/2 inch for viewing distances up to 72 inches, and proportionately larger lettering for greater viewing distances. Include secondary lettering two-thirds to three-fourths the size of principal lettering.
7. Fasteners: Stainless-steel rivets or self-tapping screws.
8. Adhesive: Contact-type permanent adhesive, compatible with label and with substrate.

C. Label Content: Include equipment's Drawing designation or unique equipment number, Drawing numbers where equipment is indicated (plans, details, and schedules), plus the Specification Section number and title where equipment is specified.

D. Equipment Label Schedule: For each item of equipment to be labeled, on 8-1/2-by-11-inch (A4) bond paper. Tabulate equipment identification number and identify Drawing numbers where equipment is indicated (plans, details, and schedules), plus the Specification Section number and title where equipment is specified. Equipment schedule shall be included in operation and maintenance data.

## 2.2 PIPE LABELS

- A. General Requirements for Manufactured Pipe Labels: Preprinted, color-coded, with lettering indicating service, and showing flow direction.
- B. Pretensioned Pipe Labels: Precoiled, semirigid plastic formed to cover full circumference of pipe and to attach to pipe without fasteners or adhesive.
- C. Self-Adhesive Pipe Labels: Printed plastic with contact-type, permanent-adhesive backing.
- D. Pipe Label Contents: Include identification of piping service using same designations or abbreviations as used on Drawings, pipe size, and an arrow indicating flow direction.
  1. Flow-Direction Arrows: Integral with piping system service lettering to accommodate both directions, or as separate unit on each pipe label to indicate flow direction.
  2. Lettering Size: At least 1-1/2 inches high.

## PART 3 - EXECUTION

### 3.1 PREPARATION

- A. Clean piping and equipment surfaces of substances that could impair bond of identification devices, including dirt, oil, grease, release agents, and incompatible primers, paints, and encapsulants.

### 3.2 EQUIPMENT LABEL INSTALLATION

- A. Install or permanently fasten labels on each major item of mechanical equipment.
- B. Locate equipment labels where accessible and visible.

### 3.3 PIPE LABEL INSTALLATION

- A. Locate pipe labels where piping is exposed or above accessible ceilings in finished spaces; machine rooms; accessible maintenance spaces such as shafts, tunnels, and plenums; and exterior exposed locations as follows:
  - 1. Near each valve and control device.
  - 2. Near each branch connection, excluding short takeoffs for fixtures and terminal units. Where flow pattern is not obvious, mark each pipe at branch.
  - 3. Near penetrations through walls, floors, ceilings, and inaccessible enclosures.
  - 4. At access doors, manholes, and similar access points that permit view of concealed piping.
  - 5. Near major equipment items and other points of origination and termination.
  - 6. Spaced at maximum intervals of 50 feet along each run. Reduce intervals to 25 feet in areas of congested piping and equipment.
  - 7. On piping above removable acoustical ceilings. Omit intermediately spaced labels.

END OF SECTION 220553

## SECTION 220719 - PLUMBING PIPING INSULATION

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated. Include thermal conductivity, water-vapor permeance thickness, and jackets (both factory- and field-applied, if any).
- B. Shop Drawings: Include plans, elevations, sections, details, and attachments to other work.
  - 1. Detail application of protective shields, saddles, and inserts at hangers for each type of insulation and hanger.
  - 2. Detail insulation application at elbows, fittings, flanges, valves, and specialties.
  - 3. Detail removable insulation at piping specialties, equipment connections, and access panels.
  - 4. Detail application of field-applied jackets and fitting covers.

#### 1.3 QUALITY ASSURANCE

- A. Installer Qualifications: Skilled mechanics who have successfully completed an apprenticeship program or another craft training program certified by the Department of Labor, Bureau of Apprenticeship and Training.
- B. Surface-Burning Characteristics: For insulation and related materials, as determined by testing identical products according to ASTM E 84 by a testing agency acceptable to authorities having jurisdiction. Factory label insulation and jacket materials and adhesive, mastic, tapes, and cement material containers, with appropriate markings of applicable testing agency.
  - 1. Insulation Installed Indoors: Flame-spread index of 25 or less, and smoke-developed index of 50 or less.

#### 1.4 DELIVERY, STORAGE, AND HANDLING

- A. Packaging: Insulation material containers shall be marked by manufacturer with appropriate ASTM standard designation, type and grade, and maximum use temperature.

#### 1.5 COORDINATION

- A. Coordinate sizes and locations of supports, hangers, and insulation shields.
- B. Coordinate clearance requirements with piping Installer for piping insulation application. Before preparing piping Shop Drawings, establish and maintain clearance requirements for

installation of insulation and field-applied jackets and finishes and for space required for maintenance.

## 1.6 SCHEDULING

- A. Schedule insulation application after pressure testing systems and, where required, after installing and testing heat tracing. Insulation application may begin on piping segments that have satisfactory test results.

## PART 2 - PRODUCTS

### 2.1 INSULATION MATERIALS

- A. Comply with requirements in "Plumbing Piping Insulation Schedule" for where insulating materials shall be applied.
- B. Products shall not contain asbestos, lead, mercury, or mercury compounds.
- C. Mineral-Fiber, Preformed Pipe Insulation:
  - 1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Johns Manville; Micro-Lok.
    - b. Knauf Insulation; 1000-Degree Pipe Insulation.
    - c. Owens Corning; Fiberglas Pipe Insulation.
    - d. Pre-approved equal.
  - 2. Type I, 850 Deg F Materials: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C 547, Type I, Grade A, with factory-applied ASJ-SSL.
- D. Flexible Elastomeric Insulation: Closed-cell, expanded-rubber materials. Comply with ASTM C 534, Type I for tubular materials.
  - 1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Aeroflex USA, Inc.; Aerocel.
    - b. Armacell LLC; AP Armaflex.
    - c. K-Flex USA; Insul-Lock, Insul-Tube, and K-FLEX LS.
    - d. Pre-approved equal.

### 2.2 ADHESIVES

- A. Materials shall be compatible with insulation materials, jackets, and substrates and for bonding insulation to itself and to surfaces to be insulated, unless otherwise indicated.
- B. Mineral-Fiber Adhesive: Comply with MIL-A-3316C, Class 2, Grade A.
  - 1. For indoor applications, adhesive shall have a VOC content of 80 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
- C. Flexible Elastomeric Adhesive: Comply with MIL-A-24179A, Type II, Class I.



1. For indoor applications, adhesive shall have a VOC content of 50 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

## 2.3 MASTICS

- A. Materials shall be compatible with insulation materials, jackets, and substrates; comply with MIL-PRF-19565C, Type II.
  1. For indoor applications, use mastics that have a VOC content of 50 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
- B. Vapor-Barrier Mastic: Water based; suitable for indoor use.
  1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Foster Brand; 30-80/30-90.
    - b. Vimasco Corporation; 749.
    - c. Childers Brand.
    - d. Pre-approved equal.
  2. Water-Vapor Permeance: ASTM E 96/E 96M, Procedure B, 0.013 perm at 43-mil dry film thickness.
  3. Service Temperature Range: Minus 20 to plus 180 deg F.
  4. Solids Content: ASTM D 1644, 58 percent by volume and 70 percent by weight.
  5. Color: White.

## 2.4 LAGGING ADHESIVES

- A. Description: Comply with MIL-A-3316C, Class I, Grade A, and shall be compatible with insulation materials, jackets, and substrates.
  1. For indoor applications, use lagging adhesives that have a VOC content of 50 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
  2. Products: Subject to compliance with requirements, provide one of the following:
    - a. Childers Brand; CP-50 AHV2.
    - b. Foster Brand; 30-36.
    - c. Vimasco Corporation; 713 and 714.
    - d. Pre-approved equal.
  3. Fire-resistant, water-based lagging adhesive and coating for use indoors to adhere fire-resistant lagging cloths over pipe insulation.
  4. Service Temperature Range: 0 to plus 180 deg F.
  5. Color: White.

## 2.5 SEALANTS

- A. Joint Sealants:
  1. Joint Sealants for Flexible Elastomeric Products: Subject to compliance with requirements, provide one of the following:

- a. Childers Brand; CP-76.
  - b. Foster Brand; 30-45.
  - c. Pittsburgh Corning Corporation; Pittseal 444.
  - d. Pre-approved equal.
- 2. Materials shall be compatible with insulation materials, jackets, and substrates.
  - 3. Permanently flexible, elastomeric sealant.
  - 4. Service Temperature Range: Minus 100 to plus 300 deg F.
  - 5. Color: White or gray.
  - 6. For indoor applications, sealants shall have a VOC content of 420 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
- B. ASJ Flashing Sealants and PVC Jacket Flashing Sealants:
- 1. Materials shall be compatible with insulation materials, jackets, and substrates.
  - 2. Fire- and water-resistant, flexible, elastomeric sealant.
  - 3. Service Temperature Range: Minus 40 to plus 250 deg F.
  - 4. Color: White.
  - 5. For indoor applications, sealants shall have a VOC content of 420 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

## 2.6 FACTORY-APPLIED JACKETS

- A. Insulation system schedules indicate factory-applied jackets on various applications. When factory-applied jackets are indicated, comply with the following:
- 1. ASJ-SSL: ASJ with self-sealing, pressure-sensitive, acrylic-based adhesive covered by a removable protective strip; complying with ASTM C 1136, Type I.

## 2.7 FIELD-APPLIED JACKETS

- A. Field-applied jackets shall comply with ASTM C 921, Type I, unless otherwise indicated.
- B. PVC Jacket: High-impact-resistant, UV-resistant PVC complying with ASTM D 1784, Class 16354-C; thickness as scheduled; roll stock ready for shop or field cutting and forming. Thickness is indicated in field-applied jacket schedules.
- 1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Johns Manville; Zeston.
    - b. P.I.C. Plastics, Inc.; FG Series.
    - c. Proto Corporation; LoSmoke.
    - d. Speedline Corporation; SmokeSafe.
    - e. Pre-approved equal.
  - 2. Adhesive: As recommended by jacket material manufacturer.
  - 3. Color: White.
  - 4. Factory-fabricated fitting covers.
    - a. Shapes: 45- and 90-degree, short- and long-radius elbows, tees, valves, flanges, unions, reducers, end caps, soil-pipe hubs, traps, mechanical joints, and P-trap and supply covers for lavatories.

## 2.8 TAPES

A. ASJ Tape: White vapor-retarder tape matching factory-applied jacket with acrylic adhesive, complying with ASTM C 1136.

1. Products: Subject to compliance with requirements, provide one of the following:

- a. ABI; 428 AWF ASJ.
- b. Avery Dennison Corporation; Fasson 0836.
- c. Compac Corporation; 104 and 105.
- d. Venture Tape; 1540 CW Plus, 1542 CW Plus, and 1542 CW Plus/SQ.
- e. Pre-approved equal.

2. Width: 3 inches.

3. Thickness: 11.5 mils.

4. Adhesion: 90 ounces force/inch in width.

5. Elongation: 2 percent.

6. Tensile Strength: 40 lbf/inch in width.

7. ASJ Tape Disks and Squares: Precut disks or squares of ASJ tape.

B. PVC Tape: White vapor-retarder tape matching field-applied PVC jacket with acrylic adhesive; suitable for indoor and outdoor applications.

1. Products: Subject to compliance with requirements, provide one of the following:

- a. ABI; 370 White PVC tape.
- b. Compac Corporation; 130.
- c. Venture Tape; 1506 CW NS.
- d. Pre-approved equal.

2. Width: 2 inches.

3. Thickness: 6 mils.

4. Adhesion: 64 ounces force/inch in width.

5. Elongation: 500 percent.

6. Tensile Strength: 18 lbf/inch in width.

## 2.9 SECUREMENTS

A. Staples for Hot Service Only: Outward-clinching insulation staples, nominal 3/4-inch- wide, stainless steel or Monel.

## 2.10 PROTECTIVE SHIELDING GUARDS

A. Protective Shielding Pipe Covers:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

- a. Insul-Tect Products Co.; a subsidiary of MVG Molded Products.
- b. Plumberex.
- c. Truebro; a brand of IPS Corporation.
- d. Zurn Industries, LLC; Tubular Brass Plumbing Products Operation.

- e. Pre-approved equal.
- 2. Description: Manufactured plastic wraps for covering plumbing fixture hot-water supply and trap and drain piping. Comply with Americans with Disabilities Act (ADA) requirements.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine substrates and conditions for compliance with requirements for installation tolerances and other conditions affecting performance of insulation application.
  - 1. Verify that systems to be insulated have been tested and are free of defects.
  - 2. Verify that surfaces to be insulated are clean and dry.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 PREPARATION

- A. Surface Preparation: Clean and dry surfaces to receive insulation. Remove materials that will adversely affect insulation application.
- B. Coordinate insulation installation with the trade installing heat tracing. Comply with requirements for heat tracing that apply to insulation.

### 3.3 GENERAL INSTALLATION REQUIREMENTS

- A. Install insulation materials, accessories, and finishes with smooth, straight, and even surfaces; free of voids throughout the length of piping including fittings, valves, and specialties.
- B. Install insulation materials, forms, vapor barriers or retarders, jackets, and thicknesses required for each item of pipe system as specified in insulation system schedules.
- C. Install accessories compatible with insulation materials and suitable for the service. Install accessories that do not corrode, soften, or otherwise attack insulation or jacket in either wet or dry state.
- D. Install insulation with longitudinal seams at bottom of horizontal runs.
- E. Install multiple layers of insulation with longitudinal and end seams staggered.
- F. Do not weld brackets, clips, or other attachment devices to piping, fittings, and specialties.
- G. Keep insulation materials dry during application and finishing.
- H. Install insulation with tight longitudinal seams and end joints. Bond seams and joints with adhesive recommended by insulation material manufacturer.
- I. Install insulation with least number of joints practical.

- J. Where vapor barrier is indicated, no penetrations of the insulation shall occur at hangers, supports, anchors, and other projections. Seal joints and seams with vapor-barrier mastic.
  - 1. Install insulation continuously through hangers and around anchor attachments.
  - 2. For insulation application where vapor barriers are indicated, extend insulation on anchor legs from point of attachment to supported item to point of attachment to structure. Taper and seal ends at attachment to structure with vapor-barrier mastic.
  - 3. Install insert materials and install insulation to tightly join the insert. Seal insulation to insulation inserts with adhesive or sealing compound recommended by insulation material manufacturer.
  - 4. Cover inserts with jacket material matching adjacent pipe insulation. Install shields over jacket, arranged to protect jacket from tear or puncture by hanger, support, and shield.
- K. Apply adhesives, mastics, and sealants at manufacturer's recommended coverage rate and wet and dry film thicknesses.
- L. Install insulation with factory-applied jackets as follows:
  - 1. Draw jacket tight and smooth.
  - 2. Cover circumferential joints with 3-inch- wide strips, of same material as insulation jacket. Secure strips with adhesive and outward clinching staples along both edges of strip, spaced 4 inches o.c.
  - 3. Overlap jacket longitudinal seams at least 1-1/2 inches. Install insulation with longitudinal seams at bottom of pipe. Clean and dry surface to receive self-sealing lap. Staple laps with outward clinching staples along edge at 4 inches o.c.
    - a. For below-ambient services, apply vapor-barrier mastic over staples.
  - 4. Cover joints and seams with tape, according to insulation material manufacturer's written instructions, to maintain vapor seal.
  - 5. Where vapor barriers are indicated, apply vapor-barrier mastic on seams and joints and at ends adjacent to pipe flanges and fittings.
- M. Cut insulation in a manner to avoid compressing insulation more than 75 percent of its nominal thickness.
- N. Finish installation with systems at operating conditions. Repair joint separations and cracking due to thermal movement.
- O. Repair damaged insulation facings by applying same facing material over damaged areas. Extend patches at least 4 inches beyond damaged areas. Adhere, staple, and seal patches similar to butt joints.
- P. For above-ambient services, do not install insulation to the following:
  - 1. Vibration-control devices.
  - 2. Testing agency labels and stamps.
  - 3. Nameplates and data plates.
  - 4. Cleanouts.

### 3.4 PENETRATIONS

- A. Insulation Installation at Interior Wall and Partition Penetrations (That Are Not Fire Rated): Install insulation continuously through walls and partitions.
- B. Insulation Installation at Fire-Rated Wall and Partition Penetrations: Install insulation continuously through penetrations of fire-rated walls and partitions.
  - 1. Comply with requirements in Section 078413 "Penetration Firestopping" for firestopping and fire-resistive joint sealers.
- C. Insulation Installation at Floor Penetrations:
  - 1. Pipe: Install insulation continuously through floor penetrations.
  - 2. Seal penetrations through fire-rated assemblies. Comply with requirements in Section 078413 "Penetration Firestopping."

### 3.5 GENERAL PIPE INSULATION INSTALLATION

- A. Requirements in this article generally apply to all insulation materials except where more specific requirements are specified in various pipe insulation material installation articles.
- B. Insulation Installation on Fittings, Valves, Strainers, Flanges, and Unions:
  - 1. Install insulation over fittings, valves, strainers, flanges, unions, and other specialties with continuous thermal and vapor-retarder integrity unless otherwise indicated.
  - 2. Insulate pipe elbows using preformed fitting insulation or mitered fittings made from same material and density as adjacent pipe insulation. Each piece shall be butted tightly against adjoining piece and bonded with adhesive. Fill joints, seams, voids, and irregular surfaces with insulating cement finished to a smooth, hard, and uniform contour that is uniform with adjoining pipe insulation.
  - 3. Insulate tee fittings with preformed fitting insulation or sectional pipe insulation of same material and thickness as used for adjacent pipe. Cut sectional pipe insulation to fit. Butt each section closely to the next and hold in place with tie wire. Bond pieces with adhesive.
  - 4. Insulate valves using preformed fitting insulation or sectional pipe insulation of same material, density, and thickness as used for adjacent pipe. Overlap adjoining pipe insulation by not less than two times the thickness of pipe insulation, or one pipe diameter, whichever is thicker. For valves, insulate up to and including the bonnets, valve stuffing-box studs, bolts, and nuts. Fill joints, seams, and irregular surfaces with insulating cement.
  - 5. Insulate strainers using preformed fitting insulation or sectional pipe insulation of same material, density, and thickness as used for adjacent pipe. Overlap adjoining pipe insulation by not less than two times the thickness of pipe insulation, or one pipe diameter, whichever is thicker. Fill joints, seams, and irregular surfaces with insulating cement. Insulate strainers so strainer basket flange or plug can be easily removed and replaced without damaging the insulation and jacket. Provide a removable reusable insulation cover. For below-ambient services, provide a design that maintains vapor barrier.
  - 6. Insulate flanges and unions using a section of oversized preformed pipe insulation. Overlap adjoining pipe insulation by not less than two times the thickness of pipe insulation, or one pipe diameter, whichever is thicker.

7. Cover segmented insulated surfaces with a layer of finishing cement and coat with a mastic. Install vapor-barrier mastic for below-ambient services and a breather mastic for above-ambient services. Reinforce the mastic with fabric-reinforcing mesh. Trowel the mastic to a smooth and well-shaped contour.
  8. For services, except for flexible elastomeric, install fitted PVC cover over elbows, tees, strainers, valves, flanges, and unions. Terminate ends with PVC end caps. Tape PVC covers to adjoining insulation facing using PVC tape.
  9. Stencil or label the outside insulation jacket of each union with the word "union." Match size and color of pipe labels.
- C. Insulate instrument connections for thermometers, pressure gages, pressure temperature taps, test connections, flow meters, sensors, switches, and transmitters on insulated pipes. Shape insulation at these connections by tapering it to and around the connection with insulating cement and finish with finishing cement, mastic, and flashing sealant.
- D. Install removable insulation covers at locations indicated. Installation shall conform to the following:
1. Make removable flange and union insulation from sectional pipe insulation of same thickness as that on adjoining pipe. Install same insulation jacket as adjoining pipe insulation.
  2. When flange and union covers are made from sectional pipe insulation, extend insulation from flanges or union long at least two times the insulation thickness over adjacent pipe insulation on each side of flange or union. Secure flange cover in place with stainless-steel or aluminum bands. Select band material compatible with insulation and jacket.
  3. Construct removable valve insulation covers in same manner as for flanges, except divide the two-part section on the vertical center line of valve body.
  4. When covers are made from block insulation, make two halves, each consisting of mitered blocks wired to stainless-steel fabric. Secure this wire frame, with its attached insulation, to flanges with tie wire. Extend insulation at least 2 inches over adjacent pipe insulation on each side of valve. Fill space between flange or union cover and pipe insulation with insulating cement. Finish cover assembly with insulating cement applied in two coats. After first coat is dry, apply and trowel second coat to a smooth finish.
  5. Finish exposed surfaces with a PVC jacket.

### 3.6 INSTALLATION OF MINERAL-FIBER INSULATION

- A. Insulation Installation on Straight Pipes and Tubes:
1. Secure each layer of preformed pipe insulation to pipe with wire or bands and tighten bands without deforming insulation materials.
  2. Where vapor barriers are indicated, seal longitudinal seams, end joints, and protrusions with vapor-barrier mastic and joint sealant.
  3. For insulation with factory-applied jackets on above-ambient surfaces, secure laps with outward clinched staples at 6 inches o.c.
  4. For insulation with factory-applied jackets on below-ambient surfaces, do not staple longitudinal tabs. Instead, secure tabs with additional adhesive as recommended by insulation material manufacturer and seal with vapor-barrier mastic and flashing sealant.
- B. Insulation Installation on Pipe Flanges:
1. Install preformed pipe insulation to outer diameter of pipe flange.

2. Make width of insulation section same as overall width of flange and bolts, plus twice the thickness of pipe insulation.
3. Fill voids between inner circumference of flange insulation and outer circumference of adjacent straight pipe segments with mineral-fiber blanket insulation.
4. Install jacket material with manufacturer's recommended adhesive, overlap seams at least 1 inch, and seal joints with flashing sealant.

C. Insulation Installation on Pipe Fittings and Elbows:

1. Install preformed sections of same material as straight segments of pipe insulation when available.
2. When preformed insulation elbows and fittings are not available, install mitered sections of pipe insulation, to a thickness equal to adjoining pipe insulation. Secure insulation materials with wire or bands.

D. Insulation Installation on Valves and Pipe Specialties:

1. Install preformed sections of same material as straight segments of pipe insulation when available.
2. When preformed sections are not available, install mitered sections of pipe insulation to valve body.
3. Arrange insulation to permit access to packing and to allow valve operation without disturbing insulation.
4. Install insulation to flanges as specified for flange insulation application.

### 3.7 FIELD-APPLIED JACKET INSTALLATION

- A. Where PVC jackets are indicated, install with 1-inch overlap at longitudinal seams and end joints. Seal with manufacturer's recommended adhesive.
1. Apply two continuous beads of adhesive to seams and joints, one bead under lap and the finish bead along seam and joint edge.

### 3.8 FIELD QUALITY CONTROL

- A. All insulation applications will be considered defective Work if inspection reveals noncompliance with requirements.

END OF SECTION 220719



## SECTION 221116 - DOMESTIC WATER PIPING

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:

1. Aboveground domestic water pipes, tubes, fittings, and specialties inside the building.
2. Specialty valves.
3. Flexible connectors.
4. Escutcheons.
5. Sleeves and sleeve seals.
6. Wall penetration systems.

- B. Reference Documents:

1. ASTM F 2389-06 - Standard Specification for Pressure-rated Polypropylene (PP) Piping Systems.
2. CSA B137.11 - Polypropylene (PP-R) Pipe and Fittings for Pressure Applications.
3. NSF/ANSI 14 – Plastic Piping System Components and Related Materials.
4. NSF/ANSI 61 – Drinking Water Systems Components – Health Effects.

- C. Definitions:

1. Definitions shall be in accordance with local plumbing codes and ASTM F 2389.

#### 1.3 SUBMITTALS

- A. Product Data: For the following products:

1. Specialty valves.
2. Transition fittings.
3. Dielectric fittings.
4. Flexible connectors.
5. Escutcheons.
6. Sleeves and sleeve seals.
7. Piping.

- B. Water Samples: Specified in "Cleaning" Article.

- C. Coordination Drawings: For piping in equipment rooms and other congested areas, drawn to scale, on which the following items are shown and coordinated with each other, using input from Installers of the items involved:

1. Domestic water piping.
- D. Field quality-control reports.

#### 1.4 QUALITY ASSURANCE

- A. Piping materials shall bear label, stamp, or other markings of specified testing agency.
- B. Comply with NSF 61 for potable domestic water piping and components.
- C. Material shall be certified by NSF International as complying with NSF 14, NSF 61, and ASTM F 2389 or CSA B137.11.
- D. Material shall comply with manufacturers specifications.
- E. Special Engineered products shall be certified by NSF International as complying with NSF 14.

#### 1.5 PROJECT CONDITIONS

- A. Interruption of Existing Water Service: Do not interrupt water service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary water service according to requirements indicated:
  1. Notify Architect, Construction Manager, or Owner no fewer than two days in advance of proposed interruption of water service.
  2. Do not proceed with interruption of water service without Architect's, Construction Manager's, or Owner's written permission.

#### 1.6 COORDINATION

- A. Coordinate sizes and locations of concrete bases with actual equipment provided.

### PART 2 - PRODUCTS

#### 2.1 PIPING MATERIALS

- A. Comply with requirements in "Piping Schedule" Article for applications of pipe, tube, fitting materials, and joining methods for specific services, service locations, and pipe sizes.

#### 2.2 COPPER TUBE AND FITTINGS

- A. Hard Copper Tube: ASTM B 88, Type L water tube, drawn temper.
  1. Cast-Copper Solder-Joint Fittings: ASME B16.18, pressure fittings.
  2. Wrought-Copper Solder-Joint Fittings: ASME B16.22, wrought-copper pressure fittings.
  3. Bronze Flanges: ASME B16.24, Class 150, with solder-joint ends.
  4. Copper Unions: MSS SP-123, cast-copper-alloy, hexagonal-stock body, with ball-and-socket, metal-to-metal seating surfaces, and solder-joint or threaded ends.
  5. Copper Pressure-Seal-Joint Fittings:

- a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - 1) Elkhart Products Corporation; Industrial Division.
    - 2) NIBCO INC.
    - 3) Viega; Plumbing and Heating Systems.
    - 4) Pre-approved equal.
  - b. NPS 2 and Smaller: Wrought-copper fitting with EPDM-rubber O-ring seal in each end.
  - c. NPS 2-1/2 to NPS 4: Cast-bronze or wrought-copper fitting with EPDM-rubber O-ring seal in each end.
6. Grooved-Joint Copper-Tube Appurtenances:
- a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - 1) Anvil International.
    - 2) Shurjoint Piping Products.
    - 3) Victaulic Company.
    - 4) Pre-approved equal.
  - b. Copper Grooved-End Fittings: ASTM B 75 copper tube or ASTM B 584 bronze castings.
  - c. Grooved-End-Tube Couplings: Copper-tube dimensions and design similar to AWWA C606. Include ferrous housing sections, EPDM-rubber gaskets suitable for hot and cold water, and bolts and nuts.
- B. Soft Copper Tube: ASTM B 88, Type K and ASTM B 88, Type L water tube, annealed temper.
- 1. Copper Solder-Joint Fittings: ASME B16.22, wrought-copper pressure fittings.

### 2.3 PIPING JOINING MATERIALS

- A. Pipe-Flange Gasket Materials: AWWA C110, rubber, flat face, 1/8 inch thick or ASME B16.21, nonmetallic and asbestos free, unless otherwise indicated; full-face or ring type unless otherwise indicated.
- B. Metal, Pipe-Flange Bolts and Nuts: ASME B18.2.1, carbon steel unless otherwise indicated.
- C. Solder Filler Metals: ASTM B 32, lead-free alloys. Include water-flushable flux according to ASTM B 813.
- D. Brazing Filler Metals: AWS A5.8/A5.8M, BCuP Series, copper-phosphorus alloys for general-duty brazing unless otherwise indicated.

### 2.4 SPECIALTY VALVES

- A. Comply with requirements in Division 22 Section "General-Duty Valves for Plumbing Piping" for general-duty metal valves.

- B. Comply with requirements in Division 22 Section "Domestic Water Piping Specialties" for balancing valves, drain valves, backflow preventers, and vacuum breakers.

## 2.5 TRANSITION FITTINGS

### A. General Requirements:

- 1. Same size as pipes to be joined.
- 2. Pressure rating at least equal to pipes to be joined.
- 3. End connections compatible with pipes to be joined.

### B. Fitting-Type Transition Couplings: Manufactured piping coupling or specified piping system fitting.

### C. Sleeve-Type Transition Coupling: AWWA C219.

- 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Cascade Waterworks Manufacturing.
  - b. Dresser, Inc.; Dresser Piping Specialties.
  - c. Ford Meter Box Company, Inc. (The).
  - d. JCM Industries.
  - e. Romac Industries, Inc.
  - f. Smith-Blair, Inc; a Sensus company.
  - g. Viking Johnson; c/o Mueller Co.
  - h. Pre-approved equal.

## 2.6 DIELECTRIC FITTINGS

### A. General Requirements: Assembly of copper alloy and ferrous materials or ferrous material body with separating nonconductive insulating material suitable for system fluid, pressure, and temperature.

### B. Dielectric Unions:

- 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Capitol Manufacturing Company.
  - b. Central Plastics Company.
  - c. EPCO Sales, Inc.
  - d. Hart Industries International, Inc.
  - e. Watts Regulator Co.; a division of Watts Water Technologies, Inc.
  - f. Zurn Plumbing Products Group; Wilkins Water Control Products.
  - g. Pre-approved equal.
- 2. Description:
  - a. Pressure Rating: 150 psig at 180 deg F.
  - b. End Connections: Solder-joint copper alloy and threaded ferrous.

C. Dielectric Flanges:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Capitol Manufacturing Company.
  - b. Central Plastics Company.
  - c. EPCO Sales, Inc.
  - d. Watts Regulator Co.; a division of Watts Water Technologies, Inc.
  - e. Pre-approved equal.
2. Description:
  - a. Factory-fabricated, bolted, companion-flange assembly.
  - b. Pressure Rating: 175 psig minimum.
  - c. End Connections: Solder-joint copper alloy and threaded ferrous; threaded solder-joint copper alloy and threaded ferrous.

D. Dielectric-Flange Kits:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Advance Products & Systems, Inc.
  - b. Calpico, Inc.
  - c. Central Plastics Company.
  - d. Pipeline Seal and Insulator, Inc.
  - e. Pre-approved equal.
2. Description:
  - a. Nonconducting materials for field assembly of companion flanges.
  - b. Pressure Rating: 150 psig.
  - c. Gasket: Neoprene or phenolic.
  - d. Bolt Sleeves: Phenolic or polyethylene.
  - e. Washers: Phenolic with steel backing washers.

E. Dielectric Couplings:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Calpico, Inc.
  - b. Lochinvar Corporation.
  - c. Sioux Chief
  - d. Pre-approved equal.
2. Description:
  - a. Galvanized-steel coupling.
  - b. Pressure Rating: 300 psig at 225 deg F.
  - c. End Connections: Female threaded.
  - d. Lining: Inert and noncorrosive, thermoplastic.

F. Dielectric Nipples:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Perfection Corporation; a subsidiary of American Meter Company.
  - b. Precision Plumbing Products, Inc.
  - c. Victaulic Company.
  - d. Pre-approved equal.
2. Description:
  - a. Electroplated steel nipple complying with ASTM F 1545.
  - b. Pressure Rating: 300 psig at 225 deg F.
  - c. End Connections: Male threaded or grooved.
  - d. Lining: Inert and noncorrosive, propylene.

2.7 FLEXIBLE CONNECTORS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
1. Flex-Hose Co., Inc.
  2. Flexicraft Industries.
  3. Flex Pression, Ltd.
  4. Flex-Weld, Inc.
  5. Hyspan Precision Products, Inc.
  6. Mercer Rubber Co.
  7. Metraflex, Inc.
  8. Proco Products, Inc.
  9. Tozen Corporation.
  10. Unaflex, Inc.
  11. Universal Metal Hose; a Hyspan company.
  12. Pre-approved equal.
- B. Bronze-Hose Flexible Connectors: Corrugated-bronze tubing with bronze wire-braid covering and ends brazed to inner tubing.
1. Working-Pressure Rating: Minimum 200 psig.
  2. End Connections NPS 2) and Smaller: Threaded copper pipe or plain-end copper tube.
  3. End Connections NPS 2-1/2 and Larger: Flanged copper alloy.
- C. Stainless-Steel-Hose Flexible Connectors: Corrugated-stainless-steel tubing with stainless-steel wire-braid covering and ends welded to inner tubing.
1. Working-Pressure Rating: Minimum 200 psig.
  2. End Connections NPS 2 and Smaller: Threaded steel-pipe nipple.
  3. End Connections NPS 2-1/2 and Larger: Flanged steel nipple.

2.8 ESCUTCHEONS

- A. General: Manufactured ceiling, floor, and wall escutcheons and floor plates.

- B. One Piece, Cast Brass: Polished, chrome-plated finish with setscrews.
- C. One Piece, Deep Pattern: Deep-drawn, box-shaped brass with chrome-plated finish.
- D. One Piece, Stamped Steel: Chrome-plated finish with setscrew.
- E. Split Casting, Cast Brass: Polished, chrome-plated finish with concealed hinge and setscrew.
- F. Split Plate, Stamped Steel: Chrome-plated finish with concealed hinge, setscrew.
- G. One-Piece Floor Plates: Cast-iron flange with holes for fasteners.
- H. Split-Casting Floor Plates: Cast brass with concealed hinge.

## 2.9 SLEEVES

- A. Cast-Iron Wall Pipes: Fabricated of cast iron, and equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop unless otherwise indicated.
- B. Galvanized-Steel-Sheet Sleeves: 0.0239-inch minimum thickness; round tube closed with welded longitudinal joint.
- C. Molded-PE Sleeves: Reusable, PE, tapered-cup shaped, and smooth outer surface with nailing flange for attaching to wooden forms.
- D. Molded-PVC Sleeves: Permanent, with nailing flange for attaching to wooden forms.
- E. PVC-Pipe Sleeves: ASTM D 1785, Schedule 40.
- F. Galvanized-Steel-Pipe Sleeves: ASTM A 53/A 53M, Type E, Grade B, Schedule 40, zinc-coated, with plain ends.

## 2.10 SLEEVE SEALS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Advance Products & Systems, Inc.
  - 2. Calpico, Inc.
  - 3. Metraflex, Inc.
  - 4. Pipeline Seal and Insulator, Inc.
  - 5. Pre-approved equal.
- B. Description: Modular sealing element unit, designed for field assembly, used to fill annular space between pipe and sleeve.
  - 1. Sealing Elements: EPDM-rubber interlocking links shaped to fit surface of pipe. Include type and number required for pipe material and size of pipe.
  - 2. Pressure Plates: Carbon steel or stainless steel.
  - 3. Connecting Bolts and Nuts: Carbon steel, with corrosion-resistant coating, or stainless steel of length required to secure pressure plates to sealing elements.

## 2.11 GROUT

- A. Standard: ASTM C 1107, Grade B, post-hardening and volume-adjusting, dry, hydraulic-cement grout.
- B. Characteristics: Nonshrink; recommended for interior and exterior applications.
- C. Design Mix: 5000-psi, 28-day compressive strength.
- D. Packaging: Premixed and factory packaged.

## PART 3 - EXECUTION

### 3.1 PIPING INSTALLATION

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of domestic water piping. Indicated locations and arrangements are used to size pipe and calculate friction loss, expansion, and other design considerations. Install piping as indicated unless deviations to layout are approved on Coordination Drawings.
- B. Install shutoff valve immediately upstream of each dielectric fitting.
- C. Install domestic water piping level without pitch and plumb.
- D. Install piping concealed from view and protected from physical contact by building occupants unless otherwise indicated and except in equipment rooms and service areas.
- E. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- F. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal, and coordinate with other services occupying that space.
- G. Install piping adjacent to equipment and specialties to allow service and maintenance.
- H. Install piping to permit valve servicing.
- I. Install nipples, unions, special fittings, and valves with pressure ratings the same as or higher than system pressure rating used in applications below unless otherwise indicated.
- J. Install piping free of sags and bends.
- K. Install fittings for changes in direction and branch connections.
- L. Install unions in copper tubing at final connection to each piece of equipment, machine, and specialty.
- M. Install thermostats in hot-water circulation piping. Comply with requirements in Division 22 Section "Domestic Water Pumps" for thermostats.
- N. Install thermometers on inlet and outlet piping from each water heater. Comply with requirements in Division 22 Section "Meters and Gages for Plumbing Piping" for thermometers.



### 3.2 JOINT CONSTRUCTION

- A. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.
- B. Remove scale, slag, dirt, and debris from inside and outside of pipes, tubes, and fittings before assembly.
- C. Brazed Joints: Join copper tube and fittings according to CDA's "Copper Tube Handbook," "Braze Joints" Chapter.
- D. Soldered Joints: Apply ASTM B 813, water-flushable flux to end of tube. Join copper tube and fittings according to ASTM B 828 or CDA's "Copper Tube Handbook."
- E. Pressure-Sealed Joints: Join copper tube and pressure-seal fittings with tools recommended by fitting manufacturer.
- F. Extruded-Tee Connections: Form tee in copper tube according to ASTM F 2104. Use tool designed for copper tube; drill pilot hole, form collar for outlet, dimple tube to form seating stop, and braze branch tube into collar.
- G. Copper-Tubing Grooved Joints: Roll groove end of tube. Assemble coupling with housing, gasket, lubricant, and bolts. Join copper tube and grooved-end fittings according to AWWA C606 for roll-grooved joints.
- H. Dissimilar-Material Piping Joints: Make joints using adapters compatible with materials of both piping systems.

### 3.3 VALVE INSTALLATION

- A. General-Duty Valves: Comply with requirements in Division 22 Section "General-Duty Valves for Plumbing Piping" for valve installations.
- B. Install shutoff valve close to water main on each branch and riser serving plumbing fixtures or equipment, on each water supply to equipment, and on each water supply to plumbing fixtures that do not have supply stops. Use ball or gate valves for piping NPS 2 and smaller.
- C. Install drain valves for equipment at base of each water riser, at low points in horizontal piping, and where required to drain water piping. Drain valves are specified in Division 22 Section "Domestic Water Piping Specialties."
  - 1. Hose-End Drain Valves: At low points in water mains, risers, and branches.
  - 2. Stop-and-Waste Drain Valves: Instead of hose-end drain valves where indicated.
- D. Install balancing valve in each hot-water circulation return branch and discharge side of each pump and circulator. Set balancing valves partly open to restrict but not stop flow. Use ball valves for piping NPS 2 and smaller. Comply with requirements in Division 22 Section "Domestic Water Piping Specialties" for balancing valves.
- E. Install calibrated balancing valves in each hot-water circulation return branch and discharge side of each pump and circulator. Set calibrated balancing valves partly open to restrict but not stop flow. Comply with requirements in Division 22 Section "Domestic Water Piping Specialties" for calibrated balancing valves.

### 3.4 TRANSITION FITTING INSTALLATION

- A. Install transition couplings at joints of dissimilar piping.
- B. Transition Fittings in Underground Domestic Water Piping:
  - 1. NPS 1-1/2 and Smaller: Fitting-type coupling.
  - 2. NPS 2 and Larger: Sleeve-type coupling.

### 3.5 DIELECTRIC FITTING INSTALLATION

- A. Install dielectric fittings in piping at connections of dissimilar metal piping and tubing.
- B. Dielectric Fittings for NPS 2 and Smaller: Use dielectric unions.

### 3.6 FLEXIBLE CONNECTOR INSTALLATION

- A. Install flexible connectors in suction and discharge piping connections to each domestic water pump and in suction and discharge manifold connections to each domestic water booster pump.
- B. Install bronze-hose flexible connectors in copper domestic water tubing.

### 3.7 HANGER AND SUPPORT INSTALLATION

- A. Comply with requirements in Division 22 Section "Hangers and Supports for Plumbing Piping and Equipment" for pipe hanger and support products and installation.
  - 1. Vertical Piping: MSS Type 8 or 42, clamps.
  - 2. Individual, Straight, Horizontal Piping Runs:
    - a. 100 Feet and Less: MSS Type 1, adjustable, steel clevis hangers.
    - b. Longer Than 100 Feet: MSS Type 43, adjustable roller hangers.
    - c. Longer Than 100 Feet If Indicated: MSS Type 49, spring cushion rolls.
  - 3. Multiple, Straight, Horizontal Piping Runs 100 Feet or Longer: MSS Type 44, pipe rolls. Support pipe rolls on trapeze.
  - 4. Base of Vertical Piping: MSS Type 52, spring hangers.
- B. Support vertical piping and tubing at base and at each floor.
- C. Rod diameter may be reduced one size for double-rod hangers, to a minimum of 3/8 inch.
- D. Install hangers for copper tubing with the following maximum horizontal spacing and minimum rod diameters:
  - 1. NPS 3/4 and Smaller: 60 inches with 3/8-inch rod.
  - 2. NPS 1 and NPS 1-1/4: 72 inches with 3/8-inch rod.
  - 3. NPS 1-1/2 and NPS 2: 96 inches with 3/8-inch rod.
  - 4. NPS 2-1/2: 108 inches with 1/2-inch rod.
  - 5. NPS 3 to NPS 5: 10 feet with 1/2-inch rod.
- E. Install supports for vertical copper tubing every 10 feet.

- F. Support piping and tubing not listed in this article according to MSS SP-69 and manufacturer's written instructions.

### 3.8 CONNECTIONS

- A. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Install piping adjacent to equipment and machines to allow service and maintenance.
- C. Connect domestic water piping to exterior water-service piping. Use transition fitting to join dissimilar piping materials.
- D. Connect domestic water piping to water-service piping with shutoff valve; extend and connect to the following:
  - 1. Water Heaters: Cold-water inlet and hot-water outlet piping in sizes indicated, but not smaller than sizes of water heater connections.
  - 2. Plumbing Fixtures: Cold- and hot-water supply piping in sizes indicated, but not smaller than required by plumbing code. Comply with requirements in Division 22 plumbing fixture Sections for connection sizes.
  - 3. Equipment: Cold- and hot-water supply piping as indicated, but not smaller than equipment connections. Provide shutoff valve and union for each connection.

### 3.9 ESCUTCHEON INSTALLATION

- A. Install escutcheons for penetrations of walls, ceilings, and floors.
- B. Escutcheons for New Piping:
  - 1. Piping with Fitting or Sleeve Protruding from Wall: One piece, deep pattern.
  - 2. Bare Piping at Wall in Finished Spaces: One piece, cast brass with polished chrome-plated finish.
  - 3. Bare Piping at Ceiling Penetrations in Finished Spaces: One piece or split casting, cast brass with polished chrome-plated finish.
  - 4. Bare Piping in Unfinished Service Spaces: One piece, cast brass with polished chrome-plated finish.
  - 5. Bare Piping in Equipment Rooms: One piece, cast brass.

### 3.10 SLEEVE INSTALLATION

- A. General Requirements: Install sleeves for pipes and tubes passing through penetrations in floors, partitions, roofs, and walls.
- B. Sleeves are not required for core-drilled holes.
- C. Permanent sleeves are not required for holes formed by removable PE sleeves.
- D. Cut sleeves to length for mounting flush with both surfaces unless otherwise indicated.
- E. Install sleeves in new partitions, slabs, and walls as they are built.

- F. For interior wall penetrations, seal annular space between sleeve and pipe or pipe insulation using joint sealants appropriate for size, depth, and location of joint. Comply with requirements in Division 07 Section "Joint Sealants" for joint sealants.
- G. For exterior wall penetrations above grade, seal annular space between sleeve and pipe using joint sealants appropriate for size, depth, and location of joint. Comply with requirements in Division 07 Section "Joint Sealants" for joint sealants.
- H. For exterior wall penetrations below grade, seal annular space between sleeve and pipe using sleeve seals specified in this Section.
- I. Seal space outside of sleeves in concrete slabs and walls with grout.
- J. Install sleeves that are large enough to provide 1/4-inch annular clear space between sleeve and pipe or pipe insulation unless otherwise indicated.
- K. Install sleeve materials according to the following applications:
  - 1. Sleeves for Piping Passing through Concrete Roof Slabs: Molded PE, molded PVC, or steel pipe.
  - 2. Sleeves for Piping Passing through Exterior Concrete Walls:
    - a. Steel pipe sleeves for pipes smaller than NPS 6.
    - b. Install sleeves that are large enough to provide 1-inch annular clear space between sleeve and pipe or pipe insulation when sleeve seals are used.
    - c. Do not use sleeves when wall penetration systems are used.
  - 3. Sleeves for Piping Passing through Interior Concrete Walls:
    - a. Steel pipe sleeves for pipes smaller than NPS 6.
- L. Fire-Barrier Penetrations: Maintain indicated fire rating of walls, partitions, ceilings, and floors at pipe penetrations. Seal pipe penetrations with firestop materials. Comply with requirements in Division 07 Section "Penetration Firestopping" for firestop materials and installations.

### 3.11 SLEEVE SEAL INSTALLATION

- A. Install sleeve seals in sleeves in exterior concrete walls at water-service piping entries into building.
- B. Select type and number of sealing elements required for pipe material and size. Position pipe in center of sleeve. Assemble sleeve seal components and install in annular space between pipe and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.

### 3.12 WALL PENETRATION SYSTEM INSTALLATION

- A. Install wall penetration systems in new, exterior concrete walls.
- B. Assemble wall penetration system components with sleeve pipe. Install so that end of sleeve pipe and face of housing are flush with wall. Adjust locking devices to secure sleeve pipe in housing.

### 3.13 IDENTIFICATION

- A. Identify system components. Comply with requirements in Division 22 Section "Identification for Plumbing Piping and Equipment" for identification materials and installation.
- B. Label pressure piping with system operating pressure.

### 3.14 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
- B. Piping Inspections:
  - 1. Do not enclose, cover, or put piping into operation until it has been inspected and approved by authorities having jurisdiction.
  - 2. During installation, notify authorities having jurisdiction at least one day before inspection must be made. Perform tests specified below in presence of authorities having jurisdiction:
    - a. Roughing-in Inspection: Arrange for inspection of piping before concealing or closing-in after roughing-in and before setting fixtures.
    - b. Final Inspection: Arrange final inspection for authorities having jurisdiction to observe tests specified below and to ensure compliance with requirements.
  - 3. Reinspection: If authorities having jurisdiction find that piping will not pass tests or inspections, make required corrections and arrange for reinspection.
  - 4. Reports: Prepare inspection reports and have them signed by authorities having jurisdiction.
- C. Piping Tests:
  - 1. Fill domestic water piping. Check components to determine that they are not air bound and that piping is full of water.
  - 2. Test for leaks and defects in new piping and parts of existing piping that have been altered, extended, or repaired. If testing is performed in segments, submit a separate report for each test, complete with diagram of portion of piping tested.
  - 3. Leave new, altered, extended, or replaced domestic water piping uncovered and unconcealed until it has been tested and approved. Expose work that was covered or concealed before it was tested.
  - 4. Cap and subject piping to static water pressure of 50 psig above operating pressure, without exceeding pressure rating of piping system materials. Isolate test source and allow to stand for four hours. Leaks and loss in test pressure constitute defects that must be repaired.
  - 5. Repair leaks and defects with new materials and retest piping or portion thereof until satisfactory results are obtained.
  - 6. Prepare reports for tests and for corrective action required.
- D. Domestic water piping will be considered defective if it does not pass tests and inspections.
- E. Prepare test and inspection reports.

### 3.15 ADJUSTING

- A. Perform the following adjustments before operation:
1. Close drain valves, hydrants, and hose bibbs.
  2. Open shutoff valves to fully open position.
  3. Open throttling valves to proper setting.
  4. Adjust balancing valves in hot-water-circulation return piping to provide adequate flow.
    - a. Manually adjust ball-type balancing valves in hot-water-circulation return piping to provide flow of hot water in each branch.
    - b. Adjust calibrated balancing valves to flows indicated.
  5. Remove plugs used during testing of piping and for temporary sealing of piping during installation.
  6. Remove and clean strainer screens. Close drain valves and replace drain plugs.
  7. Remove filter cartridges from housings and verify that cartridges are as specified for application where used and are clean and ready for use.
  8. Check plumbing specialties and verify proper settings, adjustments, and operation.

### 3.16 CLEANING

- A. Clean and disinfect potable and non-potable domestic water piping as follows:
1. Purge new piping and parts of existing piping that have been altered, extended, or repaired before using.
  2. Use purging and disinfecting procedures prescribed by authorities having jurisdiction; if methods are not prescribed, use procedures described in either AWWA C651 or AWWA C652 or follow procedures described below:
    - a. Flush piping system with clean, potable water until dirty water does not appear at outlets.
    - b. Fill and isolate system according to either of the following:
      - 1) Fill system or part thereof with water/chlorine solution with at least 50 ppm of chlorine. Isolate with valves and allow to stand for 24 hours.
      - 2) Fill system or part thereof with water/chlorine solution with at least 200 ppm of chlorine. Isolate and allow to stand for three hours.
    - c. Flush system with clean, potable water until no chlorine is in water coming from system after the standing time.
    - d. Submit water samples in sterile bottles to authorities having jurisdiction. Repeat procedures if biological examination shows contamination.
- B. Clean non-potable domestic water piping as follows:
1. Purge new piping and parts of existing piping that have been altered, extended, or repaired before using.
  2. Use purging procedures prescribed by authorities having jurisdiction or; if methods are not prescribed, follow procedures described below:
    - a. Flush piping system with clean, potable water until dirty water does not appear at outlets.

- b. Submit water samples in sterile bottles to authorities having jurisdiction. Repeat procedures if biological examination shows contamination.
- C. Prepare and submit reports of purging and disinfecting activities.
- D. Clean interior of domestic water piping system. Remove dirt and debris as work progresses.

### 3.17 PIPING SCHEDULE

- A. Transition and special fittings with pressure ratings at least equal to piping rating may be used in applications below unless otherwise indicated.
- B. Flanges and unions may be used for aboveground piping joints unless otherwise indicated.
- C. Fitting Option: Extruded-tee connections and brazed joints may be used on aboveground copper tubing.
- D. Aboveground domestic water piping, NPS 2 and smaller, shall be one of the following:
  - 1. Hard copper tube, ASTM B 88, Type L; cast- or wrought-copper solder-joint fittings; and brazed or soldered joints.
  - 2. Hard copper tube, ASTM B 88, Type L; copper pressure-seal-joint fittings; and pressure-sealed joints.

### 3.18 VALVE SCHEDULE

- A. Drawings indicate valve types to be used. Where specific valve types are not indicated, the following requirements apply:
  - 1. Shutoff Duty: Use ball valves for piping NPS 2 and smaller.
  - 2. Throttling Duty: Use ball valves for piping NPS 2 and smaller.
  - 3. Hot-Water Circulation Piping, Balancing Duty: Calibrated memory-stop balancing valves.
  - 4. Drain Duty: Hose-end drain valves.
- B. Use check valves to maintain correct direction of domestic water flow to and from equipment.

END OF SECTION 221116

## SECTION 221119 - DOMESTIC WATER PIPING SPECIALTIES

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes the following domestic water piping specialties:
  - 1. Balancing valves.
  - 2. Wall hydrants.
  - 3. Water hammer arresters.
- B. Related Sections include the following:
  - 1. Division 22 Section "Meters and Gages for Plumbing Piping" for thermometers, pressure gages, and flow meters in domestic water piping.
  - 2. Division 22 Section "Drinking Fountains and Water Coolers" for water filters for water coolers.

#### 1.3 PERFORMANCE REQUIREMENTS

- A. Minimum Working Pressure for Domestic Water Piping Specialties: 125 psig, unless otherwise indicated.

#### 1.4 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: Diagram power, signal, and control wiring.
- C. Field quality-control test reports.
- D. Operation and Maintenance Data: For domestic water piping specialties to include in emergency, operation, and maintenance manuals.

#### 1.5 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- B. NSF Compliance:



1. Comply with NSF 14, "Plastics Piping Components and Related Materials," for plastic domestic water piping components.
2. Comply with NSF 61, "Drinking Water System Components - Health Effects; Sections 1 through 9."

## PART 2 - PRODUCTS

### 2.1 BALANCING VALVES

#### A. Copper-Alloy Calibrated Balancing Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Armstrong International, Inc.
  - b. ITT Industries; Bell & Gossett Div.
  - c. NIBCO INC.
  - d. TAC Americas.
  - e. Taco, Inc.
  - f. Watts Industries, Inc.; Water Products Div.
  - g. Pre-approved equal.
2. Type: Ball or Y-pattern globe valve with two readout ports and memory setting indicator.
3. Body: Brass or bronze.
4. Size: Same as connected piping, but not larger than NPS 2.
5. Accessories: Meter hoses, fittings, valves, differential pressure meter, and carrying case.

#### B. Cast-Iron Calibrated Balancing Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Armstrong International, Inc.
  - b. Flo Fab Inc.
  - c. ITT Industries; Bell & Gossett Div.
  - d. NIBCO INC.
  - e. TAC Americas.
  - f. Watts Industries, Inc.; Water Products Div.
  - g. Pre-approved equal.
2. Type: Adjustable with Y-pattern globe valve, two readout ports, and memory-setting indicator.
3. Size: Same as connected piping, but not smaller than NPS 2-1/2.

#### C. Accessories: Meter hoses, fittings, valves, differential pressure meter, and carrying case.

#### D. Memory-Stop Balancing Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

- a. Conbraco Industries, Inc.
  - b. Crane Co.; Crane Valve Group; Crane Valves.
  - c. Crane Co.; Crane Valve Group; Jenkins Valves.
  - d. Crane Co.; Crane Valve Group; Stockham Div.
  - e. Hammond Valve.
  - f. Milwaukee Valve Company.
  - g. NIBCO INC.
  - h. Red-White Valve Corp.
  - i. Pre-approved equal.
2. Standard: MSS SP-110 for two-piece, copper-alloy ball valves.
  3. Pressure Rating: 400-psig minimum CWP.
  4. Size: NPS 2 or smaller.
  5. Body: Copper alloy.
  6. Port: Standard or full port.
  7. Ball: Chrome-plated brass.
  8. Seats and Seals: Replaceable.
  9. End Connections: Solder joint or threaded.
  10. Handle: Vinyl-covered steel with memory-setting device.

## 2.2 WALL HYDRANTS

### A. Nonfreeze Wall Hydrants:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Josam Company.
  - b. MIFAB, Inc.
  - c. Prier Products, Inc.
  - d. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
  - e. Tyler Pipe; Wade Div.
  - f. Watts Drainage Products Inc.
  - g. Woodford Manufacturing Company.
  - h. Zurn Plumbing Products Group; Light Commercial Operation.
  - i. Zurn Plumbing Products Group; Specification Drainage Operation.
  - j. Pre-approved equal.
2. Standard: ASME A112.21.3M for concealed-outlet, self-draining wall hydrants.
3. Pressure Rating: 125 psig.
4. Operation: Loose key.
5. Casing and Operating Rod: Of length required to match wall thickness. Include wall clamp.
6. Inlet: NPS 3/4 or NPS 1.
7. Outlet: Concealed, with integral vacuum breaker and garden-hose thread complying with ASME B1.20.7.
8. Box: Deep, flush mounting with cover.
9. Box and Cover Finish: Aluminum finish.
10. Outlet: Exposed, with integral vacuum breaker and garden-hose thread complying with ASME B1.20.7.
11. Nozzle and Wall-Plate Finish: Aluminum finish.
12. Operating Keys(s): One with each wall hydrant.

## 2.3 WATER HAMMER ARRESTERS

### A. Water Hammer Arresters:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. AMTROL, Inc.
  - b. Josam Company.
  - c. MIFAB, Inc.
  - d. PPP Inc.
  - e. Sioux Chief Manufacturing Company, Inc.
  - f. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
  - g. Tyler Pipe; Wade Div.
  - h. Watts Drainage Products Inc.
  - i. Zurn Plumbing Products Group; Specification Drainage Operation.
  - j. Pre-approved equal.
2. Standard: ASSE 1010 or PDI-WH 201.
3. Type: Metal bellows or copper tube with piston.
4. Size: ASSE 1010, Sizes AA and A through F or PDI-WH 201, Sizes A through F.

## PART 3 - EXECUTION

### 3.1 INSTALLATION

- A. Refer to Division 22 Section "Common Work Results for Plumbing" for piping joining materials, joint construction, and basic installation requirements.
- B. Install water regulators with inlet and outlet shutoff valves and bypass with memory-stop balancing valve. Install pressure gages on inlet and outlet.
- C. Install water control valves with inlet and outlet shutoff valves and bypass with globe valve. Install pressure gages on inlet and outlet.
- D. Install balancing valves in locations where they can easily be adjusted.
- E. Install water hammer arresters in water piping according to PDI-WH 201.

### 3.2 CONNECTIONS

- A. Piping installation requirements are specified in other Division 22 Sections. Drawings indicate general arrangement of piping and specialties.
- B. Ground equipment according to Division 26 Section "Grounding and Bonding for Electrical Systems."
- C. Connect wiring according to Division 26 Section "Low-Voltage Electrical Power Conductors and Cables."

### 3.3 LABELING AND IDENTIFYING

- A. Equipment Nameplates and Signs: Install engraved plastic-laminate equipment nameplate or sign on or near each of the following:
  - 1. Calibrated balancing valves.
- B. Distinguish among multiple units, inform operator of operational requirements, indicate safety and emergency precautions, and warn of hazards and improper operations, in addition to identifying unit. Nameplates and signs are specified in Division 22 Section "Identification for Plumbing Piping and Equipment."

### 3.4 ADJUSTING

- A. Set field-adjustable flow set points of balancing valves.

END OF SECTION 221119

## SECTION 221123 - DOMESTIC WATER PUMPS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Horizontally mounted, in-line, close-coupled centrifugal pumps.

#### 1.3 DEFINITIONS

- A. Low Voltage: As defined in NFPA 70 for circuits and equipment operating at less than 50 V or for remote-control, signaling power-limited circuits.

#### 1.4 SUBMITTALS

- A. Product Data: For each type of product indicated. Include materials of construction, rated capacities, certified performance curves with operating points plotted on curves, operating characteristics, electrical characteristics, and furnished specialties and accessories.
- B. Operation and Maintenance Data: For domestic water pumps to include in operation and maintenance manuals.

#### 1.5 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. UL Compliance: Comply with UL 778 for motor-operated water pumps.

#### 1.6 DELIVERY, STORAGE, AND HANDLING

- A. Retain shipping flange protective covers and protective coatings during storage.
- B. Protect bearings and couplings against damage.
- C. Comply with pump manufacturer's written rigging instructions for handling.

## 1.7 COORDINATION

- A. Coordinate sizes and locations of concrete bases with actual equipment provided.

## PART 2 - PRODUCTS

### 2.1 HORIZONTALLY MOUNTED, IN-LINE, CLOSE-COUPLED CENTRIFUGAL PUMPS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Armstrong Pumps Inc.
  - 2. Bell & Gossett Domestic Pump; ITT Corporation.
  - 3. PACO Pumps; Grundfos Pumps Corporation, U.S.A.
  - 4. Grundfos
  - 5. Wilo
  - 6. Pre-approved equal.
- B. Description: Factory-assembled and -tested, in-line, single-stage, close-coupled, overhung-impeller centrifugal pumps designed for installation with pump and motor shaft mounted horizontal.
- C. Pump Construction:
  - 1. Casing: Radially split with threaded companion-flange connections for pumps with NPS 2 pipe connections and flanged connections for pumps with NPS 2-1/2 pipe connections.
  - 2. Impeller: Statically and dynamically balanced, closed, and keyed to shaft.
  - 3. Shaft and Shaft Sleeve: Steel shaft with deflector, with copper-alloy shaft sleeve. Include water slinger on shaft between motor and seal.
  - 4. Seal: Mechanical, with carbon-steel rotating ring, stainless-steel spring, ceramic seat, and rubber bellows and gasket.
  - 5. Bearings: Oil-lubricated; bronze-journal or ball type.
  - 6. Shaft Coupling: Flexible, capable of absorbing torsional vibration and shaft misalignment.
- D. Motor: Single speed, with grease-lubricated ball bearings; and resiliently or rigidly mounted to pump casing.
- E. Characteristics:
  - 1. Casing Material: Bronze or cast iron.
  - 2. Impeller Material: ASTM B 584, cast bronze or stainless steel.
  - 3. Minimum Working Pressure: 175 psig.
  - 4. Maximum Continuous Operating Temperature: 225 deg F.
  - 5. Pump Control: Thermostat.

## 2.2 MOTORS

- A. Comply with NEMA designation, temperature rating, service factor, enclosure type, and efficiency requirements for motors specified in Division 22 Section "Common Motor Requirements for Plumbing Equipment."
  - 1. Motor Sizes: Minimum size as indicated. If not indicated, large enough so driven load will not require motor to operate in service factor range above 1.0.
  - 2. Controllers, Electrical Devices, and Wiring: Comply with requirements for electrical devices and connections specified in Division 26 Sections.

## 2.3 CONTROLS

- A. Refer to drawings.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine roughing-in of domestic-water-piping system to verify actual locations of connections before pump installation.

### 3.2 PUMP INSTALLATION

- A. Comply with Hydraulic Institute HI 1.4.
- B. Install in-line, sealless centrifugal pumps with shaft horizontal unless otherwise indicated.
- C. Install horizontally mounted, in-line, close-coupled centrifugal pumps with shaft(s) horizontal.
- D. Install continuous-thread hanger rods and spring hangers or spring hangers with vertical-limit stop of size required to support pump weight.
  - 1. Comply with requirements for hangers and supports specified in Division 22 Section "Hangers and Supports for Plumbing Piping and Equipment."
- E. Install thermostats in hot-water return piping.

### 3.3 CONNECTIONS

- A. Comply with requirements for piping specified in Division 22 Section "Domestic Water Piping." Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Install piping adjacent to pumps to allow service and maintenance.
- C. Connect domestic water piping to pumps. Install suction and discharge piping equal to or greater than size of pump nozzles.
  - 1. Install flexible connectors adjacent to pumps in suction and discharge piping of the following pumps:

- a. Horizontally mounted, in-line, close-coupled centrifugal pumps.
  - b. Comply with requirements for flexible connectors specified in Division 22 Section "Domestic Water Piping."
2. Install shutoff valve and strainer on suction side of each pump, and check, shutoff, and throttling valves on discharge side of each pump. Install valves same size as connected piping. Comply with requirements for valves specified in Division 22 Section "General-Duty Valves for Plumbing Piping" and comply with requirements for strainers specified in Division 22 Section "Domestic Water Piping Specialties."
  3. Install pressure gage and snubber at suction of each pump and pressure gage and snubber at discharge of each pump. Install at integral pressure-gage tapings where provided or install pressure-gage connectors in suction and discharge piping around pumps. Comply with requirements for pressure gages and snubbers specified in Division 22 Section "Meters and Gages for Plumbing Piping."
- D. Comply with Division 26 Sections for electrical connections, and wiring methods.
  - E. Connect thermostats to pumps that they control.

### 3.4 IDENTIFICATION

- A. Comply with requirements for identification specified in Division 22 Section "Identification for Plumbing Piping and Equipment" for identification of pumps.

### 3.5 STARTUP SERVICE

- A. Perform startup service.
  1. Complete installation and startup checks according to manufacturer's written instructions.
  2. Check piping connections for tightness.
  3. Clean strainers on suction piping.
  4. Set thermostats for automatic starting and stopping operation of pumps.
  5. Perform the following startup checks for each pump before starting:
    - a. Verify bearing lubrication.
    - b. Verify that pump is free to rotate by hand and that pump for handling hot liquid is free to rotate with pump hot and cold. If pump is bound or drags, do not operate until cause of trouble is determined and corrected.
    - c. Verify that pump is rotating in the correct direction.
  6. Prime pump by opening suction valves and closing drains, and prepare pump for operation.
  7. Start motor.
  8. Open discharge valve slowly.
  9. Adjust temperature settings on thermostats.
  10. Adjust timer settings.

### 3.6 ADJUSTING

- A. Adjust domestic water pumps to function smoothly, and lubricate as recommended by manufacturer.



- B. Adjust initial temperature set points.
- C. Set field-adjustable switches and circuit-breaker trip ranges as indicated.

END OF SECTION 221123

## SECTION 221316 - SANITARY WASTE AND VENT PIPING

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes the following for soil, waste, and vent piping inside the building:
  - 1. Pipe, tube, and fittings.
  - 2. Special pipe fittings.

#### 1.3 DEFINITIONS

- A. ABS: Acrylonitrile-butadiene-styrene plastic.
- B. EPDM: Ethylene-propylene-diene terpolymer rubber.
- C. LLDPE: Linear, low-density polyethylene plastic.
- D. NBR: Acrylonitrile-butadiene rubber.
- E. PE: Polyethylene plastic.
- F. PVC: Polyvinyl chloride plastic.
- G. TPE: Thermoplastic elastomer.

#### 1.4 PERFORMANCE REQUIREMENTS

- A. Components and installation shall be capable of withstanding the following minimum working pressure, unless otherwise indicated:
  - 1. Soil, Waste, and Vent Piping: 10-foot head of water.
  - 2. Sanitary Sewer, Force-Main Piping: 150 psig.

#### 1.5 SUBMITTALS

- A. Product Data: For pipe, tube, fittings, and couplings.
- B. Field quality-control inspection and test reports.

## 1.6 QUALITY ASSURANCE

- A. Piping materials shall bear label, stamp, or other markings of specified testing agency.
- B. Cast iron soil pipe and fittings shall be marked with the collective trademark of the Cast Iron Soil Pipe Institute and shall be listed by NSF International.
- C. CISPI Hubless Couplings (CISPI 310) shall be marked with NSF International.
- D. Comply with NSF 14, "Plastics Piping Systems Components and Related Materials," for plastic piping components. Include marking with "NSF-dwv" for plastic drain, waste, and vent piping; "NSF-drain" for plastic drain piping; "NSF-tubular" for plastic continuous waste piping; and "NSF-sewer" for plastic sewer piping.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. In other Part 2 articles where titles below introduce lists, the following requirements apply to product selection:
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the manufacturers specified.

### 2.2 PIPING MATERIALS

- A. Refer to Part 3 "Piping Applications" Article for applications of pipe, tube, fitting, and joining materials.

### 2.3 HUB-AND-SPIGOT, CAST-IRON SOIL PIPE AND FITTINGS

- A. Pipe and Fittings: ASTM A 74, Service class; manufactured by AB&I, Charlotte, or Tyler.
- B. Gaskets: ASTM C 564, rubber.
- C. Calking Materials: ASTM B 29, pure lead and oakum or hemp fiber.

### 2.4 HUBLESS CAST-IRON SOIL PIPE AND FITTINGS

- A. Pipe and Fittings: ASTM A 888 or CISPI 301. manufactured by AB&I, Charlotte, or Tyler.
- B. Shielded Couplings: ASTM C 1277 assembly of metal shield or housing, corrosion-resistant fasteners, and rubber sleeve with integral, center pipe stop.
  - 1. Standard, Shielded, Stainless-Steel Couplings: CISPI 310, with stainless-steel corrugated shield; stainless-steel bands and tightening devices; and ASTM C 564, rubber sleeve.
    - a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

- 1) ANACO.
  - 2) Mission Rubber Co.
  - 3) Tyler Pipe; Soil Pipe Div.
  - 4) Pre-approved equal.
2. Heavy-Duty, Shielded, Stainless-Steel Couplings: With stainless-steel shield, stainless-steel bands and tightening devices, and ASTM C 564, rubber sleeve.
    - a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
      - 1) ANACO/Husky SD 4000.
      - 2) Clamp-All Corp.-125.
      - 3) Fernco.
      - 4) Pre-approved equal.
  3. Heavy-Duty, Shielded, Cast-Iron Couplings: ASTM A 48/A 48M, two-piece, cast-iron housing; stainless-steel bolts and nuts; and ASTM C 564, rubber sleeve.
    - a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
      - 1) MG Piping Products Co.
      - 2) Fernco.
      - 3) ANACO/Husky.
      - 4) Pre-approved equal.

## 2.5 PVC PIPE AND FITTINGS

- A. Solid-Wall PVC Pipe: ASTM D 2665, drain, waste, and vent.
  1. PVC Socket Fittings: ASTM D 2665, socket type, made to ASTM D 3311, drain, waste, and vent patterns.
- B. Solvent Cement and Adhesive Primer:
  1. Use PVC solvent cement that has a VOC content of 510 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
  2. Use adhesive primer that has a VOC content of 550 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

## 2.6 SPECIAL PIPE FITTINGS

- A. Flexible, Nonpressure Pipe Couplings: Comply with ASTM C 1173, elastomeric, sleeve-type, reducing or transition pattern. Include shear ring, ends of same sizes as piping to be joined, and corrosion-resistant-metal tension band and tightening mechanism on each end.
  1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Dallas Specialty & Mfg. Co.
    - b. Fernco, Inc.
    - c. Logan Clay Products Company (The).

- d. Mission Rubber Co.
  - e. NDS, Inc.
  - f. Plastic Oddities, Inc.
  - g. Pre-approved equal.
2. Sleeve Materials:
- a. For Cast-Iron Soil Pipes: ASTM C 564, rubber.
  - b. For Plastic Pipes: ASTM F 477, elastomeric seal or ASTM D 5926, PVC.
  - c. For Dissimilar Pipes: ASTM D 5926, PVC or other material compatible with pipe materials being joined.
- B. Expansion Joints: Two or three-piece, ductile-iron assembly consisting of telescoping sleeve(s) with gaskets and restrained-type, ductile-iron, bell-and-spigot end sections complying with AWWA C110 or AWWA C153. Select and assemble components for expansion indicated. Include AWWA C111, ductile-iron glands, rubber gaskets, and steel bolts.
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
- a. EBAA Iron Sales, Inc.
  - b. Romac Industries, Inc.
  - c. Star Pipe Products; Star Fittings Div.
  - d. Pre-approved equal.

## PART 3 - EXECUTION

### 3.1 PIPING APPLICATIONS

- A. Flanges and unions may be used on aboveground pressure piping, unless otherwise indicated.
- B. Aboveground, soil and waste piping shall be the following:
  - 1. Hubless cast-iron soil pipe and fittings; standard, shielded, stainless-steel couplings; and hubless-coupling joints.
- C. Aboveground, vent piping shall be the following:
  - 1. Hubless cast-iron soil pipe and fittings; standard, shielded, stainless-steel couplings; and hubless-coupling joints.
- D. Underground, soil, waste, and vent piping NPS 15 and smaller shall be the following:
  - 1. Extra-Heavy class, cast-iron soil piping; gaskets; and gasketed joints.
  - 2. Solid wall PVC pipe, PVC socket fittings, and solvent-cemented joints.
  - 3. Dissimilar Pipe-Material Couplings: Flexible, nonpressure pipe couplings for joining dissimilar pipe materials with small difference in OD.

### 3.2 PIPING INSTALLATION

- A. Basic piping installation requirements are specified in Division 22 Section "Common Work Results for Plumbing."

- B. Install cleanout fitting with closure plug inside the building in sanitary force-main piping.
- C. Install cast-iron sleeve with water stop and mechanical sleeve seal at each service pipe penetration through foundation wall. Select number of interlocking rubber links required to make installation watertight. Sleeves and mechanical sleeve seals are specified in Division 22 Section "Common Work Results for Plumbing."
- D. Install wall-penetration fitting at each service pipe penetration through foundation wall. Make installation watertight.
- E. Install cast-iron soil piping according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook," Chapter IV, "Installation of Cast Iron Soil Pipe and Fittings."
  - 1. Install encasement on underground piping according to ASTM A 674 or AWWA C105.
- F. Make changes in direction for soil and waste drainage and vent piping using appropriate branches, bends, and long-sweep bends. Sanitary tees and short-sweep 1/4 bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical. Use long-turn, double Y-branch and 1/8-bend fittings if 2 fixtures are installed back to back or side by side with common drain pipe. Straight tees, elbows, and crosses may be used on vent lines. Do not change direction of flow more than 90 degrees. Use proper size of standard increasers and reducers if pipes of different sizes are connected. Reducing size of drainage piping in direction of flow is prohibited.
- G. Lay buried building drainage piping beginning at low point of each system. Install true to grades and alignment indicated, with unbroken continuity of invert. Place hub ends of piping upstream. Install required gaskets according to manufacturer's written instructions for use of lubricants, cements, and other installation requirements. Maintain swab in piping and pull past each joint as completed.
- H. Install soil and waste drainage and vent piping at the following minimum slopes, unless otherwise indicated:
  - 1. Building Sanitary Drain: 2 percent downward in direction of flow for piping NPS 3 and smaller; 1 percent downward in direction of flow for piping NPS 4 and larger.
  - 2. Horizontal Sanitary Drainage Piping: 2 percent downward in direction of flow.
  - 3. Vent Piping: 1 percent down toward vertical fixture vent or toward vent stack.
- I. Sleeves are not required for cast-iron soil piping passing through concrete slabs-on-grade if slab is without membrane waterproofing.
- J. Install PVC soil and waste drainage and vent piping according to ASTM D 2665.
- K. Install underground PVC soil and waste drainage piping according to ASTM D 2321.
- L. Do not enclose, cover, or put piping into operation until it is inspected and approved by authorities having jurisdiction.

### 3.3 JOINT CONSTRUCTION

- A. Basic piping joint construction requirements are specified in Division 22 Section "Common Work Results for Plumbing."

- B. Join hub-and-spigot, cast-iron soil piping with gasket joints according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for compression joints.
- C. Join hub-and-spigot, cast-iron soil piping with calked joints according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for lead and oakum calked joints.
- D. Join hubless cast-iron soil piping according to CISPI 310 and CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for hubless-coupling joints.
- E. PVC Nonpressure Piping Joints: Join piping according to ASTM D 2665.

### 3.4 HANGER AND SUPPORT INSTALLATION

- A. Pipe hangers and supports are specified in Division 22 Section "Hangers and Supports for Plumbing Piping and Equipment." Install the following:
  - 1. Vertical Piping: MSS Type 8 or Type 42, clamps.
  - 2. Install individual, straight, horizontal piping runs according to the following:
    - a. 100 Feet and Less: MSS Type 1, adjustable, steel clevis hangers.
    - b. Longer Than 100 Feet: MSS Type 43, adjustable roller hangers.
    - c. Longer Than 100 Feet, if Indicated: MSS Type 49, spring cushion rolls.
  - 3. Multiple, Straight, Horizontal Piping Runs 100 Feet or Longer: MSS Type 44, pipe rolls. Support pipe rolls on trapeze.
  - 4. Base of Vertical Piping: MSS Type 52, spring hangers.
- B. Install supports according to Division 22 Section "Hangers and Supports for Plumbing Piping and Equipment."
- C. Support vertical piping and tubing at base and at each floor.
- D. Rod diameter may be reduced 1 size for double-rod hangers, with 3/8-inch minimum rods.
- E. Install hangers for cast-iron soil piping with the following maximum horizontal spacing and minimum rod diameters:
  - 1. NPS 1-1/2 and NPS 2: 60 inches with 3/8-inch rod.
  - 2. NPS 3: 60 inches with 1/2-inch rod.
  - 3. NPS 4 and NPS 5: 60 inches with 5/8-inch rod.
- F. Install supports for vertical cast-iron soil piping every 15 feet.
- G. Support piping and tubing not listed above according to MSS SP-69 and manufacturer's written instructions.

### 3.5 CONNECTIONS

- A. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Connect soil and waste piping to exterior sanitary sewerage piping. Use transition fitting to join dissimilar piping materials.

- C. Connect drainage and vent piping to the following:
1. Plumbing Fixtures: Connect drainage piping in sizes indicated, but not smaller than required by plumbing code.
  2. Plumbing Fixtures and Equipment: Connect atmospheric vent piping in sizes indicated, but not smaller than required by authorities having jurisdiction.
  3. Plumbing Specialties: Connect drainage and vent piping in sizes indicated, but not smaller than required by plumbing code.
  4. Equipment: Connect drainage piping as indicated. Provide shutoff valve, if indicated, and union for each connection. Use flanges instead of unions for connections NPS 2-1/2 and larger.

### 3.6 FIELD QUALITY CONTROL

- A. During installation, notify authorities having jurisdiction at least 24 hours before inspection must be made. Perform tests specified below in presence of authorities having jurisdiction.
1. Roughing-in Inspection: Arrange for inspection of piping before concealing or closing-in after roughing-in and before setting fixtures.
  2. Final Inspection: Arrange for final inspection by authorities having jurisdiction to observe tests specified below and to ensure compliance with requirements.
- B. Reinspection: If authorities having jurisdiction find that piping will not pass test or inspection, make required corrections and arrange for reinspection.
- C. Reports: Prepare inspection reports and have them signed by authorities having jurisdiction.
- D. Test sanitary drainage and vent piping according to procedures of authorities having jurisdiction or, in absence of published procedures, as follows:
1. Test for leaks and defects in new piping and parts of existing piping that have been altered, extended, or repaired. If testing is performed in segments, submit separate report for each test, complete with diagram of portion of piping tested.
  2. Leave uncovered and unconcealed new, altered, extended, or replaced drainage and vent piping until it has been tested and approved. Expose work that was covered or concealed before it was tested.
  3. Roughing-in Plumbing Test Procedure: Test drainage and vent piping, except outside leaders, on completion of roughing-in. Close openings in piping system and fill with water to point of overflow, but not less than 10-foot head of water. From 15 minutes before inspection starts to completion of inspection, water level must not drop. Inspect joints for leaks.
  4. Finished Plumbing Test Procedure: After plumbing fixtures have been set and traps filled with water, test connections and prove they are gastight and watertight. Plug vent-stack openings on roof and building drains where they leave building. Introduce air into piping system equal to pressure of 1-inch wg. Use U-tube or manometer inserted in trap of water closet to measure this pressure. Air pressure must remain constant without introducing additional air throughout period of inspection. Inspect plumbing fixture connections for gas and water leaks.
  5. Repair leaks and defects with new materials and retest piping, or portion thereof, until satisfactory results are obtained.
  6. Prepare reports for tests and required corrective action.



### 3.7 CLEANING

- A. Clean interior of piping. Remove dirt and debris as work progresses.
- B. Protect drains during remainder of construction period to avoid clogging with dirt and debris and to prevent damage from traffic and construction work.
- C. Place plugs in ends of uncompleted piping at end of day and when work stops.

END OF SECTION 221316

## SECTION 221319 - SANITARY WASTE PIPING SPECIALTIES

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes the following sanitary drainage piping specialties:
  - 1. Cleanouts.
  - 2. Floor drains.
  - 3. Roof flashing assemblies.
  - 4. Through-penetration firestop assemblies.
  - 5. Miscellaneous sanitary drainage piping specialties.
  - 6. Flashing materials.

#### 1.3 DEFINITIONS

- A. ABS: Acrylonitrile-butadiene-styrene plastic.
- B. FRP: Fiberglass-reinforced plastic.
- C. HDPE: High-density polyethylene plastic.
- D. PE: Polyethylene plastic.
- E. PP: Polypropylene plastic.
- F. PVC: Polyvinyl chloride plastic.

#### 1.4 SUBMITTALS

- A. Product Data: For drainage piping specialties.
- B. Field quality-control test reports.
- C. Operation and Maintenance Data: For drainage piping specialties to include in emergency, operation, and maintenance manuals.

## 1.5 QUALITY ASSURANCE

- A. Drainage piping specialties shall bear label, stamp, or other markings of specified testing agency.
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- C. Comply with NSF 14, "Plastics Piping Components and Related Materials," for plastic sanitary piping specialty components.

## 1.6 COORDINATION

- A. Coordinate size and location of concrete bases. Cast anchor-bolt inserts into bases. Concrete, reinforcement, and formwork requirements are specified in Division 03.
- B. Coordinate size and location of roof penetrations.

## 1.7 EXTRA MATERIALS

- A. Furnish extra materials described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.

## PART 2 - PRODUCTS

### 2.1 CLEANOUTS

- A. Exposed Metal Cleanouts:
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Josam Company; Josam Div.
    - b. MIFAB, Inc.
    - c. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
    - d. Tyler Pipe; Wade Div.
    - e. Watts Drainage Products Inc.
    - f. Zurn Plumbing Products Group; Specification Drainage Operation.
    - g. Pre-approved equal.
  - 2. Standard: ASME A112.36.2M for cast iron for cleanout test tee.
  - 3. Size: Same as connected drainage piping
  - 4. Body Material: Hubless, cast-iron soil pipe test tee as required to match connected piping.
  - 5. Closure: Countersunk or raised-head plug.
  - 6. Closure Plug Size: Same as or not more than one size smaller than cleanout size.
  - 7. Closure: Stainless-steel plug with seal.
- B. Metal Floor Cleanouts:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Josam Company; Josam Div.
  - b. Oatey.
  - c. Sioux Chief Manufacturing Company, Inc.
  - d. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
  - e. Tyler Pipe; Wade Div.
  - f. Watts Drainage Products Inc.
  - g. Zurn Plumbing Products Group; Specification Drainage Operation.
  - h. Josam Company; Josam Div.
  - i. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
  - j. Pre-approved equal.
2. Standard: ASME A112.36.2M for cast-iron soil pipe with cast-iron ferrule; heavy-duty, adjustable housing; or threaded, adjustable housing cleanout.
3. Size: Same as connected branch.
4. Body or Ferrule: Cast iron.
5. Outlet Connection: Threaded
6. Closure: Brass plug with straight threads and gasket; or brass plug with tapered threads.
7. Adjustable Housing Material: Cast iron with threads, set-screws or other device.
8. Frame and Cover Material and Finish: Nickel-bronze, copper alloy.
9. Frame and Cover Shape: Round or square in tiled areas.
10. Top Loading Classification: Extra Heavy in Service, Equipment and Warehouse Areas or Medium Duty.
11. Riser: ASTM A 74, Extra-Heavy in Service, Equipment and Warehouse Areas or Service class, cast-iron drainage pipe fitting and riser to cleanout.
12. Standard: ASME A112.3.1.
13. Size: Same as connected branch.
14. Housing: Stainless steel.
15. Closure: Stainless steel with seal.
16. Riser: Stainless-steel drainage pipe fitting to cleanout.

C. Cast-Iron Wall Cleanouts:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Josam Company; Josam Div.
  - b. MIFAB, Inc.
  - c. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
  - d. Tyler Pipe; Wade Div.
  - e. Watts Drainage Products Inc.
  - f. Zurn Plumbing Products Group; Specification Drainage Operation.
  - g. Pre-approved equal.
2. Standard: ASME A112.36.2M. Include wall access.
3. Size: Same as connected drainage piping.
4. Body: Hubless, cast-iron soil pipe test tee as required to match connected piping.
5. Closure: Countersunk or raised-head; drilled-and-threaded, brass, or cast-iron plug.
6. Closure Plug Size: Same as or not more than one size smaller than cleanout size.
7. Wall Access: Round, deep, chrome-plated bronze, flat, chrome-plated brass or stainless-steel cover plate with countersunk screw.

## 2.2 FLOOR DRAINS

### A. Cast-Iron Floor Drains:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Josam Company; Josam Div.
  - b. MIFAB, Inc.
  - c. Prier Products, Inc.
  - d. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
  - e. Tyler Pipe; Wade Div.
  - f. Watts Drainage Products Inc.
  - g. Zurn Plumbing Products Group; Specification Drainage Operation.
  - h. Pre-approved equal.
2. See Schedule on Drawings.

## 2.3 ROOF FLASHING ASSEMBLIES

### A. Roof Flashing Assemblies:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Acorn Engineering Company; Elmdor/Stoneman Div.
  - b. Thaler Metal Industries Ltd.
  - c. Oatey
  - d. Pre-approved equal.

### B. Description: Manufactured assembly made of 4.0-lb/sq. ft., 0.0625-inch-thick, lead flashing collar and skirt extending at least 8 inches from pipe, with galvanized-steel boot reinforcement and counterflashing fitting.

1. Open-Top Vent Cap: Without cap.
2. Low-Silhouette Vent Cap: With vandal-proof vent cap.
3. Extended Vent Cap: With field-installed, vandal-proof vent cap.

## 2.4 THROUGH-PENETRATION FIRESTOP ASSEMBLIES

### A. Through-Penetration Firestop Assemblies:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. ProSet Systems Inc.
  - b. Hilti, Inc.
  - c. 3M, Inc.
  - d. Pre-approved equal.
2. Standard: UL 1479 assembly of sleeve and stack fitting with firestopping plug.
3. Size: Same as connected soil, waste, or vent stack.

4. Sleeve: Molded PVC plastic, of length to match slab thickness and with integral nailing flange on one end for installation in cast-in-place concrete slabs.
5. Stack Fitting: ASTM A 48/A 48M, gray-iron, hubless-pattern, wye branch with neoprene O-ring at base and gray-iron plug in thermal-release harness. Include PVC protective cap for plug.
6. Special Coating: Corrosion resistant on interior of fittings.

## 2.5 MISCELLANEOUS SANITARY DRAINAGE PIPING SPECIALTIES

### A. Open Drains:

1. Description: Shop or field fabricate from ASTM A 74, Service class, hub-and-spigot, cast-iron, soil-pipe fittings. Include P-trap, hub-and-spigot riser section; and where required, increaser fitting joined with ASTM C 564, rubber gaskets.
2. Size: Same as connected waste piping with increaser fitting of size indicated.

### B. Deep-Seal Traps:

1. Description: Cast-iron or bronze casting, with inlet and outlet matching connected piping and cleanout trap-seal primer valve connection.
2. Size: Same as connected waste piping.
  - a. NPS 2: 4-inch-minimum water seal.
  - b. NPS 2-1/2 and Larger: 5-inch-minimum water seal.

### C. Air-Gap Fittings:

1. Standard: ASME A112.1.2, for fitting designed to ensure fixed, positive air gap between installed inlet and outlet piping.
2. Body: Bronze or cast iron.
3. Inlet: Opening in top of body.
4. Outlet: Larger than inlet.
5. Size: Same as connected waste piping and with inlet large enough for associated indirect waste piping.

### D. Sleeve Flashing Device:

1. Description: Manufactured, cast-iron fitting, with clamping device, that forms sleeve for pipe floor penetrations of floor membrane. Include galvanized-steel pipe extension in top of fitting that will extend 2 inches above finished floor and galvanized-steel pipe extension in bottom of fitting that will extend through floor slab.
2. Size: As required for close fit to riser or stack piping.

### E. Stack Flashing Fittings:

1. Description: Counterflashing-type, cast-iron fitting, with bottom recess for terminating roof membrane, and with threaded or hub top for extending vent pipe.
2. Size: Same as connected stack vent or vent stack.

## 2.6 FLASHING MATERIALS

- A. Lead Sheet: ASTM B 749, Type L51121, copper bearing, with the following minimum weights and thicknesses, unless otherwise indicated:
  - 1. General Use: 4.0-lb/sq. ft., 0.0625-inch thickness.
  - 2. Vent Pipe Flashing: 3.0-lb/sq. ft., 0.0469-inch thickness.
  - 3. Burning: 6-lb/sq. ft., 0.0938-inch thickness.
- B. Copper Sheet: ASTM B 152/B 152M, of the following minimum weights and thicknesses, unless otherwise indicated:
  - 1. General Applications: 12 oz./sq. ft.
  - 2. Vent Pipe Flashing: 8 oz./sq. ft.
- C. Zinc-Coated Steel Sheet: ASTM A 653/A 653M, with 0.20 percent copper content and 0.04-inch minimum thickness, unless otherwise indicated. Include G90 hot-dip galvanized, mill-phosphatized finish for painting if indicated.
- D. Elastic Membrane Sheet: ASTM D 4068, flexible, chlorinated polyethylene, 40-mil minimum thickness.
- E. Fasteners: Metal compatible with material and substrate being fastened.
- F. Metal Accessories: Sheet metal strips, clamps, anchoring devices, and similar accessory units required for installation; matching or compatible with material being installed.
- G. Solder: ASTM B 32, lead-free alloy.
- H. Bituminous Coating: SSPC-Paint 12, solvent-type, bituminous mastic.

## PART 3 - EXECUTION

### 3.1 INSTALLATION

- A. Refer to Division 22 Section "Common Work Results for Plumbing" for piping joining materials, joint construction, and basic installation requirements.
- B. Install cleanouts in aboveground piping and building drain piping according to the following, unless otherwise indicated:
  - 1. Size same as drainage piping up to NPS 4. Use NPS 4 for larger drainage piping unless larger cleanout is indicated.
  - 2. Locate at each change in direction of piping greater than 45 degrees.
  - 3. Locate at minimum intervals of 50 feet for piping NPS 4 and smaller and 100 feet for larger piping.
  - 4. Locate at base of each vertical soil and waste stack.
- C. For floor cleanouts for piping below floors, install cleanout deck plates with top flush with finished floor.
- D. For cleanouts located in concealed piping, install cleanout wall access covers, of types indicated, with frame and cover flush with finished wall.

- E. Install floor drains at low points of surface areas to be drained. Set grates of drains flush with finished floor, unless otherwise indicated.
  - 1. Position floor drains for easy access and maintenance.
  - 2. Set floor drains below elevation of surrounding finished floor to allow floor drainage. Set with grates depressed according to the following drainage area radii:
    - a. Radius, 30 Inches or Less: Equivalent to 1 percent slope, but not less than 1/4-inch total depression.
    - b. Radius, 30 to 60 Inches: Equivalent to 1 percent slope.
    - c. Radius, 60 Inches or Larger: Equivalent to 1 percent slope, but not greater than 1-inch total depression.
  - 3. Install floor-drain flashing collar or flange so no leakage occurs between drain and adjoining flooring. Maintain integrity of waterproof membranes where penetrated.
  - 4. Install individual traps for floor drains connected to sanitary building drain, unless otherwise indicated.
- F. Install roof flashing assemblies on sanitary stack vents and vent stacks that extend through roof.
- G. Install flashing fittings on sanitary stack vents and vent stacks that extend through roof.
- H. Install through-penetration firestop assemblies in plastic conductors and stacks at floor penetrations.
- I. Install deep-seal traps on floor drains and other waste outlets, if indicated.
- J. Install air-gap fittings on draining-type backflow preventers and on indirect-waste piping discharge into sanitary drainage system.
- K. Install sleeve flashing device with each riser and stack passing through floors with waterproof membrane.
- L. Install wood-blocking reinforcement for wall-mounting-type specialties.
- M. Install traps on plumbing specialty drain outlets. Omit traps on indirect wastes unless trap is indicated.
- N. Install escutcheons at wall, floor, and ceiling penetrations in exposed finished locations and within cabinets and millwork. Use deep-pattern escutcheons if required to conceal protruding pipe fittings.

### 3.2 CONNECTIONS

- A. Piping installation requirements are specified in other Division 22 Sections. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Install piping adjacent to equipment to allow service and maintenance.
- C. Ground equipment according to Division 26 Section "Grounding and Bonding for Electrical Systems."



- D. Connect wiring according to Division 26 Section "Low-Voltage Electrical Power Conductors and Cables."

### 3.3 FLASHING INSTALLATION

- A. Fabricate flashing from single piece unless large pans, sumps, or other drainage shapes are required. Join flashing according to the following if required:
  - 1. Lead Sheets: Burn joints of lead sheets 6.0-lb/sq. ft., 0.0938-inch thickness or thicker. Solder joints of lead sheets 4.0-lb/sq. ft., 0.0625-inch thickness or thinner.
  - 2. Copper Sheets: Solder joints of copper sheets.
- B. Install sheet flashing on pipes, sleeves, and specialties passing through or embedded in floors and roofs with waterproof membrane.
  - 1. Pipe Flashing: Sleeve type, matching pipe size, with minimum length of 10 inches, and skirt or flange extending at least 8 inches around pipe.
  - 2. Sleeve Flashing: Flat sheet, with skirt or flange extending at least 8 inches around sleeve.
  - 3. Embedded Specialty Flashing: Flat sheet, with skirt or flange extending at least 8 inches around specialty.
- C. Set flashing on floors and roofs in solid coating of bituminous cement.
- D. Secure flashing into sleeve and specialty clamping ring or device.
- E. Install flashing for piping passing through roofs with counterflashing or commercially made flashing fittings, according to Division 07 Section "Sheet Metal Flashing and Trim."
- F. Extend flashing up vent pipe passing through roofs and turn down into pipe, or secure flashing into cast-iron sleeve having calking recess.
- G. Fabricate and install flashing and pans, sumps, and other drainage shapes.

### 3.4 PROTECTION

- A. Protect drains during remainder of construction period to avoid clogging with dirt or debris and to prevent damage from traffic or construction work.
- B. Place plugs in ends of uncompleted piping at end of each day or when work stops.

END OF SECTION 221319

## SECTION 223400 - FUEL-FIRED, DOMESTIC WATER HEATERS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes the following fuel-fired water heaters:
  - 1. High efficiency, condensing, gas water heaters and accessories.

#### 1.3 SUBMITTALS

- A. General: Submit each item in this Article according to the Conditions of the Contract and Division 1 Specification Sections.
- B. Product Data including rated capacities of selected models, weights (shipping, installed, and operating), furnished specialties, and accessories. Indicate dimensions, finishes and coatings, required clearances, methods of assembly of components, and piping and wiring connections.
- C. Shop Drawings showing layout of each unit, including tanks, pumps, controls, related accessories, and piping.
- D. Setting Drawings with templates and directions for installing foundation bolts, anchor bolts, and other anchorages.
- E. Wiring diagrams from manufacturers detailing electrical requirements for electrical power supply wiring to water heaters. Include ladder-type wiring diagrams for interlock and control wiring required for final installation of water heaters and controls. Differentiate between factory-installed and field-installed wiring.
- F. Product certificates signed by manufacturers of water heaters certifying that their products comply with specified requirements.
- G. Certificates of shop inspection and data report as required by provisions of ASME Boiler and Pressure Vessel Code, when ASME construction is indicated and AGA Certified.
- H. Field quality-control installation reports.
- I. Maintenance data for water heaters to include in operation and maintenance manuals specified in Division 1. Include startup instructions.
- J. Warranty: Submit manufacturers complete warranties.

## 1.4 QUALITY ASSURANCE

- A. ASHRAE Standard: Comply with performance efficiencies prescribed in ASHRAE 90.1, "Energy Efficient Design of New Buildings Except Low-Rise Residential Buildings."
- B. NFPA Standard: Comply with NFPA 70, "National Electrical Code," for electrical components.
- C. Listing and Labeling: Provide electrically operated water heaters controls, and components specified in this Section that are listed and labeled.
  - 1. The Terms "Listed" and "Labeled": As defined in National Electrical Code, Article 100.
  - 2. Listing and Labeling Agency Qualifications: A "Nationally Recognized Testing Laboratory" (NRTL) as defined in OSHA Regulation 1910.7.
- D. Product Options: Drawings indicate size, profiles, connections, dimensional requirements, and characteristics of water heaters and accessories and are based on specific types and models indicated. Other manufacturers' water heaters and accessories with equal performance characteristics may be considered. Refer to Division 1 Section "Substitutions."

## 1.5 WARRANTY

- A. General Warranty: The special warranty specified in this Article shall not deprive Owner of other rights Owner may have under other provisions of Contract Documents and shall be in addition to, and run concurrent with, other warranties made by Contractor under requirements of Contract Documents.
- B. Special Warranty: Submit a written warranty executed by manufacturer agreeing to repair or replace water heaters and accessories that fail in materials or workmanship within specified warranty period. Failures include, but are not limited to, tanks. For one year all components and parts will be covered by the manufacturer. For one year from date of start-up by the manufacturer's authorized service agent all freight and labor will be burdened by the manufacturer. For three years manufacturer will repair or replace the tank should it leak, produce discolored water, a manufacturer or material defect. For the following 2 years remedies to the tanks performed under the warranty will be shared between the Owner and manufacturer. This warranty is in addition to, and not a limitation of, other rights Owner may have against Contractor under Contract Documents.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Storage, Indirect-Fired Water Heaters:

- a. A.O. Smith Water Products Co.
- b. Ruud.
- c. Lochinvar.
- d. State Industries, Inc.

2. Compression Tanks:

- a. Amtrol, Inc.
- b. Armstrong Pumps, Inc.
- c. Expanflex, Inc.
- d. Smith: A.O. Smith; Aqua-Air Div.
- e. State Industries, Inc.

2.2 WATER HEATERS, GENERAL

- A. Specified manufacturer's standard components and features are acceptable where specific product requirements are not indicated.
- B. All water heaters shall have electric ignition.
- C. Temperature Control: Adjustable thermostat, except for units where other arrangement is indicated or temperature is regulated by flow-control fitting.
- D. Safety Control: Manual reset, high-temperature-limit cutoff device or system on commercial units and where indicated. Include electronic low-water cutoff device or system on commercial units where indicated.
- E. Interior Finish: Materials that comply with requirements of applicable NSF, AWWA, or FDA and EPA regulatory standards for tasteless and odorless, potable-water-tank linings.
- F. Tappings: Factory fabricated of materials compatible with tank. Include tappings for piping connections, relief valves, pressure gage, thermometer, blow down, vent, and controls as required and others as indicated. Attach tappings to tank before testing and labeling. Include tappings and connections as follows:
  - 1. 2-Inch NPS and Smaller: Threaded ends.
- G. Insulation: Fiberglass, polyurethane foam, or manufacturer's standard that is suitable for operating temperature and required insulating value. Include insulation material that surrounds entire tank except connections and controls.
- H. Jacket: Steel, with baked-on enamel finish, except where otherwise specified.
- I. Anode Rods: Factory installed, magnesium, if required.
- J. Combination Temperature and Pressure Relief Valve: ASME and AGA rated and stamped and complying with ASME PTC 25.3. Include relieving capacity at least as great as heat input and pressure setting less than water heater working-pressure rating. Select relief valve with sensing element that extends into tank.
- K. All water heaters shall be constructed to ASME standards. Heater shall be ASME rated where specified.

## 2.3 HIGH EFFICIENCY, CONDENSING, GAS WATER HEATERS

- A. Commercial, high efficiency, storage, gas water heaters shall comply with ANSI Z21.10.3/CSA 4.3.
- B. Description: Manufacturer's proprietary design to provide at least 94 percent combustion efficiency at optimum operating conditions. Following features and attributes may be modified or omitted if water heater otherwise complies with requirements for performance.
  - 1. Storage-Tank Construction: ASME-code steel with 150-psig working-pressure rating.
    - a. Tappings: Factory fabricated of materials compatible with tank. Attach tappings to tank before testing.
      - 1) NPS 2 and Smaller: Threaded ends according to ASME B1.20.1.
    - b. Interior Finish: Comply with NSF 61 barrier materials for potable-water tank linings, including extending finish into and through tank fittings and outlets.
    - c. Lining: Glass complying with NSF 61 barrier materials for potable-water tank linings, including extending lining into and through tank fittings and outlets.
  - 2. Factory-Installed, Storage-Tank Appurtenances:
    - a. Anode Rod: Replaceable magnesium.
    - b. Dip Tube: Provide unless cold-water inlet is near bottom of tank.
    - c. Drain Valve: Corrosion-resistant metal complying with ASSE 1005.
    - d. Insulation: Comply with ASHRAE/IESNA 90.1. Surround entire storage tank except connections and controls.
    - e. Jacket: Steel with enameled finish.
    - f. Burner: For use with power-vent water heaters and for natural-gas fuel.
    - g. Automatic Ignition: ANSI Z21.20, electric, automatic, gas-ignition system.
    - h. Temperature Control: Adjustable thermostat.
    - i. Safety Controls: Automatic, high-temperature-limit and low-water cutoff devices or systems.
    - j. Combination Temperature and Pressure Relief Valves: ANSI Z21.22/CSA 4.4. Include one or more relief valve with total relieving capacity at least as great as heat input, and include pressure setting less than water heater working-pressure rating. Select one relief valve with sensing element that extends into storage tank.
  - 3. Special Requirements: NSF 5 construction.
  - 4. Power-Vent System: Exhaust fan, interlocked with burner. Vents and combustion air shall be through Schedule 40 PVC or CPVC from outside to the connections at the heater. Provide concentric roof type intake/exhaust termination fitting.
  - 5. Energy Management System Interface: Normally closed dry contacts for enabling and disabling water heater.
  - 6. Capacity and Characteristics: See schedule on the Drawings.

## 2.4 COMPRESSION TANKS

- A. Description: Steel, pressure-rated tanks constructed with welded joints and factory-installed, butyl-rubber diaphragm. Include air precharge to minimum system-operating pressure at tank.
- B. Construction: 100-psig working-pressure rating.
- C. Interior Finish: Materials that comply with requirements of applicable NSF, AWWA, or FDA and EPA regulatory standards for tasteless and odorless, potable-water-tank linings.
- D. Accessories: Include air-charging valve and pressure gage.
- E. Compression tank to be sized by equipment supplier and in accordance with all applicable code.

## PART 3 - EXECUTION

### 3.1 CONCRETE BASES

- A. Install concrete bases of dimensions indicated for water heaters and accessories. Refer to Division 3 Section "Cast-in-Place Concrete" and Division 15 Section "Basic Mechanical Materials and Methods."

### 3.2 WATER HEATER INSTALLATION

- A. General: Install water heaters on concrete bases. Set and connect units according to manufacturer's written instructions. Install units plumb, level, and firmly anchored in locations indicated. Maintain manufacturer's recommended clearances. Install so controls and devices are accessible for service.
- B. Anchor water heaters and storage tanks to substrate.
- C. Install temperature and pressure relief valves in top portion of storage water heater tanks and hot-water storage tanks. Use relief valves with sensing elements that extend into tanks. Extend relief valve outlet with water piping in continuous downward pitch and discharge to closest floor drain.
- D. Install pressure relief valves in hot-water-outlet piping for water heaters without storage. Extend relief valve outlet with water piping in continuous downward pitch and discharge to closest floor drain.
- E. Install vacuum relief valves in cold-water-inlet piping.
- F. Install vacuum relief valves in water heaters and hot-water storage tanks that have copper lining.
- G. Install water heater drain piping as indirect waste to spill into open drains or over floor drains. Install hose-end drain valves at low points in water piping for water heaters that do not have tank drains. Refer to Division 15 Section "Plumbing Specialties" for drain valves.

- H. Install thermometers on water heater inlet and outlet piping. Thermometers are specified in Division 15 Section "Meters and Gages."
- I. Install piping adjacent to water heaters to allow service and maintenance.
- J. Arrange for field-applied insulation on equipment and piping not furnished with factory-applied insulation.
- K. Install PVC/CPVC intake and vents through wall per manufacturer's instructions. Provide roof flashing for vent terminations per roofing manufacturer's instructions.

### 3.3 CONNECTIONS

- A. Piping installation requirements are specified in other Division 15 Sections. Drawings indicate general arrangement of piping, fittings, and specialties. The following are specific connection requirements:
  - 1. Connect hot- and cold-water piping to units with shutoff valves and unions. Connect hot-water circulating piping to unit with shutoff valve, check valve, and union.
  - 2. Make connections with dielectric fittings where piping is made of dissimilar metals. Dielectric fittings are specified in Division 15 Section "Basic Mechanical Materials and Methods."
- B. Electrical Connections: Power wiring and disconnect switches are specified in Division 24 Sections. Arrange wiring to allow unit servicing.
- C. Grounding: Ground equipment. Tighten electrical connectors and terminals, including grounding connections, according to manufacturer's published torque-tightening values. Where manufacturer's torque values are not indicated, use those specified in UL 486A and UL 486B.
- D. Connect PVC/CPVC intake and vent piping to heater and at wall terminations per manufacturer's instructions.
- E. Vent and Outside-Air Connection: Connect plastic piping vent material to furnace connections and extend outdoors. Terminate vent outdoors with a cap and in an arrangement that will protect against entry of birds, insects, and dirt.
  - 1. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.
  - 2. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.
  - 3. Plastic Piping Solvent-Cement Joints: Clean and dry joining surfaces. Join pipe and fittings according to the following:
    - a. Comply with ASTM F 402 for safe-handling practice of cleaners, primers, and solvent cements.
    - b. CPVC Piping: Join according to ASTM D 2846/D 2846M Appendix.
    - c. PVC Pressure Piping: Join schedule number ASTM D 1785, PVC pipe and PVC socket fittings according to ASTM D 2672. Join other-than-scheduled-number PVC pipe and socket fittings according to ASTM D 2855.
  - 4. Slope pipe vent back to heater or to outside terminal.

### 3.4 COMMISSIONING

- A. Startup Services: Engage a factory-authorized service representative to provide startup service and to demonstrate and train Owner's maintenance personnel as specified below.
  - 1. Test and adjust operating and safety controls. Replace damaged and malfunctioning controls and equipment.
  - 2. Train Owner's maintenance personnel on procedures and schedules related to startup and shutdown, troubleshooting, servicing, and preventive maintenance.
  - 3. Review data in the operation and maintenance manuals. Refer to Division 1 Section "Contract Closeout."
  - 4. Review data in the operation and maintenance manuals. Refer to Division 1 Section "Operation and Maintenance Data."
  - 5. Schedule training with Owner with at least 7 days' advance notice.
  
- B. Perform the following final checks before startup:
  - 1. Fill water heaters with water.
  - 2. Charge compression tanks with air.
  - 3. Check that piping system tests are complete.
  - 4. Check for piping connection leaks.
  - 5. Check for clear vents and devices.
  - 6. Check for clear relief valve inlets, outlets, and drain piping.
  - 7. Check operation of pumps and circulators.
  - 8. Test operation of safety controls, relief valves, and devices.
  
- C. Perform the following startup procedures:
  - 1. Energize electric circuits.
  - 2. Adjust operating controls.
  - 3. Adjust hot-water-outlet temperature settings.

END OF SECTION 233400



## SECTION 224000 - PLUMBING FIXTURES

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes the following conventional plumbing fixtures and related components:
  - 1. Faucets for lavatories and showers.
  - 2. Flushometers.
  - 3. Toilet seats.
  - 4. Protective shielding guards.
  - 5. Fixture supports.
  - 6. Water closets.
  - 7. Urinals.
  - 8. Lavatories.
- B. Related Sections include the following:
  - 1. Division 10 Section "Toilet, Bath, and Laundry Accessories."
  - 2. Division 22 Section "Domestic Water Piping Specialties" for backflow preventers, floor drains, and specialty fixtures not included in this Section.

#### 1.3 DEFINITIONS

- A. ABS: Acrylonitrile-butadiene-styrene plastic.
- B. Accessible Fixture: Plumbing fixture that can be approached, entered, and used by people with disabilities.
- C. Cast Polymer: Cast-filled-polymer-plastic material. This material includes cultured-marble and solid-surface materials.
- D. Fitting: Device that controls the flow of water into or out of the plumbing fixture. Fittings specified in this Section include supplies and stops, faucets and spouts, shower heads and tub spouts, drains and tailpieces, and traps and waste pipes. Piping and general-duty valves are included where indicated.
- E. FRP: Fiberglass-reinforced plastic.
- F. PMMA: Polymethyl methacrylate (acrylic) plastic.
- G. PVC: Polyvinyl chloride plastic.

#### 1.4 SUBMITTALS

- A. Product Data: For each type of plumbing fixture indicated. Include selected fixture and trim, fittings, accessories, appliances, appurtenances, equipment, and supports. Indicate materials and finishes, dimensions, construction details, and flow-control rates.
- B. Shop Drawings: Diagram power, signal, and control wiring.
- C. Operation and Maintenance Data: For plumbing fixtures to include operation and maintenance manuals.
- D. Warranty: Special warranty specified in this Section.

#### 1.5 QUALITY ASSURANCE

- A. Source Limitations: Obtain plumbing fixtures, faucets, and other components of each category through one source from a single manufacturer.
  - 1. Exception: If fixtures, faucets, or other components are not available from a single manufacturer, obtain similar products from other manufacturers specified for that category.
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- C. Regulatory Requirements: Comply with requirements in ICC A117.1, "Accessible and Usable Buildings and Facilities"; Public Law 90-480, "Architectural Barriers Act"; and Public Law 101-336, "Americans with Disabilities Act"; for plumbing fixtures for people with disabilities.
- D. Regulatory Requirements: Comply with requirements in Public Law 102-486, "Energy Policy Act," about water flow and consumption rates for plumbing fixtures.
- E. NSF Standard: Comply with NSF 61, "Drinking Water System Components--Health Effects," for fixture materials that will be in contact with potable water.
- F. Select combinations of fixtures and trim, faucets, fittings, and other components that are compatible.
- G. Comply with the following applicable standards and other requirements specified for plumbing fixtures:
  - 1. Enameled, Cast-Iron Fixtures: ASME A112.19.1M.
  - 2. Vitreous-China Fixtures: ASME A112.19.2M.
  - 3. Water-Closet, Flush Valve, Tank Trim: ASME A112.19.5.
- H. Comply with the following applicable standards and other requirements specified for lavatory and sink faucets:
  - 1. Faucets: ASME A112.18.1.
  - 2. Pipe Threads: ASME B1.20.1.
  - 3. Supply Fittings: ASME A112.18.1.

4. Brass Waste Fittings: ASME A112.18.2.

I. Comply with the following applicable standards and other requirements specified for shower faucets:

1. Combination, Pressure-Equalizing and Thermostatic-Control Antiscald Faucets: ASSE 1016.
2. Faucets: ASME A112.18.1.
3. High-Temperature-Limit Controls for Thermal-Shock-Preventing Devices: ASTM F 445.
4. Manual-Control Antiscald Faucets: ASTM F 444.
5. Pipe Threads: ASME B1.20.1.
6. Pressure-Equalizing-Control Antiscald Faucets: ASTM F 444 and ASSE 1016.
7. Thermostatic-Control Antiscald Faucets: ASTM F 444 and ASSE 1016.

J. Comply with the following applicable standards and other requirements specified for miscellaneous fittings:

1. Brass and Copper Supplies: ASME A112.18.1.
2. Plastic Tubular Fittings: ASTM F 409.
3. Brass Waste Fittings: ASME A112.18.2.
4. Sensor-Operation Flushometers: ASSE 1037 and UL 1951.

K. Comply with the following applicable standards and other requirements specified for miscellaneous components:

1. Flexible Water Connectors: ASME A112.18.6.
2. Floor Drains: ASME A112.6.3.
3. Hose-Coupling Threads: ASME B1.20.7.
4. Off-Floor Fixture Supports: ASME A112.6.1M.
5. Pipe Threads: ASME B1.20.1.
6. Plastic Toilet Seats: ANSI Z124.5.
7. Supply and Drain Protective Shielding Guards: ICC A117.1.

## 1.6 WARRANTY

A. Special Warranties: Manufacturer's standard form in which manufacturer agrees to repair or replace components of whirlpools that fail in materials or workmanship within specified warranty period.

1. Failures include, but are not limited to, the following:
  - a. Structural failures of unit shell.
  - b. Faulty operation of controls, blowers, pumps, heaters, and timers.
  - c. Deterioration of metals, metal finishes, and other materials beyond normal use.
2. Warranty Period for Commercial Applications: Three years from date of Substantial Completion.

## 1.7 EXTRA MATERIALS

- A. Furnish extra materials described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
  - 1. Faucet Washers and O-Rings: Equal to 10 percent of amount, but no fewer than 2, of each type and size installed.
  - 2. Faucet Cartridges and O-Rings: Equal to 5 percent of amount, but no fewer than 2, of each type and size installed.
  - 3. Flushometer Valve, Repair Kits: Equal to 10 percent of amount of each type installed, but no fewer than 2 of each type.
  - 4. Provide hinged-top wood or metal box, or individual metal boxes, with separate compartments for each type and size of extra materials listed above.

## PART 2 - PRODUCTS

### 2.1 FAUCETS

- A. Lavatory Faucets:
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Chicago Faucets.
    - b. Kohler Co.
    - c. T&S Brass
    - d. American Standard
    - e. Pre-approved equal.
  - 2. See Schedule on Drawings.
- B. Shower Faucet Panels:
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Acorn.
    - b. Speakman.
    - c. Zurn.
    - d. Symmons.
    - e. Pre-approved equal.
  - 2. See Schedule on Drawings.

### 2.2 FLUSHOMETERS

- A. Flushometers: Manually operated.
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Sloan Valve Company.

- b. Toto.
  - a. Zurn.
  - b. Pre-approved equal.
- 2. Description: Flushometer for urinal or water-closet-type fixture. Include brass body with corrosion-resistant internal components, non-hold-open feature, control stop with check valve, vacuum breaker, copper or brass tubing, and polished chrome-plated finish on exposed parts.
  - a. Internal Design: Diaphragm operation.
  - b. Style: Exposed.
  - c. Inlet Size: NPS 1 or NPS 1-1/4.
  - d. Trip Mechanism: Oscillating, lever-handle actuator.
- 3. See Schedule on Drawings.

## 2.3 TOILET SEATS

### A. Toilet Seats:

- 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Bemis Manufacturing Company.
  - b. Church Seats.
  - c. Eljer.
  - d. Kohler Co.
  - e. Olsonite Corp.
  - f. Pre-approved equal.
- 2. Description: Toilet seat for water-closet-type fixture shall incorporate the following unless indicated otherwise:
  - a. Material: Molded, solid plastic with antimicrobial agent.
  - b. Configuration: Open front without cover.
  - c. Size: Elongated.
  - d. Hinge Type: SS, self-sustaining, check.
  - e. Class: Heavy-duty commercial.
  - f. Color: White.

## 2.4 PROTECTIVE SHIELDING GUARDS

### A. Protective Shielding Pipe Covers: Where indicated or scheduled.

- 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Insul-Tect Products Co.
  - b. McGuire Manufacturing Co., Inc.
  - c. Plumberex Specialty Products Inc.
  - d. TRUEBRO, Inc.
  - e. Zurn Plumbing Products Group.

- f. Pre-approved equal.
- 2. Description: Manufactured PVC plastic pipe covers over pipe insulation or insulation wraps for covering plumbing fixture hot-water supply and trap and drain piping. Comply with Americans with Disabilities Act (ADA) requirements.

## 2.5 FIXTURE SUPPORTS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Josam Company.
  - 2. Jay R. Smith.
  - 3. Wade.
  - 4. Watts.
  - 5. Zurn.
  - 6. Pre-approved equal.
- B. Water-Closet Supports:
  - 1. Description: Combination carrier designed for accessible or standard mounting height of wall-mounted, water-closet-type fixture. Include single or double, vertical or horizontal, hub-and-spigot or hubless waste fitting as required for piping arrangement; 4" waste and 2" vent; faceplates; couplings with gaskets; feet; and fixture bolts and hardware matching fixture. Include additional extension coupling, faceplate, and feet for installation in wide pipe space.
    - a. Wade 310 Series.
- C. Urinal Supports:
  - 1. Description: Type II, urinal carrier with hanger and bearing plates for wall-mounting, urinal-type fixture. Include steel uprights with feet.
    - a. Wade 400-AM11.
  - 2. Accessible-Fixture Support: Include rectangular steel uprights.
    - a. Wade 400-AM11-M36.
- D. Wall-Hung Lavatory Supports:
  - 1. Description: Type II, lavatory carrier with concealed arms and tie rod for wall-mounting, lavatory-type fixture. Include steel uprights with feet.
    - a. Wade 520.
  - 2. Accessible-Fixture Support: Include rectangular steel uprights with feet.
    - a. Wade 520-M36.

## 2.6 WATER CLOSETS

### A. Water Closets:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. American Standard.
  - b. Kohler Co.
  - c. TOTO USA, Inc.
  - d. Zurn.
  - e. Pre-approved equal.
2. See Schedule on Drawings.

## 2.7 URINALS

### A. Urinals:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. American Standard.
  - b. Kohler Co.
  - c. TOTO USA, Inc.
  - d. Zurn.
  - e. Pre-approved equal.
2. See Schedule on Drawings.

## 2.8 LAVATORIES

### A. Lavatories:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. American Standard.
  - b. Kohler Co.
  - c. TOTO USA, Inc.
  - d. Zurn.
  - e. Pre-approved equal.
2. See Schedule on Drawings.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine roughing-in of water supply and sanitary drainage and vent piping systems to verify actual locations of piping connections before plumbing fixture installation.

- B. Examine cabinets, counters, floors, and walls for suitable conditions where fixtures will be installed.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 INSTALLATION

- A. Assemble plumbing fixtures, trim, fittings, and other components according to manufacturers' written instructions.
- B. Install off-floor supports, affixed to building substrate, for wall-mounting fixtures.
  - 1. Use carrier supports with waste fitting and seal for back-outlet fixtures.
  - 2. Use carrier supports without waste fitting for fixtures with tubular waste piping.
  - 3. Use chair-type carrier supports with rectangular steel uprights for accessible fixtures.
- C. Install back-outlet, wall-mounting fixtures onto waste fitting seals and attach to supports.
- D. Install floor-mounting fixtures on closet flanges or other attachments to piping or building substrate.
- E. Install wall-mounted fixtures with tubular waste piping attached to supports.
- F. Install fixtures level and plumb according to roughing-in drawings.
- G. Install water-supply piping with stop on each supply to each fixture to be connected to water distribution piping. Attach supplies to supports or substrate within pipe spaces behind fixtures. Install stops in locations where they can be easily reached for operation.
  - 1. Exception: Use ball valves if supply stops are not specified with fixture. Valves are specified in Division 22 Section "General-Duty Valves for Plumbing Piping."
- H. Install trap and tubular waste piping on drain outlet of each fixture to be directly connected to sanitary drainage system.
- I. Install tubular waste piping on drain outlet of each fixture to be indirectly connected to drainage system.
- J. Install flushometer valves for accessible water closets and urinals with handle mounted on wide side of compartment. Install other actuators in locations that are easy for people with disabilities to reach.
- K. Install toilet seats on water closets.
- L. Install trap-seal liquid in dry urinals.
- M. Install faucet-spout fittings with specified flow rates and patterns in faucet spouts if faucets are not available with required rates and patterns. Include adapters if required.
- N. Install water-supply flow-control fittings with specified flow rates in fixture supplies at stop valves.
- O. Install faucet flow-control fittings with specified flow rates and patterns in faucet spouts if faucets are not available with required rates and patterns. Include adapters if required.



- P. Install shower flow-control fittings with specified maximum flow rates in shower arms.
- Q. Install traps on fixture outlets.
  - 1. Exception: Omit trap on fixtures with integral traps.
  - 2. Exception: Omit trap on indirect wastes, unless otherwise indicated.
- R. Install escutcheons at piping wall ceiling penetrations in exposed, finished locations and within cabinets and millwork. Use deep-pattern escutcheons if required to conceal protruding fittings. Escutcheons shall be chrome plated.
- S. Seal joints between fixtures and walls, floors, and countertops using sanitary-type, one-part, mildew-resistant silicone sealant. Match sealant color to fixture color.

### 3.3 CONNECTIONS

- A. Piping installation requirements are specified in other Division 22 Sections. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Connect fixtures with water supplies, stops, and risers, and with traps, soil, waste, and vent piping. Use size fittings required to match fixtures.
- C. Ground equipment according to Division 26 Section "Grounding and Bonding for Electrical Systems."
- D. Connect wiring according to Division 26 Section "Low-Voltage Electrical Power Conductors and Cables."

### 3.4 FIELD QUALITY CONTROL

- A. Verify that installed plumbing fixtures are categories and types specified for locations where installed.
- B. Check that plumbing fixtures are complete with trim, faucets, fittings, and other specified components.
- C. Inspect installed plumbing fixtures for damage. Replace damaged fixtures and components.
- D. Test installed fixtures after water systems are pressurized for proper operation. Replace malfunctioning fixtures and components, then retest. Repeat procedure until units operate properly.
- E. Install fresh batteries in sensor-operated mechanisms.

### 3.5 ADJUSTING

- A. Operate and adjust faucets and controls. Replace damaged and malfunctioning fixtures, fittings, and controls.
- B. Operate and adjust disposers and controls. Replace damaged and malfunctioning units and controls.

- C. Adjust water pressure at faucets and flushometer valves to produce proper flow and stream.
- D. Replace washers and seals of leaking and dripping faucets and stops.
- E. Install fresh batteries in sensor-operated mechanisms.

### 3.6 CLEANING

- A. Clean fixtures, faucets, and other fittings with manufacturers' recommended cleaning methods and materials. Do the following:
  - 1. Remove faucet spouts and strainers, remove sediment and debris, and reinstall strainers and spouts.
  - 2. Remove sediment and debris from drains.
- B. After completing installation of exposed, factory-finished fixtures, faucets, and fittings, inspect exposed finishes and repair damaged finishes.

### 3.7 PROTECTION

- A. Provide protective covering for installed fixtures and fittings.
- B. Do not allow use of plumbing fixtures for temporary facilities unless approved in writing by Owner.

END OF SECTION 224000

## SECTION 224700 - DRINKING FOUNTAINS/WATER COOLERS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes the following drinking fountains/water coolers and related components:
  - 1. Pressure water coolers.
  - 2. Fixture supports.

#### 1.3 DEFINITIONS

- A. Accessible Drinking Fountain/Water Cooler: Fixture that can be approached and used by people with disabilities.
- B. Cast Polymer: Dense, cast-filled-polymer plastic.
- C. Drinking Fountain: Fixture with nozzle for delivering stream of water for drinking.
- D. Fitting: Device that controls flow of water into or out of fixture.
- E. Fixture: Drinking fountain or water cooler unless one is specifically indicated.
- F. Water Cooler: Electrically powered fixture for generating and delivering cooled drinking water.

#### 1.4 SUBMITTALS

- A. Product Data: For each fixture indicated. Include rated capacities, furnished specialties, and accessories.
- B. Shop Drawings: Diagram power, signal, and control wiring.
- C. Field quality-control test reports.
- D. Operation and Maintenance Data: For fixtures to include in emergency, operation, and maintenance manuals.

#### 1.5 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.

- B. Regulatory Requirements: Comply with requirements in ICC A117.1, "Accessible and Usable Buildings and Facilities"; Public Law 90-480, "Architectural Barriers Act;" and Public Law 101-336, "Americans with Disabilities Act;" for fixtures for people with disabilities.
- C. NSF Standard: Comply with NSF 61, "Drinking Water System Components--Health Effects," for fixture materials that will be in contact with potable water.
- D. ARI Standard: Comply with ARI's "Directory of Certified Drinking Water Coolers" for style classifications.
- E. ARI Standard: Comply with ARI 1010, "Self-Contained, Mechanically Refrigerated Drinking-Water Coolers," for water coolers and with ARI's "Directory of Certified Drinking Water Coolers" for type and style classifications.
- F. ASHRAE Standard: Comply with ASHRAE 34, "Designation and Safety Classification of Refrigerants," for water coolers. Provide HFC 134a (tetrafluoroethane) refrigerant, unless otherwise indicated.

## 1.6 EXTRA MATERIALS

- A. Furnish extra materials described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
  - 1. Filter Cartridges: Equal to ten percent of amount installed for each type and size indicated, but no fewer than ten of each.

## PART 2 - PRODUCTS

### 2.1 PRESSURE WATER COOLERS

- A. Water Coolers:
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Elkay Manufacturing Co.
    - b. Halsey Taylor.
    - c. Oasis.
  - 2. Description: ARI 1010, Type PB, pressure with bubbler, Style RE, recessed water cooler.
    - a. Cabinet: All stainless steel.
    - b. Bubbler: One, with adjustable stream regulator, located on deck for each of two bowls.
    - c. Control: Push button or bar.
    - d. Supply: NPS 3/8 with ball, gate, or globe valve.
    - e. Filter: One or more water filters complying with NSF 42 and NSF 53 for cyst and lead reduction to below EPA standards; with capacity sized for unit peak flow rate.
    - f. Drain: Grid with NPS 1-1/4 minimum horizontal waste and trap complying with ASME A112.18.2.

- g. Cooling System: Electric, with hermetically sealed compressor, cooling coil, air-cooled condensing unit, corrosion-resistant tubing, refrigerant, corrosion-resistant-metal storage tank, and adjustable thermostat.
    - 1) Capacity: 8 gph of 50 deg F cooled water from 80 deg F inlet water and 90 deg F ambient air temperature.
  - h. Ventilation Grille: Stainless steel, located below fountain.
  - i. Support: Mounting frame for attaching to substrate.
3. See Schedule on Drawings.

## 2.2 FIXTURE SUPPORTS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Josam Co.
  - 2. MIFAB Manufacturing, Inc.
  - 3. Smith, Jay R. Mfg. Co.
  - 4. Tyler Pipe; Wade Div.
  - 5. Watts Drainage Products Inc.; a div. of Watts Industries, Inc.
  - 6. Zurn Plumbing Products Group; Specification Drainage Operation.
  - 7. Pre-approved equal.
- B. Description: ASME A112.6.1M, water cooler carriers. Include vertical, steel uprights with feet and tie rods and bearing plates with mounting studs matching fixture to be supported.
  - 1. Type I: Hanger-type carrier with two vertical uprights.
  - 2. Type II: Bilevel, hanger-type carrier with three vertical uprights.
  - 3. Supports for Accessible Fixtures: Include rectangular, vertical, steel uprights instead of steel pipe uprights.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine roughing-in for water and waste piping systems to verify actual locations of piping connections before fixture installation. Verify that sizes and locations of piping and types of supports match those indicated.
- B. Examine walls and floors for suitable conditions where fixtures are to be installed.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 APPLICATIONS

- A. Use carrier off-floor supports for wall-mounting fixtures, unless otherwise indicated.
- B. Use chrome-plated brass or copper tube, fittings, and valves in locations exposed to view. Plain copper tube, fittings, and valves may be used in concealed locations.

### 3.3 INSTALLATION

- A. Install off-floor supports affixed to building substrate and attach wall-mounting fixtures, unless otherwise indicated.
- B. Install mounting frames affixed to building construction and attach recessed water coolers to mounting frames, unless otherwise indicated.
- C. Install fixtures level and plumb. For fixtures indicated for children, install at height required by authorities having jurisdiction.
- D. Install water-supply piping with shutoff valve on supply to each fixture to be connected to water distribution piping. Use ball, gate, or globe valve. Install valves in locations where they can be easily reached for operation. Valves are specified in Division 22 Section "General-Duty Valves for Plumbing Piping."
- E. Install trap and waste piping on drain outlet of each fixture to be connected to sanitary drainage system.
- F. Install pipe escutcheons at wall penetrations in exposed, finished locations. Use deep-pattern escutcheons where required to conceal protruding pipe fittings. Escutcheons are specified in Division 22 Section "Common Work Results for Plumbing."
- G. Seal joints between fixtures and walls and floors using sanitary-type, one-part, mildew-resistant, silicone sealant. Match sealant color to fixture color. Sealants are specified in Division 07 Section "Joint Sealants."

### 3.4 CONNECTIONS

- A. Piping installation requirements are specified in other Division 22 Sections. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Connect fixtures with water supplies, stops, and risers, and with traps, soil, waste, and vent piping. Use size fittings required to match fixtures.
- C. Ground equipment according to Division 26 Section "Grounding and Bonding for Electrical Systems."
- D. Connect wiring according to Division 26 Section "Low-Voltage Electrical Power Conductors and Cables."

### 3.5 FIELD QUALITY CONTROL

- A. Water Cooler Testing: After electrical circuitry has been energized, test for compliance with requirements. Test and adjust controls and safeties.
  - 1. Remove and replace malfunctioning units and retest as specified above.
  - 2. Report test results in writing.

### 3.6 ADJUSTING

- A. Adjust fixture flow regulators for proper flow and stream height.

- B. Adjust water cooler temperature settings.

### 3.7 CLEANING

- A. After completing fixture installation, inspect unit. Remove paint splatters and other spots, dirt, and debris. Repair damaged finish to match original finish.
- B. Clean fixtures, on completion of installation, according to manufacturer's written instructions.

END OF SECTION 224700

## SECTION 230500 - COMMON WORK RESULTS FOR HVAC

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes the following:
  - 1. Coordination procedures.
  - 2. Piping materials and installation instructions common to most piping systems.
  - 3. Dielectric fittings.
  - 4. Sleeves.
  - 5. Escutcheons.
  - 6. Equipment installation requirements common to equipment sections.
  - 7. Painting and finishing.
  - 8. Supports and anchorages.

#### 1.3 DEFINITIONS

- A. Finished Spaces: Spaces other than mechanical and electrical equipment rooms, furred spaces, pipe and duct chases, unheated spaces immediately below roof, spaces above ceilings, unexcavated spaces, crawlspaces, and tunnels.
- B. Exposed, Interior Installations: Exposed to view indoors. Examples include finished occupied spaces and mechanical equipment rooms.
- C. Exposed, Exterior Installations: Exposed to view outdoors or subject to outdoor ambient temperatures and weather conditions. Examples include rooftop locations.
- D. Concealed, Interior Installations: Concealed from view and protected from physical contact by building occupants. Examples include above ceilings and chases.
- E. Concealed, Exterior Installations: Concealed from view and protected from weather conditions and physical contact by building occupants but subject to outdoor ambient temperatures. Examples include installations within unheated shelters.
- F. The following are industry abbreviations for rubber materials:
  - 1. EPDM: Ethylene-propylene-diene terpolymer rubber.
  - 2. NBR: Acrylonitrile-butadiene rubber.

#### 1.4 SUBMITTALS

- A. Product Data: For the following:



1. Transition fittings.
2. Dielectric fittings.
3. Mechanical sleeve seals.
4. Escutcheons.

B. Welding certificates.

## 1.5 QUALITY ASSURANCE

- A. Steel Support Welding: Qualify processes and operators according to AWS D1.1, "Structural Welding Code--Steel."
- B. Steel Pipe Welding: Qualify processes and operators according to ASME Boiler and Pressure Vessel Code: Section IX, "Welding and Brazing Qualifications."
  1. Comply with provisions in ASME B31 Series, "Code for Pressure Piping."
  2. Certify that each welder has passed AWS qualification tests for welding processes involved and that certification is current.
- C. Electrical Characteristics for HVAC Equipment: Equipment of higher electrical characteristics may be furnished provided such proposed equipment is approved in writing and connecting electrical services, circuit breakers, and conduit sizes are appropriately modified. If minimum energy ratings or efficiencies are specified, equipment shall comply with requirements.

## 1.6 DELIVERY, STORAGE, AND HANDLING

- A. Deliver pipes and tubes with factory-applied end caps. Maintain end caps through shipping, storage, and handling to prevent pipe end damage and to prevent entrance of dirt, debris, and moisture.
- B. Store plastic pipes protected from direct sunlight. Support to prevent sagging and bending.

## 1.7 COORDINATION

- A. Arrange for pipe spaces, chases, slots, and openings in building structure during progress of construction, to allow for HVAC installations.
- B. Coordinate installation of required supporting devices and set sleeves in poured-in-place concrete and other structural components as they are constructed.
- C. Coordinate requirements for access panels and doors for HVAC items requiring access that are concealed behind finished surfaces. Access panels and doors are specified in Division 08 Section "Access Doors and Frames."

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. In other Part 2 articles where subparagraph titles below introduce lists, the following requirements apply for product selection:

1. Manufacturers: Subject to compliance with requirements, provide products by the manufacturers specified.

## 2.2 PIPE, TUBE, AND FITTINGS

- A. Refer to individual Division 23 piping Sections for pipe, tube, and fitting materials and joining methods.
- B. Pipe Threads: ASME B1.20.1 for factory-threaded pipe and pipe fittings.

## 2.3 JOINING MATERIALS

- A. Refer to individual Division 23 piping Sections for special joining materials not listed below.
- B. Pipe-Flange Gasket Materials: Suitable for chemical and thermal conditions of piping system contents.
  1. ASME B16.21, nonmetallic, flat, asbestos-free, 1/8-inch maximum thickness unless thickness or specific material is indicated.
    - a. Full-Face Type: For flat-face, Class 125, cast-iron and cast-bronze flanges.
    - b. Narrow-Face Type: For raised-face, Class 250, cast-iron and steel flanges.
  2. AWWA C110, rubber, flat face, 1/8 inch thick, unless otherwise indicated; and full-face or ring type, unless otherwise indicated.
- C. Flange Bolts and Nuts: ASME B18.2.1, carbon steel, unless otherwise indicated.
- D. Plastic, Pipe-Flange Gasket, Bolts, and Nuts: Type and material recommended by piping system manufacturer, unless otherwise indicated.
- E. Welding Filler Metals: Comply with AWS D10.12 for welding materials appropriate for wall thickness and chemical analysis of steel pipe being welded.

## 2.4 DIELECTRIC FITTINGS

- A. Description: Combination fitting of copper alloy and ferrous materials with threaded, solder-joint, plain, or weld-neck end connections that match piping system materials.
- B. Insulating Material: Suitable for system fluid, pressure, and temperature.
- C. Dielectric Unions: Factory-fabricated, union assembly, for 250-psig minimum working pressure at 180 deg F
  1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Capitol Manufacturing Co.
    - b. Central Plastics Company.
    - c. Eclipse, Inc.
    - d. Epcos Sales, Inc.
    - e. Hart Industries, International, Inc.

- f. Watts Industries, Inc.; Water Products Div.
  - g. Zurn Industries, Inc.; Wilkins Div.
  - h. Pre-approved equal.
- D. Dielectric Flanges: Factory-fabricated, companion-flange assembly, for 150 or 300-psig minimum working pressure as required to suit system pressures.
- 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Capitol Manufacturing Co.
    - b. Central Plastics Company.
    - c. Epcos Sales, Inc.
    - d. Watts Industries, Inc.; Water Products Div.
    - e. Pre-approved equal.
- E. Dielectric-Flange Kits: Companion-flange assembly for field assembly. Include flanges, full-face- or ring-type neoprene or phenolic gasket, phenolic or polyethylene bolt sleeves, phenolic washers, and steel backing washers.
- 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Advance Products & Systems, Inc.
    - b. Calpico, Inc.
    - c. Central Plastics Company.
    - d. Pipeline Seal and Insulator, Inc.
    - e. Pre-approved equal.
  - 2. Separate companion flanges and steel bolts and nuts shall have 150 or 300-psig minimum working pressure where required to suit system pressures.

## 2.5 SLEEVES

- A. Galvanized-Steel Sheet: 0.0239-inch minimum thickness; round tube closed with welded longitudinal joint.
- B. Steel Pipe: ASTM A 53, Type E, Grade B, Schedule 40, galvanized, plain ends.
- C. Cast Iron: Cast or fabricated "wall pipe" equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop, unless otherwise indicated.

## 2.6 ESCUTCHEONS

- A. Description: Manufactured wall and ceiling escutcheons and floor plates, with an ID to closely fit around pipe, tube, and insulation of insulated piping and an OD that completely covers opening.
- B. One-Piece, Deep-Pattern Type: Deep-drawn, box-shaped brass with polished chrome-plated finish.
- C. One-Piece, Cast-Brass Type: With set screw.

- 1. Finish: Polished chrome-plated
- D. Split-Casting, Cast-Brass Type: With concealed hinge and set screw.
  - 1. Finish: Polished chrome-plated
- E. One-Piece, Stamped-Steel Type: With set screw or spring clips and chrome-plated finish.
- F. Split-Plate, Stamped-Steel Type: With set screw or spring clips, and chrome-plated finish.
- G. One-Piece, Floor-Plate Type: Cast-iron floor plate.
- H. Split-Casting, Floor-Plate Type: Cast brass with concealed hinge and set screw.

## PART 3 - EXECUTION

### 3.1 PIPING SYSTEMS - COMMON REQUIREMENTS

- A. Install piping according to the following requirements and Division 23 Sections specifying piping systems.
- B. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems. Indicated locations and arrangements were used to size pipe and calculate friction loss, expansion, pump sizing, and other design considerations. Install piping as indicated unless deviations to layout are approved on Coordination Drawings.
- C. Install piping in concealed locations, unless otherwise indicated and except in equipment rooms and service areas.
- D. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- E. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal.
- F. Install piping to permit valve servicing.
- G. Install piping at indicated slopes.
- H. Install piping free of sags and bends.
- I. Install fittings for changes in direction and branch connections.
- J. Install piping to allow application of insulation.
- K. Select system components with pressure rating equal to or greater than system operating pressure.
- L. Install escutcheons for penetrations of walls, ceilings, and floors according to the following:
  - 1. New Piping:
    - a. Piping with Fitting or Sleeve Protruding from Wall: One-piece, deep-pattern type.

- b. Chrome-Plated Piping: One-piece, cast-brass type with polished chrome-plated finish.
  - c. Insulated Piping: One-piece, stamped-steel type with spring clips.
  - d. Bare Piping at Wall and Floor Penetrations in Finished Spaces: One-piece, cast-brass type with polished chrome-plated finish.
  - e. Bare Piping at Wall and Floor Penetrations in Finished Spaces: One-piece, stamped-steel type.
  - f. Bare Piping at Ceiling Penetrations in Finished Spaces: One-piece or split-casting, cast-brass type with polished chrome-plated finish.
  - g. Bare Piping at Ceiling Penetrations in Finished Spaces: One-piece, stamped-steel type or split-plate, stamped-steel type with concealed hinge and set screw.
  - h. Bare Piping in Unfinished Service Spaces: One-piece, cast-brass type with polished chrome-plated finish.
  - i. Bare Piping in Unfinished Service Spaces: One-piece, stamped-steel type with concealed or exposed-rivet hinge and screw or spring clips
  - j. Bare Piping in Equipment Rooms: One-piece, cast-brass type.
  - k. Bare Piping in Equipment Rooms: One-piece, stamped-steel type with set screw or spring clips.
  - l. Bare Piping at Floor Penetrations in Equipment Rooms: One-piece, floor-plate type.
- M. Sleeves are not required for core-drilled holes.
- N. Install sleeves for pipes passing through concrete and masonry walls and concrete floor and roof slabs.
- O. Install sleeves for pipes passing through concrete and masonry walls, gypsum-board partitions, and concrete floor and roof slabs.
1. Cut sleeves to length for mounting flush with both surfaces.
    - a. Exception: Extend sleeves installed in floors of mechanical equipment areas or other wet areas 2 inches above finished floor level. Extend cast-iron sleeve fittings below floor slab as required to secure clamping ring if ring is specified.
  2. Install sleeves in new walls and slabs as new walls and slabs are constructed.
  3. Install sleeves that are large enough to provide 1/4-inch annular clear space between sleeve and pipe or pipe insulation. Use the following sleeve materials:
    - a. Steel Pipe Sleeves: For pipes smaller than NPS 6
    - b. Steel Sheet Sleeves: For pipes NPS 6 and larger, penetrating gypsum-board partitions.
    - c. Stack Sleeve Fittings: For pipes penetrating floors with membrane waterproofing. Secure flashing between clamping flanges. Install section of cast-iron soil pipe to extend sleeve to 2 inches above finished floor level. Refer to Division 07 Section "Sheet Metal Flashing and Trim" for flashing.
      - 1) Seal space outside of sleeve fittings with grout.
  4. Except for underground wall penetrations, seal annular space between sleeve and pipe or pipe insulation, using joint sealants appropriate for size, depth, and location of joint. Refer to Division 07 Section "Joint Sealants" for materials and installation.

- P. Aboveground, Exterior-Wall Pipe Penetrations: Seal penetrations using sleeves and mechanical sleeve seals. Select sleeve size to allow for 1-inch annular clear space between pipe and sleeve for installing mechanical sleeve seals.
1. Install steel pipe for sleeves smaller than 6 inches in diameter.
  2. Install cast-iron "wall pipes" for sleeves 6 inches and larger in diameter.
  3. Mechanical Sleeve Seal Installation: Select type and number of sealing elements required for pipe material and size. Position pipe in center of sleeve. Assemble mechanical sleeve seals and install in annular space between pipe and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.
- Q. Verify final equipment locations for roughing-in.
- R. Refer to equipment specifications in other Sections of these Specifications for roughing-in requirements.

### 3.2 PIPING JOINT CONSTRUCTION

- A. Join pipe and fittings according to the following requirements and Division 23 Sections specifying piping systems.
- B. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.
- C. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.
- D. Threaded Joints: Thread pipe with tapered pipe threads according to ASME B1.20.1. Cut threads full and clean using sharp dies. Ream threaded pipe ends to remove burrs and restore full ID. Join pipe fittings and valves as follows:
1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is specified.
  2. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged. Do not use pipe sections that have cracked or open welds.
- E. Welded Joints: Construct joints according to AWS D10.12, using qualified processes and welding operators according to Part 1 "Quality Assurance" Article.
- F. Flanged Joints: Select appropriate gasket material, size, type, and thickness for service application. Install gasket concentrically positioned. Use suitable lubricants on bolt threads.
- G. Plastic Pressure Piping Gasketed Joints: Join according to ASTM D 3139.

### 3.3 PIPING CONNECTIONS

- A. Make connections according to the following, unless otherwise indicated:
1. Install unions, in piping NPS 2 and smaller, adjacent to each valve and at final connection to each piece of equipment.
  2. Dry Piping Systems: Install dielectric unions and flanges to connect piping materials of dissimilar metals.

3. Wet Piping Systems: Install dielectric coupling and nipple fittings to connect piping materials of dissimilar metals.

#### 3.4 EQUIPMENT INSTALLATION - COMMON REQUIREMENTS

- A. Install equipment to allow maximum possible headroom unless specific mounting heights are not indicated.
- B. Install equipment level and plumb, parallel and perpendicular to other building systems and components in exposed interior spaces, unless otherwise indicated.
- C. Install HVAC equipment to facilitate service, maintenance, and repair or replacement of components. Connect equipment for ease of disconnecting, with minimum interference to other installations. Extend grease fittings to accessible locations.
- D. Install equipment to allow right of way for piping installed at required slope.

#### 3.5 PAINTING

- A. Painting of HVAC systems, equipment, and components is specified in Division 09 Sections "Interior Painting" and "Exterior Painting."
- B. Damage and Touchup: Repair marred and damaged factory-painted finishes with materials and procedures to match original factory finish.

#### 3.6 ERECTION OF METAL SUPPORTS AND ANCHORAGES

- A. Refer to Division 05 Section "Metal Fabrications" for structural steel.
- B. Cut, fit, and place miscellaneous metal supports accurately in location, alignment, and elevation to support and anchor HVAC materials and equipment.
- C. Field Welding: Comply with AWS D1.1.

END OF SECTION 230500

## SECTION 230529 - HANGERS AND SUPPORTS FOR HVAC PIPING AND EQUIPMENT

### PART 1 - GENERAL

#### 1.1 SUMMARY

##### A. Section Includes:

1. Metal pipe hangers and supports.
2. Trapeze pipe hangers.

#### 1.2 PERFORMANCE REQUIREMENTS

- A. Delegated Design: Design trapeze pipe hangers, including comprehensive engineering analysis by a qualified professional engineer, using performance requirements and design criteria indicated.
- B. Structural Performance: Hangers for HVAC piping and equipment shall withstand the effects of gravity loads and stresses within limits and under conditions indicated according to ASCE/SEI 7.
1. Design supports for multiple pipes capable of supporting combined weight of supported systems, system contents, and test water.

#### 1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: Show fabrication and installation details and include calculations for the following; include Product Data for components:
1. Metal pipe hangers and supports.
  2. Trapeze pipe hangers.
- C. INFORMATIONAL SUBMITTALS
- D. Welding certificates.

#### 1.4 QUALITY ASSURANCE

- A. Structural Steel Welding Qualifications: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."
- B. Pipe Welding Qualifications: Qualify procedures and operators according to ASME Boiler and Pressure Vessel Code.



## PART 2 - PRODUCTS

### 2.1 METAL PIPE HANGERS AND SUPPORTS

#### A. Carbon-Steel Pipe Hangers and Supports:

1. Description: MSS SP-58, Types 1 through 58, factory-fabricated components.
2. Galvanized Metallic Coatings: Pregalvanized or hot dipped.
3. Hanger Rods: Continuous-thread rod, nuts, and washer made of carbon steel.

### 2.2 TRAPEZE PIPE HANGERS

- #### A. Description: MSS SP-69, Type 59, shop- or field-fabricated pipe-support assembly made from structural carbon-steel shapes with MSS SP-58 carbon-steel hanger rods, nuts, saddles, and U-bolts.

### 2.3 MISCELLANEOUS MATERIALS

- #### A. Structural Steel: ASTM A 36/A 36M, carbon-steel plates, shapes, and bars; black and galvanized.

## PART 3 - EXECUTION

### 3.1 HANGER AND SUPPORT INSTALLATION

- #### A. Metal Pipe-Hanger Installation: Comply with MSS SP-69 and MSS SP-89. Install hangers, supports, clamps, and attachments as required to properly support piping from the building structure.
- #### B. Metal Trapeze Pipe-Hanger Installation: Comply with MSS SP-69 and MSS SP-89. Arrange for grouping of parallel runs of horizontal piping, and support together on field-fabricated trapeze pipe hangers.
1. Pipes of Various Sizes: Support together and space trapezes for smallest pipe size or install intermediate supports for smaller diameter pipes as specified for individual pipe hangers.
  2. Field fabricate from ASTM A 36/A 36M, carbon-steel shapes selected for loads being supported. Weld steel according to AWS D1.1/D1.1M.
- #### C. Install hangers and supports complete with necessary attachments, inserts, bolts, rods, nuts, washers, and other accessories.
- #### D. Install hangers and supports to allow controlled thermal movement of piping systems, to permit freedom of movement between pipe anchors, and to facilitate action of expansion joints, expansion loops, expansion bends, and similar units.
- #### E. Install lateral bracing with pipe hangers and supports to prevent swaying.
- #### F. Load Distribution: Install hangers and supports so that piping live and dead loads and stresses from movement will not be transmitted to connected equipment.

- G. Pipe Slopes: Install hangers and supports to provide indicated pipe slopes and to not exceed maximum pipe deflections allowed by ASME B31.9 for building services piping.

### 3.2 METAL FABRICATIONS

- A. Cut, drill, and fit miscellaneous metal fabrications for trapeze pipe hangers and equipment supports.
- B. Fit exposed connections together to form hairline joints. Field weld connections that cannot be shop welded because of shipping size limitations.
- C. Field Welding: Comply with AWS D1.1/D1.1M procedures for shielded, metal arc welding; appearance and quality of welds; and methods used in correcting welding work; and with the following:
  - 1. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals.
  - 2. Obtain fusion without undercut or overlap.
  - 3. Remove welding flux immediately.
  - 4. Finish welds at exposed connections so no roughness shows after finishing and so contours of welded surfaces match adjacent contours.

### 3.3 ADJUSTING

- A. Hanger Adjustments: Adjust hangers to distribute loads equally on attachments and to achieve indicated slope of pipe.
- B. Trim excess length of continuous-thread hanger and support rods to 1-1/2 inches.

### 3.4 PAINTING

- A. Touchup: Clean field welds and abraded areas of shop paint. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting. Comply with SSPC-PA 1 requirements for touching up field-painted surfaces.
  - 1. Apply paint by brush or spray to provide a minimum dry film thickness of 2.0 mils.
- B. Touchup: Cleaning and touchup painting of field welds, bolted connections, and abraded areas of shop paint on miscellaneous metal are specified in Division 09 painting Sections.
- C. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A 780.

### 3.5 HANGER AND SUPPORT SCHEDULE

- A. Specific hanger and support requirements are in Sections specifying piping systems and equipment.
- B. Comply with MSS SP-69 for pipe-hanger selections and applications that are not specified in piping system Sections.

- C. Use hangers and supports with galvanized metallic coatings for piping and equipment that will not have field-applied finish.
- D. Use carbon-steel pipe hangers and supports and metal trapeze pipe hangers and attachments for general service applications.
- E. Horizontal-Piping Hangers and Supports: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
  - 1. Adjustable, Steel Clevis Hangers (MSS Type 1): For suspension of noninsulated or insulated, stationary pipes NPS 1/2 to NPS 30.
  - 2. Adjustable, Steel Band Hangers (MSS Type 7): For suspension of noninsulated, stationary pipes NPS 1/2 to NPS 8.
  - 3. U-Bolts (MSS Type 24): For support of heavy pipes NPS 1/2 to NPS 30.
  - 4. Single-Pipe Rolls (MSS Type 41): For suspension of pipes NPS 1 to NPS 30, from two rods if longitudinal movement caused by expansion and contraction might occur..
- F. Vertical-Piping Clamps: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
  - 1. Extension Pipe or Riser Clamps (MSS Type 8): For support of pipe risers NPS 3/4 to NPS 24.
- G. Hanger-Rod Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
  - 1. Steel Turnbuckles (MSS Type 13): For adjustment up to 6 inches for heavy loads.
- H. Building Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
  - 1. Top-Beam C-Clamps (MSS Type 19): For use under roof installations with bar-joint construction, to attach to top flange of structural shape.
  - 2. Side-Beam or Channel Clamps (MSS Type 20): For attaching to bottom flange of beams, channels, or angles.
  - 3. Center-Beam Clamps (MSS Type 21): For attaching to center of bottom flange of beams.
  - 4. Welded Beam Attachments (MSS Type 22): For attaching to bottom of beams if loads are considerable and rod sizes are large.
  - 5. C-Clamps (MSS Type 23): For structural shapes.
  - 6. Welded-Steel Brackets: For support of pipes from below, or for suspending from above by using clip and rod. Use one of the following for indicated loads:
    - a. Light (MSS Type 31): 750 lb.
    - b. Medium (MSS Type 32): 1500 lb.
    - c. Heavy (MSS Type 33): 3000 lb.
  - 7. Side-Beam Brackets (MSS Type 34): For sides of steel or wooden beams.
- I. Comply with MSS SP-69 for trapeze pipe-hanger selections and applications that are not specified in piping system Sections.

END OF SECTION 230529

## SECTION 230553 - HVAC SYSTEM IDENTIFICATION

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. This Section includes the following mechanical identification materials and their installation:
  - 1. Equipment nameplates.
  - 2. Duct markers.

#### 1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.

#### 1.3 QUALITY ASSURANCE

- A. ASME Compliance: Comply with ASME A13.1, "Scheme for the Identification of Piping Systems," for letter size, length of color field, colors, and viewing angles of identification devices for piping.

### PART 2 - PRODUCTS

#### 2.1 EQUIPMENT IDENTIFICATION DEVICES

- A. Equipment Nameplates: Metal, with data engraved or stamped, for permanent attachment on equipment.
  - 1. Data:
    - a. Manufacturer, product name, model number, and serial number.
    - b. Capacity, operating and power characteristics, and essential data.
  - 2. Location: Accessible and visible.
  - 3. Fasteners: As required to mount on equipment.

#### 2.2 DUCT IDENTIFICATION DEVICES

- A. Duct Markers: Engraved, color-coded laminated plastic. Include direction of airflow and duct service (such as supply, return, and exhaust). Include contact-type, permanent adhesive.

## PART 3 - EXECUTION

### 3.1 APPLICATIONS, GENERAL

- A. Products specified are for applications referenced in other Sections. If more than single-type material, device, or label is specified for listed applications, selection is Installer's option.

### 3.2 EQUIPMENT IDENTIFICATION

- A. Install and permanently fasten equipment nameplates on each major item of mechanical equipment that does not have nameplate or has nameplate that is damaged or located where not easily visible. Locate nameplates where accessible and visible. Include nameplates for the following general categories of equipment:
  - 1. Fans, blowers, primary balancing dampers, and mixing boxes.
  - 2. Packaged HVAC central-station and zone-type units.
  - 3. Size: 4-1/2 by 6 inches for equipment.

### 3.3 DUCT IDENTIFICATION

- A. Install duct markers with permanent adhesive on air ducts in the following color codes:
  - 1. Green: For cold-air supply ducts.
  - 2. Yellow: For hot-air supply ducts.
  - 3. Blue: For exhaust-, outside-, relief-, return-, and mixed-air ducts.
  - 4. Letter Size: Minimum 1/4 inch for name of units if viewing distance is less than 24 inches, 1/2 inch for viewing distances up to 72 inches, and proportionately larger lettering for greater viewing distances. Include secondary lettering two-thirds to three-fourths the size of principal lettering.
- B. Locate markers near points where ducts enter into concealed spaces and at maximum intervals of 50 feet in each space where ducts are exposed or concealed by removable ceiling system.

### 3.4 ADJUSTING AND CLEANING

- A. Relocate mechanical identification materials and devices that have become visually blocked by other work.
- B. Clean faces of mechanical identification devices and glass frames of valve schedules.

END OF SECTION 230553

## SECTION 230593 - TESTING, ADJUSTING, AND BALANCING FOR HVAC

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. Section Includes:
  - 1. Balancing Air Systems:
    - a. Constant-volume air systems.

#### 1.2 DEFINITIONS

- A. NEBB: National Environmental Balancing Bureau.
- B. TAB: Testing, adjusting, and balancing.
- C. TAB Specialist: An entity engaged to perform TAB Work.

#### 1.3 INFORMATIONAL SUBMITTALS

- A. Strategies and Procedures Plan: Within 60 days of Contractor's Notice to Proceed, submit TAB strategies and step-by-step procedures as specified in "Preparation" Article.
- B. Certified TAB reports.

#### 1.4 QUALITY ASSURANCE

- A. TAB Contractor Qualifications: Engage a TAB entity certified by NEBB or AABC.
  - 1. TAB Field Supervisor: Employee of the TAB contractor and certified by NEBB or AABC.
  - 2. TAB Technician: Employee of the TAB contractor and who is certified by NEBB or AABC as a TAB technician.
- B. Certify TAB field data reports and perform the following:
  - 1. Review field data reports to validate accuracy of data and to prepare certified TAB reports.
  - 2. Certify that the TAB team complied with the approved TAB plan and the procedures specified and referenced in this Specification.
- C. TAB Report Forms: Use standard TAB contractor's forms approved by Owner and Commissioning Authority.
- D. Instrumentation Type, Quantity, Accuracy, and Calibration: As described in ASHRAE 111, Section 5, "Instrumentation."

- E. ASHRAE Compliance: Applicable requirements in ASHRAE 62.1, Section 7.2.2 - "Air Balancing."
- F. ASHRAE/IESNA Compliance: Applicable requirements in ASHRAE/IESNA 90.1, Section 6.7.2.3 - "System Balancing."

## PART 2 - PRODUCTS (Not Applicable)

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine the Contract Documents to become familiar with Project requirements and to discover conditions in systems' designs that may preclude proper TAB of systems and equipment.
- B. Examine systems for installed balancing devices, such as test ports, gage cocks, thermometer wells, flow-control devices, balancing valves and fittings, and manual volume dampers. Verify that locations of these balancing devices are accessible.
- C. Examine the approved submittals for HVAC systems and equipment.
- D. Examine design data including HVAC system descriptions, statements of design assumptions for environmental conditions and systems' output, and statements of philosophies and assumptions about HVAC system and equipment controls.
- E. Examine equipment performance data including fan and pump curves.
  - 1. Relate performance data to Project conditions and requirements, including system effects that can create undesired or unpredicted conditions that cause reduced capacities in all or part of a system.
  - 2. Calculate system-effect factors to reduce performance ratings of HVAC equipment when installed under conditions different from the conditions used to rate equipment performance. To calculate system effects for air systems, use tables and charts found in AMCA 201, "Fans and Systems," or in SMACNA's "HVAC Systems - Duct Design." Compare results with the design data and installed conditions.
- F. Examine system and equipment installations and verify that field quality-control testing, cleaning, and adjusting specified in individual Sections have been performed.
- G. Examine test reports specified in individual system and equipment Sections.
- H. Examine HVAC equipment and filters and verify that bearings are greased, belts are aligned and tight, and equipment with functioning controls is ready for operation.
- I. Examine terminal units, such as variable-air-volume boxes, and verify that they are accessible and their controls are connected and functioning.
- J. Examine heat-transfer coils for correct piping connections and for clean and straight fins.
- K. Examine operating safety interlocks and controls on HVAC equipment.

- L. Report deficiencies discovered before and during performance of TAB procedures. Observe and record system reactions to changes in conditions. Record default set points if different from indicated values.
- M. Test and balance air handling unit (DOAS-1) at the scheduled outside air quantity (100%) and at Weekday Occupied mode (30% outside air). Reference the Sequence of Operation for the dedicated outside air system on sheet M-200 for additional information. Damper start position shall be set at 0% outside air. Damper stop location shall be set at 100% outside air. Damper stop location at 30% outside air shall be achieved via software.

### 3.2 PREPARATION

- A. Prepare a TAB plan that includes strategies and step-by-step procedures.
- B. Complete system-readiness checks and prepare reports. Verify the following:
  - 1. Permanent electrical-power wiring is complete.
  - 2. Automatic temperature-control systems are operational.
  - 3. Equipment and duct access doors are securely closed.
  - 4. Balance, smoke, and fire dampers are open.
  - 5. Isolating and balancing valves are open and control valves are operational.
  - 6. Ceilings are installed in critical areas where air-pattern adjustments are required and access to balancing devices is provided.
  - 7. Windows and doors can be closed so indicated conditions for system operations can be met.

### 3.3 GENERAL PROCEDURES FOR TESTING AND BALANCING

- A. Perform testing and balancing procedures on each system according to the procedures contained in NEBB's "Procedural Standards for Testing, Adjusting, and Balancing of Environmental Systems" and in this Section.
  - 1. Comply with requirements in ASHRAE 62.1, Section 7.2.2 - "Air Balancing."
- B. Cut insulation, ducts, pipes, and equipment cabinets for installation of test probes to the minimum extent necessary for TAB procedures.
  - 1. After testing and balancing, patch probe holes in ducts with same material and thickness as used to construct ducts.
  - 2. Install and join new insulation that matches removed materials. Restore insulation, coverings, vapor barrier, and finish according to Division 23 Section "HVAC Insulation."
- C. Mark equipment and balancing devices, including damper-control positions, valve position indicators, fan-speed-control levers, and similar controls and devices, with paint or other suitable, permanent identification material to show final settings.
- D. Take and report testing and balancing measurements in inch-pound (IP) units.



### 3.4 GENERAL PROCEDURES FOR BALANCING AIR SYSTEMS

- A. Prepare test reports for both fans and outlets. Obtain manufacturer's outlet factors and recommended testing procedures. Crosscheck the summation of required outlet volumes with required fan volumes.
- B. Prepare schematic diagrams of systems' "as-built" duct layouts.
- C. Determine the best locations in main and branch ducts for accurate duct-airflow measurements.
- D. Check airflow patterns from the outdoor-air louvers and dampers and the return- and exhaust-air dampers through the supply-fan discharge and mixing dampers.
- E. Locate start-stop and disconnect switches, electrical interlocks, and motor starters.
- F. Verify that motor starters are equipped with properly sized thermal protection.
- G. Check dampers for proper position to achieve desired airflow path.
- H. Check for airflow blockages.
- I. Check condensate drains for proper connections and functioning.
- J. Check for proper sealing of air-handling-unit components.
- K. Verify that air duct system is sealed as specified in Division 23 Section "Metal Ducts."

### 3.5 PROCEDURES FOR CONSTANT-VOLUME AIR SYSTEMS

- A. Adjust fans to deliver total indicated airflows within the maximum allowable fan speed listed by fan manufacturer.
  - 1. Measure total airflow.
    - a. Where sufficient space in ducts is unavailable for Pitot-tube traverse measurements, measure airflow at terminal outlets and inlets and calculate the total airflow.
  - 2. Measure fan static pressures as follows to determine actual static pressure:
    - a. Measure outlet static pressure as far downstream from the fan as practical and upstream from restrictions in ducts such as elbows and transitions.
    - b. Measure static pressure directly at the fan outlet or through the flexible connection.
    - c. Measure inlet static pressure of single-inlet fans in the inlet duct as near the fan as possible, upstream from the flexible connection, and downstream from duct restrictions.
    - d. Measure inlet static pressure of double-inlet fans through the wall of the plenum that houses the fan.
  - 3. Measure static pressure across each component that makes up an air-handling unit, rooftop unit, and other air-handling and -treating equipment.
    - a. Report the cleanliness status of filters and the time static pressures are measured.

4. Measure static pressures entering and leaving other devices, such as sound traps, heat-recovery equipment, and air washers, under final balanced conditions.
  5. Review Record Documents to determine variations in design static pressures versus actual static pressures. Calculate actual system-effect factors. Recommend adjustments to accommodate actual conditions.
  6. Obtain approval from Architect for adjustment of fan speed higher or lower than indicated speed. Comply with requirements in Division 23 Sections for air-handling units for adjustment of fans, belts, and pulley sizes to achieve indicated air-handling-unit performance.
  7. Do not make fan-speed adjustments that result in motor overload. Consult equipment manufacturers about fan-speed safety factors. Modulate dampers and measure fan-motor amperage to ensure that no overload will occur. Measure amperage in full-cooling, full-heating, economizer, and any other operating mode to determine the maximum required brake horsepower.
- B. Adjust volume dampers for main duct, submain ducts, and major branch ducts to indicated airflows within specified tolerances.
1. Measure airflow of submain and branch ducts.
    - a. Where sufficient space in submain and branch ducts is unavailable for Pitot-tube traverse measurements, measure airflow at terminal outlets and inlets and calculate the total airflow for that zone.
  2. Measure static pressure at a point downstream from the balancing damper, and adjust volume dampers until the proper static pressure is achieved.
  3. Remeasure each submain and branch duct after all have been adjusted. Continue to adjust submain and branch ducts to indicated airflows within specified tolerances.
- C. Measure air outlets and inlets without making adjustments.
1. Measure terminal outlets using a direct-reading hood or outlet manufacturer's written instructions and calculating factors.
- D. Adjust air outlets and inlets for each space to indicated airflows within specified tolerances of indicated values. Make adjustments using branch volume dampers rather than extractors and the dampers at air terminals.
1. Adjust each outlet in same room or space to within specified tolerances of indicated quantities without generating noise levels above the limitations prescribed by the Contract Documents.
  2. Adjust patterns of adjustable outlets for proper distribution without drafts.

### 3.6 PROCEDURES FOR MOTORS

- A. Motors, 1/2 HP and Larger: Test at final balanced conditions and record the following data:
1. Manufacturer's name, model number, and serial number.
  2. Motor horsepower rating.
  3. Motor rpm.
  4. Efficiency rating.
  5. Nameplate and measured voltage, each phase.
  6. Nameplate and measured amperage, each phase.

7. Starter thermal-protection-element rating.

- B. Motors Driven by Variable-Frequency Controllers: Test for proper operation at speeds varying from minimum to maximum. Test the manual bypass of the controller to prove proper operation. Record observations including name of controller manufacturer, model number, serial number, and nameplate data.

### 3.7 TOLERANCES

A. Set HVAC system's air flow rates and water flow rates within the following tolerances:

1. Supply, Return, and Exhaust Fans and Equipment with Fans: Plus or minus 10 percent.
2. Air Outlets and Inlets: Plus or minus 10 percent.

### 3.8 REPORTING

A. Initial Construction-Phase Report: Based on examination of the Contract Documents as specified in "Examination" Article, prepare a report on the adequacy of design for systems' balancing devices. Recommend changes and additions to systems' balancing devices to facilitate proper performance measuring and balancing. Recommend changes and additions to HVAC systems and general construction to allow access for performance measuring and balancing devices.

B. Status Reports: Prepare weekly progress reports to describe completed procedures, procedures in progress, and scheduled procedures. Include a list of deficiencies and problems found in systems being tested and balanced. Prepare a separate report for each system and each building floor for systems serving multiple floors.

### 3.9 FINAL REPORT

A. General: Prepare a certified written report; tabulate and divide the report into separate sections for tested systems and balanced systems.

1. Include a certification sheet at the front of the report's binder, signed and sealed by the certified testing and balancing engineer.
2. Include a list of instruments used for procedures, along with proof of calibration.

B. Final Report Contents: In addition to certified field-report data, include the following:

1. Pump curves.
2. Fan curves.
3. Manufacturers' test data.
4. Field test reports prepared by system and equipment installers.
5. Other information relative to equipment performance; do not include Shop Drawings and product data.

C. General Report Data: In addition to form titles and entries, include the following data:

1. Title page.
2. Name and address of the TAB contractor.
3. Project name.

4. Project location.
  5. Architect's name and address.
  6. Engineer's name and address.
  7. Contractor's name and address.
  8. Report date.
  9. Signature of TAB supervisor who certifies the report.
  10. Table of Contents with the total number of pages defined for each section of the report. Number each page in the report.
  11. Summary of contents including the following:
    - a. Indicated versus final performance.
    - b. Notable characteristics of systems.
    - c. Description of system operation sequence if it varies from the Contract Documents.
  12. Nomenclature sheets for each item of equipment.
  13. Data for terminal units, including manufacturer's name, type, size, and fittings.
  14. Notes to explain why certain final data in the body of reports vary from indicated values.
  15. Test conditions for fans and pump performance forms including the following:
    - a. Settings for outdoor-, return-, and exhaust-air dampers.
    - b. Conditions of filters.
    - c. Cooling coil, wet- and dry-bulb conditions.
    - d. Face and bypass damper settings at coils.
    - e. Fan drive settings including settings and percentage of maximum pitch diameter.
    - f. Inlet vane settings for variable-air-volume systems.
    - g. Settings for supply-air, static-pressure controller.
    - h. Other system operating conditions that affect performance.
- D. System Diagrams: Include schematic layouts of air and hydronic distribution systems. Present each system with single-line diagram and include the following:
1. Quantities of outdoor, supply, return, and exhaust airflows.
  2. Duct, outlet, and inlet sizes.
  3. Balancing stations.
  4. Position of balancing devices.

END OF SECTION 230593

## SECTION 230713 - DUCT INSULATION

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Related Sections:
  - 1. Section 233113 "Metal Ducts" for ductwork with lining.

#### 1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated. Include thermal conductivity, water-vapor permeance thickness, and jackets or covering.
- B. Shop Drawings: Include plans, elevations, sections, details, and attachments to other work.
  - 1. Detail application of protective shields and inserts at hangers for each type of insulation and hanger.
  - 2. Detail insulation application at elbows, fittings, dampers, specialties and flanges for each type of insulation.
  - 3. Detail application at linkages of control devices.

#### 1.4 INFORMATIONAL SUBMITTALS

- A. Qualification Data: For qualified Installer.

#### 1.5 QUALITY ASSURANCE

- A. Installer Qualifications: Skilled mechanics who have successfully completed an apprenticeship program or another craft training program certified by the Department of Labor, Bureau of Apprenticeship and Training.
- B. Surface-Burning Characteristics: For insulation and related materials, as determined by testing identical products according to ASTM E 84, by a testing agency acceptable to authorities having jurisdiction. Factory label insulation and jacket materials and adhesive, mastic, tapes, and cement material containers, with appropriate markings of applicable testing agency.
  - 1. Insulation Installed Indoors: Flame-spread index of 25 or less, and smoke-developed index of 50 or less.

## 1.6 DELIVERY, STORAGE, AND HANDLING

- A. Packaging: Insulation material containers shall be marked by manufacturer with appropriate ASTM standard designation, type and grade, and maximum use temperature.

## 1.7 COORDINATION

- A. Coordinate sizes and locations of supports, hangers, and insulation shields.
- B. Coordinate clearance requirements with duct Installer for duct insulation application. Before preparing ductwork Shop Drawings, establish and maintain clearance requirements for installation of insulation and field-applied jackets and finishes and for space required for maintenance.

## 1.8 SCHEDULING

- A. Schedule insulation application after any required ductwork pressure testing is complete. Insulation application may begin on segments that have satisfactory test results.

## PART 2 - PRODUCTS

### 2.1 INSULATION MATERIALS

- A. Comply with requirements in Duct Insulation Schedule for where insulating materials shall be applied.
- B. Products shall not contain asbestos, lead, mercury, or mercury compounds.
- C. Products that come in contact with stainless steel shall have a leachable chloride content of less than 50 ppm when tested according to ASTM C 871.
- D. Mineral-Fiber Blanket Insulation: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C 553, Type II and ASTM C 1290, Type III with factory-applied FSK jacket. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.
  - 1. Products: Subject to compliance with requirements, provide one of the following:
    - a. CertainTeed Corp.; SoftTouch Duct Wrap.
    - b. Johns Manville; Microlite.
    - c. Knauf Insulation; Friendly Feel Duct Wrap.
    - d. Owens Corning; SOFTR All-Service Duct Wrap.
    - e. Pre-approved equal.
- E. Mineral-Fiber Board Insulation: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C 612, Type IA or Type IB. For duct and plenum applications, provide insulation with factory-applied FSK jacket. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.
  - 1. Products: Subject to compliance with requirements, provide one of the following:
    - a. CertainTeed Corp.; Commercial Board.

- b. Johns Manville; 800 Series Spin-Glas.
- c. Knauf Insulation; Insulation Board.
- d. Owens Corning; Fiberglas 700 Series.
- e. Pre-approved equal.

## 2.2 FIRE-RATED INSULATION SYSTEMS

- A. Fire-Rated Board: Structural-grade, press-molded, xonolite calcium silicate, fireproofing board suitable for operating temperatures up to 1700 deg F. Comply with ASTM C 656, Type II, Grade 6. Tested and certified to provide a 2-hour fire rating by an NRTL acceptable to authorities having jurisdiction.
  - 1. Subject to compliance with requirements, provide one of the following:
    - a. Johns Manville; Super Firetemp M.
    - b. Pabco.
    - c. Rockwool.
    - d. Pre-approved equal.
- B. Fire-Rated Blanket: High-temperature, flexible, blanket insulation with FSK jacket that is tested and certified to provide a 2-hour fire rating by an NRTL acceptable to authorities having jurisdiction.
  - 1. Subject to compliance with requirements, provide one of the following:
    - a. CertainTeed Corp.; FlameChek.
    - b. Johns Manville; Firetemp Wrap.
    - c. 3M; Fire Barrier Wrap Products.
    - d. Morgan Thermal Ceramics.
    - e. Pre-approved equal.

## 2.3 ADHESIVES

- A. Materials shall be compatible with insulation materials, jackets, and substrates and for bonding insulation to itself and to surfaces to be insulated unless otherwise indicated.
- B. Mineral-Fiber Adhesive: Comply with MIL-A-3316C, Class 2, Grade A.
  - 1. Subject to compliance with requirements, provide one of the following:
    - a. Childers Brand; CP-127.
    - b. Eagle Bridges; 225.
    - c. Foster Brand; 85-60/85-70.
    - d. Mon-Eco Industries, Inc.; 22-25.
    - e. Pre-approved equal.
  - 2. For indoor applications, adhesive shall have a VOC content of 80 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
  - 3. Adhesive shall comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."

- C. FSK Jacket Adhesive: Comply with MIL-A-3316C, Class 2, Grade A for bonding insulation jacket lap seams and joints.
1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Childers Brand; CP-82.
    - b. Eagle Bridges; 225.
    - c. Foster Brand; 85-50.
    - d. Mon-Eco Industries, Inc.; 22-25.
    - e. Pre-approved equal.
  2. For indoor applications, adhesive shall have a VOC content of 50 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
  3. Adhesive shall comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."

## 2.4 MASTICS

- A. Materials shall be compatible with insulation materials, jackets, and substrates; comply with MIL-PRF-19565C, Type II.
1. For indoor applications, use mastics that have a VOC content of 50 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
- B. Vapor-Barrier Mastic: Water based; suitable for indoor use on below ambient services.
1. Subject to compliance with requirements, provide one of the following:
    - a. Foster Brand; 30-80/30-90.
    - b. Vimasco Corporation; 749.
    - c. Childers Branh.
    - d. Pre-approved equal.
  2. Water-Vapor Permeance: ASTM E 96/E 96M, Procedure B, 0.013 perm at 43-mil dry film thickness.
  3. Service Temperature Range: Minus 20 to plus 180 deg F.
  4. Solids Content: ASTM D 1644, 58 percent by volume and 70 percent by weight.
  5. Color: White.

## 2.5 LAGGING ADHESIVES

- A. Description: Comply with MIL-A-3316C, Class I, Grade A and shall be compatible with insulation materials, jackets, and substrates.
1. For indoor applications, use lagging adhesives that have a VOC content of 50 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
  2. Products: Subject to compliance with requirements, provide one of the following:
    - a. Childers Brand; CP-50 AHV2.
    - b. Foster Brand; 30-36.
    - c. Vimasco Corporation; 713 and 714.



- d. Pre-approved equal.
3. Fire-resistant, water-based lagging adhesive and coating for use indoors to adhere fire-resistant lagging cloths over duct insulation.
4. Service Temperature Range: 0 to plus 180 deg F.
5. Color: White.

## 2.6 SEALANTS

### A. FSK Sealants:

1. Products: Subject to compliance with requirements, provide one of the following:
  - a. Childers Brand; CP-76.
  - b. Eagle Bridges; 405.
  - c. Foster Brand; 95-44.
  - d. Mon-Eco Industries, Inc.; 44-05.
  - e. Pre-approved equal.
2. Materials shall be compatible with insulation materials, jackets, and substrates.
3. Fire- and water-resistant, flexible, elastomeric sealant.
4. Service Temperature Range: Minus 40 to plus 250 deg F.
5. Color: Aluminum.
6. For indoor applications, sealants shall have a VOC content of 420 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

## 2.7 FACTORY-APPLIED JACKETS

### A. Insulation system schedules indicate factory-applied jackets on various applications. When factory-applied jackets are indicated, comply with the following:

1. FSK Jacket: Aluminum-foil, fiberglass-reinforced scrim with kraft-paper backing; complying with ASTM C 1136, Type II.

## 2.8 FIELD-APPLIED JACKETS

- A. Field-applied jackets shall comply with ASTM C 921, Type I, unless otherwise indicated.
- B. FSK Jacket: Aluminum-foil-face, fiberglass-reinforced scrim with kraft-paper backing.

## 2.9 TAPES

### A. FSK Tape: Foil-face, vapor-retarder tape matching factory-applied jacket with acrylic adhesive; complying with ASTM C 1136.

1. Products: Subject to compliance with requirements, provide one of the following:
  - a. ABI; 491 AWF FSK.
  - b. Avery Dennison Corporation; Fasson 0827.
  - c. Compac Corporation; 110 and 111.
  - d. Venture Tape; 1525 CW NT, 1528 CW, and 1528 CW/SQ.

- e. Pre-approved equal.
- 2. Width: 3 inches.
- 3. Thickness: 6.5 mils.
- 4. Adhesion: 90 ounces force/inch in width.
- 5. Elongation: 2 percent.
- 6. Tensile Strength: 40 lbf/inch in width.
- 7. FSK Tape Disks and Squares: Precut disks or squares of FSK tape.

## 2.10 SECUREMENTS

### A. Insulation Pins and Hangers:

- 1. Cupped-Head, Capacitor-Discharge-Weld Pins: Copper- or zinc-coated steel pin, fully annealed for capacitor-discharge welding, 0.135-inch- diameter shank, length to suit depth of insulation indicated with integral 1-1/2-inch galvanized carbon-steel washer.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine substrates and conditions for compliance with requirements for installation tolerances and other conditions affecting performance of insulation application.
  - 1. Verify that systems to be insulated have been tested and are free of defects.
  - 2. Verify that surfaces to be insulated are clean and dry.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 PREPARATION

- A. Surface Preparation: Clean and dry surfaces to receive insulation. Remove materials that will adversely affect insulation application.

### 3.3 GENERAL INSTALLATION REQUIREMENTS

- A. Install insulation materials, accessories, and finishes with smooth, straight, and even surfaces; free of voids throughout the length of ducts and fittings.
- B. Install insulation materials, vapor barriers or retarders, jackets, and thicknesses required for each item of duct system as specified in insulation system schedules.
- C. Install accessories compatible with insulation materials and suitable for the service. Install accessories that do not corrode, soften, or otherwise attack insulation or jacket in either wet or dry state.
- D. Keep insulation materials dry during application and finishing.
- E. Install insulation with tight longitudinal seams and end joints. Bond seams and joints with adhesive recommended by insulation material manufacturer.

- F. Install insulation with least number of joints practical.
- G. Where vapor barrier is indicated, seal joints, seams, and penetrations. No penetration in insulation is permitted at hangers, supports, and other projections.
  - 1. Install insulation continuously through hangers and supports.
  - 2. For insulation application where vapor barriers are indicated, extend insulation on anchor legs from point of attachment to supported item to point of attachment to structure. Taper and seal ends at attachment to structure with vapor-barrier mastic.
  - 3. Install insert materials and install insulation to tightly join the insert. Seal insulation to insulation inserts with adhesive or sealing compound recommended by insulation material manufacturer.
- H. Apply adhesives, mastics, and sealants at manufacturer's recommended coverage rate and wet and dry film thicknesses.
- I. Install insulation with factory-applied jackets as follows:
  - 1. Draw jacket tight and smooth.
  - 2. Cover circumferential joints with 3-inch- wide strips, of same material as insulation jacket. Secure strips with adhesive.
  - 3. Overlap jacket longitudinal seams at least 1-1/2 inches. Clean and dry surface to receive sealing tape.
  - 4. Cover joints and seams with tape, according to insulation material manufacturer's written instructions, to maintain vapor seal.
  - 5. Where vapor barriers are indicated, apply vapor-barrier mastic on seams and joints and at ends adjacent to duct flanges and fittings.
- J. Cut insulation in a manner to avoid compressing insulation more than 75 percent of its nominal thickness.
- K. Finish installation with systems at operating conditions. Repair joint separations and cracking due to thermal movement.
- L. Repair damaged insulation facings by applying same facing material over damaged areas. Extend patches at least 4 inches beyond damaged areas. Adhere, staple, and seal patches similar to butt joints.

### 3.4 PENETRATIONS

- A. Insulation Installation at Interior Wall and Partition Penetrations (That Are Not Fire Rated): Install insulation continuously through walls and partitions.
- B. Insulation Installation at Fire-Rated Wall and Partition Penetrations: Terminate insulation at fire damper sleeves for fire-rated wall and partition penetrations. Externally insulate damper sleeves to match adjacent insulation and overlap duct insulation at least 2 inches.
  - 1. Firestopping materials and fire-resistive joint sealers applicable for the installation.
- C. Insulation Installation at Floor Penetrations:

1. Duct: For penetrations through fire-rated assemblies, terminate insulation at fire damper sleeves and externally insulate damper sleeve beyond floor to match adjacent duct insulation. Overlap damper sleeve and duct insulation at least 2 inches.
2. Seal penetrations through fire-rated assemblies.

### 3.5 INSTALLATION OF MINERAL-FIBER INSULATION

- A. Blanket or Board Insulation Installation on Ducts and Plenums: Secure with adhesive and insulation pins.
1. Apply adhesives according to manufacturer's recommended coverage rates per unit area, for 50 percent coverage of duct and plenum surfaces.
  2. Apply adhesive to entire circumference of ducts and to all surfaces of fittings and transitions.
  3. Install capacitor-discharge-weld pins on sides and bottom of horizontal ducts and sides of vertical ducts as follows:
    - a. On duct sides or bottom with dimensions 18 inches and smaller, place pins along longitudinal centerline of duct. Space 3 inches maximum from insulation end joints, and 16 inches o.c.
    - b. On duct sides or bottom with dimensions larger than 18 inches, place pins 16 inches o.c. each way, and 3 inches maximum from insulation joints. Install additional pins to hold insulation tightly against surface at cross bracing.
    - c. Pins may be omitted from top surface of horizontal, rectangular ducts and plenums.
    - d. Do not overcompress insulation during installation.
    - e. Impale insulation over pins and attach speed washers.
    - f. Cut excess portion of pins extending beyond speed washers or bend parallel with insulation surface. Cover exposed pins and washers with tape matching insulation facing.
  4. For ducts and plenums, install a continuous unbroken vapor barrier. Create a facing lap for longitudinal seams and end joints with insulation by removing 2 inches from one edge and one end of insulation segment. Secure laps to adjacent insulation section with 1/2-inch outward-clinching staples, 1 inch o.c. Install vapor barrier consisting of factory- or field-applied jacket, adhesive, vapor-barrier mastic, and sealant at joints, seams, and protrusions.
    - a. Repair punctures, tears, and penetrations with tape or mastic to maintain vapor-barrier seal.
    - b. Install vapor stops for ductwork and plenums operating below 50 deg F at 18-foot intervals. Vapor stops shall consist of vapor-barrier mastic applied in a Z-shaped pattern over insulation face, along butt end of insulation, and over the surface. Cover insulation face and surface to be insulated a width equal to two times the insulation thickness, but not less than 3 inches.
  5. Install insulation on rectangular duct elbows and transitions with a full insulation section for each surface. Install insulation on round and flat-oval duct elbows with individually mitered gores cut to fit the elbow.
  6. Insulate duct stiffeners, hangers, and flanges that protrude beyond insulation surface with 6-inch-wide strips of same material used to insulate duct. Secure on alternating sides of stiffener, hanger, and flange with pins spaced 6 inches o.c.

### 3.6 FIRE-RATED INSULATION SYSTEM INSTALLATION

- A. Where fire-rated insulation system is indicated, secure system to ducts and duct hangers and supports to maintain a continuous fire rating.
- B. Insulate duct access panels and doors to achieve same fire rating as duct.
- C. Install firestopping at penetrations through fire-rated assemblies. Fire-stop systems are specified in Section 078413 "Penetration Firestopping."

### 3.7 FIELD QUALITY CONTROL

- A. All insulation applications will be considered defective Work if sample inspection reveals noncompliance with requirements.

END OF SECTION 230713

## SECTION 231123 - FACILITY NATURAL-GAS PIPING

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Pipes, tubes, and fittings.
  - 2. Piping specialties.
  - 3. Piping and tubing joining materials.
  - 4. Valves.

#### 1.3 DEFINITIONS

- A. Finished Spaces: Spaces other than mechanical and electrical equipment rooms, furred spaces, pipe and duct shafts, unheated spaces immediately below roof, spaces above ceilings, unexcavated spaces, crawlspaces, and tunnels.
- B. Exposed, Interior Installations: Exposed to view indoors. Examples include finished occupied spaces and mechanical equipment rooms.
- C. Exposed, Exterior Installations: Exposed to view outdoors or subject to outdoor ambient temperatures and weather conditions. Examples include rooftop locations.

#### 1.4 PERFORMANCE REQUIREMENTS

- A. Minimum Operating-Pressure Ratings:
  - 1. Piping and Valves: 100 psig minimum unless otherwise indicated.
- B. Natural-Gas System Pressure within Buildings: 2.0 psig or less.

#### 1.5 ACTION SUBMITTALS

- A. Product Data: For each type of the following:
  - 1. Piping specialties.
  - 2. Corrugated, stainless-steel tubing with associated components.
  - 3. Valves. Include pressure rating, capacity, settings, and electrical connection data of selected models.
  - 4. Dielectric fittings.

- B. Shop Drawings: For facility natural-gas piping layout. Include plans, piping layout and elevations, sections, and details for fabrication of pipe anchors, hangers, supports for multiple pipes, alignment guides, expansion joints and loops, and attachments of the same to building structure. Detail location of anchors, alignment guides, and expansion joints and loops.
  - 1. Shop Drawing Scale: 1/4 inch per foot.
  - 2. Detail mounting, supports, and valve arrangements for service meter assembly and pressure regulator assembly.

#### 1.6 INFORMATIONAL SUBMITTALS

- A. Welding certificates.
- B. Field quality-control reports.

#### 1.7 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For motorized gas valves and pressure regulators to include in emergency, operation, and maintenance manuals.

#### 1.8 QUALITY ASSURANCE

- A. Steel Support Welding Qualifications: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."
- B. Pipe Welding Qualifications: Qualify procedures and operators according to ASME Boiler and Pressure Vessel Code.
- C. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

#### 1.9 DELIVERY, STORAGE, AND HANDLING

- A. Handling Flammable Liquids: Remove and dispose of liquids from existing natural-gas piping according to requirements of authorities having jurisdiction.
- B. Deliver pipes and tubes with factory-applied end caps. Maintain end caps through shipping, storage, and handling to prevent pipe end damage and to prevent entrance of dirt, debris, and moisture.
- C. Store and handle pipes and tubes having factory-applied protective coatings to avoid damaging coating, and protect from direct sunlight.

#### 1.10 PROJECT CONDITIONS

- A. Interruption of Existing Natural-Gas Service: Do not interrupt natural-gas service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide purging and startup of natural-gas supply according to requirements indicated:

1. Notify Construction Manager no fewer than two days in advance of proposed interruption of natural-gas service.
2. Do not proceed with interruption of natural-gas service without Construction Manager's written permission.

#### 1.11 COORDINATION

- A. Coordinate requirements for access panels and doors for valves installed concealed behind finished surfaces. Comply with requirements in Section 083113 "Access Doors and Frames."

### PART 2 - PRODUCTS

#### 2.1 PIPES, TUBES, AND FITTINGS

- A. Steel Pipe: ASTM A 53/A 53M, black steel, Schedule 40, Type E or S, Grade B.
  1. Malleable-Iron Threaded Fittings: ASME B16.3, Class 150, standard pattern.
  2. Wrought-Steel Welding Fittings: ASTM A 234/A 234M for butt welding and socket welding.
  3. Unions: ASME B16.39, Class 150, malleable iron with brass-to-iron seat, ground joint, and threaded ends.
  4. Forged-Steel Flanges and Flanged Fittings: ASME B16.5, minimum Class 150, including bolts, nuts, and gaskets of the following material group, end connections, and facings:
    - a. Material Group: 1.1.
    - b. End Connections: Threaded or butt welding to match pipe.
    - c. Lapped Face: Not permitted underground.
    - d. Gasket Materials: ASME B16.20, metallic, flat, asbestos free, aluminum o-rings, and spiral-wound metal gaskets.
    - e. Bolts and Nuts: ASME B18.2.1, carbon steel aboveground and stainless steel underground.
- B. Appliance Flexible Connectors:
  1. Outdoor, Appliance Flexible Connectors: Comply with ANSI Z21.75.
  2. Corrugated stainless-steel tubing with polymer coating.
  3. Operating-Pressure Rating: 0.5 psig.
  4. End Fittings: Zinc-coated steel.
  5. Threaded Ends: Comply with ASME B1.20.1.
  6. Maximum Length: 72 inches
- C. Weatherproof Vent Cap: Cast- or malleable-iron increaser fitting with corrosion-resistant wire screen, with free area at least equal to cross-sectional area of connecting pipe and threaded-end connection.

#### 2.2 JOINING MATERIALS

- A. Joint Compound and Tape: Suitable for natural gas.



- B. Welding Filler Metals: Comply with AWS D10.12/D10.12M for welding materials appropriate for wall thickness and chemical analysis of steel pipe being welded.
- C. Brazing Filler Metals: Alloy with melting point greater than 1000 deg F complying with AWS A5.8/A5.8M. Brazing alloys containing more than 0.05 percent phosphorus are prohibited.

### 2.3 MANUAL GAS SHUTOFF VALVES

- A. See "Aboveground Manual Gas Shutoff Valve Schedule" Articles for where each valve type is applied in various services.
- B. General Requirements for Metallic Valves, NPS 2 and Smaller: Comply with ASME B16.33.
  - 1. CWP Rating: 125 psig.
  - 2. Threaded Ends: Comply with ASME B1.20.1.
  - 3. Dryseal Threads on Flare Ends: Comply with ASME B1.20.3.
  - 4. Tamperproof Feature: Locking feature for valves indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
  - 5. Listing: Listed and labeled by an NRTL acceptable to authorities having jurisdiction for valves 1 inch and smaller.
  - 6. Service Mark: Valves 1-1/4 inches to NPS 2 shall have initials "WOG" permanently marked on valve body.
- C. Two-Piece, Full-Port, Bronze Ball Valves with Bronze Trim: MSS SP-110.
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. BrassCraft Manufacturing Company; a Masco company.
    - b. Conbraco Industries, Inc.; Apollo Div.
    - c. Lyall, R. W. & Company, Inc.
    - d. McDonald, A. Y. Mfg. Co.
    - e. Perfection Corporation; a subsidiary of American Meter Company.
    - f. Pre-approved equal.
  - 2. Body: Bronze, complying with ASTM B 584.
  - 3. Ball: Chrome-plated bronze.
  - 4. Stem: Bronze; blowout proof.
  - 5. Seats: Reinforced TFE; blowout proof.
  - 6. Packing: Threaded-body packnut design with adjustable-stem packing.
  - 7. Ends: Threaded, flared, or socket as indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
  - 8. CWP Rating: 600 psig.
  - 9. Listing: Valves NPS 1 and smaller shall be listed and labeled by an NRTL acceptable to authorities having jurisdiction.
  - 10. Service: Suitable for natural-gas service with "WOG" indicated on valve body.
- D. Bronze Plug Valves: MSS SP-78.
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

- a. Lee Brass Company.
  - a. McDonald, A. Y. Mfg. Co.
  - b. Henry Pratt Company.
  - c. Pre-approved equal.
2. Body: Bronze, complying with ASTM B 584.
  3. Plug: Bronze.
  4. Ends: Threaded, socket, or flanged as indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
  5. Operator: Square head or lug type with tamperproof feature where indicated.
  6. Pressure Class: 125 psig.
  7. Listing: Valves NPS 1 and smaller shall be listed and labeled by an NRTL acceptable to authorities having jurisdiction.
  8. Service: Suitable for natural-gas service with "WOG" indicated on valve body.

E. Cast-Iron, Lubricated Plug Valves: MSS SP-78.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Flowserve.
  - b. Homestead Valve; a division of Olson Technologies, Inc.
  - c. McDonald, A. Y. Mfg. Co.
  - d. Milliken Valve Company.
  - e. Mueller Co.; Gas Products Div.
  - f. R&M Energy Systems, A Unit of Robbins & Myers, Inc.
  - g. Pre-approved equal.
2. Body: Cast iron, complying with ASTM A 126, Class B.
3. Plug: Bronze or nickel-plated cast iron.
4. Seat: Coated with thermoplastic.
5. Stem Seal: Compatible with natural gas.
6. Ends: Threaded or flanged as indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
7. Operator: Square head or lug type with tamperproof feature where indicated.
8. Pressure Class: 125 psig.
9. Listing: Valves NPS 1 and smaller shall be listed and labeled by an NRTL acceptable to authorities having jurisdiction.
10. Service: Suitable for natural-gas service with "WOG" indicated on valve body.

## 2.4 DIELECTRIC FITTINGS

A. General Requirements: Assembly of copper alloy and ferrous materials with separating nonconductive insulating material. Include end connections compatible with pipes to be joined.

B. Dielectric Unions:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Capitol Manufacturing Company.
  - b. Central Plastics Company.
  - c. Hart Industries International, Inc.

- d. Jomar International Ltd.
- e. Matco-Norca, Inc.
- f. McDonald, A. Y. Mfg. Co.
- g. Watts Regulator Co.; a division of Watts Water Technologies, Inc.
- h. Wilkins; a Zurn company.
- i. Pre-approved equal.

2. Description:

- a. Standard: ASSE 1079.
- b. Pressure Rating: 150 psig.
- c. End Connections: Solder-joint copper alloy and threaded ferrous.

C. Dielectric Flanges:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

- a. Capitol Manufacturing Company.
- b. Central Plastics Company.
- c. Matco-Norca, Inc.
- d. Watts Regulator Co.; a division of Watts Water Technologies, Inc.
- e. Wilkins; a Zurn company.
- f. Pre-approved equal.

2. Description:

- a. Standard: ASSE 1079.
- b. Factory-fabricated, bolted, companion-flange assembly.
- c. Pressure Rating: 150 psig.
- d. End Connections: Solder-joint copper alloy and threaded ferrous; threaded solder-joint copper alloy and threaded ferrous.

D. Dielectric-Flange Insulating Kits:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

- a. Advance Products & Systems, Inc.
- b. Calpico, Inc.
- c. Central Plastics Company.
- d. Pipeline Seal and Insulator, Inc.
- e. Pre-approved equal.

2. Description:

- a. Nonconducting materials for field assembly of companion flanges.
- b. Pressure Rating: 150 psig.
- c. Gasket: Neoprene or phenolic.
- d. Bolt Sleeves: Phenolic or polyethylene.
- e. Washers: Phenolic with steel backing washers.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine roughing-in for natural-gas piping system to verify actual locations of piping connections before equipment installation.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 PREPARATION

- A. Close equipment shutoff valves before turning off natural gas to premises or piping section.
- B. Inspect natural-gas piping according to the International Fuel Gas Code to determine that natural-gas utilization devices are turned off in piping section affected.
- C. Comply with the International Fuel Gas Code requirements for prevention of accidental ignition.

### 3.3 OUTDOOR PIPING INSTALLATION

- A. Comply with the International Fuel Gas Code for installation and purging of natural-gas piping.
- B. Install fittings for changes in direction and branch connections.
- C. Install pressure gage downstream from each service regulator. Pressure gages are specified in Section 230519 "Meters and Gages for HVAC Piping."

### 3.4 INDOOR PIPING INSTALLATION

- A. Comply with the International Fuel Gas Code for installation and purging of natural-gas piping.
- B. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems. Indicated locations and arrangements are used to size pipe and calculate friction loss, expansion, and other design considerations. Install piping as indicated unless deviations to layout are approved on Coordination Drawings.
- C. Arrange for pipe spaces, chases, slots, sleeves, and openings in building structure during progress of construction, to allow for mechanical installations.
- D. Install piping in concealed locations unless otherwise indicated and except in equipment rooms and service areas.
- E. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- F. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal.
- G. Locate valves for easy access.

- H. Install natural-gas piping at uniform grade of 2 percent down toward drip and sediment traps.
- I. Install piping free of sags and bends.
- J. Install fittings for changes in direction and branch connections.
- K. Verify final equipment locations for roughing-in.
- L. Comply with requirements in Sections specifying gas-fired appliances and equipment for roughing-in requirements.
- M. Drips and Sediment Traps: Install drips at points where condensate may collect, including service-meter outlets. Locate where accessible to permit cleaning and emptying. Do not install where condensate is subject to freezing.
  - 1. Construct drips and sediment traps using tee fitting with bottom outlet plugged or capped. Use nipple a minimum length of 3 pipe diameters, but not less than 3 inches long and same size as connected pipe. Install with space below bottom of drip to remove plug or cap.
- N. Extend relief vent connections for service regulators, line regulators, and overpressure protection devices to outdoors and terminate with weatherproof vent cap.
- O. Conceal pipe installations in walls, pipe spaces, utility spaces, above ceilings, below grade or floors, and in floor channels unless indicated to be exposed to view.
- P. Concealed Location Installations: Except as specified below, install concealed natural-gas piping and piping installed under the building in containment conduit constructed of steel pipe with welded joints as described in Part 2. Install a vent pipe from containment conduit to outdoors and terminate with weatherproof vent cap.
  - 1. Above Accessible Ceilings: Natural-gas piping, fittings, valves, and regulators may be installed in accessible spaces without containment conduit.
  - 2. In Walls or Partitions: Protect tubing installed inside partitions or hollow walls from physical damage using steel striker barriers at rigid supports.
    - a. Exception: Tubing passing through partitions or walls does not require striker barriers.
  - 3. Prohibited Locations:
    - a. Do not install natural-gas piping in or through circulating air ducts, clothes or trash chutes, chimneys or gas vents (flues), ventilating ducts, or dumbwaiter or elevator shafts.
    - b. Do not install natural-gas piping in solid walls or partitions.
- Q. Use eccentric reducer fittings to make reductions in pipe sizes. Install fittings with level side down.
- R. Connect branch piping from top or side of horizontal piping.
- S. Install unions in pipes NPS 2 and smaller, adjacent to each valve, at final connection to each piece of equipment. Unions are not required at flanged connections.

- T. Do not use natural-gas piping as grounding electrode.
- U. Install sleeves for piping penetrations of walls, ceilings, and floors. Comply with requirements for sleeves specified in Section 230517 "Sleeves and Sleeve Seals for HVAC Piping."

### 3.5 VALVE INSTALLATION

- A. Install manual gas shutoff valve for each gas appliance ahead of corrugated stainless-steel tubing, aluminum, or copper connector.

### 3.6 PIPING JOINT CONSTRUCTION

- A. Ream ends of pipes and tubes and remove burrs.
- B. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.
- C. Threaded Joints:
  - 1. Thread pipe with tapered pipe threads complying with ASME B1.20.1.
  - 2. Cut threads full and clean using sharp dies.
  - 3. Ream threaded pipe ends to remove burrs and restore full inside diameter of pipe.
  - 4. Apply appropriate tape or thread compound to external pipe threads unless dryseal threading is specified.
  - 5. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged. Do not use pipe sections that have cracked or open welds.
- D. Welded Joints:
  - 1. Construct joints according to AWS D10.12/D10.12M, using qualified processes and welding operators.
  - 2. Bevel plain ends of steel pipe.
  - 3. Patch factory-applied protective coating as recommended by manufacturer at field welds and where damage to coating occurs during construction.
- E. Brazed Joints: Construct joints according to AWS's "Brazing Handbook," "Pipe and Tube" Chapter.
- F. Flanged Joints: Install gasket material, size, type, and thickness appropriate for natural-gas service. Install gasket concentrically positioned.
- G. Flared Joints: Cut tubing with roll cutting tool. Flare tube end with tool to result in flare dimensions complying with SAE J513. Tighten finger tight, then use wrench. Do not overtighten.

### 3.7 HANGER AND SUPPORT INSTALLATION

- A. Comply with requirements for pipe hangers and supports specified in Section 230529 "Hangers and Supports for HVAC Piping and Equipment."
- B. Install hangers for horizontal steel piping with the following maximum spacing and minimum rod sizes:

1. NPS 1 and Smaller: Maximum span, 96 inches; minimum rod size, 3/8 inch.
2. NPS 1-1/4: Maximum span, 108 inches; minimum rod size, 3/8 inch.

### 3.8 CONNECTIONS

- A. Install natural-gas piping electrically continuous, and bonded to gas appliance equipment grounding conductor of the circuit powering the appliance according to NFPA 70.
- B. Install piping adjacent to appliances to allow service and maintenance of appliances.
- C. Connect piping to appliances using manual gas shutoff valves and unions. Install valve within 72 inches of each gas-fired appliance and equipment. Install union between valve and appliances or equipment.
- D. Sediment Traps: Install tee fitting with capped nipple in bottom to form drip, as close as practical to inlet of each appliance.

### 3.9 LABELING AND IDENTIFYING

- A. Comply with requirements in Section 230553 "Identification for HVAC Piping and Equipment" for piping and valve identification.

### 3.10 PAINTING

- A. Comply with requirements in Section 099113 "Exterior Painting" and Section 099123 "Interior Painting" for painting interior and exterior natural-gas piping.
- B. Paint exposed, exterior metal piping, valves, service regulators, service meters and meter bars, earthquake valves, and piping specialties, except components, with factory-applied paint or protective coating.
  1. Alkyd System: MPI EXT 5.1D.
    - a. Prime Coat: Alkyd anticorrosive metal primer.
    - b. Intermediate Coat: Exterior alkyd enamel matching topcoat.
    - c. Topcoat: Exterior alkyd enamel (semigloss).
    - d. Color: Gray.
- C. Paint exposed, interior metal piping, valves, service regulators, service meters and meter bars, earthquake valves, and piping specialties, except components, with factory-applied paint or protective coating.
  1. Latex Over Alkyd Primer System: MPI INT 5.1Q.
    - a. Prime Coat: Alkyd anticorrosive metal primer.
    - b. Intermediate Coat: Interior latex matching topcoat.
    - c. Topcoat: Interior latex (low sheen).
    - d. Color: Gray.
  2. Alkyd System: MPI INT 5.1E.
    - a. Prime Coat: Alkyd anticorrosive metal primer.

- b. Intermediate Coat: Interior alkyd matching topcoat.
  - c. Topcoat: Interior alkyd (eggshell).
  - d. Color: Gray.
- D. Damage and Touchup: Repair marred and damaged factory-applied finishes with materials and by procedures to match original factory finish.

### 3.11 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
- B. Tests and Inspections:
  - 1. Test, inspect, and purge natural gas according to the International Fuel Gas Code and authorities having jurisdiction.
- C. Natural-gas piping will be considered defective if it does not pass tests and inspections.
- D. Prepare test and inspection reports.

### 3.12 DEMONSTRATION

- A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, and maintain earthquake valves.

### 3.13 OUTDOOR PIPING SCHEDULE

- A. Aboveground natural-gas piping shall be one of the following:
  - 1. Steel pipe with malleable-iron fittings and threaded joints.
  - 2. Steel pipe with wrought-steel fittings and welded joints.

### 3.14 INDOOR PIPING SCHEDULE FOR SYSTEM PRESSURES LESS THAN 0.5 PSIG

- A. Aboveground, branch piping NPS 1 and smaller shall be one of the following:
  - 1. Steel pipe with malleable-iron fittings and threaded joints.
- B. Aboveground, distribution piping shall be one of the following:
  - 1. Steel pipe with malleable-iron fittings and threaded joints.
  - 2. Steel pipe with wrought-steel fittings and welded joints.

### 3.15 ABOVEGROUND MANUAL GAS SHUTOFF VALVE SCHEDULE

- A. Valves for pipe sizes NPS 2 and smaller at service meter shall be one of the following:
  - 1. One-piece, bronze ball valve with bronze trim.
  - 2. Two-piece, full-port, bronze ball valves with bronze trim.
  - 3. Bronze plug valve.



B. Distribution piping valves for pipe sizes NPS 2 and smaller shall be one of the following:

1. One-piece, bronze ball valve with bronze trim.
2. Two-piece, full-port, bronze ball valves with bronze trim.
3. Bronze plug valve.

C. Valves in branch piping for single appliance shall be one of the following:

1. One-piece, bronze ball valve with bronze trim.
2. Two-piece, full-port, bronze ball valves with bronze trim.
3. Bronze plug valve.

END OF SECTION 231123

## SECTION 232300 - REFRIGERANT PIPING

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. This Section includes refrigerant piping used for air-conditioning applications.

#### 1.2 PERFORMANCE REQUIREMENTS

- A. Line Test Pressure for Refrigerant:
  - 1. Suction Lines for Air-Conditioning Applications: 185 psig
  - 2. Suction Lines for Heat-Pump Applications: 325 psig
  - 3. Hot-Gas and Liquid Lines: 325 psig

#### 1.3 ACTION SUBMITTALS

- A. Product Data: For each type of valve and refrigerant piping specialty indicated. Include pressure drop based on manufacturer's test data.
- B. Shop Drawings: Show layout of refrigerant piping and specialties, including pipe, tube, and fitting sizes, flow capacities, valve arrangements and locations, slopes of horizontal runs, oil traps, double risers, wall and floor penetrations, and equipment connection details. Show interface and spatial relationships between piping and equipment.
  - 1. Refrigerant piping indicated on Drawings is schematic only. Size piping and design actual piping layout, including oil traps, double risers, specialties, and pipe and tube sizes to accommodate, as a minimum, equipment provided, elevation difference between compressor and evaporator, and length of piping to ensure proper operation and compliance with warranties of connected equipment.

#### 1.4 INFORMATIONAL SUBMITTALS

- A. Field quality-control test reports.

#### 1.5 CLOSEOUT SUBMITTALS

- A. Operation and maintenance data.

#### 1.6 QUALITY ASSURANCE

- A. Comply with ASHRAE 15, "Safety Code for Refrigeration Systems."
- B. Comply with ASME B31.5, "Refrigeration Piping and Heat Transfer Components."

## 1.7 PRODUCT STORAGE AND HANDLING

- A. Store piping in a clean and protected area with end caps in place to ensure that piping interior and exterior are clean when installed.

## PART 2 - PRODUCTS

### 2.1 COPPER TUBE AND FITTINGS

- A. Copper Tube: ASTM B 88, Type K or L
- B. Wrought-Copper Fittings: ASME B16.22.
- C. Wrought-Copper Unions: ASME B16.22.
- D. Solder Filler Metals: ASTM B 32. Use 95-5 tin antimony or alloy HB solder to join copper socket fittings on copper pipe.
- E. Brazing Filler Metals: AWS A5.8.
- F. Flexible Connectors:
  - 1. Body: Tin-bronze bellows with woven, flexible, tinned-bronze-wire-reinforced protective jacket.
  - 2. End Connections: Socket ends.
  - 3. Offset Performance: Capable of minimum 3/4-inch misalignment in minimum 7-inch long assembly.
  - 4. Pressure Rating: Factory test at minimum 500 psig
  - 5. Maximum Operating Temperature: 250 deg F

### 2.2 VALVES AND SPECIALTIES

- A. Diaphragm Packless Valves:
  - 1. Body and Bonnet: Forged brass or cast bronze; globe design with straight-through or angle pattern.
  - 2. Diaphragm: Phosphor bronze and stainless steel with stainless-steel spring.
  - 3. Operator: Rising stem and hand wheel.
  - 4. Seat: Nylon.
  - 5. End Connections: Socket, union, or flanged.
  - 6. Working Pressure Rating: 500 psig
  - 7. Maximum Operating Temperature: 275 deg F
- B. Packed-Angle Valves:
  - 1. Body and Bonnet: Forged brass or cast bronze.
  - 2. Packing: Molded stem, back seating, and replaceable under pressure.
  - 3. Operator: Rising stem.
  - 4. Seat: Nonrotating, self-aligning polytetrafluoroethylene.
  - 5. Seal Cap: Forged-brass or valox hex cap.
  - 6. End Connections: Socket, union, threaded, or flanged.

7. Working Pressure Rating: 500 psig
8. Maximum Operating Temperature: 275 deg F

C. Check Valves:

1. Body: Ductile iron, forged brass, or cast bronze; globe pattern.
2. Bonnet: Bolted ductile iron, forged brass, or cast bronze; or brass hex plug.
3. Piston: Removable polytetrafluoroethylene seat.
4. Closing Spring: Stainless steel.
5. Manual Opening Stem: Seal cap, plated-steel stem, and graphite seal.
6. End Connections: Socket, union, threaded, or flanged.
7. Maximum Opening Pressure: 0.50 psig
8. Working Pressure Rating: 500 psig
9. Maximum Operating Temperature: 275 deg F

D. Service Valves:

1. Body: Forged brass with brass cap including key end to remove core.
2. Core: Removable ball-type check valve with stainless-steel spring.
3. Seat: Polytetrafluoroethylene.
4. End Connections: Copper spring.
5. Working Pressure Rating: 500 psig

E. Solenoid Valves: Comply with ARI 760 and UL 429; listed and labeled by an NRTL.

1. Body and Bonnet: Plated steel.
2. Solenoid Tube, Plunger, Closing Spring, and Seat Orifice: Stainless steel.
3. Seat: Polytetrafluoroethylene.
4. End Connections: Threaded.
5. Electrical: Molded, watertight coil in NEMA 250 enclosure of type required by location with 1/2-inch conduit adapter, and 24V ac coil.
6. Working Pressure Rating: 400 psig
7. Maximum Operating Temperature: 240 deg F
8. Manual operator.

F. Safety Relief Valves: Comply with ASME Boiler and Pressure Vessel Code; listed and labeled by an NRTL.

1. Body and Bonnet: Ductile iron and steel, with neoprene O-ring seal.
2. Piston, Closing Spring, and Seat Insert: Stainless steel.
3. Seat Disc: Polytetrafluoroethylene.
4. End Connections: Threaded.
5. Working Pressure Rating: 400 psig
6. Maximum Operating Temperature: 240 deg F

G. Thermostatic Expansion Valves: Comply with ARI 750.

1. Body, Bonnet, and Seal Cap: Forged brass or steel.
2. Diaphragm, Piston, Closing Spring, and Seat Insert: Stainless steel.
3. Packing and Gaskets: Non-asbestos.
4. Capillary and Bulb: Copper tubing filled with refrigerant charge.
5. Suction Temperature: 40 deg F
6. Superheat: Adjustable
7. End Connections: Socket, flare, or threaded union.

8. Working Pressure Rating: 700 psig
- H. Straight-Type Strainers:
1. Body: Welded steel with corrosion-resistant coating.
  2. Screen: 100-mesh stainless steel.
  3. End Connections: Socket or flare.
  4. Working Pressure Rating: 500 psig
  5. Maximum Operating Temperature: 275 deg F
- I. Angle-Type Strainers:
1. Body: Forged brass or cast bronze.
  2. Drain Plug: Brass hex plug.
  3. Screen: 100-mesh monel.
  4. End Connections: Socket or flare.
  5. Working Pressure Rating: 500 psig
  6. Maximum Operating Temperature: 275 deg F
- J. Moisture/Liquid Indicators:
1. Body: Forged brass.
  2. Window: Replaceable, clear, fused glass window with indicating element protected by filter screen.
  3. Indicator: Color coded to show moisture content in ppm.
  4. Minimum Moisture Indicator Sensitivity: Indicate moisture above 60 ppm.
  5. End Connections: Socket or flare.
  6. Working Pressure Rating: 500 psig
  7. Maximum Operating Temperature: 240 deg F
- K. Replaceable-Core Filter Dryers: Comply with ARI 730.
1. Body and Cover: Painted-steel shell with ductile-iron cover, stainless-steel screws, and neoprene gaskets.
  2. Filter Media: 10 micron, pleated with integral end rings; stainless-steel support.
  3. Desiccant Media: Activated alumina
  4. End Connections: Socket.
  5. Access Ports: NPS 1/4 connections at entering and leaving sides for pressure differential measurement.
  6. Maximum Pressure Loss: 2 psig
  7. Working Pressure Rating: 500 psig
  8. Maximum Operating Temperature: 240 deg F
- L. Permanent Filter Dryers: Comply with ARI 730.
1. Body and Cover: Painted-steel shell.
  2. Filter Media: 10 micron, pleated with integral end rings; stainless-steel support.
  3. Desiccant Media: Activated alumina
  4. Designed for reverse flow (for heat-pump applications).
  5. End Connections: Socket.
  6. Access Ports: NPS 1/4 connections at entering and leaving sides for pressure differential measurement.
  7. Maximum Pressure Loss: 2 psig
  8. Working Pressure Rating: 500 psig

9. Maximum Operating Temperature: 240 deg F
- M. Liquid Accumulators: Comply with ARI 495.
1. Body: Welded steel with corrosion-resistant coating.
  2. End Connections: Socket or threaded.
  3. Working Pressure Rating: 500 psig
  4. Maximum Operating Temperature: 275 deg F

## PART 3 - EXECUTION

### 3.1 PIPING APPLICATIONS

- A. Suction Lines NPS 1-1/2 and Smaller for Conventional Air-Conditioning Applications: Copper, Type ACR, annealed-temper tubing and wrought-copper fittings with soldered joints.
- B. Hot-Gas and Liquid Lines, Copper, Type ACR, annealed-temper tubing and wrought-copper fittings with soldered joints.
- C. Safety-Relief-Valve Discharge Piping: Copper, Type ACR drawn-temper tubing and wrought-copper fittings with soldered joints.
- D. Safety-Relief-Valve Discharge Piping:
  1. NPS 1-1/2 and Smaller: Copper, Type ACR, annealed-temper tubing and wrought-copper fittings with soldered joints.
  2. L drawn-temper tubing and wrought-copper fittings with soldered joints.

### 3.2 VALVE AND SPECIALTY APPLICATIONS

- A. Install diaphragm packless valves in suction and discharge lines of compressor.
- B. Install service valves for gage taps at strainers if they are not an integral part of strainers.
- C. Install a check valve at the compressor discharge and a liquid accumulator at the compressor suction connection.
- D. Except as otherwise indicated, install diaphragm packless valves on inlet and outlet side of filter dryers.
- E. Install a full-sized, three-valve bypass around filter dryers.
- F. Install solenoid valves upstream from each expansion valve. Install solenoid valves in horizontal lines with coil at top.
- G. Install thermostatic expansion valves as close as possible to distributors on evaporators.
  1. Install valve so diaphragm case is warmer than bulb.
  2. Secure bulb to clean, straight, horizontal section of suction line using two bulb straps. Do not mount bulb in a trap or at bottom of the line.
  3. If external equalizer lines are required, make connection where it will reflect suction-line pressure at bulb location.

- H. Install safety relief valves where required by ASME Boiler and Pressure Vessel Code. Pipe safety-relief-valve discharge line to outside according to ASHRAE 15.
- I. Install moisture/liquid indicators in liquid line at the inlet of the thermostatic expansion valve or at the inlet of the evaporator coil capillary tube.
- J. Install strainers upstream from and adjacent to the following unless they are furnished as an integral assembly for device being protected:
  - 1. Solenoid valves.
  - 2. Thermostatic expansion valves.
  - 3. Compressor.
- K. Install filter dryers in liquid line between compressor and thermostatic expansion valve, and in the suction line at the compressor.
- L. Install flexible connectors at compressors.

### 3.3 PIPING INSTALLATION

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems; indicated locations and arrangements were used to size pipe and calculate friction loss, expansion, pump sizing, and other design considerations. Install piping as indicated unless deviations to layout are approved on Shop Drawings.
- B. Install refrigerant piping according to ASHRAE 15.
- C. Install piping in concealed locations unless otherwise indicated and except in equipment rooms and service areas.
- D. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- E. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal.
- F. Install piping adjacent to machines to allow service and maintenance.
- G. Install piping free of sags and bends.
- H. Install fittings for changes in direction and branch connections.
- I. Select system components with pressure rating equal to or greater than system operating pressure.
- J. Refer to Section 230900 "Instrumentation and Control for HVAC" and Section 230993 "Sequence and Operations for HVAC Controls" for solenoid valve controllers, control wiring, and sequence of operation.
- K. Install piping as short and direct as possible, with a minimum number of joints, elbows, and fittings.
- L. Install refrigerant piping in protective conduit where installed belowground.

- M. Install refrigerant piping in rigid or flexible conduit in locations where exposed to mechanical injury.
- N. Slope refrigerant piping as follows:
  - 1. Install horizontal hot-gas discharge piping with a uniform slope downward away from compressor.
  - 2. Install horizontal suction lines with a uniform slope downward to compressor.
  - 3. Install traps and double risers to entrain oil in vertical runs.
  - 4. Liquid lines may be installed level.
- O. When brazing or soldering, remove solenoid-valve coils and sight glasses; also remove valve stems, seats, and packing, and accessible internal parts of refrigerant specialties. Do not apply heat near expansion-valve bulb.
- P. Install piping with adequate clearance between pipe and adjacent walls and hangers or between pipes for insulation installation.
- Q. Identify refrigerant piping and valves according to Section 230553 "Identification for HVAC Piping and Equipment."
- R. Install sleeves for piping penetrations of walls, ceilings, and floors. Comply with requirements for sleeves specified in Section 230517 "Sleeves and Sleeve Seals for HVAC Piping."
- S. Install sleeve seals for piping penetrations of concrete walls and slabs. Comply with requirements for sleeve seals specified in Section 230517 "Sleeves and Sleeve Seals for HVAC Piping."
- T. Install escutcheons for piping penetrations of walls, ceilings, and floors. Comply with requirements for escutcheons specified in Section 230518 "Escutcheons for HVAC Piping."

### 3.4 PIPE JOINT CONSTRUCTION

- A. Soldered Joints: Construct joints according to ASTM B 828 or CDA's "Copper Tube Handbook."
- B. Brazed Joints: Construct joints according to AWS's "Brazing Handbook," Chapter "Pipe and Tube."
  - 1. Use Type BcuP, copper-phosphorus alloy for joining copper socket fittings with copper pipe.
  - 2. Use Type BAg, cadmium-free silver alloy for joining copper with bronze or steel.

### 3.5 HANGERS AND SUPPORTS

- A. Hanger, support, and anchor products are specified in Section 230529 "Hangers and Supports for HVAC Piping and Equipment."
- B. Install the following pipe attachments:
  - 1. Adjustable steel clevis hangers for individual horizontal runs less than 20 feet long.
  - 2. Roller hangers and spring hangers for individual horizontal runs 20 feet or longer.



3. Pipe Roller: MSS SP-58, Type 44 for multiple horizontal piping 20 feet or longer, supported on a trapeze.
4. Spring hangers to support vertical runs.
5. Copper-clad hangers and supports for hangers and supports in direct contact with copper pipe.

C. Install hangers for copper tubing with the following maximum spacing and minimum rod sizes:

1. NPS 1/2: Maximum span, 60 inches minimum rod size, 1/4 inch (6.4 mm).
2. NPS 5/8 Maximum span, 60 inches minimum rod size, 1/4 inch
3. NPS 1: Maximum span, 72 inches minimum rod size, 1/4 inch
4. NPS 1-1/4: Maximum span, 96 inches minimum rod size, 3/8 inch.
5. NPS 1-1/2 Maximum span, 96 inches minimum rod size, 3/8 inch

D. Support multifloor vertical runs at least at each floor.

### 3.6 FIELD QUALITY CONTROL

A. Perform tests and inspections and prepare test reports.

B. Tests and Inspections:

1. Comply with ASME B31.5, Chapter VI.
2. Test refrigerant piping and specialties. Isolate compressor, condenser, evaporator, and safety devices from test pressure if they are not rated above the test pressure.
3. Test high- and low-pressure side piping of each system separately at not less than the pressures indicated in Part 1 "Performance Requirements" Article.
  - a. Fill system with nitrogen to the required test pressure.
  - b. System shall maintain test pressure at the manifold gage throughout duration of test.
  - c. Test joints and fittings with electronic leak detector or by brushing a small amount of soap and glycerin solution over joints.
  - d. Remake leaking joints using new materials, and retest until satisfactory results are achieved.

### 3.7 SYSTEM CHARGING

A. Charge system using the following procedures:

1. Install core in filter dryers after leak test but before evacuation.
2. Evacuate entire refrigerant system with a vacuum pump to 500 micrometers. If vacuum holds for 12 hours, system is ready for charging.
3. Break vacuum with refrigerant gas, allowing pressure to build up to 2 psig.
4. Charge system with a new filter-dryer core in charging line.

### 3.8 ADJUSTING

A. Adjust thermostatic expansion valve to obtain proper evaporator superheat.

- B. Adjust high- and low-pressure switch settings to avoid short cycling in response to fluctuating suction pressure.
- C. Adjust set-point temperature of air-conditioning or chilled-water controllers to the system design temperature.
- D. Perform the following adjustments before operating the refrigeration system, according to manufacturer's written instructions:
  - 1. Open shutoff valves in condenser water circuit.
  - 2. Verify that compressor oil level is correct.
  - 3. Open compressor suction and discharge valves.
  - 4. Open refrigerant valves except bypass valves that are used for other purposes.
  - 5. Check open compressor-motor alignment and verify lubrication for motors and bearings.
- E. Replace core of replaceable filter dryer after system has been adjusted and after design flow rates and pressures are established.

END OF SECTION 232300

## SECTION 233113 - METAL DUCTS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Low pressure rectangular ducts and fittings.
  - 2. Low pressure ductwork.
  - 3. Single-wall round and flat-oval ducts and fittings.
  - 4. Single-wall round ductwork.
  - 5. Sheet metal materials.
  - 6. Duct liner.
  - 7. Sealants and gaskets.
  - 8. Hangers and supports.

#### 1.3 PERFORMANCE REQUIREMENTS

- A. Structural Performance: Duct hangers and supports shall withstand the effects of gravity loads and stresses within limits and under conditions described in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
- B. Airstream Surfaces: Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1.

#### 1.4 ACTION SUBMITTALS

- A. Product Data: For each type of the following products:
  - 1. Liners and adhesives.
  - 2. Sealants and gaskets.
- B. Shop Drawings:
  - 1. Fabrication, assembly, and installation, including plans, elevations, sections, components, and attachments to other work.
  - 2. Factory- and shop-fabricated ducts and fittings.
  - 3. Duct layout indicating sizes, configuration, liner material, and static-pressure classes.
  - 4. Elevation of bottom of ducts.
  - 5. Dimensions of main duct runs from building grid lines.
  - 6. Fittings.
  - 7. Reinforcement and spacing.
  - 8. Seam and joint construction.

9. Penetrations through fire-rated and other partitions.
10. Equipment installation based on equipment being used on Project.
11. Locations for duct accessories, including dampers, turning vanes, and access doors and panels.
12. Hangers and supports, including methods for duct and building attachment and vibration isolation.

## 1.5 INFORMATIONAL SUBMITTALS

## 1.6 QUALITY ASSURANCE

- A. ASHRAE Compliance: Applicable requirements in ASHRAE 62.1, Section 5 - "Systems and Equipment" and Section 7 - "Construction and System Start-up."
- B. ASHRAE/IESNA Compliance: Applicable requirements in ASHRAE/IESNA 90.1, Section 6.4.4 - "HVAC System Construction and Insulation."

## PART 2 - PRODUCTS

### 2.1 SHEET METAL MATERIALS

- A. General Material Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for acceptable materials, material thicknesses, and duct construction methods unless otherwise indicated. Sheet metal materials shall be free of pitting, seam marks, roller marks, stains, discolorations, and other imperfections.
- B. Galvanized Sheet Steel: Comply with ASTM A 653/A 653M.
  1. Galvanized Coating Designation: G60.
  2. Finishes for Surfaces Exposed to View: Mill phosphatized.
- C. Duct materials other than the above is specified in the particular ductwork description.
- D. Stainless-Steel Sheets: Comply with ASTM A 480/A 480M, Type 304 or 316, as indicated in the "Duct Schedule" Article; cold rolled, annealed, sheet. Exposed surface finish shall be as indicated in the Duct Schedule.
- E. Carbon-Steel Sheets: ASTM A 366/A 366M, cold-rolled sheets; commercial quality; with oiled, exposed matte finish.

### 2.2 LOW PRESSURE RECTANGULAR DUCTS AND FITTINGS

- A. General Fabrication Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible, Second Edition-1995" based on 2" w.g. static-pressure class, Table 1-5.
- B. Transverse Joints: Select joint types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible, Second Edition-1995," Tables 1-10 through 1-13, "Rectangular Duct/Transverse Joints," for 2" w.g. static-pressure class, applicable sealing

requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible, Second Edition-1995."

- C. Longitudinal Seams: Select seam types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible, Second Edition-1995," Figure 1-5, "Rectangular Duct/Longitudinal Seams," for 2" w.g. static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible, Second Edition-1995."
- D. Elbows, Transitions, Offsets, Branch Connections, and Other Duct Construction: Select types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible, Second Edition-1995," Chapter 2, "Fittings and Other Construction," for 2" w.g. static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible, Second Edition-1995."
  - 1. All elbows or offsets in rectangular ductwork under positive pressure shall contain turning vanes. Turning vanes in low pressure ductwork shall be single wall.
  - 2. All rectangular branch takeoffs in supply ductwork shall be of the 45 deg. entry design with a manual damper. Round take-offs in supply ductwork shall use rectangular to round transition with 45 degree entry design and a manual damper in the round, Sheet Metal Connectors H.E.T. (Hi-Efficiency Take-Off) or equal.

### 2.3 SINGLE-WALL ROUND AND FLAT-OVAL DUCTS AND FITTINGS

- A. Low pressure round ducts shall be constructed per SMACNA HVAC Construction Standards, Table 3-2, 2" w.g. (pos.), Second Edition, 1995 with Addendum No. 1, for galvanized steel with grooved longitudinal seam and sleeved type transverse joint, pipe riveted. Hangers shall be 2" band, attached at duct joints with draw bands. Spiral duct and fittings per paragraph below may be used as an option.
- B. Round ducts in medium pressure systems and ahead of terminal boxes shall be of the continuous weld or continuous lock seam construction from ASTM A-527-67 galvanized steel. All round fittings shall be manufactured from galvanized steel with continuous welds or locked seams. Gasketed self-sealing spiral duct and fittings installed in accordance with manufacturer's instructions may be used. All round ducts and fittings shall be equal constructed to the gauges called for in SMACNA HVAC Round Duct Construction Standards, Table 3-2, for spiral lock seam duct, 10" w.g., Second Edition, 1995 with Addendum No. 1.
- C. All exposed round ducts regardless of system pressure, shall be constructed as described in paragraph B above.
- D. All round ducts shall be sealed per SMACNA seal classification "B" requirements.

### 2.4 DUCT LINER

- A. Fibrous-Glass Duct Liner: Comply with ASTM C 1071, NFPA 90A, or NFPA 90B; and with NAIMA AH124, "Fibrous Glass Duct Liner Standard."
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

- a. CertainTeed Corporation.
  - b. Johns Manville.
  - c. Knauf Insulation.
  - d. Owens Corning.
  - e. Pre-approved equal.
2. Minimum Thermal Conductivity:
    - a. Type I, Flexible: 0.27 Btu x in./h x sq. ft. x deg F at 75 deg F mean temperature.
  3. Antimicrobial Erosion-Resistant Coating: Apply to the surface of the liner that will form the interior surface of the duct to act as a moisture repellent and erosion-resistant coating. Antimicrobial compound shall be tested for efficacy by an NRTL and registered by the EPA for use in HVAC systems.
  4. Water-Based Liner Adhesive: Comply with NFPA 90A or NFPA 90B and with ASTM C 916.
    - a. For indoor applications, adhesive shall have a VOC content of 80 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
    - b. Adhesive shall comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."
- B. Shop Application of Duct Liner: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 7-11, "Flexible Duct Liner Installation."
1. Adhere a single layer of indicated thickness of duct liner with at least 90 percent adhesive coverage at liner contact surface area. Attaining indicated thickness with multiple layers of duct liner is prohibited.
  2. Apply adhesive to transverse edges of liner facing upstream that do not receive metal nosing.
  3. Butt transverse joints without gaps, and coat joint with adhesive.
  4. Fold and compress liner in corners of rectangular ducts or cut and fit to ensure butted-edge overlapping.
  5. Secure liner with mechanical fasteners 4 inches from corners and at intervals not exceeding 12 inches transversely; at 3 inches from transverse joints and at intervals not exceeding 18 inches longitudinally.
  6. Secure transversely oriented liner edges facing the airstream with metal nosings that have either channel or "Z" profiles or are integrally formed from duct wall. Fabricate edge facings at the following locations:
    - a. Fan discharges.
    - b. Intervals of lined duct preceding unlined duct.

## 2.5 SEALANT AND GASKETS

- A. General Sealant and Gasket Requirements: Surface-burning characteristics for sealants and gaskets shall be a maximum flame-spread index of 25 and a maximum smoke-developed index of 50 when tested according to UL 723; certified by an NRTL.
- B. Water-Based Joint and Seam Sealant:

1. Application Method: Brush on.
2. Solids Content: Minimum 65 percent.
3. Shore A Hardness: Minimum 20.
4. Water resistant.
5. Mold and mildew resistant.
6. VOC: Maximum 75 g/L (less water).
7. Maximum Static-Pressure Class: 10-inch wg, positive and negative.
8. Service: Indoor or outdoor.
9. Substrate: Compatible with galvanized sheet steel (both PVC coated and bare), stainless steel, or aluminum sheets.

C. Flanged Joint Sealant: Comply with ASTM C 920.

1. General: Single-component, acid-curing, silicone, elastomeric.
2. Type: S.
3. Grade: NS.
4. Class: 25.
5. Use: O.
6. For indoor applications, sealant shall have a VOC content of 250 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
7. Sealant shall comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."

D. Flange Gaskets: Butyl rubber, neoprene, or EPDM polymer with polyisobutylene plasticizer.

E. Round Duct Joint O-Ring Seals:

1. Seal shall provide maximum 3 cfm/100 sq. ft. at 1-inch wg and shall be rated for 10-inch wg static-pressure class, positive or negative.

## 2.6 HANGERS AND SUPPORTS

A. Hanger Rods for Noncorrosive Environments: Cadmium-plated steel rods and nuts.

B. Hanger Rods for Corrosive Environments: Electrogalvanized, all-thread rods or galvanized rods with threads painted with zinc-chromate primer after installation.

C. Strap and Rod Sizes: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible, Second Edition-1995," Table 4-1, "Rectangular Duct Hangers Minimum Size," and Table 4-2, "Minimum Hanger Sizes for Round Duct."

D. Duct Attachments: Sheet metal screws, blind rivets, or self-tapping metal screws; compatible with duct materials.

E. Trapeze and Riser Supports:

1. Supports for Galvanized-Steel Ducts: Galvanized-steel shapes and plates.
2. Supports for Stainless-Steel Ducts: Stainless-steel shapes and plates.
3. Supports for Aluminum Ducts: Aluminum or galvanized steel coated with zinc chromate.

## PART 3 - EXECUTION

### 3.1 DUCT INSTALLATION

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of duct system. Indicated duct locations, configurations, and arrangements were used to size ducts and calculate friction loss for air-handling equipment sizing and for other design considerations. Install duct systems as indicated unless deviations to layout are approved on Shop Drawings and Coordination Drawings.
- B. Install ducts according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible, Second Edition-1995" unless otherwise indicated.
- C. Install round and flat-oval ducts in maximum practical lengths.
- D. Install ducts with fewest possible joints.
- E. Install factory- or shop-fabricated fittings for changes in direction, size, and shape and for branch connections.
- F. Unless otherwise indicated, install ducts vertically and horizontally, and parallel and perpendicular to building lines.
- G. Install ducts close to walls, overhead construction, columns, and other structural and permanent enclosure elements of building.
- H. Install ducts with a minimum clearance of 1 inch, plus allowance for insulation thickness.
- I. Where ducts pass through non-fire-rated interior partitions and exterior walls and are exposed to view, cover the opening between the partition and duct or duct insulation with sheet metal flanges of same metal thickness as the duct. Overlap openings on four sides by at least 1-1/2 inches.
- J. Where ducts pass through fire-rated interior partitions and exterior walls, install fire dampers. Comply with requirements in Section 233300 "Air Duct Accessories" for fire and smoke dampers.
- K. Protect duct interiors from moisture, construction debris and dust, and other foreign materials.

### 3.2 INSTALLATION OF EXPOSED DUCTWORK

- A. Protect ducts exposed in finished spaces from being dented, scratched, or damaged.
- B. Trim duct sealants flush with metal. Create a smooth and uniform exposed bead. Do not use two-part tape sealing system.
- C. Grind welds to provide smooth surface free of burrs, sharp edges, and weld splatter. When welding stainless steel with a No. 3 or 4 finish, grind the welds flush, polish the exposed welds, and treat the welds to remove discoloration caused by welding.
- D. Maintain consistency, symmetry, and uniformity in the arrangement and fabrication of fittings, hangers and supports, duct accessories, and air outlets.



- E. Repair or replace damaged sections and finished work that does not comply with these requirements.

### 3.3 DUCT SEALING

- A. Seal ducts for duct static-pressure, seal classes, and leakage classes specified in ductwork schedule on drawings.

### 3.4 HANGER AND SUPPORT INSTALLATION

- A. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible, Second Edition-1995," Chapter 4, "Hangers and Supports."
- B. Building Attachments: Concrete inserts, powder-actuated fasteners, or structural-steel fasteners appropriate for construction materials to which hangers are being attached.
  - 1. Where practical, install concrete inserts before placing concrete.
  - 2. Install powder-actuated concrete fasteners after concrete is placed and completely cured.
  - 3. Use powder-actuated concrete fasteners for standard-weight aggregate concretes or for slabs more than 4 inches thick.
  - 4. Do not use powder-actuated concrete fasteners for lightweight-aggregate concretes or for slabs less than 4 inches thick.
- C. Hanger Spacing: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Table 5-1, "Rectangular Duct Hangers Minimum Size," and Table 5-2, "Minimum Hanger Sizes for Round Duct," for maximum hanger spacing; install hangers and supports within 24 inches of each elbow and within 48 inches of each branch intersection.
- D. Hangers Exposed to View: Threaded rod and angle or channel supports.
- E. Support vertical ducts with steel angles or channel secured to the sides of the duct with welds, bolts, sheet metal screws, or blind rivets; support at each floor and at a maximum intervals of 16 feet.
- F. Install upper attachments to structures. Select and size upper attachments with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.

### 3.5 CONNECTIONS

- A. Make connections to equipment with flexible connectors complying with Section 233300 "Air Duct Accessories."
- B. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible, Second Edition-1995" for branch, outlet and inlet, and terminal unit connections.

### 3.6 PAINTING

- A. Paint interior of metal ducts that are visible through registers and grilles and that do not have duct liner. Apply one coat of flat, black, latex paint over a compatible galvanized-steel primer.

### 3.7 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
- B. Leakage Tests:
  - 1. Comply with SMACNA's "HVAC Air Duct Leakage Test Manual." Submit a test report for each test.
  - 2. Test the following systems:
    - a. Ducts with a Pressure Class Higher Than 3-Inch wg: Test representative duct sections totaling no less than 25 percent of total installed duct area for each designated pressure class.
  - 3. Disassemble, reassemble, and seal segments of systems to accommodate leakage testing and for compliance with test requirements.
  - 4. Test for leaks before applying external insulation.
  - 5. Conduct tests at static pressures equal to maximum design pressure of system or section being tested. If static-pressure classes are not indicated, test system at maximum system design pressure. Do not pressurize systems above maximum design operating pressure.
  - 6. Give seven days' advance notice for testing.
- C. Duct System Cleanliness Tests:
  - 1. Visually inspect duct system to ensure that no visible contaminants are present.
  - 2. Test sections of metal duct system, chosen randomly by Owner, for cleanliness according to "Vacuum Test" in NADCA ACR, "Assessment, Cleaning and Restoration of HVAC Systems."
    - a. Acceptable Cleanliness Level: Net weight of debris collected on the filter media shall not exceed 0.75 mg/100 sq. cm.

### 3.8 DUCT CLEANING

- A. Clean duct system(s) before testing, adjusting, and balancing.
- B. Use service openings for entry and inspection.
  - 1. Create new openings and install access panels appropriate for duct static-pressure class if required for cleaning access. Provide insulated panels for insulated or lined duct. Patch insulation and liner as recommended by duct liner manufacturer. Comply with Section 233300 "Air Duct Accessories" for access panels and doors.
  - 2. Disconnect and reconnect flexible ducts as needed for cleaning and inspection.
  - 3. Remove and reinstall ceiling to gain access during the cleaning process.
- C. Particulate Collection and Odor Control:
  - 1. When venting vacuuming system inside the building, use HEPA filtration with 99.97 percent collection efficiency for 0.3-micron-size (or larger) particles.
  - 2. When venting vacuuming system to outdoors, use filter to collect debris removed from HVAC system, and locate exhaust downwind and away from air intakes and other points of entry into building.

D. Clean the following components by removing surface contaminants and deposits:

1. Air outlets and inlets (registers, grilles, and diffusers).
2. Supply, return, and exhaust fans including fan housings, plenums (except ceiling supply and return plenums), scrolls, blades or vanes, shafts, baffles, dampers, and drive assemblies.
3. Air-handling unit internal surfaces and components including mixing box, coil section, air wash systems, spray eliminators, condensate drain pans, humidifiers and dehumidifiers, filters and filter sections, and condensate collectors and drains.
4. Coils and related components.
5. Return-air ducts, dampers, actuators, and turning vanes except in ceiling plenums and mechanical equipment rooms.
6. Supply-air ducts, dampers, actuators, and turning vanes.
7. Dedicated exhaust and ventilation components and makeup air systems.

E. Mechanical Cleaning Methodology:

1. Clean metal duct systems using mechanical cleaning methods that extract contaminants from within duct systems and remove contaminants from building.
2. Use vacuum-collection devices that are operated continuously during cleaning. Connect vacuum device to downstream end of duct sections so areas being cleaned are under negative pressure.
3. Use mechanical agitation to dislodge debris adhered to interior duct surfaces without damaging integrity of metal ducts, duct liner, or duct accessories.
4. Clean fibrous-glass duct liner with HEPA vacuuming equipment; do not permit duct liner to get wet. Replace fibrous-glass duct liner that is damaged, deteriorated, or delaminated or that has friable material, mold, or fungus growth.
5. Clean coils and coil drain pans according to NADCA 1992. Keep drain pan operational. Rinse coils with clean water to remove latent residues and cleaning materials; comb and straighten fins.
6. Provide drainage and cleanup for wash-down procedures.
7. Antimicrobial Agents and Coatings: Apply EPA-registered antimicrobial agents if fungus is present. Apply antimicrobial agents according to manufacturer's written instructions after removal of surface deposits and debris.

### 3.9 START UP

- A. Air Balance: Comply with requirements in "Testing, Adjusting, and Balancing for HVAC."

### 3.10 DUCT SCHEDULE

- A. Fabricate ducts with galvanized sheet steel except as otherwise indicated and as follows.
- B. Refer to ductwork schedule on drawings.

END OF SECTION 233113

## SECTION 233300 - DUCT ACCESSORIES

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. This Section includes the following:
1. Backdraft dampers.
  2. Volume dampers.
  3. Turning vanes.
  4. Duct-mounting access doors.
  5. Flexible connectors.
  6. Flexible ducts.
  7. Duct accessory hardware.

#### 1.2 SUBMITTALS

- A. Product Data: For the following:
1. Backdraft dampers.
  2. Volume dampers.
  3. Turning vanes.
  4. Duct-mounting access doors.
  5. Flexible connectors.
  6. Flexible ducts.
- B. Shop Drawings: Detail equipment assemblies and indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
1. Special fittings.
  2. Manual-volume damper installations.
  3. Wiring Diagrams: Power, signal, and control wiring.

#### 1.3 QUALITY ASSURANCE

- A. Comply with NFPA 90A, "Installation of Air Conditioning and Ventilating Systems," and NFPA 90B, "Installation of Warm Air Heating and Air Conditioning Systems."

### PART 2 - PRODUCTS

#### 2.1 MANUFACTURERS

- A. In other Part 2 articles where titles below introduce lists, the following requirements apply to product selection:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the manufacturers specified.

## 2.2 SHEET METAL MATERIALS

- A. Comply with SMACNA's "HVAC Duct Construction Standards--Metal and Flexible" for acceptable materials, material thicknesses, and duct construction methods, unless otherwise indicated.
- B. Galvanized Sheet Steel: Lock-forming quality; complying with ASTM A 653/A 653M and having G90 coating designation; ducts shall have mill-phosphatized finish for surfaces exposed to view.
- C. Stainless Steel: ASTM A 480/A 480M.
- D. Aluminum Sheets: ASTM B 209, alloy 3003, temper H14; with mill finish for concealed ducts and standard, 1-side bright finish for exposed ducts.
- E. Extruded Aluminum: ASTM B 221, alloy 6063, temper T6.
- F. Reinforcement Shapes and Plates: Galvanized-steel reinforcement where installed on galvanized sheet metal ducts; compatible materials for aluminum and stainless-steel ducts.
- G. Tie Rods: Galvanized steel, 1/4-inch minimum diameter for lengths 36 inches or less; 3/8-inch minimum diameter for lengths longer than 36 inches.

## 2.3 BACKDRAFT DAMPERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  1. Air Balance, Inc.
  2. American Warming and Ventilating.
  3. CESCO Products.
  4. Duro Dyne Corp.
  5. Greenheck.
  6. Penn Ventilation Company, Inc.
  7. Prefco Products, Inc.
  8. Ruskin Company.
  9. Vent Products Company, Inc.
  10. Pre-approved equal.
- B. Description: Multiple-blade, parallel action gravity balanced, with center-pivoted blades of maximum 6-inch width, with sealed edges, assembled in rattle-free manner with 90-degree stop, steel ball bearings, and axles; adjustment device to permit setting for varying differential static pressure.
- C. Frame: 0.052-inch-thick, galvanized sheet steel, with welded corners and mounting flange.
- D. Blades: 0.050-inch-thick aluminum sheet.
- E. Blade Seals: Neoprene.

- F. Blade Axles: Galvanized steel.
- G. Tie Bars and Brackets: Galvanized steel.
- H. Return Spring: Adjustable tension.

## 2.4 VOLUME DAMPERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Air Balance, Inc.
  - 2. American Warming and Ventilating.
  - 3. Flexmaster U.S.A., Inc.
  - 4. McGill AirFlow Corporation.
  - 5. METALAIRE, Inc.
  - 6. Nailor Industries Inc.
  - 7. Penn Ventilation Company, Inc.
  - 8. Ruskin Company.
  - 9. Vent Products Company, Inc.
  - 10. Greenheck Fan Corporation
  - 11. Pre-approved equal.
- B. General Description: Factory fabricated, with required hardware and accessories. Stiffen damper blades for stability. Include locking device to hold single-blade dampers in a fixed position without vibration. Close duct penetrations for damper components to seal duct consistent with pressure class.
- C. Standard Volume Dampers: Multiple- or single-blade, parallel- or opposed-blade design as indicated, standard leakage rating, with linkage outside airstream, and suitable for horizontal or vertical applications.
  - 1. Steel Frames: Hat-shaped, galvanized sheet steel channels, minimum of 0.064 inch thick, with mitered and welded corners; frames with flanges where indicated for attaching to walls and flangeless frames where indicated for installing in ducts.
  - 2. Roll-Formed Steel Blades: 0.064-inch-thick, galvanized sheet steel.
  - 3. Blade Axles: Galvanized steel.
  - 4. Bearings: Oil-impregnated bronze.
  - 5. Tie Bars and Brackets: Galvanized steel.
- D. Jackshaft: 1-inch-diameter, galvanized-steel pipe rotating within pipe-bearing assembly mounted on supports at each mullion and at each end of multiple-damper assemblies.
  - 1. Length and Number of Mountings: Appropriate to connect linkage of each damper in multiple-damper assembly.
- E. Damper Hardware: Zinc-plated, die-cast core with dial and handle made of 3/32-inch-thick zinc-plated steel, and a 3/4-inch hexagon locking nut. Include center hole to suit damper operating-rod size. Include elevated platform for insulated duct mounting.

## 2.5 TURNING VANES

- A. Fabricate to comply with SMACNA's "HVAC Duct Construction Standards--Metal and Flexible" for vanes and vane runners. Vane runners shall automatically align vanes.
- B. Manufactured Turning Vanes: Fabricate 1-1/2-inch-wide, double-vane, curved blades of galvanized sheet steel set 3/4 inch o.c.; support with bars perpendicular to blades set 2 inches o.c.; and set into vane runners suitable for duct mounting.
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Ductmate Industries, Inc.
    - b. Duro Dyne Corp.
    - c. METALAIRE, Inc.
    - d. Ward Industries, Inc.
    - e. Pre-approved equal.
- C. Acoustic Turning Vanes: Fabricate airfoil-shaped aluminum extrusions with perforated faces and fibrous-glass fill.

## 2.6 DUCT-MOUNTING ACCESS DOORS

- A. General Description: Fabricate doors airtight and suitable for duct pressure class.
- B. Door: Double wall, duct mounting, and rectangular; fabricated of galvanized sheet metal with insulation fill and thickness as indicated for duct pressure class. Include vision panel where indicated. Include 1-by-1-inch butt or piano hinge and cam latches.
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. American Warming and Ventilating.
    - b. CESCO Products.
    - c. Ductmate Industries, Inc.
    - d. Flexmaster U.S.A., Inc.
    - e. Greenheck.
    - f. McGill AirFlow Corporation.
    - g. Nailor Industries Inc.
    - h. Ventfabrics, Inc.
    - i. Ward Industries, Inc.
    - j. Elgen Manufacturing
    - k. Pre-approved equal.
  - 2. Frame: Galvanized sheet steel, with bend-over tabs and foam gaskets.
  - 3. Provide number of hinges and locks as follows:
    - a. Less Than 12 Inches Square: Secure with two sash locks.
    - b. Up to 18 Inches Square: Two hinges and two sash locks.
    - c. Up to 24 by 48 Inches: Three hinges and two compression latches.
    - d. Sizes 24 by 48 Inches and Larger: One additional hinge.
- C. Seal around frame attachment to duct and door to frame with neoprene or foam rubber.

- D. Insulation: 1-inch-thick, fibrous-glass or polystyrene-foam board.

## 2.7 FLEXIBLE CONNECTORS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Ductmate Industries, Inc.
  - 2. Duro Dyne Corp.
  - 3. Ventfabrics, Inc.
  - 4. Ward Industries, Inc.
  - 5. Pre-approved equal.
- B. General Description: Flame-retardant or noncombustible fabrics, coatings, and adhesives complying with UL 181, Class 1.
- C. Flexible Connector Fabric: Glass fabric double coated with neoprene.
  - 1. Minimum Weight: 26 oz./sq. yd.
  - 2. Tensile Strength: 480 lbf/inch in the warp and 360 lbf/inch in the filling.
  - 3. Service Temperature: Minus 40 to plus 200 deg F.

## 2.8 FLEXIBLE DUCTS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Flexmaster U.S.A., Inc.
  - 2. Thermaflex.
  - 3. McGill AirFlow Corporation.
  - 4. Pre-approved equal.
- B. Insulated-Duct Connectors: UL 181, Class 1, 2-ply vinyl film supported by helically wound, spring-steel wire; fibrous-glass insulation; aluminized vapor barrier film.
  - 1. Pressure Rating: 10-inch wg positive and 1.0-inch wg negative.
  - 2. Maximum Air Velocity: 4000 fpm.
  - 3. Temperature Range: Minus 10 to plus 160 deg F.
- C. Flexible Duct Clamps: Stainless-steel band with cadmium-plated hex screw to tighten band with a worm-gear action, in sizes 3 through 18 inches to suit duct size.

## 2.9 DUCT ACCESSORY HARDWARE

- A. Instrument Test Holes: Cast iron or cast aluminum to suit duct material, including screw cap and gasket. Size to allow insertion of pitot tube and other testing instruments and of length to suit duct insulation thickness.
- B. Adhesives: High strength, quick setting, neoprene based, waterproof, and resistant to gasoline and grease.



## PART 3 - EXECUTION

### 3.1 APPLICATION AND INSTALLATION

- A. Install duct accessories according to applicable details in SMACNA's "HVAC Duct Construction Standards--Metal and Flexible" for metal ducts and in NAIMA AH116, "Fibrous Glass Duct Construction Standards," for fibrous-glass ducts.
- B. Provide duct accessories of materials suited to duct materials; use galvanized-steel accessories in galvanized-steel and fibrous-glass ducts, stainless-steel accessories in stainless-steel ducts, and aluminum accessories in aluminum ducts.
- C. Install backdraft dampers on exhaust fans or exhaust ducts nearest to outside and where indicated.
- D. Install volume dampers in ducts with liner; avoid damage to and erosion of duct liner.
- E. Provide balancing dampers at points on supply, return, and exhaust systems where branches lead from larger ducts as required for air balancing. Install at a minimum of two duct widths from branch takeoff.
- F. Provide test holes at fan inlets and outlets and elsewhere as indicated.
- G. Install duct access doors to allow for inspecting, adjusting, and maintaining accessories and terminal units as follows:
  - 1. On both sides of duct coils.
  - 2. Downstream from volume dampers and equipment.
  - 3. Adjacent to fire or smoke dampers, providing access to reset or reinstall fusible links.
  - 4. To interior of ducts for cleaning; before and after each change in direction, at maximum 50-foot spacing.
  - 5. On sides of ducts where adequate clearance is available.
- H. Install the following sizes for duct-mounting, rectangular access doors:
  - 1. One-Hand or Inspection Access: 8 by 5 inches.
  - 2. Two-Hand Access: 12 by 6 inches.
  - 3. Head and Hand Access: 18 by 10 inches.
  - 4. Head and Shoulders Access: 21 by 14 inches.
  - 5. Body Access: 25 by 14 inches.
  - 6. Body Plus Ladder Access: 25 by 17 inches.
- I. Install the following sizes for duct-mounting, round access doors:
  - 1. One-Hand or Inspection Access: 8 inches in diameter.
  - 2. Two-Hand Access: 10 inches in diameter.
  - 3. Head and Hand Access: 12 inches in diameter.
  - 4. Head and Shoulders Access: 18 inches in diameter.
  - 5. Body Access: 24 inches in diameter.
- J. Label access doors according to Division 23 Section "HVAC System Identification."

- K. Install flexible connectors immediately adjacent to equipment in ducts associated with fans and motorized equipment supported by vibration isolators.
- L. Connect diffusers or light troffer boots to low pressure ducts with maximum 60-inch lengths of flexible duct clamped or strapped in place.
- M. Connect flexible ducts to metal ducts with draw bands.
- N. Install duct test holes where indicated and required for testing and balancing purposes.

### 3.2 ADJUSTING

- A. Adjust duct accessories for proper settings.
- B. Final positioning of manual-volume dampers is specified in Division 23 Section "Testing, Adjusting, and Balancing."

END OF SECTION 233300

## SECTION 233713 - DIFFUSERS, REGISTERS, AND GRILLES

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. This Section includes ceiling, wall and floor-mounted diffusers, registers, and grilles.

#### 1.2 SUBMITTALS

- A. Product Data: For each product indicated, include the following:
  - 1. Data Sheet: Indicate materials of construction, finish, and mounting details; and performance data including throw and drop, static-pressure drop, and noise ratings.
  - 2. Diffuser, Register, and Grille Schedule: Indicate Drawing designation, room location, quantity, model number, size, and accessories furnished.

### PART 2 - PRODUCTS

#### 2.1 MANUFACTURERS

- A. In other Part 2 articles where titles below introduce lists, the following requirements apply to product selection:
  - 1. Products: Subject to compliance with requirements, provide one of the products specified.
  - 2. Manufacturers: Subject to compliance with requirements, provide products by one of the manufacturers specified.

#### 2.2 GRILLES, DIFFUSERS AND REGISTERS

- A. See schedule on the drawings.
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Krueger.
    - b. Nailor Industries of Texas Inc.
    - c. Price Industries.
    - d. Titus.
    - e. Pre-approved equal.

#### 2.3 SOURCE QUALITY CONTROL

- A. Verification of Performance: Rate diffusers, registers, and grilles according to ASHRAE 70, "Method of Testing for Rating the Performance of Air Outlets and Inlets."

## PART 3 - EXECUTION

### 3.1 INSTALLATION

- A. Install diffusers, registers, and grilles level and plumb.
- B. Ceiling-Mounted Outlets and Inlets: Drawings indicate general arrangement of ducts, fittings, and accessories. Air outlet and inlet locations have been indicated to achieve design requirements for air volume, noise criteria, airflow pattern, throw, and pressure drop. Make final locations where indicated, as much as practicable. For units installed in lay-in ceiling panels, locate units in the center of panel. Where architectural features or other items conflict with installation, notify Architect for a determination of final location.
- C. Install diffusers, registers, and grilles with airtight connections to ducts and to allow service and maintenance of dampers, air extractors, and fire dampers.

### 3.2 ADJUSTING

- A. After installation, adjust diffusers, registers, and grilles to air patterns indicated, or as directed, before starting air balancing.

END OF SECTION 233713

## SECTION 235416 - GAS-FIRED FURNACES

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Gas-fired, condensing furnaces and accessories complete with controls.
  - 2. Air filters.
  - 3. Refrigeration components.

#### 1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product.
  - 1. Include rated capacities, operating characteristics, furnished specialties, and accessories.
- B. Shop Drawings:
  - 1. Include details of equipment assemblies. Indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
  - 2. Include diagrams for power, signal, and control wiring.

#### 1.4 INFORMATIONAL SUBMITTALS

- A. Sample Warranty: For special warranty.

#### 1.5 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For each furnace to include in emergency, operation, and maintenance manuals.
  - 1. In addition to standard items specified, include the following:
    - a. Furnace and accessories complete with controls.
    - b. Air filter.
    - c. Refrigeration components.

## 1.6 MAINTENANCE MATERIAL SUBMITTALS

- A. Furnish extra materials described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
  - 1. Disposable Air Filters: Furnish two sets.
  - 2. Fan Belts: Furnish one set.

## 1.7 QUALITY ASSURANCE

- A. ASHRAE Compliance: Applicable requirements in ASHRAE 62.1, Section 5 - "Systems and Equipment" and Section 7 - "Construction and Startup."
- B. ASHRAE/IES 90.1 Compliance: Applicable requirements in ASHRAE/IES 90.1, Section 6 - "Heating, Ventilating, and Air-Conditioning."
- C. Comply with NFPA 70.

## 1.8 WARRANTY

- A. Special Warranty: Manufacturer agrees to repair or replace the following components of furnaces that fail in materials or workmanship within specified warranty period:
  - 1. Warranty Period, Commencing on Date of Substantial Completion:
    - a. Furnace Heat Exchanger: Five years.
    - b. Integrated Ignition and Blower Control Circuit Board: Five years.
    - c. Draft-Inducer Motor: Five years.
    - d. Refrigeration Compressors: Five years.
    - e. Evaporator and Condenser Coils: Five years.

## PART 2 - PRODUCTS

### 2.1 ASSEMBLY DESCRIPTION

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a qualified testing agency, and marked for intended location and application.
- B. General Requirements for Noncondensing Gas-Fired Furnaces: Factory assembled, piped, wired, and tested; complying with ANSI Z21.47/CSA 2.3 and NFPA 54.

### 2.2 GAS-FIRED FURNACES, CONDENSING

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Lennox
  - 2. Carrier Corporation; a unit of United Technologies Corp.
  - 3. Trane.
  - 4. York.

5. Bosch.
- B. Cabinet: Steel or galvanized steel.
1. Cabinet interior around heat exchanger shall be factory-installed insulation.
  2. Lift-out panels shall expose burners and all other items requiring access for maintenance.
  3. Factory paint external cabinets in manufacturer's standard color.
  4. Airstream Surfaces: Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1.
- C. Fan: Centrifugal, factory balanced, resilient mounted, direct drive.
1. Special Motor Features: Single speed, premium efficiency, and with internal thermal protection and permanent lubrication.
  2. Special Motor Features: Multitapped, multispeed with internal thermal protection and permanent lubrication.
  3. Special Motor Features: Electronically controlled motor (ECM) controlled by integrated furnace/blower control.
- D. Type of Gas: Natural.
- E. Heat Exchanger:
1. Primary: Aluminized or stainless steel.
  2. Secondary: Polyethylene-coated or stainless steel.
- F. Burner:
1. Gas Valve: 100 percent safety two-stage or modulating main gas valve, main shutoff valve, pressure regulator, safety pilot with electronic flame sensor, limit control, transformer, and combination ignition/fan timer control board.
  2. Ignition: Electric pilot ignition, with hot-surface igniter or electric spark ignition.
- G. Gas-Burner Safety Controls:
1. Electronic Flame Sensor: Prevents gas valve from opening until pilot flame is proven; stops gas flow on ignition failure.
  2. Flame Rollout Switch: Installed on burner box; prevents burner operation.
  3. Limit Control: Fixed stop at maximum permissible setting; de-energizes burner on excessive bonnet temperature; automatic reset.
- H. Combustion-Air Inducer: Centrifugal fan with thermally protected motor and sleeve bearings prepurges heat exchanger and vents combustion products; pressure switch prevents furnace operation if combustion-air inlet or flue outlet is blocked.
- I. Furnace Controls: Solid-state board integrates ignition, heat, cooling, and fan speeds; adjustable fan-on and fan-off timing; terminals for connection to accessories; diagnostic light with viewport.
- J. Accessories:
1. Combination Combustion-Air Intake and Vent: PVC plastic fitting to combine combustion-air inlet and vent through outside wall.
  2. CPVC Plastic Vent Materials:

- a. CPVC Plastic Pipe: Schedule 40, complying with ASTM F 441/F 441M.
  - b. CPVC Plastic Fittings: Schedule 40, complying with ASTM F 438, socket type.
  - c. CPVC Solvent Cement: ASTM F 493.
3. PVC Plastic Vent Materials:
- a. PVC Plastic Pipe: Schedule 40, complying with ASTM D 1785.
  - b. PVC Plastic Fittings: Schedule 40, complying with ASTM D 2466, socket type.
  - c. PVC Solvent Cement: ASTM D 2564.

## 2.3 THERMOSTATS

- A. Controls shall comply with requirements in ASHRAE/IES 90.1, "Controls."
- B. 7-day programmable thermostat with auto changeover.
- C. Liquid-crystal display indicating temperature, set-point temperature, time setting, operating mode, and fan speed.

## 2.4 AIR FILTERS

- A. Disposable Filters: 1-inch- thick fiberglass media with ASHRAE 52.2 MERV rating of 13, in sheet metal frame.

## 2.5 REFRIGERATION COMPONENTS

- A. General Refrigeration Component Requirements:
  - 1. Refrigeration compressor, coils, and specialties shall be designed to operate with CFC-free refrigerants.
  - 2. Energy Efficiency: Equal to or greater than prescribed by ASHRAE/IES 90.1.
- B. Refrigerant Coil: Copper tubes mechanically expanded into aluminum fins. Comply with AHRI 210/240. Match size with furnace. Include condensate drain pan with accessible drain outlet complying with ASHRAE 62.1.
  - 1. Refrigerant Coil Enclosure: Steel, matching furnace and evaporator coil, with access panel and flanges for integral mounting at or on furnace cabinet and galvanized sheet metal drain pan coated with black asphaltic base paint.
- C. Refrigerant Line Kits: Annealed-copper suction and liquid lines factory cleaned, dried, pressurized with nitrogen, sealed, and with suction line insulated. Provide in standard lengths for installation without joints, except at equipment connections.
- D. Air-Cooled Compressor-Condenser Unit:
  - 1. Casing: Steel, finished with baked enamel, with removable panels for access to controls, weep holes for water drainage, and mounting holes in base. Provide brass service valves, fittings, and gage ports on exterior of casing.
  - 2. Compressor: Hermetically sealed reciprocating or scroll type.
    - a. Crankcase heater.



- b. Restrained vibration or vibration isolation mounts for compressor.
  - c. Compressor motor shall have thermal- and current-sensitive overload devices, start capacitor, relay, and contactor.
  - d. Two-speed compressor motors shall have manual-reset high-pressure switch and automatic-reset low-pressure switch.
  - e. Refrigerant Charge: R-410A.
  - f. Refrigerant: R-410A.
- 3. Refrigerant Coil: Copper tube, with mechanically bonded aluminum fins, complying with AHRI 210/240, and with liquid subcooler.
  - 4. Heat-Pump Components: Reversing valve and low-temperature air cut-off thermostat.
  - 5. Fan: Aluminum-propeller type, directly connected to motor.
  - 6. Motor: Permanently lubricated, with integral thermal-overload protection.
  - 7. Low Ambient Kit: Permits operation down to 45 deg F.
  - 8. Mounting Base: Polyethylene.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine areas and conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of the Work.
- B. Examine factory-installed insulation before furnace installation. Reject units that are wet, moisture damaged, or mold damaged.
- C. Examine roughing-in for gas and refrigerant piping systems to verify actual locations of piping connections before equipment installation.
- D. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 INSTALLATION

- A. Install gas-fired furnaces and associated fuel and vent features and systems according to NFPA 54.
- B. Suspended Units: Suspend from structure using threaded rods, spring hangers, and building attachments. Secure rods to unit hanger attachments. Adjust hangers so unit is level and plumb.
- C. Provide galvanized auxiliary drain pan for suspended furnaces.
- D. Controls: Install thermostat at mounting height of 60 inches above floor.
- E. Wiring Method: Install control wiring in accessible ceiling spaces and in gypsum board partitions where unenclosed wiring method may be used. Conceal control wiring except in unfinished spaces.
- F. Install ground mounted compressor-condenser components on raised condenser pad or concrete slab.

### 3.3 CONNECTIONS

- A. Install piping adjacent to equipment to allow service and maintenance.
- B. Vent and Outside-Air Connection, Condensing, Gas-Fired Furnaces: Connect plastic piping vent material to furnace connections and extend outdoors. Terminate vent outdoors with a cap and in an arrangement that will protect against entry of birds, insects, and dirt.
  - 1. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.
  - 2. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.
  - 3. Plastic Piping Solvent-Cement Joints: Clean and dry joining surfaces. Join pipe and fittings according to the following:
    - a. Comply with ASTM F 402 for safe-handling practice of cleaners, primers, and solvent cements.
    - b. CPVC Piping: Join according to ASTM D 2846/D 2846M, Appendix.
    - c. PVC Pressure Piping: Join schedule number ASTM D 1785 PVC pipe and PVC socket fittings according to ASTM D 2672. Join other-than-schedule-number PVC pipe and socket fittings according to ASTM D 2855.
  - 4. Slope pipe vent back to furnace or to outside terminal.
- C. Connect ducts to furnace with flexible connector.
- D. Connect refrigerant tubing kits to refrigerant coil in furnace and to air-cooled compressor-condenser unit.
  - 1. Flared Joints: Use ASME B16.26 fitting and flared ends, following procedures in CDA's "Copper Tube Handbook."
  - 2. Soldered Joints: Apply ASTM B 813, water-flushable flux, unless otherwise indicated, to tube end. Construct joints according to ASTM B 828 or CDA's "Copper Tube Handbook," using lead-free solder alloy complying with ASTM B 32.
  - 3. Brazed Joints: Construct joints according to AWS's "Brazing Handbook," "Pipe and Tube" Chapter, using copper-phosphorus brazing filler metal complying with AWS A5.8/A5.8M.

### 3.4 FIELD QUALITY CONTROL

- A. Perform the following tests and inspections:
  - 1. Perform electrical test and visual and mechanical inspection.
  - 2. Leak Test: After installation, charge systems with refrigerant and test for leaks. Repair leaks, replace lost refrigerant, and retest until no leaks exist.
  - 3. Operational Test: After electrical circuitry has been energized, start units to confirm proper operation, product capability, and compliance with requirements.
  - 4. Verify that fan wheel is rotating in the correct direction and is not vibrating or binding.
  - 5. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.
- B. Verify that vibration isolation and flexible connections properly dampen vibration transmission to structure.

### 3.5 STARTUP SERVICE

- A. Complete installation and startup checks according to manufacturer's written instructions and perform the following:
  - 1. Inspect for physical damage to unit casings.
  - 2. Verify that access doors move freely and are weathertight.
  - 3. Clean units and inspect for construction debris.
  - 4. Verify that all bolts and screws are tight.
  - 5. Adjust vibration isolation and flexible connections.
  - 6. Verify that controls are connected and operational.
- B. Adjust fan belts to proper alignment and tension.
- C. Start unit according to manufacturer's written instructions and complete manufacturer's operational checklist.
- D. Measure and record airflows.
- E. Verify proper operation of capacity control device.
- F. After startup and performance test, lubricate bearings.

### 3.6 ADJUSTING

- A. Adjust initial temperature and humidity set points.
- B. Set controls, burner, and other adjustments for optimum heating performance and efficiency. Adjust heat-distribution features, including shutters, dampers, and relays, to provide optimum heating performance and system efficiency.

### 3.7 CLEANING

- A. After completing installation, clean furnaces internally according to manufacturer's written instructions.
- B. Install new filters in each furnace within 14 days after Substantial Completion.

### 3.8 DEMONSTRATION

- A. Train Owner's maintenance personnel to adjust, operate, and maintain condensing units.

END OF SECTION 235416

## SECTION 237413 - PACKAGED, OUTDOOR, CENTRAL-STATION AIR-HANDLING UNITS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section includes factory-packaged units (DOAS) with energy recovery wheels capable of supplying up to 100 percent outdoor air and providing cooling and heating.

#### 1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product. Include rated capacities, operating characteristics, and furnished specialties and accessories.
- B. Shop Drawings:
  - 1. Include plans, elevations, sections, and attachment details.
  - 2. Include details of equipment assemblies. Indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
  - 3. Prepare the following by or under the supervision of a qualified professional engineer:
    - a. Mounting Details: For securing and flashing roof curb to roof structure. Indicate coordinating requirements with roof membrane system.
    - b. Include diagrams for power, signal, and control wiring.

#### 1.4 INFORMATIONAL SUBMITTALS

- A. Coordination Drawings: Roof-curb mounting details, drawn to scale, on which the following items are shown and coordinated with each other, using input from installers of the items involved:
  - 1. Size and location of unit-mounted rails and anchor points and methods for anchoring units to roof curb.
  - 2. Required roof penetrations for ducts, pipes, and electrical raceways, including size and location of each penetration.
- B. Startup service reports.
- C. Sample Warranty: For special warranty.

## 1.5 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For units to include in emergency, operation, and maintenance manuals.

## 1.6 MAINTENANCE MATERIAL SUBMITTALS

- A. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.

- 1. Filters: One set for each unit.

## 1.7 WARRANTY

- A. Special Warranty: Manufacturer agrees to replace components of units that fail in materials or workmanship within specified warranty period.

- 1. Warranty Period for Compressors: Five years from date of Substantial Completion.
- 2. Warranty Period for Heat Exchangers: 25 years non-prorated from date of Substantial Completion.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

- 1. AAON RQ/RN Series
- 2. Daikin Rebel Series
- 3. Trane Horizon Series

### 2.2 PERFORMANCE REQUIREMENTS

- A. General Fabrication Requirements: Comply with requirements in ASHRAE 62.1, Section 5 - "Systems and Equipment," and Section 7 - "Construction and System Start-up."

- B. Cabinet Thermal Performance:

- 1. Maximum Overall U-Value: Comply with requirements in ASHRAE/IESNA 90.1.
- 2. Maximum Overall U-Value: 0.10 Btu/h x sq. ft. x deg F. Include effects of metal-to-metal contact and thermal bridges in the calculations.
- 3. R-13 insulation.

- C. Cabinet Surface Condensation:

- 1. Cabinet shall have additional insulation and vapor seals if required to prevent condensation on the interior and exterior of the cabinet.
- 2. Portions of cabinet located downstream from the cooling coil shall have a thermal break at each thermal bridge between the exterior and interior casing to prevent condensation

from occurring on the interior and exterior surfaces. The thermal break shall not compromise the structural integrity of the cabinet.

- D. Maximum Cabinet Leakage: 2 percent of the total supply-air flow at a pressure rating equal to the fan shut-off pressure.
- E. Cabinet Deflection Performance:
  - 1. Walls and roof deflection shall be within 1/240 of the span at the design working pressure equal to the fan shut-off pressure. Deflection limits shall be measured at any point on the surface.
  - 2. Floor deflections shall be within 1/360 of the span considering the worst-case condition caused by the following:
    - a. Service personnel.
    - b. Internal components.
    - c. Design working pressure defined for the walls and roof.
- F. Electrical components, devices, and accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- G. Capacities and Characteristics: Refer to Drawings.

## 2.3 CABINET

- A. Construction: Double wall foam injected casing.
- B. Exterior Casing Material: Galvanized steel with exterior paint finish that shall be capable of withstanding at least 2,500 hours, with no visible corrosive effects.
- C. Interior Casing Material: Galvanized steel.
- D. Lifting and Handling Provisions: Factory-installed shipping skids and lifting lugs.
- E. Base Rails: Galvanized-steel rails for mounting on roof curb or pad as indicated.
- F. Access for Inspection, Cleaning, and Maintenance: Comply with requirements in ASHRAE 62.1.
  - 1. Service Doors: Hinged access doors with gaskets. Material and construction of doors shall match material and construction of cabinet in which doors are installed.
- G. Roof: Standing seam or membrane; sloped to drain water.
- H. Floor: Reinforced, metal surface; reinforced to limit deflection when walked on by service personnel. Insulation shall be below metal walking surface.
- I. Cabinet Insulation:
  - 1. R-13, 2" foam insulation.
- J. Condensate Drain Pans: Formed sections of stainless-steel sheet, a minimum of 2 inches deep, and complying with ASHRAE 62.1.

1. Double-Wall Construction: Fill space between walls with foam insulation and seal moisture tight.
  2. Drain Connections: Threaded nipple one side of drain pan.
- K. Surfaces in Contact with Airstream: Comply with requirements in ASHRAE 62.1 for resistance to mold and erosion.

## 2.4 SUPPLY FAN

- A. Plenum Fan Type: Single width, non-overloading, with backward-inclined or airfoil blades.
1. Fan Wheel Material: Aluminum; attached directly to motor shaft.
  2. Fan Wheel Drive and Arrangement: Direct drive, AMCA Arrangement 4.
  3. Fan panel and frame Material: Powder-coated steel, stainless steel, or aluminum.
  4. Fan Enclosure: Easily removable enclosure around rotating parts.
  5. Fan Balance: Precision balance fan below 0.08 inch/st design speed with filter in.
- B. Motors:
1. Comply with NEMA designation, temperature rating, service factor, and efficiency requirements for motors specified in Section 230513 "Common Motor Requirements for HVAC Equipment."
  2. Enclosure: Totally enclosed.
  3. Enclosure Materials: Cast iron or cast aluminum.
  4. Efficiency: Premium efficient.
- C. Mounting: Fan wheel, motor, and drives shall be mounted to fan casing with spring isolators.

## 2.5 COOLING COILS

- A. Capacity Ratings: Comply with ASHRAE 33 and ARI 410.
- B. Coil Casing Material: Manufacturer's standard material.
- C. Tube Material: Copper.
- D. Tube Header Material: Manufacturer's standard material.
- E. Fin Material: Aluminum.
- F. Fin and Tube Joints: Mechanical bond.
- G. Leak Test: Coils shall be leak tested with air underwater.
- H. Refrigerant Coil Suction and Distributor Header Materials: Seamless copper tube with brazed joints.
- I. Reheat coil shall be fully integrated into the supply air and fan system and capable of delivering design supply air temperature.
- J. Reheat coils shall be multi-pass and fabricated from aluminum microchannel tubes. The reheat coils shall be piped in parallel with the condensing unit.

- K. To prevent re-hydration of condensate from evaporator coil, the evaporator coil face and the hot gas reheat coil face shall be separated a minimum of six inches.

## 2.6 REFRIGERATION SYSTEM

- A. Comply with requirements in ASHRAE 15, "Safety Standard for Refrigeration Systems."
- B. Refrigerant Charge: Factory charged with refrigerant and filled with oil.
- C. Compressors: Scroll and digital scroll compressors (as scheduled) with integral vibration isolators, internal overcurrent and overtemperature protection, internal pressure relief, and crankcase heater.
- D. Refrigerant: R-410A.
  - 1. Classified as Safety Group A1 according to ASHRAE 34.
  - 2. Provide unit with operating charge of refrigerant.
- E. Refrigeration System Specialties:
  - 1. Expansion valve with replaceable thermostatic element.
  - 2. Refrigerant dryer.
  - 3. High-pressure switch.
  - 4. Low-pressure switch.
  - 5. Thermostat for coil freeze-up protection during low ambient temperature operation or loss of air.
  - 6. Brass service valves installed in discharge and liquid lines.
- F. Capacity Control:
  - 1. Single compressor with evaporator and condenser coil within the refrigerant section to provide initial pre-cooling and modulating hot gas reheat for humidity control.
- G. Refrigerant condenser coils:
  - 1. Capacity Ratings: Complying with ASHRAE 33 and ARI 410.
  - 2. Tube Material: Copper.
  - 3. Fin Material: Aluminum.
  - 4. Fin and Tube Joint: Mechanical bond.
  - 5. Leak Test: Coils shall be leak tested with air underwater.
  - 6. Coating: Phenolic epoxy corrosion-protection coating after assembly. Standard construction is aluminum without any additional coating.
  - 7. Coils shall be multi-pass and fabricated from aluminum microchannel tubes.
  - 8. Condenser fans shall be VFD driven variable speed for condenser head pressure control. Factory provided and factory programmed VFDs shall continuously modulate the fan air flow to maintain head pressure at acceptable levels. Cooling operation shall be allowed down to 35°F with adjustable compressor lockout.
- H. Condenser Fan Assembly:
  - 1. Fans: Direct-drive propeller type with statically and dynamically balanced fan blades.
  - 2. Fan Motors:



- a. Comply with NEMA designation, temperature rating, service factor, and efficiency requirements for motors specified in Section 230513 "Common Motor Requirements for HVAC Equipment."
  - b. Motor Enclosure: Totally enclosed non-ventilating (TENV) or totally enclosed air over (TEAO) enclosure.
  - c. Enclosure Materials: Cast iron or cast aluminum.
  - d. Built-in overcurrent and thermal-overload protection.
  - e. Efficiency: Premium efficient.
3. Fan Safety Guards: Steel with corrosion-resistant coating.
- I. Safety Controls:
- 1. Compressor motor and condenser coil fan motor low ambient lockout.
  - 2. Overcurrent protection for compressor motor.

## 2.7 GAS FURNACE

- A. Description: Factory assembled, piped, and wired; complying with ANSI Z21.47 and NFPA 54.
- 1. CSA Approval: Designed and certified by and bearing label of CSA.
- B. Burners: Stainless steel.
- 1. Fuel: Natural gas.
  - 2. Ignition: Electronically controlled electric spark or hot-surface igniter with flame sensor.
- C. Heat-Exchanger and Drain Pan: Stainless steel.
- D. Venting: Gravity vented.
- E. Safety Controls:
- 1. Gas Control Valve: Modulating.
  - 2. Gas Train: Single-body, regulated, redundant, 24-V ac gas valve assembly containing pilot solenoid valve, pilot filter, pressure regulator, pilot shutoff, and manual shutoff.

## 2.8 HEAT WHEELS

- A. Casing:
- 1. Steel with standard factory-painted finish.
  - 2. Integral purge section limiting carryover of exhaust air to between 0.05 percent at 1.6-inch wg and 0.20 percent at 4-inch wg differential pressure.
  - 3. Casing seals on periphery of rotor and on duct divider and purge section.
  - 4. Support vertical rotors on grease-lubricated ball bearings having extended grease fittings or permanently lubricated bearings. Support horizontal rotors on tapered roller bearing.
- B. Rotor: Aluminum segmented wheel strengthened with radial spokes, with nontoxic, noncorrosive, desiccant coating.

1. Maximum Solid Size for Media to Pass: 4 ANGSTROM.
- C. Sensible and latent recovery efficiencies must be clearly documented through a testing program conducted in accordance with ASHRAE Standard 84 and AHRI 1060. The testing must have been conducted by a qualified independent organization. The performance test reports must be provided for engineering review as part of the submittals for this project.
- D. Drive: Fractional horsepower motor and gear reducer and self-adjusting multilink belt around outside of rotor.
1. Comply with NEMA designation, temperature rating, service factor, enclosure type, and efficiency requirements for motors specified in Section 230513 "Common Motor Requirements for HVAC Equipment."
  2. Motor Sizes: Minimum size as indicated. If not indicated, large enough so driven load will not require motor to operate in service factor range above 1.0.
- E. Controls:
1. Starting relay, factory mounted and wired.
  2. Variable frequency controllers, factory mounted and wired, permitting input of field connected 4-20 mA or 1-10-V control signal.
  3. Modulate wheel bypass dampers to maintain exhaust temperature above freezing and air differential temperature above set point.

## 2.9 OUTDOOR-AIR INTAKE HOOD

- A. Type: Manufacturer's standard hood or louver.
- B. Materials: Match cabinet.
- C. Bird Screen: Comply with requirements in ASHRAE 62.1.
- D. Configuration: Designed to inhibit wind-driven rain and snow from entering unit.

## 2.10 FILTERS

- A. Disposable Panel Filters:
1. Comply with NFPA 90A.
  2. Factory-fabricated, viscous-coated, flat-panel type.
  3. Thickness: 2-inch.
  4. Minimum Arrestance: 80, according to ASHRAE 52.1.
  5. Minimum Merv: 13, according to ASHRAE 52.2.
  6. Media: Interlaced glass fibers sprayed with nonflammable adhesive.
- B. Mounting Frames:
1. Panel filters arranged for angular orientation, with access doors on both sides of unit. Filters shall be removable from one side or from access plenum.
  2. Galvanized or stainless steel with gaskets and fasteners, suitable for bolting together into built-up filter banks.

## 2.11 ELECTRICAL POWER CONNECTIONS

- A. General Electrical Power Connection Requirements: Factory-installed and -wired switches, motor controllers, transformers, and other necessary electrical devices shall provide a single-point field power connection to unit.
- B. Wiring: Numbered and color-coded to match wiring diagram.
- C. Wiring Location: Install factory wiring outside an enclosure in a raceway.
- D. Factory Wiring: Branch power circuit to each motor and to controls with one of the following disconnecting means:
  - 1. NEMA KS 1, heavy-duty, fusible switch with rejection-type fuse clips rated for fuses. Select and size fuses to provide Type 2 protection according to IEC 60947-4-1.
  - 2. NEMA KS 1, heavy-duty, nonfusible switch.
  - 3. UL 489, motor-circuit protector (circuit breaker) with field-adjustable, short-circuit trip coordinated with motor locked-rotor amperes.
- E. Factory-Mounted, Overcurrent-Protection Service: For each motor.
- F. Transformer: Factory mounted with primary and secondary fuses and sized with enough capacity to operate electrical load plus spare capacity.
- G. Controls: Factory wire unit-mounted controls.
- H. Receptacle: Factory wire unit-mounted, ground fault interrupt (GFI) duplex receptacle.
- I. Control Relays: Auxiliary and adjustable time-delay relays.

## 2.12 CONTROLS

- A. Factory Installed Terminal Strip and Factory Furnished Remote Controller
  - 1. Unit shall be provided with factory installed terminal strip. Terminal strip shall be provided with labeled connections for required field connections.
  - 2. Unit shall be provided with remote touchscreen controller capable of controlling all features and options of the unit. Controller shall be remotely installed (by mechanical contractor) as shown on the plans. Controller shall be factory tested. Controller shall be Siemens Desigo Control Point 10.1" touch panel. Equal controllers as manufactured by Delta Controls, Johnson Controls Inc., Trane, or Automated Logic.
  - 3. Controller shall be capable of standalone operation with unit configuration, setpoint adjustment, sensor status viewing, unit alarm viewing, and occupancy scheduling available without dependence on a building management system.
  - 4. Controller shall have an onboard clock and calendar functions that allow for occupancy scheduling.
  - 5. Controller shall include non-volatile memory to retain all programmed values without the use of a battery, in the event of a power failure.
  - 6. Controllers shall be Single Zone VAV
    - a. Unit shall utilize a variable capacity compressor system and a variable speed fan system to modulate the cooling and airflow as required in meeting the space

- temperature needs and to save unit operating energy. Unit fan speed shall modulate based on space temperature, not supply air pressure.
- b. Units ordered with modulating gas shall be capable of modulating fan speed in both the heating and cooling mode.
  - c. With modulating hot gas reheat, unit shall modulate cooling and hot gas reheat as efficiently as possible, to meet space humidity loads and prevent supply air temperature swings and overcooling of the space.
  - d. Unit shall be provided with supply air temperature control. Mixing boxes and bypass ducts shall not be required for operation as a single zone VAV system.
7. Controller user interface:
- a. The system user interface shall be digital based and graphically oriented. Provide a method for the operator to easily move between pages. Dynamic points shall include analog and binary values, dynamic text, static text, and animation files. Graphics shall have the ability to show animation of equipment. Animation capabilities shall include the ability to show a sequence of images reflecting the position of analog outputs, such as valve or damper positions. Graphics shall be capable of launching other screens.
  - b. Custom background images. Custom background images shall be created with the use of commonly available graphics packages such as Adobe Photoshop. The graphics generation package shall create and modify graphics that are saved in industry standard formats such as GIF and JPEG.
  - c. Graphics Library. Furnish a library of standard HVAC equipment such as air handlers, terminals, fan coils, unit ventilators, rooftop units, and VAV boxes, in 3-dimensional graphic depictions. The library shall be furnished in a file format compatible with the graphics generation program.
  - d. Engineering Units. Allow for selection of the desired engineering units (i.e. Inch Pound or SI) in the system. Unit selection shall be able to be customized by locality to select the desired units for each measurement. Engineering units on this project shall be Inch Pound.
8. Refer to the drawings, HVAC Control Schematic for Sequence of Operation and factory programming. Implement all features of programs to specified requirements and as appropriate to sequence of operation.

## 2.13 ACCESSORIES

- A. Duplex Receptacle: Factory mounted in unit supply-fan section, with 20 amp 120 V GFI duplex receptacle and weatherproof cover.

## 2.14 ROOF CURBS

- A. Materials: Galvanized steel with corrosion-protection coating, watertight gaskets, and factory-installed wood nailer; complying with NRCA standards.
  1. Curb Insulation and Adhesive: Comply with NFPA 90A or NFPA 90B.
    - a. Materials: ASTM C 1071, Type I or II.
    - b. Thickness: 1 inch.
  2. Application: Factory applied with adhesive and mechanical fasteners to the internal surface of curb.

- a. Liner Adhesive: Comply with ASTM C 916, Type I.
  - b. Mechanical Fasteners: Galvanized steel, suitable for adhesive attachment, mechanical attachment, or welding attachment to duct without damaging liner when applied as recommended by manufacturer and without causing leakage in cabinet.
  - c. Liner materials applied in this location shall have air-stream surface coated with a temperature-resistant coating or faced with a plain or coated fibrous mat or fabric depending on service air velocity.
  - d. Liner Adhesive: Comply with ASTM C 916, Type I.
- B. Provide spring isolation curb with a minimum of 2 inch static deflection. Provide base curb height as required for base curb to extend minimum 12" above final roofing membrane. Coordinate required height of base curb with roofing insulation; refer to architectural drawings.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of the Work.
- B. Examine roughing-in for piping, ducts, and electrical systems to verify actual locations of connections before equipment installation.
- C. Examine roof curbs and equipment supports for suitable conditions where units will be installed.
- D. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 INSTALLATION

- A. Comply with manufacturer's rigging and installation instructions for unloading units and moving to final locations.
- B. Curb Support: Install roof curb on roof structure according to "The NRCA Roofing Manual."
  - 1. Install and secure units on curbs and coordinate roof penetrations and flashing with roof construction.
  - 2. Coordinate size, installation, and structural capacity of roof curbs, equipment supports, and roof penetrations. These items are specified in Section 077200 "Roof Accessories."
  - 3. Coordinate size, location, and installation of unit manufacturer's roof curbs and equipment supports with roof Installer.
- C. Restrained Curb Support: Install restrained vibration isolation roof-curb rails on roof structure according to "The NRCA Roofing Manual."
- D. Install wall- and duct-mounted sensors furnished by manufacturer for field installation. Install control wiring and make final connections to control devices and unit terminal strip.
- E. Install remote touchscreen controller furnished by manufacturer for field installation. Install control wiring and make final connection to control devices and unit terminal strip.

- F. Comply with requirements for gas-fired furnace installation in NFPA 54, "National Fuel Gas Code."
- G. Install separate devices furnished by manufacturer and not factory installed.
- H. Install new filters at completion of equipment installation and before testing, adjusting, and balancing.
- I. Install condensate drain, minimum connection size, with trap and indirect connection to nearest roof drain or area drain.

### 3.3 CONNECTIONS

- A. Where installing piping adjacent to units, allow space for service and maintenance.
- B. Gas Piping Connections:
  - 1. Comply with requirements in Section 231123 "Facility Natural-Gas Piping."
  - 2. Connect gas piping to furnace, full size of gas train inlet, and connect with union, pressure regulator, and shutoff valve with sufficient clearance for burner removal and service.
  - 3. Install AGA-approved flexible connectors.
- C. Duct Connections:
  - 1. Comply with requirements in Section 233113 "Metal Ducts."
  - 2. Drawings indicate the general arrangement of ducts.
  - 3. Connect ducts to units with flexible duct connectors. Comply with requirements for flexible duct connectors in Section 233300 "Air Duct Accessories."
- D. Electrical Connections: Comply with requirements for power wiring, switches, and motor controls in electrical Sections.
  - 1. Install electrical devices furnished by unit manufacturer but not factory mounted.

### 3.4 FIELD QUALITY CONTROL

- A. Manufacturer's Field Service: Engage a factory-employed service representative to start DOAS in both heating and cooling modes, inspect, test, and adjust components, assemblies, and equipment installations, including connections.
  - 1. Complete installation and startup checks according to manufacturer's written instructions.
  - 2. Inspect units for visible damage to furnace combustion chamber.
  - 3. Perform the following operations for both minimum and maximum firing and adjust burner for peak efficiency:
    - a. Measure gas pressure at manifold.
    - b. Measure combustion-air temperature at inlet to combustion chamber.
    - c. Measure flue-gas temperature at furnace discharge.
    - d. Perform flue-gas analysis. Measure and record flue-gas carbon dioxide and oxygen concentration.

- e. Measure supply-air temperature and volume when burner is at maximum firing rate and when burner is off. Calculate useful heat to supply air.
4. Verify operation of remote panel including pilot-light operation and failure modes. Inspect the following:
    - a. High-limit heat exchanger.
    - b. Alarms.
  5. Inspect units for visible damage to refrigerant compressor, condenser and evaporator coils, and fans.
  6. Start refrigeration system when outdoor-air temperature is within normal operating limits and measure and record the following:
    - a. Cooling coil leaving-air, dry- and wet-bulb temperatures.
    - b. Cooling coil entering-air, dry- and wet-bulb temperatures.
    - c. Condenser coil entering-air dry-bulb temperature.
    - d. Condenser coil leaving-air dry-bulb temperature.
  7. Simulate maximum cooling demand and inspect the following:
    - a. Compressor refrigerant suction and hot-gas pressures.
    - b. Short-circuiting of air through outside coil or from outside coil to outdoor-air intake.
  8. Inspect casing insulation for integrity, moisture content, and adhesion.
  9. Verify that clearances have been provided for servicing.
  10. Verify that controls are connected and operable.
  11. Verify that filters are installed.
  12. Clean coils and inspect for construction debris.
  13. Clean furnace flue and inspect for construction debris.
  14. Inspect operation of power vents.
  15. Purge gas line.
  16. Inspect and adjust vibration isolators and seismic restraints.
  17. Verify bearing lubrication.
  18. Clean fans and inspect fan-wheel rotation for movement in correct direction without vibration and binding.
  19. Adjust fan belts to proper alignment and tension.
  20. Start unit.
  21. Inspect and record performance of interlocks and protective devices including response to smoke detectors by fan controls and fire alarm.
  22. Operate unit for run-in period.
  23. Calibrate controls.
  24. Adjust and inspect high-temperature limits.
  25. Inspect outdoor-air dampers for proper stroke.
  26. Verify operational sequence of controls.
- B. After startup, change filters, verify bearing lubrication, and adjust belt tension.
  - C. Remove and replace components that do not properly operate and repeat startup procedures as specified above.
  - D. Prepare written report of the results of startup services.

### 3.5 CLEANING AND ADJUSTING

- A. Occupancy Adjustments: When requested within 12 months of date of Substantial Completion, provide on-site assistance in adjusting system to suit actual occupied conditions. Provide up to two visits to site during other-than-normal occupancy hours for this purpose.
- B. After completing system installation and testing, adjusting, and balancing DOAS and air-distribution systems, clean filter housings and install new filters.

### 3.6 DEMONSTRATION AND TRAINING

- A. Contractor shall engage qualified instructors to instruct Owner's personnel how to adjust, operate, and maintain systems, subsystems, and equipment not part of a system. Instructors shall be factory-authorized service representatives experienced in operation and maintenance procedures and training.
  - 1. System manufacturers shall provide qualified instructor to:
    - a. Describe system design, operational requirements, criteria, and regulatory requirements.
    - b. Demonstrate routine maintenance items including cleaning and preventative maintenance.
    - c. Provide instruction on control sequence, data measurement locations, and interface with control system including meaning of alarms and error messages.
  - 2. Owner's Representative will furnish Contractor with names and positions of participants.
  - 3. Schedule of Training Sessions: Contractor shall schedule with Owner's representative and arrange to have 4 hours of training scheduled for any one day.
  - 4. Attendance Record: For each training module, Contractor shall submit list of participants and length of instruction time.

END OF SECTION 237413



## SECTION 238126 - SPLIT-SYSTEM AIR-CONDITIONERS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section includes split-system air-conditioning and heat-pump units consisting of separate evaporator-fan and compressor-condenser components, including:
  - 1. Ductless split systems.

#### 1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated. Include rated capacities, operating characteristics, and furnished specialties and accessories. Include performance data in terms of capacities, outlet velocities, static pressures, sound power characteristics, motor requirements, and electrical characteristics.
- B. Shop Drawings: Include plans, elevations, sections, details, and attachments to other work.
  - 1. Detail equipment assemblies and indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
  - 2. Wiring Diagrams: For power, signal, and control wiring.
- C. Samples for Initial Selection: For units with factory-applied color finishes.

#### 1.4 INFORMATIONAL SUBMITTALS

- A. Field quality-control reports.
- B. Warranty: Sample of special warranty.

#### 1.5 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For split-system air-conditioning units to include in emergency, operation, and maintenance manuals.

#### 1.6 MAINTENANCE MATERIAL SUBMITTALS

- A. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.

1. Filters: One set for each air-handling unit.
2. Fan Belts: One set for each air-handling unit fan.

## 1.7 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. ASHRAE Compliance:
  1. Fabricate and label refrigeration system to comply with ASHRAE 15, "Safety Standard for Refrigeration Systems."
  2. ASHRAE Compliance: Applicable requirements in ASHRAE 62.1, Section 4 - "Outdoor Air Quality," Section 5 - "Systems and Equipment," Section 6 - "Procedures," and Section 7 - "Construction and System Start-up."
- C. ASHRAE/IESNA Compliance: Applicable requirements in ASHRAE/IESNA 90.1.

## 1.8 COORDINATION

- A. Coordinate sizes and locations of roof curbs, equipment supports, and roof penetrations with actual equipment provided.

## 1.9 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace components of split-system air-conditioning units that fail in materials or workmanship within specified warranty period.
  1. Warranty Period:
    - a. For Compressor: Five years from date of Substantial Completion.
    - b. For Parts: One year from date of Substantial Completion.
    - c. For Labor: One year from date of Substantial Completion.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. Wall Mount (Ductless) Split Systems: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
  1. Mitsubishi Electric & Electronics USA, Inc.; HVAC Advanced Products Division.
  2. SANYO North America Corporation; SANYO Fisher Company.
  3. Trane; a business of American Standard companies.
  4. Daikin.
  5. LG.

## 2.2 INDOOR UNITS

### A. Wall-Mounted, Evaporator-Fan Components:

1. Cabinet: Enameled steel with removable panels on front and ends in color selected by Architect, and discharge drain pans with drain connection.
2. Refrigerant Coil: Copper tube, with mechanically bonded aluminum fins and thermal-expansion valve. Comply with ARI 206/110.
3. Electric Coil: Helical, nickel-chrome, resistance-wire heating elements; with refractory ceramic support bushings, automatic-reset thermal cutout, built-in magnetic contactors, manual-reset thermal cutout, airflow proving device, and one-time fuses in terminal box for overcurrent protection.
4. Fan: Direct drive, centrifugal.
5. Fan Motors:
  - a. Comply with NEMA designation, temperature rating, service factor, enclosure type, and efficiency requirements specified in Section 230513 "Common Motor Requirements for HVAC Equipment."
  - b. Multitapped, multispeed with internal thermal protection and permanent lubrication.
  - c. Enclosure Type: Totally enclosed, fan cooled.
  - d. NEMA Premium (TM) efficient motors as defined in NEMA MG 1.
  - e. Controllers, Electrical Devices, and Wiring: Comply with requirements for electrical devices and connections specified in electrical Sections.
  - f. Mount unit-mounted disconnect switches on exterior
  - g. ASHRAE compliance in "Airstream Surfaces" Subparagraph below may be required to comply with Project requirements or authorities having jurisdiction. Retain first subparagraph to comply with LEED Prerequisite IEQ 1.
6. Airstream Surfaces: Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1.
7. Condensate Drain Pans:
  - a. Fabricated with two percent slope in at least two planes to collect condensate from cooling coils (including coil piping connections, coil headers, and return bends) and humidifiers, and to direct water toward drain connection.
    - 1) Length: Extend drain pan downstream from leaving face to comply with ASHRAE 62.1
    - 2) Depth: A minimum of 1"
  - b. Single-wall, stainless-steel sheet.
  - c. Drain Connection: Located at lowest point of pan and sized to prevent overflow. Terminate with threaded nipple on both ends of pan.
    - 1) Minimum Connection Size: NPS 1
  - d. Pan-Top Surface Coating: Asphaltic waterproofing compound.
8. Air Filtration Section:
  - a. General Requirements for Air Filtration Section:
    - 1) Comply with NFPA 90A.
    - 2) Minimum Arrestance: According to ASHRAE 52.1 and MERV according to ASHRAE 52.2.
    - 3) Filter-Holding Frames: Arranged for flat or angular orientation, with access doors on both sides of unit. Filters shall be removable from one side or lifted out from access plenum.

- b. Disposable Panel Filters:
  - 1) Factory-fabricated, viscous-coated, flat-panel type.
  - 2) Thickness: 1 inch.

## 2.3 OUTDOOR UNITS

### A. Air-Cooled, Compressor-Condenser Components:

- 1. Casing: Steel, finished with baked enamel in color selected by Architect, with removable panels for access to controls, weep holes for water drainage, and mounting holes in base. Provide brass service valves, fittings, and gage ports on exterior of casing.
- 2. Compressor: Hermetically sealed reciprocating or scroll type.
  - a. Crankcase heater.
  - b. Restrained vibration or vibration isolation mounts for compressor.
  - c. Compressor motor shall have thermal- and current-sensitive overload devices, start capacitor, relay, and contactor.
  - d. Two-speed compressor motors shall have manual-reset high-pressure switch and automatic-reset low-pressure switch.
  - e. Refrigerant Charge: R-410A.
  - f. Refrigerant: R-410A.
- 3. Refrigerant Coil: Copper tube, with mechanically bonded aluminum fins, complying with AHRI 210/240, and with liquid subcooler.
- 4. Heat-Pump Components: Reversing valve and low-temperature air cut-off thermostat.
- 5. Fan: Aluminum-propeller type, directly connected to motor.
- 6. Motor: Permanently lubricated, with integral thermal-overload protection.
- 7. Low Ambient Kit: Permits operation down to 45 deg F.
- 8. Mounting Base: Polyethylene.

## 2.4 ACCESSORIES

- A. Control equipment and sequence of operation are specified in Section 23 09 00 "Instrumentation and Control for HVAC" and Section 23 09 93 "Sequence and Operations for HVAC Controls."
- B. Thermostat: Smart type programmable thermostats by Nest Labs.
- C. Automatic-reset timer to prevent rapid cycling of compressor.
- D. Refrigerant Line Kits: Soft-annealed copper suction and liquid lines factory cleaned, dried, pressurized, and sealed; factory-insulated suction line with flared fittings at both ends.

## 2.5 CAPACITIES AND CHARACTERISTICS

- A. See schedules on the Drawings.

## PART 3 - EXECUTION

### 3.1 INSTALLATION

- A. Install units level and plumb.
- B. Install evaporator-fan components using manufacturer's standard mounting devices securely fastened to building structure.
- C. Install wall-mounted, compressor-condenser components on equipment supports. Anchor units to supports with removable, cadmium-plated fasteners.
- D. Install and connect precharged refrigerant tubing to component's quick-connect fittings. Install tubing to allow access to unit.

### 3.2 CONNECTIONS

- A. Piping installation requirements are specified in other Sections. Drawings indicate general arrangement of piping, fittings, and specialties.

### 3.3 FIELD QUALITY CONTROL

- A. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect, test, and adjust components, assemblies, and equipment installations, including connections.
- B. Perform tests and inspections.
  - 1. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect components, assemblies, and equipment installations, including connections, and to assist in testing.
- C. Tests and Inspections:
  - 1. Leak Test: After installation, charge system and test for leaks. Repair leaks and retest until no leaks exist.
  - 2. Operational Test: After electrical circuitry has been energized, start units to confirm proper motor rotation and unit operation.
  - 3. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.
- D. Remove and replace malfunctioning units and retest as specified above.
- E. Prepare test and inspection reports.

### 3.4 STARTUP SERVICE

- A. Perform startup service.
  - 1. Complete installation and startup checks according to manufacturer's written instructions.

3.5 DEMONSTRATION

- A. Train Owner's maintenance personnel to adjust, operate, and maintain units.

END OF SECTION 238126

## SECTION 260500 - COMMON WORK RESULTS FOR ELECTRICAL

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. Section Includes:
1. Sleeves for raceways and cables.
  2. Sleeve seals.
  3. Grout.
  4. Common electrical installation requirements.

#### 1.2 SUBMITTALS

- A. Product Data: For sleeve seals.

#### 1.3 COORDINATION

- A. Coordinate layout and installation with all other trades. Refer to section 230500 'Common Work Results for HVAC', paragraphs 1.3 and 1.4 for specific requirements regarding coordination procedures required.

### PART 2 - PRODUCTS

#### 2.1 SLEEVES FOR RACEWAYS AND CABLES

- A. Steel Pipe Sleeves: ASTM A 53/A 53M, Type E, Grade B, Schedule 40, galvanized steel, plain ends.

#### 2.2 GROUT

- A. Nonmetallic, Shrinkage-Resistant Grout: ASTM C 1107, factory-packaged, nonmetallic aggregate grout, noncorrosive, nonstaining, mixed with water to consistency suitable for application and a 30-minute working time.

### PART 3 - EXECUTION

#### 3.1 COMMON REQUIREMENTS FOR ELECTRICAL INSTALLATION

- A. Comply with NECA 1.
- B. Measure indicated mounting heights to bottom of unit for suspended items and to center of unit for wall-mounting items.

- C. Headroom Maintenance: If mounting heights or other location criteria are not indicated, arrange and install components and equipment to provide maximum possible headroom consistent with these requirements.
- D. Equipment: Install to facilitate service, maintenance, and repair or replacement of components of both electrical equipment and other nearby installations. Connect in such a way as to facilitate future disconnecting with minimum interference with other items in the vicinity.
- E. Right of Way: Give to piping systems installed at a required slope.

### 3.2 SLEEVE INSTALLATION FOR ELECTRICAL PENETRATIONS

- A. Electrical penetrations occur when raceways, cables, wireways, cable trays, or busways penetrate concrete slabs, concrete or masonry walls, or fire-rated floor and wall assemblies.
- B. Concrete Slabs and Walls: Install sleeves for penetrations unless core-drilled holes or formed openings are used. Install sleeves during erection of slabs and walls.
- C. Use pipe sleeves unless penetration arrangement requires rectangular sleeved opening.
- D. Fire-Rated Assemblies: Install sleeves for penetrations of fire-rated floor and wall assemblies unless openings compatible with firestop system used are fabricated during construction of floor or wall.
- E. Cut sleeves to length for mounting flush with both surfaces of walls.
- F. Extend sleeves installed in floors 2 inches above finished floor level.
- G. Size pipe sleeves to provide 1/4-inch annular clear space between sleeve and raceway or cable, unless indicated otherwise.
- H. Seal space outside of sleeves with grout for penetrations of concrete and masonry
  - 1. Promptly pack grout solidly between sleeve and wall so no voids remain. Tool exposed surfaces smooth; protect grout while curing.
- I. Interior Penetrations of Non-Fire-Rated Walls and Floors: Seal annular space between sleeve and raceway or cable, using joint sealant appropriate for size, depth, and location of joint. Comply with requirements in Division 07 Section "Joint Sealants."
- J. Fire-Rated-Assembly Penetrations: Maintain indicated fire rating of walls, partitions, ceilings, and floors at raceway and cable penetrations. Install sleeves and seal raceway and cable penetration sleeves with firestop materials. Comply with requirements in Division 07 Section "Penetration Firestopping."
- K. Roof-Penetration Sleeves: Seal penetration of individual raceways and cables with flexible boot-type flashing units applied in coordination with roofing work.

### 3.3 SLEEVE-SEAL INSTALLATION

- A. Install to seal exterior wall penetrations.



- B. Use type and number of sealing elements recommended by manufacturer for raceway or cable material and size. Position raceway or cable in center of sleeve. Assemble mechanical sleeve seals and install in annular space between raceway or cable and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.

#### 3.4 FIRESTOPPING

- A. Apply firestopping to penetrations of fire-rated floor and wall assemblies for electrical installations to restore original fire-resistance rating of assembly.

END OF SECTION 260500

## SECTION 260519 - LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. This Section includes the following:
  - 1. Building wires and cables rated 600 V and less.
  - 2. Connectors, splices, and terminations rated 600 V and less.
  - 3. Sleeves and sleeve seals for cables.

#### 1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Field quality-control test reports.

#### 1.3 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- B. Comply with NFPA 70.

### PART 2 - PRODUCTS

#### 2.1 CONDUCTORS AND CABLES

- A. Aluminum and Copper Conductors: Comply with NEMA WC 70.
- B. Conductor Insulation: Comply with NEMA WC 70 for Types THHN-THWN.

#### 2.2 CONNECTORS AND SPLICES

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. AFC Cable Systems, Inc.
  - 2. Hubbell Power Systems, Inc.
  - 3. O-Z/Gedney; EGS Electrical Group LLC.
  - 4. 3M; Electrical Products Division.
  - 5. Tyco Electronics Corp.
  - 6. Pre-approved equal.

- B. Description: Factory-fabricated connectors and splices of size, ampacity rating, material, type, and class for application and service indicated.

## 2.3 SLEEVES FOR CABLES

- A. Steel Pipe Sleeves: ASTM A 53/A 53M, Type E, Grade B, Schedule 40, galvanized steel, plain ends.
- B. Coordinate sleeve selection and application with selection and application of firestopping specified in Division 07 Section "Penetration Firestopping."

## PART 3 - EXECUTION

### 3.1 CONDUCTOR MATERIAL APPLICATIONS

- A. Feeders: Copper. Solid for No. 10 AWG and smaller; stranded for No. 8 AWG and larger.
- B. Branch Circuits: Copper. Solid for No. 10 AWG and smaller; stranded for No. 8 AWG and larger.

### 3.2 CONDUCTOR INSULATION AND MULTICONDUCTOR CABLE APPLICATIONS AND WIRING METHODS

- A. Service Entrance: Type THHN-THWN, single conductors in raceway.
- B. Feeders Concealed in Ceilings, Walls, Partitions, and Crawlspace: Type THHN-THWN, single conductors in raceway.
- C. Feeders Concealed in Concrete, below Slabs-on-Grade, and Underground: Type THHN-THWN, single conductors in raceway.
- D. Branch Circuits Concealed in Ceilings, Walls, and Partitions:
  - 1. Home runs: Type THHN-THWN, single conductors in raceway
  - 2. Between devices: Type THHN-THWN, single conductors in raceway..
- E. Branch Circuits Concealed in Concrete, below Slabs-on-Grade, and Underground: Type THHN-THWN, single conductors in raceway.
- F. Cord Drops and Portable Appliance Connections: Type SO, hard service cord with stainless-steel, wire-mesh, strain relief device at terminations to suit application.
- G. Class 1 Control Circuits: Type THHN-THWN, in raceway.
- H. Class 2 Control Circuits: Type THHN-THWN, in raceway.

### 3.3 INSTALLATION OF CONDUCTORS AND CABLES

- A. Conceal cables in finished walls, ceilings, and floors, unless otherwise indicated.

- B. Use manufacturer-approved pulling compound or lubricant where necessary; compound used must not deteriorate conductor or insulation. Do not exceed manufacturer's recommended maximum pulling tensions and sidewall pressure values.
- C. Use pulling means, including fish tape, cable, rope, and basket-weave wire/cable grips, that will not damage cables or raceway.
- D. Install exposed cables parallel and perpendicular to surfaces of exposed structural members, and follow surface contours.
- E. Identify and color-code conductors and cables according to Division 26 Section "Identification for Electrical Systems."
- F. Tighten electrical connectors and terminals according to manufacturer's published torque-tightening values. If manufacturer's torque values are not indicated, use those specified in UL 486A and UL 486B.
- G. Make splices and taps that are compatible with conductor material and that possess equivalent or better mechanical strength and insulation ratings than unspliced conductors.
- H. Wiring at Outlets: Install conductor at each outlet, with at least 6 inches of slack.

END OF SECTION 260519

## SECTION 260523 - CONTROL-VOLTAGE ELECTRICAL POWER CABLES

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. Section Includes:
  - 1. UTP cabling.
  - 2. RS-232 cabling.
  - 3. RS-485 cabling.
  - 4. Low-voltage control cabling.
  - 5. Control-circuit conductors.
  - 6. Identification products.

#### 1.2 DEFINITIONS

- A. Low Voltage: As defined in NFPA 70 for circuits and equipment operating at less than 50 V or for remote-control and signaling power-limited circuits.

#### 1.3 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Field quality-control reports.
- C. Maintenance data.

#### 1.4 QUALITY ASSURANCE

- A. Testing Agency Qualifications: Member company of an NRTL.
- B. Surface-Burning Characteristics: As determined by testing identical products according to ASTM E 84 by a qualified testing agency. Identify products with appropriate markings of applicable testing agency.
  - 1. Flame-Spread Index: 25 or less.
  - 2. Smoke-Developed Index: 450 or less.
- C. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

#### 1.5 DELIVERY, STORAGE, AND HANDLING

- A. Test cables upon receipt at Project site.
- B. Test each pair of UTP cable for open and short circuits.

## PART 2 - PRODUCTS

### 2.1 PATHWAYS

- A. Support of Open Cabling: NRTL labeled for support of cabling, designed to prevent degradation of cable performance and pinch points that could damage cable.
  - 1. Support brackets with cable tie slots for fastening cable ties to brackets.
  - 2. Lacing bars, spools, J-hooks, and D-rings.
  - 3. Straps and other devices.
- B. Conduit and Boxes: Comply with requirements in Division 26 Section "Raceway and Boxes for Electrical Systems." Flexible metal conduit shall not be used.
  - 1. Outlet boxes shall be no smaller than 2 inches wide, 3 inches high, and 2-1/2 inches deep.

### 2.2 LOW-VOLTAGE CONTROL CABLE

- A. Paired Cable: NFPA 70, Type CMG.
  - 1. One pair, twisted, No. 16 AWG, stranded (19x29) tinned-copper conductors.
  - 2. PVC insulation.
  - 3. Unshielded.
  - 4. PVC jacket.
  - 5. Flame Resistance: Comply with UL 1581.
- B. Plenum-Rated, Paired Cable: NFPA 70, Type CMP.
  - 1. One pair, twisted, No. 16 AWG, stranded (19x29) tinned-copper conductors.
  - 2. PVC insulation.
  - 3. Unshielded.
  - 4. PVC jacket.
  - 5. Flame Resistance: Comply with NFPA 262.
- C. Paired Cable: NFPA 70, Type CMG.
  - 1. One pair, twisted, No. 18 AWG, stranded (19x30) tinned-copper conductors.
  - 2. PVC insulation.
  - 3. Unshielded.
  - 4. PVC jacket.
  - 5. Flame Resistance: Comply with UL 1581.
- D. Plenum-Rated, Paired Cable: NFPA 70, Type CMP.
  - 1. One pair, twisted, No. 18 AWG, stranded (19x30) tinned-copper conductors.
  - 2. Fluorinated ethylene propylene insulation.
  - 3. Unshielded.
  - 4. Plastic jacket.
  - 5. Flame Resistance: NFPA 262, Flame Test.

## 2.3 CONTROL-CIRCUIT CONDUCTORS

- A. Class 1 Control Circuits: Stranded copper, Type THHN-THWN, in raceway, complying with UL 83.
- B. Class 2 Control Circuits: Stranded copper, Type THHN-THWN, in raceway, complying with UL 83.
- C. Class 3 Remote-Control and Signal Circuits: Stranded copper, Type TW or Type TF, complying with UL 83.

## 2.4 IDENTIFICATION PRODUCTS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Brady Corporation.
  - 2. HellermannTyton.
  - 3. Kroy LLC.
  - 4. Panduit Corp.
- B. Comply with UL 969 for a system of labeling materials, including label stocks, laminating adhesives, and inks used by label printers.
- C. Comply with requirements in Division 26 Section "Identification for Electrical Systems."

## PART 3 - EXECUTION

### 3.1 INSTALLATION OF PATHWAYS

- A. Comply with TIA/EIA-569-A for pull-box sizing and length of conduit and number of bends between pull points.
- B. Comply with requirements in Division 26 Section "Raceway and Boxes for Electrical Systems" for installation of conduits and wireways.

### 3.2 INSTALLATION OF CONDUCTORS AND CABLES

- A. Comply with NECA 1.
- B. Installation of Control-Circuit Conductors:
  - 1. Install wiring in raceways. Comply with requirements specified in Division 26 Section "Raceway and Boxes for Electrical Systems."
- C. Open-Cable Installation:
  - 1. Install cabling with horizontal and vertical cable guides in telecommunications spaces with terminating hardware and interconnection equipment.
  - 2. Suspend copper cable not in a wireway or pathway a minimum of 8 inches above ceilings by cable supports not more than 60 inches apart.

3. Cable shall not be run through structural members or in contact with pipes, ducts, or other potentially damaging items.

### 3.3 CONTROL-CIRCUIT CONDUCTORS

#### A. Minimum Conductor Sizes:

1. Class 1 remote-control and signal circuits, No 14 AWG.
2. Class 2 low-energy, remote-control, and signal circuits, No. 16 AWG.
3. Class 3 low-energy, remote-control, alarm, and signal circuits, No 12 AWG.

### 3.4 FIRESTOPPING

- #### A. Comply with requirements in Division 07 Section "Penetration Firestopping."

### 3.5 GROUNDING

- #### A. For low-voltage wiring and cabling, comply with requirements in Division 26 Section "Grounding and Bonding for Electrical Systems."

### 3.6 IDENTIFICATION

- #### A. Identify system components, wiring, and cabling according to TIA/EIA-606-A. Comply with requirements for identification specified in Division 26 Section "Identification for Electrical Systems."

END OF SECTION 260523



## SECTION 260526 - GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. This Section includes methods and materials for grounding systems and equipment.

#### 1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Field quality-control test reports.

#### 1.3 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- B. Comply with UL 467 for grounding and bonding materials and equipment.

### PART 2 - PRODUCTS

#### 2.1 CONDUCTORS

- A. Insulated Conductors: Copper wire or cable insulated for 600 V unless otherwise required by applicable Code or authorities having jurisdiction.

#### 2.2 CONNECTORS

- A. Listed and labeled by a nationally recognized testing laboratory acceptable to authorities having jurisdiction for applications in which used, and for specific types, sizes, and combinations of conductors and other items connected.
- B. Bolted Connectors for Conductors and Pipes: Copper or copper alloy, bolted pressure-type, with at least two bolts.
  - 1. Pipe Connectors: Clamp type, sized for pipe.
- C. Welded Connectors: Exothermic-welding kits of types recommended by kit manufacturer for materials being joined and installation conditions.

## PART 3 - EXECUTION

### 3.1 APPLICATIONS

- A. Conductors: Install solid conductor for No. 8 AWG and smaller, and stranded conductors for No. 6 AWG and larger, unless otherwise indicated.
- B. Conductor Terminations and Connections:
  - 1. Pipe and Equipment Grounding Conductor Terminations: Bolted connectors.
  - 2. Connections to Structural Steel: Welded connectors.

### 3.2 EQUIPMENT GROUNDING

- A. Install insulated equipment grounding conductors with the following items, in addition to those required by NFPA 70:
  - 1. Feeders and branch circuits.
  - 2. Lighting circuits.
  - 3. Receptacle circuits.
  - 4. Single-phase motor and appliance branch circuits.
  - 5. Three-phase motor and appliance branch circuits.
  - 6. Flexible raceway runs.
  - 7. Armored and metal-clad cable runs.
- B. Air-Duct Equipment Circuits: Install insulated equipment grounding conductor to duct-mounted electrical devices operating at 120 V and more, including air cleaners, heaters, dampers, humidifiers, and other duct electrical equipment. Bond conductor to each unit and to air duct and connected metallic piping.

### 3.3 INSTALLATION

- A. Grounding Conductors: Route along shortest and straightest paths possible, unless otherwise indicated or required by Code. Avoid obstructing access or placing conductors where they may be subjected to strain, impact, or damage.
- B. Bonding Straps and Jumpers: Install in locations accessible for inspection and maintenance, except where routed through short lengths of conduit.
  - 1. Bonding to Structure: Bond straps directly to basic structure, taking care not to penetrate any adjacent parts.
  - 2. Bonding to Equipment Mounted on Vibration Isolation Hangers and Supports: Install so vibration is not transmitted to rigidly mounted equipment.
  - 3. Use exothermic-welded connectors for outdoor locations, but if a disconnect-type connection is required, use a bolted clamp.

END OF SECTION 260526

## SECTION 260529 - HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS

### PART 1 - GENERAL

#### 1.1 SUMMARY

A. Section includes:

1. Hangers and supports for electrical equipment and systems.

#### 1.2 PERFORMANCE REQUIREMENTS

- A. Design supports for multiple raceways capable of supporting combined weight of supported systems and its contents.
- B. Design equipment supports capable of supporting combined operating weight of supported equipment and connected systems and components.
- C. Rated Strength: Adequate in tension, shear, and pullout force to resist maximum loads calculated or imposed for this Project, with a minimum structural safety factor of five times the applied force.

#### 1.3 SUBMITTALS

- A. Product Data: For steel slotted support systems.
- B. Shop Drawings: Show fabrication and installation details and include calculations for the following:
1. Trapeze hangers. Include Product Data for components.
  2. Steel slotted channel systems. Include Product Data for components.
  3. Equipment supports.
- C. Welding certificates.

#### 1.4 QUALITY ASSURANCE

- A. Welding: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."
- B. Comply with NFPA 70.

## PART 2 - PRODUCTS

### 2.1 SUPPORT, ANCHORAGE, AND ATTACHMENT COMPONENTS

- A. Steel Slotted Support Systems: Comply with MFMA-4, factory-fabricated components for field assembly.
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Allied Tube & Conduit.
    - b. Cooper B-Line, Inc.; a division of Cooper Industries.
    - c. ERICO International Corporation.
    - d. GS Metals Corp.
    - e. Thomas & Betts Corporation.
    - f. Unistrut; Tyco International, Ltd.
    - g. Wesanco, Inc.
    - h. Pre-approved equal.
  2. Metallic Coatings: Hot-dip galvanized after fabrication and applied according to MFMA-4.
  3. Nonmetallic Coatings: Manufacturer's standard PVC, polyurethane, or polyester coating applied according to MFMA-4.
  4. Painted Coatings: Manufacturer's standard painted coating applied according to MFMA-4.
  5. Channel Dimensions: Selected for applicable load criteria.
- B. Raceway and Cable Supports: As described in NECA 1 and NECA 101.
- C. Conduit and Cable Support Devices: Steel hangers, clamps, and associated fittings, designed for types and sizes of raceway or cable to be supported.
- D. Support for Conductors in Vertical Conduit: Factory-fabricated assembly consisting of threaded body and insulating wedging plug or plugs for non-armored electrical conductors or cables in riser conduits. Plugs shall have number, size, and shape of conductor gripping pieces as required to suit individual conductors or cables supported. Body shall be malleable iron.
- E. Structural Steel for Fabricated Supports and Restraints: ASTM A 36/A 36M, steel plates, shapes, and bars; black and galvanized.
- F. Mounting, Anchoring, and Attachment Components: Items for fastening electrical items or their supports to building surfaces include the following:
1. Powder-Actuated Fasteners: Threaded-steel stud, for use in hardened portland cement concrete, steel, or wood, with tension, shear, and pullout capacities appropriate for supported loads and building materials where used.
    - a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
      - 1) Hilti Inc.
      - 2) ITW Ramset/Red Head; a division of Illinois Tool Works, Inc.
      - 3) MKT Fastening, LLC.

- 4) Simpson Strong-Tie Co., Inc.; Masterset Fastening Systems Unit.
  - 5) Pre-approved equal.
2. Mechanical-Expansion Anchors: Insert-wedge-type, stainless steel, for use in hardened portland cement concrete with tension, shear, and pullout capacities appropriate for supported loads and building materials in which used.
    - a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
      - 1) Cooper B-Line, Inc.; a division of Cooper Industries.
      - 2) Empire Tool and Manufacturing Co., Inc.
      - 3) Hilti Inc.
      - 4) ITW Ramset/Red Head; a division of Illinois Tool Works, Inc.
      - 5) MKT Fastening, LLC.
      - 6) Pre-approved equal.
  3. Concrete Inserts: Steel or malleable-iron, slotted support system units similar to MSS Type 18; complying with MFMA-4 or MSS SP-58.
  4. Clamps for Attachment to Steel Structural Elements: MSS SP-58, type suitable for attached structural element.
  5. Through Bolts: Structural type, hex head, and high strength. Comply with ASTM A 325.
  6. Toggle Bolts: All-steel springhead type.
  7. Hanger Rods: Threaded steel.

## 2.2 FABRICATED METAL EQUIPMENT SUPPORT ASSEMBLIES

- A. Description: Welded or bolted, structural-steel shapes, shop or field fabricated to fit dimensions of supported equipment.
- B. Materials: Comply with requirements in Division 05 Section "Metal Fabrications" for steel shapes and plates.

## PART 3 - EXECUTION

### 3.1 APPLICATION

- A. Comply with NECA 1 and NECA 101 for application of hangers and supports for electrical equipment and systems except if requirements in this Section are stricter.
- B. Maximum Support Spacing and Minimum Hanger Rod Size for Raceway: Space supports for EMT, IMC, and RMC as required by NFPA 70. Minimum rod size shall be 1/4 inch in diameter.
- C. Multiple Raceways or Cables: Install trapeze-type supports fabricated with steel slotted support system, sized so capacity can be increased by at least 25 percent in future without exceeding specified design load limits.
  1. Secure raceways and cables to these supports with two-bolt conduit clamps.

- D. Spring-steel clamps designed for supporting single conduits without bolts may be used for 1-1/2-inch and smaller raceways serving branch circuits and communication systems above suspended ceilings and for fastening raceways to trapeze supports.

### 3.2 SUPPORT INSTALLATION

- A. Comply with NECA 1 and NECA 101 for installation requirements except as specified in this Article.
- B. Raceway Support Methods: In addition to methods described in NECA 1, EMT, IMC, and RMC may be supported by openings through structure members, as permitted in NFPA 70.
- C. Strength of Support Assemblies: Where not indicated, select sizes of components so strength will be adequate to carry present and future static loads within specified loading limits. Minimum static design load used for strength determination shall be weight of supported components plus 200 lb.
- D. Mounting and Anchorage of Surface-Mounted Equipment and Components: Anchor and fasten electrical items and their supports to building structural elements by the following methods unless otherwise indicated by code:
  - 1. To Wood: Fasten with lag screws or through bolts.
  - 2. To New Concrete: Bolt to concrete inserts.
  - 3. To Masonry: Approved toggle-type bolts on hollow masonry units and expansion anchor fasteners on solid masonry units.
  - 4. To Steel: Beam clamps (MSS Type 19, 21, 23, 25, or 27) complying with MSS SP-69.
  - 5. To Light Steel: Sheet metal screws.
  - 6. Items Mounted on Hollow Walls and Nonstructural Building Surfaces: Mount cabinets, panelboards, disconnect switches, control enclosures, pull and junction boxes, transformers, and other devices on slotted-channel racks attached to substrate by means that meet anchorage requirements.
- E. Drill holes for expansion anchors in concrete at locations and to depths that avoid reinforcing bars.

### 3.3 INSTALLATION OF FABRICATED METAL SUPPORTS

- A. Comply with installation requirements in Division 05 Section "Metal Fabrications" for site-fabricated metal supports.
- B. Cut, fit, and place miscellaneous metal supports accurately in location, alignment, and elevation to support and anchor electrical materials and equipment.
- C. Field Welding: Comply with AWS D1.1/D1.1M.

### 3.4 PAINTING

- A. Touchup: Clean field welds and abraded areas of shop paint. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting. Comply with SSPC-PA 1 requirements for touching up field-painted surfaces.

1. Apply paint by brush or spray to provide minimum dry film thickness of 2.0 mils.
- B. Touchup: Comply with requirements in Division 09 painting Sections for cleaning and touchup painting of field welds, bolted connections, and abraded areas of shop paint on miscellaneous metal.
- C. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A 780.

END OF SECTION 260529

## SECTION 260533 - RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. This Section includes raceways, fittings, boxes, enclosures, and cabinets for electrical wiring.

#### 1.2 SUBMITTALS

- A. Product Data: For surface raceways, wireways and fittings, floor boxes, hinged-cover enclosures, and cabinets.
- B. Shop Drawings: For custom enclosures and cabinets. Include plans, elevations, sections, details, and attachments to other work.

#### 1.3 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- B. Comply with NFPA 70.

### PART 2 - PRODUCTS

#### 2.1 METAL CONDUIT AND TUBING

- A. Rigid Steel Conduit: ANSI C80.1.
- B. IMC: ANSI C80.6.
- C. EMT: ANSI C80.3.
- D. FMC: Zinc-coated steel.
- E. LFMC: Flexible steel conduit with PVC jacket.
- F. Fittings for Conduit (Including all Types and Flexible and Liquidtight), EMT, and Cable: NEMA FB 1; listed for type and size raceway with which used, and for application and environment in which installed.
  - 1. Conduit Fittings for Hazardous (Classified) Locations: Comply with UL 886.
  - 2. Fittings for EMT: compression type.



## 2.2 NONMETALLIC CONDUIT AND TUBING

- A. ENT: NEMA TC 13.
- B. RNC: NEMA TC 2, Type EPC-40-PVC, unless otherwise indicated. Exception: direct-buried conduit (for site lighting) shall be EPC-80-PVC. Fittings for ENT and RNC: NEMA TC 3; match to conduit or tubing type and material.
- C. Fittings for LFNC: UL 514B.

## 2.3 METAL WIREWAYS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Cooper B-Line, Inc.
  - 2. Hoffman.
  - 3. Square D; Schneider Electric.
  - 4. Pre-approved equal.
- B. Description: Sheet metal sized and shaped as indicated, NEMA 250, Type 1, unless otherwise indicated.
- C. Fittings and Accessories: Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, and other fittings to match and mate with wireways as required for complete system.
- D. Wireway Covers: Screw-cover type.
- E. Finish: Manufacturer's standard enamel finish.

## 2.4 NONMETALLIC WIREWAYS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Hoffman.
  - 2. Lamson & Sessions; Carlon Electrical Products.
  - 3. Pre-approved equal.
- B. Description: PVC plastic, extruded and fabricated to size and shape indicated, with snap-on cover and mechanically coupled connections with plastic fasteners.
- C. Fittings and Accessories: Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, and other fittings to match and mate with wireways as required for complete system.

## 2.5 BOXES, ENCLOSURES, AND CABINETS

- A. Sheet Metal Outlet and Device Boxes: NEMA OS 1.
- B. Cast-Metal Outlet and Device Boxes: NEMA FB 1, aluminum, Type FD, with gasketed cover.

- C. Nonmetallic Outlet and Device Boxes: NEMA OS 2.
- D. Metal Floor Boxes: Cast metal, fully adjustable, rectangular.
- E. Nonmetallic Floor Boxes: Nonadjustable, round.
- F. Small Sheet Metal Pull and Junction Boxes: NEMA OS 1.
- G. Cast-Metal Access, Pull, and Junction Boxes: NEMA FB 1, cast aluminum with gasketed cover.
- H. Hinged-Cover Enclosures: NEMA 250, Type 1, with continuous-hinge cover with flush latch, unless otherwise indicated.
  - 1. Metal Enclosures: Steel, finished inside and out with manufacturer's standard enamel.
  - 2. Nonmetallic Enclosures: Plastic.
- I. Cabinets:
  - 1. NEMA 250, Type 1, galvanized-steel box with removable interior panel and removable front, finished inside and out with manufacturer's standard enamel.
  - 2. Hinged door in front cover with flush latch and concealed hinge.
  - 3. Key latch to match panelboards.
  - 4. Metal barriers to separate wiring of different systems and voltage.
  - 5. Accessory feet where required for freestanding equipment.

## PART 3 - EXECUTION

### 3.1 RACEWAY APPLICATION

- A. Outdoors: Apply raceway products as specified below, unless otherwise indicated:
  - 1. Exposed Conduit: Rigid steel conduit.
  - 2. Concealed Conduit, Aboveground: EMT.
  - 3. Connection to Vibrating Equipment (Including Transformers and Hydraulic, Pneumatic, Electric Solenoid, or Motor-Driven Equipment): LFMC.
  - 4. Boxes and Enclosures, Aboveground: NEMA 250, Type 3R.
- B. Comply with the following indoor applications, unless otherwise indicated:
  - 1. Exposed, Not Subject to Physical Damage: EMT.
  - 2. Exposed, Not Subject to Severe Physical Damage: EMT.
  - 3. Exposed and Subject to Severe Physical Damage: Rigid steel conduit. Includes raceways in the following locations:
    - a. Mechanical rooms.
  - 4. Concealed in Ceilings and Interior Walls and Partitions: EMT or Type MC where acceptable.
  - 5. Connection to Vibrating Equipment (Including Transformers and Hydraulic, Pneumatic, Electric Solenoid, or Motor-Driven Equipment): FMC, except use LFMC in damp or wet locations.
  - 6. Damp or Wet Locations: Rigid steel conduit.

7. Raceways for Optical Fiber or Communications Cable: EMT.
  8. Boxes and Enclosures: NEMA 250, Type 1, except use NEMA 250, Type 4, stainless steel in damp or wet locations.
  9. Metal-clad Cable, Type MC:
    - a. Type MC cable shall be U.L. listed. MC cable materials, marking, installation methods and permitted usage shall comply with Article 334 of the N.E.C. and with these specifications.”
    - b. Type MC cable shall be as manufactured by American Flexible Conduit Company, Cerro, Coleman or Alflex.
    - c. Type MC cable may be used in lieu of EMT conduit only for branch circuits (with up to four conductors not including ground conductor) and only in dry concealed locations above grade except where specifically not permitted by the NEC or this specification.
  10. Type MC cable shall not be permitted for the following uses:
    - a. Homeruns to panelboards.
    - b. Where exposed to view.
    - c. Where exposed to damage.
    - d. Hazardous locations.
    - e. Concealed above non-accessible ceilings or in walls.
    - f. Wet locations.
    - g. Emergency circuits covered by NFPA Art 700 Emergency Systems
  11. All type MC cables shall contain conductors suitable for the application. Reference the “conductor insulation and multiconductor cable applications and wiring methods” section in 260519 for conductors.
  12. All type MC cables shall contain a separate insulated green grounding conductor along with the current carrying conductors sized in accordance with the NEC.
    - a. UL listed connectors with insulated bushings and offset screw connections shall be utilized for MC cable installations.
  13. Type MC cable shall be supported and secured within twelve (12) inches of every outlet box or fitting.
  14. Type MC cable whips may be utilized in lieu of flexible conduit and wire for wiring from light fixtures in accessible ceilings to junction boxes above ceiling. Cable whip lengths shall be sufficient to allow for relocating each light fixture within a five (5) foot radius of its installed location.
- C. Minimum Raceway Size: 1/2-inch trade size.
- D. Raceway Fittings: Compatible with raceways and suitable for use and location.
1. Rigid and Intermediate Steel Conduit: Use threaded rigid steel conduit fittings, unless otherwise indicated.

### 3.2 INSTALLATION

- A. Comply with NECA 1 for installation requirements applicable to products specified in Part 2 except where requirements on Drawings or in this Article are stricter.
- B. Keep raceways at least 6 inches away from parallel runs of flues and steam or hot-water pipes. Install horizontal raceway runs above water and steam piping.
- C. Complete raceway installation before starting conductor installation.

- D. Support raceways as specified in Division 26 Section "Hangers and Supports for Electrical Systems."
- E. Arrange stub-ups so curved portions of bends are not visible above the finished slab.
- F. Install no more than the equivalent of three 90-degree bends in any conduit run except for communications conduits, for which fewer bends are allowed.
- G. Conceal conduit and EMT within finished walls, ceilings, and floors, unless otherwise indicated.
- H. Raceway Terminations at Locations Subject to Moisture or Vibration: Use insulating bushings to protect conductors, including conductors smaller than No. 4 AWG.
- I. Install pull wires in empty raceways. Use polypropylene or monofilament plastic line with not less than 200-lb tensile strength. Leave at least 12 inches of slack at each end of pull wire.
- J. Install raceway sealing fittings at suitable, approved, and accessible locations and fill them with listed sealing compound. For concealed raceways, install each fitting in a flush steel box with a blank cover plate having a finish similar to that of adjacent plates or surfaces. Install raceway sealing fittings at the following points:
  - 1. Where conduits pass from warm to cold locations, such as boundaries of refrigerated spaces.
  - 2. Where otherwise required by NFPA 70.
- K. Flexible Conduit Connections: Use maximum of 72 inches of flexible conduit for recessed and semirecessed lighting fixtures, equipment subject to vibration, noise transmission, or movement; and for transformers and motors.
  - 1. Use LFMC in damp or wet locations subject to severe physical damage.
  - 2. Use LFMC or LFNC in damp or wet locations not subject to severe physical damage.

### 3.3 INSTALLATION OF EXPOSED RACEWAY

- A. Locations with No Ceilings Where Structure is Exposed:
  - 1. Install all raceway parallel and perpendicular to surfaces of exposed structural members, and follow surface contours.
  - 2. Install all raceway above the structural members, tight to deck.
  - 3. All exposed raceway must be conduit; no exposed MC cable allowed.

### 3.4 FIRESTOPPING

- A. Apply firestopping to electrical penetrations of fire-rated floor and wall assemblies to restore original fire-resistance rating of assembly.

END OF SECTION 260533

## SECTION 260553 - IDENTIFICATION FOR ELECTRICAL SYSTEMS

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. Section Includes:
1. Identification of power and control cables.
  2. Identification for conductors.
  3. Warning labels and signs.
  4. Instruction signs.
  5. Equipment identification labels.
  6. Miscellaneous identification products.

#### 1.2 SUBMITTALS

- A. Product Data: For each electrical identification product indicated.

#### 1.3 QUALITY ASSURANCE

- A. Comply with ANSI A13.1.
- B. Comply with NFPA 70.
- C. Comply with 29 CFR 1910.144 and 29 CFR 1910.145.
- D. Comply with ANSI Z535.4 for safety signs and labels.
- E. Adhesive-attached labeling materials, including label stocks, laminating adhesives, and inks used by label printers, shall comply with UL 969.

### PART 2 - PRODUCTS

#### 2.1 POWER AND CONTROL CABLE IDENTIFICATION MATERIALS

- A. Comply with ANSI A13.1 for minimum size of letters for legend and for minimum length of color field for each raceway and cable size.
- B. Self-Adhesive Vinyl Labels: Preprinted, flexible label laminated with a clear, weather- and chemical-resistant coating and matching wraparound adhesive tape for securing ends of legend label.

## 2.2 CONDUCTOR IDENTIFICATION MATERIALS

- A. Color-Coding Conductor Tape: Colored, self-adhesive vinyl tape not less than 3 mils thick by 1 to 2 inches wide.
- B. Self-Adhesive Vinyl Labels: Preprinted, flexible label laminated with a clear, weather- and chemical-resistant coating and matching wraparound adhesive tape for securing ends of legend label.

## 2.3 WARNING LABELS AND SIGNS

- A. Comply with NFPA 70 and 29 CFR 1910.145.
- B. Self-Adhesive Warning Labels: Factory-printed, multicolor, pressure-sensitive adhesive labels, configured for display on front cover, door, or other access to equipment unless otherwise indicated.
- C. Baked-Enamel Warning Signs:
  - 1. Preprinted aluminum signs, punched or drilled for fasteners, with colors, legend, and size required for application.
  - 2. 1/4-inch grommets in corners for mounting.
  - 3. Nominal size, 7 by 10 inches.
- D. Warning label and sign shall include, but are not limited to, the following legends:
  - 1. Multiple Power Source Warning: "DANGER - ELECTRICAL SHOCK HAZARD - EQUIPMENT HAS MULTIPLE POWER SOURCES."
  - 2. Workspace Clearance Warning: "WARNING - OSHA REGULATION - AREA IN FRONT OF ELECTRICAL EQUIPMENT MUST BE KEPT CLEAR FOR 36 INCHES."

## 2.4 EQUIPMENT IDENTIFICATION LABELS

- A. Self-Adhesive, Engraved, Laminated Acrylic or Melamine Label: Adhesive backed, with white letters on a dark-gray background. Minimum letter height shall be 3/8 inch.

## 2.5 MISCELLANEOUS IDENTIFICATION PRODUCTS

- A. Paint: Comply with requirements in Division 09 painting Sections for paint materials and application requirements. Select paint system applicable for surface material and location (exterior or interior).
- B. Fasteners for Labels and Signs: Self-tapping, stainless-steel screws or stainless-steel machine screws with nuts and flat and lock washers.

## PART 3 - EXECUTION

### 3.1 INSTALLATION

- A. Location: Install identification materials and devices at locations for most convenient viewing without interference with operation and maintenance of equipment.
- B. Apply identification devices to surfaces that require finish after completing finish work.
- C. Self-Adhesive Identification Products: Clean surfaces before application, using materials and methods recommended by manufacturer of identification device.
- D. Attach signs and plastic labels that are not self-adhesive type with mechanical fasteners appropriate to the location and substrate.

### 3.2 IDENTIFICATION SCHEDULE

- A. Power-Circuit Conductor Identification, 600 V or Less: For conductors in vaults, pull and junction boxes, manholes, and handholes, use color-coding conductor tape to identify the phase.
  - 1. Color-Coding for Phase and Voltage Level Identification, 600 V or Less: Use colors listed below for ungrounded service, feeder and branch-circuit conductors.
    - a. Color shall be factory applied.
    - b. Colors for 208/120-V Circuits:
      - 1) Phase A: Black.
      - 2) Phase B: Red.
      - 3) Phase C: Blue.
    - c. Field-Applied, Color-Coding Conductor Tape: Apply in half-lapped turns for a minimum distance of 6 inches from terminal points and in boxes where splices or taps are made. Apply last two turns of tape with no tension to prevent possible unwinding. Locate bands to avoid obscuring factory cable markings.
- B. Install instructional sign including the color-code for grounded and ungrounded conductors using adhesive-film-type labels.
- C. Operating Instruction Signs: Install instruction signs to facilitate proper operation and maintenance of electrical systems and items to which they connect. Install instruction signs with approved legend where instructions are needed for system or equipment operation.
- D. Equipment Identification Labels: On each unit of equipment, install unique designation label that is consistent with wiring diagrams, schedules, and the Operation and Maintenance Manual. Apply labels to disconnect switches and protection equipment, central or master units. Systems include power, lighting, control, communication, signal, monitoring, and alarm systems unless equipment is provided with its own identification.
  - 1. Labeling Instructions:
    - a. Indoor Equipment: Self-adhesive, engraved, laminated acrylic or melamine label. Unless otherwise indicated, provide a single line of text with 1/2-inch-high letters

on 1-1/2-inch-high label; where two lines of text are required, use labels 2 inches high.

- b. Outdoor Equipment: Engraved, laminated acrylic or melamine label.
- c. Elevated Components: Increase sizes of labels and letters to those appropriate for viewing from the floor.
- d. Unless provided with self-adhesive means of attachment, fasten labels with appropriate mechanical fasteners that do not change the NEMA or NRTL rating of the enclosure.

END OF SECTION 260553



## SECTION 260923 - LIGHTING CONTROL DEVICES

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. This Section includes the following lighting control devices:
  - 1. Indoor occupancy sensors.

#### 1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Field quality-control test reports.
- C. Operation and maintenance data.

#### 1.3 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.

### PART 2 - PRODUCTS

#### 2.1 INDOOR OCCUPANCY SENSORS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Cooper Industries, Inc.
  - 2. Hubbell Building Automation, Inc.
  - 3. Leviton Manufacturing Co., Inc.
  - 4. Lightolier Controls.
  - 5. Lithonia Lighting; Acuity Brands Lighting, Inc.
  - 6. Lutron Electronics Co., Inc.
  - 7. Sensor Switch, Inc.
  - 8. Square D.
  - 9. Watt Stopper.
  - 10. Steinel America
  - 11. Douglas Lighting Control.
- B. General Description: Wall- or ceiling-mounting, solid-state units with a separate relay unit.
  - 1. Operation: Unless otherwise indicated, turn lights on when covered area is occupied and off when unoccupied; with a time delay for turning lights off, adjustable over a minimum range of 1 to 15 minutes.

2. Sensor Output: Contacts rated to operate the connected relay, complying with UL 773A. Sensor shall be powered from the relay unit.
  3. Relay Unit: Dry contacts rated for 20-A ballast load at 120- and 277-V ac, for 13-A tungsten at 120-V ac, and for 1 hp at 120-V ac. Power supply to sensor shall be 24-V dc, 150-mA, Class 2 power source as defined by NFPA 70.
  4. Mounting:
    - a. Sensor: Suitable for mounting in any position on a standard outlet box.
    - b. Relay: Externally mounted through a 1/2-inch knockout in a standard electrical enclosure.
    - c. Time-Delay and Sensitivity Adjustments: Recessed and concealed behind hinged door.
  5. Indicator: LED, to show when motion is being detected during testing and normal operation of the sensor.
  6. Bypass Switch: Override the on function in case of sensor failure.
  7. Automatic Light-Level Sensor: Adjustable from 2 to 200 fc; keep lighting off when selected lighting level is present.
- C. PIR Type: Ceiling mounting; detect occupancy by sensing a combination of heat and movement in area of coverage.
1. Detector Sensitivity: Detect occurrences of 6-inch-minimum movement of any portion of a human body that presents a target of not less than 36 sq. in.
  2. Detection Coverage (Room): Detect occupancy anywhere in a circular area of 1000 sq. ft. when mounted on a 96-inch-high ceiling.
  3. Detection Coverage (Corridor): Detect occupancy within 90 feet when mounted on a 10-foot-high ceiling.
- D. Ultrasonic Type: Ceiling mounted; detect occupants in coverage area through pattern changes of reflected ultrasonic energy.
1. Detector Sensitivity: Detect a person of average size and weight moving not less than 12 inches in either a horizontal or a vertical manner at an approximate speed of 12 inches/s.
- E. Dual-Technology Type: Ceiling mounted; detect occupants in coverage area using PIR and ultrasonic detection methods. The particular technology or combination of technologies that control on-off functions is selectable in the field by operating controls on unit.
1. Sensitivity Adjustment: Separate for each sensing technology.
  2. Detector Sensitivity: Detect occurrences of 6-inch-minimum movement of any portion of a human body that presents a target of not less than 36 sq. in., and detect a person of average size and weight moving not less than 12 inches in either a horizontal or a vertical manner at an approximate speed of 12 inches/s.

## PART 3 - EXECUTION

### 3.1 SENSOR INSTALLATION

- A. Install and aim sensors in locations to achieve not less than 90 percent coverage of areas indicated. Do not exceed coverage limits specified in manufacturer's written instructions.

### 3.2 WIRING INSTALLATION

- A. Wiring Method: Comply with Division 26 Section "Low-Voltage Electrical Power Conductors and Cables." Minimum conduit size shall be 1/2 inch.
- B. Wiring within Enclosures: Comply with NECA 1. Separate power-limited and nonpower-limited conductors according to conductor manufacturer's written instructions.
- C. Size conductors according to lighting control device manufacturer's written instructions, unless otherwise indicated.
- D. Splices, Taps, and Terminations: Make connections only on numbered terminal strips in junction, pull, and outlet boxes; terminal cabinets; and equipment enclosures.

### 3.3 IDENTIFICATION

- A. Identify components and power and control wiring according to Division 26 Section "Identification for Electrical Systems."
  - 1. Identify circuits or luminaries controlled by photoelectric and occupancy sensors at each sensor.

### 3.4 FIELD QUALITY CONTROL

- A. Perform the following field tests and inspections and prepare test reports:
  - 1. After installing sensors, and after electrical circuitry has been energized, adjust and test for compliance with requirements.
  - 2. Operational Test: Verify operation of each lighting control device, and adjust time delays.
- B. Lighting control devices that fail tests and inspections are defective work.

### 3.5 DEMONSTRATION

- A. Train Owner's maintenance personnel to adjust, operate, and maintain lighting control devices.

END OF SECTION 260923

## SECTION 262416 - PANELBOARDS

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. Section includes distribution panelboards and lighting and appliance branch-circuit panelboards.

#### 1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: For each panelboard and related equipment.
  - 1. Include dimensioned plans, elevations, sections, and details. Show tabulations of installed devices, equipment features, and ratings.
  - 2. Detail enclosure types and details for types other than NEMA 250, Type 1.
  - 3. Detail bus configuration, current, and voltage ratings.
  - 4. Short-circuit current rating of panelboards and overcurrent protective devices.
  - 5. Include evidence of NRTL listing for series rating of installed devices.
  - 6. Detail features, characteristics, ratings, and factory settings of individual overcurrent protective devices and auxiliary components.
  - 7. Include wiring diagrams for power, signal, and control wiring.
- C. Field quality-control reports.
- D. Panelboard schedules for installation in panelboards.
- E. Operation and maintenance data.

#### 1.3 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Comply with NEMA PB 1.
- C. Comply with NFPA 70.

#### 1.4 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace transient voltage suppression devices that fail in materials or workmanship within specified warranty period.
  - 1. Warranty Period: Five years from date of Substantial Completion.

## PART 2 - PRODUCTS

### 2.1 GENERAL REQUIREMENTS FOR PANELBOARDS

- A. Enclosures: Flush- and surface-mounted cabinets.
  - 1. Rated for environmental conditions at installed location.
    - a. Indoor Dry and Clean Locations: NEMA 250, Type 1.
  - 2. Front: Secured to box with concealed trim clamps. For surface-mounted fronts, match box dimensions; for flush-mounted fronts, overlap box.
  - 3. Hinged Front Cover: Entire front trim hinged to box and with standard door within hinged trim cover.
  - 4. Directory Card: Typed schedule depicting "as-built" circuit descriptions, inside panelboard door, mounted in transparent card holder.
- B. Incoming Mains Location: Top or bottom as required by project conditions.
- C. Phase, Neutral, and Ground Buses: Hard-drawn copper, 98 percent conductivity.
- D. Service Equipment Label: NRTL labeled for use as service equipment for panelboards with one or more main service disconnecting and overcurrent protective devices.
- E. Future Devices: Mounting brackets, bus connections, filler plates, and necessary appurtenances required for future installation of devices.
- F. Panelboard Short-Circuit Current Rating: Fully rated to interrupt symmetrical short-circuit current available at terminals.

### 2.2 LIGHTING AND APPLIANCE BRANCH-CIRCUIT PANELBOARDS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. General Electric Company; GE Consumer & Industrial - Electrical Distribution.
  - 2. Eaton Electrical Inc.; Cutler-Hammer Business Unit.
  - 3. Siemens Energy & Automation, Inc.
  - 4. Square D; a brand of Schneider Electric.
  - 5. Pre-approved equal.
- B. Panelboards: NEMA PB 1, lighting and appliance branch-circuit type.
- C. Doors: Concealed hinges; secured with flush latch with tumbler lock; keyed alike.

### 2.3 DISCONNECTING AND OVERCURRENT PROTECTIVE DEVICES

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. General Electric Company; GE Consumer & Industrial - Electrical Distribution.
  - 2. Eaton Electrical Inc.; Cutler-Hammer Business Unit.

3. Siemens Energy & Automation, Inc.
  4. Square D; a brand of Schneider Electric.
  5. Pre-approved equal.
- B. Molded-Case Circuit Breaker (MCCB): Comply with UL 489, with interrupting capacity to meet available fault currents.
1. Thermal-Magnetic Circuit Breakers: Inverse time-current element for low-level overloads, and instantaneous magnetic trip element for short circuits. Adjustable magnetic trip setting for circuit-breaker frame sizes 250 A and larger.
  2. Adjustable Instantaneous-Trip Circuit Breakers: Magnetic trip element with front-mounted, field-adjustable trip setting.
  3. Electronic trip circuit breakers with rms sensing; field-replaceable rating plug or field-replaceable electronic trip; and the following field-adjustable settings:
    - a. Instantaneous trip.
    - b. Long- and short-time pickup levels.
    - c. Long- and short-time time adjustments.
    - d. Ground-fault pickup level, time delay, and  $I^2t$  response.
  4. Current-Limiting Circuit Breakers: Frame sizes 400 A and smaller; let-through ratings less than NEMA FU 1, RK-5.
  5. GFCI Circuit Breakers: Single- and two-pole configurations with Class A ground-fault protection (6-mA trip).
  6. Ground-Fault Equipment Protection (GFEP) Circuit Breakers: Class B ground-fault protection (30-mA trip).

## 2.4 ACCESSORY COMPONENTS AND FEATURES

- A. Portable Test Set: For testing functions of solid-state trip devices without removing from panelboard. Include relay and meter test plugs suitable for testing panelboard meters and switchboard class relays.

## PART 3 - EXECUTION

### 3.1 INSTALLATION

- A. Receive, inspect, handle, store and install panelboards and accessories according to NECA 407.
- B. Mount top of trim 90 inches above finished floor unless otherwise indicated.
- C. Mount panelboard cabinet plumb and rigid without distortion of box. Mount recessed panelboards with fronts uniformly flush with wall finish and mating with back box.
- D. Install overcurrent protective devices and controllers not already factory installed.
  1. Set field-adjustable, circuit-breaker trip ranges.
- E. Install filler plates in unused spaces.

- F. Stub four 1-inch empty conduits from panelboard into accessible ceiling space or space designated to be ceiling space in the future. Stub four 1-inch empty conduits into raised floor space or below slab not on grade.
- G. Arrange conductors in gutters into groups and bundle and wrap with wire ties.
- H. Comply with NECA 1.

### 3.2 IDENTIFICATION

- A. Identify field-installed conductors, interconnecting wiring, and components; provide warning signs complying with Division 26 Section "Identification for Electrical Systems."
- B. Create a directory to indicate installed circuit loads and incorporating Owner's final room designations. Obtain approval before installing. Use a computer or typewriter to create directory; handwritten directories are not acceptable.
- C. Panelboard Nameplates: Label each panelboard with a nameplate complying with requirements for identification specified in Division 26 Section "Identification for Electrical Systems."
- D. Device Nameplates: Label each branch circuit device in distribution panelboards with a nameplate complying with requirements for identification specified in Division 26 Section "Identification for Electrical Systems."

### 3.3 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
- B. Acceptance Testing Preparation:
  - 1. Test insulation resistance for each panelboard bus, component, connecting supply, feeder, and control circuit.
  - 2. Test continuity of each circuit.
- C. Tests and Inspections:
  - 1. Perform each visual and mechanical inspection and electrical test stated in NETA Acceptance Testing Specification. Certify compliance with test parameters.
  - 2. Correct malfunctioning units on-site, where possible, and retest to demonstrate compliance; otherwise, replace with new units and retest.
- D. Panelboards will be considered defective if they do not pass tests and inspections.

END OF SECTION 262416

## SECTION 262726 - WIRING DEVICES

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. This Section includes the following:
  - 1. Receptacles, receptacles with integral GFCI, and associated device plates.
  - 2. Snap switches.
  - 3. Occupancy sensors.
  - 4. Wall plates.

#### 1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: List of legends and description of materials and process used for premarking wall plates.
- C. Operation and Maintenance Data: For wiring devices to include in all manufacturers' packing label warnings and instruction manuals that include labeling conditions.

#### 1.3 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- B. Comply with NFPA 70.

### PART 2 - PRODUCTS

#### 2.1 MANUFACTURERS

- A. Manufacturers' Names: Shortened versions (shown in parentheses) of the following manufacturers' names are used in other Part 2 articles:
  - 1. Cooper Wiring Devices; a division of Cooper Industries, Inc. (Cooper).
  - 2. Hubbell Incorporated; Wiring Device-Kellems (Hubbell).
  - 3. Leviton Mfg. Company Inc. (Leviton).
  - 4. Pass & Seymour/Legrand; Wiring Devices & Accessories (Pass & Seymour).
  - 5. Pre-approved equal.



## 2.2 STRAIGHT BLADE RECEPTACLES

- A. Convenience Receptacles, 125 V, 20 A: Comply with NEMA WD 1, NEMA WD 6 configuration 5-20R, and UL 498.
  - 1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Cooper; 5351 (single), 5352 (duplex).
    - b. Hubbell; HBL5351 (single), CR5352 (duplex).
    - c. Leviton; 5891 (single), 5352 (duplex).
    - d. Pass & Seymour; 5381 (single), 5352 (duplex).
    - e. Pre-approved equal.

## 2.3 GFCI RECEPTACLES

- A. General Description: Straight blade, feed-through type. Comply with NEMA WD 1, NEMA WD 6, UL 498, and UL 943, Class A, and include indicator light that is lighted when device is tripped.
- B. Duplex GFCI Convenience Receptacles, 125 V, 20 A:
  - 1. Products: Subject to compliance with requirements, provide products by one of the following:
    - a. Cooper; GF20.
    - b. Pass & Seymour; 2084.
    - c. Hubbell; GFRST.
    - d. Pre-approved equal.

## 2.4 SNAP SWITCHES

- A. Comply with NEMA WD 1 and UL 20.
- B. Switches, 120/277 V, 20 A:
  - 1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Cooper; 2221 (single pole), 2222 (two pole), 2223 (three way), 2224 (four way).
    - b. Hubbell; CS1221 (single pole), CS1222 (two pole), CS1223 (three way), CS1224 (four way).
    - c. Leviton; 1221-2 (single pole), 1222-2 (two pole), 1223-2 (three way), 1224-2 (four way).
    - d. Pass & Seymour; 20AC1 (single pole), 20AC2 (two pole), 20AC3 (three way), 20AC4 (four way).
    - e. Pre-approved equal.

## 2.5 OCCUPANCY SENSORS

- A. Provide occupancy sensors as noted on Drawings. Provide all power packs and accessories for a complete and operable lighting control system as required to support sensors and control devices indicated on Drawings.

## 2.6 WALL PLATES

- A. Single and combination types to match corresponding wiring devices.
  - 1. Plate-Securing Screws: Metal with head color to match plate finish.
  - 2. Material for Finished Spaces: Stainless steel.
  - 3. Material for Unfinished Spaces: Galvanized steel.
  - 4. Material for Damp Locations: Cast aluminum with spring-loaded lift cover, and listed and labeled for use in "wet locations."
- B. Wet-Location, Weatherproof Cover Plates: NEMA 250, complying with type 3R weather-resistant, die-cast aluminum with lockable cover.

## 2.7 FINISHES

- A. Color: Wiring device catalog numbers in Section Text do not designate device color.
  - 1. Wiring Devices Connected to Normal Power System: Grey, unless otherwise indicated or required by NFPA 70 or device listing.

## PART 3 - EXECUTION

### 3.1 INSTALLATION

- A. Comply with NECA 1, including the mounting heights listed in that standard, unless otherwise noted.
- B. Coordination with Other Trades:
  - 1. Take steps to insure that devices and their boxes are protected. Do not place wall finish materials over device boxes and do not cut holes for boxes with routers that are guided by riding against outside of the boxes.
  - 2. Keep outlet boxes free of plaster, drywall joint compound, mortar, cement, concrete, dust, paint, and other material that may contaminate the raceway system, conductors, and cables.
  - 3. Install device boxes in brick or block walls so that the cover plate does not cross a joint unless the joint is troweled flush with the face of the wall.
  - 4. Install wiring devices after all wall preparation, including painting, is complete.
- C. Conductors:
  - 1. Do not strip insulation from conductors until just before they are spliced or terminated on devices.
  - 2. Strip insulation evenly around the conductor using tools designed for the purpose. Avoid scoring or nicking of solid wire or cutting strands from stranded wire.
  - 3. The length of free conductors at outlets for devices shall meet provisions of NFPA 70, Article 300, without pigtails.
  - 4. Existing Conductors:
    - a. Cut back and pigtail, or replace all damaged conductors.
    - b. Straighten conductors that remain and remove corrosion and foreign matter.

c. Pigtailing existing conductors is permitted provided the outlet box is large enough.

D. Device Installation:

1. Replace all devices that have been in temporary use during construction or that show signs that they were installed before building finishing operations were complete.
2. Keep each wiring device in its package or otherwise protected until it is time to connect conductors.
3. Do not remove surface protection, such as plastic film and smudge covers, until the last possible moment.
4. Connect devices to branch circuits using pigtails that are not less than 6 inches in length.
5. When there is a choice, use side wiring with binding-head screw terminals. Wrap solid conductor tightly clockwise, 2/3 to 3/4 of the way around terminal screw.
6. Use a torque screwdriver when a torque is recommended or required by the manufacturer.
7. When conductors larger than No. 12 AWG are installed on 15- or 20-A circuits, splice No. 12 AWG pigtails for device connections.
8. Tighten unused terminal screws on the device.
9. When mounting into metal boxes, remove the fiber or plastic washers used to hold device mounting screws in yokes, allowing metal-to-metal contact.

E. Receptacle Orientation:

1. Install ground pin of vertically mounted receptacles down, and on horizontally mounted receptacles to the left.

F. Device Plates: Do not use oversized or extra-deep plates. Repair wall finishes and remount outlet boxes when standard device plates do not fit flush or do not cover rough wall opening.

G. Arrangement of Devices: Unless otherwise indicated, mount flush, with long dimension vertical and with grounding terminal of receptacles on top. Group adjacent switches under single, multi-gang wall plates.

END OF SECTION 262726

## SECTION 263600 - TRANSFER SWITCHES

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. This Section includes manual transfer switches rated 600 V and less.

#### 1.2 SUBMITTALS

- A. Product Data: Include rated capacities, weights, operating characteristics, furnished specialties, and accessories.
- B. Shop Drawings: Dimensioned plans, elevations, sections, and details showing minimum clearances, conductor entry provisions, gutter space, installed features and devices, and material lists for each switch specified.
- C. Field quality-control test reports.
- D. Operation and maintenance data.

#### 1.3 WARRANTY

- A. Manufacturer's Warranty: Manufacturer agrees to repair or replace components of transfer switch or transfer switch components that fail in materials or workmanship within specified warranty period.
- B. Warranty Period: 12 months from date of Substantial Completion.

#### 1.4 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- B. Comply with NEMA ICS 1.
- C. Comply with NFPA 70.
- D. Comply with NFPA 110.
- E. Comply with UL 891.
- F. Comply with UL 1008 unless requirements of these Specifications are stricter.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide ASCO transfer switch as indicated on the plans, or equal.
  - 1. Transfer Switches:
    - a. Eaton
    - b. Kohler Power Systems; Generator Division.
    - c. Onan/Cummins Power Generation; Industrial Business Group.
    - d. Russelectric, Inc.
    - e. Pre-approved equal.

### 2.2 GENERAL TRANSFER-SWITCH PRODUCT REQUIREMENTS

- A. Indicated Current Ratings: Apply as defined in UL 1008 for continuous loading and total system transfer, including tungsten filament lamp loads not exceeding 30 percent of switch ampere rating, unless otherwise indicated.
- B. Tested Fault-Current Closing and Withstand Ratings: Adequate for duty imposed by protective devices at installation locations in Project under the fault conditions indicated, based on testing according to UL 1008.
  - 1. Where transfer switch includes internal fault-current protection, rating of switch and trip unit combination shall exceed indicated fault-current value at installation location.
- C. Solid-State Controls: Repetitive accuracy of all settings shall be plus or minus 2 percent or better over an operating temperature range of minus 20 to plus 70 deg C.
- D. Resistance to Damage by Voltage Transients: Components shall meet or exceed voltage-surge withstand capability requirements when tested according to IEEE C62.41. Components shall meet or exceed voltage-impulse withstand test of NEMA ICS 1.
- E. Electrical Operation: Accomplish by a nonfused, momentarily energized solenoid or electric-motor-operated mechanism, mechanically and electrically interlocked in both directions.
- F. Switch Characteristics: Designed for continuous-duty repetitive transfer of full-rated current between active power sources.
  - 1. Limitation: Switches using molded-case switches or circuit breakers or insulated-case circuit-breaker components are not acceptable.
  - 2. Switch Action: Double throw; mechanically held in both directions.
  - 3. Contacts: Silver composition or silver alloy for load-current switching. Conventional automatic transfer-switch units, rated 225 A and higher, shall have separate arcing contacts.
- G. Neutral Terminal: Fully rated switched neutral, unless otherwise indicated.
- H. Enclosures: General-purpose NEMA 250, Type 3R, complying with NEMA ICS 6 and UL 508, unless otherwise indicated.

## 2.3 MANUAL TRANSFER SWITCHES

- A. Manual and Electrically Operated: Electrically actuated by push buttons designated "Normal Source" and "Alternative Source." Manual handle provides quick-make, quick-break manual-switching action. Switch shall be capable of electrically or manually transferring load in either direction with either or both sources energized. Control circuit disconnects from electrical operator during manual operation.
- B. Double-Throw Switching Arrangement: Incapable of pauses or intermediate position stops during switching sequence.
- C. Pilot Lights: Indicate source to which load is connected.
- D. Source-Available Indicating Lights: Supervise sources via transfer-switch normal- and alternative-source sensing circuits.
  - 1. Normal Power Supervision: Green light with nameplate engraved "Normal Source Available."
  - 2. Emergency Power Supervision: Red light with nameplate engraved "Alternative Source Available."
- E. Unassigned Auxiliary Contacts: Switch shall have one set of normally closed contacts for each switch position, rated 10 A at 240-V ac.
- F. Switch Characteristics: Designed for continuous-duty repetitive transfer of full-rated current between active power sources.
  - 1. Switch Action: Double throw; mechanically held in both directions.
  - 2. Contacts: Silver composition or silver alloy for load-current switching.
  - 3. Conductor Connectors: Suitable for use with conductor material and sizes.
  - 4. Material: Hard-drawn copper, 98 percent conductivity.
- G. Integrated Quick Connections: Quick connect panel for reliable connection of alternate power to transfer switch.
  - 1. Standard Cam-Lock receptacles for connection.
  - 2. Lockable doors.

## 2.4 SOURCE QUALITY CONTROL

- A. Factory test and inspect components, assembled switches, and associated equipment. Ensure proper operation. Check transfer time and voltage, frequency, and time-delay settings for compliance with specified requirements. Perform dielectric strength test complying with NEMA ICS 1.

## PART 3 - EXECUTION

### 3.1 INSTALLATION

- A. Identify components according to Division 26 Section "Identification for Electrical Systems."
- B. Set field-adjustable intervals and delays, relays, and engine exerciser clock.

### 3.2 CONNECTIONS

- A. Ground equipment according to Division 26 Section "Grounding and Bonding for Electrical Systems."
- B. Connect wiring according to Division 26 Section "Low-Voltage Electrical Power Conductors and Cables."

### 3.3 FIELD QUALITY CONTROL

- A. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect, test, and adjust components, assemblies, and equipment installations, including connections. Report results in writing.
- B. Perform tests and inspections and prepare test reports.
  - 1. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect components, assemblies, and equipment installation, including connections, and to assist in testing.
  - 2. After installing equipment and after electrical circuitry has been energized, test for compliance with requirements.
  - 3. Perform each visual and mechanical inspection and electrical test stated in NETA Acceptance Testing Specification. Certify compliance with test parameters.
  - 4. Measure insulation resistance phase-to-phase and phase-to-ground with insulation-resistance tester. Use test voltages and procedure recommended by manufacturer. Comply with manufacturer's specified minimum resistance.
    - a. Check for electrical continuity of circuits and for short circuits.
    - b. Inspect for physical damage, proper installation and connection, and integrity of barriers, covers, and safety features.
    - c. Verify that manual transfer warnings are properly placed.
    - d. Perform manual transfer operation.
  - 5. After energizing circuits, demonstrate interlocking sequence and operational function for each switch at least three times.
    - a. Simulate power failures of normal source to automatic transfer switches and of emergency source with normal source available.
    - b. Simulate loss of phase-to-ground voltage for each phase of normal source.
    - c. Verify time-delay settings.
    - d. Verify pickup and dropout voltages by data readout or inspection of control settings.
    - e. Verify proper sequence and correct timing of automatic engine starting, transfer time delay, retransfer time delay on restoration of normal power, and engine cool-down and shutdown.
  - 6. Ground-Fault Tests: Coordinate with testing of ground-fault protective devices for power delivery from both sources.
    - a. Verify grounding connections and locations and ratings of sensors.
- C. Coordinate tests with tests of generator and run them concurrently.

- D. Report results of tests and inspections in writing. Record adjustable relay settings and measured insulation and contact resistances and time delays. Attach a label or tag to each tested component indicating satisfactory completion of tests.
- E. Remove and replace malfunctioning units and retest as specified above.

#### 3.4 DEMONSTRATION

- A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, and maintain transfer switches and related equipment as specified below. Refer to Division 01 Section "Demonstration and Training."
- B. Coordinate this training with that for generator equipment.

END OF SECTION 263600



## SECTION 265119 - LED INTERIOR LIGHTING

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Interior solid-state luminaires that use LED technology.
  - 2. Lighting fixture supports.

#### 1.3 DEFINITIONS

- A. CCT: Correlated color temperature.
- B. CRI: Color Rendering Index.
- C. Fixture: See "Luminaire."
- D. IP: International Protection or Ingress Protection Rating.
- E. LED: Light-emitting diode.
- F. Lumen: Measured output of lamp and luminaire, or both.
- G. Luminaire: Complete lighting unit, including lamp, reflector, and housing.

#### 1.4 SUBMITTALS

- A. Product Data: For each type of product.
  - 1. Arrange in order of luminaire designation.
  - 2. Include data on features, accessories, and finishes.
  - 3. Include physical description and dimensions of luminaires.
  - 4. Include emergency lighting units, including batteries and chargers.
  - 5. Include life, output (lumens, CCT, and CRI), and energy efficiency data.
  - 6. Photometric data and adjustment factors based on laboratory tests, complying with IESNA Lighting Measurements Testing and Calculation Guides, of each lighting fixture type. The adjustment factors shall be for lamps and accessories identical to those indicated for the lighting fixture as applied in this Project, IES LM-79, and IES LM-80.
    - a. Manufacturers' Certified Data: Photometric data certified by manufacturer's laboratory with a current accreditation under the National Voluntary Laboratory Accreditation Program for Energy Efficient Lighting Products.

- B. Shop Drawings: For nonstandard or custom luminaires.
  - 1. Include plans, elevations, sections, and mounting and attachment details.
  - 2. Include details of luminaire assemblies. Indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
  - 3. Include diagrams for power, signal, and control wiring.
- C. Product Schedule: For luminaires and lamps. Use same designations indicated on Drawings.
- D. Product Certificates: For each type of luminaire.
- E. Sample warranty.

## 1.5 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For luminaires and lighting systems to include in operation and maintenance manuals.
  - 1. Provide a list of all lamp types used on Project; use ANSI and manufacturers' codes.

## 1.6 QUALITY ASSURANCE

- A. Luminaire Photometric Data Testing Laboratory Qualifications: Luminaire manufacturer's laboratory that is accredited under the NVLAP for Energy Efficient Lighting Products.
- B. Each luminaire type shall be binned within a three-step MacAdam Ellipse to ensure color consistency among luminaires.

## 1.7 WARRANTY

- A. Warranty: Manufacturer and Installer agree to repair or replace components of luminaires that fail in materials or workmanship within specified warranty period.
- B. Warranty Period: Five year(s) from date of Substantial Completion.

## PART 2 - PRODUCTS

### 2.1 LUMINAIRE REQUIREMENTS

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Recessed Fixtures: Comply with NEMA LE 4.
- C. CRI of 80 (minimum). CCT of 3500 K unless otherwise indicated.
- D. LEDs shall have a minimum L70 at 50,000 hours based on TM-21 Addendum-A lifetime report data.

- E. Internal driver or as listed in fixture schedule.
- F. Batteries in fixtures designated for emergency lighting must be compatible with the emergency unit used with minimum leakage.

## 2.2 MATERIALS

### A. Metal Parts:

- 1. Free of burrs and sharp corners and edges.
- 2. Sheet metal components shall be steel unless otherwise indicated.
- 3. Form and support to prevent warping and sagging.

### B. Doors, Frames, and Other Internal Access: Smooth operating, free of light leakage under operating conditions, and designed to permit LED or driver access without use of tools. Designed to prevent doors, frames, lenses, diffusers, and other components from falling accidentally during maintenance and when secured in operating position.

### C. Diffusers and Globes:

- 1. Acrylic Diffusers: One hundred percent virgin acrylic plastic, with high resistance to yellowing and other changes due to aging, exposure to heat, and UV radiation.
- 2. Glass: Annealed crystal glass unless otherwise indicated.
- 3. Lens Thickness: At least 0.125 inch minimum unless otherwise indicated.

### D. Factory-Applied Labels: Comply with UL 1598. Include recommended lamps. Locate labels where they will be readily visible to service personnel, but not seen from normal viewing angles when lamps are in place.

- 1. Label shall include the following lamp characteristics:
  - a. "USE ONLY" and include specific lamp type.
  - b. Lamp diameter, shape, size, wattage, and coating.
  - c. CCT and CRI for all luminaires.

## 2.3 METAL FINISHES

### A. Variations in finishes are unacceptable in the same piece. Variations in finishes of adjoining components are acceptable if they are within the range of approved Samples and if they can be and are assembled or installed to minimize contrast.

## 2.4 LUMINAIRE FIXTURE SUPPORT COMPONENTS

- A. Comply with requirements in Section 260529 "Hangers and Supports for Electrical Systems" for channel and angle iron supports and nonmetallic channel and angle supports.
- B. Single-Stem Hangers: 1/2-inch steel tubing with swivel ball fittings and ceiling canopy. Finish same as luminaire.
- C. Wires: ASTM A 641/A 641 M, Class 3, soft temper, zinc-coated steel, 12 gage.
- D. Rod Hangers: 3/16-inch minimum diameter, cadmium-plated, threaded steel rod.

- E. Hook Hangers: Integrated assembly matched to luminaire, line voltage, and equipment with threaded attachment, cord, and locking-type plug.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of the Work.
- B. Examine roughing-in for luminaire to verify actual locations of luminaire and electrical connections before fixture installation. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 INSTALLATION

- A. Comply with NECA 1.
- B. Remote Mounting of drivers: Distance between the driver and luminaire shall not exceed that recommended by the fixture manufacturer. Verify, with manufacturer, maximum distance between driver and luminaire.
- C. Install luminaires level, plumb, and square with ceilings and walls unless otherwise indicated.
- D. Coordinate layout and installation of luminaires and suspension system with other construction that penetrates ceilings or is supported by them.
- E. Supports:
  - 1. Sized and rated for luminaire weight.
  - 2. Able to maintain luminaire position after cleaning and servicing.
  - 3. Provide support for luminaire without causing deflection of ceiling or wall.
  - 4. Luminaire mounting devices shall be capable of supporting a horizontal force of 100 percent of luminaire weight and vertical force of 400 percent of luminaire weight.
- F. Ceiling-Grid-Mounted Luminaire Supports: Use grid as a support element.
  - 1. Install ceiling support system rods or wires, independent of the ceiling suspension devices, for each luminaire. Locate not more than 6 inches from luminaire corners.
  - 2. Support Clips: Fasten to luminaires and to ceiling grid members at or near each luminaire corner with clips that are UL listed for the application.
  - 3. Luminaires of Sizes Less Than Ceiling Grid: Install as indicated on reflected ceiling plans or center in acoustical panel, and support luminaires independently with at least two 3/4-inch metal channels spanning and secured to ceiling tees.
  - 4. Install at least one independent support rod or wire from structure to a tab on luminaire. Wire or rod shall have breaking strength of the luminaire weight at a safety factor of 3.
- G. Flush-Mounted Luminaire Support:
  - 1. Secured to outlet box.

2. Attached to ceiling structural members at four points equally spaced around circumference of luminaire.
  3. Trim ring flush with finished surface.
- H. Wall-Mounted Luminaire Support:
1. Attached to structural members in walls.
  2. Do not attach luminaires directly to gypsum board.
- I. Suspended Luminaire Support:
1. Pendants and Rods: Where longer than 48 inches, brace to limit swinging.
  2. Stem-Mounted, Single-Unit Luminaires: Suspend with twin-stem hangers. Support with approved outlet box and accessories that hold stem and provide damping of luminaire oscillations. Support outlet box vertically to building structure using approved devices.
  3. Continuous Rows of Luminaires: Use tubing or stem for wiring at one point and wire support for suspension for each unit length of luminaire chassis, including one at each end.
  4. Do not use ceiling grid as support for pendant luminaires. Connect support wires or rods to building structure.
- J. Comply with requirements in Section 260519 "Low-Voltage Electrical Power Conductors and Cables" and Section 260533 "Raceways and Boxes for Electrical Systems" for wiring connections and wiring methods.

### 3.3 IDENTIFICATION

- A. Identify system components, wiring, cabling, and terminals. Comply with requirements for identification specified in Section 260553 "Identification for Electrical Systems."

### 3.4 FIELD QUALITY CONTROL

- A. Perform the following tests and inspections:
1. Operational Test: After installing luminaires, switches, and accessories, and after electrical circuitry has been energized, test units to confirm proper operation.
  2. Test for Emergency Lighting: Interrupt power supply to demonstrate proper operation. Verify transfer from normal power to battery power and retransfer to normal.
- B. Luminaire will be considered defective if it does not pass operation tests and inspections.

### 3.5 ADJUSTING

- A. Occupancy Adjustments: Provide on-site assistance in adjusting the direction of aim of luminaires to suit occupied conditions. Some of this work may be required during hours of darkness.
1. Adjust the aim of luminaires in the presence of the Architect.

END OF SECTION 265119

## SECTION 265619 - LED EXTERIOR LIGHTING

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Exterior solid-state luminaires that use LED technology.
  - 2. Lighting fixture supports.

#### 1.3 DEFINITIONS

- A. CCT: Correlated color temperature.
- B. CRI: Color Rendering Index.
- C. Fixture: See "Luminaire."
- D. IP: International Protection or Ingress Protection Rating.
- E. LED: Light-emitting diode.
- F. Lumen: Measured output of lamp and luminaire, or both.
- G. Luminaire: Complete lighting unit, including lamp, reflector, and housing.

#### 1.4 SUBMITTALS

- A. Product Data: For each type of product.
  - 1. Arrange in order of luminaire designation.
  - 2. Include data on features, accessories, and finishes.
  - 3. Include physical description and dimensions of luminaires.
  - 4. Include emergency lighting units, including batteries and chargers.
  - 5. Include life, output (lumens, CCT, and CRI), and energy efficiency data.
  - 6. Photometric data and adjustment factors based on laboratory tests, complying with IESNA Lighting Measurements Testing and Calculation Guides, of each lighting fixture type. The adjustment factors shall be for lamps and accessories identical to those indicated for the lighting fixture as applied in this Project, IES LM-79, and IES LM-80.
    - a. Manufacturers' Certified Data: Photometric data certified by manufacturer's laboratory with a current accreditation under the National Voluntary Laboratory Accreditation Program for Energy Efficient Lighting Products.

- B. Shop Drawings: For nonstandard or custom luminaires.
  - 1. Include plans, elevations, sections, and mounting and attachment details.
  - 2. Include details of luminaire assemblies. Indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
  - 3. Include diagrams for power, signal, and control wiring.
- C. Product Schedule: For luminaires and lamps. Use same designations indicated on Drawings.
- D. Product Certificates: For each type of luminaire.
- E. Sample warranty.

## 1.5 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For luminaires and lighting systems to include in operation and maintenance manuals.
  - 1. Provide a list of all lamp types used on Project; use ANSI and manufacturers' codes.

## 1.6 QUALITY ASSURANCE

- A. Luminaire Photometric Data Testing Laboratory Qualifications: Luminaire manufacturer's laboratory that is accredited under the NVLAP for Energy Efficient Lighting Products.
- B. Each luminaire type shall be binned within a three-step MacAdam Ellipse to ensure color consistency among luminaires.

## 1.7 WARRANTY

- A. Warranty: Manufacturer and Installer agree to repair or replace components of luminaires that fail in materials or workmanship within specified warranty period.
- B. Warranty Period: Five year(s) from date of Substantial Completion.

## PART 2 - PRODUCTS

### 2.1 LUMINAIRE REQUIREMENTS

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Recessed Fixtures: Comply with NEMA LE 4.
- C. CRI of 80 (minimum). CCT of 2700 K unless otherwise indicated.
- D. LEDs shall have a minimum L70 at 50,000 hours based on TM-21 Addendum-A lifetime report data.

- E. Internal driver or as listed in fixture schedule.
- F. Batteries in fixtures designated for emergency lighting must be compatible with the emergency unit used with minimum leakage.

## 2.2 DIMMING REQUIREMENTS

- A. LEDs dimmable from 100 percent to 5 percent of maximum light output, unless noted otherwise in the light fixture schedule.
- B. All LED dimming shall be smooth and free of flickering. Contractor shall coordinate between dimmer manufacturers, light fixture manufacturers, driver manufacturers, and lamp manufacturers as required in order to install a completely flicker free dimming system.

## 2.3 MATERIALS

- A. Metal Parts:
  - 1. Free of burrs and sharp corners and edges.
  - 2. Sheet metal components shall be steel unless otherwise indicated.
  - 3. Form and support to prevent warping and sagging.
- B. Doors, Frames, and Other Internal Access: Smooth operating, free of light leakage under operating conditions, and designed to permit LED or driver access without use of tools. Designed to prevent doors, frames, lenses, diffusers, and other components from falling accidentally during maintenance and when secured in operating position.
- C. Diffusers and Globes:
  - 1. Acrylic Diffusers: One hundred percent virgin acrylic plastic, with high resistance to yellowing and other changes due to aging, exposure to heat, and UV radiation.
  - 2. Glass: Annealed crystal glass unless otherwise indicated.
  - 3. Lens Thickness: At least 0.125 inch minimum unless otherwise indicated.
- D. Lens and Refractor Gaskets: Use heat- and aging-resistant resilient gaskets to seal and cushion lenses and refractors in luminaire doors.
- E. Housings:
  - 1. Rigidly formed, weather- and light-tight enclosure that will not warp, sag, or deform in use.
  - 2. Provide filter/breather for enclosed luminaires.
- F. Factory-Applied Labels: Comply with UL 1598. Include recommended lamps. Locate labels where they will be readily visible to service personnel, but not seen from normal viewing angles when lamps are in place.
  - 1. Label shall include the following lamp characteristics:
    - a. "USE ONLY" and include specific lamp type.
    - b. Lamp diameter, shape, size, wattage, and coating.
    - c. CCT and CRI for all luminaires.



## 2.4 METAL FINISHES

- A. Variations in finishes are unacceptable in the same piece. Variations in finishes of adjoining components are acceptable if they are within the range of approved Samples and if they can be and are assembled or installed to minimize contrast.

## 2.5 LUMINAIRE FIXTURE SUPPORT COMPONENTS

- A. Comply with requirements in Section 260529 "Hangers and Supports for Electrical Systems" for channel and angle iron supports and nonmetallic channel and angle supports.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of the Work.
- B. Examine roughing-in for luminaire to verify actual locations of luminaire and electrical connections before fixture installation. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 INSTALLATION

- A. Comply with NECA 1.
- B. Remote Mounting of drivers: Distance between the driver and luminaire shall not exceed that recommended by the fixture manufacturer. Verify, with manufacturer, maximum distance between driver and luminaire.
- C. Install luminaires level, plumb, and square with ceilings and walls unless otherwise indicated.
- D. Coordinate layout and installation of luminaires and suspension system with other construction that penetrates ceilings or is supported by them.
- E. Supports:
  - 1. Sized and rated for luminaire weight.
  - 2. Able to maintain luminaire position after cleaning and relamping.
  - 3. Provide support for luminaire without causing deflection of ceiling or wall.
  - 4. Luminaire mounting devices shall be capable of supporting a horizontal force of 100 percent of luminaire weight and vertical force of 400 percent of luminaire weight.
- F. Flush-Mounted Luminaire Support:
  - 1. Secured to outlet box.
  - 2. Attached to ceiling structural members at four points equally spaced around circumference of luminaire.
  - 3. Trim ring flush with finished surface.
- G. Wall-Mounted Luminaire Support:

1. Attached to structural members in walls.
2. Do not attach luminaires directly to gypsum board.

H. Suspended Luminaire Support:

1. Pendants and Rods: Where longer than 48 inches, brace to limit swinging.
2. Stem-Mounted, Single-Unit Luminaires: Suspend with twin-stem hangers. Support with approved outlet box and accessories that hold stem and provide damping of luminaire oscillations. Support outlet box vertically to building structure using approved devices.
3. Continuous Rows of Luminaires: Use tubing or stem for wiring at one point and wire support for suspension for each unit length of luminaire chassis, including one at each end.

- i. Comply with requirements in Section 260519 "Low-Voltage Electrical Power Conductors and Cables" and Section 260533 "Raceways and Boxes for Electrical Systems" for wiring connections and wiring methods.

### 3.3 IDENTIFICATION

- A. Identify system components, wiring, cabling, and terminals. Comply with requirements for identification specified in Section 260553 "Identification for Electrical Systems."

### 3.4 FIELD QUALITY CONTROL

- A. Perform the following tests and inspections:

1. Operational Test: After installing luminaires, switches, and accessories, and after electrical circuitry has been energized, test units to confirm proper operation.
2. Test for Emergency Lighting: Interrupt power supply to demonstrate proper operation. Verify transfer from normal power to battery power and retransfer to normal.

- B. Luminaire will be considered defective if it does not pass operation tests and inspections.

### 3.5 ADJUSTING

- A. Occupancy Adjustments: Provide on-site assistance in adjusting the direction of aim of luminaires to suit occupied conditions. Some of this work may be required during hours of darkness.

1. Adjust the aim of luminaires in the presence of the Architect.

END OF SECTION 265619

## SECTION 280500 - COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY

### PART 1 - GENERAL

#### 1.1 SUMMARY

##### A. Section Includes:

1. Sleeves for raceways and cables.
2. Sleeve seals.
3. Grout.
4. Common electronic safety and security installation requirements.

#### 1.2 SUBMITTALS

##### A. Product Data: For sleeve seals.

### PART 2 - PRODUCTS

#### 2.1 SLEEVES FOR RACEWAYS AND CABLES

- A. Steel Pipe Sleeves: ASTM A 53/A 53M, Type E, Grade B, Schedule 40, galvanized steel, plain ends.
- B. Cast-Iron Pipe Sleeves: Cast or fabricated "wall pipe," equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop, unless otherwise indicated.
- C. Sleeves for Rectangular Openings: Galvanized sheet steel.
  1. Minimum Metal Thickness:
    - a. For sleeve cross-section rectangle perimeter less than 50 inches and no side more than 16 inches, thickness shall be 0.052 inch.
    - b. For sleeve cross-section rectangle perimeter equal to, or more than, 50 inches and 1 or more sides equal to, or more than, 16 inches, thickness shall be 0.138 inch.

#### 2.2 SLEEVE SEALS

- A. Description: Modular sealing device, designed for field assembly, to fill annular space between sleeve and raceway or cable.
  1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Advance Products & Systems, Inc.
    - b. Calpico, Inc.
    - c. Metraflex Co.
    - d. Pipeline Seal and Insulator, Inc.

## 2.3 GROUT

- A. Nonmetallic, Shrinkage-Resistant Grout: ASTM C 1107, factory-packaged, nonmetallic aggregate grout, noncorrosive, nonstaining, mixed with water to consistency suitable for application and a 30-minute working time.

## PART 3 - EXECUTION

### 3.1 COMMON REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY INSTALLATION

- A. Comply with NECA 1.
- B. Measure indicated mounting heights to bottom of unit for suspended items and to center of unit for wall-mounting items.
- C. Headroom Maintenance: If mounting heights or other location criteria are not indicated, arrange and install components and equipment to provide maximum possible headroom consistent with these requirements.
- D. Equipment: Install to facilitate service, maintenance, and repair or replacement of components of both electronic safety and security equipment and other nearby installations. Connect in such a way as to facilitate future disconnecting with minimum interference with other items in the vicinity.
- E. Right of Way: Give to piping systems installed at a required slope.

### 3.2 SLEEVE INSTALLATION FOR ELECTRONIC SAFETY AND SECURITY PENETRATIONS

- A. Electronic safety and security penetrations occur when raceways, pathways, cables, wireways, or cable trays penetrate concrete slabs, concrete or masonry walls, or fire-rated floor and wall assemblies.
- B. Concrete Slabs and Walls: Install sleeves for penetrations unless core-drilled holes or formed openings are used. Install sleeves during erection of slabs and walls.
- C. Use pipe sleeves unless penetration arrangement requires rectangular sleeved opening.
- D. Fire-Rated Assemblies: Install sleeves for penetrations of fire-rated floor and wall assemblies unless openings compatible with firestop system used are fabricated during construction of floor or wall.
- E. Cut sleeves to length for mounting flush with both surfaces of walls.
- F. Extend sleeves installed in floors 2 inches above finished floor level.
- G. Size pipe sleeves to provide 1/4-inch annular clear space between sleeve and raceway or cable, unless indicated otherwise.
- H. Seal space outside of sleeves with grout for penetrations of concrete and masonry

1. Promptly pack grout solidly between sleeve and wall so no voids remain. Tool exposed surfaces smooth; protect grout while curing.
- I. Interior Penetrations of Non-Fire-Rated Walls and Floors: Seal annular space between sleeve and raceway or cable, using joint sealant appropriate for size, depth, and location of joint. Comply with requirements in Division 07 Section "Joint Sealants."
- J. Fire-Rated-Assembly Penetrations: Maintain indicated fire rating of walls, partitions, ceilings, and floors at raceway and cable penetrations. Install sleeves and seal raceway and cable penetration sleeves with firestop materials. Comply with requirements in Division 07 Section "Penetration Firestopping."
- K. Roof-Penetration Sleeves: Seal penetration of individual raceways and cables with flexible boot-type flashing units applied in coordination with roofing work.
- L. Aboveground, Exterior-Wall Penetrations: Seal penetrations using steel pipe sleeves and mechanical sleeve seals. Select sleeve size to allow for 1-inch annular clear space between pipe and sleeve for installing mechanical sleeve seals.
- M. Underground, Exterior-Wall Penetrations: Install cast-iron pipe sleeves. Size sleeves to allow for 1-inch annular clear space between raceway or cable and sleeve for installing mechanical sleeve seals.

### 3.3 SLEEVE-SEAL INSTALLATION

- A. Install to seal exterior wall penetrations.
- B. Use type and number of sealing elements recommended by manufacturer for raceway or cable material and size. Position raceway or cable in center of sleeve. Assemble mechanical sleeve seals and install in annular space between raceway or cable and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.

### 3.4 FIRESTOPPING

- A. Apply firestopping to penetrations of fire-rated floor and wall assemblies for electronic safety and security installations to restore original fire-resistance rating of assembly. Firestopping materials and installation requirements are specified in Division 07 Section "Penetration Firestopping."

END OF SECTION 280500

## SECTION 280513 - CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. Section Includes:
  - 1. Fire alarm wire and cable.
  - 2. Identification products.

#### 1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Qualification Data: For qualified layout technician, installation supervisor, and field inspector.
- C. Source quality-control reports.
- D. Field quality-control reports.
- E. Maintenance data.

#### 1.3 QUALITY ASSURANCE

- A. Surface-Burning Characteristics: As determined by testing identical products according to ASTM E 84 by a qualified testing agency. Identify products with appropriate markings of applicable testing agency.
  - 1. Flame-Spread Index: 25 or less.
  - 2. Smoke-Developed Index: 50 or less.
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

### PART 2 - PRODUCTS

#### 2.1 PATHWAYS

- A. Support of Open Cabling: NRTL labeled for support of cabling, designed to prevent degradation of cable performance and pinch points that could damage cable.
  - 1. Support brackets with cable tie slots for fastening cable ties to brackets.
  - 2. Lacing bars, spools, J-hooks, and D-rings.
  - 3. Straps and other devices.
- B. Conduit and Boxes: Comply with requirements in Division 26 Section "Raceway and Boxes for Electrical Systems."

1. Outlet boxes shall be no smaller than 2 inches wide, 3 inches high, and 2-1/2 inches deep.

## 2.2 FIRE ALARM WIRE AND CABLE

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  1. Comtran Corp.
  2. Draka USA.
  3. Genesis Cable Products; Honeywell International, Inc.
  4. Rockbestos-Suprenant Cable Corporation.
  5. West Penn Wire/CDT; a division of Cable Design Technologies.
- B. General Wire and Cable Requirements: NRTL listed and labeled as complying with NFPA 70, Article 760.
- C. Signaling Line Circuits: Twisted, shielded pair, size as recommended by system manufacturer.
  1. Circuit Integrity Cable: Twisted shielded pair, NFPA 70, Article 760, Classification CI, for power-limited fire alarm signal service Type FPL. NRTL listed and labeled as complying with UL 1424 and UL 2196 for a 2-hour rating.
- D. Non-Power-Limited Circuits: Solid-copper conductors with 600-V rated, 75 deg C, color-coded insulation.
  1. Low-Voltage Circuits: No. 16 AWG, minimum.
  2. Line-Voltage Circuits: No. 12 AWG, minimum.
  3. Multiconductor Armored Cable: NFPA 70, Type MC, copper conductors, Type TFN/THHN conductor insulation, copper drain wire, copper armor with outer jacket with red identifier stripe, NRTL listed for fire alarm and cable tray installation, plenum rated, and complying with requirements in UL 2196 for a 2-hour rating.

## 2.3 IDENTIFICATION PRODUCTS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  1. Brady Corporation
  2. HellermannTyton.
  3. Kroy LLC.
  4. Panduit Corp.
- B. Comply with UL 969 for a system of labeling materials, including label stocks, laminating adhesives, and inks used by label printers.
- C. Comply with requirements in Division 26 Section "Identification for Electrical Systems."

## 2.4 SOURCE QUALITY CONTROL

- A. Testing Agency: Engage a qualified testing agency to evaluate cables.

- B. Factory sweep test coaxial cables at frequencies from 5 MHz to 1 GHz. Sweep test shall test the frequency response, or attenuation over frequency, of a cable by generating a voltage whose frequency is varied through the specified frequency range and graphing the results.
- C. Cable will be considered defective if it does not pass tests and inspections.
- D. Prepare test and inspection reports.

## PART 3 - EXECUTION

### 3.1 INSTALLATION OF PATHWAYS

- A. Cable Trays: Comply with NEMA VE 2 and TIA/EIA-569-A-7.
- B. Comply with TIA/EIA-569-A for pull-box sizing and length of conduit and number of bends between pull points.
- C. Comply with requirements in Division 26 Section "Raceway and Boxes for Electrical Systems." for installation of conduits and wireways.
- D. Install manufactured conduit sweeps and long-radius elbows whenever possible.
- E. Pathway Installation in Equipment Rooms:
  - 1. Position conduit ends adjacent to a corner on backboard where a single piece of plywood is installed or in the corner of room where multiple sheets of plywood are installed around perimeter walls of room.
  - 2. Install cable trays to route cables if conduits cannot be located in these positions.
  - 3. Secure conduits to backboard when entering room from overhead.
  - 4. Extend conduits 3 inches above finished floor.
  - 5. Install metal conduits with grounding bushings and connect with grounding conductor to grounding system.
- F. Backboards: Install backboards with 96-inch dimension vertical. Butt adjacent sheets tightly, and form smooth gap-free corners and joints.

### 3.2 FIRE ALARM WIRING INSTALLATION

- A. Comply with NECA 1 and NFPA 72.
- B. Wiring Method: Install wiring in metal raceway according to Division 26 Section "Raceway and Boxes for Electrical Systems."
  - 1. Install plenum cable in environmental air spaces, including plenum ceilings.
- C. Wiring Method:
  - 1. Cables and raceways used for fire alarm circuits, and equipment control wiring associated with the fire alarm system, may not contain any other wire or cable.
  - 2. Fire-Rated Cables: Use of 2-hour, fire-rated fire alarm cables, NFPA 70, Types MI and CI, is permitted.



3. Signaling Line Circuits: Power-limited fire alarm cables may be installed in the same cable or raceway as signaling line circuits.
  - D. Wiring within Enclosures: Separate power-limited and non-power-limited conductors as recommended by manufacturer. Install conductors parallel with or at right angles to sides and back of the enclosure. Bundle, lace, and train conductors to terminal points with no excess. Connect conductors that are terminated, spliced, or interrupted in any enclosure associated with the fire alarm system to terminal blocks. Mark each terminal according to the system's wiring diagrams. Make all connections with approved crimp-on terminal spade lugs, pressure-type terminal blocks, or plug connectors.
  - E. Cable Taps: Use numbered terminal strips in junction, pull, and outlet boxes, cabinets, or equipment enclosures where circuit connections are made.
  - F. Color-Coding: Color-code fire alarm conductors differently from the normal building power wiring. Use one color-code for alarm circuit wiring and another for supervisory circuits. Color-code audible alarm-indicating circuits differently from alarm-initiating circuits. Use different colors for visible alarm-indicating devices. Paint fire alarm system junction boxes and covers red.
  - G. Risers: Install at least two vertical cable risers to serve the fire alarm system. Separate risers in close proximity to each other with a minimum one-hour-rated wall, so the loss of one riser does not prevent the receipt or transmission of signals from other floors or zones.
  - H. Wiring to Remote Alarm Transmitting Device: 1-inch conduit between the fire alarm control panel and the transmitter. Install number of conductors and electrical supervision for connecting wiring as needed to suit monitoring function.

### 3.3 FIRESTOPPING

- A. Comply with requirements in Division 07 Section "Penetration Firestopping."

### 3.4 GROUNDING

- A. For low-voltage wiring and cabling, comply with requirements in Division 26 Section "Grounding and Bonding for Electrical Systems."

### 3.5 FIELD QUALITY CONTROL

- A. Tests and Inspections:
  1. Visually inspect cable jacket materials for UL or third-party certification markings. Inspect cabling terminations to confirm color-coding.
  2. Visually inspect cable placement, cable termination, grounding, and bonding.
- B. Document data for each measurement. Print data for submittals in a summary report that is formatted using Table 10.1 in BICSI TDMM as a guide, or transfer the data from the instrument to the computer, save as text files, print, and submit.

C. Prepare test and inspection reports.

END OF SECTION 280513

## SECTION 283111 - DIGITAL, ADDRESSABLE FIRE-ALARM SYSTEM

### PART 1 - GENERAL

#### 1.1 SUMMARY

##### A. Section Includes:

1. Fire-alarm control unit.
2. Manual fire-alarm boxes.
3. System smoke detectors.
4. Heat detectors.
5. Notification appliances.
6. Magnetic door holders.
7. Remote annunciator.
8. Addressable interface device.
9. Digital alarm communicator transmitter.

#### 1.2 SYSTEM DESCRIPTION

- A. Noncoded, addressable system, with multiplexed signal transmission, dedicated to fire-alarm service only.

#### 1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated.

- B. Shop Drawings: For fire-alarm system. Include plans, elevations, sections, details, and attachments to other work.

1. Comply with recommendations in the "Documentation" Section of the "Fundamentals of Fire Alarm Systems" Chapter in NFPA 72.
2. Include voltage drop calculations for notification appliance circuits.
3. Include battery-size calculations. Battery calculations shall be based upon the potential for all apartment units to have visual alarm notification devices installed.
4. Include performance parameters and installation details for each detector, verifying that each detector is listed for complete range of air velocity, temperature, and humidity possible when air-handling system is operating.
5. Include plans, sections, and elevations of heating, ventilating, and air-conditioning ducts, drawn to scale and coordinating installation of duct smoke detectors and access to them. Show critical dimensions that relate to placement and support of sampling tubes, detector housing, and remote status and alarm indicators. Locate detectors according to manufacturer's written recommendations.
6. Include floor plans to indicate final outlet locations showing address of each addressable device. Show size and route of cable and conduits.

- C. General Submittal Requirements:

1. Submittals shall be approved by authorities having jurisdiction prior to submitting them to Architect.
2. Shop Drawings shall be prepared by persons with the following qualifications:
  - a. Trained and certified by manufacturer in fire-alarm system design.

D. Delegated-Design Submittal: For smoke and heat detectors indicated to comply with performance requirements and design criteria, including analysis data signed and sealed by the qualified professional engineer responsible for their preparation.

1. Drawings showing the location of each smoke and heat detector, ratings of each, and installation details as needed to comply with listing conditions of the detector.
2. Design Calculations: Calculate requirements for selecting the spacing and sensitivity of detection, complying with NFPA 72.

#### 1.4 INFORMATIONAL SUBMITTALS

A. Qualification Data: For qualified Installer.

#### 1.5 CLOSEOUT SUBMITTALS

A. Operation and Maintenance Data: For fire-alarm systems and components to include in emergency, operation, and maintenance manuals. In addition to items specified in Section 01 78 23 "Operation and Maintenance Data," deliver copies to authorities having jurisdiction and include the following:

1. Comply with the "Records" Section of the "Inspection, Testing and Maintenance" Chapter in NFPA 72.
2. Provide "Record of Completion Documents" according to NFPA 72 article "Permanent Records" in the "Records" Section of the "Inspection, Testing and Maintenance" Chapter.
3. Record copy of site-specific software.
4. Provide "Maintenance, Inspection and Testing Records" according to NFPA 72 article of the same name and include the following:
  - a. Frequency of testing of installed components.
  - b. Frequency of inspection of installed components.
  - c. Requirements and recommendations related to results of maintenance.
  - d. Manufacturer's user training manuals.
5. Manufacturer's required maintenance related to system warranty requirements.
6. Abbreviated operating instructions for mounting at fire-alarm control unit.

B. Software and Firmware Operational Documentation:

1. Software operating and upgrade manuals.
2. Program Software Backup: On magnetic media or compact disk, complete with data files.
3. Device address list.
4. Printout of software application and graphic screens.

## 1.6 QUALITY ASSURANCE

- A. Installer Qualifications: Personnel shall be trained and certified by manufacturer for installation of units required for this Project.
- B. Source Limitations for Fire-Alarm System and Components: Obtain fire-alarm system from single source from single manufacturer. Components shall be compatible with, and operate as, an extension of existing system.
- C. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

## 1.7 SOFTWARE SERVICE AGREEMENT

- A. Comply with UL 864.
- B. Technical Support: Beginning with Substantial Completion, provide software support for two years.
- C. Upgrade Service: Update software to latest version at Project completion. Install and program software upgrades that become available within two years from date of Substantial Completion. Upgrading software shall include operating system. Upgrade shall include new or revised licenses for use of software.
  - 1. Provide 30 days' notice to Owner to allow scheduling and access to system and to allow Owner to upgrade computer equipment if necessary.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Bosch Security Systems.
  - 2. Faraday; Siemens Building Technologies, Inc.
  - 3. Fire Lite Alarms; a Honeywell company.
  - 4. GE Infrastructure; a unit of General Electric Company.
  - 5. Siemens Building Technologies, Inc.; Fire Safety Division.
  - 6. Silent Knight; a Honeywell company.
  - 7. SimplexGrinnell LP; a Tyco International company.
  - 8. Notifier.

### 2.2 SYSTEMS OPERATIONAL DESCRIPTION

- A. Fire-alarm signal initiation shall be by one or more of the following devices:
  - 1. Manual stations.
  - 2. Heat detectors.
  - 3. Smoke detectors.
  - 4. Duct smoke detectors.

5. Automatic sprinkler system water flow.
6. Heat detectors in elevator shaft and pit.
7. Fire-extinguishing system operation.

B. Fire-alarm signal shall initiate the following actions:

1. Continuously operate alarm-notification appliances.
2. Identify alarm at the fire-alarm control unit.
3. Transmit an alarm signal to the remote alarm receiving station.
4. Unlock electric door locks in designated egress paths.
5. Release fire and smoke doors held open by magnetic door holders.
6. Switch heating, ventilating, and air-conditioning equipment controls to fire-alarm mode.
7. Activate emergency shutoffs for gas and fuel supplies.
8. Record events in the system memory.

C. System trouble signal initiation shall be by one or more of the following devices and actions:

1. Open circuits, shorts, and grounds in designated circuits.
2. Opening, tampering with, or removing alarm-initiating and supervisory signal-initiating devices.
3. Loss of primary power at fire-alarm control unit.
4. Ground or a single break in fire-alarm control unit internal circuits.
5. Abnormal ac voltage at fire-alarm control unit.
6. Break in standby battery circuitry.
7. Failure of battery charging.
8. Abnormal position of any switch at fire-alarm control unit or annunciator.

D. System Trouble and Supervisory Signal Actions: Initiate notification appliance and annunciate at fire-alarm control unit.

## 2.3 FIRE-ALARM CONTROL UNIT

A. General Requirements for Fire-Alarm Control Unit:

1. Field-programmable, microprocessor-based, modular, power-limited design with electronic modules, complying with UL 864 and listed and labeled by an NRTL.
  - a. System software and programs shall be held in flash electrically erasable programmable read-only memory (EEPROM), retaining the information through failure of primary and secondary power supplies.
  - b. Include a real-time clock for time annotation of events on the event recorder and printer.
2. Addressable control circuits for operation of mechanical equipment.

B. Alphanumeric Display and System Controls: Arranged for interface between human operator at fire-alarm control unit and addressable system components including annunciation and supervision. Display alarm, supervisory, and component status messages and the programming and control menu.

1. Annunciator and Display: Liquid-crystal type.
2. Keypad: Arranged to permit entry and execution of programming, display, and control commands.

- C. Door Controls: Door hold-open devices that are controlled by smoke detectors at doors in smoke barrier walls shall be connected to fire-alarm system.
- D. Transmission to Remote Alarm Receiving Station: Automatically transmit alarm, supervisory, and trouble signals to a remote alarm station.
- E. Primary Power: 24-V dc obtained from 120-V ac service and a power-supply module. Initiating devices, notification appliances, signaling lines, trouble signals and supervisory signals shall be powered by 24-V dc source.
  - 1. Alarm current draw of entire fire-alarm system shall not exceed 80 percent of the power-supply module rating.
- F. Secondary Power: 24-V dc supply system with batteries, automatic battery charger, and automatic transfer switch.
  - 1. Batteries: Sealed lead calcium.
- G. Instructions: Computer printout or typewritten instruction card mounted behind a plastic or glass cover in a stainless-steel or aluminum frame. Include interpretation and describe appropriate response for displays and signals. Briefly describe the functional operation of the system under normal, alarm, and trouble conditions.

## 2.4 MANUAL FIRE-ALARM BOXES

- A. General Requirements for Manual Fire-Alarm Boxes: Comply with UL 38. Boxes shall be finished in red with molded, raised-letter operating instructions in contrasting color; shall show visible indication of operation; and shall be mounted on recessed outlet box. If indicated as surface mounted, provide manufacturer's surface back box.
  - 1. Single-action mechanism, pull-lever type. With integral addressable module arranged to communicate manual-station status (normal, alarm, or trouble) to fire-alarm control unit.
  - 2. Station Reset: Key- or wrench-operated switch.

## 2.5 SYSTEM SMOKE DETECTORS

- A. General Requirements for System Smoke Detectors:
  - 1. Comply with UL 268; operating at 24-V dc, nominal.
  - 2. Integral Addressable Module: Arranged to communicate detector status (normal, alarm, or trouble) to fire-alarm control unit.
  - 3. Base Mounting: Detector and associated electronic components shall be mounted in a twist-lock module that connects to a fixed base. Provide terminals in the fixed base for connection to building wiring.
  - 4. Self-Restoring: Detectors do not require resetting or readjustment after actuation to restore them to normal operation.
  - 5. Integral Visual-Indicating Light: LED type indicating detector has operated and power-on status.
- B. Photoelectric Smoke Detectors:

1. Detector address shall be accessible from fire-alarm control unit and shall be able to identify the detector's location within the system and its sensitivity setting.
2. An operator at fire-alarm control unit, having the designated access level, shall be able to manually access the following for each detector:
  - a. Primary status.
  - b. Device type.
  - c. Present average value.
  - d. Present sensitivity selected.
  - e. Sensor range (normal, dirty, etc.).

C. Duct Smoke Detectors: Photoelectric type complying with UL 268A.

1. Detector address shall be accessible from fire-alarm control unit and shall be able to identify the detector's location within the system and its sensitivity setting.
2. An operator at fire-alarm control unit, having the designated access level, shall be able to manually access the following for each detector:
  - a. Primary status.
  - b. Device type.
  - c. Present average value.
  - d. Present sensitivity selected.
  - e. Sensor range (normal, dirty, etc.).
3. Weatherproof Duct Housing Enclosure: NEMA 250, Type 4X; NRTL listed for use with the supplied detector.
4. Each sensor shall have multiple levels of detection sensitivity.
5. Sampling Tubes: Design and dimensions as recommended by manufacturer for specific duct size, air velocity, and installation conditions where applied.
6. Relay Fan Shutdown: Rated to interrupt fan motor-control circuit.

## 2.6 HEAT DETECTORS

- A. General Requirements for Heat Detectors: Comply with UL 521.
- B. Heat Detector, Combination Type: Actuated by either a fixed temperature of 135 deg F or a rate of rise that exceeds 15 deg F per minute unless otherwise indicated.
  1. Mounting: Twist-lock base interchangeable with smoke-detector bases.
  2. Integral Addressable Module: Arranged to communicate detector status (normal, alarm, or trouble) to fire-alarm control unit.

## 2.7 NOTIFICATION APPLIANCES

- A. General Requirements for Notification Appliances: Connected to notification appliance signal circuits, zoned as indicated, equipped for mounting as indicated and with screw terminals for system connections.
  1. Combination Devices: Factory-integrated audible and visible devices in a single-mounting assembly, equipped for mounting as indicated and with screw terminals for system connections.



- B. Chimes, Low-Level Output: Vibrating type, 75-dBA minimum rated output.
- C. Chimes, High-Level Output: Vibrating type, 81-dBA minimum rated output.
- D. Horns: Electric-vibrating-polarized type, 24-V dc; with provision for housing the operating mechanism behind a grille. Comply with UL 464. Horns shall produce a sound-pressure level of 90 dBA, measured 10 feet from the horn, using the coded signal prescribed in UL 464 test protocol.
- E. Visible Notification Appliances: Xenon strobe lights comply with UL 1971, with clear or nominal white polycarbonate lens mounted on an aluminum faceplate. The word "FIRE" is engraved in minimum 1-inch- high letters on the lens.
  - 1. Rated Light Output:
    - a. 15/30/75/110 cd, selectable in the field.
  - 2. Mounting: Wall mounted unless otherwise indicated.
  - 3. For units with guards to prevent physical damage, light output ratings shall be determined with guards in place.
  - 4. Flashing shall be in a temporal pattern, synchronized with other units.
  - 5. Strobe Leads: Factory connected to screw terminals.
  - 6. Mounting Faceplate: Factory finished, red.

## 2.8 MAGNETIC DOOR HOLDERS

- A. Description: Units are equipped for wall or floor mounting as indicated and are complete with matching doorplate.
  - 1. Electromagnet: Requires no more than 3 W to develop 25-lbf holding force.
  - 2. Wall-Mounted Units: Flush mounted unless otherwise indicated.
  - 3. Rating: 24-V ac or dc.
  - 4. Rating: 120-V ac.
- B. Material and Finish: Match door hardware.

## 2.9 REMOTE ANNUNCIATOR

- A. Description: Annunciator functions shall match those of fire-alarm control unit for alarm, supervisory, and trouble indications. Manual switching functions shall match those of fire-alarm control unit, including acknowledging, silencing, resetting, and testing.
  - 1. Mounting: Flush cabinet, NEMA 250, Type 1.
- B. Display Type and Functional Performance: Alphanumeric display and LED indicating lights shall match those of fire-alarm control unit. Provide controls to acknowledge, silence, reset, and test functions for alarm, supervisory, and trouble signals.

## 2.10 ADDRESSABLE INTERFACE DEVICE

- A. Description: Microelectronic monitor module, NRTL listed for use in providing a system address for alarm-initiating devices for wired applications with normally open contacts.

- B. Integral Relay: Capable of providing a direct signal to elevator controller to initiate elevator recall.

## 2.11 DIGITAL ALARM COMMUNICATOR TRANSMITTER

- A. Digital alarm communicator transmitter shall be acceptable to the remote central station and shall comply with UL 632 and be listed and labeled by an NRTL.
- B. Functional Performance: Unit shall receive an alarm, supervisory, or trouble signal from fire-alarm control unit and automatically capture one telephone line(s) and dial a preset number for a remote central station. When contact is made with central station(s), signals shall be transmitted. If service on line is interrupted for longer than 45 seconds, transmitter shall initiate a local trouble signal and transmit the signal indicating loss of telephone line to the remote alarm receiving station over the remaining line. Transmitter shall automatically report telephone service restoration to the central station.
- C. Local functions and display at the digital alarm communicator transmitter shall include the following:
  - 1. Programming device.
  - 2. LED display.
  - 3. Manual test report function and manual transmission clear indication.
  - 4. Communications failure with the central station or fire-alarm control unit.
- D. Digital data transmission shall include the following:
  - 1. Address of the alarm-initiating device.
  - 2. Address of the supervisory signal.
  - 3. Address of the trouble-initiating device.
  - 4. Loss of ac supply or loss of power.
  - 5. Low battery.
  - 6. Abnormal test signal.
  - 7. Communication bus failure.
- E. Secondary Power: Integral rechargeable battery and automatic charger.
- F. Self-Test: Conducted automatically every 24 hours with report transmitted to central station.

## PART 3 - EXECUTION

### 3.1 EQUIPMENT INSTALLATION

- A. Comply with NFPA 72 for installation of fire-alarm equipment.
- B. Install wall-mounted equipment, with tops of cabinets not more than 72 inches above the finished floor.
- C. Smoke- or Heat-Detector Spacing:
  - 1. Comply with NFPA 72, "Smoke-Sensing Fire Detectors" Section in the "Initiating Devices" Chapter, for smoke-detector spacing.

2. Comply with NFPA 72, "Heat-Sensing Fire Detectors" Section in the "Initiating Devices" Chapter, for heat-detector spacing.
  3. Spacing of detectors for irregular areas, for irregular ceiling construction, and for high ceiling areas shall be determined according to Appendix A in NFPA 72.
  4. HVAC: Locate detectors not closer than 3 feet from air-supply diffuser or return-air opening.
  5. Lighting Fixtures: Locate detectors not closer than 12 inches from any part of a lighting fixture.
- D. Duct Smoke Detectors: Comply with NFPA 72 and NFPA 90A. Install sampling tubes so they extend the full width of duct.
  - E. Remote Status and Alarm Indicators: Install near each smoke detector and each sprinkler water-flow switch and valve-tamper switch that is not readily visible from normal viewing position.
  - F. Audible Alarm-Indicating Devices: Install not less than 6 inches below the ceiling. Install bells and horns on flush-mounted back boxes with the device-operating mechanism concealed behind a grille.
  - G. Visible Alarm-Indicating Devices: Install adjacent to each alarm bell or alarm horn and at least 6 inches below the ceiling.
  - H. Device Location-Indicating Lights: Locate in public space near the device they monitor.
  - I. Fire-Alarm Control Unit: Surface mounted, with tops of cabinets not more than 72 inches above the finished floor.

### 3.2 CONNECTIONS

- A. For fire-protection systems related to doors in fire-rated walls and partitions and to doors in smoke partitions, comply with requirements in Section 08 71 00 "Door Hardware." Connect hardware and devices to fire-alarm system.
  1. Verify that hardware and devices are NRTL listed for use with fire-alarm system in this Section before making connections.
- B. Make addressable connections with a supervised interface device to the following devices and systems. Install the interface device less than 3 feet from the device controlled. Make an addressable confirmation connection when such feedback is available at the device or system being controlled.
  1. Alarm-initiating connection to elevator recall system and components.
  2. Alarm-initiating connection to activate emergency shutoffs for gas and fuel supplies.
  3. Supervisory connections at valve supervisory switches.

### 3.3 IDENTIFICATION

- A. Identify system components, wiring, cabling, and terminals. Comply with requirements for identification specified in Section 26 05 53 "Identification for Electrical Systems."
- B. Install framed instructions in a location visible from fire-alarm control unit.

### 3.4 GROUNDING

- A. Ground fire-alarm control unit and associated circuits; comply with IEEE 1100. Install a ground wire from main service ground to fire-alarm control unit.

### 3.5 FIELD QUALITY CONTROL

- A. Field tests shall be witnessed by authorities having jurisdiction.
- B. Tests and Inspections:
  - 1. Visual Inspection: Conduct visual inspection prior to testing.
    - a. Inspection shall be based on completed Record Drawings and system documentation that is required by NFPA 72 in its "Completion Documents, Preparation" Table in the "Documentation" Section of the "Fundamentals of Fire Alarm Systems" Chapter.
    - b. Comply with "Visual Inspection Frequencies" Table in the "Inspection" Section of the "Inspection, Testing and Maintenance" Chapter in NFPA 72; retain the "Initial/Reacceptance" column and list only the installed components.
  - 2. System Testing: Comply with "Test Methods" Table in the "Testing" Section of the "Inspection, Testing and Maintenance" Chapter in NFPA 72.
  - 3. Test audible appliances for the public operating mode according to manufacturer's written instructions. Perform the test using a portable sound-level meter complying with Type 2 requirements in ANSI S1.4.
  - 4. Test audible appliances for the private operating mode according to manufacturer's written instructions.
  - 5. Test visible appliances for the public operating mode according to manufacturer's written instructions.
  - 6. Factory-authorized service representative shall prepare the "Fire Alarm System Record of Completion" in the "Documentation" Section of the "Fundamentals of Fire Alarm Systems" Chapter in NFPA 72 and the "Inspection and Testing Form" in the "Records" Section of the "Inspection, Testing and Maintenance" Chapter in NFPA 72.
- C. Reacceptance Testing: Perform reacceptance testing to verify the proper operation of added or replaced devices and appliances.
- D. Fire-alarm system will be considered defective if it does not pass tests and inspections.
- E. Prepare test and inspection reports.
- F. Maintenance Test and Inspection: Perform tests and inspections listed for weekly, monthly, quarterly, and semiannual periods. Use forms developed for initial tests and inspections.
- G. Annual Test and Inspection: One year after date of Substantial Completion, test fire-alarm system complying with visual and testing inspection requirements in NFPA 72. Use forms developed for initial tests and inspections.

END OF SECTION 283111

## SECTION 311000 - SITE CLEARING

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Protecting existing vegetation to remain.
  - 2. Removing existing vegetation.
  - 3. Clearing and grubbing.
  - 4. Stripping and stockpiling topsoil.
  - 5. Removing above- and below-grade site improvements.
  - 6. Disconnecting, capping or sealing, and removing site utilities.
  - 7. Temporary erosion- and sedimentation-control measures.

#### 1.3 DEFINITIONS

- A. Subsoil: All soil beneath the topsoil layer of the soil profile, and typified by the lack of organic matter and soil organisms.
- B. Surface Soil: Soil that is present at the top layer of the existing soil profile at the Project site. In undisturbed areas, the surface soil is typically topsoil; but in disturbed areas such as urban environments, the surface soil can be subsoil.
- C. Topsoil: Top layer of the soil profile consisting of existing native surface topsoil or existing in-place surface soil and is the zone where plant roots grow.
- D. Plant-Protection Zone: Area surrounding individual trees, groups of trees, shrubs, or other vegetation to be protected during construction, and indicated on Drawings.
- E. Tree-Protection Zone: Area surrounding individual trees or groups of trees to be protected during construction, and defined by a circle concentric with each tree with a radius 1.5 times the diameter of the drip line unless otherwise indicated.
- F. Vegetation: Trees, shrubs, groundcovers, grass, and other plants.

#### 1.4 MATERIAL OWNERSHIP

- A. Except for stripped topsoil and other materials indicated to be stockpiled or otherwise remain Owner's property, cleared materials shall become Contractor's property and shall be removed from Project site.

## 1.5 SUBMITTALS

- A. Existing Conditions: Documentation of existing trees and plantings, adjoining construction, and site improvements that establishes preconstruction conditions that might be misconstrued as damage caused by site clearing.
  - 1. Use sufficiently detailed photographs or videotape.
  - 2. Include plans and notations to indicate specific wounds and damage conditions of each tree or other plants designated to remain.
- B. Record Drawings: Identifying and accurately showing locations of capped utilities and other subsurface structural, electrical, and mechanical conditions.

## 1.6 PROJECT CONDITIONS

- A. Traffic: Minimize interference with adjoining roads, streets, walks, and other adjacent occupied or used facilities during site-clearing operations.
  - 1. Do not close or obstruct streets, walks, or other adjacent occupied or used facilities without permission from Owner and authorities having jurisdiction.
  - 2. Provide alternate routes around closed or obstructed traffic ways if required by Owner or authorities having jurisdiction.
- B. Improvements on Adjoining Property: Authority for performing site clearing indicated on property adjoining Owner's property will be obtained by Owner before award of Contract.
  - 1. Do not proceed with work on adjoining property until directed by Engineer.
- C. Utility Locator Service: Notify "One Call" for area where Project is located before site clearing.
- D. Do not commence site clearing operations until temporary erosion- and sedimentation-control measures are in place.

## PART 2 - PRODUCTS

### 2.1 MATERIALS

- A. Satisfactory Soil Material: Requirements for satisfactory soil material are specified in Division 31 Section "Earth Moving."
  - 1. Obtain approved borrow soil material off-site when satisfactory soil material is not available on-site.

## PART 3 - EXECUTION

### 3.1 PREPARATION

- A. Protect and maintain benchmarks and survey control points from disturbance during construction.

- B. Locate and clearly identify trees, shrubs, and other vegetation to remain. Wrap a 1-inch (25-mm) blue vinyl tie tape flag around each tree trunk at 54 inches (1372 mm) above the ground.
- C. Protect existing site improvements to remain from damage during construction.
  - 1. Restore damaged improvements to their original condition, as acceptable to Owner.

### 3.2 TEMPORARY EROSION AND SEDIMENTATION CONTROL

- A. Provide temporary erosion- and sedimentation-control measures to prevent soil erosion and discharge of soil-bearing water runoff or airborne dust to adjacent properties and walkways, according to erosion- and sedimentation-control Drawings and requirements of authorities having jurisdiction.
- B. Verify that flows of water redirected from construction areas or generated by construction activity do not enter or cross protection zones.
- C. Inspect, maintain, and repair erosion- and sedimentation-control measures during construction until permanent vegetation has been established.
- D. Remove erosion and sedimentation controls and restore and stabilize areas disturbed during removal.

### 3.3 TREE AND PLANT PROTECTION

- A. General: Protect trees and plants remaining on-site.
- B. Repair or replace trees, shrubs, and other vegetation indicated to remain or be relocated that are damaged by construction operations, in a manner approved by Engineer.

### 3.4 EXISTING UTILITIES

- A. Contractor will arrange for disconnecting and sealing indicated utilities that serve existing structures before site clearing.
  - 1. Verify that utilities have been disconnected and capped before proceeding with site clearing.
- B. Locate, identify, disconnect, and seal or cap utilities indicated to be removed.
  - 1. Arrange with utility companies to shut off indicated utilities.
  - 2. Contractor will arrange to shut off indicated utilities as necessary.
- C. Locate, identify, and disconnect utilities indicated to be abandoned in place.
- D. Interrupting Existing Utilities: Do not interrupt utilities serving facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary utility services according to requirements indicated:
  - 1. Notify Engineer not less than two days in advance of proposed utility interruptions.
  - 2. Do not proceed with utility interruptions without Engineer's written permission.
- E. Excavate for and remove underground utilities indicated to be removed.

### 3.5 CLEARING AND GRUBBING

- A. Remove obstructions, trees, shrubs, and other vegetation to permit installation of new construction.
  - 1. Do not remove trees, shrubs, and other vegetation indicated to remain or to be relocated.
  - 2. Grind down stumps and remove roots, obstructions, and debris to a depth of 36 inches (450 mm) below exposed subgrade.
  - 3. Use only hand methods for grubbing within protection zones.
  - 4. Chip removed tree branches and dispose of as directed by Engineer.
- B. Fill depressions caused by clearing and grubbing operations with satisfactory soil material unless further excavation or earthwork is indicated.
  - 1. Place fill material in horizontal layers not exceeding a loose depth of 8 inches (200 mm), and compact each layer to a density equal to adjacent original ground.

### 3.6 TOPSOIL STRIPPING

- A. Remove sod and grass before stripping topsoil.
- B. Strip topsoil to depth of 5 inches (150 mm) in a manner to prevent intermingling with underlying subsoil or other waste materials.
  - 1. Remove subsoil and nonsoil materials from topsoil, including clay lumps, gravel, and other objects more than 2 inches (50 mm) in diameter; trash, debris, weeds, roots, and other waste materials.
- C. Stockpile topsoil at a location as designated by the owner. Grade and shape stockpiles to drain surface water.
  - 1. Limit height of topsoil stockpiles to 72 inches (1800 mm).
  - 2. Do not stockpile topsoil within protection zones.
  - 3. Stockpile surplus topsoil to allow for respreading deeper topsoil.
  - 4. Install erosion control devices around stockpiles.

### 3.7 SITE IMPROVEMENTS

- A. Remove existing above- and below-grade improvements as indicated and necessary to facilitate new construction.
- B. Remove slabs, paving, curbs, gutters, and aggregate base as indicated.
  - 1. Unless existing full-depth joints coincide with line of demolition, neatly saw-cut along line of existing pavement to remain before removing adjacent existing pavement. Saw-cut faces vertically.

### 3.8 DISPOSAL OF SURPLUS AND WASTE MATERIALS

- A. Remove obstructions, demolished materials, and waste materials including trash and debris, and legally dispose of them off Owner's property.



## SECTION 312011 - EARTHWORK

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:

1. Preparing subgrades for slabs-on-grade, walks and pavements.
2. Excavating and backfilling for buildings and structures.
3. Drainage course for concrete slabs-on-grade.
4. Subbase course for concrete walks and pavements.
5. Subsurface drainage backfill for walls and trenches.
6. Excavating and backfilling trenches for utilities and pits for buried utility structures.

- B. Related Sections:

1. Division 31 Section "Site Clearing" for site stripping, grubbing, stripping and stockpiling topsoil, and removal of above- and below-grade improvements and utilities.

#### 1.3 DEFINITIONS

- A. Backfill: Soil material or controlled low-strength material used to fill an excavation.

1. Initial Backfill: Backfill placed beside and over pipe in a trench, including haunches to support sides of pipe.
2. Final Backfill: Backfill placed over initial backfill to fill a trench, or a foundation overdig.

- B. Base Course: Aggregate layer placed between the subbase course and hot-mix asphalt paving.

- C. Bedding Course: Aggregate layer placed over the excavated subgrade in a trench before laying pipe.

- D. Borrow Soil: Satisfactory soil imported from off-site for use as fill or backfill.

- E. Drainage Course: Aggregate layer supporting the slab-on-grade that also minimizes upward capillary flow of pore water.

- F. Excavation: Removal of material encountered above subgrade elevations and to lines and dimensions indicated.

1. Authorized Additional Excavation: Excavation below subgrade elevations or beyond indicated lines and dimensions as directed by Engineer.

2. Unauthorized Excavation: Excavation below subgrade elevations or beyond indicated lines and dimensions without direction by Engineer. Unauthorized excavation, as well as remedial work directed by Engineer, shall be without additional compensation.
- G. Fill: Soil materials used to raise existing grades.
- H. Rock: Rock material in beds, ledges, unstratified masses, conglomerate deposits, and boulders of rock material that exceed 1 cu. yd. (0.76 cu. m) for bulk excavation or 3/4 cu. yd. (0.57 cu. m) for footing, trench, and pit excavation that cannot be removed by rock excavating equipment equivalent to the following in size and performance ratings, without systematic drilling, ram hammering, ripping, or blasting, when permitted:
1. Excavation of Footings, Trenches, and Pits: Late-model, track-mounted hydraulic excavator; equipped with a 42-inch- (1065-mm-) wide, maximum, short-tip-radius rock bucket; rated at not less than 138-hp (103-kW) flywheel power with bucket-curling force of not less than 28,700 lbf (128 kN) and stick-crowd force of not less than 18,400 lbf (82 kN) with extra-long reach boom; measured according to SAE J-1179.
  2. Bulk Excavation: Late-model, track-mounted loader; rated at not less than 230-hp (172-kW) flywheel power and developing a minimum of 47,992-lbf (213.3-kN) breakout force with a general-purpose bare bucket; measured according to SAE J-732.
- I. Structures: Buildings, footings, foundations, retaining walls, slabs, tanks, curbs, mechanical and electrical appurtenances, or other man-made stationary features constructed above or below the ground surface.
- J. Subbase Course: Aggregate layer placed between the subgrade and base course for hot-mix asphalt pavement, or aggregate layer placed between the subgrade and a cement concrete pavement or a cement concrete or hot-mix asphalt walk.
- K. Subgrade: Uppermost surface of an excavation or the top surface of a fill or backfill immediately below subbase, drainage fill, drainage course, or topsoil materials.
- L. Utilities: On-site underground pipes, conduits, ducts, and cables, as well as underground services within buildings.

#### 1.4 PROJECT CONDITIONS

- A. Traffic: Minimize interference with adjoining roads, streets, walks, and other adjacent occupied or used facilities during earth moving operations.
1. Do not close or obstruct streets, walks, or other adjacent occupied or used facilities without permission from Owner and authorities having jurisdiction.
  2. Provide alternate routes around closed or obstructed traffic ways if required by Owner or authorities having jurisdiction.
- B. Utility Locator Service: Notify "One Call" for area where Project is located before beginning earth moving operations.
- C. Do not commence earth moving operations until temporary erosion- and sedimentation-control measures are in place.
- D. Do not commence earth moving operations until plant-protection measures are in place.

## PART 2 - PRODUCTS

### 2.1 SOIL MATERIALS

- A. General: Provide borrow soil materials when sufficient satisfactory soil materials are not available from excavations.
- B. Satisfactory Soils: Soil Classification Groups GW, GM, SW, SM, CL and ML according to ASTM D 2487 or a combination of these groups; free of rock or gravel larger than 3 inches in any dimension, debris, waste, frozen materials, vegetation, and other deleterious matter.
- C. Base Material: Type 5 Aggregate in accordance with Section 1007 of the Missouri Department of Transportation Standard Specifications for Highway Construction.
- D. Subbase Material: Type 5 Aggregate in accordance with Section 1007 of the Missouri Department of Transportation Standard Specifications for Highway Construction.
- E. Engineered Fill: Well graded crushed limestone similar to Type 4 Aggregate in accordance with Section 1007 of the Missouri Department of Transportation Standard Specifications for Highway Construction.

### 2.2 ACCESSORIES

- A. Warning Tape: Acid- and alkali-resistant, polyethylene film warning tape manufactured for marking and identifying underground utilities, 6 inches (150 mm) wide and 4 mils (0.1 mm) thick, continuously inscribed with a description of the utility; colored as follows:
  - 1. Red: Electric.
  - 2. Yellow: Gas, oil, steam, and dangerous materials.
  - 3. Orange: Telephone and other communications.
  - 4. Blue: Water systems.
  - 5. Green: Sewer systems.
- B. Detectable Warning Tape: Acid- and alkali-resistant, polyethylene film warning tape manufactured for marking and identifying underground utilities, a minimum of 6 inches (150 mm) wide and 4 mils (0.1 mm) thick, continuously inscribed with a description of the utility, with metallic core encased in a protective jacket for corrosion protection, detectable by metal detector when tape is buried up to 30 inches (750 mm) deep; colored as follows:
  - 1. Red: Electric.
  - 2. Yellow: Gas, oil, steam, and dangerous materials.
  - 3. Orange: Telephone and other communications.
  - 4. Blue: Water systems.
  - 5. Green: Sewer systems.

## PART 3 - EXECUTION

### 3.1 PREPARATION

- A. Protect structures, utilities, sidewalks, pavements, and other facilities from damage caused by settlement, lateral movement, undermining, washout, and other hazards created by earth moving operations.

- B. Protect and maintain erosion and sedimentation controls during earth moving operations.
- C. Protect subgrades and foundation soils from freezing temperatures and frost. Remove temporary protection before placing subsequent materials.

### 3.2 DEWATERING

- A. Prevent surface water and ground water from entering excavations, from ponding on prepared subgrades, and from flooding Project site and surrounding area.
- B. Protect subgrades from softening, undermining, washout, and damage by rain or water accumulation.
  - 1. Reroute surface water runoff away from excavated areas. Do not allow water to accumulate in excavations. Do not use excavated trenches as temporary drainage ditches.

### 3.3 EXCAVATION, GENERAL

- A. Unclassified Excavation: Excavate to subgrade elevations regardless of the character of surface and subsurface conditions encountered. Unclassified excavated materials may include rock, soil materials, and obstructions.
  - 1. If excavated materials intended for fill and backfill include unsatisfactory soil materials and rock, replace with satisfactory soil materials.
  - 2. Remove rock to lines and grades indicated to permit installation of permanent construction without exceeding the following dimensions:
    - a. 24 inches outside of concrete forms other than at footings.
    - b. 12 inches outside of concrete forms at footings.
    - c. 6 inches outside of minimum required dimensions of concrete cast against grade.
    - d. Outside dimensions of concrete walls indicated to be cast against rock without forms or exterior waterproofing treatments.
    - e. 12 inches beneath bottom of concrete slabs-on-grade.
    - f. 6 inches beneath pipe in trenches, and the greater of 24 inches wider than pipe or 42 inches wide.

### 3.4 EXCAVATION FOR STRUCTURES

- A. Excavate to indicated elevations and dimensions within a tolerance of plus or minus 1 inch (25 mm). If applicable, extend excavations a sufficient distance from structures for placing and removing concrete formwork, for installing services and other construction, and for inspections.
  - 1. Excavations for Footings and Foundations: Do not disturb bottom of excavation. Excavate by hand to final grade just before placing concrete reinforcement. Trim bottoms to required lines and grades to leave solid base to receive other work.
  - 2. Excavation for Underground Tanks, Basins, and Mechanical or Electrical Utility Structures: Excavate to elevations and dimensions indicated within a tolerance of plus or minus 1 inch (25 mm). Do not disturb bottom of excavations intended as bearing surfaces.

### 3.5 EXCAVATION FOR WALKS AND PAVEMENTS

- A. Excavate surfaces under walks and pavements to indicated lines, cross sections, elevations, and subgrades.

### 3.6 EXCAVATION FOR UTILITY TRENCHES

- A. Excavate trenches to indicated gradients, lines, depths, and elevations.
  - 1. Beyond building perimeter, excavate trenches to allow installation of top of pipe below frost line.
- B. Excavate trenches to uniform widths to provide the proper clearance on each side of pipe or conduit. Excavate trench walls vertically from trench bottom to 12 inches (300 mm) higher than top of pipe or conduit unless otherwise indicated.
- C. Trench Bottoms: Excavate and shape trench bottoms to provide uniform bearing and support of pipes and conduit. Shape subgrade to provide continuous support for bells, joints, and barrels of pipes and for joints, fittings, and bodies of conduits. Remove projecting stones and sharp objects along trench subgrade.
  - 1. For pipes and conduit less than 6 inches (150 mm) in nominal diameter, hand-excavate trench bottoms and support pipe and conduit on an undisturbed subgrade.
  - 2. For pipes and conduit 6 inches (150 mm) or larger in nominal diameter, shape bottom of trench to support bottom 90 degrees of pipe or conduit circumference. Fill depressions with tamped sand backfill.
  - 3. For flat-bottomed, multiple-duct conduit units, hand-excavate trench bottoms and support conduit on an undisturbed subgrade.
  - 4. Excavate trenches 6 inches (150 mm) deeper than elevation required in rock or other unyielding bearing material to allow for bedding course.

### 3.7 SUBGRADE INSPECTION

- A. Notify Engineer when excavations have reached required subgrade.
- B. If Engineer determines that unsatisfactory soil is present, continue excavation and replace with compacted backfill or fill material as directed.
- C. If directed by the Engineer, proof-roll subgrade below the building slabs and pavements with a pneumatic-tired and loaded 10-wheel, tandem-axle dump truck weighing not less than 15 tons to identify soft pockets and areas of excess yielding. Do not proof-roll wet or saturated subgrades.
  - 1. Completely proof-roll subgrade in one direction. Limit vehicle speed to 3 mph (5 km/h).
  - 2. Excavate soft spots, unsatisfactory soils, and areas of excessive pumping or rutting, as determined by Engineer, and replace with compacted backfill or fill as directed.
- D. Reconstruct subgrades damaged by freezing temperatures, frost, rain, accumulated water, or construction activities, as directed by Engineer.

### 3.8 UNAUTHORIZED EXCAVATION

- A. Fill unauthorized excavation under foundations or wall footings by extending bottom elevation of concrete foundation or footing to excavation bottom, without altering top elevation. Lean concrete fill, with 28-day compressive strength of 2500 psi (17.2 MPa), may be used when approved by Engineer.
  - 1. Fill unauthorized excavations under other construction, pipe, or conduit as directed by Engineer.

### 3.9 STORAGE OF SOIL MATERIALS

- A. Stockpile borrow soil materials and excavated satisfactory soil materials without intermixing. Place, grade, and shape stockpiles to drain surface water.
  - 1. Stockpile soil materials away from edge of excavations. Do not store within drip line of remaining trees.

### 3.10 BACKFILL

- A. Place and compact backfill in excavations promptly, but not before completing the following:
  - 1. Construction below finish grade including, where applicable, subdrainage, dampproofing, waterproofing, and perimeter insulation.
  - 2. Surveying locations of underground utilities for Record Documents.
  - 3. Testing and inspecting underground utilities.
  - 4. Removing concrete formwork.
  - 5. Removing trash and debris.
  - 6. Removing temporary shoring and bracing, and sheeting.
  - 7. Installing permanent or temporary horizontal bracing on horizontally supported walls.
- B. Place backfill on subgrades free of mud, frost, snow, or ice.

### 3.11 UTILITY TRENCH BACKFILL

- A. Place backfill on subgrades free of mud, frost, snow, or ice.
- B. Place and compact bedding course on trench bottoms and where indicated. Shape bedding course to provide continuous support for bells, joints, and barrels of pipes and for joints, fittings, and bodies of conduits.
- C. Place and compact initial backfill of satisfactory soil, free of particles larger than 1 inch (25 mm) in any dimension, to a height of 12 inches (300 mm) over the pipe or conduit.
  - 1. Carefully compact initial backfill under pipe haunches and compact evenly up on both sides and along the full length of piping or conduit to avoid damage or displacement of piping or conduit. Coordinate backfilling with utilities testing.
- D. Place and compact final backfill of satisfactory soil to final subgrade elevation.
- E. Install warning tape directly above utilities, 12 inches (300 mm) below finished grade, except 6 inches (150 mm) below subgrade under pavements and slabs.

### 3.12 SOIL FILL

- A. Plow, scarify, bench, or break up sloped surfaces steeper than 1 vertical to 4 horizontal so fill material will bond with existing material.
- B. Place and compact fill material in layers to required elevations as follows:
  - 1. Under grass and planted areas, use satisfactory soil material.
  - 2. Under walks and pavements, use satisfactory soil material.

3. Under steps and ramps, use engineered fill or satisfactory soil material.
4. Under building slabs, use engineered fill or satisfactory soil material.
5. Under footings and foundations, use engineered fill or satisfactory soil materials.

C. Place fill on subgrades free of mud, frost, snow, or ice.

### 3.13 SOIL MOISTURE CONTROL

A. Uniformly moisten or aerate subgrade and each subsequent fill or backfill soil layer before compaction to within 2 percent of optimum moisture content.

1. Do not place backfill or fill soil material on surfaces that are muddy, frozen, or contain frost or ice.
2. Remove and replace, or scarify and air dry, otherwise satisfactory soil material that exceeds optimum moisture content by 2 percent and is too wet to compact to specified dry unit weight.

### 3.14 COMPACTION OF SOIL BACKFILLS AND FILLS

A. Place backfill and fill soil materials in layers not more than 10 inches (200 mm) in loose depth for material compacted by heavy compaction equipment, and not more than 4 inches (100 mm) in loose depth for material compacted by hand-operated tampers.

B. Place backfill and fill soil materials evenly on all sides of structures to required elevations, and uniformly along the full length of each structure.

C. Compact fill materials to not less than the following percentages of maximum dry unit weight according to ASTM D 698:

1. Under structures, foundations, building slabs, steps, and pavements, scarify and recompact top 12 inches (300 mm) of existing approved subgrade and each layer of backfill or fill soil material at 95 percent.
2. Under walkways, scarify and recompact top 6 inches (150 mm) below subgrade and compact each layer of backfill or fill soil material at 95 percent.
3. Under turf or unpaved areas, scarify and recompact top 6 inches (150 mm) below subgrade and compact each layer of backfill or fill soil material at 90 percent.
4. For utility trenches, compact each layer of initial and final backfill soil material at 90 percent.

### 3.15 GRADING

A. General: Uniformly grade areas to a smooth surface, free of irregular surface changes. Comply with compaction requirements and grade to cross sections, lines, and elevations indicated.

1. Provide a smooth transition between adjacent existing grades and new grades.
2. Cut out soft spots, fill low spots, and trim high spots to comply with required surface tolerances.

B. Site Rough Grading: Slope grades to direct water away from buildings and to prevent ponding. Finish subgrades to required elevations within the following tolerances:

1. Turf or Unpaved Areas: Plus or minus 1 inch (25 mm).
2. Walks: Plus or minus 1 inch (25 mm).
3. Pavements: Plus or minus 1/2 inch (13 mm).

- C. Grading inside Building Lines: Finish subgrade to a tolerance of 1/2 inch (13 mm) when tested with a 10-foot (3-m) straightedge.

### 3.16 SUBBASE AND BASE COURSES UNDER PAVEMENTS AND WALKS

- A. Place subbase course on subgrades free of mud, frost, snow, or ice.
- B. On prepared subgrade, place subbase course under pavements and walks as follows:
  - 1. Shape subbase course to required crown elevations and cross-slope grades.
  - 2. Place subbase course 6 inches (150 mm) or less in compacted thickness in a single layer.
  - 3. Place subbase course that exceeds 6 inches (150 mm) in compacted thickness in layers of equal thickness, with no compacted layer more than 6 inches (150 mm) thick or less than 3 inches (75 mm) thick.
  - 4. Compact subbase course at optimum moisture content to required grades, lines, cross sections, and thickness to not less than 95 percent of the maximum dry unit weight according to ASTM D 698.
- C. Pavement Shoulders: Place shoulders along edges of subbase course to prevent lateral movement. Construct shoulders, at least 12 inches (300 mm) wide, of satisfactory soil materials and compact simultaneously with each subbase layer to not less than 95 percent of the maximum dry unit weight according to ASTM D 698.

### 3.17 FIELD QUALITY CONTROL

- A. Special Inspections: Owner will engage a qualified special inspector to perform the following special inspections:
  - 1. Determine prior to placement of fill that site has been prepared in compliance with requirements.
  - 2. Determine that fill material and maximum lift thickness comply with requirements.
  - 3. Determine, at the required frequency, that in-place density of compacted fill complies with requirements.
- B. Testing Agency: Owner will engage a qualified geotechnical engineering testing agency to perform tests and inspections.
- C. Allow testing agency to inspect and test subgrades and each fill or backfill layer. Proceed with subsequent earth moving only after test results for previously completed work comply with requirements.
- D. Testing agency will test compaction of soils in place according to ASTM D 1556, ASTM D 2167, ASTM D 2922, and ASTM D 2937, as applicable. Tests will be performed at the following locations and frequencies:
  - 1. Paved and Building Slab Areas: At subgrade and at each compacted fill and backfill layer, at least one test for every 2000 sq. ft. (186 sq. m) or less of paved area or building slab, but in no case fewer than three tests.
  - 2. Foundation Wall Backfill: At each compacted backfill layer, at least one test for every 25 feet (30 m) or less of wall length, but no fewer than two tests.
  - 3. Trench Backfill: At each compacted initial and final backfill layer, at least one test for every 50 feet (46 m) or less of trench length, but no fewer than two tests.



- E. When testing agency reports that subgrades, fills, or backfills have not achieved degree of compaction specified, scarify and moisten or aerate, or remove and replace soil materials to depth required; recompact and retest until specified compaction is obtained.

### 3.18 PROTECTION

- A. Protecting Graded Areas: Protect newly graded areas from traffic, freezing, and erosion. Keep free of trash and debris.
- B. Repair and reestablish grades to specified tolerances where completed or partially completed surfaces become eroded, rutted, settled, or where they lose compaction due to subsequent construction operations or weather conditions.
  - 1. Scarify or remove and replace soil material to depth as directed by Engineer; reshape and recompact.
- C. Where settling occurs before Project correction period elapses, remove finished surfacing, backfill with additional soil material, compact, and reconstruct surfacing.
  - 1. Restore appearance, quality, and condition of finished surfacing to match adjacent work, and eliminate evidence of restoration to greatest extent possible.

### 3.19 DISPOSAL OF SURPLUS AND WASTE MATERIALS

- A. Remove unsatisfactory soil, trash, and debris, and legally dispose of them off Owner's property.
- B. Stockpile or spread surplus soil as directed by Engineer.
  - 1. Remove waste materials, including unsatisfactory soil, trash, and debris, and legally dispose of them off Owner's property.

END OF SECTION 312011

## SECTION 321313 - CONCRETE PAVING

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Driveways.
  - 2. Roadways.
  - 3. Parking lots.
  - 4. Curbs and gutters.
  - 5. Walks.

#### 1.3 DEFINITIONS

- A. Cementitious Materials: Portland cement alone or in combination with one or more of blended hydraulic cement, fly ash and other pozzolans, and ground granulated blast-furnace slag.

#### 1.4 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Other Action Submittals:
  - 1. Design Mixtures: For each concrete paving mixture. Include alternate design mixtures when characteristics of materials, Project conditions, weather, test results, or other circumstances warrant adjustments.

#### 1.5 PROJECT CONDITIONS

- A. Traffic Control: Maintain access for vehicular and pedestrian traffic as required for other construction activities.
- B. Pavement-Marking Paint: Proceed with pavement marking only on clean, dry surfaces and at a minimum ambient or surface temperature recommended by manufacturer.

### PART 2 - PRODUCTS

#### 2.1 FORMS

- A. Form Materials: Plywood, metal, metal-framed plywood, or other approved panel-type materials to provide full-depth, continuous, straight, and smooth exposed surfaces.
  - 1. Use flexible or uniformly curved forms for curves with a radius of 100 feet (30.5 m) or less. Do not use notched and bent forms.
- B. Form-Release Agent: Commercially formulated form-release agent that will not bond with, stain, or adversely affect concrete surfaces and that will not impair subsequent treatments of concrete surfaces.

## 2.2 STEEL REINFORCEMENT

- A. Plain-Steel Welded Wire Reinforcement: ASTM A 185/A 185M, fabricated from as-drawn steel wire into flat sheets.
- B. Deformed-Steel Welded Wire Reinforcement: ASTM A 497/A 497M, flat sheet.
- C. Epoxy-Coated Welded Wire Reinforcement: ASTM A 884/A 884M, Class A, plain steel.
- D. Reinforcing Bars: ASTM A 615/A 615M, Grade 60 (Grade 420); deformed.
- E. Epoxy-Coated Reinforcing Bars: ASTM A 775/A 775M or ASTM A 934/A 934M; with ASTM A 615/A 615M, Grade 60 (Grade 420) deformed bars.
- F. Steel Bar Mats: ASTM A 184/A 184M; with ASTM A 615/A 615M, Grade 60 (Grade 420), deformed bars; assembled with clips.
- G. Plain-Steel Wire: ASTM A 82/A 82M, [as drawn] [galvanized].
- H. Deformed-Steel Wire: ASTM A 496/A 496M.
- I. Joint Dowel Bars: ASTM A 615/A 615M, Grade 60 (Grade 420) plain-steel bars. Cut bars true to length with ends square and free of burrs.
- J. Tie Bars: ASTM A 615/A 615M, Grade 60 (Grade 420), deformed.
- K. Bar Supports: Bolsters, chairs, spacers, and other devices for spacing, supporting, and fastening reinforcing bars, welded wire reinforcement, and dowels in place. Manufacture bar supports according to CRSI's "Manual of Standard Practice" from steel wire, plastic, or precast concrete of greater compressive strength than concrete specified, and as follows:
  - 1. Equip wire bar supports with sand plates or horizontal runners where base material will not support chair legs.
  - 2. For epoxy-coated reinforcement, use epoxy-coated or other dielectric-polymer-coated wire bar supports.

## 2.3 CONCRETE MATERIALS

- A. Cementitious Material: Use the following cementitious materials, of same type, brand, and source throughout Project:
- B. Normal-Weight Aggregates: ASTM C 33, uniformly graded. Provide aggregates from a single source.
  - 1. Maximum Coarse-Aggregate Size: 3/4 inch (19 mm) nominal.

2. Fine Aggregate: Free of materials with deleterious reactivity to alkali in cement.
- C. Water: Potable and complying with ASTM C 94/C 94M.
  - D. Air-Entraining Admixture: ASTM C 260.
  - E. Chemical Admixtures: Admixtures certified by manufacturer to be compatible with other admixtures and to contain not more than 0.1 percent water-soluble chloride ions by mass of cementitious material.
    1. Water-Reducing Admixture: ASTM C 494/C 494M, Type A.
    2. Retarding Admixture: ASTM C 494/C 494M, Type B.
    3. Water-Reducing and Retarding Admixture: ASTM C 494/C 494M, Type D.
    4. High-Range, Water-Reducing Admixture: ASTM C 494/C 494M, Type F.
    5. High-Range, Water-Reducing and Retarding Admixture: ASTM C 494/C 494M, Type G.
    6. Plasticizing and Retarding Admixture: ASTM C 1017/C 1017M, Type II.

## 2.4 CURING MATERIALS

- A. Absorptive Cover: AASHTO M 182, burlap cloth made from jute or kenaf, weighing approximately 9 oz./sq. yd. (305 g/sq. m) dry.
- B. Moisture-Retaining Cover: ASTM C 171, polyethylene film or white burlap-polyethylene sheet.
- C. Water: Potable.
- D. Evaporation Retarder: Waterborne, monomolecular, film forming, manufactured for application to fresh concrete.
  1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
    - a. Axim Italcementi Group, Inc.; Caltexol CIMFILM.
    - b. BASF Construction Chemicals, LLC; Confilm.
    - c. ChemMasters; Spray-Film.
    - d. Conspec by Dayton Superior; Aquafilm.
    - e. Dayton Superior Corporation; Sure Film (J-74).
    - f. Edoco by Dayton Superior; BurkeFilm.
    - g. Euclid Chemical Company (The), an RPM company; Eucobar.
    - h. Kaufman Products, Inc.; VaporAid.
    - i. Lambert Corporation; LAMBCO Skin.
    - j. L&M Construction Chemicals, Inc.; E-CON.
    - k. Meadows, W. R., Inc.; EVAPRE.
    - l. Metalcrete Industries; Waterhold.
    - m. Nox-Crete Products Group; MONOFILM.
    - n. Sika Corporation, Inc.; SikaFilm.
    - o. SpecChem, LLC; Spec Film.
    - p. Symons by Dayton Superior; Finishing Aid.
    - q. TK Products, Division of Sierra Corporation; TK-2120 TRI-FILM.
    - r. Unitex; PRO-FILM.
    - s. Vexcon Chemicals Inc.; Certi-Vex EnvioAssist.
    - t. or approved equal.
- E. Clear, Waterborne, Membrane-Forming Curing Compound: ASTM C 309, Type 1, Class B, dissipating.

1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
  - a. Anti-Hydro International, Inc.; A-H Curing Compound #2 DR WB.
  - b. ChemMasters; Safe-Cure Clear.
  - c. Conspec by Dayton Superior; D.O.T. Resin Cure..
  - d. Dayton Superior Corporation; Day-Chem Rez Cure (J-11-W).
  - e. Euclid Chemical Company (The), an RPM company; Kurez W VOX.
  - f. Kaufman Products, Inc.; Thinfilm 420.
  - g. Lambert Corporation; AQUA KURE - CLEAR.
  - h. L&M Construction Chemicals, Inc.; L&M CURE R.
  - i. Meadows, W. R., Inc.; 1100-CLEAR SERIES.
  - j. Nox-Crete Products Group; Resin Cure E.
  - k. SpecChem, LLC; PaveCure Rez.
  - l. Symons by Dayton Superior; Resi-Chem Clear.
  - m. Tamms Industries, Inc., Euclid Chemical Company (The); TAMMSCURE WB 30C.
  - n. Vexcon Chemicals Inc.; Certi-Vex Enviocure 100.
  - o. or approved equal.

## 2.5 RELATED MATERIALS

- A. Joint Fillers: ASTM D 1751, asphalt-saturated cellulosic fiber in preformed strips.

## 2.6 PAVEMENT MARKINGS

- A. Pavement-Marking Paint: Alkyd-resin type, lead and chromate free, ready mixed, complying with AASHTO M 248, Type N; colors complying with FS TT-P-1952.

1. Color: As indicated.

## 2.7 WHEEL STOPS

- A. Wheel Stops: Precast, air-entrained concrete, 2500-psi (17.2-MPa) minimum compressive strength, 7 1/2 inches (115 mm) high by 8 inches (225 mm) wide by 72 inches (1820 mm) long. Provide chamfered corners and drainage slots on underside and holes for anchoring to substrate.

1. Dowels: Galvanized steel, 3/4 inch (19 mm) in diameter, 10-inch (254-mm) minimum length.

- B. Wheel Stops: Solid, integrally colored, plastic; UV stabilized; 4 inches (100 mm) high by 6 inches (150 mm) wide by 72 inches (1820 mm) long. Provide chamfered corners and drainage slots on underside and holes for anchoring to substrate.

1. Color: Gray for standard spaces or Blue for handicap accessible spaces.
2. Dowels: Galvanized steel, 3/4 inch (19 mm) in diameter, 10-inch (254-mm) minimum length.
3. Adhesive: As recommended by wheel stop manufacturer for application to concrete pavement.

## 2.8 CONCRETE MIXTURES

- A. Prepare design mixtures, proportioned according to ACI 301 (ACI 301M), for each type and strength of normal-weight concrete, and as determined by either laboratory trial mixtures or field experience.

- B. Proportion mixtures to provide normal-weight concrete with the following properties:
  - 1. Compressive Strength (28 Days): 4000 psi (27.6 MPa).
  - 2. Maximum Water-Cementitious Materials Ratio at Point of Placement: 0.45.
  - 3. Slump Limit: 5 inches (125 mm), plus or minus 1 inch (25 mm).
- C. Add air-entraining admixture at manufacturer's prescribed rate to result in normal-weight concrete at point of placement having an air content as follows:
  - 1. Air Content: 4-1/2 percent plus or minus 1.5 percent for 1-1/2-inch (38-mm) nominal maximum aggregate size.
  - 2. Air Content: 4-1/2 percent plus or minus 1.5 percent for 1-inch (25-mm) nominal maximum aggregate size.
  - 3. Air Content: 5 percent plus or minus 1.5 percent for 3/4-inch (19-mm) nominal maximum aggregate size.
- D. Limit water-soluble, chloride-ion content in hardened concrete to 0.15 percent by weight of cement.
- E. Chemical Admixtures: Use admixtures according to manufacturer's written instructions.
  - 1. Use water-reducing and retarding admixture when required by high temperatures, low humidity, or other adverse placement conditions.

## 2.9 CONCRETE MIXING

- A. Ready-Mixed Concrete: Measure, batch, and mix concrete materials and concrete according to ASTM C 94/C 94M. Furnish batch certificates for each batch discharged and used in the Work.
  - 1. When air temperature is between 85 and 90 deg F (30 and 32 deg C), reduce mixing and delivery time from 1-1/2 hours to 75 minutes; when air temperature is above 90 deg F (32 deg C), reduce mixing and delivery time to 60 minutes.
- B. Project-Site Mixing: Measure, batch, and mix concrete materials and concrete according to ASTM C 94/C 94M. Mix concrete materials in appropriate drum-type batch machine mixer.
  - 1. For concrete batches of 1 cu. yd. (0.76 cu. m) or smaller, continue mixing at least 1-1/2 minutes, but not more than 5 minutes after ingredients are in mixer, before any part of batch is released.
  - 2. For concrete batches larger than 1 cu. yd. (0.76 cu. m), increase mixing time by 15 seconds for each additional 1 cu. yd. (0.76 cu. m).
  - 3. Provide batch ticket for each batch discharged and used in the Work, indicating Project identification name and number, date, mixture type, mixing time, quantity, and amount of water added.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine exposed subgrades and subbase surfaces for compliance with requirements for dimensional, grading, and elevation tolerances.
- B. Proof-roll prepared subbase surface below concrete paving to identify soft pockets and areas of excess yielding.

1. Completely proof-roll subbase in one direction. Limit vehicle speed to 3 mph (5 km/h).
2. Proof-roll with a pneumatic-tired and loaded, 10-wheel, tandem-axle dump truck weighing not less than 15 tons (13.6 tonnes).
3. Correct subbase with soft spots and areas of pumping or rutting.

C. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 PREPARATION

A. Remove loose material from compacted subbase surface immediately before placing concrete.

### 3.3 EDGE FORMS AND SCREED CONSTRUCTION

A. Set, brace, and secure edge forms, bulkheads, and intermediate screed guides to required lines, grades, and elevations. Install forms to allow continuous progress of work and so forms can remain in place at least 24 hours after concrete placement.

B. Clean forms after each use and coat with form-release agent to ensure separation from concrete without damage.

### 3.4 STEEL REINFORCEMENT

A. General: Comply with CRSI's "Manual of Standard Practice" for fabricating, placing, and supporting reinforcement.

B. Clean reinforcement of loose rust and mill scale, earth, ice, or other bond-reducing materials.

C. Arrange, space, and securely tie bars and bar supports to hold reinforcement in position during concrete placement. Maintain minimum cover to reinforcement.

D. Install welded wire reinforcement in lengths as long as practicable. Lap adjoining pieces at least one full mesh, and lace splices with wire. Offset laps of adjoining widths to prevent continuous laps in either direction.

E. Zinc-Coated Reinforcement: Use galvanized-steel wire ties to fasten zinc-coated reinforcement. Repair cut and damaged zinc coatings with zinc repair material.

F. Epoxy-Coated Reinforcement: Use epoxy-coated steel wire ties to fasten epoxy-coated reinforcement. Repair cut and damaged epoxy coatings with epoxy repair coating according to ASTM D 3963/D 3963M.

G. Install fabricated bar mats in lengths as long as practicable. Handle units to keep them flat and free of distortions. Straighten bends, kinks, and other irregularities, or replace units as required before placement. Set mats for a minimum 2-inch (50-mm) overlap of adjacent mats.

### 3.5 JOINTS

A. General: Form construction, isolation, and contraction joints and tool edges true to line, with faces perpendicular to surface plane of concrete. Construct transverse joints at right angles to centerline unless otherwise indicated.

1. When joining existing paving, place transverse joints to align with previously placed joints unless otherwise indicated.
- B. Construction Joints: Set construction joints at side and end terminations of paving and at locations where paving operations are stopped for more than one-half hour unless paving terminates at isolation joints.
1. Continue steel reinforcement across construction joints unless otherwise indicated. Do not continue reinforcement through sides of paving strips unless otherwise indicated.
  2. Provide tie bars at sides of paving strips where indicated.
  3. Keyed Joints: Provide preformed keyway-section forms or bulkhead forms with keys unless otherwise indicated. Embed keys at least 1-1/2 inches (38 mm) into concrete.
  4. Doweled Joints: Install dowel bars and support assemblies at joints where indicated. Lubricate or coat with asphalt one-half of dowel length to prevent concrete bonding to one side of joint.
- C. Isolation Joints: Form isolation joints of preformed joint-filler strips abutting concrete curbs, catch basins, manholes, inlets, structures, other fixed objects, and where indicated.
1. Locate expansion joints at intervals of 50 feet (15.25 m) unless otherwise indicated.
  2. Extend joint fillers full width and depth of joint.
  3. Terminate joint filler not less than 1/2 inch (13 mm) or more than 1 inch (25 mm) below finished surface if joint sealant is indicated.
  4. Place top of joint filler flush with finished concrete surface if joint sealant is not indicated.
  5. Furnish joint fillers in one-piece lengths. Where more than one length is required, lace or clip joint-filler sections together.
  6. During concrete placement, protect top edge of joint filler with metal, plastic, or other temporary preformed cap. Remove protective cap after concrete has been placed on both sides of joint.
- D. Contraction Joints: Form weakened-plane contraction joints, sectioning concrete into areas as indicated. Construct contraction joints for a depth equal to at least one-fourth of the concrete thickness, as follows:
1. Grooved Joints: Form contraction joints after initial floating by grooving and finishing each edge of joint with grooving tool to a 3/8-inch (10-mm) radius. Repeat grooving of contraction joints after applying surface finishes.
    - a. Tolerance: Ensure that grooved joints are within 3 inches (75 mm) either way from centers of dowels.
  2. Sawed Joints: Form contraction joints with power saws equipped with shatterproof abrasive or diamond-rimmed blades. Cut 1/8-inch- (3-mm-) wide joints into concrete when cutting action will not tear, abrade, or otherwise damage surface and before developing random contraction cracks.
    - a. Tolerance: Ensure that sawed joints are within 3 inches (75 mm) either way from centers of dowels.
  3. Doweled Contraction Joints: Install dowel bars and support assemblies at joints where indicated. Lubricate or coat with asphalt one-half of dowel length to prevent concrete bonding to one side of joint.
- E. Edging: After initial floating, tool edges of paving, gutters, curbs, and joints in concrete with an edging tool to a 3/8-inch (10-mm) radius. Repeat tooling of edges after applying surface finishes.

### 3.6 CONCRETE PLACEMENT



- A. Before placing concrete, inspect and complete formwork installation, steel reinforcement, and items to be embedded or cast-in.
- B. Remove snow, ice, or frost from subbase surface and steel reinforcement before placing concrete. Do not place concrete on frozen surfaces.
- C. Moisten subbase to provide a uniform dampened condition at time concrete is placed. Do not place concrete around manholes or other structures until they are at required finish elevation and alignment.
- D. Comply with ACI 301 (ACI 301M) requirements for measuring, mixing, transporting, and placing concrete.
- E. Do not add water to concrete during delivery or at Project site. Do not add water to fresh concrete after testing.
- F. Deposit and spread concrete in a continuous operation between transverse joints. Do not push or drag concrete into place or use vibrators to move concrete into place.
- G. Consolidate concrete according to ACI 301 (ACI 301M) by mechanical vibrating equipment supplemented by hand spading, rodding, or tamping.
  - 1. Consolidate concrete along face of forms and adjacent to transverse joints with an internal vibrator. Keep vibrator away from joint assemblies, reinforcement, or side forms. Use only square-faced shovels for hand spreading and consolidation. Consolidate with care to prevent dislocating reinforcement and joint devices.
- H. Screed paving surface with a straightedge and strike off.
- I. Commence initial floating using bull floats or darbies to impart an open-textured and uniform surface plane before excess moisture or bleed water appears on the surface. Do not further disturb concrete surfaces before beginning finishing operations or spreading surface treatments.
- J. Curbs and Gutters: Use design mixture for automatic machine placement. Produce curbs and gutters to required cross section, lines, grades, finish, and jointing.
- K. Slip-Form Paving: Use design mixture for automatic machine placement. Produce paving to required thickness, lines, grades, finish, and jointing.
  - 1. Compact subbase and prepare subgrade of sufficient width to prevent displacement of slip-form paving machine during operations.
- L. Cold-Weather Placement: Protect concrete work from physical damage or reduced strength that could be caused by frost, freezing, or low temperatures. Comply with ACI 306.1 and the following:
  - 1. When air temperature has fallen to or is expected to fall below 40 deg F (4.4 deg C), uniformly heat water and aggregates before mixing to obtain a concrete mixture temperature of not less than 50 deg F (10 deg C) and not more than 80 deg F (27 deg C) at point of placement.
  - 2. Do not use frozen materials or materials containing ice or snow.
  - 3. Do not use calcium chloride, salt, or other materials containing antifreeze agents or chemical accelerators unless otherwise specified and approved in design mixtures.
- M. Hot-Weather Placement: Comply with ACI 301 (ACI 301M) and as follows when hot-weather conditions exist:

1. Cool ingredients before mixing to maintain concrete temperature below 90 deg F (32 deg C) at time of placement. Chilled mixing water or chopped ice may be used to control temperature, provided water equivalent of ice is calculated in total amount of mixing water. Using liquid nitrogen to cool concrete is Contractor's option.
2. Cover steel reinforcement with water-soaked burlap so steel temperature will not exceed ambient air temperature immediately before embedding in concrete.
3. Fog-spray forms, steel reinforcement, and subgrade just before placing concrete. Keep subgrade moisture uniform without standing water, soft spots, or dry areas.

### 3.7 FLOAT FINISHING

- A. General: Do not add water to concrete surfaces during finishing operations.
- B. Float Finish: Begin the second floating operation when bleed-water sheen has disappeared and concrete surface has stiffened sufficiently to permit operations. Float surface with power-driven floats or by hand floating if area is small or inaccessible to power units. Finish surfaces to true planes. Cut down high spots and fill low spots. Refloat surface immediately to uniform granular texture.
  1. Burlap Finish: Drag a seamless strip of damp burlap across float-finished concrete, perpendicular to line of traffic, to provide a uniform, gritty texture.
  2. Medium-to-Fine-Textured Broom Finish: Draw a soft-bristle broom across float-finished concrete surface perpendicular to line of traffic to provide a uniform, fine-line texture.
  3. Medium-to-Coarse-Textured Broom Finish: Provide a coarse finish by striating float-finished concrete surface 1/16 to 1/8 inch (1.6 to 3 mm) deep with a stiff-bristled broom, perpendicular to line of traffic.

### 3.8 CONCRETE PROTECTION AND CURING

- A. General: Protect freshly placed concrete from premature drying and excessive cold or hot temperatures.
- B. Comply with ACI 306.1 for cold-weather protection.
- C. Evaporation Retarder: Apply evaporation retarder to concrete surfaces if hot, dry, or windy conditions cause moisture loss approaching 0.2 lb/sq. ft. x h (1 kg/sq. m x h) before and during finishing operations. Apply according to manufacturer's written instructions after placing, screeding, and bull floating or darbying concrete but before float finishing.
- D. Begin curing after finishing concrete but not before free water has disappeared from concrete surface.
- E. Curing Methods: Cure concrete by moisture curing, moisture-retaining-cover curing, curing compound or a combination of these as follows:
  1. Moisture Curing: Keep surfaces continuously moist for not less than seven days with the following materials:
    - a. Water.
    - b. Continuous water-fog spray.
    - c. Absorptive cover, water saturated and kept continuously wet. Cover concrete surfaces and edges with 12-inch (300-mm) lap over adjacent absorptive covers.
  2. Moisture-Retaining-Cover Curing: Cover concrete surfaces with moisture-retaining cover, placed in widest practicable width, with sides and ends lapped at least 12 inches (300 mm) and sealed by

waterproof tape or adhesive. Immediately repair any holes or tears occurring during installation or curing period using cover material and waterproof tape.

3. Curing Compound: Apply uniformly in continuous operation by power spray or roller according to manufacturer's written instructions. Recoat areas that have been subjected to heavy rainfall within three hours after initial application. Maintain continuity of coating, and repair damage during curing period.

### 3.9 PAVING TOLERANCES

A. Comply with tolerances in ACI 117 and as follows:

1. Elevation: 3/4 inch (19 mm).
2. Thickness: Plus 3/8 inch (10 mm), minus 1/4 inch (6 mm).
3. Surface: Gap below 10-foot- (3-m-) long, unlevelled straightedge not to exceed 1/2 inch (13 mm).
4. Alignment of Tie-Bar End Relative to Line Perpendicular to Paving Edge: 1/2 inch per 12 inches (13 mm per 300 mm) of tie bar.
5. Lateral Alignment and Spacing of Dowels: 1 inch (25 mm).
6. Vertical Alignment of Dowels: 1/4 inch (6 mm).
7. Alignment of Dowel-Bar End Relative to Line Perpendicular to Paving Edge: 1/4 inch per 12 inches (6 mm per 300 mm) of dowel.
8. Joint Spacing: 3 inches (75 mm).
9. Contraction Joint Depth: Plus 1/4 inch (6 mm), no minus.
10. Joint Width: Plus 1/8 inch (3 mm), no minus.

### 3.10 PAVEMENT MARKING

- A. Do not apply pavement-marking paint until layout, colors, and placement have been verified with Engineer.
- B. Allow concrete paving to cure for a minimum of 28 days and be dry before starting pavement marking.
- C. Sweep and clean surface to eliminate loose material and dust.
- D. Apply paint with mechanical equipment to produce markings of dimensions indicated with uniform, straight edges. Apply at manufacturer's recommended rates to provide a minimum wet film thickness of 15 mils (0.4 mm).
  1. Apply graphic symbols and lettering with paint-resistant, die-cut stencils, firmly secured to concrete surface. Mask an extended area beyond edges of each stencil to prevent paint application beyond stencil. Apply paint so that it cannot run beneath stencil.
  2. Broadcast glass beads uniformly into wet markings at a rate of 6 lb/gal. (0.72 kg/L).

### 3.11 WHEEL STOPS

- A. Install wheel stops in bed of adhesive applied as recommended by manufacturer.
- B. Securely attach wheel stops to paving with not less than two steel dowels located at one-quarter to one-third points. Install dowels in drilled holes in the paving and bond dowels to wheel stop. Recess head of dowel beneath top of wheel stop.

### 3.12 FIELD QUALITY CONTROL

- A. Testing Agency: Owner will engage a qualified testing agency to perform tests and inspections.
- B. Testing Services: Testing of composite samples of fresh concrete obtained according to ASTM C 172 shall be performed according to the following requirements:
  - 1. Testing Frequency: Obtain at least one composite sample for each 50 cu. yd. or fraction thereof of each concrete mixture placed each day.
    - a. When frequency of testing will provide fewer than five compressive-strength tests for each concrete mixture, testing shall be conducted from at least five randomly selected batches or from each batch if fewer than five are used.
  - 2. Slump: ASTM C 143/C 143M; one test at point of placement for each composite sample, but not less than one test for each day's pour of each concrete mixture. Perform additional tests when concrete consistency appears to change.
  - 3. Air Content: ASTM C 231, pressure method; one test for each composite sample, but not less than one test for each day's pour of each concrete mixture.
  - 4. Concrete Temperature: ASTM C 1064/C 1064M; one test hourly when air temperature is 40 deg F (4.4 deg C) and below and when it is 80 deg F (27 deg C) and above, and one test for each composite sample.
  - 5. Compression Test Specimens: ASTM C 31/C 31M; cast and laboratory cure one set of four standard cylinder specimens for each composite sample.
  - 6. Compressive-Strength Tests: ASTM C 39/C 39M; test one specimen at seven days and two specimens at 28 days.
    - a. A compressive-strength test shall be the average compressive strength from two specimens obtained from same composite sample and tested at 28 days.
- C. Strength of each concrete mixture will be satisfactory if average of any three consecutive compressive-strength tests equals or exceeds specified compressive strength and no compressive-strength test value falls below specified compressive strength by more than 500 psi (3.4 MPa).
- D. Test results shall be reported in writing to Engineer, concrete manufacturer, and Contractor within 48 hours of testing. Reports of compressive-strength tests shall contain Project identification name and number, date of concrete placement, name of concrete testing and inspecting agency, location of concrete batch in Work, design compressive strength at 28 days, concrete mixture proportions and materials, compressive breaking strength, and type of break for both 7- and 28-day tests.
- E. Nondestructive Testing: Impact hammer, sonoscope, or other nondestructive device may be permitted by Engineer but will not be used as sole basis for approval or rejection of concrete.
- F. Additional Tests: Testing and inspecting agency shall make additional tests of concrete when test results indicate that slump, air entrainment, compressive strengths, or other requirements have not been met, as directed by Engineer.
- G. Concrete paving will be considered defective if it does not pass tests and inspections.
- H. Additional testing and inspecting, at Contractor's expense, will be performed to determine compliance of replaced or additional work with specified requirements.
- I. Prepare test and inspection reports.

### 3.13 REPAIRS AND PROTECTION

- A. Remove and replace concrete paving that is broken, damaged, or defective or that does not comply with requirements in this Section. Remove work in complete sections from joint to joint unless otherwise approved by Engineer.
- B. Drill test cores, where directed by Engineer, when necessary to determine magnitude of cracks or defective areas. Fill drilled core holes in satisfactory paving areas with portland cement concrete bonded to paving with epoxy adhesive.
- C. Protect concrete paving from damage. Exclude traffic from paving for at least 14 days after placement. When construction traffic is permitted, maintain paving as clean as possible by removing surface stains and spillage of materials as they occur.
- D. Maintain concrete paving free of stains, discoloration, dirt, and other foreign material. Sweep paving not more than two days before date scheduled for Substantial Completion inspections.

END OF SECTION 321313

## SECTION 321373 - CONCRETE PAVING JOINT SEALANTS

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. This Section includes the following:
  - 1. Expansion and contraction joints within cement concrete pavement.
  - 2. Joints between cement concrete and asphalt pavement.

#### 1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Samples: For each type and color of joint sealant required.
- C. Product certificates.
- D. Compatibility and Adhesion Test Reports: From sealant manufacturer.

#### 1.3 QUALITY ASSURANCE

- A. Preconstruction Compatibility and Adhesion Testing: Submit samples of materials that will contact or affect joint sealants to joint-sealant manufacturers for testing according to manufacturer's standard test method to determine whether priming and other specific joint preparation techniques are required to obtain rapid, optimum adhesion of joint sealants to joint substrates.

### PART 2 - PRODUCTS

#### 2.1 MANUFACTURERS

- A. Available Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to, products listed in other Part 2 articles.
- B. Products: Subject to compliance with requirements, provide one of the products listed in other Part 2 articles.

#### 2.2 MATERIALS, GENERAL

- A. Compatibility: Provide joint sealants, backing materials, and other related materials that are compatible with one another and with joint substrates under conditions of service and application, as demonstrated by joint-sealant manufacturer based on testing and field experience.

1. Primers: Product recommended by joint-sealant manufacturer where required for adhesion of sealant to joint substrates indicated, as determined from preconstruction joint-sealant-substrate tests and field tests.
- B. Colors of Exposed Joint Sealants shall match existing joint on previously constructed areas.

### 2.3 COLD-APPLIED JOINT SEALANTS

- A. Multicomponent Jet-Fuel-Resistant Sealant for Concrete: Pourable, chemically curing elastomeric formulation complying with the following requirements for formulation and with ASTM C 920 for type, grade, class, and uses indicated:
1. Urethane Formulation: Type M; Grade P; Class 12-1/2; Uses T, M, and, as applicable to joint substrates indicated, O.
  2. Coal-Tar-Modified Polymer Formulation: Type M; Grade P; Class 25; Uses T and, as applicable to joint substrates indicated, O.
  3. Bitumen-Modified Urethane Formulation: Type M; Grade P; Class 25; Uses T, M, and, as applicable to joint substrates indicated, O.
- B. Single-Component Jet-Fuel-Resistant Urethane Sealant for Concrete: Single-component, pourable, coal-tar-modified, urethane formulation complying with ASTM C 920 for Type S; Grade P; Class 25; Uses T, M, and, as applicable to joint substrates indicated, O.
- C. Type NS Silicone Sealant for Concrete: Single-component, low-modulus, neutral-curing, nonsag silicone sealant complying with ASTM D 5893 for Type NS.
- D. Type SL Silicone Sealant for Concrete and Asphalt: Single-component, low-modulus, neutral-curing, self-leveling silicone sealant complying with ASTM D 5893 for Type SL.
- E. Multicomponent Low-Modulus Sealant for Concrete and Asphalt: Proprietary formulation consisting of reactive petropolymer and activator components producing a pourable, self-leveling sealant.
- F. Jet-Fuel-Resistant Elastomeric Sealant for Concrete: Single-component formulation complying with ASTM D 3569.
- G. Jet-Fuel-Resistant Sealant for Concrete and Tar Concrete: Single-component formulation complying with ASTM D 3581.
- H. Elastomeric Sealant for Concrete: Single-component formulation complying with ASTM D 3406.
- I. Sealant for Concrete and Asphalt: Single-component formulation complying with ASTM D 3405.

### 2.4 JOINT-SEALANT BACKER MATERIALS

- A. General: Provide joint-sealant backer materials that are nonstaining; are compatible with joint substrates, sealants, primers, and other joint fillers; and are approved for applications indicated by joint-sealant manufacturer based on field experience and laboratory testing.

- B. Round Backer Rods for Cold- and Hot-Applied Sealants: ASTM D 5249, Type 1, of diameter and density required to control sealant depth and prevent bottom-side adhesion of sealant.
- C. Backer Strips for Cold- and Hot-Applied Sealants: ASTM D 5249; Type 2; of thickness and width required to control sealant depth, prevent bottom-side adhesion of sealant, and fill remainder of joint opening under sealant.
- D. Round Backer Rods for Cold-Applied Sealants: ASTM D 5249, Type 3, of diameter and density required to control sealant depth and prevent bottom-side adhesion of sealant.

## PART 3 - EXECUTION

### 3.1 INSTALLATION

- A. Surface Cleaning of Joints: Clean out joints immediately before installing joint sealants to comply with joint-sealant manufacturer's written instructions.
- B. Joint Priming: Prime joint substrates where indicated or where recommended in writing by joint-sealant manufacturer, based on preconstruction joint-sealant-substrate tests or prior experience.
- C. Sealant Installation Standard: Comply with recommendations in ASTM C 1193 for use of joint sealants as applicable to materials, applications, and conditions indicated.
- D. Install backer materials to support sealants during application and at position required to produce optimum sealant movement capability. Do not leave gaps between ends of backer materials. Do not stretch, twist, puncture, or tear backer materials. Remove absorbent backer materials that have become wet before sealant application and replace them with dry materials.
- E. Install sealants at the same time backings are installed to completely fill recesses provided for each joint configuration and to produce uniform, cross-sectional shapes and depths relative to joint widths that allow optimum sealant movement capability.
- F. Tooling of Nonsag Sealants: Immediately after sealant application and before skinning or curing begins, tool sealants to form smooth, uniform beads of configuration indicated; to eliminate air pockets; and to ensure contact and adhesion of sealant with sides of joint.
- G. Clean off excess sealants or sealant smears adjacent to joints as the Work progresses by methods and with cleaning materials approved by manufacturers of joint sealants and of products in which joints occur.

END OF SECTION 321373



## SECTION 329200 – TURF AND GRASSES

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. This section includes requirements for lawns.

#### 1.2 Related Sections:

- A. Division 31 Section “ Site Clearing” for protection of existing trees and plating, topsoil stripping and stockpiling, and site clearing.
- B. Division 31 Section “ Earthwork” for excavation, filling, rough and finish grading, and subsurface aggregate drainage and drainage backfill.
- C. Maintenance: Water, fertilize, weed, mow, trim, and establish lawns. Replant nonuniform, bare, or eroded grassed areas and remulch. Maintain for not less than 60 days.

### PART 2 - PRODUCTS

#### 2.1 GRASSES

- A. Grass Seed: Fresh, clean, dry, new-crop seed complying with the Association of Official Seed Analysts' "Rules for Testing Seeds" for purity and germination tolerances.
  - 1. Seed Mixture: 80% Kentucky 31 Fescue and 20% Perennial Rye.

#### 2.2 SOILS AND AMENDMENTS

- A. Topsoil: ASTM D 5268, free of stones 1 inch or larger.
- B. Lime: ASTM C 602, Class T, agricultural limestone.
- C. Peat Humus: Finely divided or granular texture, with a pH range of 6 to 7.5, consisting of partially decomposed moss peat (other than sphagnum), peat humus, or reed-sedge peat.
- D. Sawdust or Ground-Bark Humus: Decomposed, nitrogen treated, of uniform texture, free of foreign objects and toxic materials.
- E. Bonemeal: Commercial, raw, finely ground; minimum of 4 percent nitrogen and 20 percent phosphoric acid.
- F. Superphosphate: Commercial, phosphate mixture, soluble; minimum of 20 percent available phosphoric acid.
- G. Commercial Fertilizer: Commercial-grade complete fertilizer, consisting of 1 lb/1000 sq. ft. of actual nitrogen, 4 percent phosphorous, and 2 percent potassium, by weight.
- H. Slow-Release Fertilizer: Granular fertilizer consisting of 50 percent water-insoluble nitrogen, phosphorus, and potassium; 5 percent nitrogen; 10 percent phosphorous; and 5 percent potassium; by weight.
- I. Straw Mulch: Clean, mildew- and seed-free salt hay or threshed straw.
- J. Peat Mulch: Peat moss in natural, shredded, or granulated form, of fine texture, with a pH range of 4 to 6.

## PART 3 - EXECUTION

### 3.1 PREPARATION

- A. Examine areas to receive landscaping for compliance with requirements and for conditions affecting performance of work of this section. Do not proceed with installation until unsatisfactory conditions have been corrected.
- B. Planting Soil: Mix soil amendments and fertilizers with clean topsoil.
- C. Loosen subgrade to a minimum depth of 4 inches, remove stones, sticks, and other extraneous materials. Spread planting soil mixture in two layers to thickness, grades, and elevations shown. Topsoil thickness to be 4 inches minimum
- D. Grade lawn areas to a smooth, even surface with loose, uniformly fine texture. Roll and rake, remove ridges, and fill depressions to meet finish grades. Limit grading to areas that can be planted in the immediate future. Remove trash, debris, and stones. Moisten before planting. Allow surface to dry before planting. Do not create muddy soil.

### 3.2 PLANTING

- A. Seeding Lawns: Evenly distribute seed by sowing with a spreader or a seeding machine. Rake seed lightly into top 1/8 inch of topsoil, roll lightly, and water with fine spray. Protect seeded areas by spreading straw mulch at rate of 2 tons/acre and anchor by crimping into topsoil.
  - 1. Seeding Rate: 3 to 4 lb/1000 sq. ft..
- B. Disposal: Remove waste material, including, unsuitable soil, trash, and debris, and legally dispose of it off Owner's property.
  - 1. Dispose of surplus suitable subgrade soil and topsoil on owner's property as directed.

### 3.3 RECONDITIONING LAWNS

- A. Recondition existing lawn areas damaged by Contractor's operations, including storage of materials or equipment and movement of vehicles. Also recondition lawn areas where settlement or washouts occur or where minor regrading is required.
- B. Remove sod and vegetation from diseased or unsatisfactory lawn areas; do not bury into soil. Remove topsoil containing foreign materials resulting from Contractor's operations, including oil drippings, fuel spills, stone, gravel, and other construction materials, and replace with new topsoil.
- C. Remove waste and foreign materials, including weeds, soil cores, grass, vegetation, and turf, and legally dispose of it off the Owner's property.
- D. Apply required soil amendments and initial fertilizers and mix thoroughly into top 4 inches of soil. Provide new planting soil as required to fill low spots and meet new finish grades.
- E. Apply seed and protect with straw mulch as required for new lawns. Water newly planted areas and keep moist until new grass is established.

### 3.4 CLEANUP AND PROTECTION

- A. During landscaping, keep pavements clean and work area in an orderly condition.
- B. Protect landscaping from damage due to landscape operations, operation by other contractors and trades, and trespassers. Maintain protection during installation and maintenance periods. Treat, repair, or replace damaged landscape work as directed.

END OF SECTION 32 92 00