


CONNECT CAMP CLARK SEWER SYSTEM TO CITY OF NEVADA SEWER SYSTEM CAMP CLARK TRAINING SITE NEVADA, MISSOURI



ALLGEIER, MARTIN and ASSOCIATES, INC.

OWNER: STATE OF MISSOURI
MICHAEL L. PARSON,
GOVERNOR
DEPARTMENT OF
MISSOURI NATIONAL GUARD

PROJECT
MANAGEMENT: OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES MANAGEMENT,
DESIGN AND CONSTRUCTION

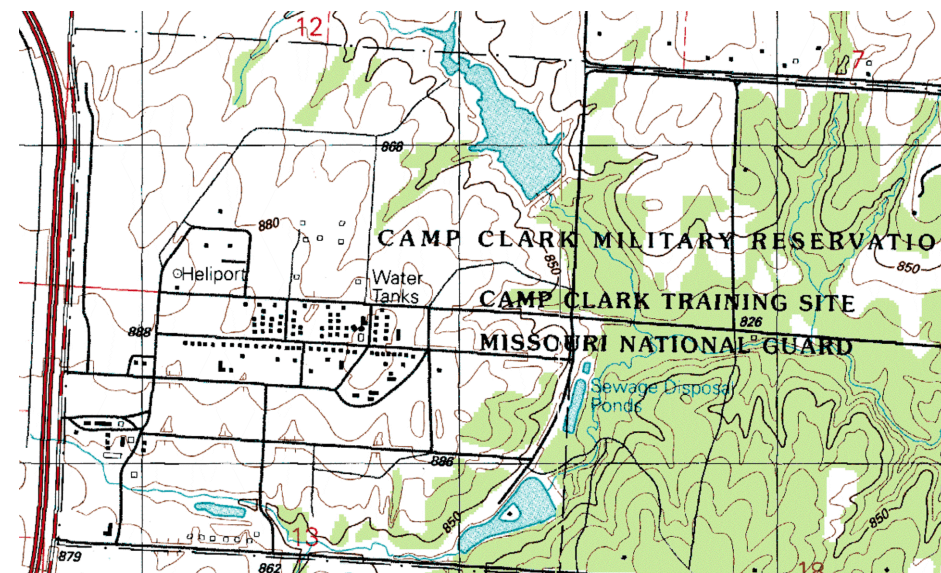

DESIGNER: Allgeier Martin & Associates
7231 East 24th Street Joplin, Missouri 64804
(417) 680-7200

PROJECT NUMBER: T2301-02

SITE NUMBER: 6274
ASSET NUMBER: 8136274075




PROJECT ADDRESS:
18159 EE HIGHWAY
NEVADA, MO 64772

SHEET NUMBER:

G-001

1 OF 23 SHEETS
JUNE 14, 2024

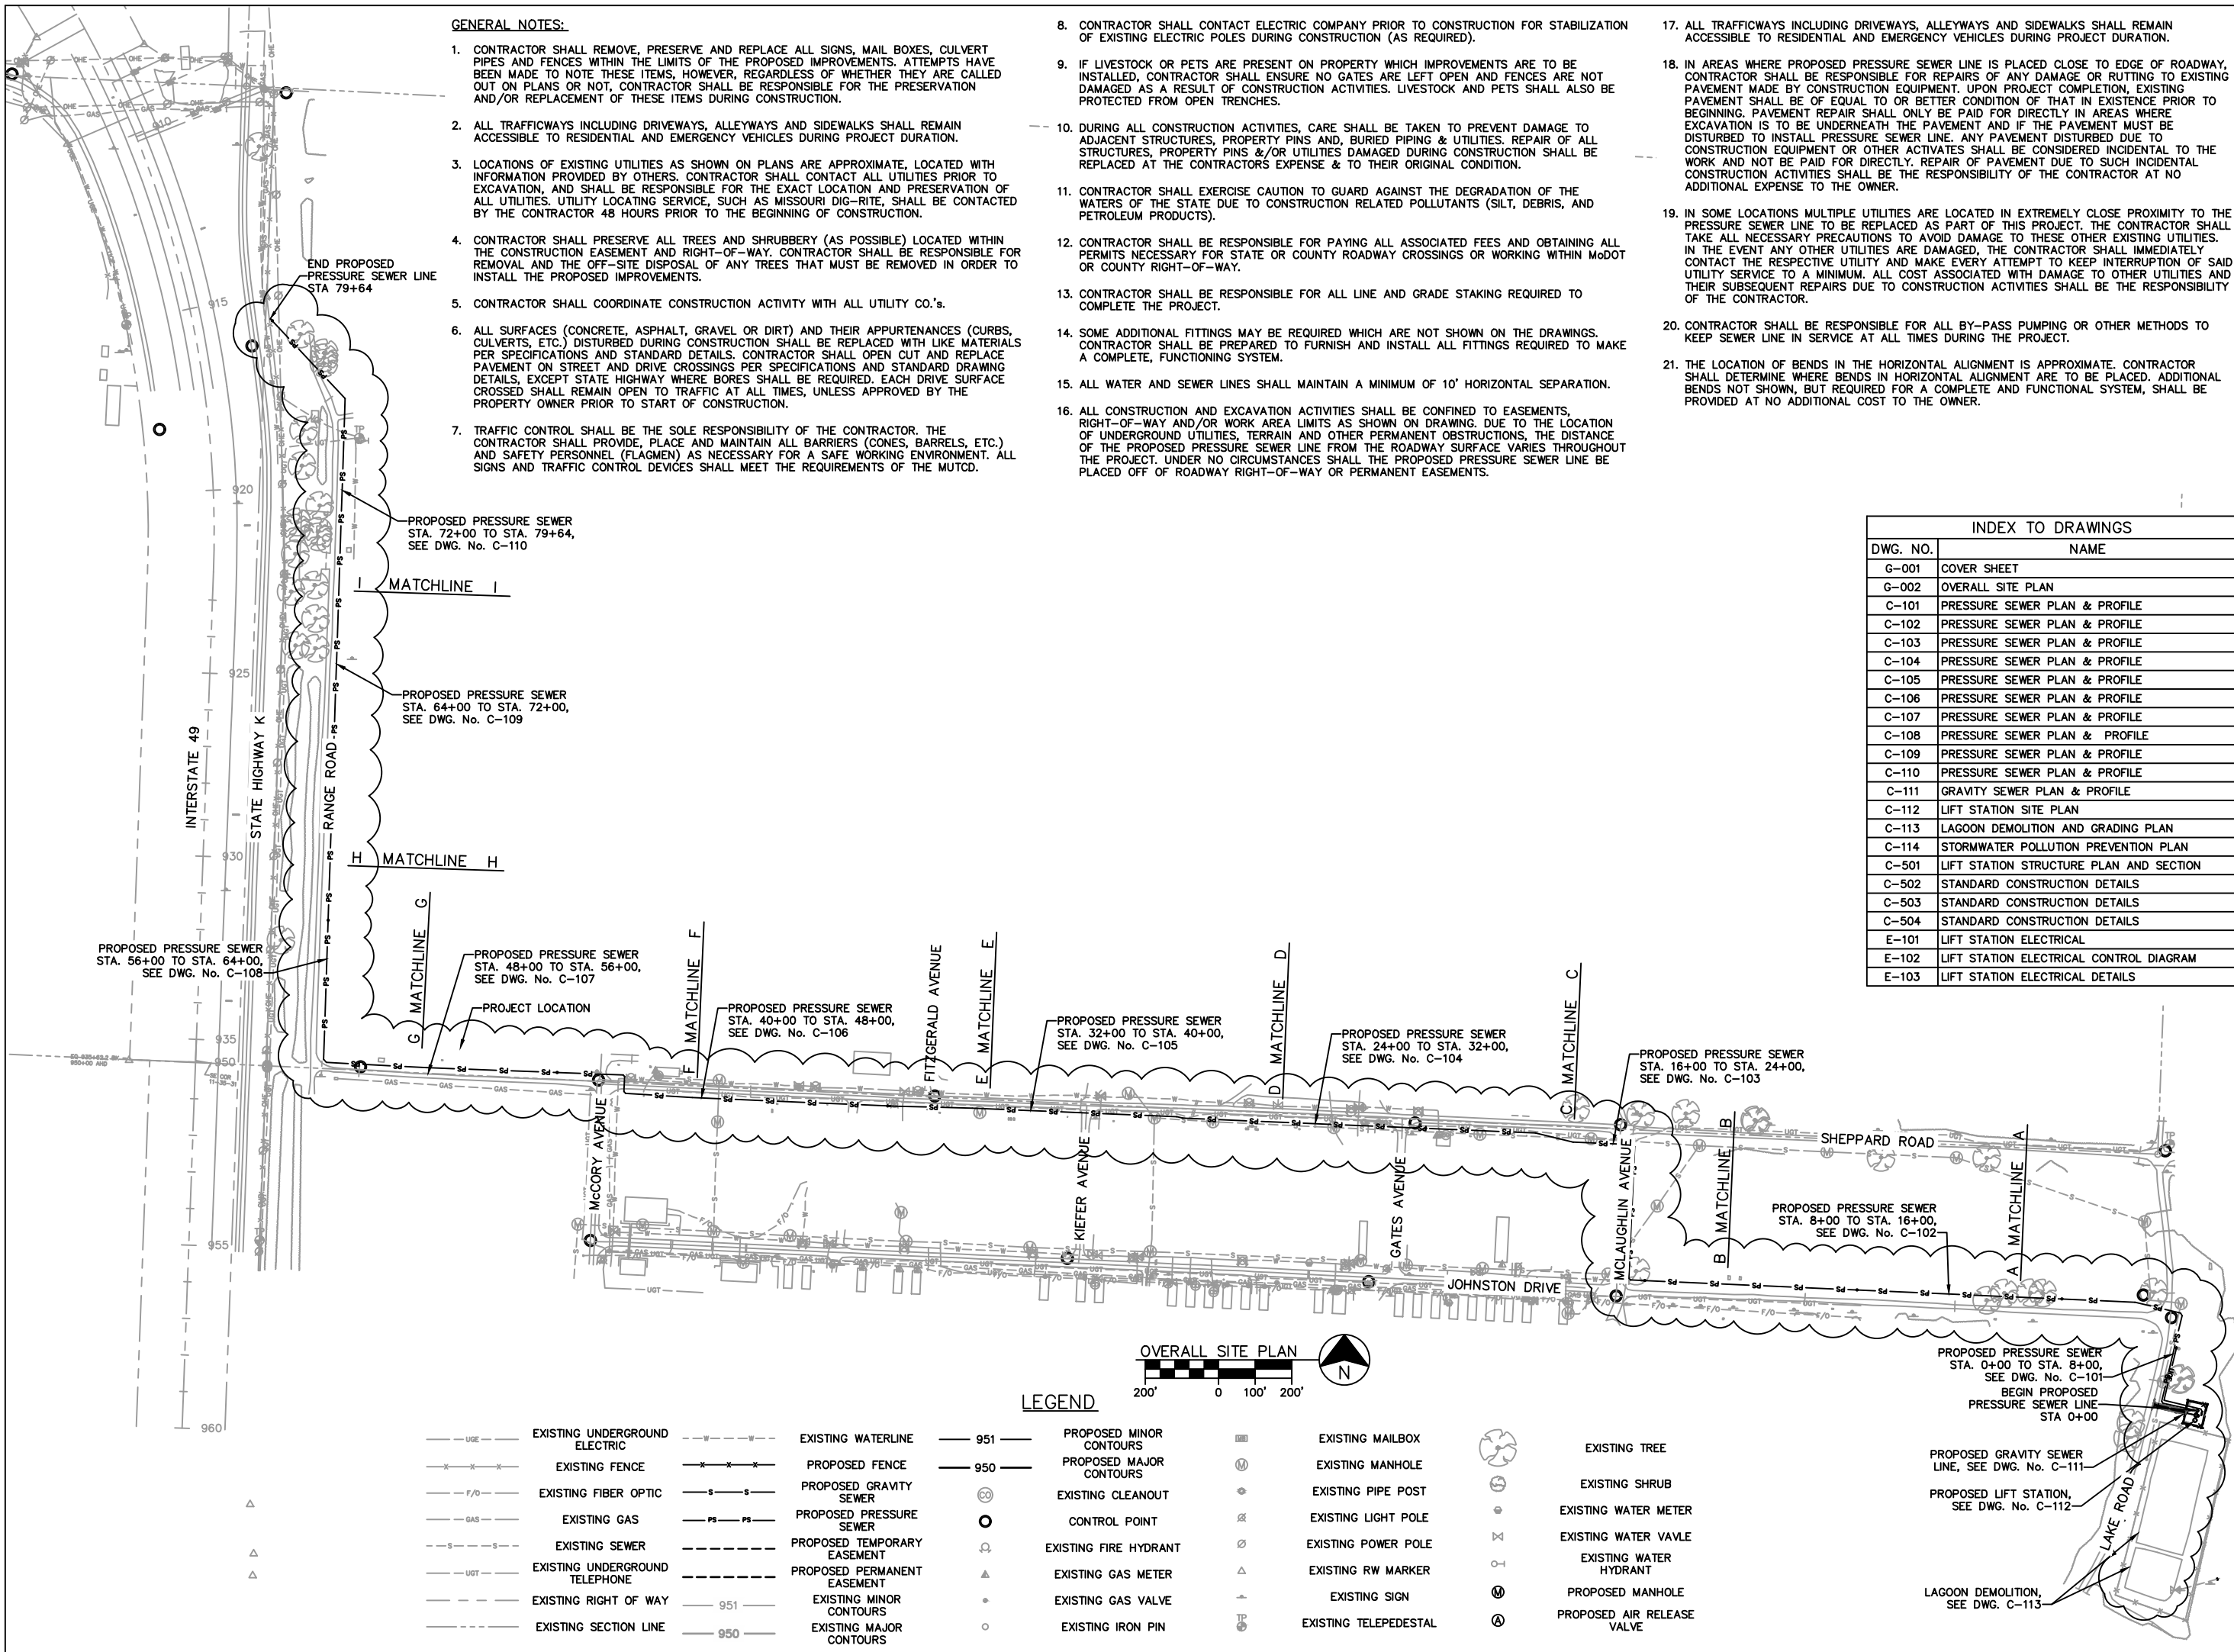

GENERAL NOTES:

- CONTRACTOR SHALL REMOVE, PRESERVE AND REPLACE ALL SIGNS, MAIL BOXES, CULVERT PIPES AND FENCES WITHIN THE LIMITS OF THE PROPOSED IMPROVEMENTS. ATTEMPTS HAVE BEEN MADE TO NOTE THESE ITEMS, HOWEVER, REGARDLESS OF WHETHER THEY ARE CALLED OUT ON PLANS OR NOT, CONTRACTOR SHALL BE RESPONSIBLE FOR THE PRESERVATION AND/OR REPLACEMENT OF THESE ITEMS DURING CONSTRUCTION.
- ALL TRAFFICWAYS INCLUDING DRIVEWAYS, ALLEYS AND SIDEWALKS SHALL REMAIN ACCESSIBLE TO RESIDENTIAL AND EMERGENCY VEHICLES DURING PROJECT DURATION.
- LOCATIONS OF EXISTING UTILITIES AS SHOWN ON PLANS ARE APPROXIMATE. LOCATED WITH INFORMATION PROVIDED BY OTHERS. CONTRACTOR SHALL CONTACT ALL UTILITIES PRIOR TO EXCAVATION, AND SHALL BE RESPONSIBLE FOR THE EXACT LOCATION AND PRESERVATION OF ALL UTILITIES. UTILITY LOCATING SERVICE, SUCH AS MISSOURI DIG-RITE, SHALL BE CONTACTED BY THE CONTRACTOR 48 HOURS PRIOR TO THE BEGINNING OF CONSTRUCTION.
- CONTRACTOR SHALL PRESERVE ALL TREES AND SHRUBBERY (AS POSSIBLE) LOCATED WITHIN THE CONSTRUCTION EASEMENT AND RIGHT-OF-WAY. CONTRACTOR SHALL BE RESPONSIBLE FOR REMOVAL AND THE OFF-SITE DISPOSAL OF ANY TREES THAT MUST BE REMOVED IN ORDER TO INSTALL THE PROPOSED IMPROVEMENTS.
- CONTRACTOR SHALL COORDINATE CONSTRUCTION ACTIVITY WITH ALL UTILITY CO.'S.
- ALL SURFACES (CONCRETE, ASPHALT, GRAVEL OR DIRT) AND THEIR APPURTENANCES (CURBS, CULVERTS, ETC.) DISTURBED DURING CONSTRUCTION SHALL BE REPLACED WITH LIKE MATERIALS PER SPECIFICATIONS AND STANDARD DETAILS. CONTRACTOR SHALL OPEN CUT AND REPLACE PAVEMENT ON STREET AND DRIVE CROSSINGS PER SPECIFICATIONS AND STANDARD DRAWING DETAILS, EXCEPT STATE HIGHWAY WHERE BORES SHALL BE REQUIRED. EACH DRIVE SURFACE CROSSED SHALL REMAIN OPEN TO TRAFFIC AT ALL TIMES, UNLESS APPROVED BY THE PROPERTY OWNER PRIOR TO START OF CONSTRUCTION.
- TRAFFIC CONTROL SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR. THE CONTRACTOR SHALL PROVIDE, PLACE AND MAINTAIN ALL BARRIERS (CONES, BARRELS, ETC.) AND SAFETY PERSONNEL (FLAGMEN) AS NECESSARY FOR A SAFE WORKING ENVIRONMENT. ALL SIGNS AND TRAFFIC CONTROL DEVICES SHALL MEET THE REQUIREMENTS OF THE MUTCD.
- CONTRACTOR SHALL CONTACT ELECTRIC COMPANY PRIOR TO CONSTRUCTION FOR STABILIZATION OF EXISTING ELECTRIC POLES DURING CONSTRUCTION (AS REQUIRED).
- IF LIVESTOCK OR PETS ARE PRESENT ON PROPERTY WHICH IMPROVEMENTS ARE TO BE INSTALLED, CONTRACTOR SHALL ENSURE NO GATES ARE LEFT OPEN AND FENCES ARE NOT DAMAGED AS A RESULT OF CONSTRUCTION ACTIVITIES. LIVESTOCK AND PETS SHALL ALSO BE PROTECTED FROM OPEN TRENCHES.
- DURING ALL CONSTRUCTION ACTIVITIES, CARE SHALL BE TAKEN TO PREVENT DAMAGE TO ADJACENT STRUCTURES, PROPERTY PINS AND BURIED PIPING & UTILITIES. REPAIR OF ALL STRUCTURES, PROPERTY PINS &/OR UTILITIES DAMAGED DURING CONSTRUCTION SHALL BE REPLACED AT THE CONTRACTORS EXPENSE & TO THEIR ORIGINAL CONDITION.
- CONTRACTOR SHALL EXERCISE CAUTION TO GUARD AGAINST THE DEGRADATION OF THE WATERS OF THE STATE DUE TO CONSTRUCTION RELATED POLLUTANTS (SILT, DEBRIS, AND PETROLEUM PRODUCTS).
- CONTRACTOR SHALL BE RESPONSIBLE FOR PAYING ALL ASSOCIATED FEES AND OBTAINING ALL PERMITS NECESSARY FOR STATE OR COUNTY ROADWAY CROSSINGS OR WORKING WITHIN MODOT OR COUNTY RIGHT-OF-WAY.
- CONTRACTOR SHALL BE RESPONSIBLE FOR ALL LINE AND GRADE STAKING REQUIRED TO COMPLETE THE PROJECT.
- SOME ADDITIONAL FITTINGS MAY BE REQUIRED WHICH ARE NOT SHOWN ON THE DRAWINGS. CONTRACTOR SHALL BE PREPARED TO FURNISH AND INSTALL ALL FITTINGS REQUIRED TO MAKE A COMPLETE, FUNCTIONING SYSTEM.
- ALL WATER AND SEWER LINES SHALL MAINTAIN A MINIMUM OF 10' HORIZONTAL SEPARATION.
- ALL CONSTRUCTION AND EXCAVATION ACTIVITIES SHALL BE CONFINED TO EASEMENTS, RIGHT-OF-WAY AND/OR WORK AREA LIMITS AS SHOWN ON DRAWING. DUE TO THE LOCATION OF UNDERGROUND UTILITIES, TERRAIN AND OTHER PERMANENT OBSTRUCTIONS, THE DISTANCE OF THE PROPOSED PRESSURE SEWER LINE FROM THE ROADWAY SURFACE VARIES THROUGHOUT THE PROJECT. UNDER NO CIRCUMSTANCES SHALL THE PROPOSED PRESSURE SEWER LINE BE PLACED OFF OF ROADWAY RIGHT-OF-WAY OR PERMANENT EASEMENTS.
- ALL TRAFFICWAYS INCLUDING DRIVEWAYS, ALLEYS AND SIDEWALKS SHALL REMAIN ACCESSIBLE TO RESIDENTIAL AND EMERGENCY VEHICLES DURING PROJECT DURATION.
- IN AREAS WHERE PROPOSED PRESSURE SEWER LINE IS PLACED CLOSE TO EDGE OF ROADWAY, CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIRS OF ANY DAMAGE OR RUTTING TO EXISTING PAVEMENT MADE BY CONSTRUCTION EQUIPMENT. UPON PROJECT COMPLETION, EXISTING PAVEMENT SHALL BE OF EQUAL TO OR BETTER CONDITION OF THAT IN EXISTENCE PRIOR TO BEGINNING. PAVEMENT REPAIR SHALL ONLY BE PAID FOR DIRECTLY IN AREAS WHERE EXCAVATION IS TO BE UNDERNEATH THE PAVEMENT AND IF THE PAVEMENT MUST BE DISTURBED TO INSTALL PRESSURE SEWER LINE. ANY PAVEMENT DISTURBED DUE TO CONSTRUCTION EQUIPMENT OR OTHER ACTIVITIES SHALL BE CONSIDERED INCIDENTAL TO THE WORK AND NOT BE PAID FOR DIRECTLY. REPAIR OF PAVEMENT DUE TO SUCH INCIDENTAL CONSTRUCTION ACTIVITIES SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR AT NO ADDITIONAL EXPENSE TO THE OWNER.
- IN SOME LOCATIONS MULTIPLE UTILITIES ARE LOCATED IN EXTREMELY CLOSE PROXIMITY TO THE PRESSURE SEWER LINE TO BE REPLACED AS PART OF THIS PROJECT. THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS TO AVOID DAMAGE TO THESE OTHER EXISTING UTILITIES. IN THE EVENT ANY OTHER UTILITIES ARE DAMAGED, THE CONTRACTOR SHALL IMMEDIATELY CONTACT THE RESPECTIVE UTILITY AND MAKE EVERY ATTEMPT TO KEEP INTERRUPTION OF SAID UTILITY SERVICE TO A MINIMUM. ALL COST ASSOCIATED WITH DAMAGE TO OTHER UTILITIES AND THEIR SUBSEQUENT REPAIRS DUE TO CONSTRUCTION ACTIVITIES SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
- CONTRACTOR SHALL BE RESPONSIBLE FOR ALL BY-PASS PUMPING OR OTHER METHODS TO KEEP SEWER LINE IN SERVICE AT ALL TIMES DURING THE PROJECT.
- THE LOCATION OF BENDS IN THE HORIZONTAL ALIGNMENT IS APPROXIMATE. CONTRACTOR SHALL DETERMINE WHERE BENDS IN HORIZONTAL ALIGNMENT ARE TO BE PLACED. ADDITIONAL BENDS NOT SHOWN, BUT REQUIRED FOR A COMPLETE AND FUNCTIONAL SYSTEM, SHALL BE PROVIDED AT NO ADDITIONAL COST TO THE OWNER.

INDEX TO DRAWINGS	
DWG. NO.	NAME
G-001	COVER SHEET
G-002	OVERALL SITE PLAN
C-101	PRESSURE SEWER PLAN & PROFILE
C-102	PRESSURE SEWER PLAN & PROFILE
C-103	PRESSURE SEWER PLAN & PROFILE
C-104	PRESSURE SEWER PLAN & PROFILE
C-105	PRESSURE SEWER PLAN & PROFILE
C-106	PRESSURE SEWER PLAN & PROFILE
C-107	PRESSURE SEWER PLAN & PROFILE
C-108	PRESSURE SEWER PLAN & PROFILE
C-109	PRESSURE SEWER PLAN & PROFILE
C-110	PRESSURE SEWER PLAN & PROFILE
C-111	GRAVITY SEWER PLAN & PROFILE
C-112	LIFT STATION SITE PLAN
C-113	LAGOON DEMOLITION AND GRADING PLAN
C-114	STORMWATER POLLUTION PREVENTION PLAN
C-501	LIFT STATION STRUCTURE PLAN AND SECTION
C-502	STANDARD CONSTRUCTION DETAILS
C-503	STANDARD CONSTRUCTION DETAILS
C-504	STANDARD CONSTRUCTION DETAILS
E-101	LIFT STATION ELECTRICAL
E-102	LIFT STATION ELECTRICAL CONTROL DIAGRAM
E-103	LIFT STATION ELECTRICAL DETAILS




LEGEND

- | | | | | | | | | | |
|-------------|--------------------------------|------------|-----------------------------|-------------|-------------------------|---|---------------------|---|----------------------------|
| --- UGE --- | EXISTING UNDERGROUND ELECTRIC | --- W --- | EXISTING WATERLINE | --- 951 --- | PROPOSED MINOR CONTOURS | Ⓜ | EXISTING MAILBOX | Ⓢ | EXISTING TREE |
| --- F/O --- | EXISTING FIBER OPTIC | --- S --- | PROPOSED GRAVITY SEWER | --- 950 --- | PROPOSED MAJOR CONTOURS | Ⓜ | EXISTING MANHOLE | Ⓢ | EXISTING SHRUB |
| --- GAS --- | EXISTING GAS | --- PS --- | PROPOSED PRESSURE SEWER | Ⓢ | EXISTING CLEANOUT | Ⓢ | EXISTING PIPE POST | Ⓢ | EXISTING WATER METER |
| --- S --- | EXISTING SEWER | --- | PROPOSED TEMPORARY EASEMENT | Ⓢ | Ⓢ | Ⓢ | EXISTING LIGHT POLE | Ⓢ | EXISTING WATER VALVE |
| --- | EXISTING UNDERGROUND TELEPHONE | --- | PROPOSED PERMANENT EASEMENT | Ⓢ | Ⓢ | Ⓢ | EXISTING POWER POLE | Ⓢ | EXISTING WATER HYDRANT |
| --- | EXISTING RIGHT OF WAY | --- | EXISTING MINOR CONTOURS | Ⓢ | Ⓢ | Ⓢ | EXISTING RW MARKER | Ⓢ | PROPOSED MANHOLE |
| --- | EXISTING SECTION LINE | --- | EXISTING MAJOR CONTOURS | Ⓢ | Ⓢ | Ⓢ | EXISTING SIGN | Ⓢ | PROPOSED AIR RELEASE VALVE |

STATE OF MISSOURI
MICHAEL L. PARSON,
GOVERNOR

CIVIL ENGINEER: GARRETT D. WAGNER
LICENSE NO. PE-2019000226



OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES
MANAGEMENT,
DESIGN AND CONSTRUCTION

MISSOURI
NATIONAL GUARD

CONNECT CAMP CLARK
TO CITY OF NEVADA
SEWER SYSTEM

CAMP CLARK

NEVADA, MISSOURI

PROJECT # T2301-02
SITE # 6274
ASSET # 8136274075

REVISION: REMOVE LOCATION MAP
DATE: 03-12-2024
REVISION: _____
DATE: _____
REVISION: _____
DATE: _____
ISSUE DATE: 06/14/2024


CAD DWG FILE: _____
DRAWN BY: AWW
CHECKED BY: SCW
DESIGNED BY: GDW

SHEET TITLE:
OVERALL SITE PLAN

SHEET NUMBER:

G-002

2 OF 23 SHEETS

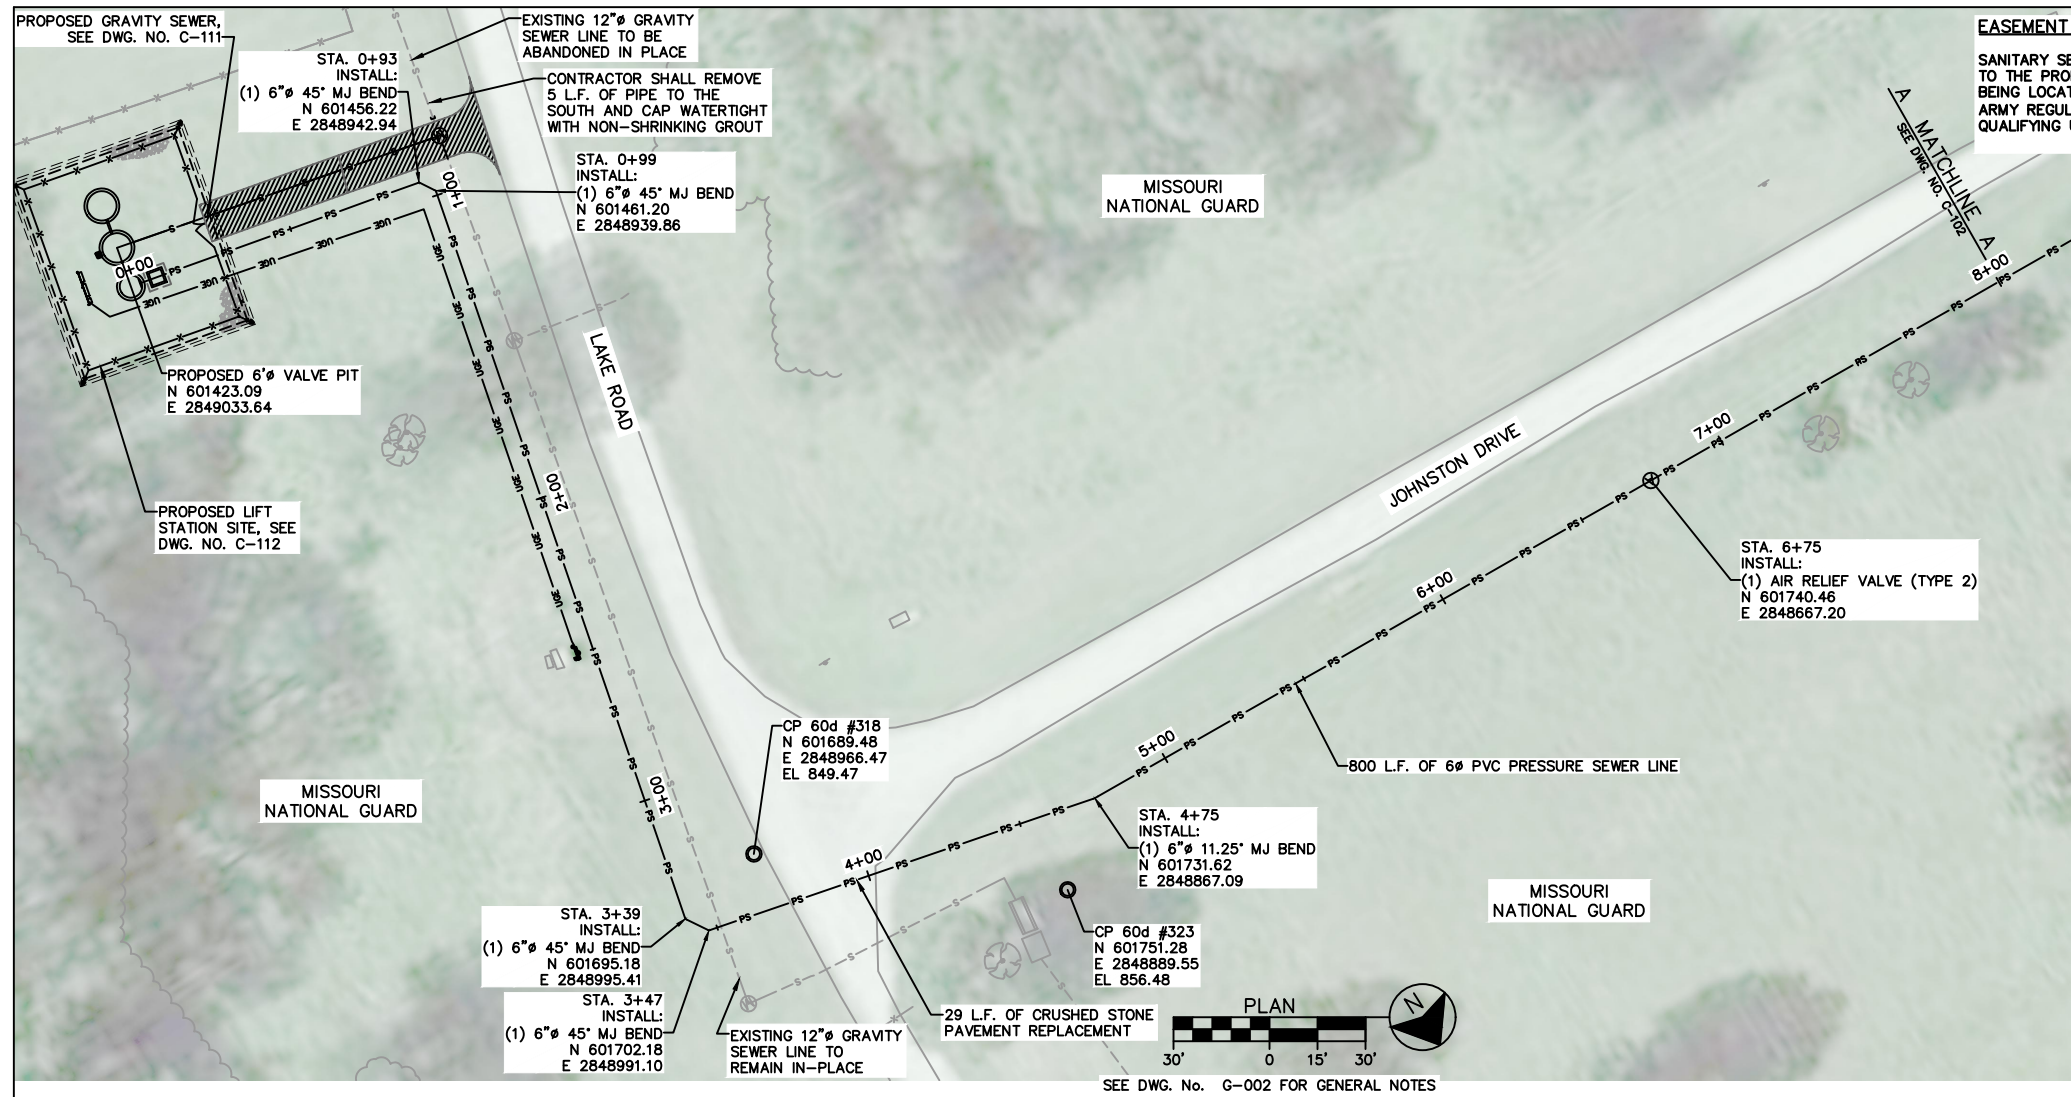

EASEMENT NOTE:

SANITARY SEWER EASEMENTS HAVE NOT BEEN OBTAINED DUE TO THE PROPOSED PRESSURE SEWER PIPE AND LIFT STATION BEING LOCATED ON FEDERAL PROPERTY THAT IS COVERED IN ARMY REGULATION (AR 405-80) GRANTING ACCESS FOR ALL QUALIFYING UTILITIES.

PRESSURE SEWER NOTES:


- NO. 12 COATED COPPER DETECTION WIRE SHALL BE RUN IN TRENCH FOR ENTIRE LENGTH OF INSTALLED PRESSURE SEWER MAIN, PER DETAILS AND SPECIFICATIONS.
- PRESSURE SEWER LINE SHALL BE INSTALLED WITH A MINIMUM OF 42" OF COVER OVER TOP OF PIPE.

LEGEND

---	EXISTING UNDERGROUND ELECTRIC	⊗	EXISTING FIRE HYDRANT
---	EXISTING FENCE	▲	EXISTING GAS METER
-F/O-	EXISTING FIBER OPTIC	•	EXISTING GAS VALVE
---	EXISTING GAS	○	EXISTING IRON PIN
-S-S-	EXISTING SEWER	■	EXISTING MAILBOX
---	EXISTING UNDERGROUND TELEPHONE	⊙	EXISTING MANHOLE
---	EXISTING RIGHT OF WAY	⊕	EXISTING PIPE POST
---	EXISTING SECTION LINE	⊗	EXISTING LIGHT POLE
---	EXISTING WATERLINE	⊗	EXISTING POWER POLE
-x-x-	PROPOSED FENCE	▲	EXISTING RW MARKER
-s-s-	PROPOSED GRAVITY SEWER	▲	EXISTING SIGN
-ps-ps-	PROPOSED PRESSURE SEWER	⊕	EXISTING TELEPEDESTAL
---	PROPOSED TEMPORARY EASEMENT	⊗	EXISTING TREE
---	PROPOSED PERMANENT EASEMENT	⊗	EXISTING SHRUB
951	EXISTING MINOR CONTOURS	⊗	EXISTING WATER METER
950	EXISTING MAJOR CONTOURS	⊗	EXISTING WATER VAVLE
951	PROPOSED MINOR CONTOURS	⊗	EXISTING WATER HYDRANT
950	PROPOSED MAJOR CONTOURS	⊗	PROPOSED MANHOLE
⊗	EXISTING CLEANOUT	⊗	PROPOSED AIR RELEASE VALVE
○	CONTROL POINT		

STATE OF MISSOURI
MICHAEL L. PARSON,
GOVERNOR

CHIEF ENGINEER: GARRETT D. WAGNER
LICENSE NO. PE-2019000226



OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES
MANAGEMENT,
DESIGN AND CONSTRUCTION

MISSOURI
NATIONAL GUARD

CONNECT CAMP CLARK
TO CITY OF NEVADA
SEWER SYSTEM

CAMP CLARK
NEVADA, MISSOURI

PROJECT # T2301-02
SITE # 6274
ASSET # 8136274075

REVISION:	EASEMENTS
DATE:	03-26-2024
REVISION:	
DATE:	
REVISION:	
DATE:	
ISSUE DATE:	06/14/2024


CAD DWG FILE:	
DRAWN BY:	AWW
CHECKED BY:	SCW
DESIGNED BY:	GDW

SHEET TITLE:
**PRESSURE SEWER
PLAN & PROFILE**

SHEET NUMBER:

C-101



3 OF 23 SHEETS

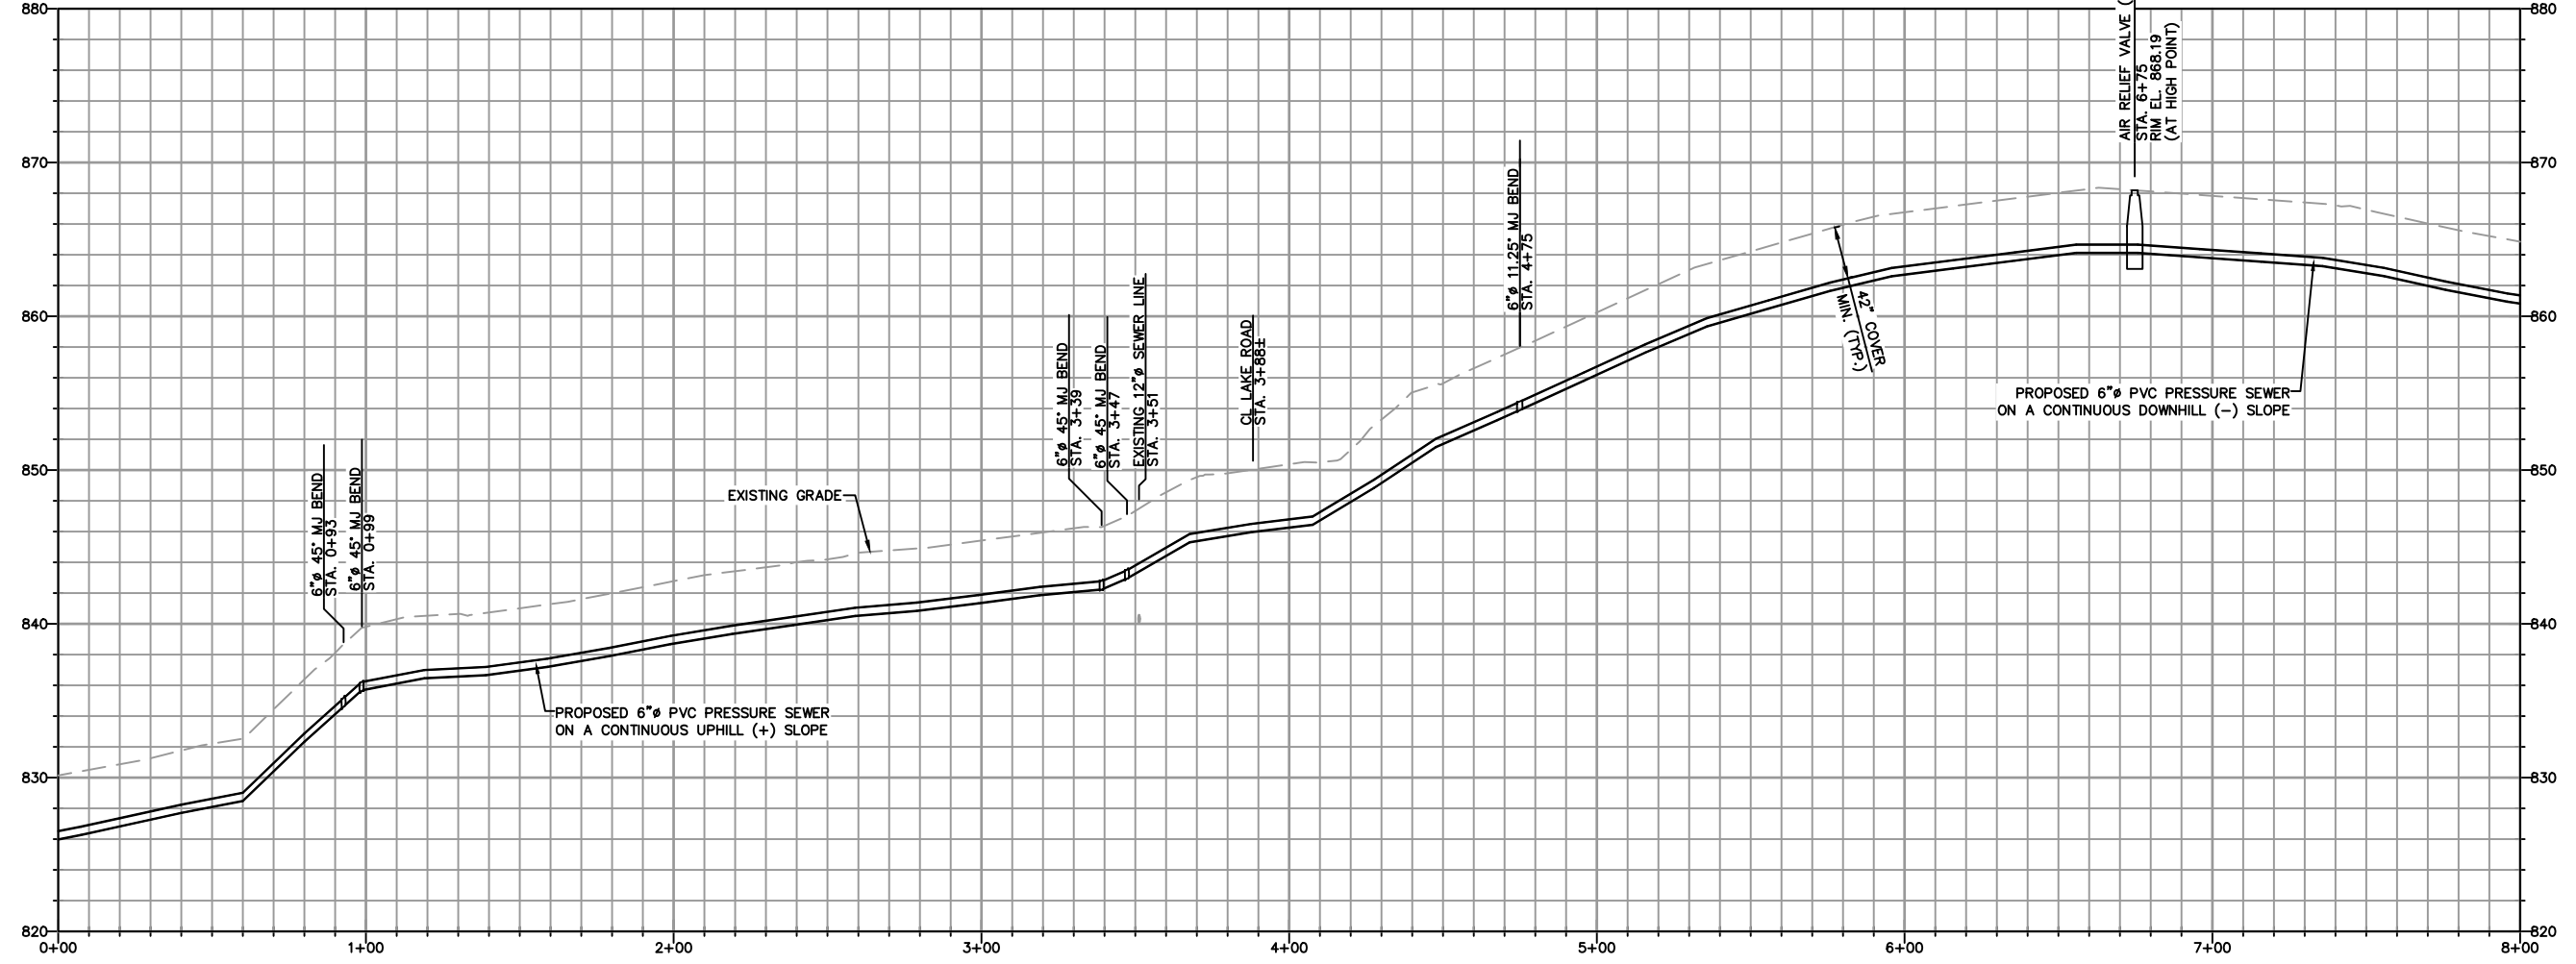

LEGEND			
---E---	EXISTING UNDERGROUND ELECTRIC	---S---	PROPOSED GRAVITY SEWER
---F/O---	EXISTING FIBER OPTIC	---PS---	PROPOSED PRESSURE SEWER
---GAS---	EXISTING GAS	---	PROPOSED TEMPORARY EASEMENT
---	EXISTING SEWER	---	PROPOSED PERMANENT EASEMENT
---UST---	EXISTING UNDERGROUND TELEPHONE	951	EXISTING MINOR CONTOURS
---	EXISTING RIGHT OF WAY	950	EXISTING MAJOR CONTOURS
---	EXISTING SECTION LINE	951	PROPOSED MINOR CONTOURS
---W---	EXISTING WATERLINE		
---X---	PROPOSED FENCE	950	PROPOSED MAJOR CONTOURS
---	EXISTING CLEANOUT	○	EXISTING FIRE HYDRANT
---	CONTROL POINT	△	EXISTING GAS METER
---	EXISTING GAS VALVE	•	EXISTING IRON PIN
---	EXISTING MAILBOX	■	EXISTING MANHOLE
---	EXISTING MANHOLE	⊙	
---	EXISTING PIPE POST	●	EXISTING WATER METER
---	EXISTING LIGHT POLE	⊗	EXISTING WATER VALVE
---	EXISTING POWER POLE	⊕	EXISTING WATER HYDRANT
---	EXISTING RW MARKER	⊙	PROPOSED MANHOLE
---	EXISTING SIGN	⊙	PROPOSED AIR RELEASE VALVE
---	EXISTING TELEPEDESTAL	⊙	
---	EXISTING TREE	⊙	
---	EXISTING SHRUB	⊙	

EASEMENT NOTE:
 SANITARY SEWER EASEMENTS HAVE NOT BEEN OBTAINED DUE TO THE PROPOSED PRESSURE SEWER PIPE AND LIFT STATION BEING LOCATED ON FEDERAL PROPERTY THAT IS COVERED IN ARMY REGULATION (AR 405-80) GRANTING ACCESS FOR ALL QUALIFYING UTILITIES.

- PRESSURE SEWER NOTES:**
- NO. 12 COATED COPPER DETECTION WIRE SHALL BE RUN IN TRENCH FOR ENTIRE LENGTH OF INSTALLED PRESSURE SEWER MAIN, PER DETAILS AND SPECIFICATIONS.
 - PRESSURE SEWER LINE SHALL BE INSTALLED WITH A MINIMUM OF 42" OF COVER OVER TOP OF PIPE.

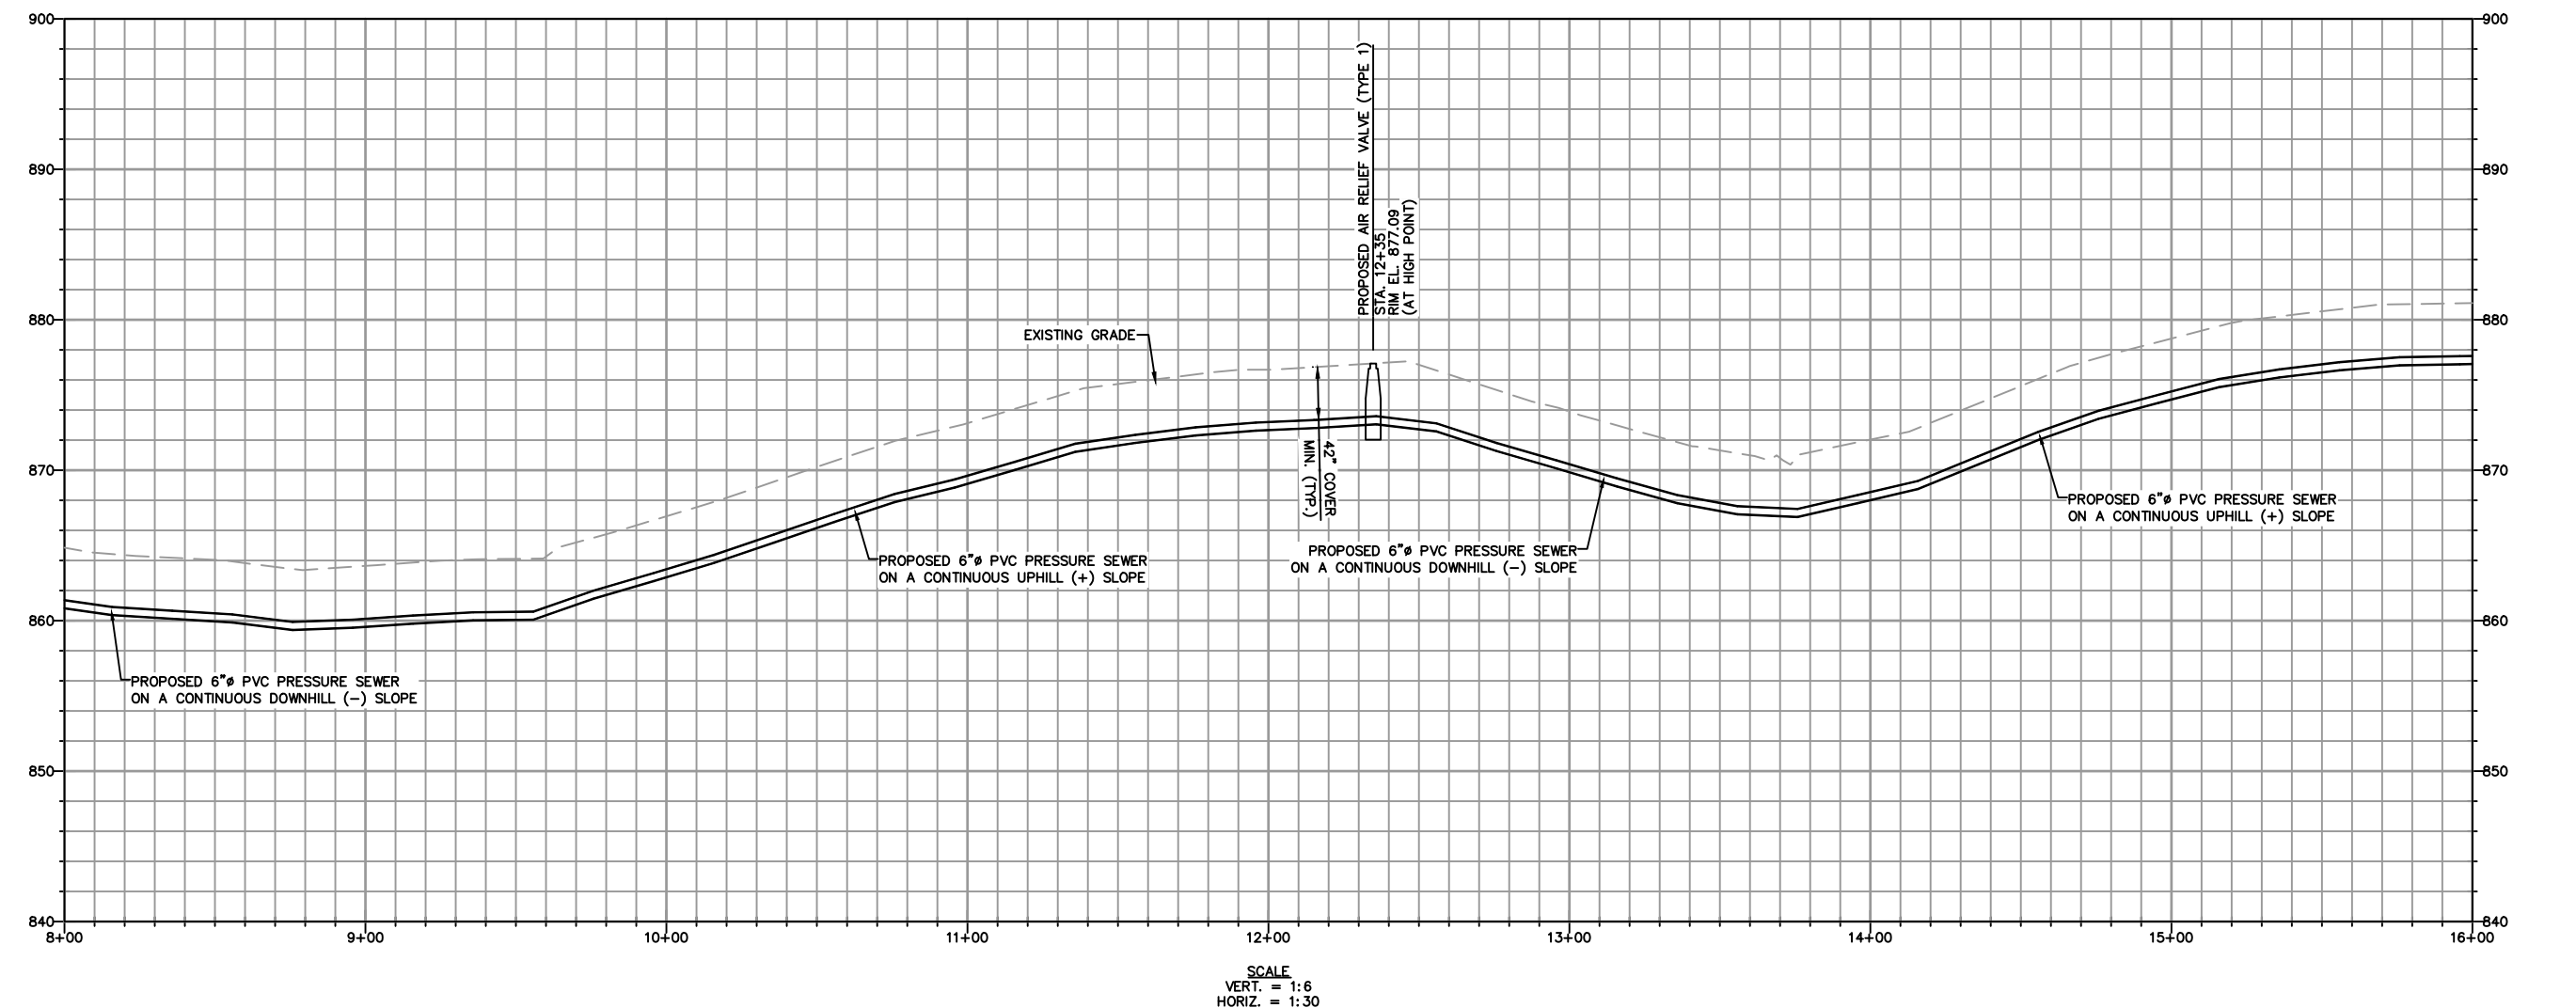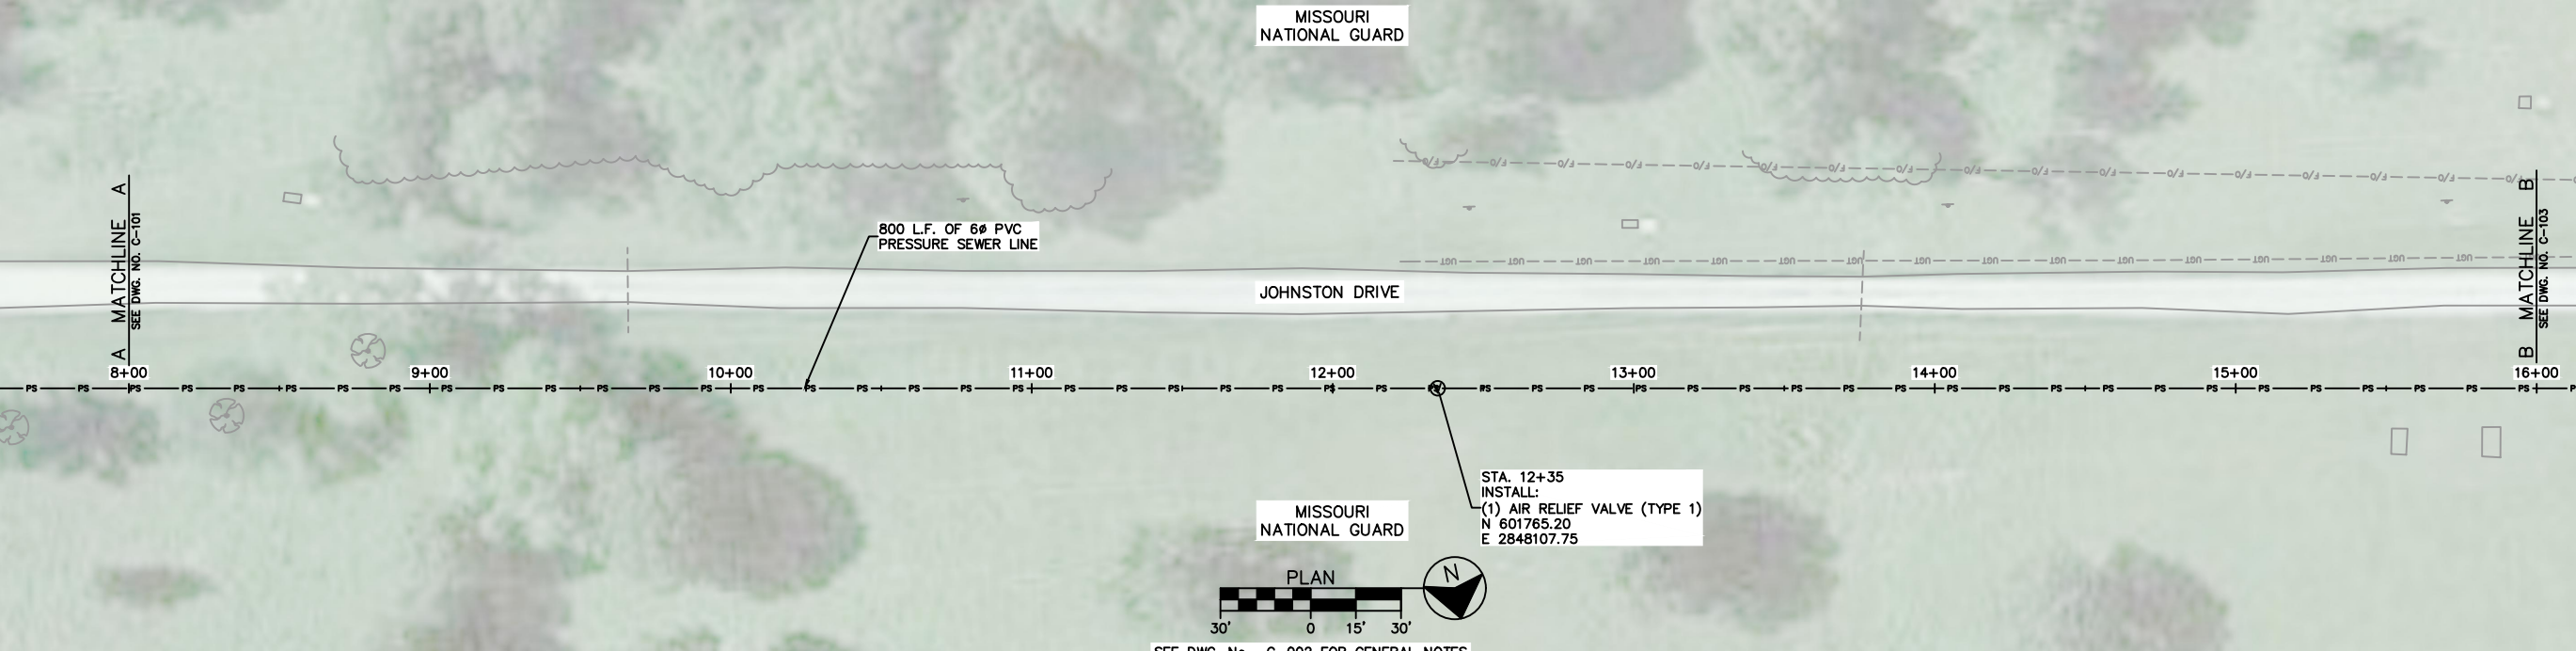

STATE OF MISSOURI
 MICHAEL L. PARSON,
 GOVERNOR

CIVIL ENGINEER: GARRETT D. WAGNER
 LICENSE NO. PE-2019000226



OFFICE OF ADMINISTRATION
 DIVISION OF FACILITIES
 MANAGEMENT,
 DESIGN AND CONSTRUCTION

MISSOURI
 NATIONAL GUARD

CONNECT CAMP CLARK
 TO CITY OF NEVADA
 SEWER SYSTEM

CAMP CLARK
 NEVADA, MISSOURI

PROJECT # T2301-02
 SITE # 6274
 ASSET # 8136274075

REVISION: EASEMENTS
 DATE: 03-26-2024
 REVISION:
 DATE:
 REVISION:
 DATE:
 ISSUE DATE: 06/14/2024


CAD DWG FILE:
 DRAWN BY: AWW
 CHECKED BY: SCW
 DESIGNED BY: GDW

SHEET TITLE:
 PRESSURE SEWER
 PLAN & PROFILE

SHEET NUMBER:

C-102

4 OF 23 SHEETS

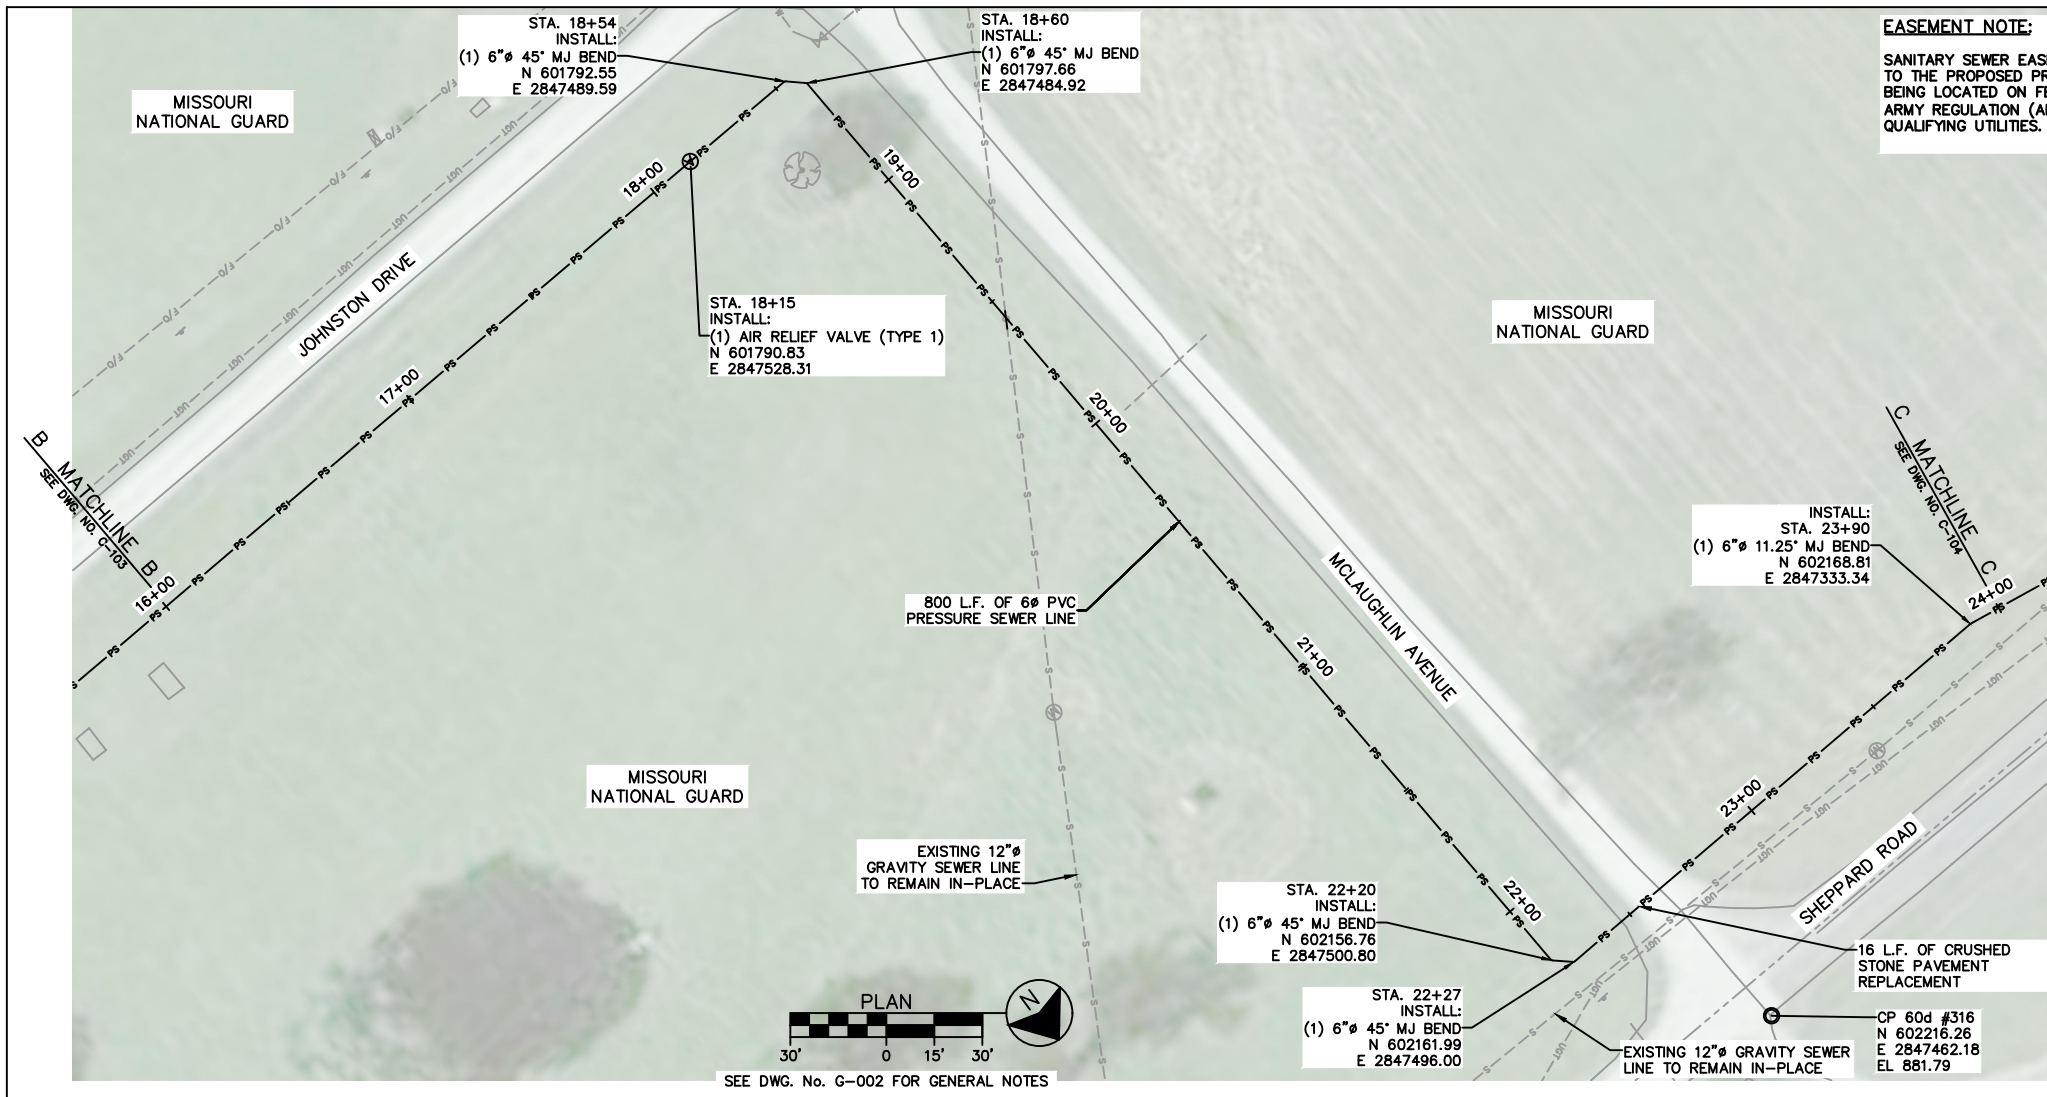

LEGEND

---	EXISTING UNDERGROUND ELECTRIC	⊙	EXISTING FIRE HYDRANT
-x-x-	EXISTING FENCE	▲	EXISTING GAS METER
-f/f-	EXISTING FIBER OPTIC	•	EXISTING GAS VALVE
-g-g-	EXISTING GAS	○	EXISTING IRON PIN
-s-s-	EXISTING SEWER	⊠	EXISTING MAILBOX
-u-u-	EXISTING UNDERGROUND TELEPHONE	⊕	EXISTING MANHOLE
- - -	EXISTING RIGHT OF WAY	⊙	EXISTING PIPE POST
- - -	EXISTING SECTION LINE	⊗	EXISTING LIGHT POLE
-w-w-	EXISTING WATERLINE	⊗	EXISTING POWER POLE
-x-x-	PROPOSED FENCE	▲	EXISTING RW MARKER
-s-s-	PROPOSED GRAVITY SEWER	▲	EXISTING SIGN
-ps-ps-	PROPOSED PRESSURE SEWER	⊕	EXISTING TELEPEDESTAL
- - -	PROPOSED TEMPORARY EASEMENT	⊕	EXISTING TREE
- - -	PROPOSED PERMANENT EASEMENT	⊕	EXISTING SHRUB
951	EXISTING MINOR CONTOURS	⊕	EXISTING WATER METER
950	EXISTING MAJOR CONTOURS	⊕	EXISTING WATER VALVE
951	PROPOSED MINOR CONTOURS	⊕	EXISTING WATER HYDRANT
950	PROPOSED MAJOR CONTOURS	⊕	PROPOSED MANHOLE
⊕	EXISTING CLEANOUT	⊕	PROPOSED AIR RELEASE VALVE
⊙	CONTROL POINT		

STATE OF MISSOURI
MICHAEL L. PARSON,
GOVERNOR

CIVIL ENGINEER: GARRETT D. WAGNER
LICENSE NO. PE-2019000226

STATE OF MISSOURI
GARRETT D. WAGNER
Camp Clark Sewer
NUMBER
PE-2019000226
3/26/24
PROFESSIONAL ENGINEER



OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES
MANAGEMENT,
DESIGN AND CONSTRUCTION

MISSOURI
NATIONAL GUARD

CONNECT CAMP CLARK
TO CITY OF NEVADA
SEWER SYSTEM

CAMP CLARK
NEVADA, MISSOURI

PROJECT # T2301-02
SITE # 6274
ASSET # 8136274075

REVISION: EASEMENTS
DATE: 03-26-2024
REVISION:
DATE:
REVISION:
DATE:
ISSUE DATE: 06/14/2024


CAD DWG FILE:
DRAWN BY: AWW
CHECKED BY: SCW
DESIGNED BY: GDW

SHEET TITLE:
PRESSURE SEWER
PLAN & PROFILE

SHEET NUMBER:

C-103



5 OF 23 SHEETS

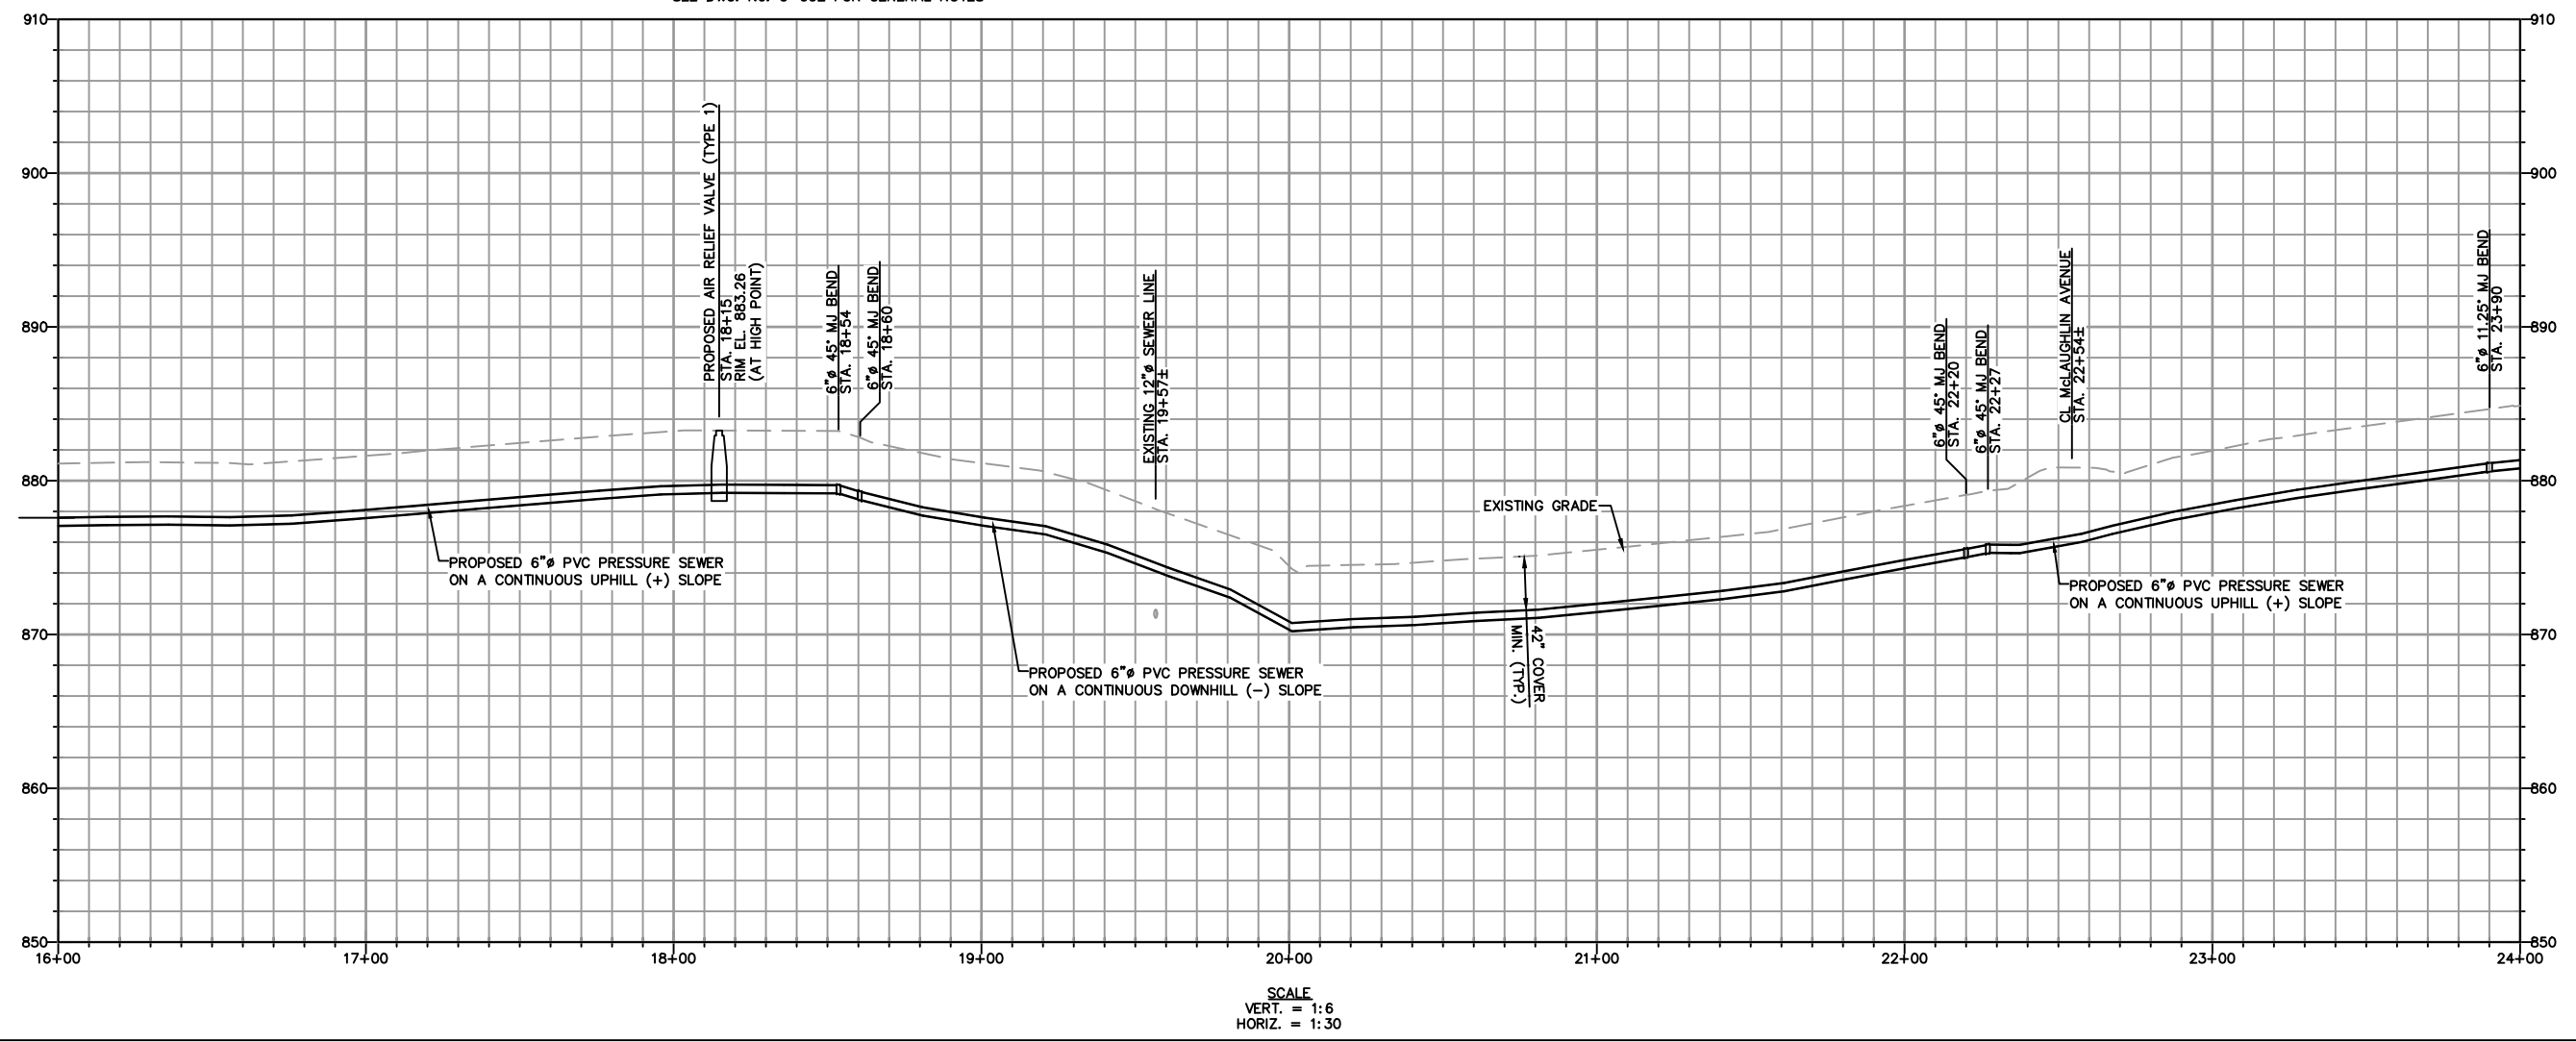

LEGEND			
---	EXISTING UNDERGROUND ELECTRIC	---x---x---	PROPOSED FENCE
---	EXISTING FENCE	---s---s---	PROPOSED GRAVITY SEWER
---	EXISTING FIBER OPTIC	---ps---ps---	PROPOSED PRESSURE SEWER
---	EXISTING GAS	---	PROPOSED TEMPORARY EASEMENT
---	EXISTING SEWER	---	PROPOSED PERMANENT EASEMENT
---	EXISTING UNDERGROUND TELEPHONE	---	EXISTING MINOR CONTOURS
---	EXISTING RIGHT OF WAY	---	EXISTING MAJOR CONTOURS
---	EXISTING SECTION LINE	---	PROPOSED MINOR CONTOURS
---	EXISTING WATERLINE	---	
950	PROPOSED MAJOR CONTOURS	○	EXISTING CLEANOUT
○	CONTROL POINT	○	EXISTING FIRE HYDRANT
△	EXISTING GAS METER	○	EXISTING GAS VALVE
○	EXISTING IRON PIN	○	EXISTING MAILBOX
○	EXISTING MANHOLE	○	EXISTING MANHOLE
●	EXISTING PIPE POST	○	EXISTING LIGHT POLE
○	EXISTING POWER POLE	○	EXISTING RW MARKER
○	EXISTING SIGN	○	EXISTING TELEPEDESTAL
○	EXISTING TREE	○	EXISTING SHRUB
○	EXISTING WATER METER	○	EXISTING WATER VAVLE
○	EXISTING WATER HYDRANT	○	PROPOSED MANHOLE
○	PROPOSED AIR RELEASE VALVE		

EASEMENT NOTE:
 SANITARY SEWER EASEMENTS HAVE NOT BEEN OBTAINED DUE TO THE PROPOSED PRESSURE SEWER PIPE AND LIFT STATION BEING LOCATED ON FEDERAL PROPERTY THAT IS COVERED IN ARMY REGULATION (AR 405-80) GRANTING ACCESS FOR ALL QUALIFYING UTILITIES.

PRESSURE SEWER NOTES:
 1. NO. 12 COATED COPPER DETECTION WIRE SHALL BE RUN IN TRENCH FOR ENTIRE LENGTH OF INSTALLED PRESSURE SEWER MAIN, PER DETAILS AND SPECIFICATIONS.
 2. PRESSURE SEWER LINE SHALL BE INSTALLED WITH A MINIMUM OF 42" OF COVER OVER TOP OF PIPE.

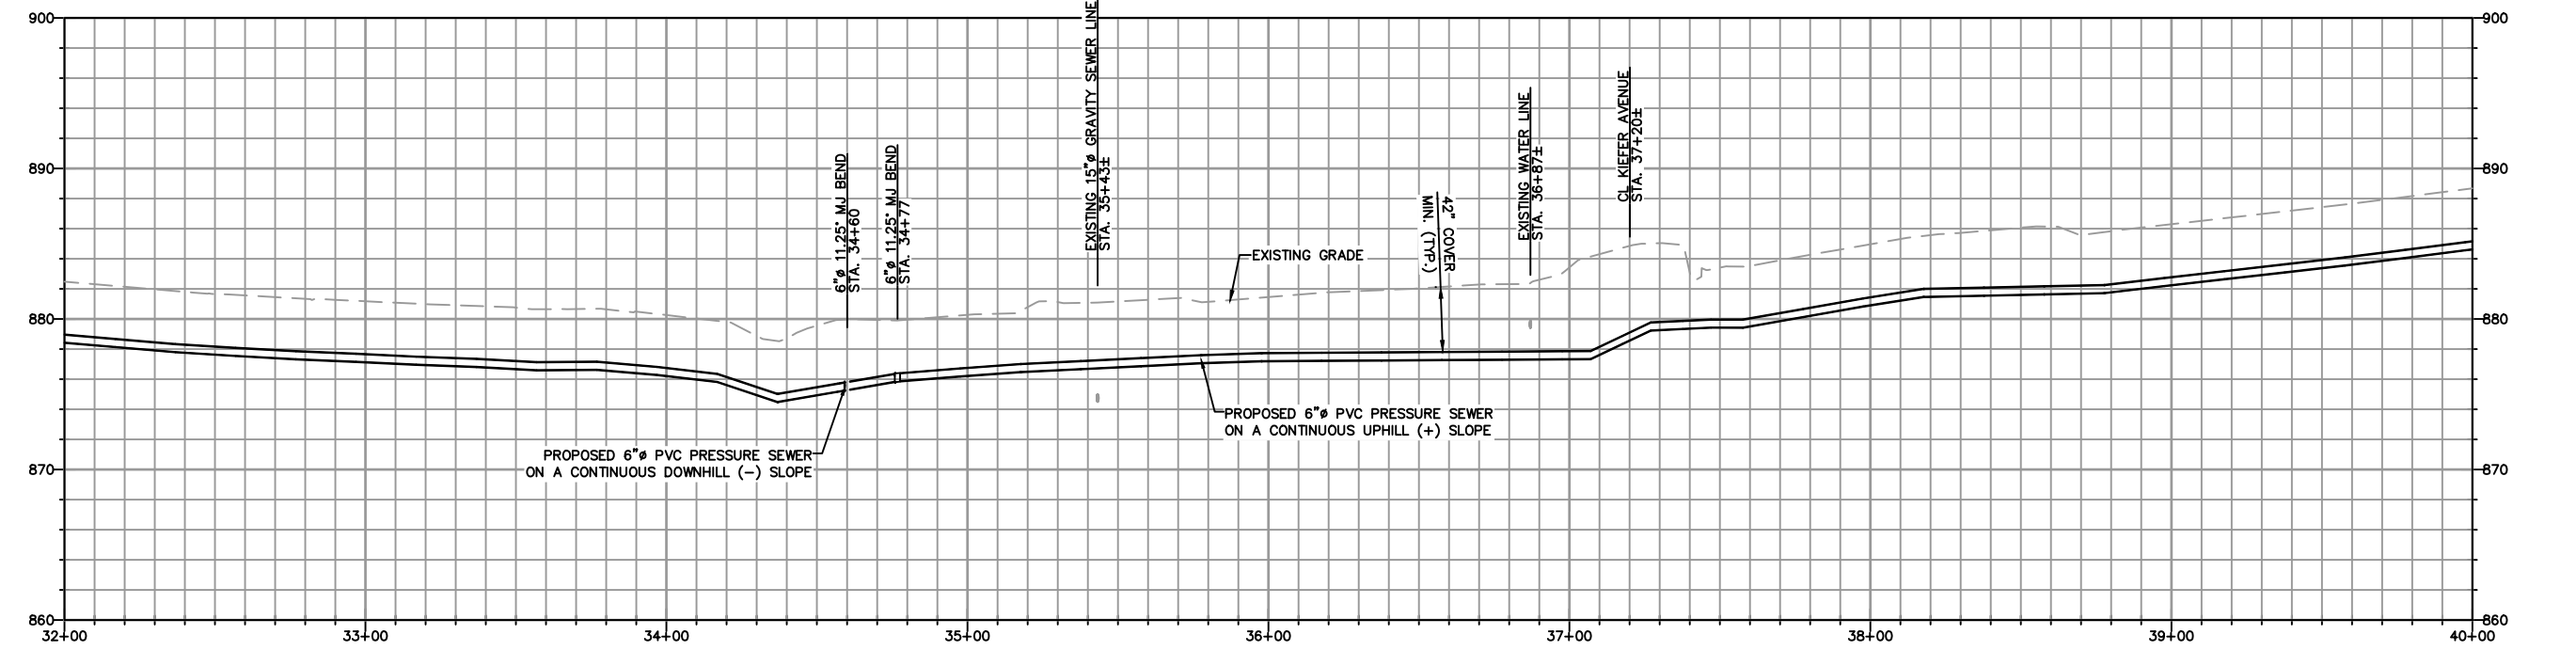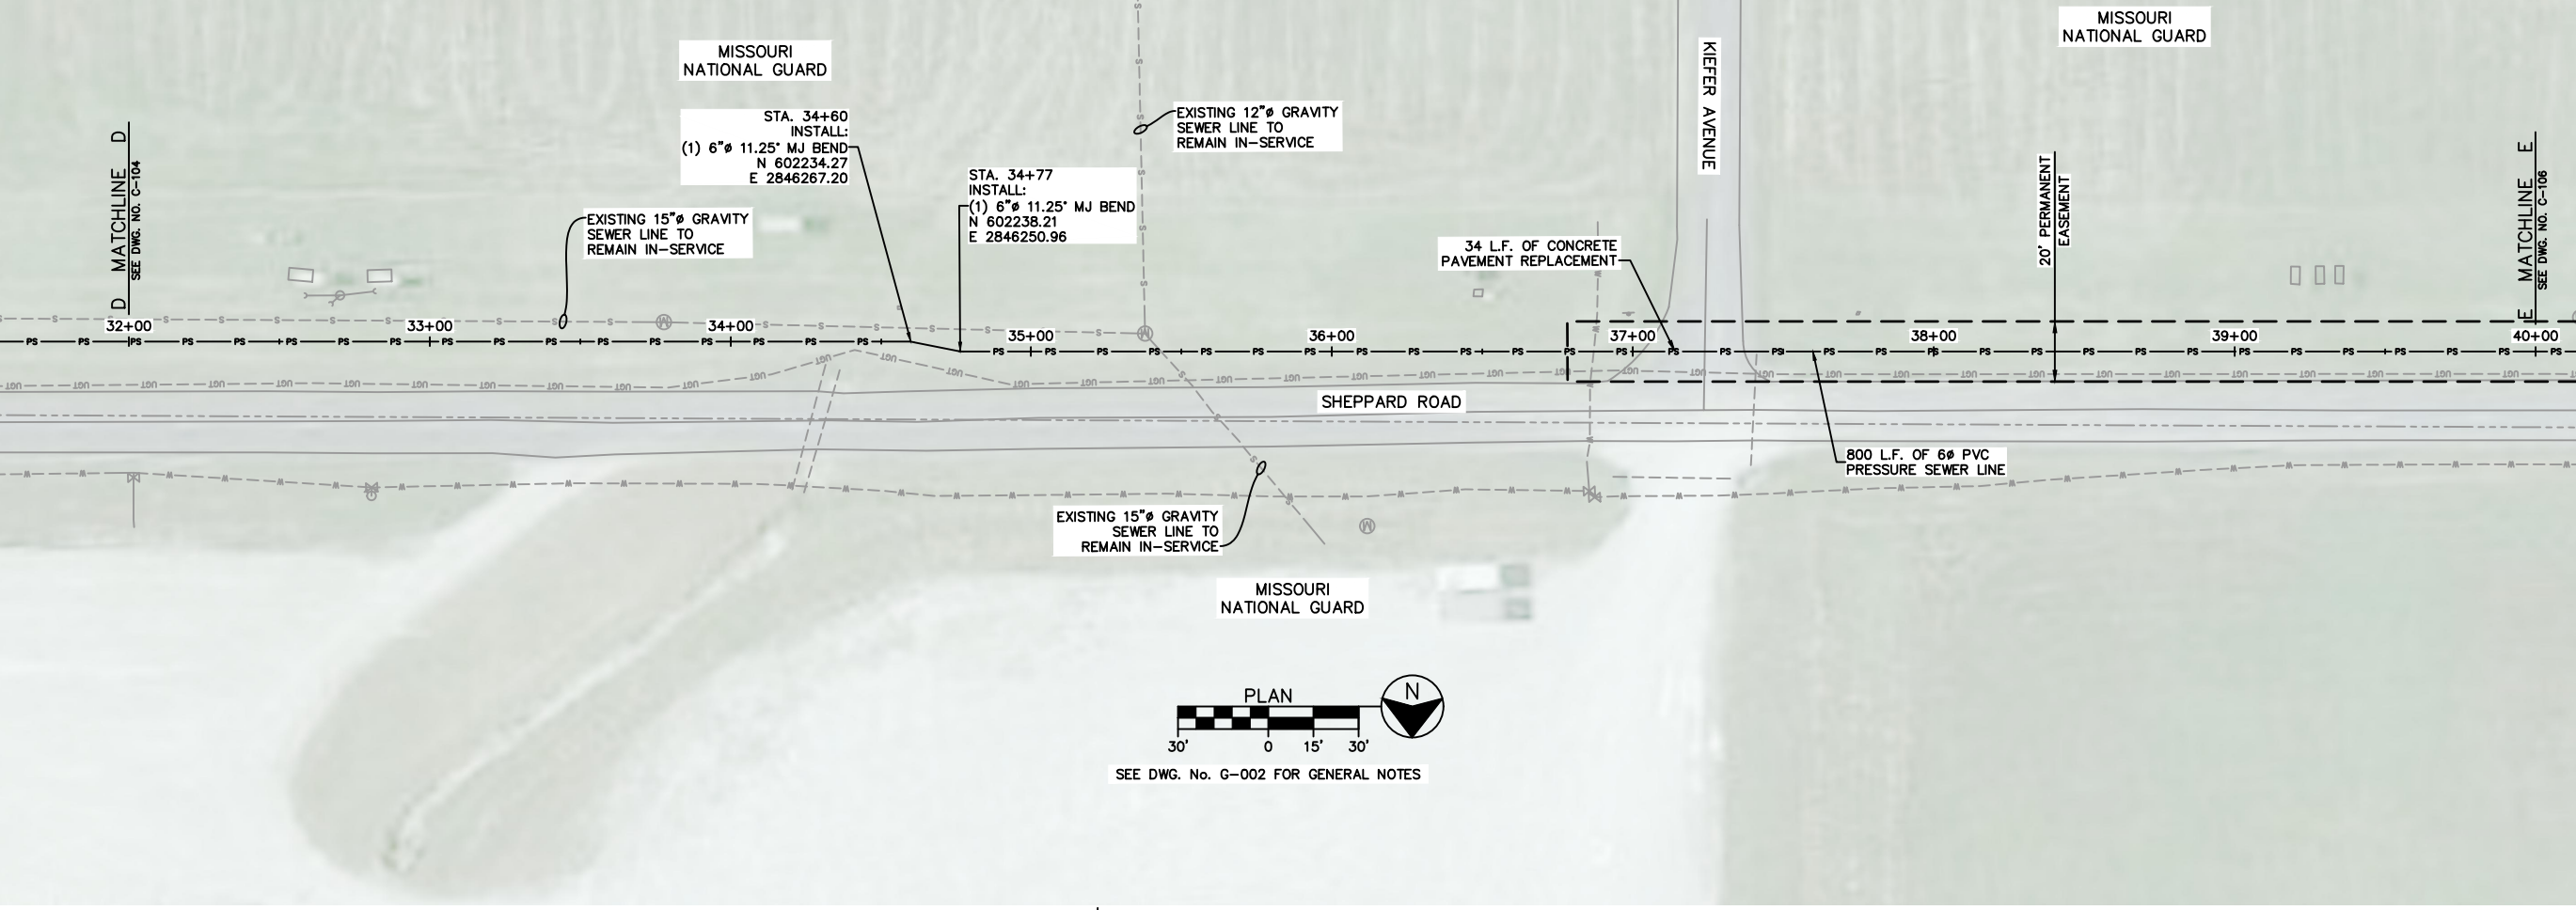

SCALE
 VERT. = 1:6
 HORIZ. = 1:30

STATE OF MISSOURI
 MICHAEL L. PARSON,
 GOVERNOR

CIVIL ENGINEER: GARRETT D. WAGNER
 LICENSE NO. PE-2019000226



OFFICE OF ADMINISTRATION
 DIVISION OF FACILITIES
 MANAGEMENT,
 DESIGN AND CONSTRUCTION

MISSOURI
 NATIONAL GUARD

CONNECT CAMP CLARK
 TO CITY OF NEVADA
 SEWER SYSTEM

CAMP CLARK
 NEVADA, MISSOURI

PROJECT # T2301-02
 SITE # 6274
 ASSET # 8136274075

REVISION: EASEMENTS
 DATE: 03-26-2024
 REVISION: REMOVE TEMP EASEMENT
 DATE: 05-03-2024
 REVISION:
 DATE:
 ISSUE DATE: 06/14/2024

CAD DWG FILE:
 DRAWN BY: AWW
 CHECKED BY: SCW
 DESIGNED BY: GDW

SHEET TITLE:
 PRESSURE SEWER
 PLAN & PROFILE

SHEET NUMBER:

C-105

7 OF 23 SHEETS



LEGEND			
---	EXISTING UNDERGROUND ELECTRIC	---x---x---	PROPOSED FENCE
---x---x---	EXISTING FENCE	---s---s---	PROPOSED GRAVITY SEWER
---F/O---	EXISTING FIBER OPTIC	---PS---PS---	PROPOSED PRESSURE SEWER
---GAS---	EXISTING GAS	---	PROPOSED TEMPORARY EASEMENT
---	EXISTING SEWER	---	PROPOSED PERMANENT EASEMENT
---UST---	EXISTING UNDERGROUND TELEPHONE	---	EXISTING MINOR CONTOURS
---	EXISTING RIGHT OF WAY	950	EXISTING MAJOR CONTOURS
---	EXISTING SECTION LINE	951	PROPOSED MINOR CONTOURS
---	EXISTING WATERLINE	---	---
---	---	950	PROPOSED MAJOR CONTOURS
---	---	⊙	EXISTING CLEANOUT
---	---	⊙	CONTROL POINT
---	---	⊙	EXISTING FIRE HYDRANT
---	---	⊙	EXISTING GAS METER
---	---	⊙	EXISTING GAS VALVE
---	---	⊙	EXISTING IRON PIN
---	---	⊙	EXISTING MAILBOX
---	---	⊙	EXISTING MANHOLE
---	---	⊙	EXISTING PIPE POST
---	---	⊙	EXISTING LIGHT POLE
---	---	⊙	EXISTING POWER POLE
---	---	⊙	EXISTING RW MARKER
---	---	⊙	EXISTING SIGN
---	---	⊙	EXISTING TELEPEDESTAL
---	---	⊙	EXISTING TREE
---	---	⊙	EXISTING SHRUB
---	---	⊙	EXISTING WATER METER
---	---	⊙	EXISTING WATER VALVE
---	---	⊙	EXISTING WATER HYDRANT
---	---	⊙	PROPOSED MANHOLE
---	---	⊙	PROPOSED AIR RELEASE VALVE

PRESSURE SEWER NOTES:

- NO. 12 COATED COPPER DETECTION WIRE SHALL BE RUN IN TRENCH FOR ENTIRE LENGTH OF INSTALLED PRESSURE SEWER MAIN, PER DETAILS AND SPECIFICATIONS.
- PRESSURE SEWER LINE SHALL BE INSTALLED WITH A MINIMUM OF 42" OF COVER OVER TOP OF PIPE.

STATE OF MISSOURI
MICHAEL L. PARSON,
GOVERNOR

CIVIL ENGINEER: GARRETT D. WAGNER
LICENSE NO. PE-2019000226

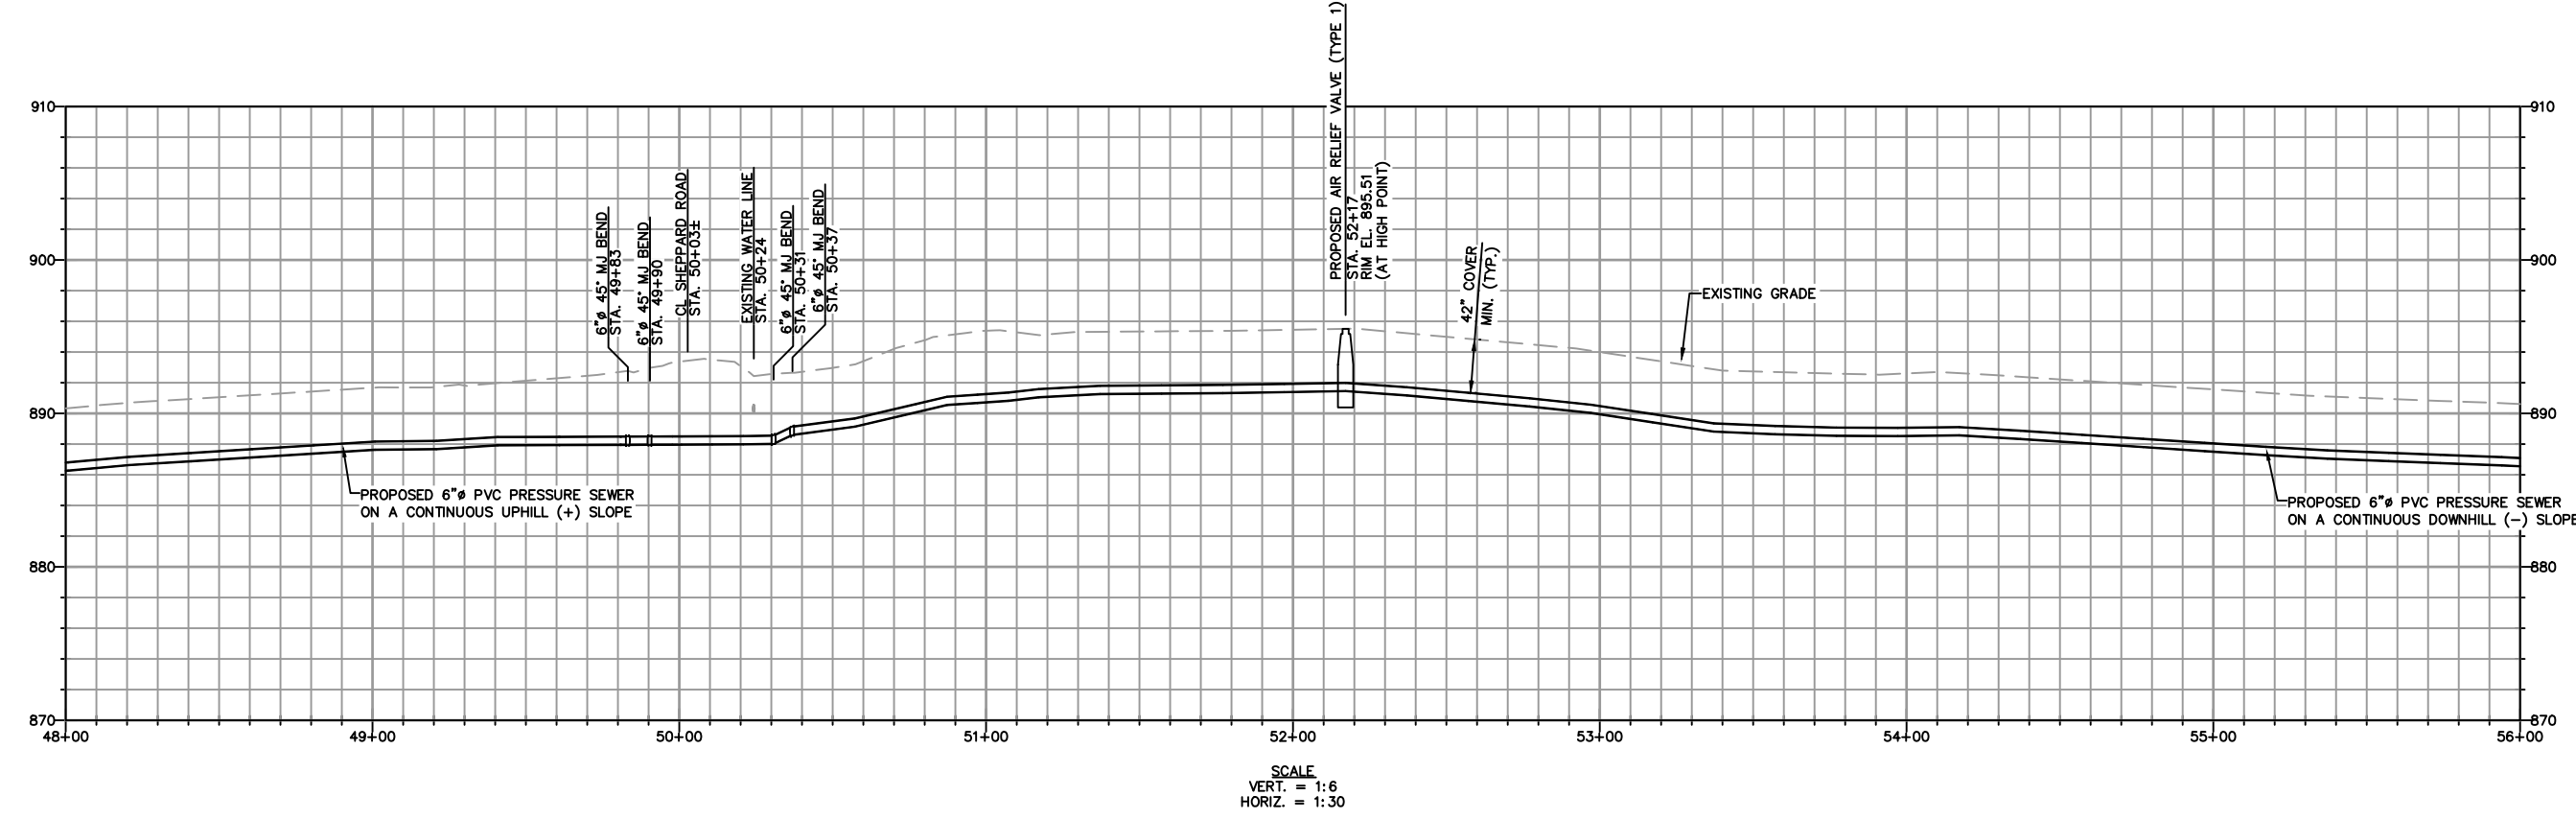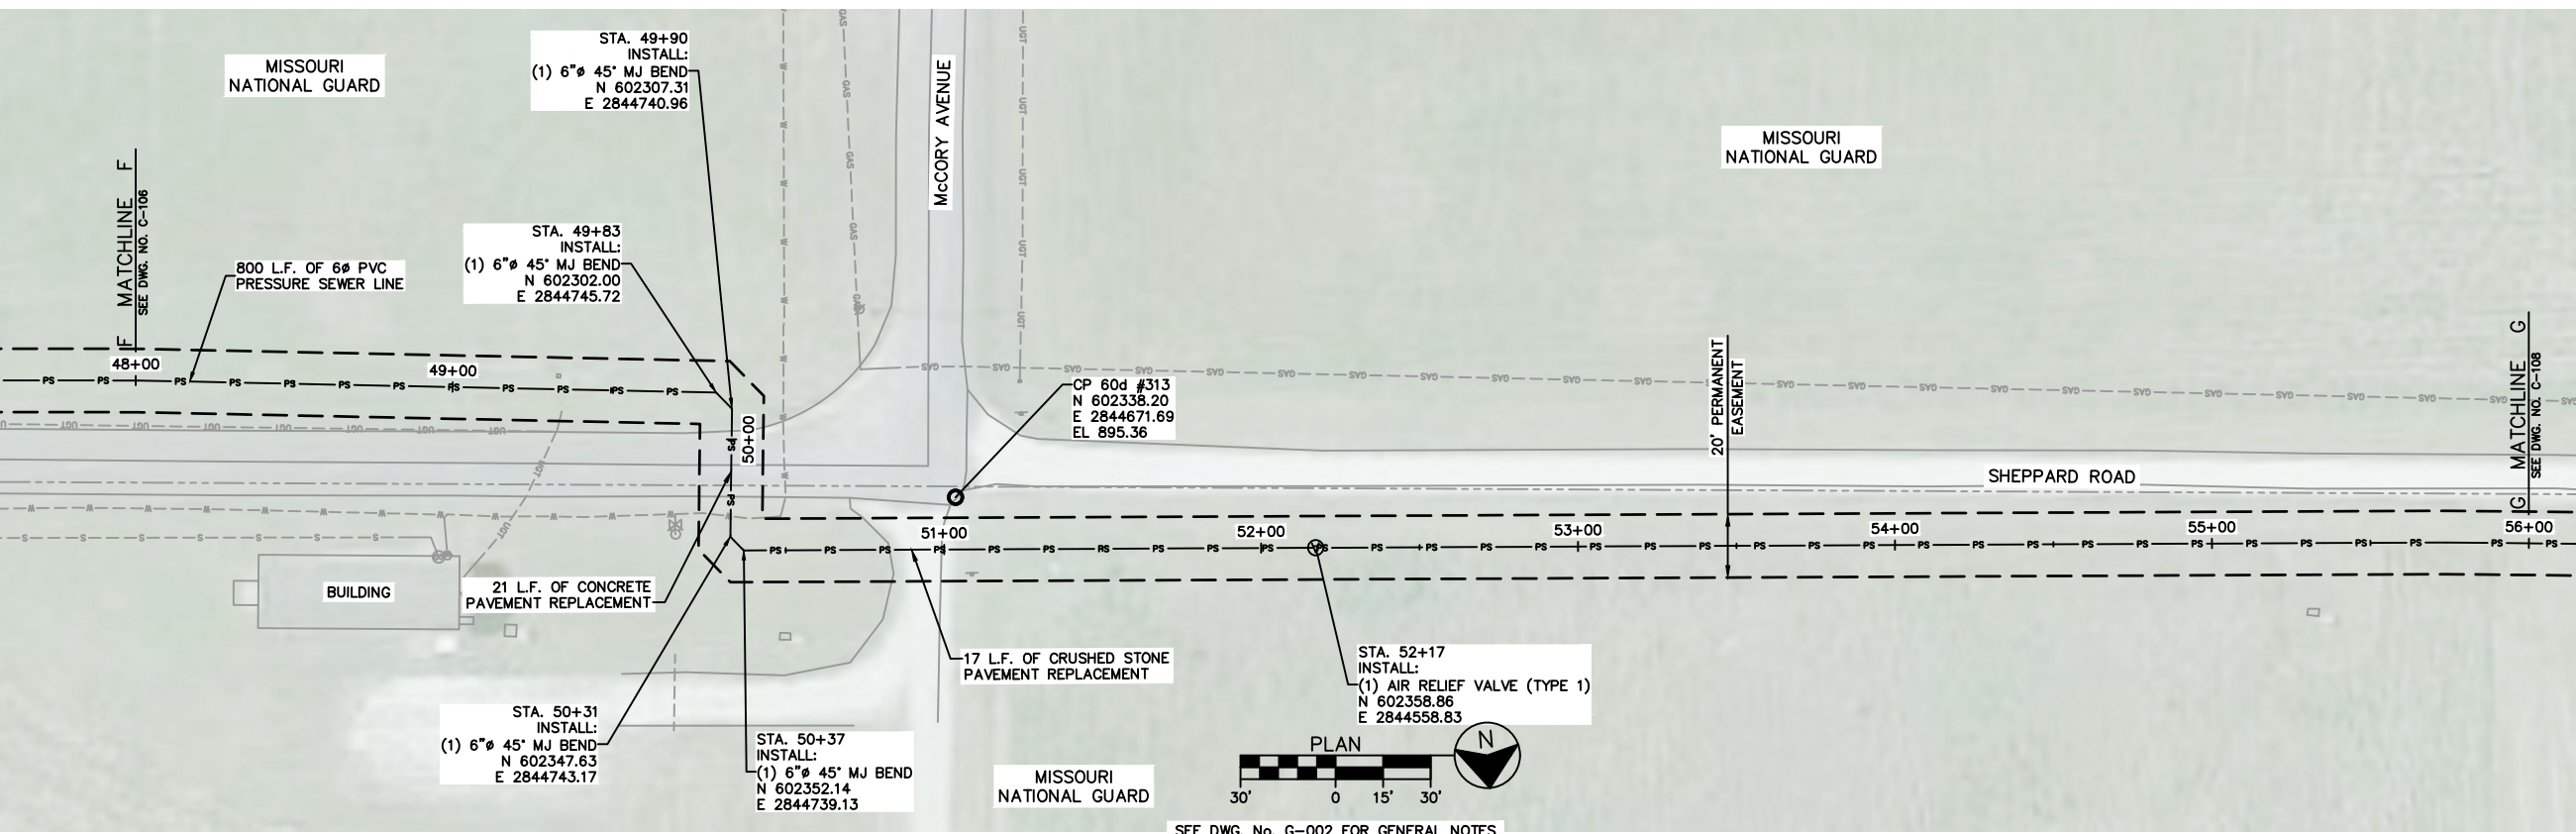

OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES
MANAGEMENT,
DESIGN AND CONSTRUCTION

MISSOURI
NATIONAL GUARD

CONNECT CAMP CLARK
TO CITY OF NEVADA
SEWER SYSTEM

CAMP CLARK
NEVADA, MISSOURI


PROJECT # T2301-02
SITE # 6274
ASSET # 8136274075

REVISION: REMOVE TEMP EASEMENT
DATE: 05-03-2024
REVISION: _____
DATE: _____
REVISION: _____
DATE: _____
ISSUE DATE: 06/14/2024

CAD DWG FILE: _____
DRAWN BY: AWW
CHECKED BY: SCW
DESIGNED BY: GDW

SHEET TITLE:
**PRESSURE SEWER
PLAN & PROFILE**

SHEET NUMBER:
C-107
9 OF 23 SHEETS

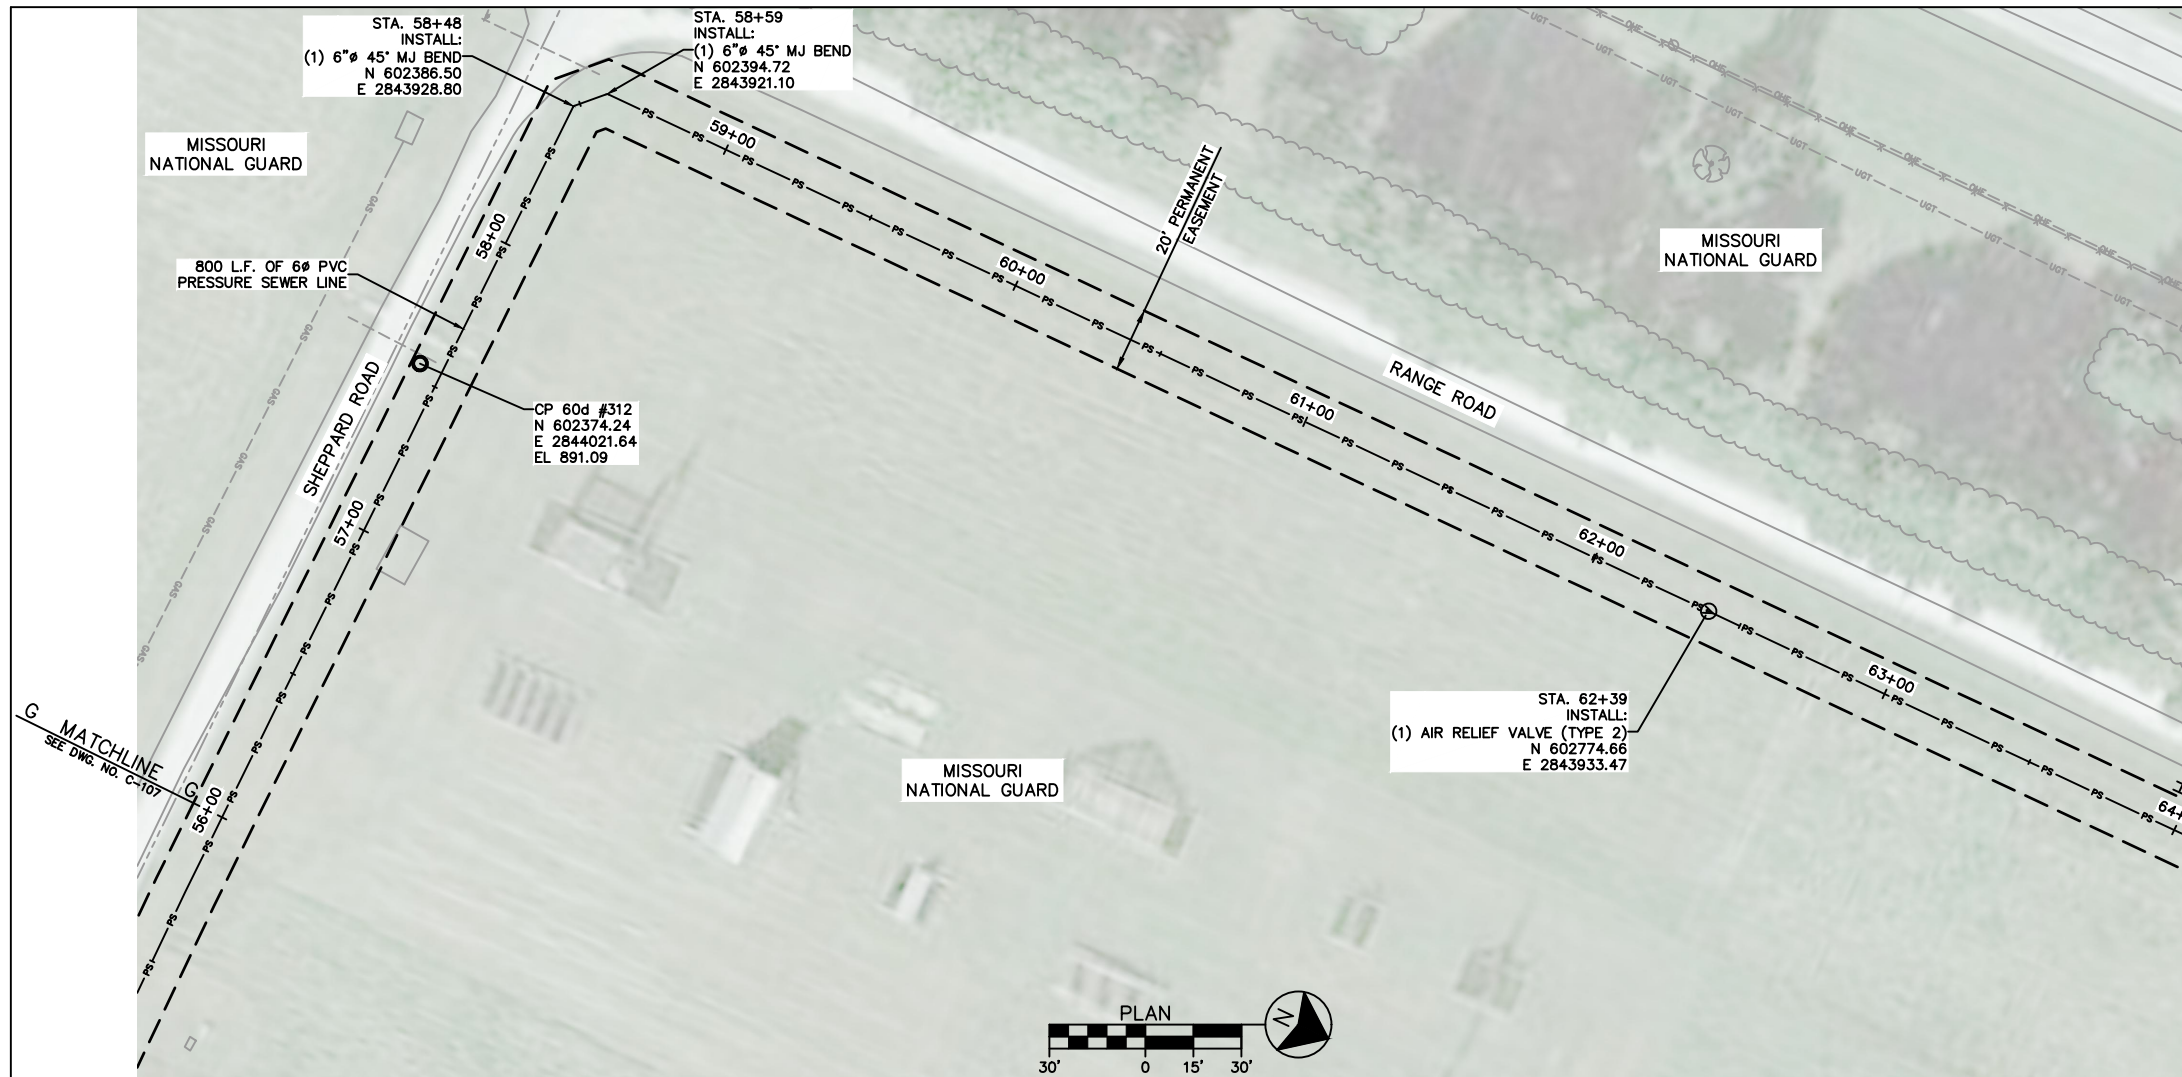

SEE DWG. No. G-002 FOR GENERAL NOTES

PRESSURE SEWER NOTES:

- NO. 12 COATED COPPER DETECTION WIRE SHALL BE RUN IN TRENCH FOR ENTIRE LENGTH OF INSTALLED PRESSURE SEWER MAIN, PER DETAILS AND SPECIFICATIONS.
- PRESSURE SEWER LINE SHALL BE INSTALLED WITH A MINIMUM OF 42" OF COVER OVER TOP OF PIPE.

LEGEND

---	EXISTING UNDERGROUND ELECTRIC	⊙	EXISTING FIRE HYDRANT
---	EXISTING FENCE	▲	EXISTING GAS METER
---	EXISTING FIBER OPTIC	•	EXISTING GAS VALVE
---	EXISTING GAS	○	EXISTING IRON PIN
---	EXISTING SEWER	⊞	EXISTING MAILBOX
---	EXISTING UNDERGROUND TELEPHONE	⊕	EXISTING MANHOLE
---	EXISTING RIGHT OF WAY	⊙	EXISTING PIPE POST
---	EXISTING SECTION LINE	⊗	EXISTING LIGHT POLE
---	EXISTING WATERLINE	⊙	EXISTING POWER POLE
---	PROPOSED FENCE	▲	EXISTING RW MARKER
---	PROPOSED GRAVITY SEWER	+	EXISTING SIGN
---	PROPOSED PRESSURE SEWER	⊕	EXISTING TELEPEDESTAL
---	PROPOSED TEMPORARY EASEMENT	⊙	EXISTING TREE
---	PROPOSED PERMANENT EASEMENT	⊙	EXISTING SHRUB
---	EXISTING MINOR CONTOURS	⊙	EXISTING WATER METER
---	EXISTING MAJOR CONTOURS	⊙	EXISTING WATER VALVE
---	PROPOSED MINOR CONTOURS	⊙	EXISTING WATER HYDRANT
---	PROPOSED MAJOR CONTOURS	⊕	PROPOSED MANHOLE
⊙	EXISTING CLEANOUT	⊕	PROPOSED AIR RELEASE VALVE
○	CONTROL POINT		

STATE OF MISSOURI
MICHAEL L. PARSON,
GOVERNOR

CIVIL ENGINEER: GARRETT D. WAGNER
LICENSE NO. PE-2019000226



OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES
MANAGEMENT,
DESIGN AND CONSTRUCTION

MISSOURI
NATIONAL GUARD

CONNECT CAMP CLARK
TO CITY OF NEVADA
SEWER SYSTEM

CAMP CLARK

NEVADA, MISSOURI

PROJECT # T2301-02
SITE # 6274
ASSET # 8136274075

REVISION: REMOVE TEMP EASEMENT
DATE: 05-03-2024
REVISION: _____
DATE: _____
REVISION: _____
DATE: _____
ISSUE DATE: 06/14/2024


CAD DWG FILE: _____
DRAWN BY: AWW
CHECKED BY: SCW
DESIGNED BY: GDW

SHEET TITLE:
**PRESSURE SEWER
PLAN & PROFILE**

SHEET NUMBER:

C-108

10 OF 23 SHEETS

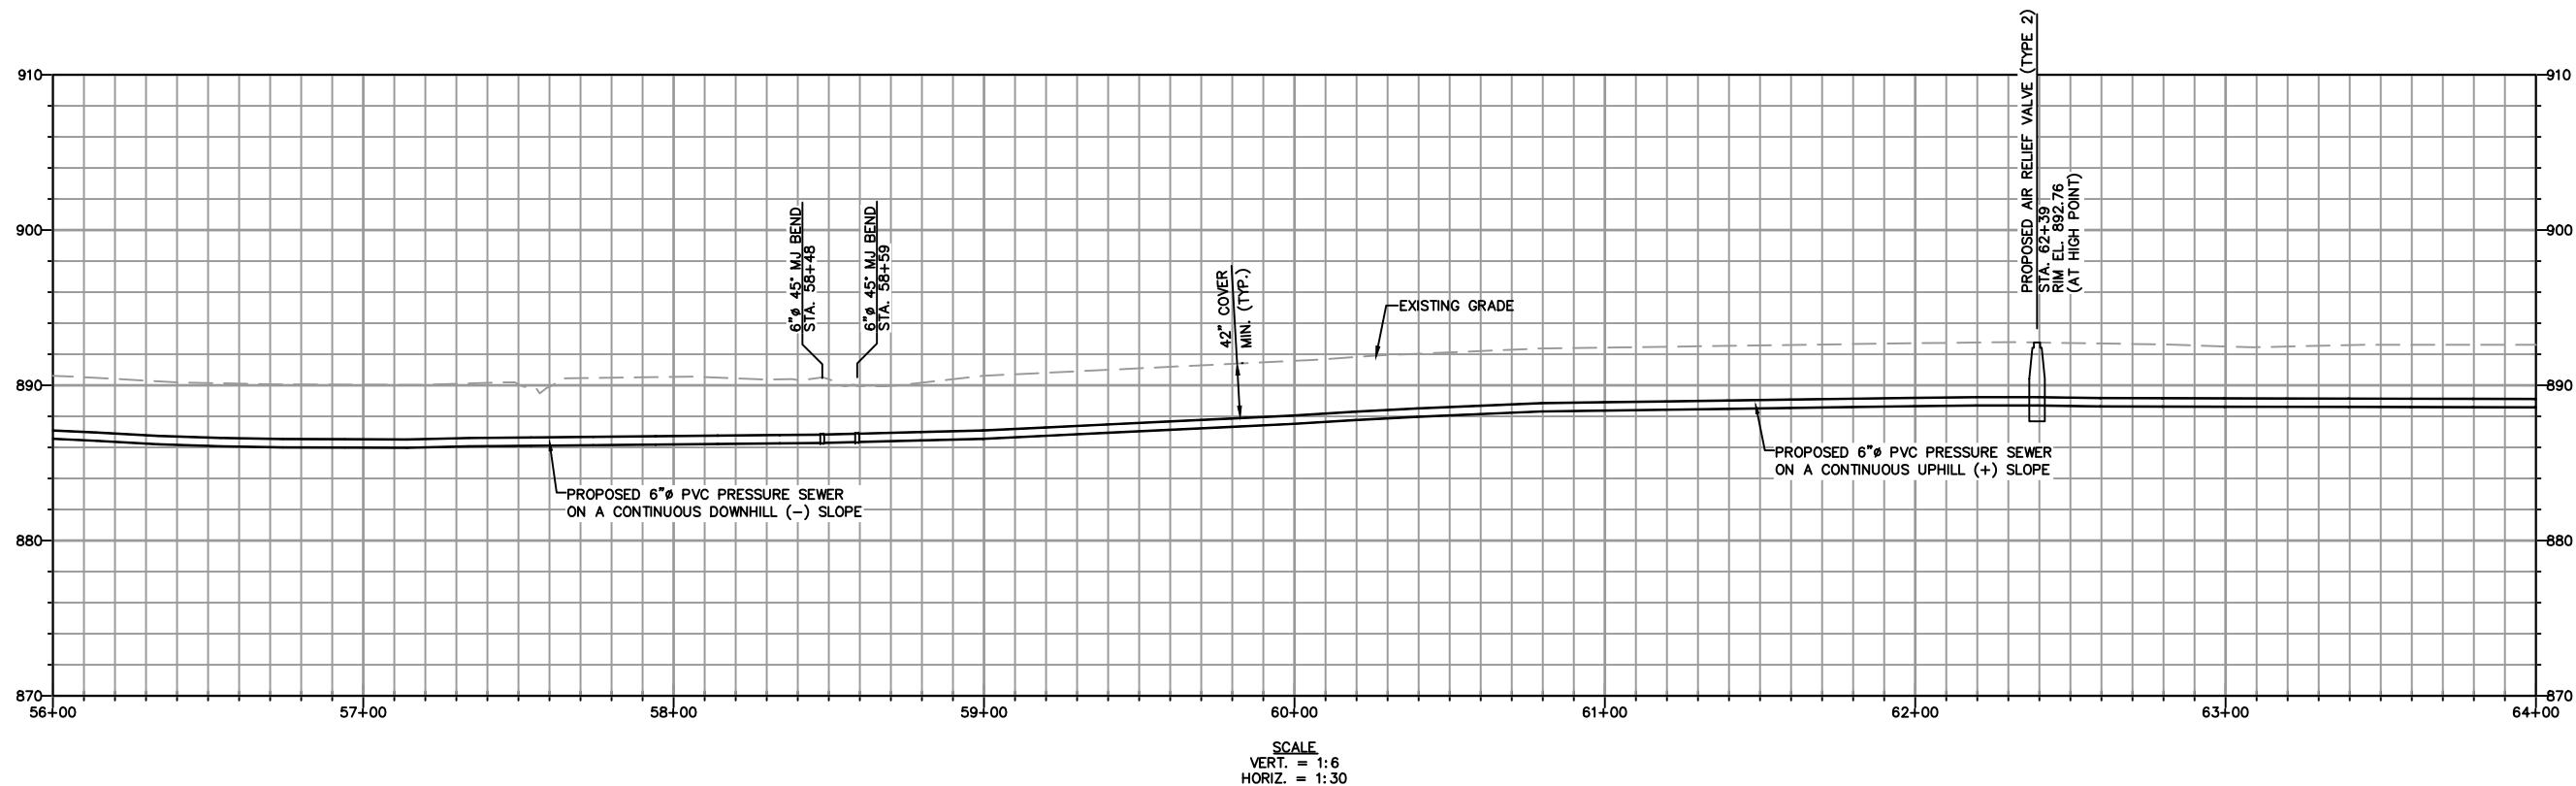

SCALE
VERT. = 1:6
HORIZ. = 1:30


LEGEND			
--- UGE ---	EXISTING UNDERGROUND ELECTRIC	--- X-X-X ---	PROPOSED FENCE
--- S-S-S ---	EXISTING FENCE	--- S-S-S ---	PROPOSED GRAVITY SEWER
--- F/O ---	EXISTING FIBER OPTIC	--- PS-PS ---	PROPOSED PRESSURE SEWER
--- GAS ---	EXISTING GAS	-----	PROPOSED TEMPORARY EASEMENT
--- S-S-S ---	EXISTING SEWER	-----	PROPOSED PERMANENT EASEMENT
--- UGT ---	EXISTING UNDERGROUND TELEPHONE	951	EXISTING MINOR CONTOURS
---	EXISTING RIGHT OF WAY	950	EXISTING MAJOR CONTOURS
---	EXISTING SECTION LINE	951	PROPOSED MINOR CONTOURS
--- W ---	EXISTING WATERLINE		
--- 950 ---	PROPOSED MAJOR CONTOURS	⊙	EXISTING CLEANOUT
⊙	CONTROL POINT	⊙	EXISTING FIRE HYDRANT
⊙	EXISTING GAS METER	⊙	EXISTING GAS VALVE
⊙	EXISTING IRON PIN	⊙	EXISTING MAILBOX
⊙	EXISTING MANHOLE	⊙	EXISTING TREE
⊙	EXISTING PIPE POST	⊙	EXISTING SHRUB
⊙	EXISTING LIGHT POLE	⊙	
⊙	EXISTING POWER POLE	⊙	
⊙	EXISTING RW MARKER	⊙	
⊙	EXISTING SIGN	⊙	
⊙	EXISTING TELEPEDESTAL	⊙	
⊙	EXISTING WATER METER	⊙	
⊙	EXISTING WATER VALVE	⊙	
⊙	EXISTING WATER HYDRANT	⊙	
⊙	PROPOSED MANHOLE	⊙	
⊙	PROPOSED AIR RELEASE VALVE	⊙	

PRESSURE SEWER NOTES:

- NO. 12 COATED COPPER DETECTION WIRE SHALL BE RUN IN TRENCH FOR ENTIRE LENGTH OF INSTALLED PRESSURE SEWER MAIN, PER DETAILS AND SPECIFICATIONS.
- PRESSURE SEWER LINE SHALL BE INSTALLED WITH A MINIMUM OF 42" OF COVER OVER TOP OF PIPE.

STATE OF MISSOURI
MICHAEL L. PARSON,
GOVERNOR

CIVIL ENGINEER: GARRETT D. WAGNER
LICENSE NO. PE-2019000226



OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES
MANAGEMENT,
DESIGN AND CONSTRUCTION

MISSOURI
NATIONAL GUARD

CONNECT CAMP CLARK
TO CITY OF NEVADA
SEWER SYSTEM

CAMP CLARK

NEVADA, MISSOURI

PROJECT # T2301-02
SITE # 6274
ASSET # 8136274075

REVISION: REMOVE TEMP EASEMENT
DATE: 05-03-2024
REVISION: _____
DATE: _____
REVISION: _____
DATE: _____
ISSUE DATE: 06/14/2024



CAD DWG FILE: _____
DRAWN BY: AWW
CHECKED BY: SCW
DESIGNED BY: GDW

SHEET TITLE:
**PRESSURE SEWER
PLAN & PROFILE**


SHEET NUMBER:

C-109

11 OF 23 SHEETS

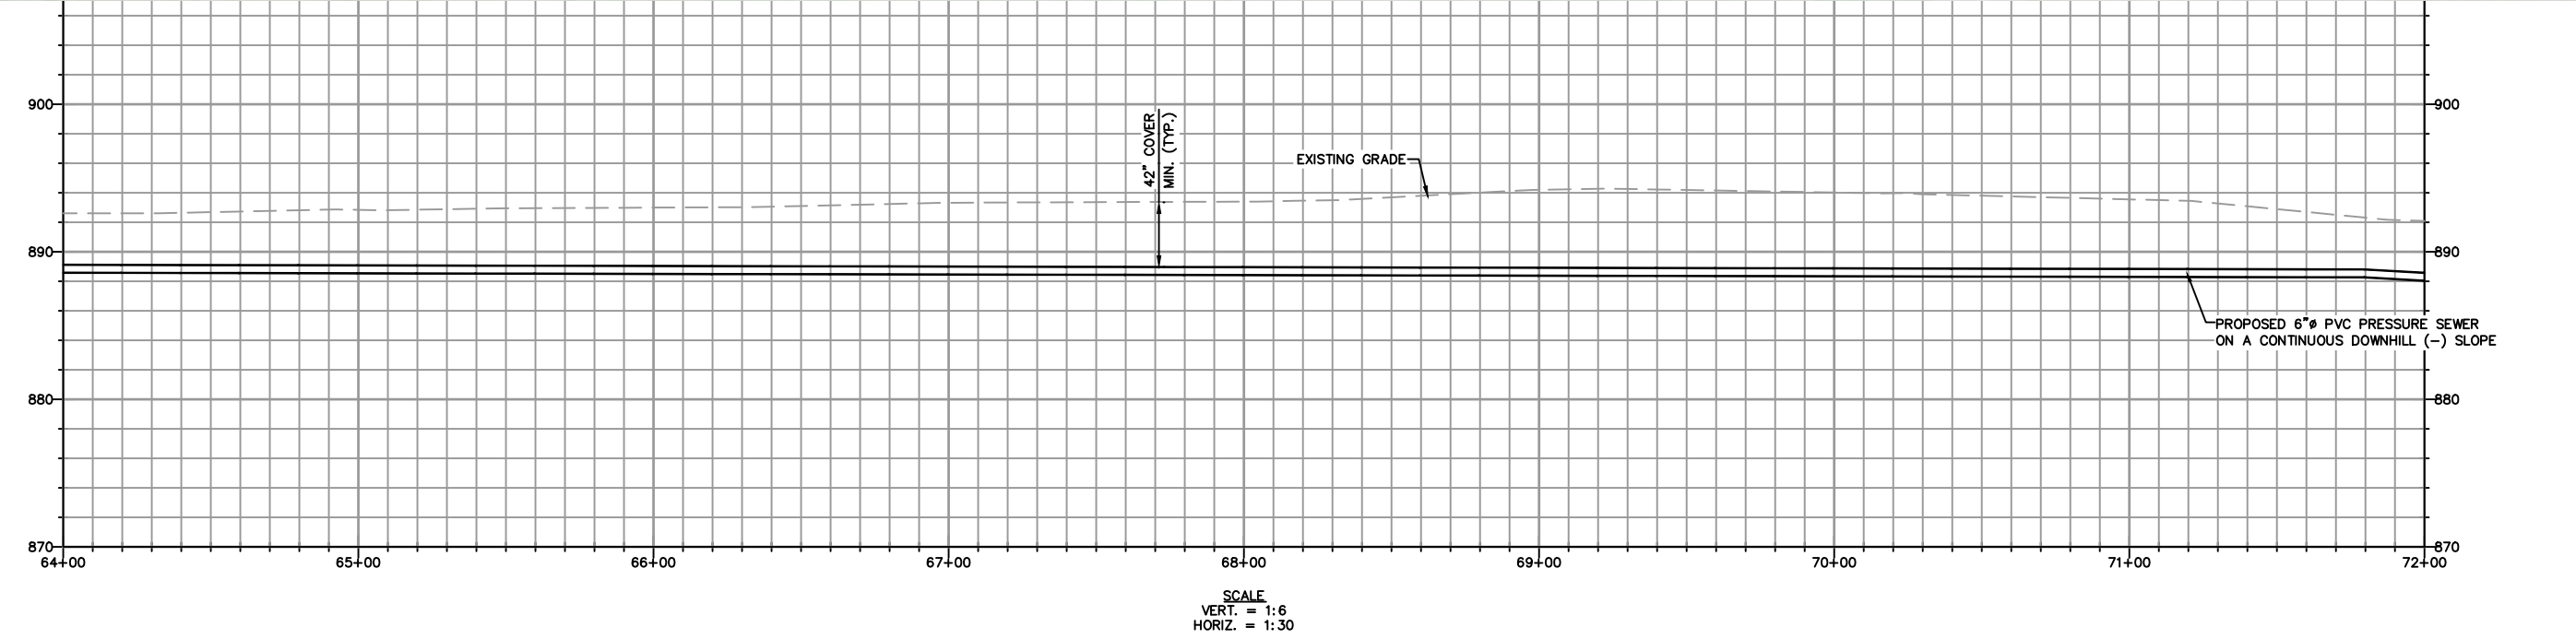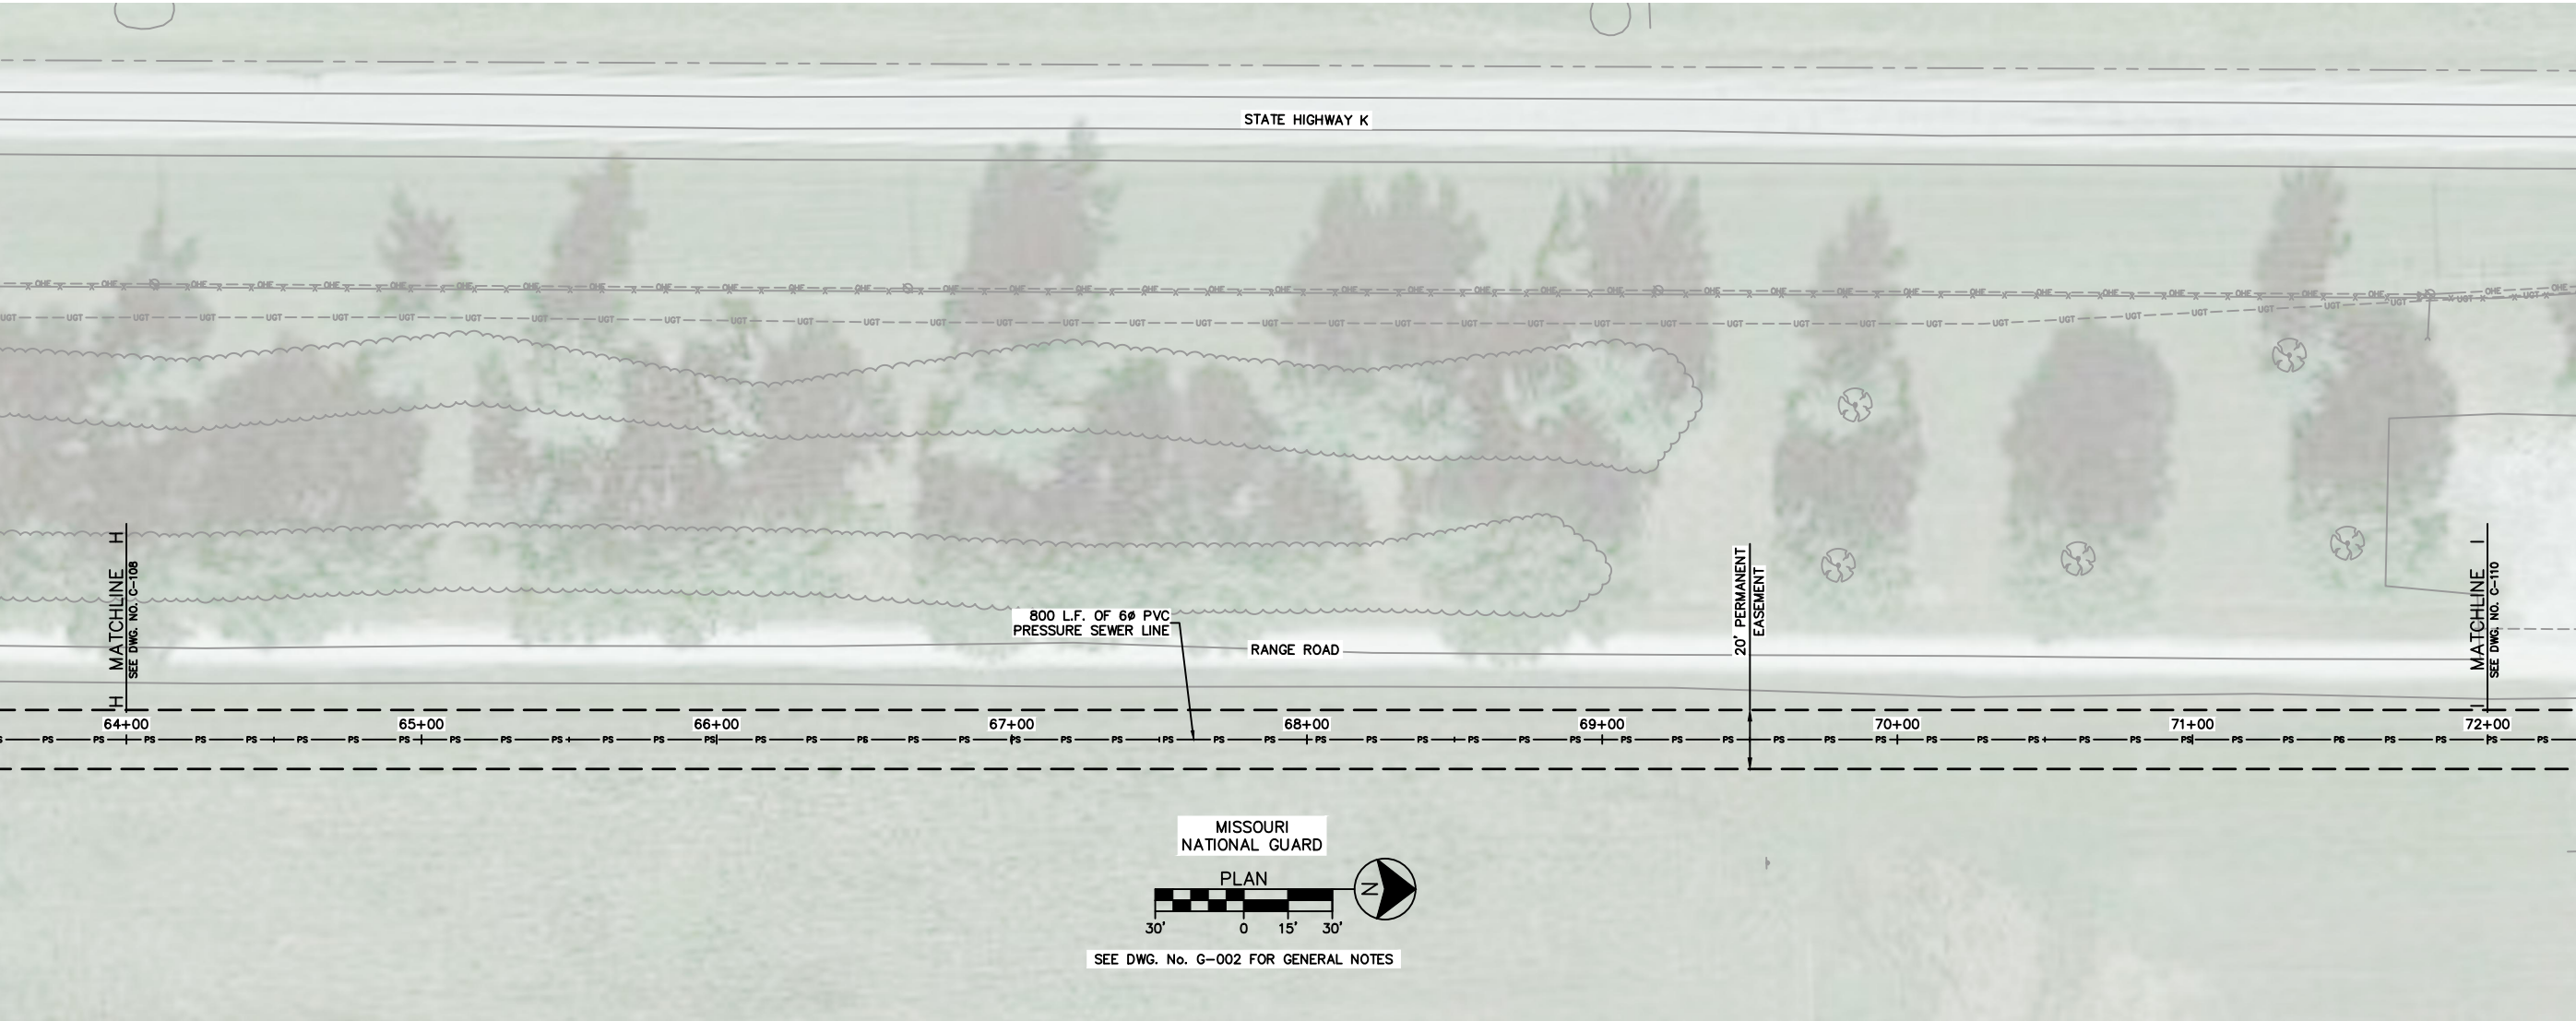

SCALE
VERT. = 1:6
HORIZ. = 1:30

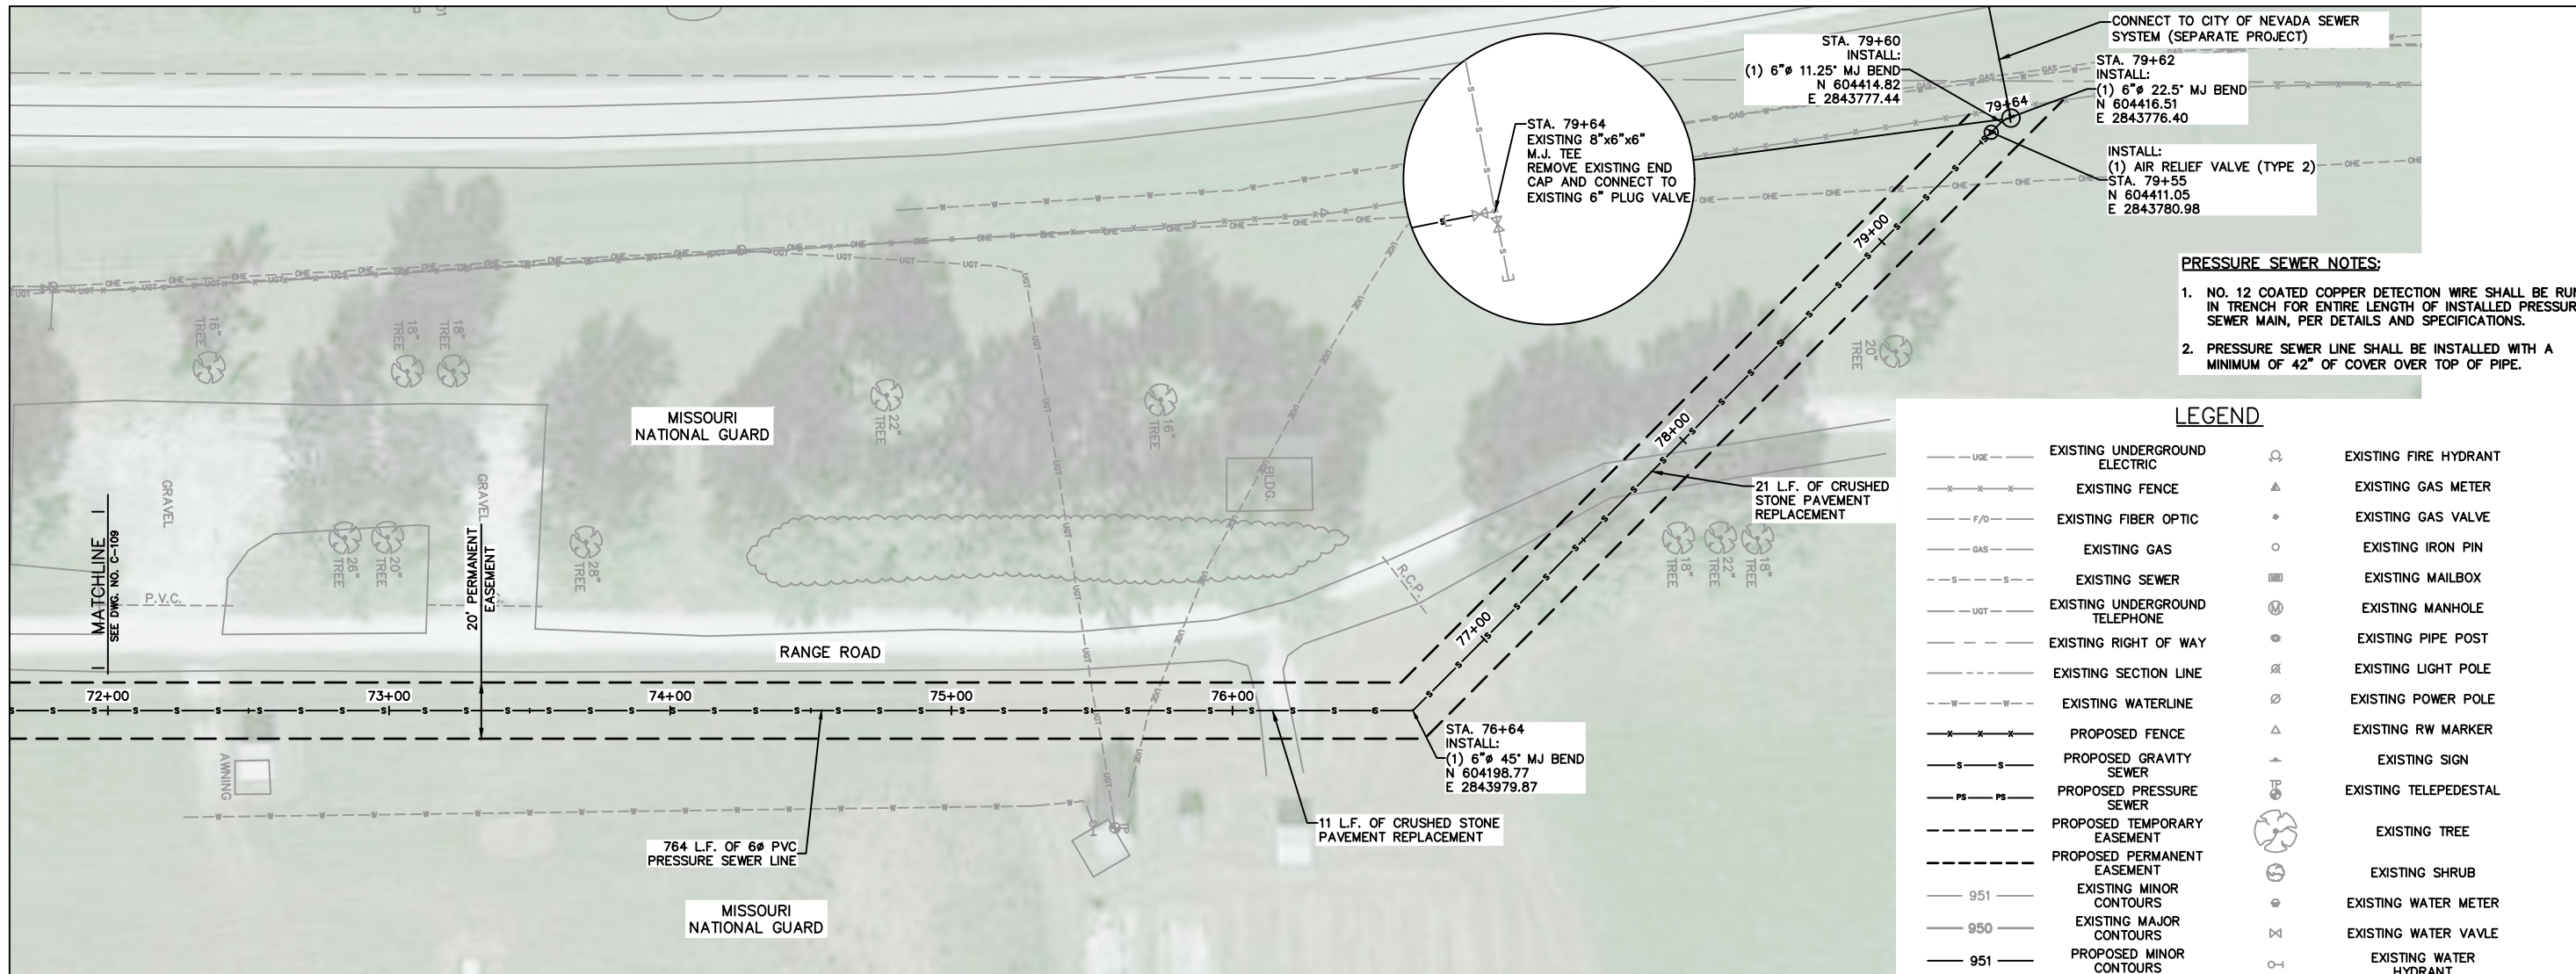


PRESSURE SEWER NOTES:


- NO. 12 COATED COPPER DETECTION WIRE SHALL BE RUN IN TRENCH FOR ENTIRE LENGTH OF INSTALLED PRESSURE SEWER MAIN, PER DETAILS AND SPECIFICATIONS.
- PRESSURE SEWER LINE SHALL BE INSTALLED WITH A MINIMUM OF 42" OF COVER OVER TOP OF PIPE.

LEGEND

---	EXISTING UNDERGROUND ELECTRIC	⊙	EXISTING FIRE HYDRANT
-x-x-	EXISTING FENCE	▲	EXISTING GAS METER
-F/O-	EXISTING FIBER OPTIC	•	EXISTING GAS VALVE
-GAS-	EXISTING GAS	○	EXISTING IRON PIN
-S-S-	EXISTING SEWER	⊞	EXISTING MAILBOX
-UST-	EXISTING UNDERGROUND TELEPHONE	⊕	EXISTING MANHOLE
- - -	EXISTING RIGHT OF WAY	⊙	EXISTING PIPE POST
- - -	EXISTING SECTION LINE	⊙	EXISTING LIGHT POLE
-W-W-	EXISTING WATERLINE	⊙	EXISTING POWER POLE
-x-x-	PROPOSED FENCE	▲	EXISTING RW MARKER
-S-S-	PROPOSED GRAVITY SEWER	⊙	EXISTING SIGN
-PS-PS-	PROPOSED PRESSURE SEWER	⊙	EXISTING TELEPEDESTAL
- - -	PROPOSED TEMPORARY EASEMENT	⊙	EXISTING TREE
- - -	PROPOSED PERMANENT EASEMENT	⊙	EXISTING SHRUB
951	EXISTING MINOR CONTOURS	⊙	EXISTING WATER METER
950	EXISTING MAJOR CONTOURS	⊙	EXISTING WATER VALVE
951	PROPOSED MINOR CONTOURS	⊙	EXISTING WATER HYDRANT
950	PROPOSED MAJOR CONTOURS	⊙	PROPOSED MANHOLE
⊙	EXISTING CLEANOUT	⊙	PROPOSED AIR RELEASE VALVE
○	CONTROL POINT		



SEE DWG. No. G-002 FOR GENERAL NOTES

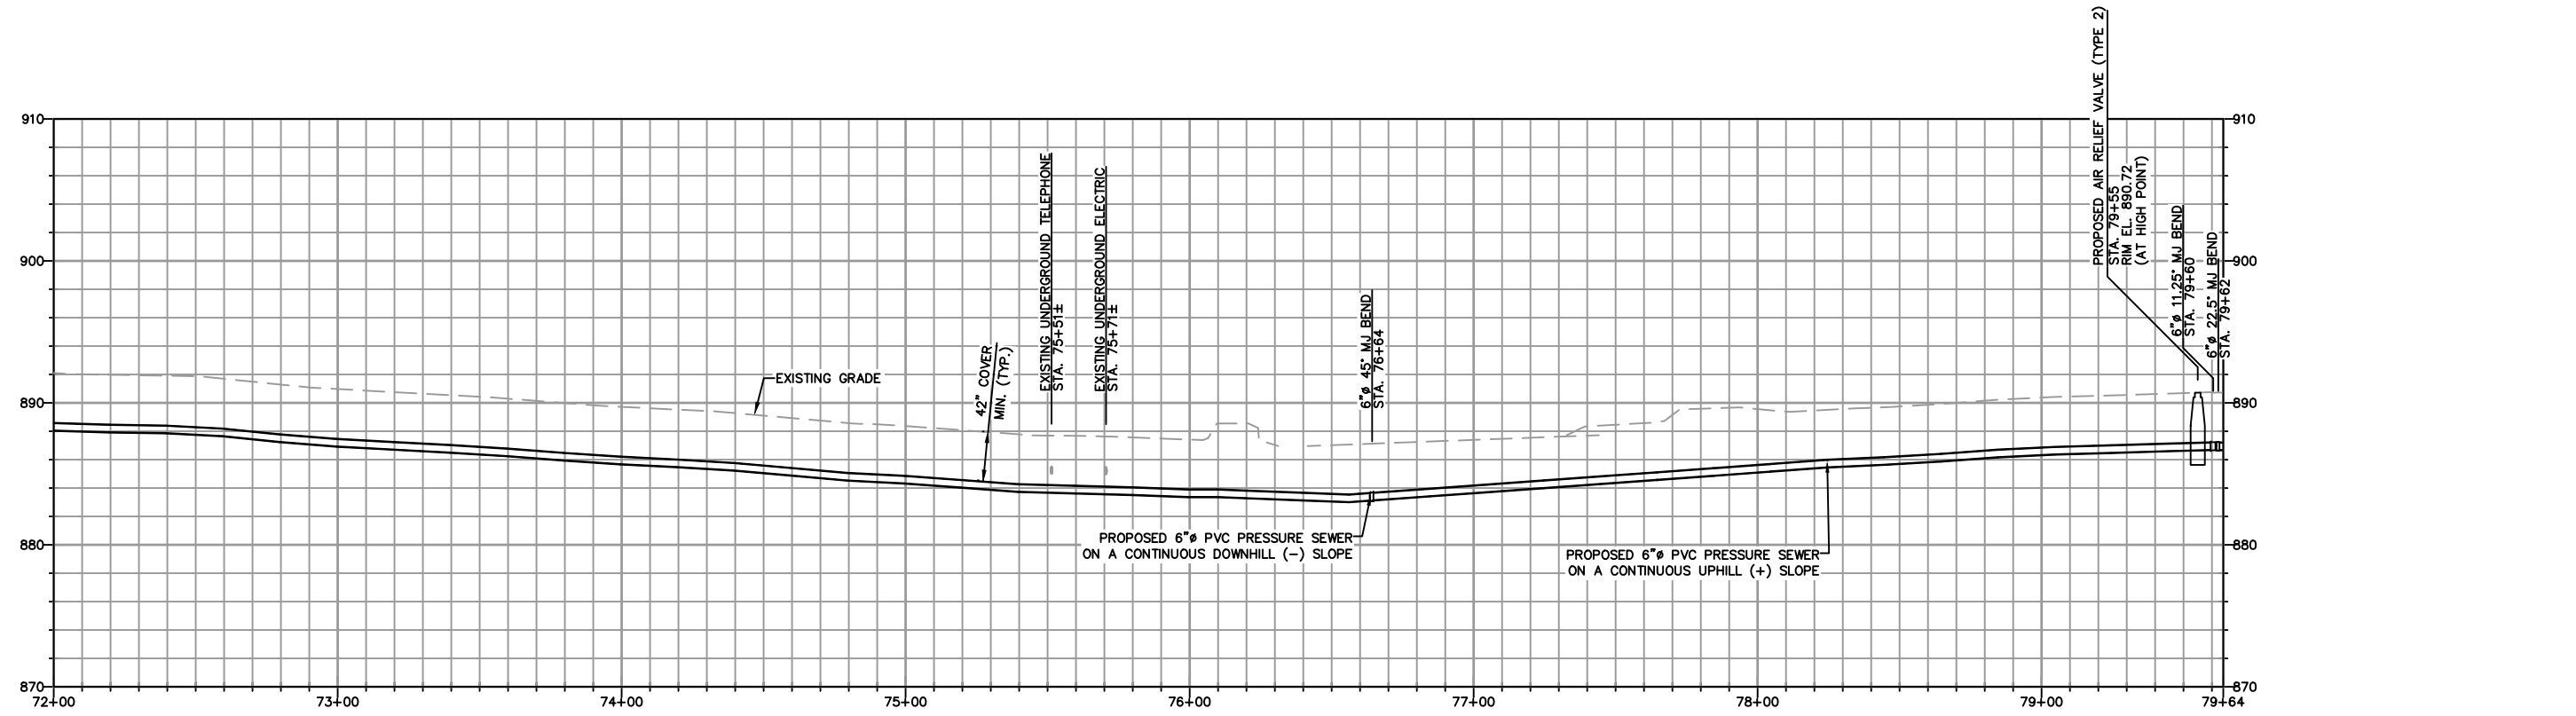

SCALE
VERT. = 1:6
HORIZ. = 1:30

STATE OF MISSOURI
MICHAEL L. PARSON,
GOVERNOR

CIVIL ENGINEER: GARRETT D. WAGNER
LICENSE NO. PE-2019000226



OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES
MANAGEMENT,
DESIGN AND CONSTRUCTION

MISSOURI
NATIONAL GUARD

CONNECT CAMP CLARK
TO CITY OF NEVADA
SEWER SYSTEM

CAMP CLARK
NEVADA, MISSOURI



PROJECT # T2301-02
SITE # 6274
ASSET # 8136274075

REVISION: REMOVE TEMP EASEMENT
DATE: 05-03-2024
REVISION: _____
DATE: _____
REVISION: _____
DATE: _____
ISSUE DATE: 06/14/2024


CAD DWG FILE: _____
DRAWN BY: AWW
CHECKED BY: SCW
DESIGNED BY: GDW

SHEET TITLE:
**PRESSURE SEWER
PLAN & PROFILE**

SHEET NUMBER:
C-110
12 OF 23 SHEETS

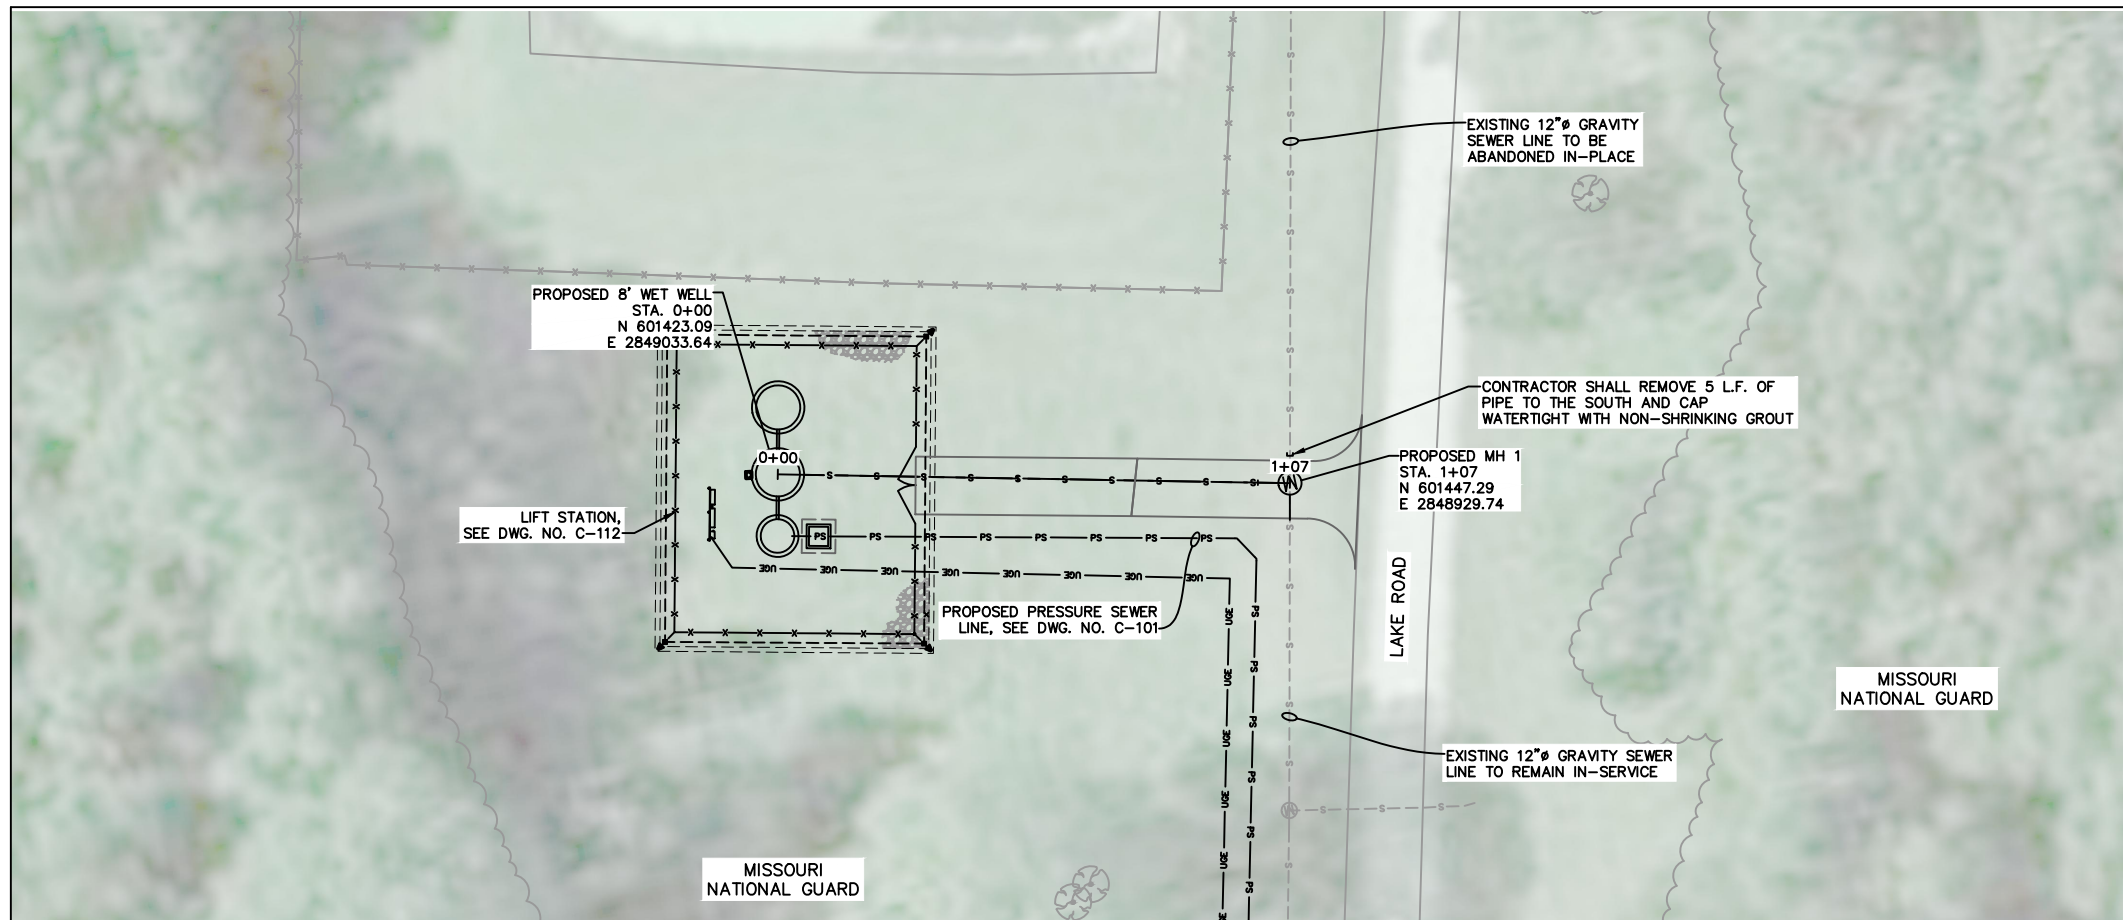

SEE DWG. No. G-002 FOR GENERAL NOTES

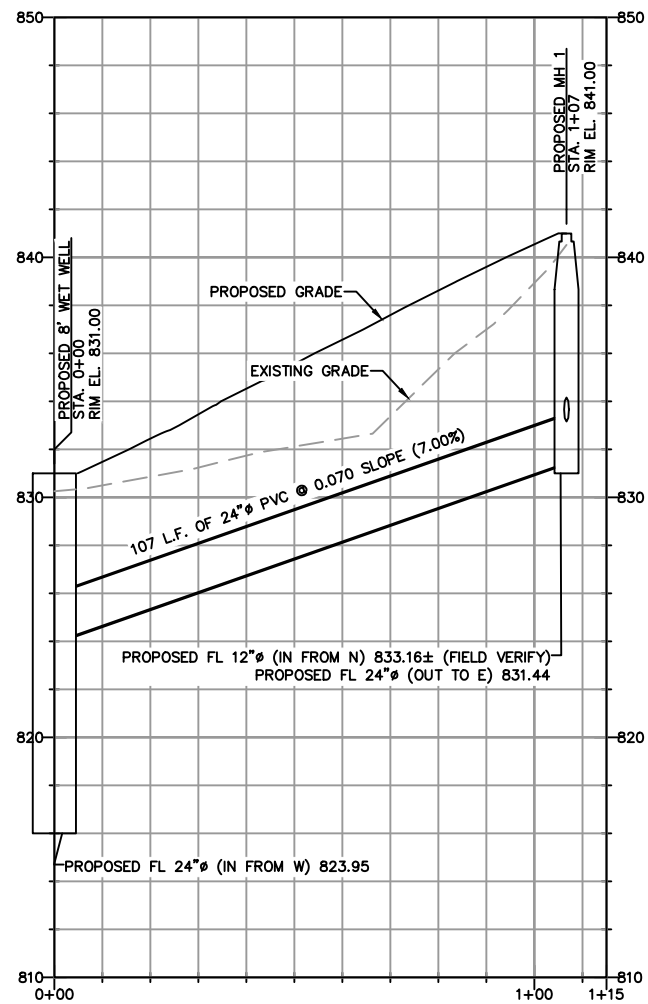

SCALE
VERT. = 1:6
HORIZ. = 1:30

EASEMENT NOTE:


SANITARY SEWER EASEMENTS HAVE NOT BEEN OBTAINED DUE TO THE PROPOSED PRESSURE SEWER PIPE AND LIFT STATION BEING LOCATED ON FEDERAL PROPERTY THAT IS COVERED IN ARMY REGULATION (AR 405-80) GRANTING ACCESS FOR ALL QUALIFYING UTILITIES.

LEGEND

---	EXISTING UNDERGROUND ELECTRIC	⊗	EXISTING FIRE HYDRANT
-x-x-	EXISTING FENCE	▲	EXISTING GAS METER
-F/O-	EXISTING FIBER OPTIC	•	EXISTING GAS VALVE
-GAS-	EXISTING GAS	○	EXISTING IRON PIN
-S-S-	EXISTING GRAVITY SEWER	■	EXISTING MAILBOX
-TST-	EXISTING UNDERGROUND TELEPHONE	⊙	EXISTING MANHOLE
- - -	EXISTING RIGHT OF WAY	●	EXISTING PIPE POST
- - - -	EXISTING SECTION LINE	⊗	EXISTING LIGHT POLE
-W-W-	EXISTING WATERLINE	∅	EXISTING POWER POLE
-x-x-	PROPOSED FENCE	▲	EXISTING RW MARKER
-S-S-	PROPOSED SEWER	▲	EXISTING SIGN
-PS-PS-	PROPOSED PRESSURE SEWER	TP	EXISTING TELEPEDESTAL
- - - -	PROPOSED TEMPORARY EASEMENT	⊗	EXISTING TREE
- - - -	PROPOSED PERMANENT EASEMENT	⊗	EXISTING SHRUB
951	EXISTING MINOR CONTOURS	•	EXISTING WATER METER
950	EXISTING MAJOR CONTOURS	⊗	EXISTING WATER VALVE
951	PROPOSED MINOR CONTOURS	○	EXISTING WATER HYDRANT
950	PROPOSED MAJOR CONTOURS	⊙	PROPOSED MANHOLE
⊗	EXISTING CLEANOUT	⊗	PROPOSED AIR RELEASE VALVE
○	CONTROL POINT		

STATE OF MISSOURI
MICHAEL L. PARSON,
GOVERNOR

CIVIL ENGINEER: GARRETT D. WAGNER
LICENSE NO. PE-2019000226



OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES
MANAGEMENT,
DESIGN AND CONSTRUCTION

MISSOURI
NATIONAL GUARD

CONNECT CAMP CLARK
TO CITY OF NEVADA
SEWER SYSTEM

CAMP CLARK

NEVADA, MISSOURI

PROJECT # T2301-02
SITE # 6274
ASSET # 8136274075

REVISION: EASEMENTS
DATE: 03-26-2024
REVISION: WET WELL SIZE
DATE: 06-05-2024
REVISION: ADD WET WELL/PIPE SIZE
DATE: 06-14-2024
ISSUE DATE: 06/14/2024

CAD DWG FILE: _____
DRAWN BY: AWW
CHECKED BY: SCW
DESIGNED BY: GDW

SHEET TITLE:
**GRAVITY SEWER
PLAN & PROFILE**

SHEET NUMBER:

C-111

13 OF 23 SHEETS



OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES
MANAGEMENT,
DESIGN AND CONSTRUCTION

MISSOURI
NATIONAL GUARD

CONNECT CAMP CLARK
TO CITY OF NEVADA
SEWER SYSTEM

CAMP CLARK

NEVADA, MISSOURI

PROJECT # T2301-02
SITE # 6274
ASSET # 8136274075

REVISION: EASEMENTS
DATE: 03-26-2024
REVISION: WET WELL SIZE
DATE: 06-05-2024
REVISION: ADD WET WELL
DATE: 06-14-2024
ISSUE DATE: 06/14/2024

CAD DWG FILE:
DRAWN BY: AWW
CHECKED BY: SCW
DESIGNED BY: GDW

SHEET TITLE:
LIFT STATION
SITE PLAN



SHEET NUMBER:


C-112

14 OF 23 SHEETS

EASEMENT NOTE:

SANITARY SEWER EASEMENTS HAVE NOT BEEN OBTAINED DUE TO THE PROPOSED PRESSURE SEWER PIPE AND LIFT STATION BEING LOCATED ON FEDERAL PROPERTY THAT IS COVERED IN ARMY REGULATION (AR 405-80) GRANTING ACCESS FOR ALL QUALIFYING UTILITIES.

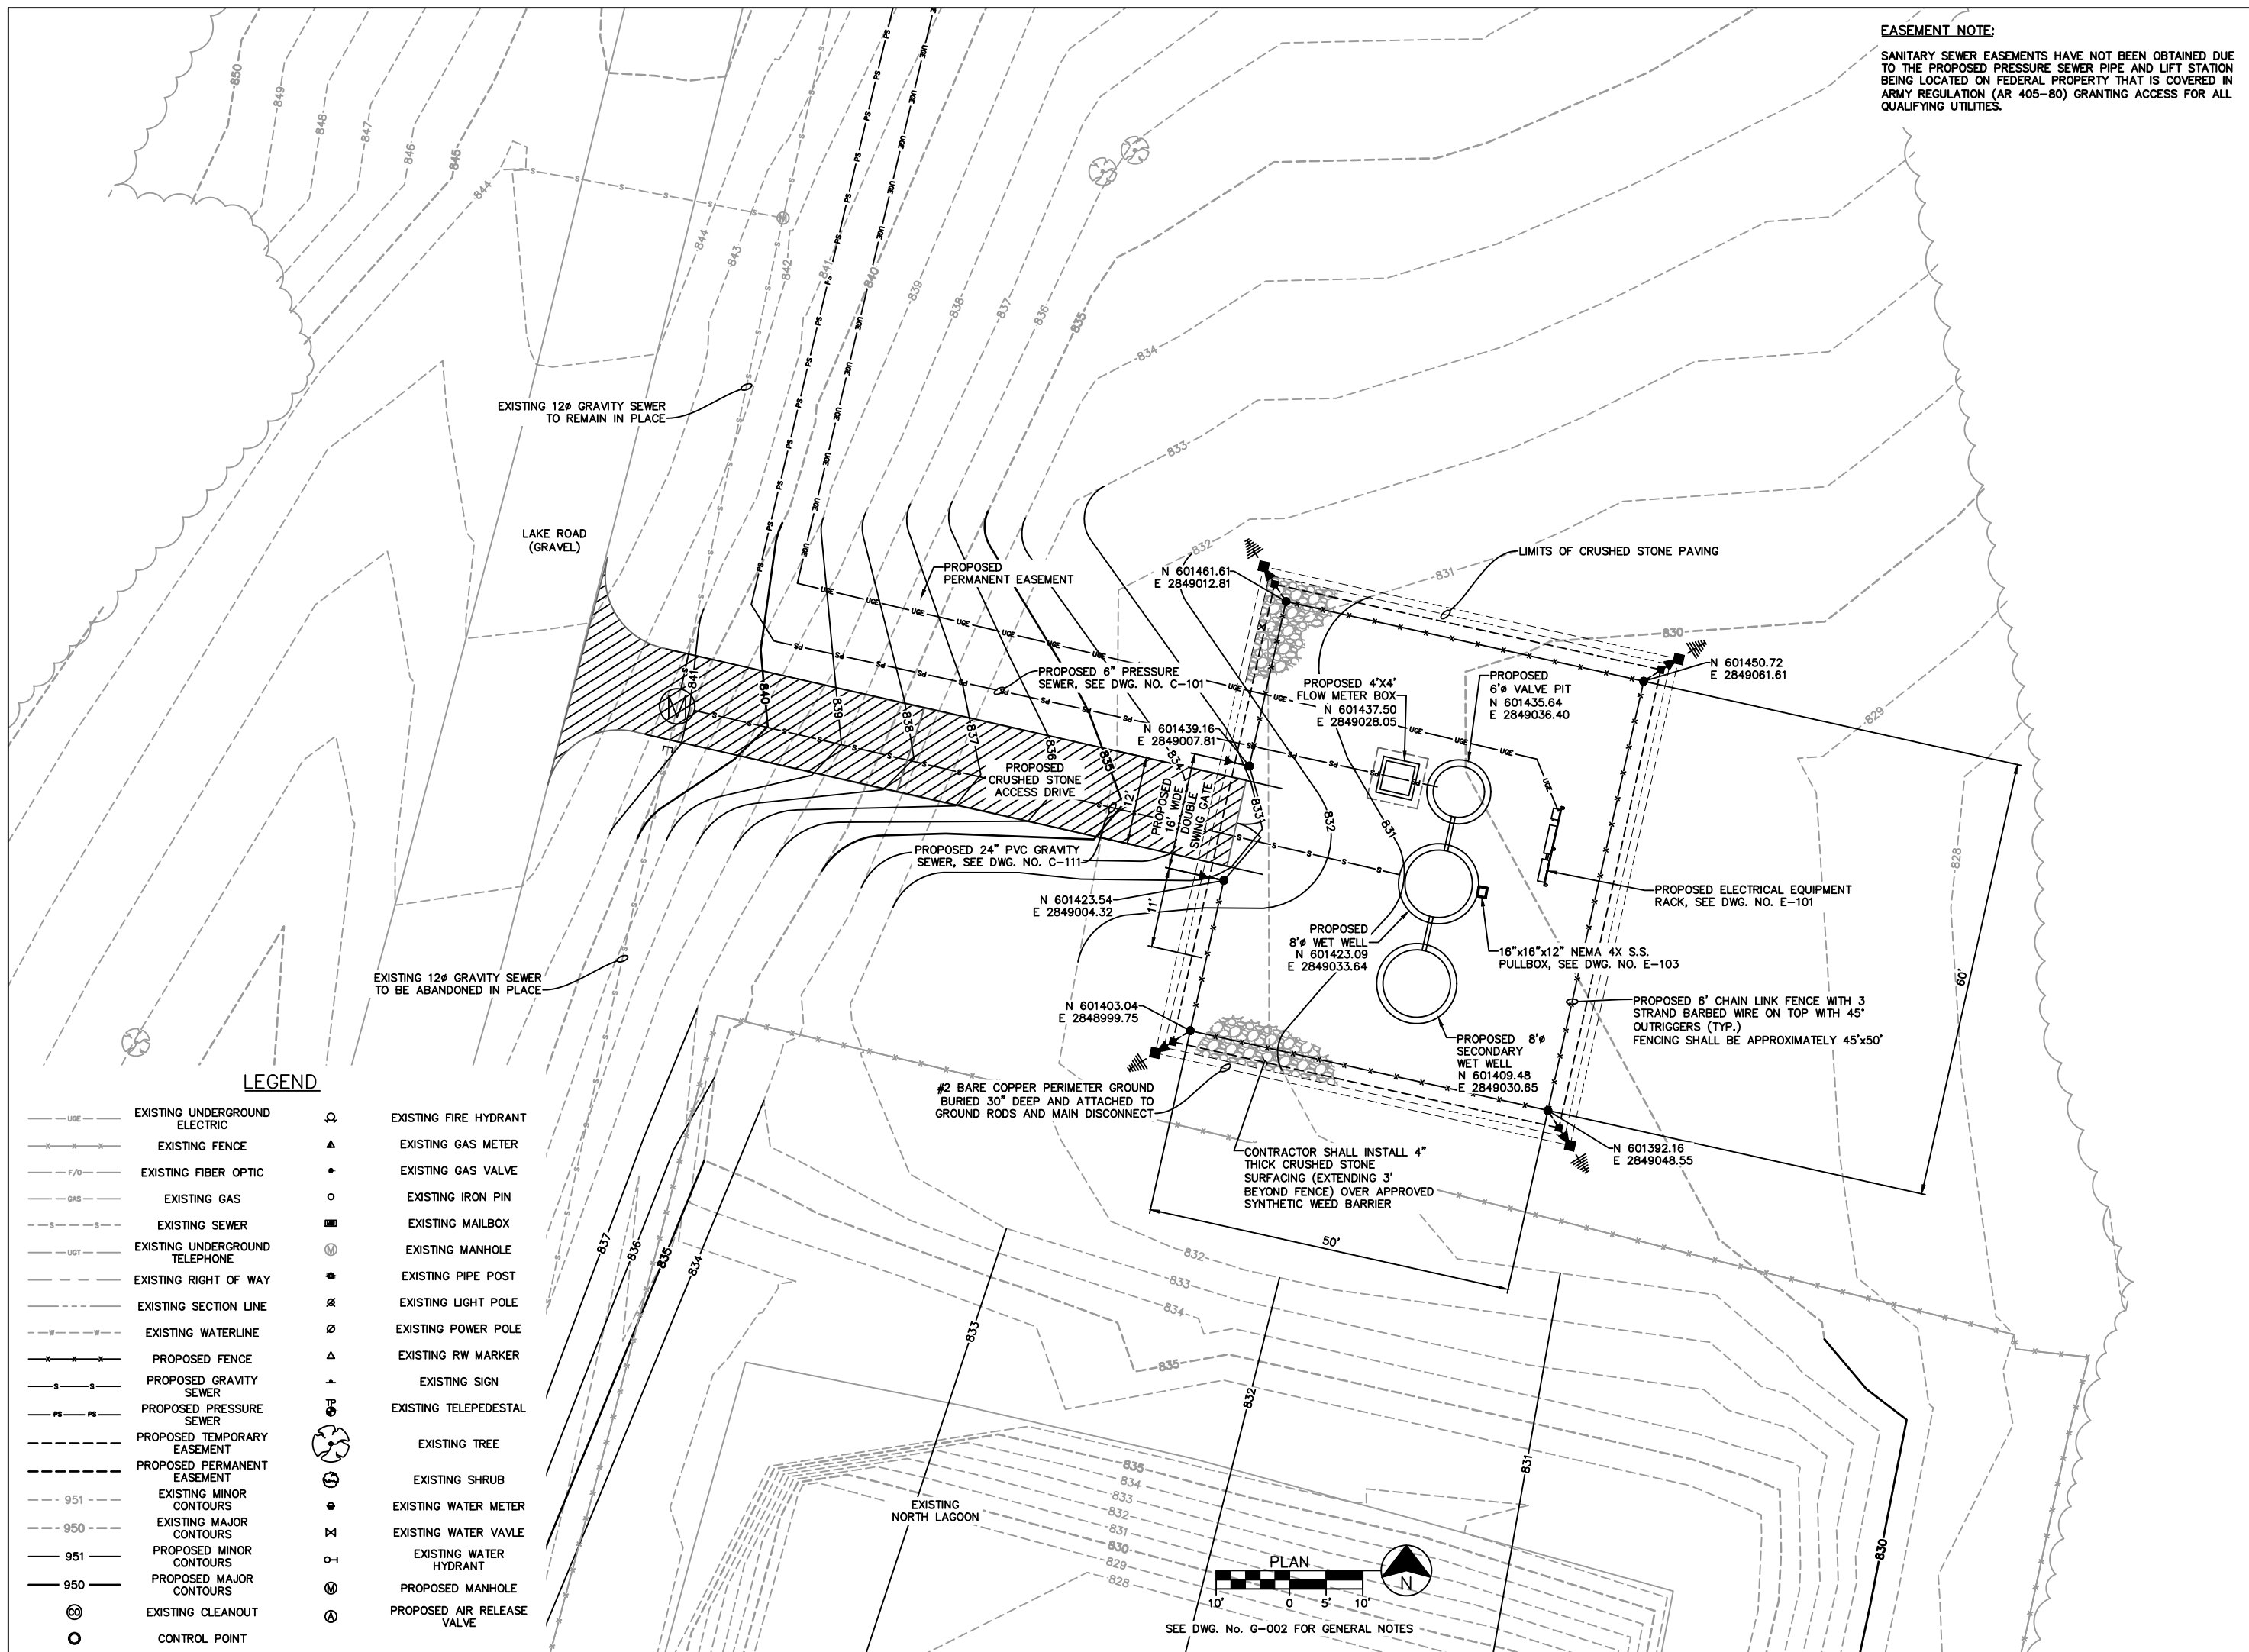



--- 951 ---	EXISTING MINOR CONTOURS
--- 950 ---	EXISTING MAJOR CONTOURS
— 951 —	PROPOSED MINOR CONTOURS
— 950 —	PROPOSED MAJOR CONTOURS

EASEMENT NOTE:

SANITARY SEWER EASEMENTS HAVE NOT BEEN OBTAINED DUE TO THE PROPOSED PRESSURE SEWER PIPE AND LIFT STATION BEING LOCATED ON FEDERAL PROPERTY THAT IS COVERED IN ARMY REGULATION (AR 405-80) GRANTING ACCESS FOR ALL QUALIFYING UTILITIES.

LAGOON CLOSURE NOTES:

- LAGOON SHALL BE CLOSED PER SPECIFICATION 312305.
- CONTRACTOR SHALL REMOVE AND DISPOSE OF LAGOON LINERS, PIPING, BAFFLES, AERATORS, ELECTRICAL EQUIPMENT AND OTHER ABOVE GROUND STRUCTURES.
- CONTRACTOR SHALL DEMOLISH BERMS AND GRADE SITE TO THE ELEVATIONS SHOWN HEREON. SITE SHALL BE SEEDED AND MULCHED AFTER FINAL GRADING.
- CONTRACTOR SHALL BE RESPONSIBLE FOR THE FINAL ESTIMATION OF ALL EARTHWORK QUANTITIES AND ASSOCIATED COSTS PRIOR TO BID SUBMISSION.
- IT IS INTENDED THAT CUTS AND FILLS WILL BE BALANCED WITH ON-SITE MATERIALS WHERE POSSIBLE. ADJUSTMENTS TO THE FINISH CONTOURS OF THE SITE ARE ANTICIPATED. CHANGES TO CONTOURS SHOWN SHALL BE APPROVED BY THE ENGINEER. THE FOLLOWING CUT AND FILL QUANTITIES ARE APPROXIMATE:
LAGOON CUT: 5,291 CY
LAGOON FILL: 7,966 CY
SEWER LINE CUT: 988 CY


PROPOSED LIFT STATION,
SEE DWG. NO. C-112

APPROXIMATELY 1,394 L.F. OF BARBED WIRE FENCE TO BE REMOVED BY CONTRACTOR. CONTRACTOR SHALL COORDINATE WITH OWNER ON RE-USE, OTHERWISE DISPOSE OF FENCE AT HIS EXPENSE

CONTRACTOR SHALL REMOVE APPROXIMATELY 5 L.F. OF OUTFALL PIPE AND CAP PIPE WATERTIGHT WITH CONCRETE

CONTRACTOR SHALL REMOVE AND DISPOSE OF OUTFALL SIGNS

EXISTING OUTFALL PIPE

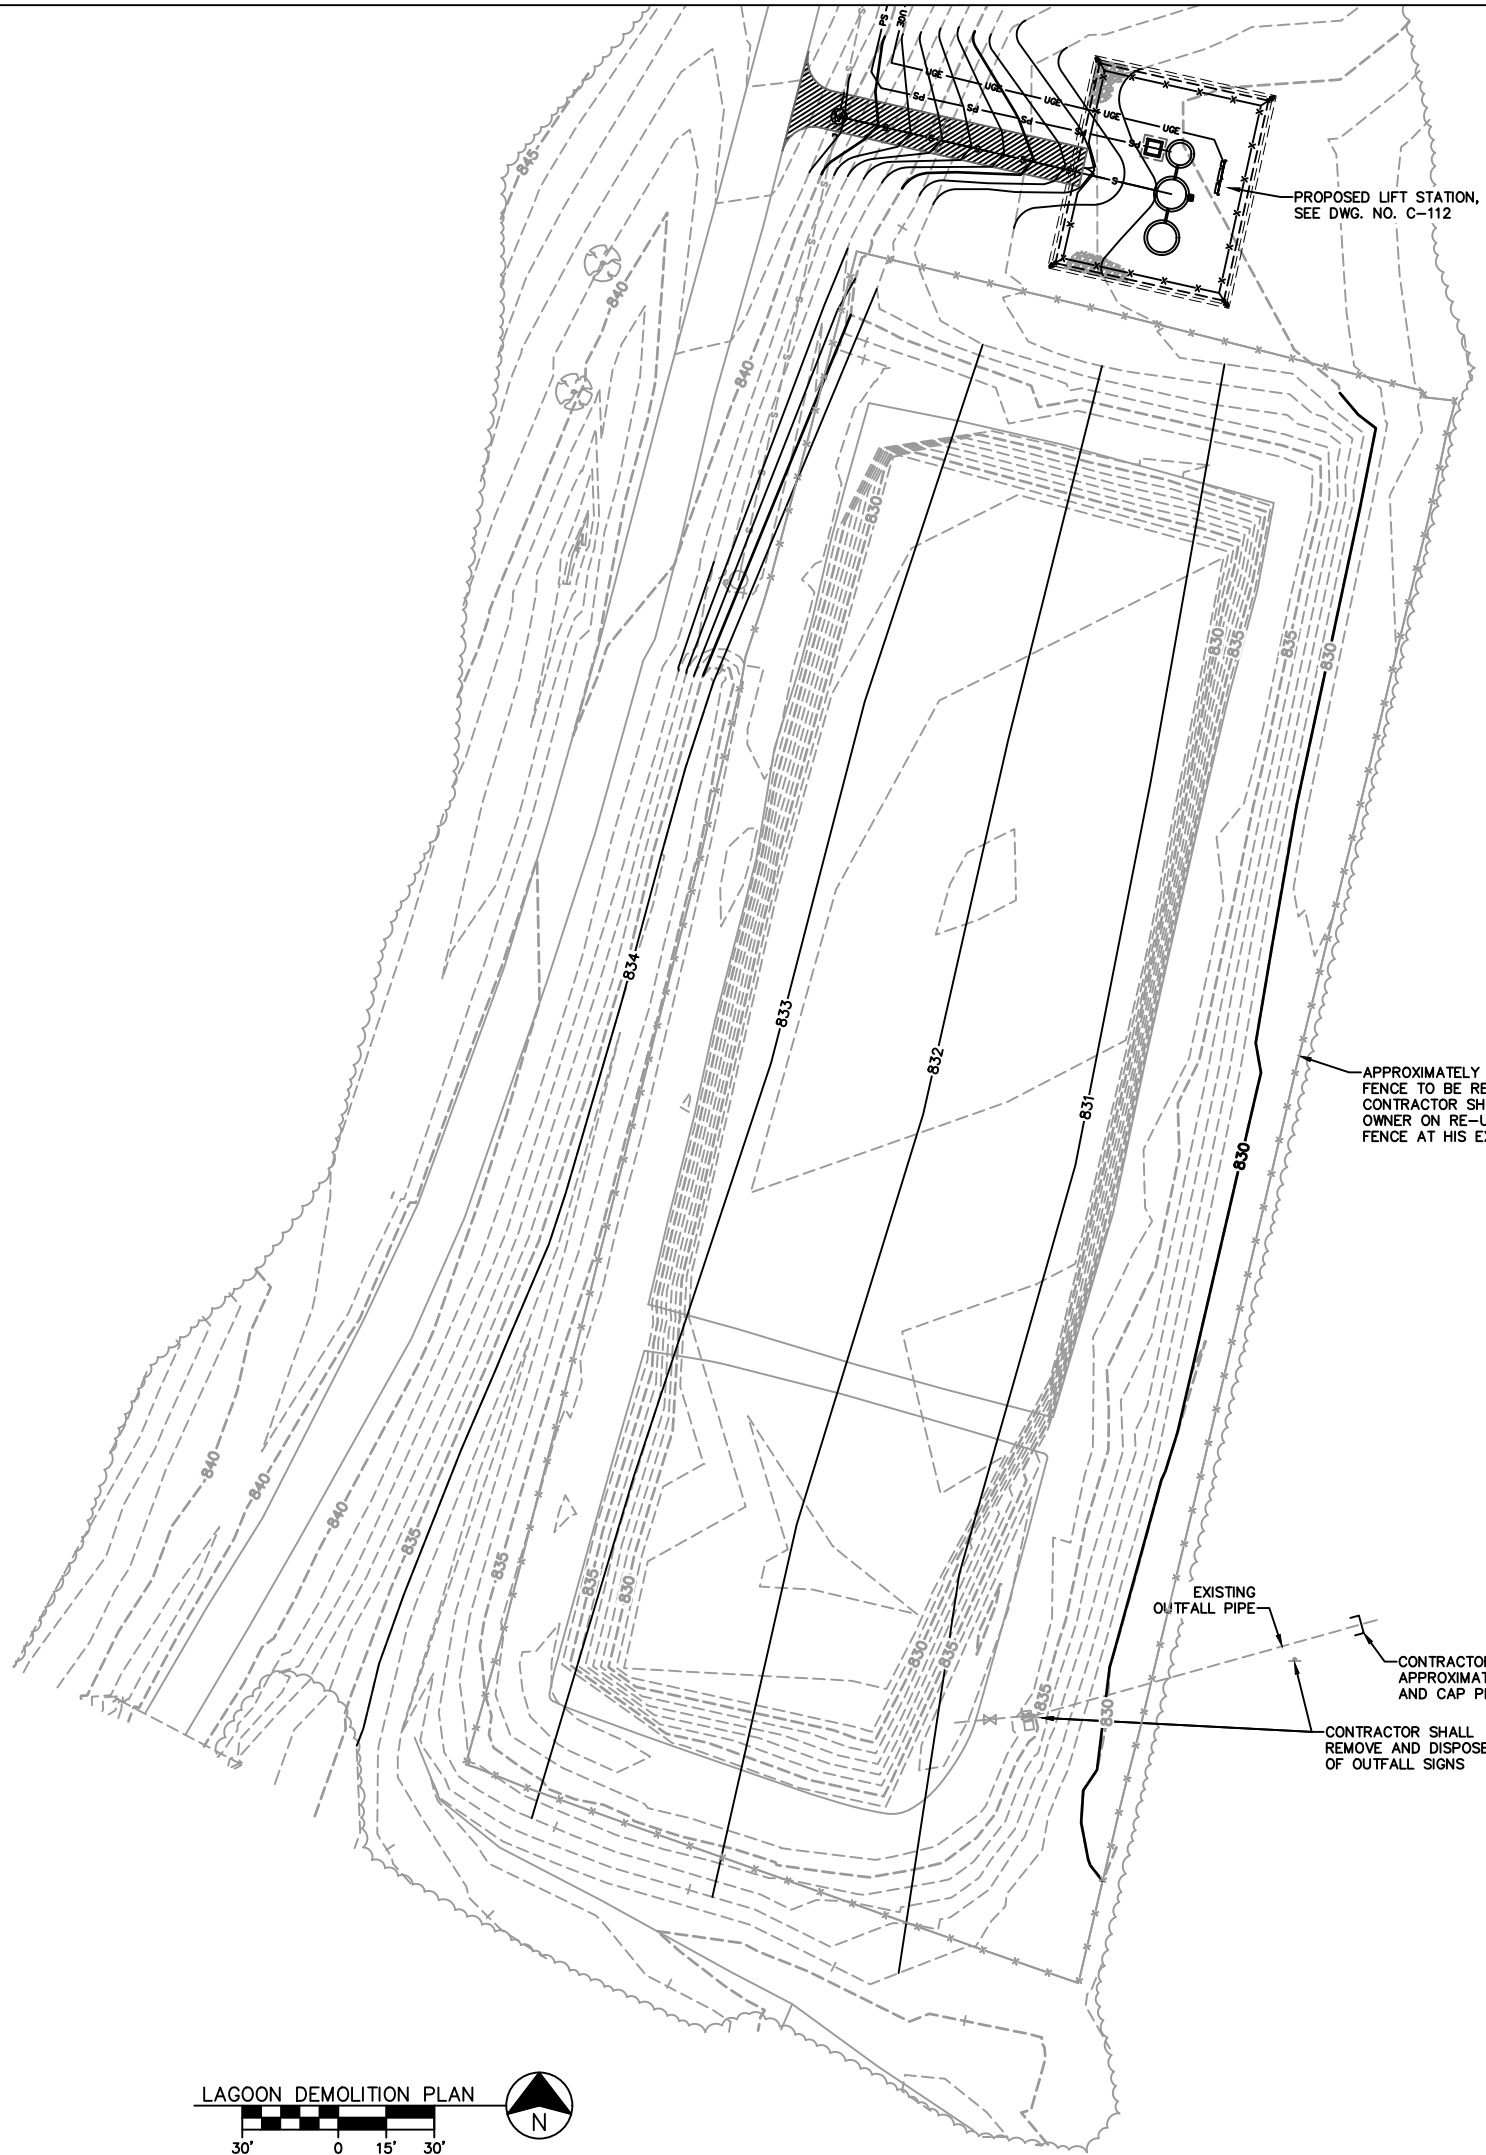

OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES
MANAGEMENT,
DESIGN AND CONSTRUCTION

MISSOURI
NATIONAL GUARD

CONNECT CAMP CLARK
TO CITY OF NEVADA
SEWER SYSTEM

CAMP CLARK

NEVADA, MISSOURI

PROJECT # T2301-02
SITE # 6274
ASSET # 8136274075

REVISION: EASEMENTS	DATE: 03-26-2024
REVISION:	DATE:
REVISION:	DATE:
REVISION:	DATE:
ISSUE DATE:	06/14/2024


CAD DWG FILE:	
DRAWN BY:	AWW
CHECKED BY:	SCW
DESIGNED BY:	GDW

SHEET TITLE:
**LAGOON
DEMOLITION &
GRADING PLAN**

SHEET NUMBER:

C-113


15 OF 23 SHEETS

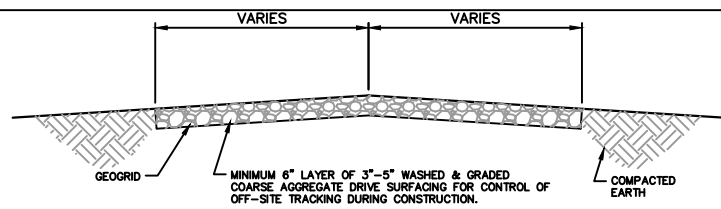

TYPICAL SECTION THRU CONSTRUCTION ENTRANCE
N.T.S.

NOTES:


1. WHEN NECESSARY, EQUIPMENT/VEHICLES SHALL BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO A PUBLIC ROADWAY. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE WITH DRAINAGE FLOWING AWAY FROM BOTH THE PUBLIC STREET OR ROAD AND THE STABILIZED ENTRANCE. ALL SEDIMENT SHALL BE PREVENTED FROM ENTERING ANY STORM DRAIN, DITCH OR WATERCOURSE USING APPROVED METHODS.
2. THE SITE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PAVED SURFACES. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS MAY REQUIRE. ALL SEDIMENT SPILLED, DROPPED, WASHED AWAY OR TRACKED ONTO PAVED SURFACES MUST BE REMOVED AS SOON AS POSSIBLE.

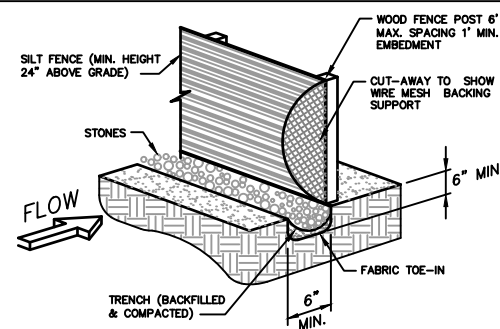

FILTER FABRIC SILT FENCE
N.T.S.

NOTES:

1. SILT FENCE SHALL BE SECURELY FASTENED TO EACH WOOD SUPPORT POST OR TO WOVEN WIRE. THERE SHALL BE A 6 INCH DOUBLE OVERLAP, SECURELY FASTENED WHERE ENDS OF FABRIC MEET.
2. INSPECTION SHALL BE MADE AT LEAST WEEKLY, BEFORE A KNOWN MAJOR STORM EVENT, AND AFTER EACH 0.5" RAINFALL EVENT. REPAIR OR REPLACEMENT SHALL BE MADE PROMPTLY AS NEEDED.
3. ACCUMULATED SILT SHALL BE REMOVED FROM THE UPPER SIDE OF SILT FENCE WHEN IT REACHES A DEPTH OF 8 INCHES. THE SILT SHALL BE DISPOSED ON SITE (OR AT AN APPROVED SITE) AND IN SUCH A MANNER AS TO NOT CONTRIBUTE TO ADDITIONAL SILTATION.
4. FILTER FABRIC SILT FENCE SHALL BE ENHANCED WITH STRAW BALES IF SITE CONDITIONS INDICATE THE NEED FOR ADDITIONAL FILTRATION OF RUNOFF.

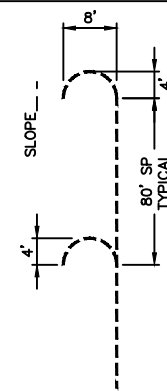

FILTER FABRIC SILT FENCE HOOK
DETAIL
N.T.S.


NOTE:
HOOKS SHOWN LARGER FOR CLARITY
INSTALL AS NEEDED ON SLOPES WHERE SILT FENCE IS INSTALLED PARALLEL TO SLOPE.

NOTE:
FILTER FABRIC SILT FENCE/HOOKS AND STRAW BALE BARRIER LOCATIONS ARE APPROXIMATE. PLACEMENT MAY NEED ADJUSTED ACCORDING TO SITE SPECIFIC TERRAIN CONDITIONS.


CONSTRUCTION NOTE:
THE CONTRACTOR SHALL PROVIDE ANY ADDITIONAL EROSION OR POLLUTION CONTROL DEVICES AS REQUIRED DURING THE CONSTRUCTION PHASE IN ORDER TO COMPLY WITH STORM WATER DISCHARGE REGULATIONS OF THE UNITED STATES ENVIRONMENTAL PROTECTION AGENCY AND ALL OTHER AGENCIES HAVING JURISDICTION.

NOTE:


① POINT "A" MUST BE A MINIMUM OF 6 INCHES HIGHER THAN POINT "B" TO ENSURE THAT WATER FLOWS OVER THE DIKE AND NOT AROUND THE ENDS.

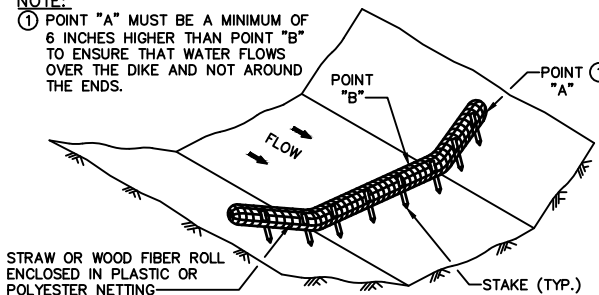

COMPOST FILTER SOCK DITCH CHECK
N.T.S.

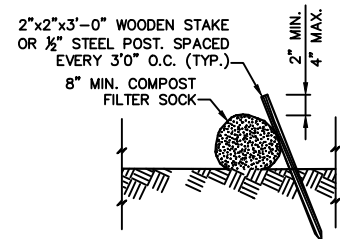

ALTERNATIVE 1 (Staking)
N.T.S.

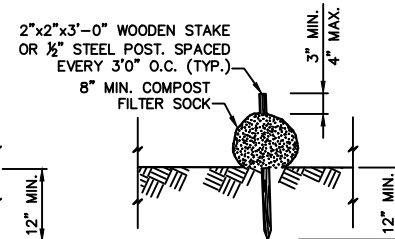


ALTERNATIVE 2 (Staking)
N.T.S.

COMPOST FILTER SOCK

COMPOST FILTER SOCK: SLOPE, SOCK SPACING, AND SOCK DIAMETER

SLOPE	SPACING (ft)	SOCK DIAMETER (inches)
<50:1	250	8
50:1 - 10:1	125	12
10:1 - 5:1	100	12
3:1 - 2:1	50	18
> 2:1	25	18

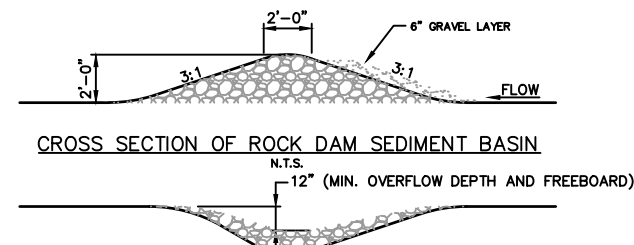

CROSS SECTION OF ROCK DAM SEDIMENT BASIN
N.T.S.



CROSS SECTION OF DITCH AT ROCK DAM
N.T.S.

THE CONTRACTOR SHALL MAINTAIN A COPY OF THE MDNR ISSUED NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES) STORM WATER DISCHARGE PERMIT, A CURRENT SIGNED AND CERTIFIED COPY OF THE SWPPP, AND COPIES OF ALL COMPLETED INSPECTION AND MAINTENANCE FORMS AT THE CONSTRUCTION SITE AT ALL TIMES, AS REQUIRED. THE ISSUED STORM WATER DISCHARGE PERMIT AND THE SWPPP MUST BE AVAILABLE FOR REVIEW BY ANY AND ALL LOCAL, STATE, OR FEDERAL AUTHORIZED REGULATORY AGENCY REPRESENTATIVE UPON REQUEST.

NOTE:
SEE SWPPP APPENDICES FOR ADDITIONAL INFORMATION AND EXAMPLES OF BMP'S AND REQUIRED INSPECTION AND REPORTING FORMS.

THE CONTRACTOR SHALL NAME AN INDIVIDUAL AS THE SITE ENVIRONMENTAL MANAGER RESPONSIBLE FOR ALL STORM WATER AND ENVIRONMENTAL ISSUES AT THE SITE DURING THE CONSTRUCTION OF THE PROJECT.



THE DESIGNATED ENVIRONMENTAL MANAGER FOR THE SITE IS:



THE CONTRACTOR SHALL PHYSICALLY MARK IN THE FIELD THE LOCATION OF THE OUTFALL AND INDICATE THE OUTFALL NUMBER, AS SHOWN ON THIS DRAWING.

THE CONTRACTOR SHALL PENCIL IN AND KEEP CURRENT, ANY UPDATE AS NEEDED, ANY AND ALL ADDITIONS OR CHANGES TO THE STORM WATER POLLUTION PREVENTION PLAN ON THE SWPPP DRAWING, INCLUDING, BUT NOT LIMITED TO, THE LOCATION OF THE FOLLOWING ITEMS, IF APPLICABLE:

- CONSTRUCTION OFFICE
- PORTABLE TOILET(S)
- SOLID WASTE CONTAINER(S)
- FUEL STORAGE AREA
- MATERIAL STORAGE AREA(S)
- CHEMICAL STORAGE AREA(S)
- EQUIPMENT STORAGE AREA(S)
- TOP SOIL STOCKPILE AREA(S)
- ANY AND ALL ADDITIONAL INSTALLED BMP'S


THIS DRAWING IS FOR A STORM WATER POLLUTION PREVENTION PLAN ONLY, AND IS NOT INTENDED TO BE USED FOR CONSTRUCTION PURPOSES.

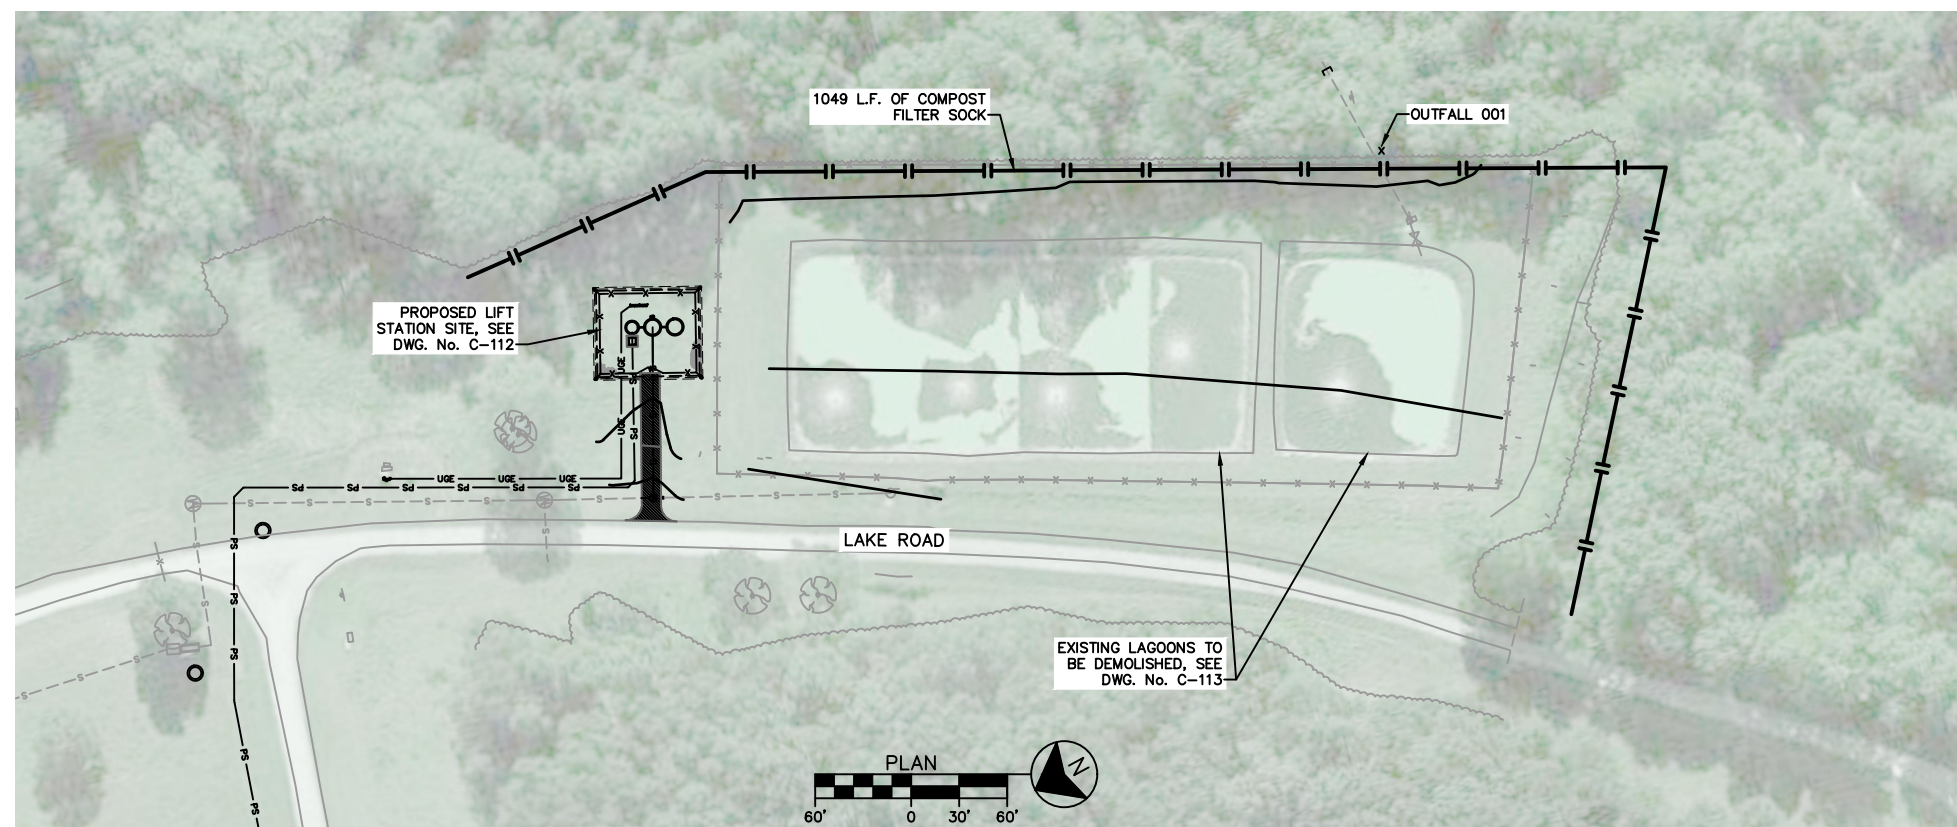

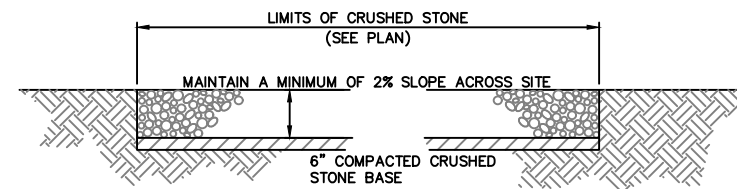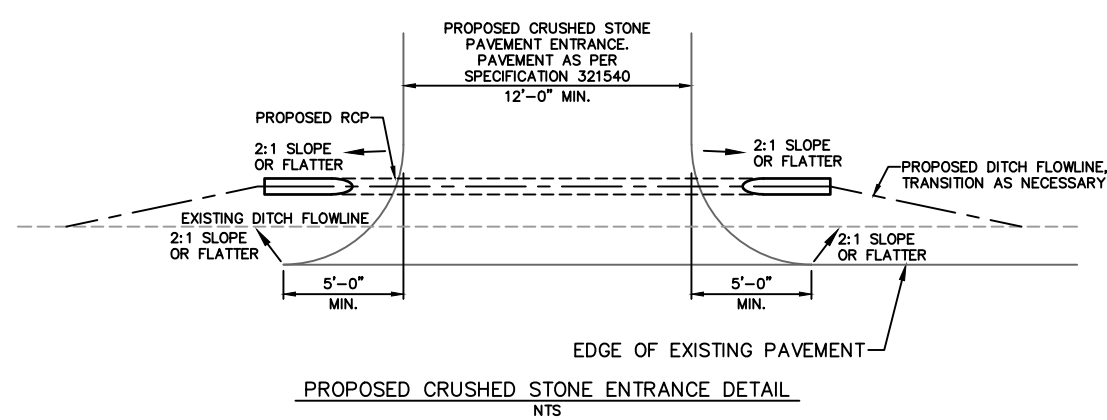


TYPICAL CRUSHED STONE SURFACING DETAIL
N.T.S.


AIR RELIEF VALVE SCHEDULE		
NO.	STATION	TYPE
1	6+75	TYPE 2
2	12+35	TYPE 1
3	18+15	TYPE 1
4	27+97	TYPE 2
5	42+67	TYPE 2
6	52+17	TYPE 1
7	62+39	TYPE 2
8	79+55	TYPE 2

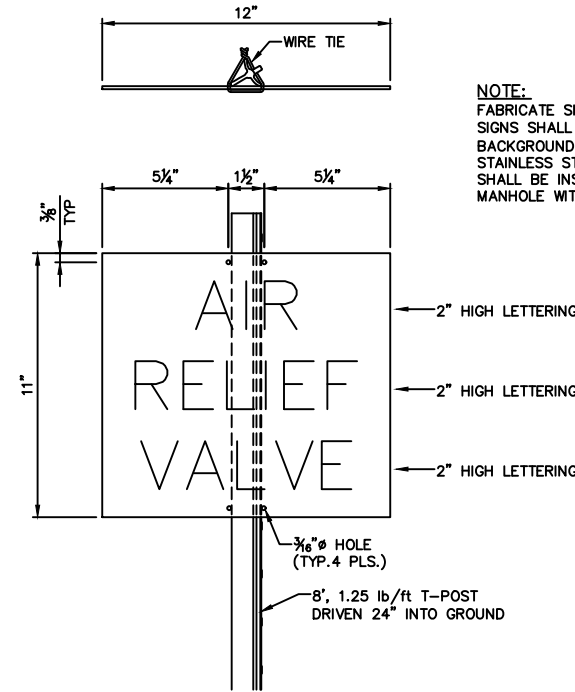



NOTE:
FABRICATE SIGNS FROM 0.08" 3003 ALUMINUM SHEET.
SIGNS SHALL HAVE BLACK LETTERING ON WHITE
BACKGROUND. ATTACH SIGNS TO T-POST W/ 1/8" Ø
STAINLESS STEEL WIRE AT ANY LOCATION AS SHOWN. SIGN
SHALL BE INSTALLED THREE FEET AWAY FROM CENTER OF
MANHOLE WITHIN EASEMENT.

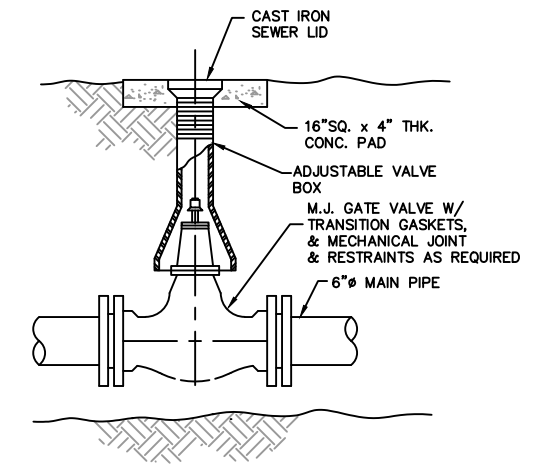


PLUG VALVE INSTALLATION
N.T.S.

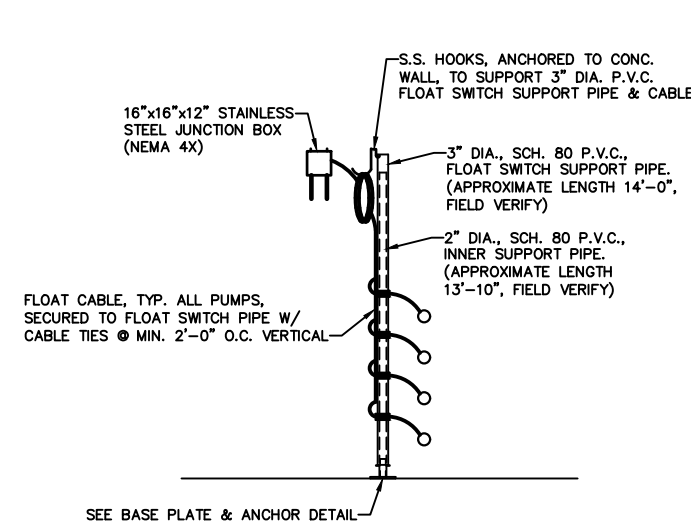


SEE BASE PLATE & ANCHOR DETAIL
FLOAT SWITCH ASSEMBLY DETAIL
N.T.S.

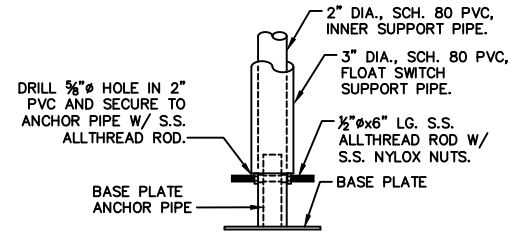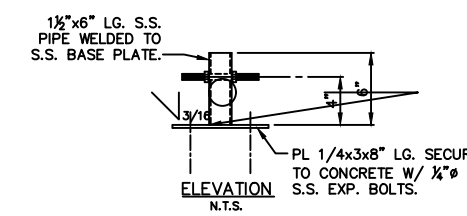

DRILL 3/8" Ø HOLE IN 2" PVC AND SECURE TO ANCHOR PIPE W/ S.S. ALLTHREAD ROD.
FLOAT ASSEMBLY ELEVATION
N.T.S.


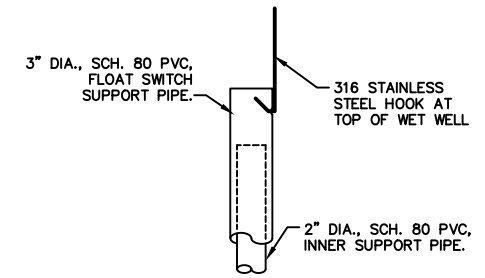


UPPER ANCHOR
N.T.S.

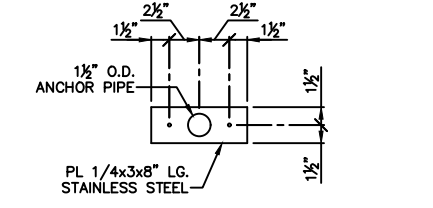


BASE PLATE PLAN
N.T.S.


GROUNDING LEGEND

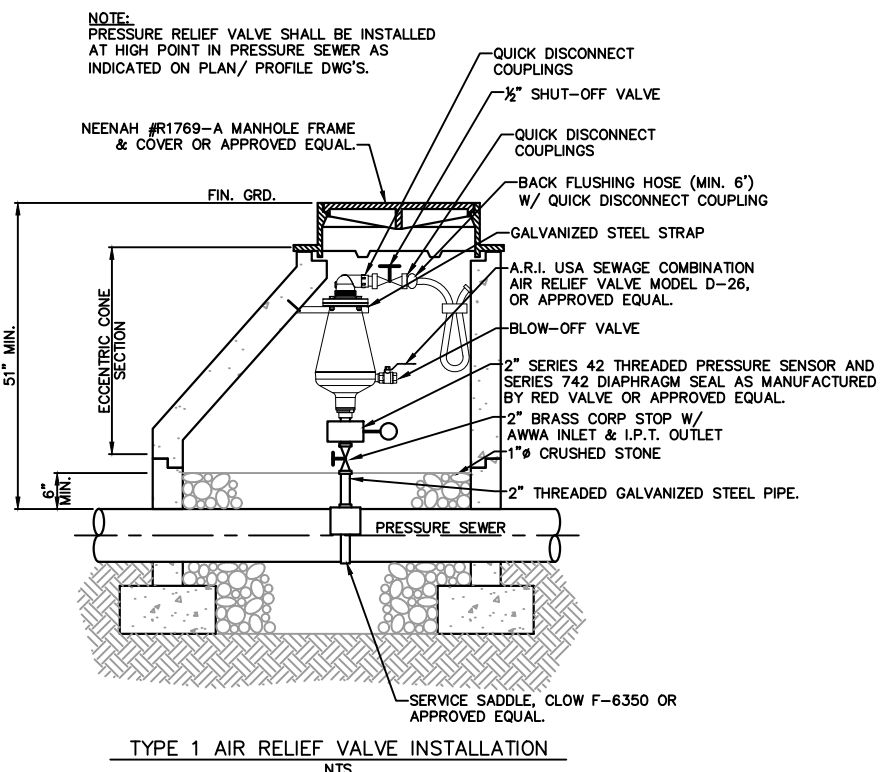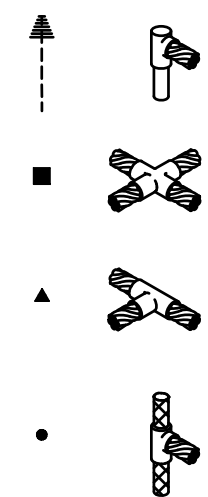

TYPE 1 AIR RELIEF VALVE INSTALLATION
N.T.S.

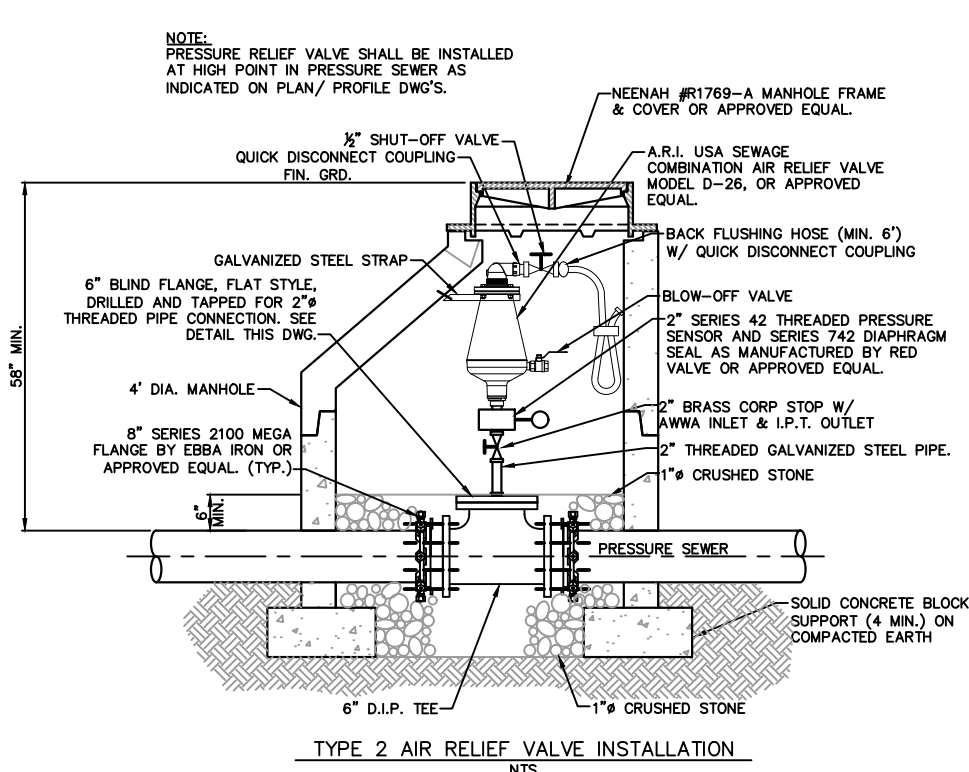

TYPE 2 AIR RELIEF VALVE INSTALLATION
N.T.S.

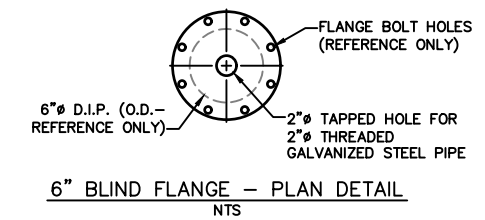

6" BLIND FLANGE - PLAN DETAIL
N.T.S.

NOTES:

- (1) EA. ALUMINUM ACCESS DOOR SHALL BE HALLIDAY PRODUCTS MODEL No. S1S3636 SINGLE LEAF CONSTRUCTION FOR A 36" x 36" CONCRETE OPENING OR AN APPROVED EQUAL. DOOR SHALL HAVE A LOAD RATING OF 300 LBS. PER SQ. FT. LOCATION OF ACCESS DOOR SHALL BE AS DIMENSIONED W/ HINGE SIDE AS NOTED. INSTALLATION OF ACCESS DOOR MAY BE EITHER CAST-IN-PLACE OR GROUTED-IN-PLACE PER MFR'S. REQMT'S. THAT PORTION OF THE ACCESS DOOR FRAME IN CONTACT WITH CONCRETE OR GROUT SHALL HAVE A HEAVY SHOP COAT OF BITUMINOUS PAINT.
- FLOW METER BOX - (1) EA. WITH THE FOLLOWING REQUIREMENTS: THE METER BOX SHALL BE PRECAST REINFORCED CONCRETE WALLS, TOP & BOTTOM W/ FOLLOWING DIMENSIONS: 4'-0" x 4'-0" INSIDE, 6 3/4" THICK WALLS, 8" THICK TOP & 8" THICK BOTTOM. DEPTH PER PLANS. SMOOTH CAST HOLES IN WALLS FOR 6" D.I. PIPES W/ HOLES LOCATED PER PIPING PLAN & SECTION. SMOOTH CAST HOLE IN BOTTOM SLAB FOR 2" SCH. 40 P.V.C. PIPE W/ HOLE LOCATED PER PIPING PLAN & SECTION. INSTALLATION OF ALL PIPES SHALL BE PER REQUIREMENTS OF NOTE 3. ACCESS DOOR PER NOTE 1 IN TOP WITH LOCATION PER PIPING PLAN & SECTION
- PIPES SHALL BE INSTALLED IN CAST HOLES OF VALVE BOX & WET WELL WITH A BENTONITE/BUTYL-RUBBER BASED COMPOUND STRIP WATERSTOP ON THE PIPE WITH ONE (1) 360° WRAP AROUND PIPE WITH ENDS BUTTED TOGETHER TO FORM A CONTINUOUS WATERSTOP PER MFR'S. REQMT'S. LOCATION ON THE PIPE SHALL COINCIDE WITH THE CENTER OF THE WALL OR SLAB. WATERSTOP SHALL BE VOLCLAY WATERSTOP RX-102 (3/8" x 3/4") OR AN APPROVED EQUAL. AFTER PLACEMENT OF THE PIPE & WATERSTOP, FILL ANNULAR SPACE WITH NON-SHRINK, NON-METALLIC GROUT, FLUSH WITH BOTH SURFACES.


GENERAL NOTES:

CONTRACTOR SHALL BE RESPONSIBLE FOR SUPPLYING & INSTALLING FLOW METER, PIPING, VALVES, FITTINGS & APPURTENANCES FOR A COMPLETE & FUNCTIONING SYSTEM.

PIPE SIZE & TYPE AS NOTED & SHOWN ON DRAWINGS. PIPE LENGTHS VARIABLE, AS REQUIRED FOR INSTALLATION PER DRAWINGS. FOR COMPLETE DESCRIPTION OF PIPE, CLASS & MATERIAL, SEE SPECIFICATIONS.



ALL PIPING, VALVES & FITTINGS SHALL BE ADEQUATELY SUPPORTED. FOR TYPICAL PIPE SUPPORTS & HANGERS; FLOOR, WALL & CEILING, SEE SPECIFICATIONS.

ALL BURIED PIPE FITTINGS (BENDS, TEES, PLUGS, CAPS, ETC.) SHALL BE PLAIN CONCRETE THRUST BLOCKED AGAINST UNDISTURBED EARTH.

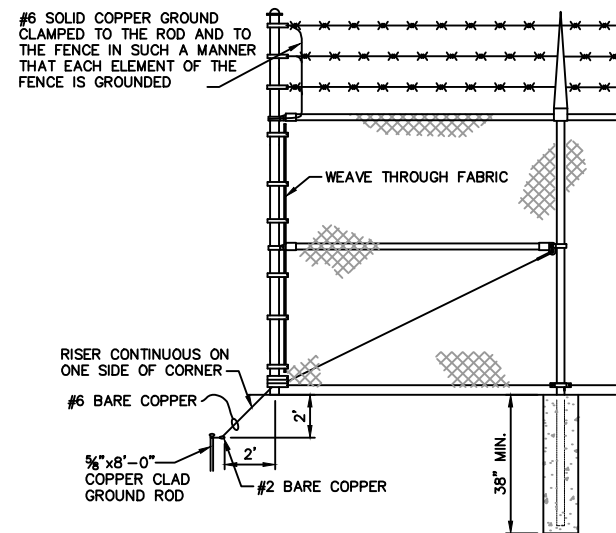


CHAINLINK FENCE GROUNDING
NTS


GROUNDING LEGEND

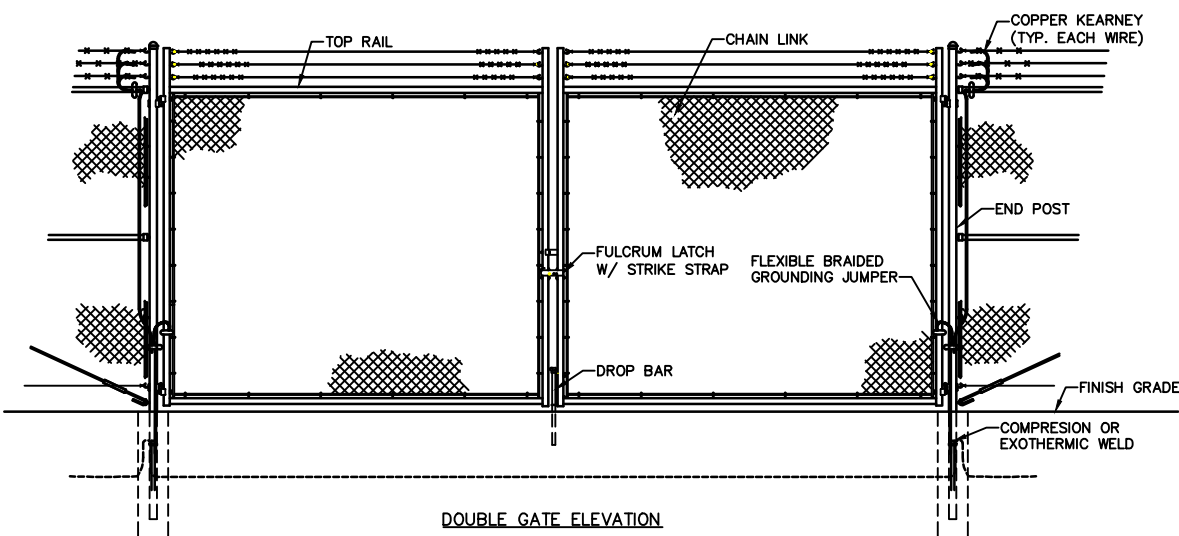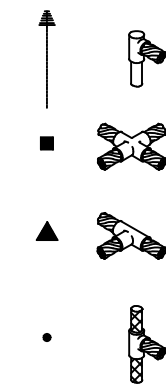


DOUBLE GATE ELEVATION

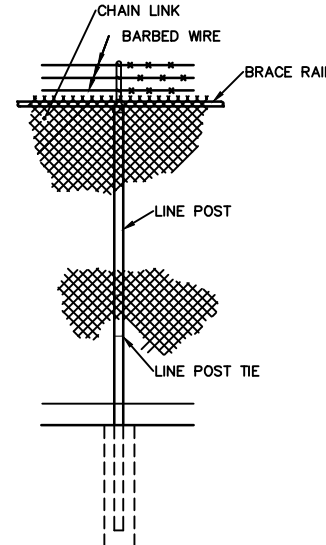


FENCE SECTION ELEVATION

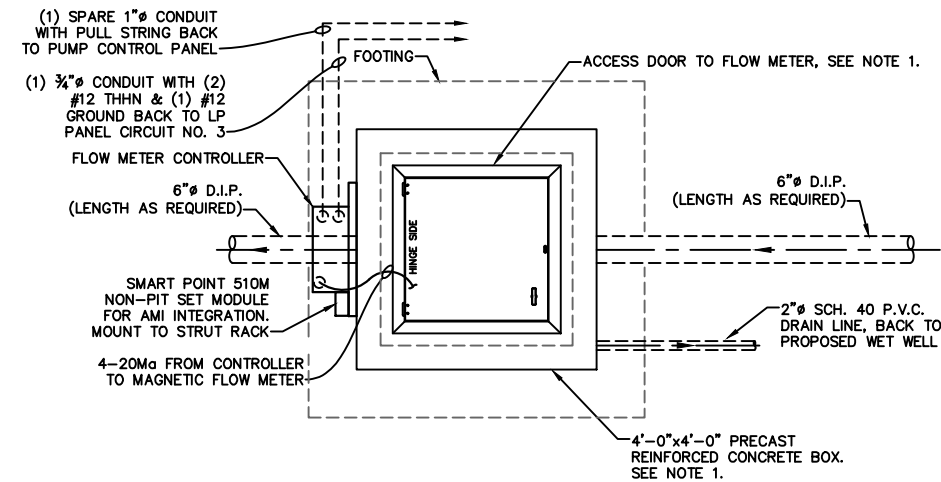

FLOW METER GENERAL PLAN
1/2" = 1'-0"

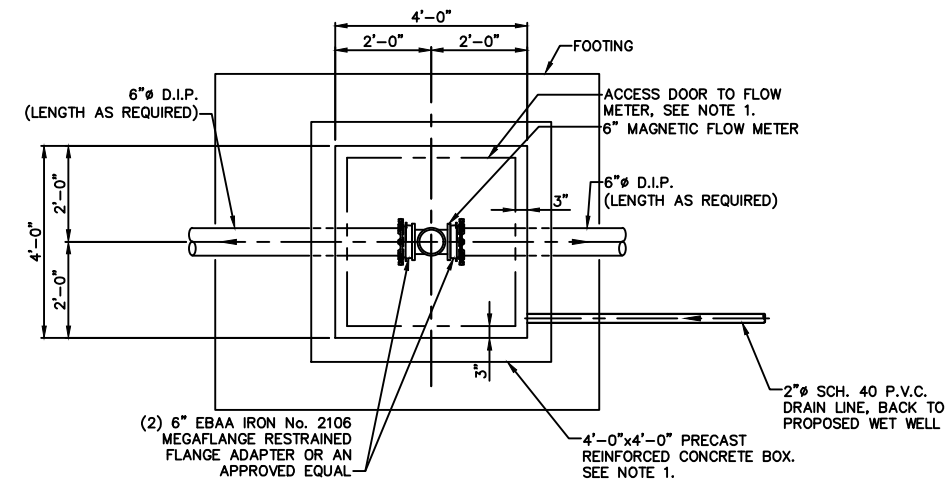

FLOW METER PIPING PLAN
1/2" = 1'-0"

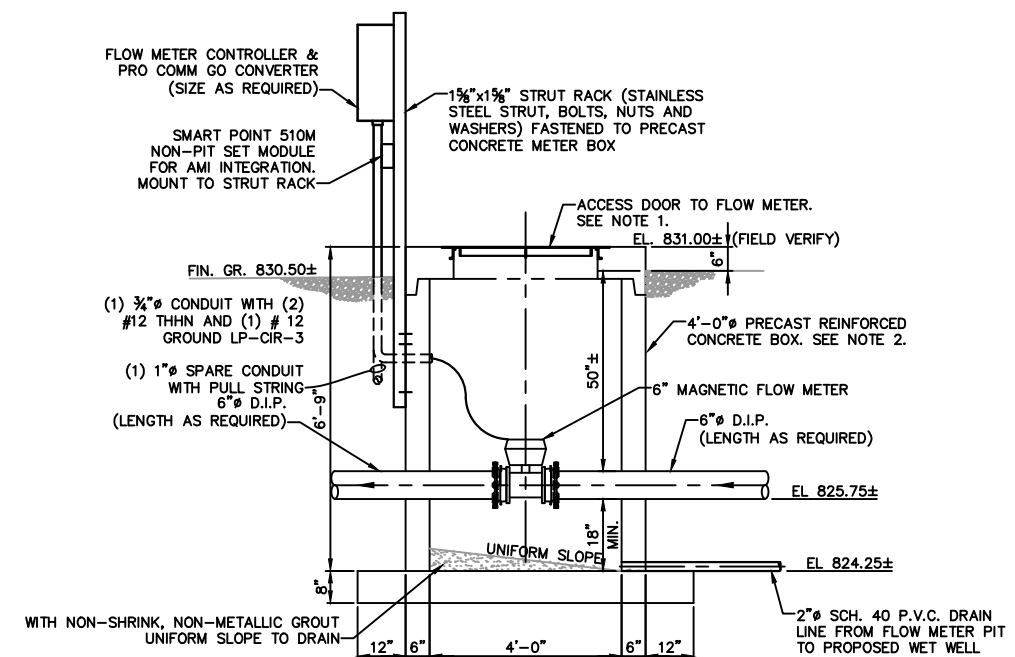

FLOW METER SECTION
1/2" = 1'-0"




REVISION:	DATE:
REVISION:	DATE:
REVISION:	DATE:
REVISION:	DATE:
ISSUE DATE:	06/14/2024

CAD DWG FILE:	
DRAWN BY:	AWW
CHECKED BY:	SCW
DESIGNED BY:	GDW


SHEET TITLE:
**STANDARD
CONSTRUCTION
DETAILS**

SHEET NUMBER:

C-503




NOTE:
ALL BURIED FITTINGS SHALL
HAVE PLAIN CONCRETE (3000
PSI MIN.) THRUST BLOCKING

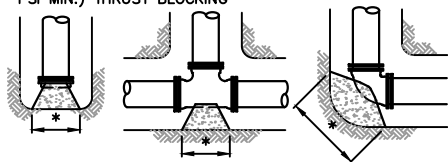

* CONCRETE THRUST BLOCK SHALL HAVE A
MINIMUM BEARING AREA ON UNDISTURBED SOIL
OF 5 SQ. FT. ON 6" & 8" FITTINGS, 7 SQ. FT.
ON 10" FITTINGS, 10 SQ. FT. ON 12" FITTINGS,
13 SQ. FT. ON 14" FITTINGS AND 16" SQ. FT.
ON 16" FITTINGS.

THRUST BLOCK DETAIL
NTS


NOTE: TRENCH SHALL BE EXCAVATED TO PROVIDE
VERTICAL WALLS. SHORING SHALL BE PROVIDED
AS NECESSARY TO MEET OSHA REQMT'S.

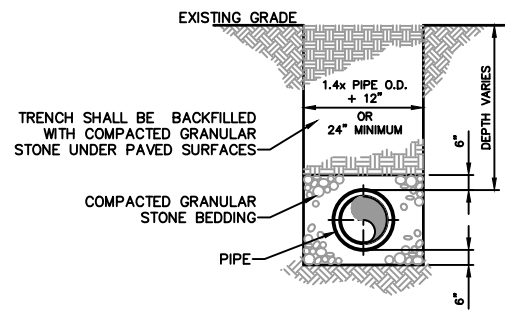

GRAVITY SANITARY AND STORM SEWER
STANDARD TRENCH & BEDDING DETAIL
N.T.S.


NOTE:
TRENCH SHALL BE EXCAVATED TO A DEPTH OF
6" BELOW BOTTOM OF PIPE AND BACKFILLED TO
6" ABOVE PIPE WITH GRAVEL OR CRUSHED
STONE CONFORMING TO THE FOLLOWING
GRADATION TO PROVIDE UNIFORM BEDDING FOR
THE ENTIRE LENGTH OF THE PIPE.

SIEVE SIZE	PERCENT PASSING
1	100
3/4	90-100
3/8	20-55
No. 4	0-10
No. 8	0-5

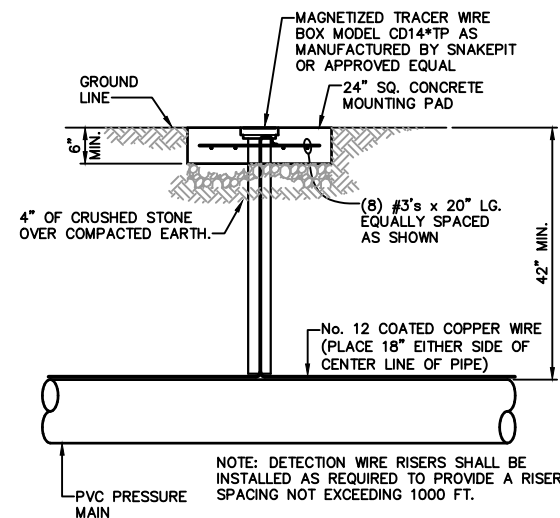

DETECTION WIRE RISER DETAIL
NTS


NOTE: COMPACTED BACKFILL, SLOPED
FROM MANHOLE FRAME TO EXISTING
GRADE SHALL BE PROVIDED AROUND
ALL MANHOLES EXCEPT THOSE
WITHIN STREET PAVEMENT.

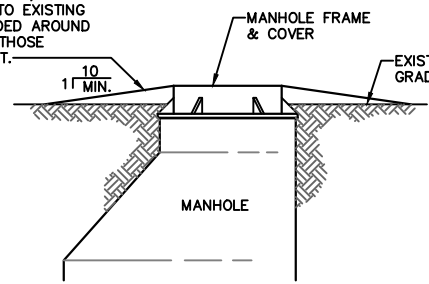

MANHOLE GRADING DETAIL
N.T.S.


GENERAL NOTES:

- JOINT BETWEEN MANHOLE FRAME AND ADJUSTMENT RING AREA SHALL BE WATERTIGHT. JOINT GASKET SHALL BE OF PREFORMED MASTIC (RAM-NEK, HAMILTON-KENT, OR APPROVED EQUAL). A ONE-PIECE EXTERNAL, MOLDED RUBBER SEAL SHALL BE INSTALLED AROUND MANHOLE FRAME AND ADJUSTMENT RING AREA ON ALL BELOW-GRADE MANHOLES.
- MANHOLE JOINTS SHALL BE WATERTIGHT. JOINT GASKET SHALL BE PREFORMED MASTIC (RAM-NEK, HAMILTON-KENT, OR APPROVED EQUAL). A MIN. 12" WIDE, EXTERNAL RUBBER JOINT WRAP SHALL BE INSTALLED ON ALL BELOW-GRADE PRECAST CONCRETE MANHOLE JOINTS.
- OPENINGS FOR SEWER PIPE IN MANHOLE SECTIONS SHALL BE FORMED AT THE FACTORY, EITHER CAST IN PLACE GASKET OR CUTOUT OPENING.
 - MINIMUM OPENING FOR CUTOUTS SHALL BE EQUAL TO OUTSIDE DIAMETER OF PIPE PLUS (4) FOUR INCHES AND MAXIMUM OPENING SHALL BE EQUAL TO OUTSIDE DIAMETER OF PIPE PLUS (6) INCHES
 - ANNULAR SPACE BETWEEN SEWER PIPE AND CUTOUT OPENING IN MANHOLE SECTIONS SHALL BE FILLED WITH NON-SHRINKING TYPE GROUT PER SPECIFICATIONS.
 - CAST-IN-PLACE GASKET SHALL BE A-LOK OR APPROVED EQUAL.
- ALL MANHOLE DETAILS ARE FOR PRECAST REINFORCED CONCRETE MANHOLE SECTIONS AND SHALL CONFORM TO ASTM SPEC. C478 - (CURRENT REVISION) WITH THE FOLLOWING MODIFICATIONS:
 - CEMENT USED SHALL CONFORM TO SPECIFICATIONS FOR PORTLAND CEMENT ASTM DESIGNATION C150. CONCRETE SHALL HAVE MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI.
 - MINIMUM SHELL THICKNESS SHALL BE: FOR (0) TO 16 FEET DEPTH, (1/12) ONE-TWELFTH INTERNAL SHELL DIAMETER OR (4) FOUR INCHES, WHICHEVER IS GREATER. FOR 16 FEET AND OVER IN DEPTH, (1/12) ONE-TWELFTH INTERNAL SHELL DIAMETER PLUS (1) ONE INCH OR (5) INCHES, WHICHEVER IS GREATER.
 - EXTERIOR DAMP PROOFING SHALL CONFORM TO KOPPERS SPECIFICATIONS FOR COAL TAR BITUMASTIC SUPER SERVICE BLACK, TNEC HEAVY DUTY BLACK, CARBOLINE, OR APPROVED EQUAL. DAMP PROOFING SHALL BE FACTORY APPLIED.
 - JOINTS BETWEEN MANHOLE SECTIONS SHALL BE WATERTIGHT. JOINT GASKETS SHALL BE RUBBER O-RING TYPE (NATURAL OR SYNTHETIC) OR PREFORMED MASTIC (RAM-NEK, HAMILTON-KENT OR APPROVED EQUAL). A MIN. 12" WIDE, EXTERNAL RUBBER JOINT WRAP SHALL BE INSTALLED ON ALL BELOW-GRADE PRECAST CONCRETE MANHOLE JOINTS.

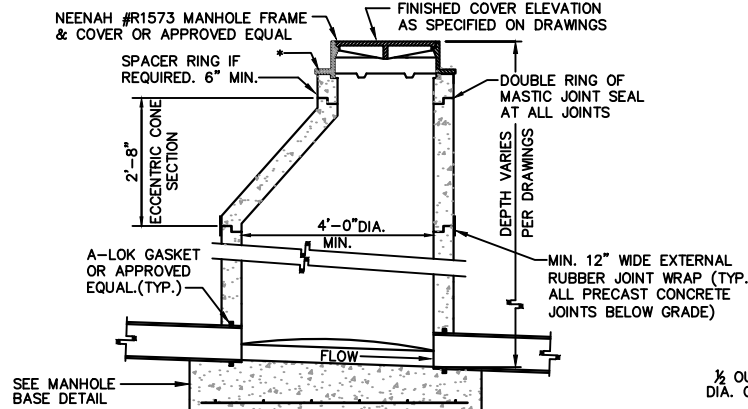


TYPICAL PRECAST MANHOLE DETAIL
N.T.S.

* IN LOW LYING AREAS WHERE GROUND WATER IS
AN ISSUE & TO PREVENT INFILTRATION A UNI-BAND
OR APPROVED EQUAL SHALL BE USED

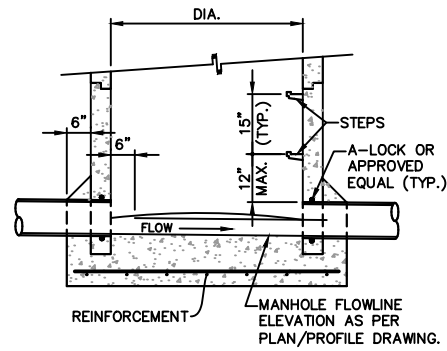

SECTION




STD. FRAME & COVER,
NEENAH R-1573
OR APPROVED EQUAL

TOTAL WEIGHT OF FRAME
& COVER, 400 LBS. (MIN.)


MANHOLE FRAME & COVER DETAIL
N.T.S.

NOTES:


INVERTS COMING IN AT
ELEVATION HIGHER THAN THE
OUTLET INVERT SHALL BE
FILLETED TO A UNIFORM
SLOPE BETWEEN INLET AND
OUTLET INVERTS. INVERTS
COMING INTO THE MANHOLE
AT AN ANGLE WITH THE
OUTLET PIPE SHALL BE
CURVED INTO THE OUTLET
CHANNEL. FLOW CHANNEL
THRU ALL MANHOLES SHALL
CONFORM TO 1/2 THE INSIDE
DIAMETER OF THE SEWER
PIPE CROSS SECTION. 1/2
SECTION OF SEWER PIPE MAY
BE USED ON STRAIGHT
RUNS THROUGH MANHOLES
FOR FLOW CHANNEL.

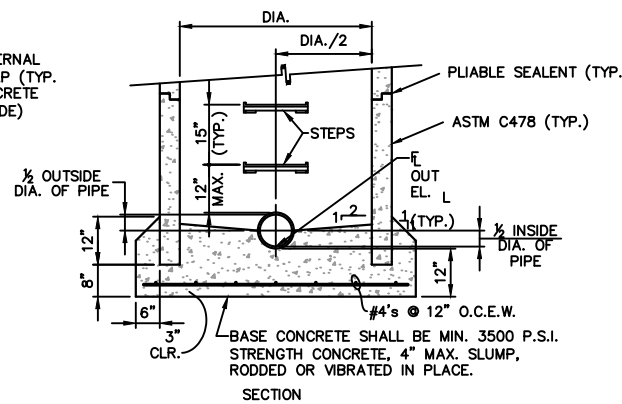


CAST-IN-PLACE MANHOLE BASE DETAILS
N.T.S.

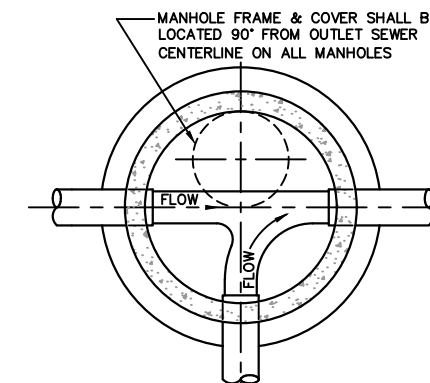

PLAN - TYPICAL ALL MANHOLES
N.T.S.

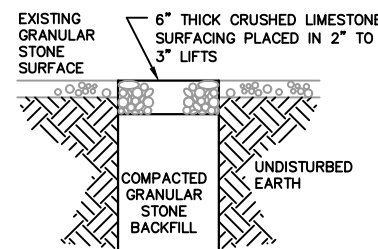

TYPE I
CRUSHED STONE SURFACING

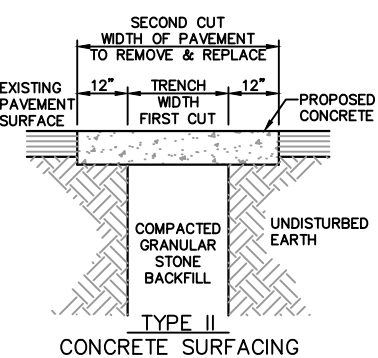


TYPE II
CONCRETE SURFACING

PAVEMENT REPAIR DETAIL
N.T.S.

NOTES:

PAVEMENT SHALL BE REMOVED AT THE
TRENCH WIDTH AFTER THE FIRST CUT
WITHOUT DAMAGE TO ADJACENT PAVEMENT.
AFTER TRENCH IS PROPERLY BACKFILLED,
PAVEMENT SHALL BE CUT AND REMOVED AN
ADDITIONAL 12" ON EACH SIDE OF THE
FIRST SAW CUT, AS SHOWN. THE SECOND
CUT SHALL BE SAWN TO FULL DEPTH OF
THE EXISTING SURFACE.

ALL EXISTING PAVEMENT SHALL BE
REPLACED WITH A MINIMUM OF 6" OF
CONCRETE OR A CONCRETE THICKNESS
EQUAL TO THE EXISTING PAVEMENT
THICKNESS PLUS TWO INCHES, WHICHEVER IS
GREATER. SPECIAL REQUEST FOR USE OF
ASPHALT SHALL BE SUBMITTED IN WRITING
TO THE CITY. IF APPROVED, THE CITY SHALL
ISSUE A WRITTEN APPROVAL.

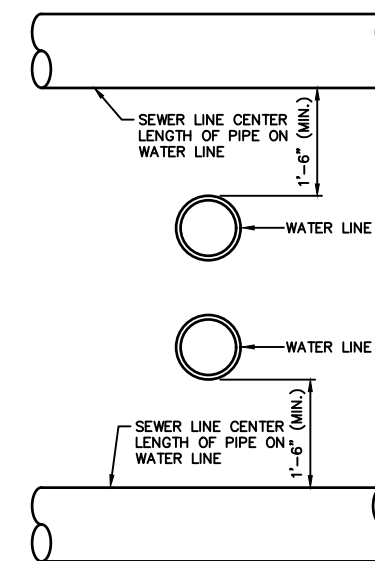

NOTE:
IF 18" SEPARATION CANNOT BE ACHIEVED, THE
ENGINEER SHALL BE NOTIFIED TO DETERMINE
AN APPROPRIATE REMEDY.

WATER CROSSING DETAIL
NTS

OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES
MANAGEMENT,
DESIGN AND CONSTRUCTION

MISSOURI
NATIONAL GUARD

CONNECT CAMP CLARK
TO CITY OF NEVADA
SEWER SYSTEM

CAMP CLARK

NEVADA, MISSOURI

PROJECT # T2301-02
SITE # 6274
ASSET # 8136274075

REVISION: _____
DATE: _____
REVISION: _____
DATE: _____
REVISION: _____
DATE: _____
ISSUE DATE: 06/14/2024

CAD DWG FILE: _____
DRAWN BY: AWW
CHECKED BY: SCW
DESIGNED BY: GDW

SHEET TITLE:
STANDARD
CONSTRUCTION
DETAILS

SHEET NUMBER:

C-504

EASEMENT NOTE:

SANITARY SEWER EASEMENTS HAVE NOT BEEN OBTAINED DUE TO THE PROPOSED PRESSURE SEWER PIPE AND LIFT STATION BEING LOCATED ON FEDERAL PROPERTY THAT IS COVERED IN ARMY REGULATION (AR 405-80) GRANTING ACCESS FOR ALL QUALIFYING UTILITIES.



EXISTING 120/208 3 ϕ PAD MOUNT TRANSFORMER TO BE REPLACED WITH A 277/480 VOLT 3 ϕ TRANSFORMER. CONTRACTOR SHALL COORDINATE WITH EVERGY.

PROPOSED ELECTRICAL SERVICE EQUIPMENT RACK, SEE DETAIL ON DWG. NO. E-103

LEGEND


---	EXISTING UNDERGROUND ELECTRIC	⊗	EXISTING FIRE HYDRANT
-x-x-	EXISTING FENCE	▲	EXISTING GAS METER
-f/o-	EXISTING FIBER OPTIC	•	EXISTING GAS VALVE
-g-	EXISTING GAS	○	EXISTING IRON PIN
-s-s-	EXISTING SEWER	⊞	EXISTING MAILBOX
-uot-	EXISTING UNDERGROUND TELEPHONE	⊙	EXISTING MANHOLE
- - - -	EXISTING RIGHT OF WAY	●	EXISTING PIPE POST
- - - -	EXISTING SECTION LINE	⊗	EXISTING LIGHT POLE
-w-w-	EXISTING WATERLINE	⊘	EXISTING POWER POLE
-x-x-	PROPOSED FENCE	▲	EXISTING RW MARKER
-s-s-	PROPOSED GRAVITY SEWER	+	EXISTING SIGN
-ps-ps-	PROPOSED PRESSURE SEWER	⊗	EXISTING TELEPEDESTAL
- - - -	PROPOSED TEMPORARY EASEMENT	⊗	EXISTING TREE
- - - -	PROPOSED PERMANENT EASEMENT	⊗	EXISTING SHRUB
951	EXISTING MINOR CONTOURS	●	EXISTING WATER METER
950	EXISTING MAJOR CONTOURS	⊗	EXISTING WATER VALVE
951	PROPOSED MINOR CONTOURS	⊗	EXISTING WATER HYDRANT
950	PROPOSED MAJOR CONTOURS	⊗	PROPOSED MANHOLE
⊗	EXISTING CLEANOUT	⊗	PROPOSED AIR RELEASE VALVE
○	CONTROL POINT		

GROUNDING LEGEND

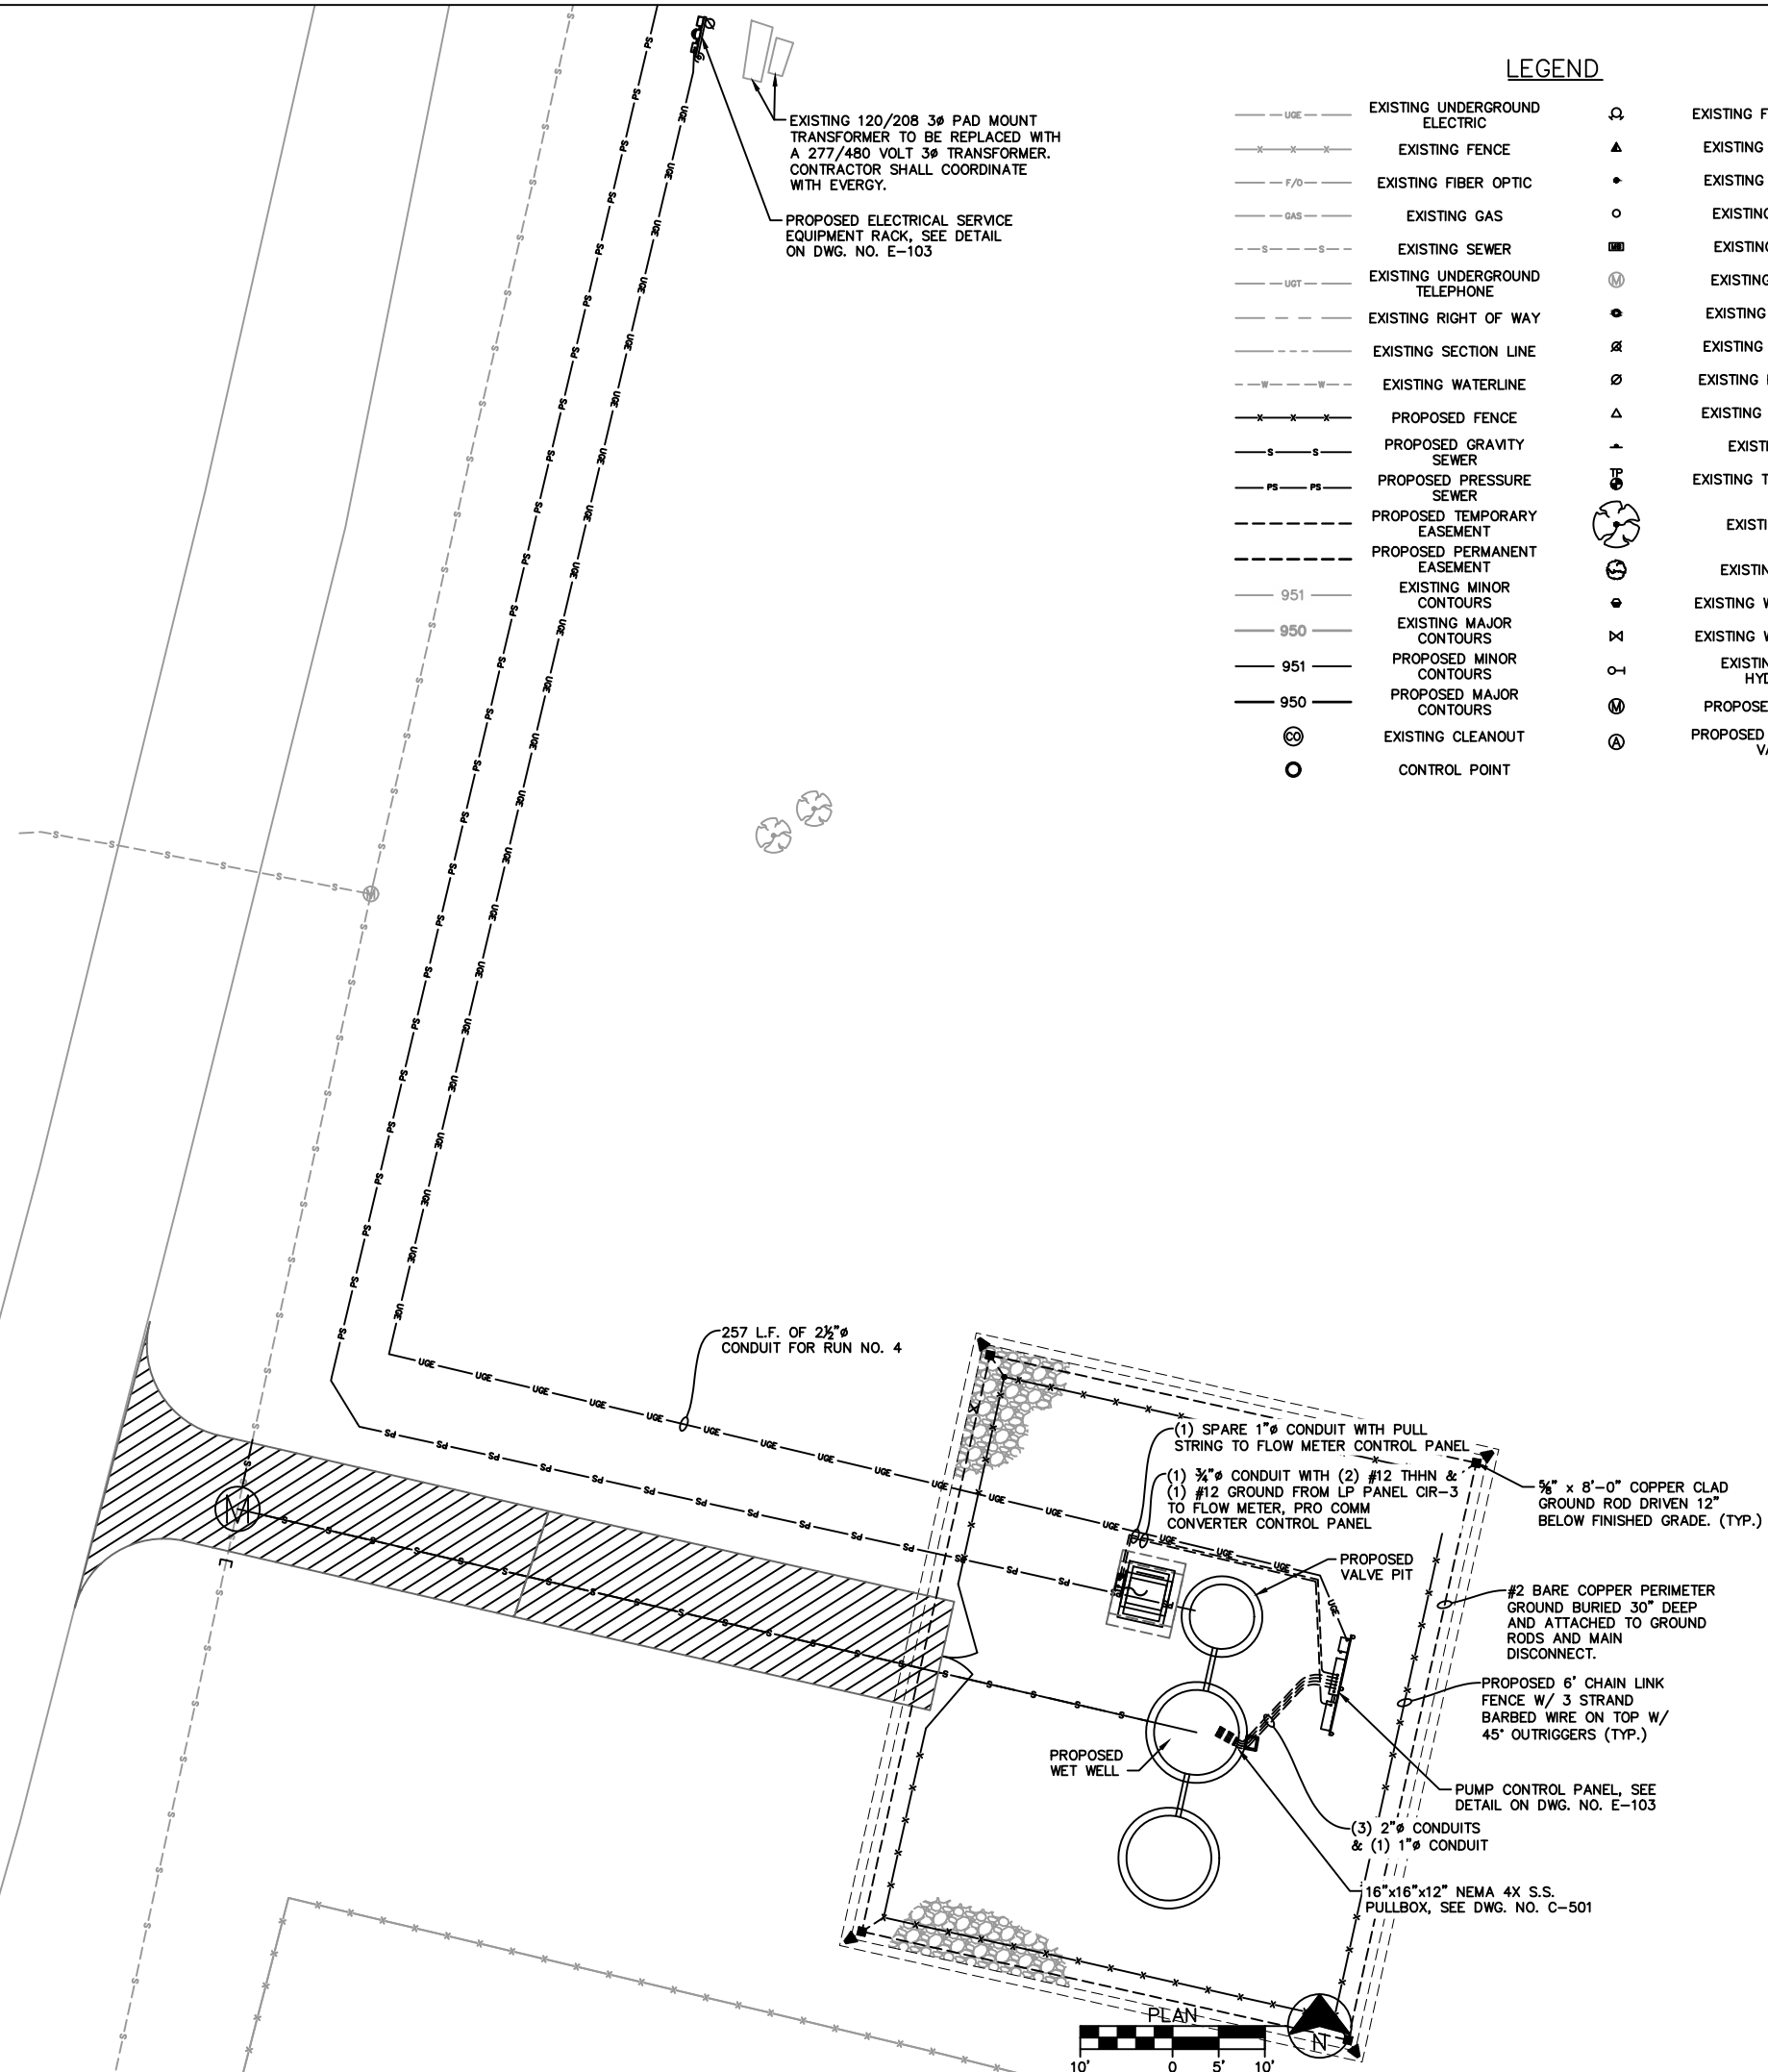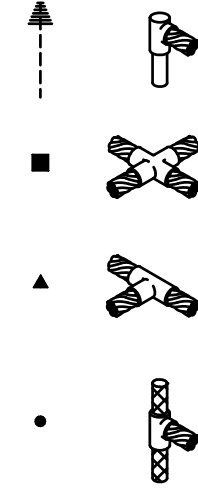

STATE OF MISSOURI
MICHAEL L. PARSON,
GOVERNOR

CIVIL ENGINEER: GARRETT D. WAGNER
LICENSE NO. PE-2019000226



OFFICE OF ADMINISTRATION
DIVISION OF FACILITIES
MANAGEMENT,
DESIGN AND CONSTRUCTION

MISSOURI
NATIONAL GUARD

CONNECT CAMP CLARK
TO CITY OF NEVADA
SEWER SYSTEM

CAMP CLARK

NEVADA, MISSOURI

PROJECT # T2301-02
SITE # 6274
ASSET # 8136274075

REVISION:	EASEMENTS
DATE:	03-26-2024
REVISION:	
DATE:	
REVISION:	
DATE:	
ISSUE DATE:	06/14/2024



CAD DWG FILE:	
DRAWN BY:	AWW
CHECKED BY:	SCW
DESIGNED BY:	GDW

SHEET TITLE:
**LIFT STATION
ELECTRICAL**

SHEET NUMBER:

E-101



21 OF 23 SHEETS

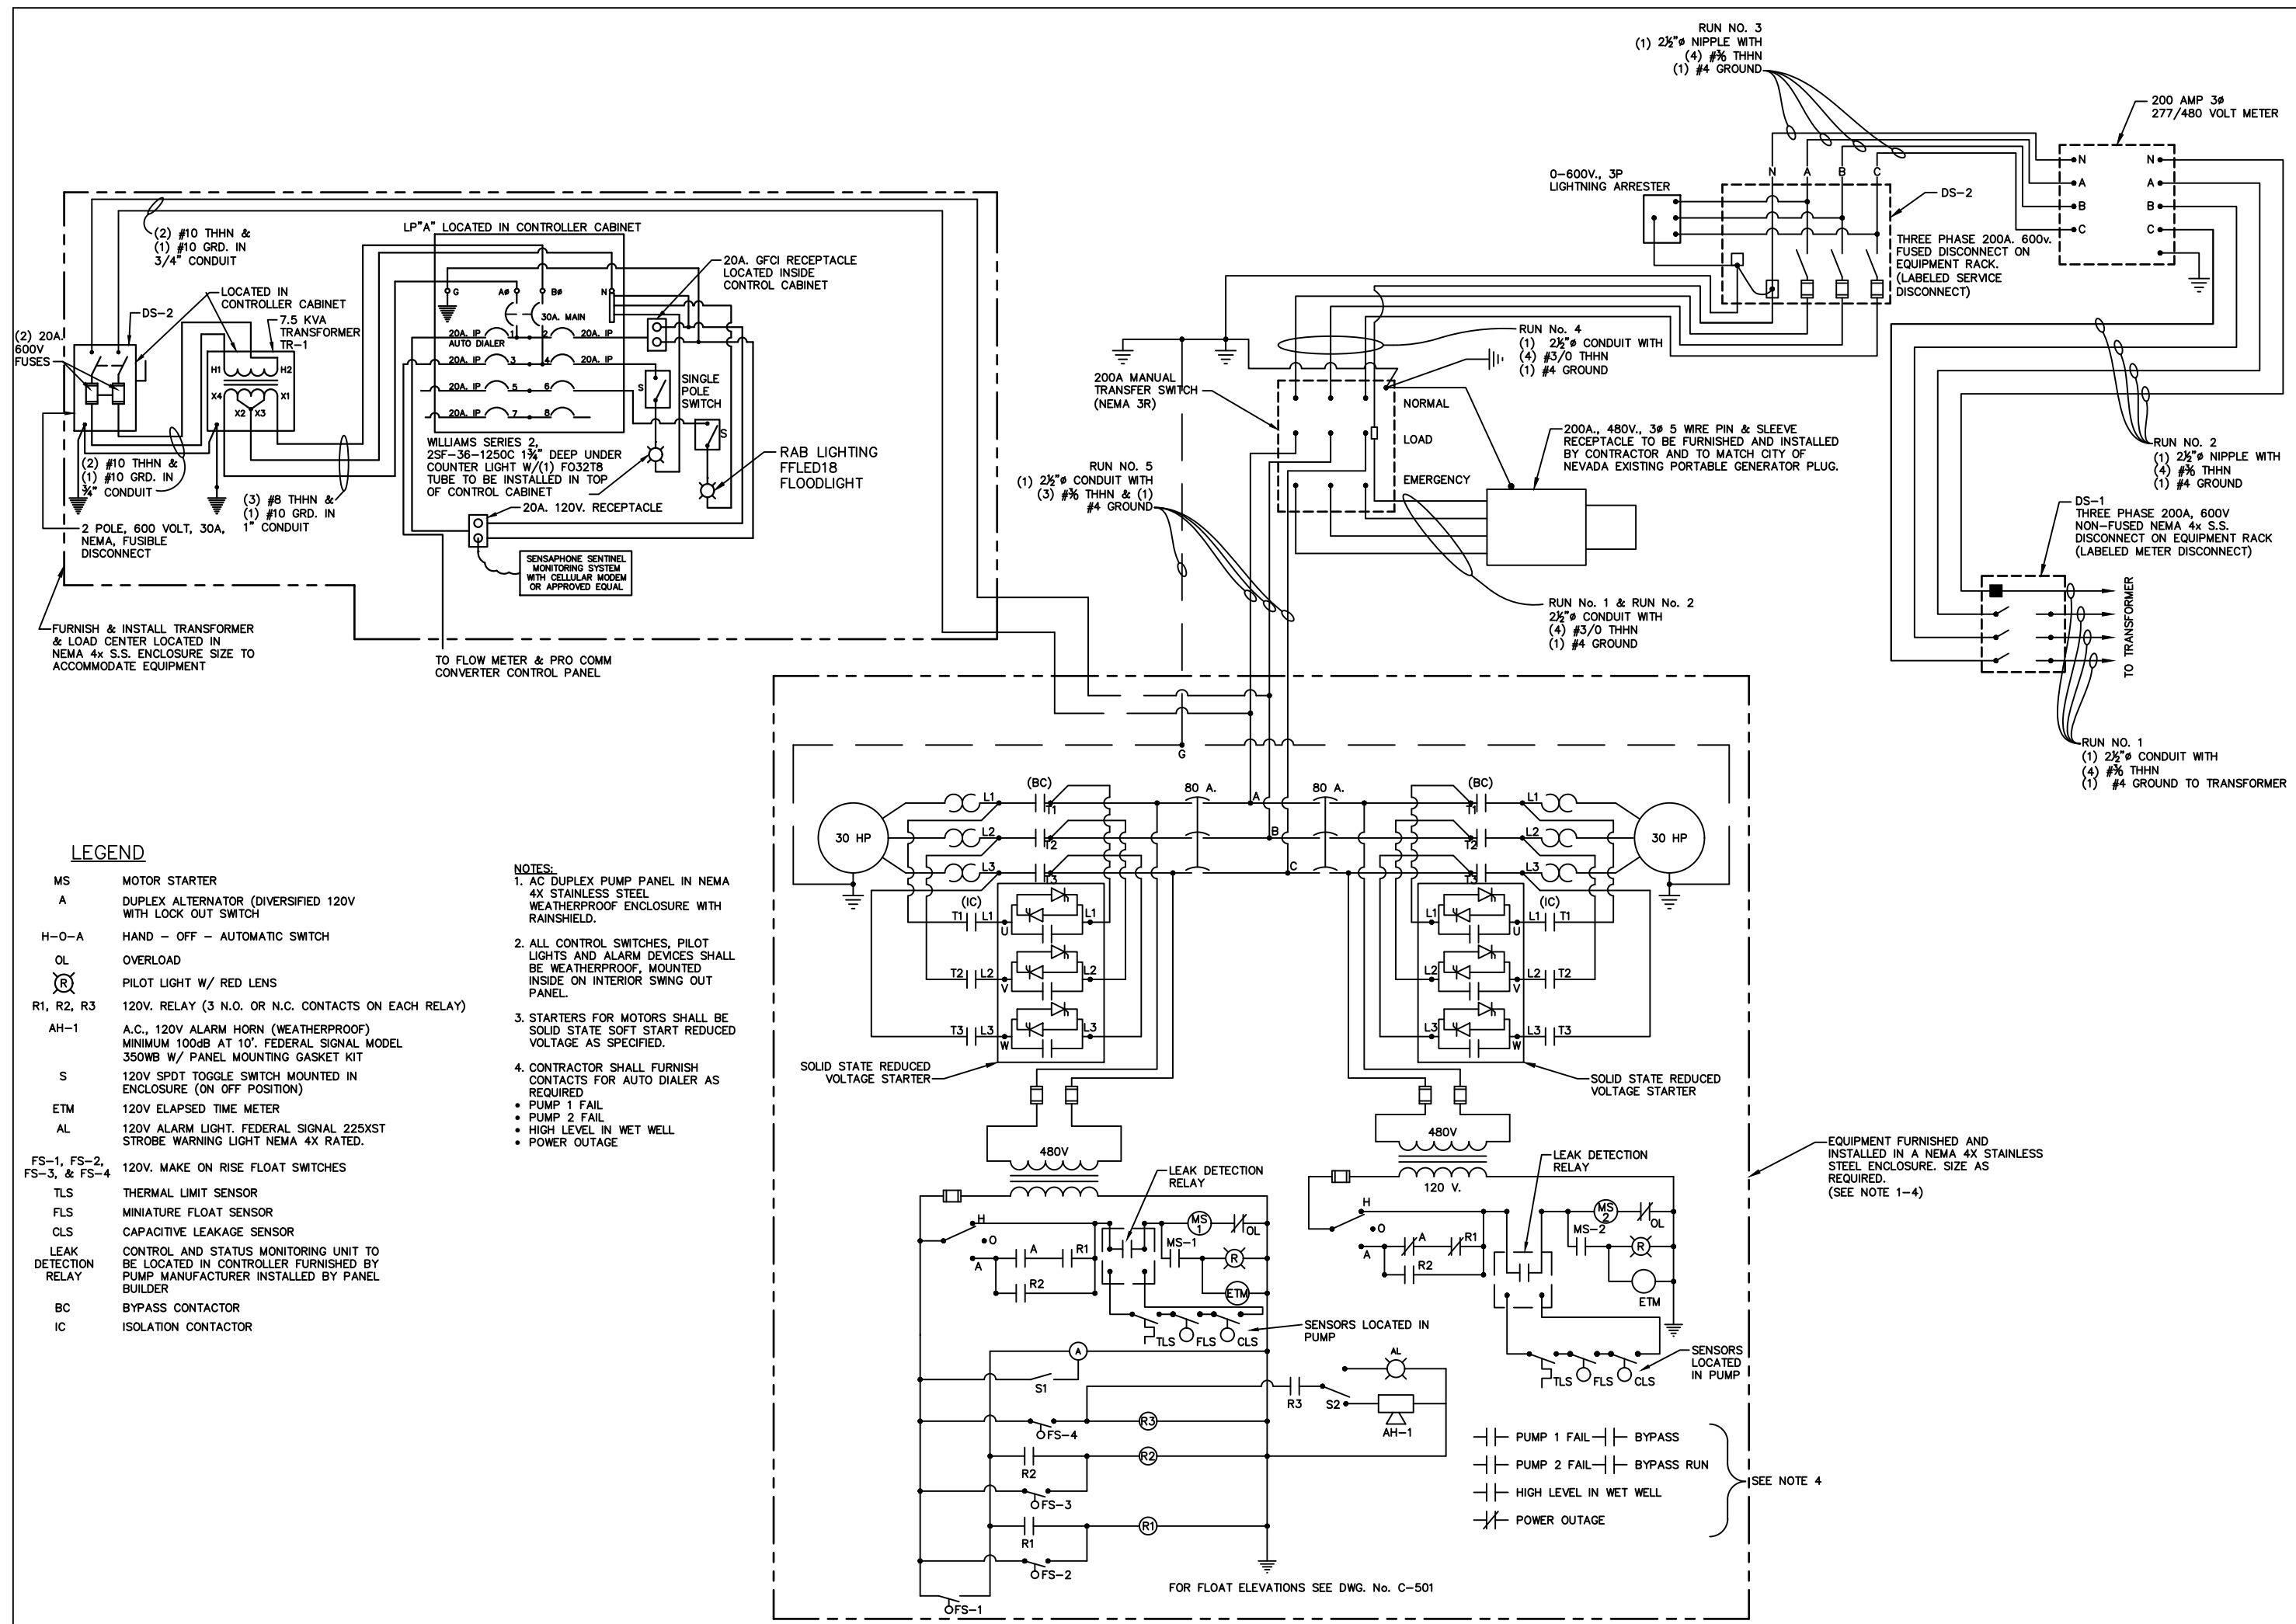

- LEGEND**
- MS MOTOR STARTER
 - A DUPLEX ALTERNATOR (DIVERSIFIED 120V WITH LOCK OUT SWITCH)
 - H-O-A HAND - OFF - AUTOMATIC SWITCH
 - OL OVERLOAD
 - (R) PILOT LIGHT W/ RED LENS
 - R1, R2, R3 120V. RELAY (3 N.O. OR N.C. CONTACTS ON EACH RELAY)
 - AH-1 A.C., 120V ALARM HORN (WEATHERPROOF) MINIMUM 100dB AT 10'. FEDERAL SIGNAL MODEL 350WB W/ PANEL MOUNTING GASKET KIT
 - S 120V SPDT TOGGLE SWITCH MOUNTED IN ENCLOSURE (ON OFF POSITION)
 - ETM 120V ELAPSED TIME METER
 - AL 120V ALARM LIGHT. FEDERAL SIGNAL 225XST STROBE WARNING LIGHT NEMA 4X RATED.
 - FS-1, FS-2, FS-3, & FS-4 120V. MAKE ON RISE FLOAT SWITCHES
 - TLS THERMAL LIMIT SENSOR
 - FLS MINIATURE FLOAT SENSOR
 - CLS CAPACITIVE LEAKAGE SENSOR
 - LEAK DETECTION RELAY CONTROL AND STATUS MONITORING UNIT TO BE LOCATED IN CONTROLLER FURNISHED BY PUMP MANUFACTURER INSTALLED BY PANEL BUILDER
 - BC BYPASS CONTACTOR
 - IC ISOLATION CONTACTOR

- NOTES:**
1. AC DUPLEX PUMP PANEL IN NEMA 4X STAINLESS STEEL WEATHERPROOF ENCLOSURE WITH RAINSHIELD.
 2. ALL CONTROL SWITCHES, PILOT LIGHTS AND ALARM DEVICES SHALL BE WEATHERPROOF, MOUNTED INSIDE ON INTERIOR SWING OUT PANEL.
 3. STARTERS FOR MOTORS SHALL BE SOLID STATE SOFT START REDUCED VOLTAGE AS SPECIFIED.
 4. CONTRACTOR SHALL FURNISH CONTACTS FOR AUTO DIALER AS REQUIRED
 - PUMP 1 FAIL
 - PUMP 2 FAIL
 - HIGH LEVEL IN WET WELL
 - POWER OUTAGE

- || PUMP 1 FAIL || BYPASS
 - || PUMP 2 FAIL || BYPASS RUN
 - || HIGH LEVEL IN WET WELL
 - || POWER OUTAGE
- { SEE NOTE 4

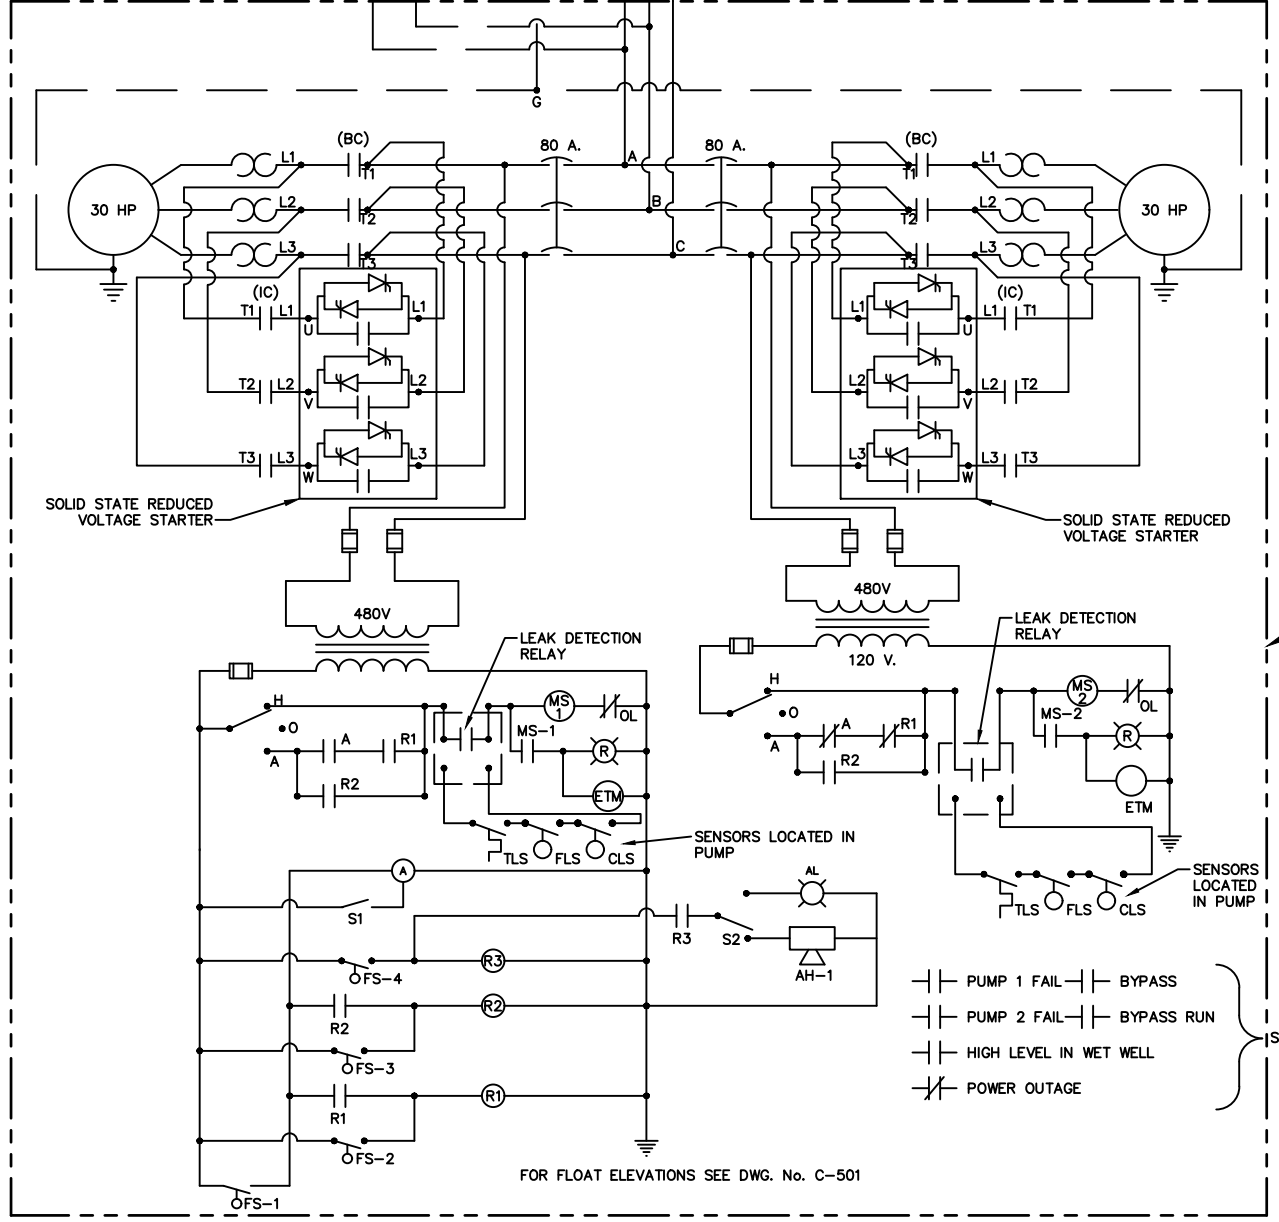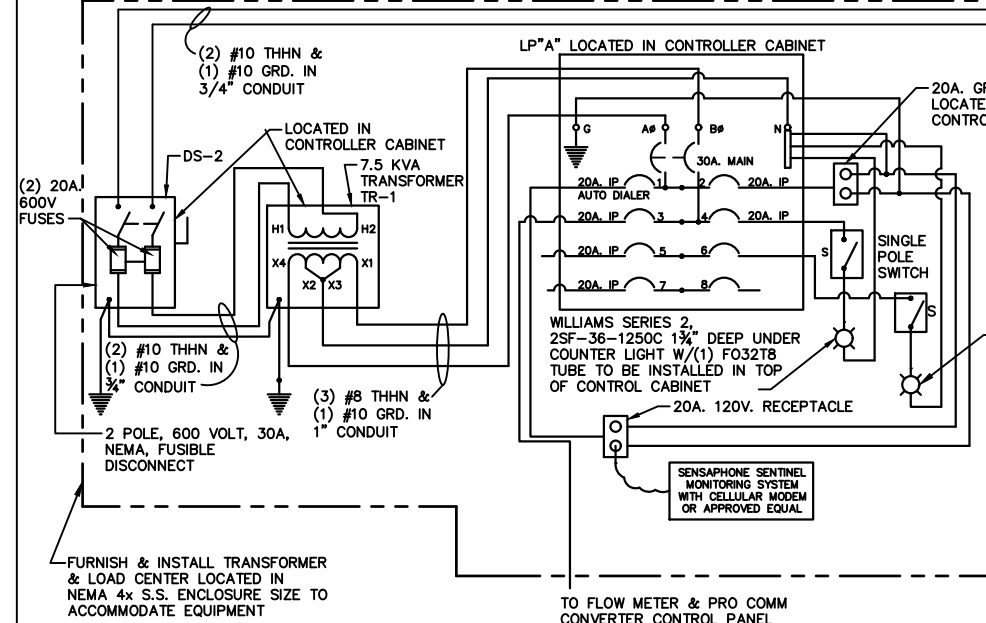

EQUIPMENT FURNISHED AND INSTALLED IN A NEMA 4X STAINLESS STEEL ENCLOSURE. SIZE AS REQUIRED. (SEE NOTE 1-4)

FOR FLOAT ELEVATIONS SEE DWG. No. C-501

ELECTRICAL CONTROL DIAGRAM

