

## ADDENDUM NO. 2

TO: PLANS AND SPECIFICATIONS FOR STATE OF MISSOURI

Repairs to Interior/Exterior  
Lebanon Readiness Center  
Lebanon, Missouri  
PROJECT NO.: T2507-01

Bid Opening Date: 1:30 PM, Thursday, FEBRUARY 19, 2026 (not changed)

Bidders are hereby informed that the Construction Plans and/or Specifications are modified as follows:

### **SPECIFICATION CHANGES:**

1. Reference Specification 007300 – SUPPLEMENTARY CONDITIONS

#### **ADD the following to 2.0 CONTACTS:**

##### **Construction Representative:**

John Gentges  
Division of Facilities Management Design & Construction  
301 W High Street Room 730  
Jefferson City, MO 65101  
Telephone: 573-526-5768  
Email: [john.gentges@oa.mo.gov](mailto:john.gentges@oa.mo.gov)

2. Reference Specification 096500 – RESILIENT FLOORING: **Revise** the following in Part 1, Paragraph 1.5 Warranty to provide a Ten (10) Year warranty on manufacturing defects and a Ten (10) year wear warranty stating that product will not wear through (damage or affect) the printed film layer due to normal traffic. Manufacturer will pay all reasonable labor costs (these costs will be determined by manufacturer).
3. Reference Specification 096500 – RESILIENT FLOORING: **Revise** the following in Part 2, Paragraph 2.1, item A to the following:

##### **A. Luxury Vinyl Tile:**

1. Basis of Design Manufacturer: J+J Flooring, P.O. Box 1287, Dalton, GA, 30722. (800) 241-4586. JJFLOORINGGROUP.COM. Please contact JOE DINEEN, (785) 550-5300, [joe.dineen@jfflooringgroup.com](mailto:joe.dineen@jfflooringgroup.com) or comparable product of other manufacturers approved by the Architect.

a) Any manufacturer and/or product must meet or exceed those requirements specified under all sections of this document in pattern, color, and format. Any substitutions must be made in accordance with the specified procedures for substitutions.

2. Product: 5mm
3. Color: To be selected by Architect from manufacturer's full range.

4. Added Antimicrobial: ZPT (Zinc Protective Technology)
  5. Thickness: 5mm Loose Lay
  6. Finish / Coating: Enhanced UV Urethane w/ Ceramic Bead
  7. Ceramic bead with immersion rate greater than 5 micrograms/sf
  8. Pattern Repeat: Random
  9. Dimensions: 18" x 36"
  10. Backing Class: Commercial Grade
  11. Commercial Traffic: Heavy Commercial
4. Reference Specification 096723 – RESINOUS WALLS AND FLOORING: **Revise** the following in Part 2, Paragraph 2.3, item A Fiberglass Reinforced Wall System, Restroom Shower Stall, System GWB-R1 to System FG-R1. GWB-R1 does not exist.
  5. Reference Specification 099123 – INTERIOR PAINTING: Revise the following in Part 3, Paragraph 3.5 – Paint System Schedule **ADD** CMU-E3 System, Location Interior Existing Painted CMU (Epoxy System) - See High Performance Coating Specification System.
  6. Reference Specification 102800 – TOILET, BATH, AND LAUNDRY ACCESSORIES: Revise the following in Part 2, Paragraph 2.6, **ADD** item G as follows:
    - G. Folding Dressing Room Seat: Wall-mounted surface; welded tubular seat frame, structural support members, hinges, and mechanical fasteners of Type 304 stainless steel, rectangular shaped
      1. Seat: Phenolic or polymeric composite one-piece seat or seat slats, of color as selected.
      2. Size: ADA Standards compliant. Bench size: 25.5 x 14 inches.
      3. Products:
        - a. Bobrick Washroom Equipment, Inc.: B-5193:  
[www.bobrick.com](http://www.bobrick.com).
  7. Reference Specification 23 05 93 – Testing, Adjusting, and Balancing for HVAC:
    - A. Refer to part 3.01, subpart F – Pre-Qualified TAB Agencies:
      1. Add “4. Precisionaire of the Midwest”.
  8. Reference Specification 23 81 26.13 – Small-Capacity Split-System Air Conditioners:
    - A. Refer to part 2.01 – Manufacturers:
      1. Add “E. Lennox”.

#### **DRAWING CHANGES:**

1. Sheet A-002 – DEMOLITION FLOOR PLAN
  - a. Revise to **ADD** removal of existing resilient flooring in Women’s restroom 126.
2. Sheet M-201 – Mechanical Details and Schedules:
  - a. Refer to “Heat Pump Condensing Unit Schedule”:
    - i. Revise schedule per attached sheet AD02-M-201.
  - b. Refer to “furnace Schedule”: Revise note per attached sheet AD02-M-201.

#### **GENERAL COMMENTS:**

1. The Pre-Bid Meeting was held February 3rd, 2026. The Pre-Bid Meeting sign-in sheet is attached.
2. Please contact Lorena Villalobos 573-645-6526 [lorena.villalobos@oa.mo.gov](mailto:lorena.villalobos@oa.mo.gov) for questions regarding bidding procedures, MBE/WBE/SDVE Goals, and other submittal requirements.
3. The deadline for technical questions is February 10, 2026, at noon (12 pm).
4. Changes to, or clarification of, the Bid Documents are only made as issued in the Addenda.
5. All correspondence with respect to this project must include the State of Missouri project number as indicated above.
6. Current Planholders list is available online at: <https://www.oafmdcplanroom.com/projects/3126/details/t2507-01-repairs-to-interiorexterior-lebanon-readiness-center>
7. Weather Allowance: Included within the completion period for this Project 5 (five) "bad weather" days.
8. Facility Interruption: Included within the completion period for this Project 20 (twenty) "facility interruption" days.
9. Working hours will be 8-5 unless otherwise arranged with onsite staff of the building.
10. A competent Superintendent from the general contractor is to be on site every day.
11. Armory will move all its own belongings. This project will not be phased but will continue to be occupied during construction.
12. Drill weekends take place once a month on sat/sun. Someone will be there to set up for this on Friday.
13. Contractors should plan to have a job site trailer as no in-building services or storage shall be expected. The fenced in portion of the facility can be used for contractor storage and trailer.
14. Clarification asked if the louvers in the drill floor were operational and if the new ACT ceiling could go against them. DWA clarified that the acoustical panels in the drill floor are direct applied to the existing ceiling therefore would not interfere with the louvers.
15. Cap flashing on the roof is intended to be the same gauge as the existing.
16. On Print E2.01 Keynotes 26.07 thru 26.13 and 26.17, 26.25 it states to Circuit it to Existing Space in Panel Board and Provide New Breaker. Are we to assume we need to install new Conduit and Wire as well?
  - a. If we are showing a new circuit, then yes - a new conduit and wire should be provided. If the contractor can reuse the existing in the field, then we would not have a problem with that, however the bids need to include new as we have adjusted some of the size of the circuits and we do not know the condition of the existing circuits.
17. The Data/IT cover plate and jacks are not included in Alternate 2.
18. **All bids shall be submitted without additional terms and conditions, modification or reservation on the bid form with each space properly filled. Bids not on these forms will be rejected. Failure to do so will result in rejection of the bid.**
19. **MBE/WBE/SDVE participation requirements can be found in DIVISION 00. MBE/WBE/SDVE Goals: MBE 10%, WBE 10%, and SDVE 3%. NOTE: Only MBE/WBE firms certified by the State of Missouri Office of Equal Opportunity as of the date of bid opening, or SDVE(s) meeting the requirements of Section 34.074, RSMo and 1 CSR 30-5.010, can be used to satisfy the MBE/WBE/SDVE participation goals for this project. No other certifications from other Missouri certifying agencies will be accepted. If a bidder is unable to meet a participation goal, a Good Faith Effort Determination Form must be completed. Failure to complete this process will result in rejection of the bid.**

**SUBSTITUTION REQUESTS:**

1. Scranton Products, Hiny Hiders Solid Plastic
  - a. Given that Phenolic and HDPE are not the same material and given our recent experience, we will not be accepting this product as a substitution.

**ATTACHMENTS:**



1. Pre-Bid Meeting Sign-In Sheet
2. Attachments: AD02-M-201

**February 6, 2026**

**END ADDENDUM NO. 2**

**Pre-Bid Meeting Attendance Sheet**  
**Lebanon Readiness Center-Repairs to Interior/Exterior, Readiness Center Building,**  
**Lebanon Readiness Center**  
**301 West Freemont Road**  
**Lebanon, MO 65536**

**Project No. T2507-01**  
**February 03, 2026 @ 9:00 a.m.**

Name & Title	Company Name Type of Contracting	MBE/WBE/ SDVE Status	Phone	E-Mail Address
Lorena Villalobos 	OA/FMDC	N/A	(573) 645-6526	<u>Lorena.Villalobos@oa.mo.gov</u>
Bill Edwards 	MONG	N/A	(573) 638-9534	<u>Billy.j.edwards55.nfg@army.mil</u>
Jason Hollandsworth	MOARNG	N/A	(417) 588-2058	<u>Jason.d.hollandsworth.mil@army.mil</u>
Chris Sutterer 	DAKE WELLS	N/A	(833) 518-45458	<u>csutterer@dake-wells.com</u>
Emily Whitty 	DAKE WELLS	N/A	(833) 518-45458	<u>ewhitty@dake-wells.com</u>

**Pre-Bid Meeting Attendance Sheet**  
**Lebanon Readiness Center-Repairs to Interior/Exterior, Readiness Center Building,**  
**Lebanon Readiness Center**  
**301 West Freemont Road**  
**Lebanon, MO 65536**

**Project No. T2507-01**  
**February 03, 2026 @ 9:00 a.m.**

Name & Title	Company Name Type of Contracting	MBE/WBE/ SDVE Status	Phone	E-Mail Address
Justin Rogers Pm / GC	Brown & Root GC		573 301 4995	Justin. Rogers @ Brownandroot.com
Mike Burgart	G.P.H Builders		573-893- 3633	Mike @ gphbuilders.com
ISAAC LAWSON	HAMBEY CONSTRUCTION		417-349-2493	isaac@hambeyconstruction.com
Clayton Caperton	DeLong Plumbing		417-224-5989	Clayton.C@delongplumbing.com
Matt Beabout	Quality Electric		1-573-369-3107	qualityelec@hughes.net
Darin Piggott	Mid-Missouri Plumbing		573-286-4746	Mid.Mo.Plumbing at Gmail.com

**Pre-Bid Meeting Attendance Sheet**  
**Lebanon Readiness Center-Repairs to Interior/Exterior, Readiness Center Building,**  
**Lebanon Readiness Center**  
**301 West Freemont Road**  
**Lebanon, MO 65536**

Project No. T2507-01  
 February 03, 2026 @ 9:00 a.m.

Name & Title	Company Name Type of Contracting	MBE/WBE/ SDVE Status	Phone	E-Mail Address
Brandon Gentges owner	Gentges Roofing Construction/Roofing		573-680-9399	gentgesroofing@gmail
Marc Christo Regional Mgr.	American Weatherstar		913-209-5638	mchrisc@weatherstar.com
Scott Hant	Meyer Electric		(73) 694 1219	scott@meyerelectric.net
MIKE STILLWELL PM	ALLOY ABATE/SELECT DEMO		314-327 1650	mstillwell@alloygroup.com
Rich Northemer President	Pro/Prost LLC		573-257- 1122	estimating@rustbullet.com -CONS rnorthemer@proconstruction SDVE.COM
DAVID NICHOLS  DUSTIN HAGENS	SES CONSTRUCTION  GC	WBE	(573) 253-1148	DAVID@SESCONSTRUCTION.COM  DUSTIN@SESCONSTRUCTION.COM

**Pre-Bid Meeting Attendance Sheet**  
**Lebanon Readiness Center-Repairs to Interior/Exterior, Readiness Center Building,**  
**Lebanon Readiness Center**  
**301 West Freemont Road**  
**Lebanon, MO 65536**

**Project No. T2507-01**  
**February 03, 2026 @ 9:00 a.m.**

Name & Title	Company Name Type of Contracting	MBE/WBE/ SDVE Status	Phone	E-Mail Address
Mark Exter Estimator	Bill's Electric Inc	NO	417-960-1312	mexter@beijoplinc.com
DJ DeGreffner owner	DeGreffner HVAC	NO	573-375-0787	degreffnerhvac@att.net
James Berhert V.P	Comfort Zone INC	NO	573-801-5483	berhertcomfortzone@gmail.com
Russell Berhert President	Comfort Zone INC	NO	573-680-1867	berhertcomfortzone@gmail.com
Matt Roark	ARSI, Demo & Abate	NO	573-896-0222	Mattroark@arsi-mo.com
KRIS YORK	K. YORK ELECTRIC	NO	573-736-5977	kyorkelectrical@gmail.com

**Pre-Bid Meeting Attendance Sheet**  
**Lebanon Readiness Center-Repairs to Interior/Exterior, Readiness Center Building,**  
**Lebanon Readiness Center**  
**301 West Freemont Road**  
**Lebanon, MO 65536**

**Project No. T2507-01**  
**February 03, 2026 @ 9:00 a.m.**

Name & Title	Company Name Type of Contracting	MBE/WBE/ SDVE Status	Phone	E-Mail Address
Kegan Benzley	Comfort Zone Inc	NO	573-301-8714	Berhorstcomfortzone@gmail.com
Jarrett Sims	Nabholz	NO	417-402-9693	jarrett.sims@nabholz.com
Dennis Dedmon	Dedmon Flooring	NO	417-872-7327	DennisDedmon@yahoo.com
Guy AUGENSTEIN	THOMAS CONSTRUCTION	NO	314-792-3316	gaugenstein@thomasbuilder.com
Ben Ashford Sales Dir	Firm Foundation Builders	NO	417-294-1239	ben@ffbuilders.com

**T250701 - Lebanon Readiness Center**

**Pre-Bid sign in sheet**

Date: February 02, 2026

**Sign-Up**

Name: Eric SHERRELL Company: PCE Const. Address: Lake Ozark MO Phone: 573-201-1834 e-mail: esherrell@pce-mo.com

Name: Gary McGuire Company: Stiles Roofing Address: Lebanon, MO Phone: 417-532-2050 e-mail: gmcguire@stilesroofinginc.com

Name: Gene Bauer Company: Reinhold EL Address: Springfield Mo Phone: 361-271-7615 e-mail: ebauer@reinholdstock-electric.com

Name: Colby Wilson Company: CCW Plumbing Address: 1050 Bobwhite Rd Phone: 417-872-9616 e-mail: CCWPlumbing-LHC@gmail.com

Name: Colt Wilson Company: CCW Plumbing Address: 1050 Bobwhite Rd Phone: 417-241-2736 e-mail: CCWplumbingllc@gmail.com

Name: CHRIS OBERHANSKY Company: ABI Address: SPRINGFIELD MO Phone: 417-496-9145 e-mail: COBERHANSKY@GMAIL.COM

Name: STERLING HATCH Company: ABI Address: SPRINGFIELD MO Phone: 480-818-2151 e-mail: \_\_\_\_\_

Name: Bill Slater Company: Wright Construction Address: 11 Lami Industrial Dr St. Peters MO 63704 Phone: 636-220-6850 e-mail: bids@wrightconstruct.com


Name: John Gentges Company: OA-FMDC Address: JC MO Phone: 573-291-9596 e-mail: John.gentges@oa.mo.gov

Name: Brian Messier Company: Clearwater Plb Address: 115 W. Grant Republic, MO Phone: 417-343-4192 e-mail: clearwaterrep@att.net

Name: \_\_\_\_\_ Company: \_\_\_\_\_ Address: \_\_\_\_\_ Phone: \_\_\_\_\_ e-mail: \_\_\_\_\_

Name: \_\_\_\_\_ Company: \_\_\_\_\_ Address: \_\_\_\_\_ Phone: \_\_\_\_\_ e-mail: \_\_\_\_\_


Name: \_\_\_\_\_ Company: \_\_\_\_\_ Address: \_\_\_\_\_ Phone: \_\_\_\_\_ e-mail: \_\_\_\_\_

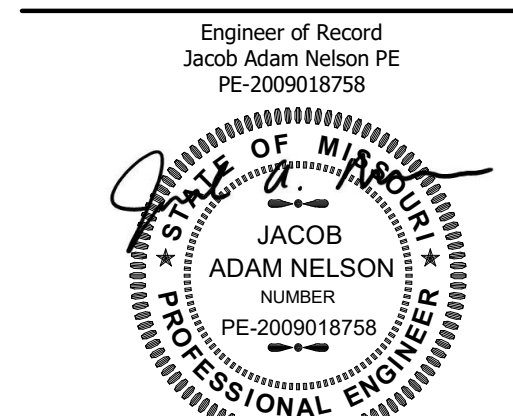


02/06/2026  
PROFESSIONAL SEAL



**TRUE ENGINEERING**  
MECHANICAL • ELECTRICAL • PLUMBING  
1200 E WOODHURST DR, STE F  
SPRINGFIELD, MO 65804  
417.708.7025  
WWW.TRUE-MEP.COM

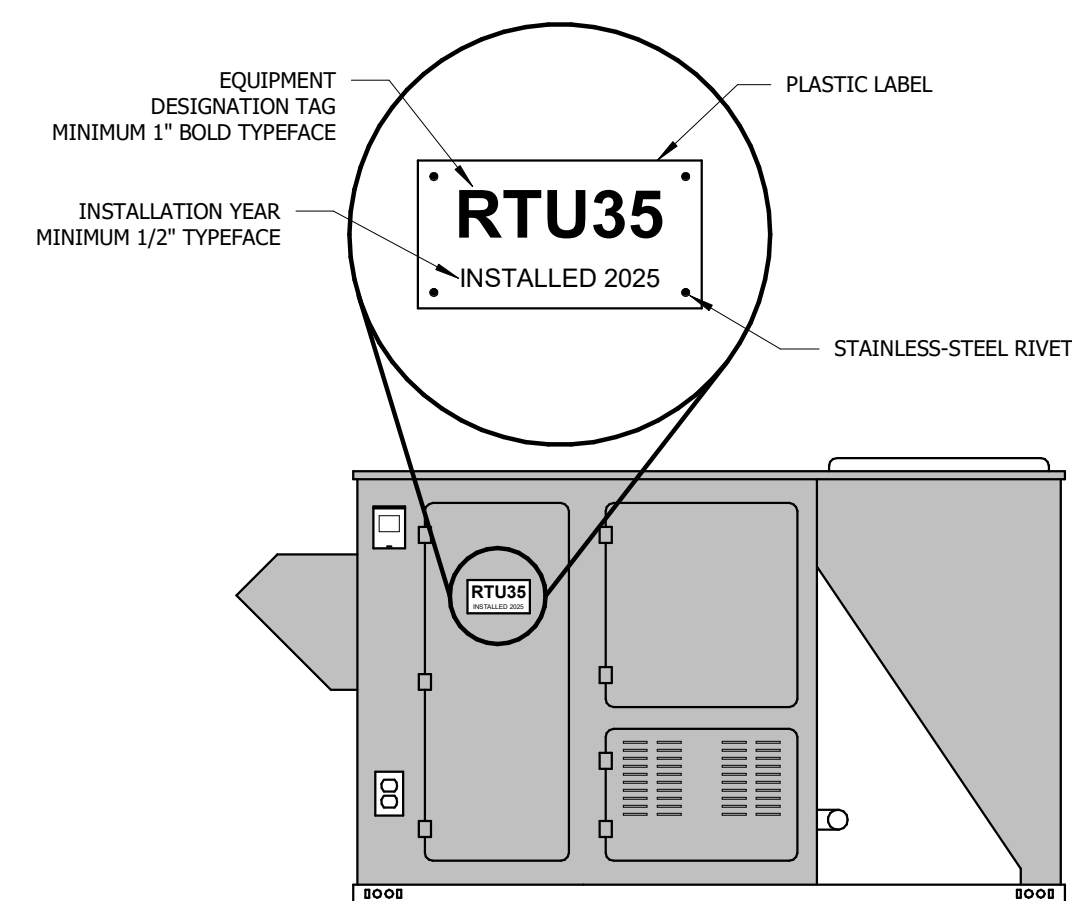

- NOTES:**
- EQUIPMENT LABEL SHALL BE MULTILAYER, MULTICOLOR PLASTIC LABELS MINIMUM 1/8" THICK. LABEL SHALL HAVE PREDRILLED HOLES FOR ATTACHMENT HARDWARE.
  - LETTERING SHALL BE MECHANICALLY ENGRAVED. LETTER COLOR SHALL BE WHITE WITH BLACK BACKGROUND.
  - LABEL AND LETTERING SHALL BE RATED FOR EXTERIOR APPLICATIONS WITH EXTENDED DURABILITY AND FADE RESISTANCE.
  - REFER TO SPECIFICATIONS FOR ADDITIONAL EQUIPMENT LABEL REQUIREMENTS.

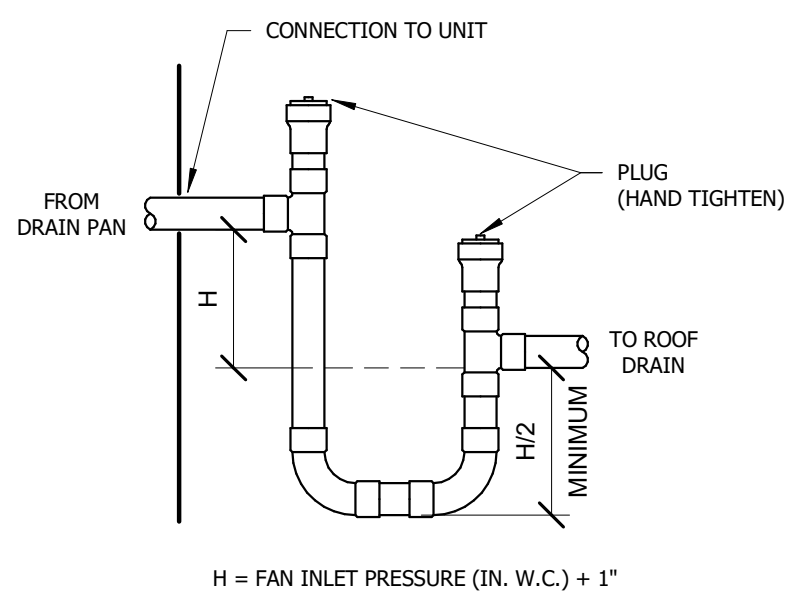

**3 CONDENSATE TRAP**  
NOT TO SCALE

**UNIT HEATER SCHEDULE**

**NOTES:**

- TWO STAGE THERMOSTAT (FIELD COORDINATE LOCATION WITH OWNER).
- CHAIN HANGING SET.
- STAINLESS STEEL FLEXIBLE GAS CONNECTOR.
- 4-POINT SUSPENSION.
- FULL FAN GUARD.
- VENT CAP.
- TWO STAGE NATURAL GAS VALVE.

TYPE MARK	MANUFACTURER	MODEL NUMBER	INPUT (MBH)	HEATING OUTPUT (MBH)	VOLTAGE	WEIGHT	NOTES	EQUIVALENTS
LHD2	MODINE	HD30	30	24.9	120/1	55 LBS	1 THRU 7	SEE SPECS

**AIR DEVICE SCHEDULE**

**NOTES:**

- GRILLE/DIFFUSER NECK SHALL BE SAME SIZE AS BRANCH DUCTWORK UNLESS NOTED OTHERWISE ON PLAN.
- DIFFUSER DISCHARGE AIR PATTERN SHALL BE 4-WAY UNLESS NOTED BY DIRECTION ON PLANS.
- GRILLE/DIFFUSER SHALL BE FIELD PAINTABLE.
- PROVIDE PLASTER FRAME ADAPTOR FOR LAYIN INTO GYPSUM CEILING.

TYPE MARK	SYTEM TYPE	MANUFACTURER	MODEL NUMBER	FRAME	FINISH	DAMPER	MAX NC RATING	EXTERNAL STATIC (WC)	NOTES	EQUIVALENTS
E01	EXHAUST	KRUEGER	6690	GYP.	WHITE	-	30	0.1"	1,2,4	SEE SPECS
S01	SUPPLY	KRUEGER	PLQ	GYP.	WHITE	-	30	0.1"	1,2,4	SEE SPECS
S02	SUPPLY	KRUEGER	880	DUCT	PAINT	ORD	30	0.1"	2,3	SEE SPECS

**2 EQUIPMENT LABEL**  
NOT TO SCALE

**EXHAUST FAN SCHEDULE**

**NOTES:**

- FACTORY MOUNTED DISCONNECTING MEANS.
- GRAVITY BACKDRAFT DAMPER.
- FAN SPEED CONTROLLER.
- INTERIOR WIRE GUARD.
- VIBRATION ISOLATION SUPPORTS.


TYPE MARK	MANUFACTURER	MODEL NUMBER	CFM	EXTERNAL STATIC (WC)	MOUNTING	FINISH	VOLTAGE	MOTOR HP (WATTS)	NOTES	EQUIVALENTS
EF01	COOK	GN-622	400	0.25"	SUSPENDED	STANDARD	120/1	(116)	1,2,3,4,5	SEE SPECS
EF02	COOK	GN-168	150	0.25"	SUSPENDED	STANDARD	120/1	(50)	1,2,3,4,5	SEE SPECS

**MINI-SPLIT SYSTEM SCHEDULE**

**NOTES:**

- PROVIDE REFRIGERANT LINE SET(S) SIZED PER MANUFACTURER'S RECOMMENDATIONS.
- PROVIDE ALL REFRIGERATION SYSTEM ACCESSORIES REQUIRED BY MANUFACTURER FOR GIVEN LINE SET ROUTING.
- PROVIDE BALL VALVES AT LIQUID AND SUCTION LINE FOR EACH BRANCH.

TYPE MARK	MANUFACTURER	OUTDOOR UNIT	INDOOR UNIT	AMBIENT TEMPERATURE SUMMER DB/WB	WINTER DB/WB	TOTAL MBH	HEATING MBH	VOLTAGE	MCA	MOCOP	NOTES	EQUIVALENTS
MS01	LG	KUSXB181A	KNUDB181A	96.1/73.0	0.0/0.0	16.1	8.7	208/1	16	25	1,2,3	SEE SPECS

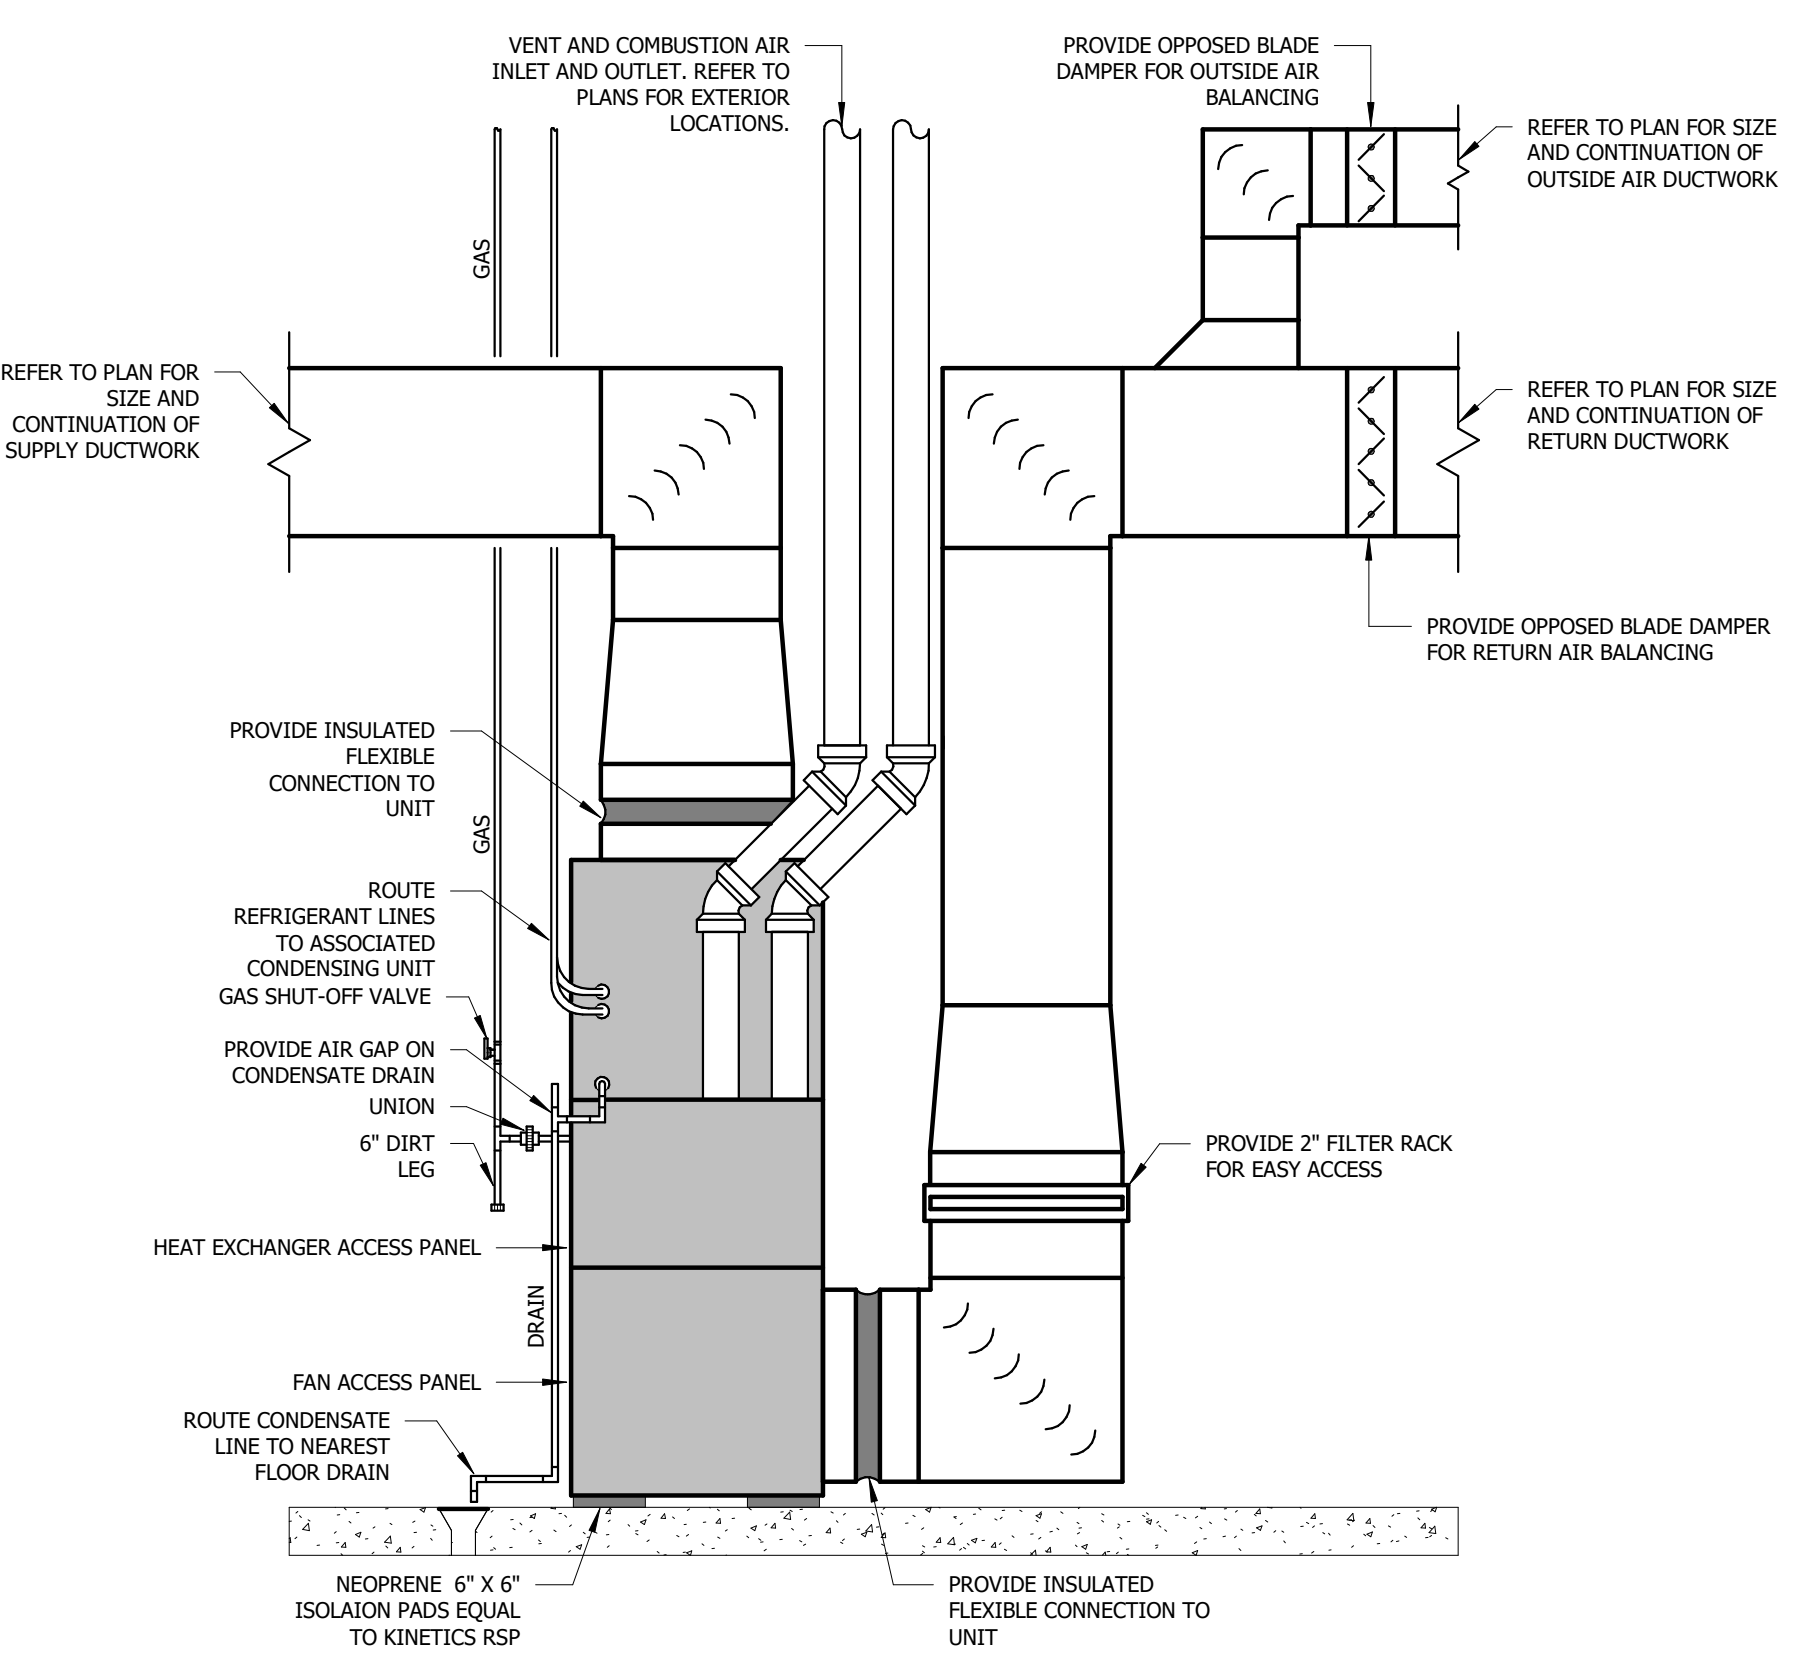

**1 FURNACE**  
NOT TO SCALE

**HEAT PUMP CONDENSING UNIT SCHEDULE**

**NOTES:**

- PROVIDE REFRIGERANT LINE SET(S) SIZED PER MANUFACTURER'S RECOMMENDATIONS.
- PROVIDE ALL REFRIGERATION SYSTEM ACCESSORIES REQUIRED BY MANUFACTURER FOR GIVEN LINE SET ROUTING.
- INSTALL ON PRECAST CONCRETE HOUSEKEEPING PAD. REFER TO DETAIL.
- PROVIDE COMPATABLE EVAPORATOR COIL. COIL SHALL BE COMPATABLE WITH DUEL FUEL SYSTEMS.

TYPE MARK	MANUFACTURER	TONNAGE	CONDENSER MODEL NUMBER	COOLING				HEATING			MCA	MOCOP	VOLTAGE	NOTES	EQUIVALENTS
				ENTERING AIR DB	ENTERING AIR WB	SENSIBLE (MBH)	TOTAL (MBH)	ENTERING AIR DB	TOTAL (MBH)	LEAVING AIR DB					
CU01	RHEEM	4	RP15AY48AJ2NA	72	60	35.5	43.2	68	33.4	90	28	45	208/1	1,2,3,4	SEE SPECS
CU02	RHEEM	2	RP15AY24AJ2NA	72	60	18.0	22.2	68	15.4	90	21	35	208/1	1,2,3,4	SEE SPECS
CU03	RHEEM	4	RP15AY48AJ2NA	72	60	35.1	42.5	68	33.6	90	28	45	208/1	1,2,3,4	SEE SPECS
CU04	RHEEM	2	RP15AY24AJ2NA	72	60	17.7	20.8	68	15.4	90	21	35	208/1	1,2,3,4	SEE SPECS
CU05	RHEEM	3	RP15AY36AJ2NA	72	60	22.3	25.8	68	33.9	90	22	35	208/1	1,2,3,4	SEE SPECS

**FURNACE SCHEDULE**

**NOTES:**

- EXTERNAL STATIC PRESSURE INCLUDES WET COIL, EXCLUDES FILTER LOSS.
- PROVIDE ACCESSIBLE FILTER RACK AND 1" FILTERS WITH MINIMUM MERV 8 RATING.
- COMBUSTION INTAKE AND EXHAUST CONCENTRIC ROOF TERMINATION KIT.
- PROVIDE RHEEM ECONET OR EQUIVALENT THERMOSTAT.
- PROVIDE CONDENSATE PUMP EQUIVALENT TO LITTLE GIANT VCM4-15 SERIES WITH SAFETY SWITCH.

TYPE MARK	MANUFACTURER	MODEL NUMBER	SUPPLY AIR (CFM)	OUTSIDE AIR (CFM)	EXTERNAL STATIC (WC)	ENTERING AIR DB	HEATING INPUT (MBH)	HEATING OUTPUT (MBH)	LEAVING AIR DB	MCA	MOCOP	VOLTAGE	NOTES	EQUIVALENTS
F01	RHEEM	R96VA0852521MSB	1600	-	0.5"	68	84	82	95	8.8	20	120/1	1,2,3,4,5	SEE SPECS
F02	RHEEM	R96VA0402317MSA	800	-	0.5"	68	42	41	95	5.9	15	120/1	1,2,3,4,5	SEE SPECS
F03	RHEEM	R96VA1152524M5A	1600	-	0.5"	68	112	109	95	8.6	20	120/1	1,2,3,4,5	SEE SPECS
F04	RHEEM	R97VA07019137USA	800	-	0.5"	68	70	68	95	6.1	15	120/1	1,2,3,4	SEE SPECS
F05	RHEEM	R96VA0702317MSA	1000	-	0.5"	68	70	68	95	6.1	15	120/1	1,2,3,4	SEE SPECS
F06	RHEEM	R96VA1152524M5A	1600	1000	0.5"	0	112	109	90	8.6	20	120/1	1,2,3,4	SEE SPECS



MISSOURI STATE CERTIFICATE OF AUTHORITY #E-2016000752

OFFICE OF  
ADMINISTRATION  
DIVISION OF FACILITIES  
MANAGEMENT,  
DESIGN AND  
CONSTRUCTION  
DEPARTMENT OF  
MISSOURI NATIONAL  
GUARD

LEBANON READINESS  
CENTER - REPAIRS TO  
INTERIOR/EXTERIOR

301 WEST FREMONT RD  
LEBANON, MO 65536

PROJECT # T2507-01  
SITE # 6286  
FACILITY # 8136286002

REVISION: AD02  
DATE: 02/06/2026  
REVISION:  
DATE:  
REVISION:  
DATE:  
ISSUE DATE: 11/07/2025

CAD DWG FILE: T2507-01  
DRAWN BY: KP  
CHECKED BY: JN  
DESIGNED BY: JN

SHEET TITLE:  
MECHANICAL  
DETAILS AND  
SCHEDULES

SHEET NUMBER:

**M-201**

25 of 30 SHEETS  
11/07/2025