

# PROJECT MANUAL

*Design & Install Domestic Water Plant*

*St. James Veterans Home*

*St. James, Missouri*

Designed By: CASCO  
12 Sunnen Dr. Suite 100  
St. Louis, MO, 63143

Date Issued: August 15, 2024

Project No.: U2409-01

STATE *of* MISSOURI

---

OFFICE *of* ADMINISTRATION  
Facilities Management, Design & Construction


---

**SECTION 000107 - PROFESSIONAL SEALS AND CERTIFICATIONS**

**PROJECT NUMBER:** (U2409-01 Design & Install Domestic Water Plant, Veterans Home Building, St. James, MO)

**THE FOLLOWING DESIGN PROFESSIONALS HAVE SIGNED AND SEALED THE ORIGINAL PLANS AND SPECIFICATIONS FOR THIS PROJECT, WHICH ARE ON FILE WITH THE DIVISION OF FACILITIES MANAGEMENT, DESIGN AND CONSTRUCTION:**


**Mechanical/Plumbing Design:**

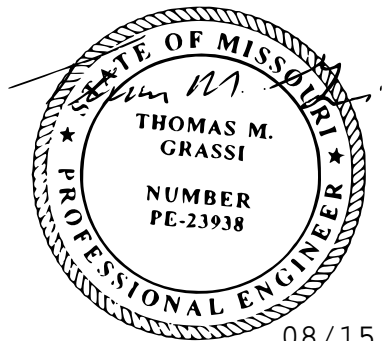

08/15/24

**Thomas M. Grassi  
Exp. Date: 12/31/24  
Lic. E-23938**

**Electrical Engineering Design:**

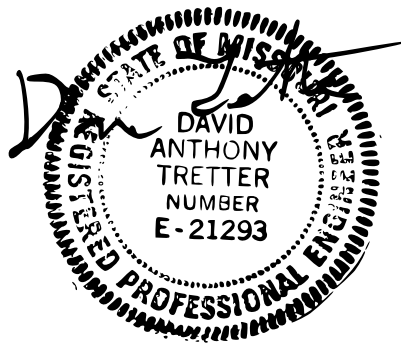

08/15/24

**David A. Tretter  
Exp. Date: 12/31/25  
Lic. #021293**

**TABLE OF CONTENTS**

<b>SECTION</b>	<b>TITLE</b>	<b>NUMBER OF PAGES</b>
<b>DIVISION 00 – PROCUREMENT AND CONTRACTING INFORMATION</b>		
<b>000000 INTRODUCTORY INFORMATION</b>		
000101	Project Manual Cover	1
000107	Professional Seals and Certifications	1
000110	Table of Contents	2
000115	List of Drawings	1
<b>001116</b>	<b>INVITATION FOR BID (IFB) plus Missouri Buys instructions and special notice</b>	<b>2</b>
<b>002113</b>	<b>INSTRUCTIONS TO BIDDERS (Includes MBE/WBE/SDVE Information)</b>	<b>8</b>
003144	MBE/WBE/SDVE Directory	1
<b>**The following documents may be found on MissouriBUYS at <a href="https://missouribuys.mo.gov/">https://missouribuys.mo.gov/</a>**</b>		
<b>004000 PROCUREMENT FORMS &amp; SUPPLEMENTS</b>		
004113	Bid Form	*
004322	Unit Prices Form	*
004336	Proposed Subcontractors Form	*
004337	MBE/WBE/SDVE Compliance Evaluation Form	*
004338	MBE/WBE/SDVE Eligibility Determination Form for Joint Ventures	*
004339	MBE/WBE/SDVE Good Faith Effort (GFE) Determination Forms	*
004340	SDVE Business Form	*
004541	Affidavit of Work Authorization	*
004545	Anti-Discrimination Against Israel Act Certification form	*
<b>005000 CONTRACTING FORMS AND SUPPLEMENTS</b>		
005213	Construction Contract	3
005414	Affidavit for Affirmative Action	1
<b>006000 PROJECT FORMS</b>		
006113	Performance and Payment Bond	2
006325	Product Substitution Request	2
006519.16	Final Receipt of Payment and Release Form	1
006519.18	MBE/WBE/SDVE Progress Report	1
006519.21	Affidavit of Compliance with Prevailing Wage Law	1
<b>007000 CONDITIONS OF THE CONTRACT</b>		
007213	General Conditions	20
007300	Supplementary Conditions	1
007346	Wage Rate	4
<b>DIVISION 1 - GENERAL REQUIREMENTS</b>		
011000	Summary of Work	4
012100	Allowances	3
012300	Alternates	2
012600	Contract Modification Procedures	3
013100	Coordination	5
013115	Project Management Communications	4
013200	Schedules – Bar Chart	5
013300	Submittals	7
013513.28	Site Security and Health Requirements	6
015000	Construction Facilities and Temporary Controls	10
017400	Cleaning	4
017900	Demonstration and Training	6

## TECHNICAL SPECIFICATIONS INDEX:

### DIVISION 2 – EXISTING CONDITION

024119	Selective Demolition	6
--------	----------------------	---

### DIVISION 3 - CONCRETE

033000	Cast-In-Place Concrete	18
--------	------------------------	----

### DIVISION 7 – THERMAL AND MOISTURE PROTECTION

079200	Joint Sealants	4
--------	----------------	---

### DIVISION 22 – PLUMBING

220510	Basic Plumbing Requirements	4
220511	Common Work Results for Plumbing	10
220513	Common Work Requirements for Plumbing Equipment	3
220519	Meters and Gages for Plumbing Piping	6
220523	General-Duty Valves for Plumbing Piping	8
220529	Hangers and Supports for Plumbing Piping and Equipment	10
220553	Identification for Plumbing Piping and Equipment	5
220719	Plumbing Insulation	19
221116	Domestic Water Piping	8
221119	Domestic Water Piping Specialties	6
221123	Domestic Water Pumps	5
223450	Commercial, Hot Water Storage Tanks	5

### DIVISION 23 – HEATING VENTILATING AND AIR CONDITIONING

230900	Instrumentation and Control for HVAC	12
231123	Facility Natural-Gas Piping	14
232113	Hydronic Piping	10
232116	Hydronic Piping Specialties	6
232123	Hydronic Pumps	6
235233	Fire-Tube Boilers	10

### DIVISION 26 – ELECTRICAL

260533	Raceways and Boxes for Electrical Systems	4
262726	Wiring Devices	3
262816	Enclosed Switches and Circuit Breakers	4

### Appendix

Exhibit A	Water Treatment	2
-----------	-----------------	---

## **SECTION 000115 – LIST OF DRAWINGS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

1. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

1. This Section provides a comprehensive list of the drawings that comprise the Bid Documents for this project.

### **PART 2 - PRODUCTS (NOT APPLICABLE)**

### **PART 3 - EXECUTION**

#### **3.1 LIST OF DRAWINGS**

1. The following list of drawings is a part of the Bid Documents:

<b><u>TITLE</u></b>	<b><u>SHEET #</u></b>	<b><u>DATE</u></b>
COVER SHEET	G-001	08.15.2024
PLUMBING – PHASE 1 DEMOLITION & NEW	P-101	08.15.2024
PLUMBING – PHASE 2 DEMOLITION & NEW	P-102	08.15.2024
PLUMBING BASEMENT FLOOR PLANS	P-103	08.15.2024
PLUMBING FIRST FLOOR PLAN – ALTERNATE #2	P-104	08.15.2024
PLUMBING DETAILS	P-501	08.15.2024
PLUMBING SEQUENCE OF OPERATIONS	P-601	08.15.2024
PLUMBING SCHEDULES	P-602	08.15.2024
PLUMBING DIAGRAMS	P-603	08.15.2024
PLUMBING RISER ISOMETRICS	P-901	08.15.2024
PLUMBING PHASE 1 DEMO RISER ISOMETRICS ROTATED	P-902	08.15.2024
PLUMBING PHASE 1 NEW RISER ISOMETRICS ROTATED	P-903	08.15.2024
PLUMBING PHASE 2 DEMO RISER ISOMETRICS ROTATED	P-904	08.15.2024
PLUMBING PHASE 2 NEW RISER ISOMETRICS ROTATED	P-905	08.15.2024
ELECTRICAL LEGEND & SYMBOLS	E-001	08.15.2024
ELECTRICAL GENERAL NOTES & SCHEDULES	E-002	08.15.2024
ELECTRICAL BASEMENT FLOOR PLAN – PHASE 1	E-101	08.15.2024
ELECTRICAL BASEMENT FLOOR PLAN – PHASE 2	E-102	08.15.2024

**END OF SECTION 000115**

## SECTION 001116 - INVITATION FOR BID

### 1.0 OWNER:

- A. The State of Missouri  
Office of Administration,  
Division of Facilities Management, Design and Construction  
Jefferson City, Missouri

### 2.0 PROJECT TITLE AND NUMBER:

- A. Design & Install Domestic Water Plant  
St. James Veterans Home  
St. James, Missouri  
**Project No.: U2409-01**

### 3.0 BIDS WILL BE RECEIVED:

- A. Until: 1:30 PM, December 10, 2024
- B. **Only electronic bids on MissouriBUYS shall be accepted: <https://missouribuys.mo.gov>. Bidder must be registered to bid.**

### 4.0 DESCRIPTION:

- A. Scope: The project includes the replacement of a portion of the hot water system.
- B. MBE/WBE/SDVE Goals: MBE 10%, WBE 10%, and SDVE 3%. **NOTE: Only MBE/WBE firms certified by the State of Missouri Office of Equal Opportunity as of the date of bid opening, or SDVE(s) meeting the requirements of Section 34.074, RSMo and 1 CSR 30-5.010, can be used to satisfy the MBE/WBE/SDVE participation goals for this project.**
- C. **\*\*NOTE:** Bidders are provided new Good Faith Effort (GFE) forms on MissouriBUYS.

### 5.0 PRE-BID MEETING:

- A. Place/Time: 10:00 AM, November 25, 2024, at St. James Veterans Home; 620 North Jefferson St. James, MO 65559
- B. Access to State of Missouri property requires presentation of a photo ID by all persons.

### 6.0 HOW TO GET PLANS & SPECIFICATIONS:

- A. View Only Electronic bid sets are available at no cost or paper bid sets for a deposit of \$100.00 from American Document Solutions (ADS). MAKE CHECKS PAYABLE TO: American Document Solutions. Mail to: American Document Solutions, 1400 Forum Blvd., Suite 7A, Columbia, Missouri 65203. Phone 573-446-7768, Fax 573-355-5433, <https://www.adsplanroom.net>. NOTE: Prime contractors will be allowed a maximum of two bid sets at the deposit rate shown above. Other requesters will be allowed only one bid set at this rate. Additional bid sets or parts thereof may be obtained by any bidder at the cost of printing and shipping by request to American Document Solutions at the address shown above. **Bidder must secure at least one bid set to become a planholder.**
- B. **Refunds: Return plans and specifications in unmarked condition within 15 working days of bid opening to American Document Solutions, 1400 Forum Blvd., Suite 7A, Columbia, Missouri 65203. Phone 573-446-7768, Fax 573-355-5433. Deposits for plans not returned within 15 working days shall be forfeited.**
- C. Information for upcoming bids, including downloadable plans, specifications, Invitation for Bid, bid tabulation, award, addenda, and access to the ADS planholders list, is available on the Division of Facilities Management, Design and Construction's web site: <https://oa.mo.gov/facilities/bid-opportunities/bid-listing-electronic-plans>.

### 7.0 POINT OF CONTACT:

- A. Designer: CASCO, Regina Raineri, (314) 821-1100 x 145, email: [Regina.Raineri@thecdcompanies.com](mailto:Regina.Raineri@thecdcompanies.com)
- B. Project Manager: Ryan Abbott, (573) 298-1967, email: [Ryan.Abbott@oa.mo.gov](mailto:Ryan.Abbott@oa.mo.gov)

### 8.0 GENERAL INFORMATION:

- A. The State reserves the right to reject any and all bids and to waive all informalities in bids. No bid may be withdrawn for a period of 20 working days subsequent to the specified bid opening time. The contractor shall pay not less than the prevailing hourly rate of wages for work of a similar character in the locality in which the work is performed, as determined by the Missouri Department of Labor and Industrial Relations and as set out in the detailed plans and specifications.
- B. Bid results will be available at <https://oa.mo.gov/facilities/bid-opportunities/bid-listing-electronic-plans> after it is verified that at least one bid is awardable and affordable.

## Very Important MissouriBUYS Instructions to Help Submit a Bid Correctly

- A. The bidder shall submit his or her bid and all supporting documentation on MissouriBUYS eProcurement System. No hard copy bids shall be accepted. Go to <https://missouribuys.mo.gov> and register. The bidder must register and complete a profile fully with all required documents submitted prior to submitting a bid.
- B. Once registered, log in.
1. Under "Solicitation" select "View Current Solicitations."
  2. Under "Filter by Agency" select "OA-FMDC-Contracts Chapter 8", then click "Filter Solicitation" button.
  3. Select "Active Solicitations" tab.
  4. To see the Solicitation Summary, click on the Project Number and the summary will open. Click each heading to open detailed information.
- C. Here are simplified instructions for uploading the bid to MissouriBUYS:
1. Find the solicitation by completing Steps 1 through 4 above.
  2. Select the three dots under "Actions." Select "Add New Response."
  3. When the Quote box opens, give the response a title and select "OK."
  4. The detailed solicitation will open. Select "Check All" for the Original Solicitation Documents, open each document, and select "Accept." If this step is not completed, a bid cannot be uploaded. Scroll to the bottom of the page and select "Add Attachments." If you do not see this command, not all documents have been opened and accepted.
  5. The Supplier Attachments box will open. Select "Add Attachment" again.
  6. The Upload Documents box will open. Read the instructions for uploading. Disregard the "Confidential" check box.
  7. Browse and attach up to 5 files at a time. Scroll to bottom of box and select "Upload." The Supplier Attachments box will open. Repeat Steps 5 through 7 if more than 5 files are to be uploaded.
  8. When the Supplier Attachments box opens again and uploading is complete, select "Done." A message should appear that the upload is successful. If it does not, go to the Bidder Response tab and select "Submit."
  9. The detailed solicitation will open. At the bottom select "Close."
- D. Any time a bidder wants to modify the bid, he or she will have to submit a new one. FMDC will open the last response the bidder submits. The bidder may revise and submit the bid up to the close of the solicitation (bid date and time). Be sure to allow for uploading time so that the bid is successfully uploaded prior to the 1:30 PM deadline; we can only accept the bid if it is uploaded before the deadline.
- E. If you want to verify that you are uploading documents correctly, please contact Paul Girouard: 573-751-4797, [paul.girouard@oa.mo.gov](mailto:paul.girouard@oa.mo.gov) ; April Howser: 573-751-0053, [April.Howser@oa.mo.gov](mailto:April.Howser@oa.mo.gov) ; or Mandy Roberson: 573-522-0074, [Mandy.Roberson@oa.mo.gov](mailto:Mandy.Roberson@oa.mo.gov).
- F. If you are experiencing login issues, please contact Web Procure Support (Proactis) at 866-889-8533 anytime from 7:00 AM to 7:00 PM Central Time, Monday through Friday. If you try using a userid or password several times that is incorrect, the system will lock you out. Web Procure Support is the only option to unlock you! If you forget your userid or password, Web Procure Support will provide a temporary userid or password. Also, if it has been a while since your last successful login and you receive an "inactive" message, contact Web Procure (Proactis). If you are having a registration issue, you may contact Cathy Holliday at 573-751-3491 or by email: [cathy.holliday@oa.mo.gov](mailto:cathy.holliday@oa.mo.gov).

## **SECTION 002113 – INSTRUCTIONS TO BIDDERS**

### **1.0 - SPECIAL NOTICE TO BIDDERS**

- A. If awarded a contract, the Bidder's employees, and the employees of all subcontractors, who perform the work on the project must adhere to requirements in Section 013513 – Site Security and Health Requirements as applicable per Agency.
- B. The Bidder's prices shall include all city, state, and federal sales, excise, and similar taxes that may lawfully be assessed in connection with the performance of work, and the purchased of materials to be incorporated in the work. THIS PROJECT IS NOT TAX EXEMPT.

### **2.0 - BID DOCUMENTS**

- A. The number of sets obtainable by any one (1) party may be limited in accordance with available supply.
- B. For the convenience of contractors, sub-contractors and suppliers, copies of construction documents are on file at the office of the Director, Division of Facilities Management, Design and Construction and on the Division's web site - <https://oa.mo.gov/facilities/bid-opportunities/bid-listing-electronic-plans>.

### **3.0 - BIDDERS' OBLIGATIONS**

- A. Bidders must carefully examine the entire site of the work and shall make all reasonable and necessary investigations to inform themselves thoroughly as to the facilities available as well as to all the difficulties involved in the completion of all work in accordance with the specifications and the plans. Bidders are also required to examine all maps, plans and data mentioned in the specifications. No plea of ignorance concerning observable existing conditions or difficulties that may be encountered in the execution of the work under this contract will be accepted as an excuse for any failure or omission on the part of the contractor to fulfill in every detail all of the requirements of the contract, nor accepted as a basis for any claims for extra compensation.
- B. Under no circumstances will contractors give their plans and specifications to another contractor. Any bid received from a contractor whose name does not appear on the list of plan holders may be subject to rejection.

### **4.0 - INTERPRETATIONS**

- A. No bidder shall be entitled to rely on oral interpretations as to the meaning of the plans and specifications or the acceptability of alternate products, materials, form or type of construction. Every request for interpretation shall be made in writing and submitted with all supporting documents not less than five (5) working days before opening of bids. Every interpretation made to a bidder will be in the form of an addendum and will be sent as promptly as is practicable to all persons to whom plans and specifications have been issued. All such addenda shall become part of the contract documents.
- B. Approval for an "acceptable substitution" issued in the form of an addendum as per Paragraph 4A above, and as per Article 3.1 of the General Conditions; ACCEPTABLE SUBSTITUTIONS shall constitute approval for use in the project of the product.
- C. An "acceptable substitution" requested after the award of bid shall be approved if proven to the satisfaction of the Owner and the Designer as per Article 3.1, that the product is acceptable in design, strength, durability, usefulness, and convenience for the purpose intended. Approval of the substitution after award is at the sole discretion of the Owner.
- D. A request for "Acceptable Substitutions" shall be made on the Section 006325 Substitution Request Form. The request shall be sent directly to the project Designer. A copy of said request should also be mailed to the Owner, Division of Facilities Management, Design and Construction, Post Office Box 809, Jefferson City, Missouri 65102.



## **5.0 - BIDS AND BIDDING PROCEDURE**

- A. Bidders shall submit all submission forms and accompanying documents listed in SECTION 004113 – BID FORM, Article 5.0, ATTACHMENTS TO BID by the stated time or their bid will be rejected for being non-responsive.

Depending on the specific project requirements, **the following is a GENERIC list** of all possible bid forms that may be due with bid submittals and times when they may be due. Please check for specific project requirements on the proposal form (Section 004113). ***Not all of the following bid forms may be required to be submitted.***

### **Bid Submittal – due before stated date and time of bid opening (see IFB):**

004113	Bid Form (all pages are always required)
004322	Unit Prices Form
004336	Proposed Subcontractors Form
004337	MBE/WBE/SDVE Compliance Evaluation Form
004338	MBE/WBE/SDVE Eligibility Determination for Joint Ventures
004339	MBE/WBE/SDVE GFE Determination
004340	SDVE Business Form
004541	Affidavit of Work Authorization
004545	Anti-Discrimination Against Israel Act Certification form

- B. All bids shall be submitted without additional terms and conditions, modification or reservation on the bid forms with each space properly filled. Bids not on these forms will be rejected.
- C. All bids shall be accompanied by a bid bond executed by the bidder and a duly authorized surety company, certified check, cashier's check or bank draft made payable to the Division of Facilities Management, Design and Construction, State of Missouri, in the amount indicated on the bid form, Section 004113. Failure of the contractor to submit the full amount required shall be sufficient cause to reject his bid. The bidder agrees that the proceeds of the check, draft or bond shall become the property of the State of Missouri, if for any reason the bidder withdraws his bid after closing, or if on notification of award refuses or is unable to execute tendered contract, provide an acceptable performance and payment bond, provide evidence of required insurance coverage and/or provide required copies of affirmative action plans within ten (10) working days after such tender.
- D. The check or draft submitted by the successful bidder will be returned after the receipt of an acceptable performance and payment bond and execution of the formal contract. Checks or drafts of all other bidders will be returned within a reasonable time after it is determined that the bid represented by same will receive no further consideration by the State of Missouri. Bid bonds will only be returned upon request.

## **6.0 - SIGNING OF BIDS**

- A. A bid from an individual shall be signed as noted on the Bid Form.
- B. A bid from a partnership or joint venture shall require only one signature of a partner, an officer of the joint venture authorized to bind the venture or an attorney-in-fact. If the bid is signed by an officer of a joint venture or an attorney-in-fact, a document evidencing the individual's authority to execute contracts should be included with the bid form.
- C. A bid from a limited liability company (LLC) shall be signed by a manager or a managing member of the LLC.
- D. A bid from a corporation shall have the correct corporate name thereon and the signature of an authorized officer of the corporation manually written. Title of office held by the person signing for the corporation shall appear, along with typed name of said individual. Corporate license number shall be provided and, if a corporation organized in a state other than Missouri, a Certificate of Authority to do business in the State of Missouri shall be attached. In addition, for corporate proposals, the President or Vice-President should sign as the bidder. If the signatory is other than the corporate president or vice president, the bidder must provide satisfactory evidence that the signatory has the legal authority to bind the corporation.

- E. A bid should contain the full and correct legal name of the Bidder. If the Bidder is an entity registered with the Missouri Secretary of State, the Bidder's name on the bid form should appear as shown in the Secretary of State's records.
- F. The Bidder should include its corporate license number on the Bid Form and, if the corporation is organized in a state other than Missouri, a Certificate of Authority to do business in the State of Missouri shall be attached to the bid form.

#### **7.0 - RECEIVING BID SUBMITTALS**

- A. It is the bidder's sole responsibility to assure receipt by Owner of bid submittals by the date and time specified in the Invitation for Bid. Bids received after the date and time specified shall not be considered by the Owner.
- B. Bids must be submitted through the MissouriBUYS statewide eProcurement system (<https://www.missouribuys.mo.gov/>) in accordance with the instructions for that system. The Owner shall only accept bids submitted through MissouriBUYS. Bids received by the Owner through any other means, including hard copies, shall not be considered and will be discarded by the Owner unopened.
- C. To respond to an Invitation for Bid, the Bidder must first register with MissouriBUYS by going through the MissouriBUYS Home Page (<https://www.missouribuys.mo.gov/>), clicking the "Register" button at the top of the page, and completing the Vendor Registration. Once registered, the Bidder accesses its account by clicking the "Login" button at the top of the MissouriBUYS Home Page. Enter your USERID and PASSWORD, which the Bidder will select. Under Solicitations, select "View Current Solicitations." A new screen will open. Under "Filter by Agency" select "OA-FMDC-Contracts Chapter 8." Under "Filter by Opp. No." type in the State Project Number. Select "Submit." Above the dark blue bar, select "Other Active Opportunities." To see the Solicitation Summary, single click the Opp. No. (Project Number) and the summary will open. Single quick click each blue bar to open detailed information. The Bidder must read and accept the Original Solicitation Documents and complete all identified requirements. The Bidder should download and save all of the Original Solicitation Documents on its computer so that the Bidder can prepare its response to these documents. The Bidder should upload its completed response to the downloaded documents as an attachment to the electronic solicitation response.
- D. Step-by-step instructions for how a registered vendor responds to a solicitation electronically are provided in Section 001116 – Invitation For Bid.
- E. The Bidder shall submit its bid on the forms provided by the Owner on MissouriBUYS with each space fully and properly completed, including all amounts required for alternate bids, unit prices, cost accounting data, etc. The Owner may reject bids that are not on the Owner's forms or that do not contain all requested information.
- F. No Contractor shall stipulate in his bid any conditions not contained in the specifications or standard bid form contained in the contract documents. To do so may subject the Contractor's bid to rejection.
- G. The completed forms shall be without interlineations, alterations or erasures.

#### **8.0 - MODIFICATION AND WITHDRAWAL OF BIDS**

- A. Bidder may withdraw his bid at any time prior to scheduled closing time for receipt of bids, but no bidder may withdraw his bid for a period of twenty (20) working days after the scheduled closing time for receipt of bids.
- B. The Bidder shall modify his or her original bid by submitting a revised bid on MissouriBUYS.

#### **9.0 - AWARD OF CONTRACT**

- A. The Owner reserves the right to reject any and/or all bids and further to waive all informalities in bidding when deemed in the best interest of the State of Missouri.
- B. The Owner reserves the right to let other contracts in connection with the work, including but not by way of limitation, contracts for the furnishing and installation of furniture, equipment, machines, appliances and other apparatus.

- C. The Owner shall award a contract to the lowest, responsive, responsible Bidder in accordance with Section 8.250, RSMo. No contract will be awarded to any Bidder who has had a contract with the Owner terminated within the preceding twelve months for material breach of contract or who has been suspended or debarred by the Owner.
- D. Award of alternates, if any, will be made in numerical order unless all bids received are such that the order of acceptance of alternates does not affect the determination of the lowest, responsive, responsible bidder.
- E. No bid shall be considered binding upon the Owner until the written contract has been properly executed, a satisfactory bond has been furnished, evidence of required insurance coverage, submittal of executed Section 004541, Affidavit of Work Authorization form, documentation evidencing enrollment and participation in a federal work authorization program has been received and an affirmative action plan submitted. Failure to execute and return the contract and associated documents within the prescribed period of time shall be treated, at the option of the Owner, as a breach of bidder's obligation and the Owner shall be under no further obligation to bidder.
- F. If the successful bidder is doing business in the State of Missouri under a fictitious name, he shall furnish to Owner, attached to the Bid Form, a properly certified copy of the certificate of Registration of Fictitious Name from the State of Missouri, and such certificate shall remain on file with the Owner.
- G. Any successful bidder which is a corporation organized in a state other than Missouri shall furnish to the Owner, attached to the Bid Form, a properly certified copy of its current Certificate of Authority to do business in the State of Missouri, such certificate to remain on file with the Owner. No contract will be awarded by the Owner unless such certificate is furnished by the bidder.
- H. Any successful bidder which is a corporation organized in the State of Missouri shall furnish at its own cost to the Owner, if requested, a Certificate of Good Standing issued by the Secretary of State, such certificate to remain on file with the Owner.
- I. Transient employers subject to Sections 285.230 and 285.234, RSMo, (out-of-state employers who temporarily transact any business in the State of Missouri) may be required to file a bond with the Missouri Department of Revenue. No contract will be awarded by the Owner unless the successful bidder certifies that he has complied with all applicable provisions of Section 285.230-234.
- J. Sections 285.525 and 285.530, RSMo, require business entities to enroll and participate in a federal work authorization program in order to be eligible to receive award of any state contract in excess of \$5,000. Bidders should submit with their bid an Affidavit of Work Authorization (Section 004541) along with appropriate documentation evidencing such enrollment and participation. Section-004541, Affidavit of Work Authorization is located on the MissouriBUYS solicitation for this project. Bidders must also submit an E-Verify Memorandum before the Owner may award a contract to the Bidder. Information regarding a E-Verify is located at <https://www.uscis.gov/e-verify/>. The contractor shall be responsible for ensuring that all subcontractors and suppliers associated with this contract enroll in E-Verify.

#### **10.0 - CONTRACT SECURITY**

- A. The successful bidder shall furnish a performance/payment bond as set forth in General Conditions Article 6.1 on a condition prior to the State executing the contract and issuing a notice to proceed.

#### **11.0 - LIST OF SUBCONTRACTORS**

- A. If required by “Section 004113 – Bid Form,” each bidder must submit as part of their bid a list of subcontractors to be used in performing the work (Section 004336). The list must specify the name of the single designated subcontractor, for each category of work listed in “Section 004336 - Proposed Subcontractors Form.” If work within a category will be performed by more than one subcontractor, the bidder must provide the name of each subcontractor and specify the exact portion of the work to be done by each. Failure to list the Bidder’s firm, or a subcontractor for each category of work identified on the Bid Form or the listing of more than one subcontractor for any category without designating the portion of work to be performed by each shall be cause for rejection of the bid. If the bidder intends to perform any of the designated subcontract work with the use of his own employees, the bidder shall make that fact clear, by listing his own firm for the subject category. **If any category of work is left vacant, the bid shall be rejected.**

## **12.0 - WORKING DAYS**

- A. Contract duration time is stated in working days and will use the following definition in determining the actual calendar date for contract completion:
  - 1. Working days are defined as all calendar days except Saturdays, Sundays and the following State of Missouri observed holidays: New Year’s Day, Martin Luther King, Jr. Day, Lincoln Day, Washington’s Birthday, Truman Day, Memorial Day, Juneteenth, Independence Day, Labor Day, Columbus Day, Veterans Day, Thanksgiving Day and Christmas Day.

## **13.0 - AMERICAN AND MISSOURI - MADE PRODUCTS AND FIRMS**

- A. By signing the bid form and submitting a bid on this project, the Bidder certifies that it will use American and Missouri products as set forth in Article 1.7 of the General Conditions. Bidders are advised to review those requirements carefully prior to bidding.
- B. A preference shall be given to Missouri firms, corporations or individuals, or firms, corporations or individuals that maintain Missouri offices or places of business, when the quality of performance promised is equal or better and the price quoted is the same or less.
- C. Pursuant to Section 34.076, RSMo, a contractor or Bidder domiciled outside the boundaries of the State of Missouri shall be required, in order to be successful, to submit a bid the same percent less than the lowest bid submitted by a responsible contractor or Bidder domiciled in Missouri as would be required for such a Missouri domiciled contractor or Bidder to succeed over the bidding contractor or Bidder domiciled outside Missouri on a like contract or bid being let in the person's domiciliary state and, further, the contractor or Bidder domiciled outside the boundaries of Missouri shall be required to submit an audited financial statement as would be required of a Missouri domiciled contractor or Bidder on a like contract or bid being let in the domiciliary state of that contractor or Bidder.

## **14.0 – ANTI-DISCRIMINATION AGAINST ISRAEL ACT CERTIFICATION:**

- A. Pursuant to section 34.600, RSMo, if the Bidder meets the section 34.600, RSMo, definition of a “company” and the Bidder has ten or more employees, the Bidder must certify in writing that the Bidder is not currently engaged in a boycott of goods or services from the State of Israel as defined in section 34.600, RSMo, and shall not engage in a boycott of goods or services from the State of Israel, if awarded a contract, for the duration of the contract. The Bidder is requested to complete and submit the applicable portion of Section 004545 - Anti-Discrimination Against Israel Act Certification with their Bid Form. The applicable portion of the exhibit must be submitted prior to execution of a contract by the Owner and issuance of Notice to Proceed. If the exhibit is not submitted, the Owner shall rescind its Intent to Award and move to the next lowest, responsive, responsible bidder.

## **15.0 - MBE/WBE/SDVE INSTRUCTIONS**

- A. Definitions:
  - 1. “**MBE**” means a Minority Business Enterprise.
  - 2. “**MINORITY**” has the same meaning as set forth in 1 C.S.R. 10-17.010.
  - 3. “**MINORITY BUSINESS ENTERPRISE**” has the same meaning as set forth in section 37.020, RSMo.
  - 4. “**WBE**” means a Women’s Business Enterprise.
  - 5. “**WOMEN’S BUSINESS ENTERPRISE**” has the same meaning as set forth in section 37.020, RSMo.
  - 6. “**SDVE**” means a Service-Disabled Veterans Enterprise.
  - 7. “**SERVICE-DISABLED VETERAN**” has the same meaning as set forth in section 34.074, RSMo.
  - 8. “**SERVICE-DISABLED VETERAN ENTERPRISE**” has the same meaning as “Service-Disabled Veteran Business” set forth in section 34.074, RSMo.

B. MBE/WBE/SDVE General Requirements:

1. For all bids greater than \$100,000, the Bidder shall obtain MBE, WBE and SDVE participation in an amount equal to or greater than the percentage goals set forth in the Invitation for Bid and the Bid Form, unless the Bidder is granted a Good Faith Effort waiver by the Director of the Division, as set forth below. If the Bidder does not meet the MBE, WBE and SDVE goals, or make a good faith effort to do so, the Bidder shall be non-responsive, and its bid shall be rejected.
2. The Bidder should submit with its bid all of the information requested in the MBE/WBE/SDVE Compliance Evaluation Form for every MBE, WBE, or SDVE subcontractor or material supplier the Bidder intends to use for the contract work. The Bidder is required to submit all appropriate MBE/WBE/SDVE documentation before the stated time and date set forth in the Invitation for Bid. If the Bidder fails to provide such information by the specified date and time, the Owner shall reject the bid.
3. The Director reserves the right to request additional information from a Bidder to clarify the Bidder's proposed MBE, WBE, and/or SDVE participation. The Bidder shall submit the clarifying information requested by the Owner within two (2) Working Days of receiving the request for clarification.
4. Pursuant to section 34.074, RSMo, a Bidder that is a SDVE doing business as Missouri firm, corporation, or individual, or that maintains a Missouri office or place of business, shall receive a three-point bonus preference in the contract award evaluation process. The bonus preference will be calculated and applied by reducing the bid amount of the eligible SDVE by three percent of the apparent low responsive bidder's bid. Based on this calculation, if the eligible SDVE's evaluation is less than the apparent low responsive bidder's bid, the eligible SDVE's bid becomes the apparent low responsive bid. This reduction is for evaluation purposes only, and will have no impact on the actual amount(s) of the bid or the amount(s) of any contract awarded. In order to be eligible for the SDVE preference, the Bidder must complete and submit with its bid the Missouri Service Disabled Veteran Business Form, and any information required by the form. The form is available on the MissouriBUYS solicitation for this project.

C. Computation of MBE/WBE/SDVE Goal Participation:

1. A Bidder who is a MBE, WBE, or SDVE may count 100% of the contract towards the MBE, WBE or SDVE goal, less any amounts awarded to another MBE, WBE or SDVE. (NOTE: A MBE firm that bids as general contractor must obtain WBE and SDVE participation; a WBE firm that bids as a general contractor must obtain MBE and SDVE participation; and a SDVE firm that bids as general contractor must obtain MBE and WBE participation.) In order for the remaining contract amount to be counted towards the MBE, WBE or SDVE goal, the Bidder must complete the MBE/WBE/SDVE Compliance Evaluation Form (Section 004337) identifying itself as an MBE, WBE or SDVE.
2. The total dollar value of the work granted to a certified MBE, WBE or SDVE by the Bidder shall be counted towards the applicable goal.
3. Expenditures for materials and supplies obtained from a certified MBE, WBE, or SDVE supplier or manufacturer may be counted towards the MBE, WBE and SDVE goals, if the MBE, WBE, or SDVE assumes the actual and contractual responsibility for the provision of the materials and supplies.
4. The total dollar value of the work granted to a second or subsequent tier subcontractor or a supplier may be counted towards a Bidder's MBE, WBE and SDVE goals, if the MBE, WBE, or SDVE properly assumes the actual and contractual responsibility for the work.
5. The total dollar value of work granted to a certified joint venture equal to the percentage of the ownership and control of the MBE, WBE, or SDVE partner in the joint venture may be counted towards the MBE/WBE/SDVE goals.
6. Only expenditures to a MBE, WBE, or SDVE that performs a commercially useful function in the work may be counted towards the MBE, WBE and SDVE goals. A MBE, WBE, or SDVE performs a commercially useful function when it is responsible for executing a distinct element of the work and carrying out its responsibilities by actually performing, managing and supervising the work or providing supplies or manufactured materials.

D. Certification of MBE/WBE/SDVE Subcontractors:

1. In order to be counted towards the goals, an MBE or WBE must be certified by the State of Missouri Office of Equal Opportunity and an SDVE must be certified by the State of Missouri, Office of Administration, Division of Purchasing and Material Management or by the Department of Veterans Affairs.
2. The Bidder may determine the certification status of a proposed MBE or WBE subcontractor or supplier by referring to the Office of Equal Opportunity (OEO)'s online MBE/WBE directory (<https://apps1.mo.gov/MWBCertifiedFirms/>). The Bidder may determine the eligibility of a SDVE subcontractor or supplier by referring to the Division of Purchasing and Materials Management's online SDVE directory (<https://oao.mo.gov/sdve-certification-program/>) or the Department of Veterans Affairs' directory (<https://veterans.certify.sba.gov/#search>).
3. Additional information, clarifications, etc., regarding the listings in the directories may be obtained by calling the Division at (573)751-3339 and asking to speak to the Contract Specialist of record as shown in the Supplementary Conditions (Section 007300).

E. Waiver of MBE/WBE/SDVE Participation:

1. If a Bidder has made a good faith effort to secure the required MBE, WBE and/or SDVE participation and has failed, the Bidder shall submit with its bid the information requested in MBE/WBE/SDVE Good Faith Effort (GFE) Determination form. The GFE forms are located on the MissouriBUYS solicitation for this project. The Director will determine if the Bidder made a good faith effort to meet the applicable goals. If the Director determines that the Bidder did not make a good faith effort, the bid shall be rejected as being nonresponsive to the bid requirements. Bidders who demonstrate that they have made a good faith effort to include MBE, WBE, and/or SDVE participation will be determined to be responsive to the applicable participation goals, regardless of the percent of actual participation obtained, if the bid is otherwise acceptable.
2. In determining whether a Bidder has made a good faith effort to obtain MBE, WBE and/or SDVE participation, the Director may evaluate the factors set forth in 1 CSR 30-5.010(6)(C) and the following:
  - a. The amount of actual participation obtained;
  - b. How and when the Bidder contacted potential MBE, WBE, and SDVE subcontractors and suppliers;
  - c. The documentation provided by the Bidder to support its contacts, including whether the Bidder provided the names, addresses, phone numbers, and dates of contact for MBE/WBE/SDVE firms contacted for specific categories of work;
  - d. If project information, including plans and specifications, were provided to MBE/WBE/SDVE subcontractors;
  - e. Whether the Bidder made any attempts to follow-up with MBE, WBE or SDVE firms prior to bid;
  - f. Amount of bids received from any of the subcontractors and/or suppliers that the Bidder contacted;
  - g. The Bidder's stated reasons for rejecting any bids;
3. If no bidder has obtained any participation in a particular category (MBE/WBE/SDVE) or made a good faith effort to do so, the Director may waive that goal rather than rebid.

F. Contractor MBE/WBE/SDVE Obligations

1. If awarded a contract, the Bidder will be contractually required to subcontract with or obtain materials from the MBE, WBE, and SDVE firms listed in its bid, in amounts equal to or greater than the dollar amount bid, unless the amount is modified in writing by the Owner.

2. If the Contractor fails to meet or maintain the participation requirements contained in the Contractor's bid, the Contractor must satisfactorily explain to the Director why it cannot comply with the requirement and why failing meeting the requirement was beyond the Contractor's control. If the Director finds the Contractor's explanation unsatisfactory, the Director may take any appropriate action including, but not limited to:
  - a. Declaring the Contractor ineligible to participate in any contracts with the Division for up to twelve (12) months (suspension); and/or
  - b. Declaring the Contractor be non-responsive to the Invitation for Bid, or in breach of contract and rejecting the bid or terminating the contract.
3. If the Contractor replaces an MBE, WBE, or SDVE during the course of this contract, the Contractor shall replace it with another MBE, WBE, or SDVE or make a good faith effort to do so. All MBE, WBE and SDVE substitutions must be approved by the Director.
4. The Contractor shall provide the Owner with regular reports on its progress in meeting its MBE/WBE/SDVE obligations. At a minimum, the Contractor shall report the dollar-value of work completed by each MBE, WBE, or SDVE during the preceding month and the cumulative total of work completed by each MBE, WBE or SDVE to date with each monthly application for payment. The Contractor shall also make a final report, which shall include the total dollar-value of work completed by each MBE, WBE, and SDVE during the entire contract.

**STATE OF MISSOURI  
DIVISION OF FACILITIES MANAGEMENT,  
DESIGN AND CONSTRUCTION  
*MBE/WBE/SDVE DIRECTORIES***

---

---

The MBE/WBE Directory for goods and services is maintained by the Office of Equal Opportunity (OEO) and is located at the following web address:

<https://apps1.mo.gov/MWBCertifiedFirms/>

The SERVICE DISABLED VETERAN ENTERPRISE (SDVE) Directories may be accessed at the following web addresses:

<https://oeo.mo.gov/sdve-certification-program/>

<https://veterans.certify.sba.gov/#search>





# State of Missouri Construction Contract

THIS AGREEMENT is made (DATE) by and between:

## *Contractor Name and Address*

hereinafter called the "Contractor,"

and the **State of Missouri**, hereinafter called the "**Owner**", represented by the Office of Administration, Division of Facilities Management, Design and Construction, on behalf of the Department of Public Safety/Vets Commission.

WITNESSETH, that the Contractor and the Owner, for the consideration stated herein agree as follows:

## **ARTICLE 1. STATEMENT OF WORK**

The Contractor shall furnish all labor and materials and perform all work required for furnishing and installing all labor, materials, equipment and transportation and everything necessarily inferred from the general nature and tendency of the plans and specifications for the proper execution of the work for:

**Project Name:**                      **Design & Install Domestic Water Plant**  
St. James Veterans Home  
St. James, Missouri

**Project Number:**                **U2409-01**

in strict accordance with the Contract Documents as enumerated in Article 7, all of which are made a part hereof.

## **ARTICLE 2. TIME OF COMPLETION**

The contract performance time is **150 working days** from the transmittal date of this agreement. The contract completion date is **MONTH, DAY, YEAR**. This time includes ten (10) working days for the Contractor to receive, sign and return the contract form along with required bonding and insurance certificates. Failure of the Contractor to provide correct bonding and insurance within the ten (10) working days shall not be grounds for a time extension. Receipt of proper bonding and insurance is a condition precedent to the formation of the contract and if not timely received, may result in forfeiture of the Contractor's bid security. Work may not commence until the Owner issues a written Notice to Proceed and must commence within seven (7) working days thereafter.

## **ARTICLE 3. LIQUIDATED DAMAGES**

Whenever time is mentioned in this contract, time shall be and is of the essence of this contract. The Owner would suffer a loss should the Contractor fail to have the work embraced in this contract fully completed on or before the time above specified. THEREFORE, the parties hereto realize in order to adjust satisfactorily the damages on account of such failure that it might be impossible to compute accurately or estimate the amount of such loss or damages which the Owner would sustain by reason of failure to complete fully said work within the time required by this contract. The Contractor hereby covenants and agrees to pay the Owner, as and for **liquidated damages, the sum of \$700** per day for each and every day, Sunday and legal holidays excepted, during which the work remains incomplete and unfinished. Any sum which may be due the Owner for such damages shall be deducted and retained by the Owner from any balance which may be due the Contractor when said work shall have been finished and accepted. But such provisions shall not release the Bond of the Contractor from liability according to its terms. In case of failure to complete, the Owner will be under no obligation to show or prove any actual or specific loss or damage.

**ARTICLE 4. CONTRACT SUM**

The Owner shall pay the Contractor for the prompt, faithful and efficient performance of the conditions and undertakings of this contract, subject to additions, and deductions as provided herein, in current funds the sum of:

Base Bid: \$  
Alternate No. 1: \$  
Alternate No. 2: \$

**TOTAL CONTRACT AMOUNT: (\$CONTRACT AMOUNT)**

**ARTICLE 5. PREVAILING WAGE RATE**

**MISSOURI PREVAILING WAGE LAW (Sections 290.210 to 290.340, RSMo):** The Contractor shall pay not less than the specified hourly rate of wages, as set out in the wage order attached to and made part of the specifications for work under this contract, to all workers performing work under the contract, in accordance with sections 290.210 to 290.340, RSMo. The Contractor shall forfeit a penalty to the Owner of one hundred dollars per day (or portion of a day) for each worker that is paid less than the specified rates for any work done under the contract by the Contractor or by any subcontractor, in accordance with section 290.250, RSMo.

**DAVIS-BACON ACT:** If this Project is financed in whole or in part from Federal funds (as indicated in the Instructions to Bidders or other bid or contract documents for this Project), then this contract shall be subject to all applicable federal labor statutes, rules and regulations, including provisions of the Davis-Bacon Act, 40 U.S.C. §3141 et seq., and the “Federal Labor Standards Provisions,” as further set forth in Section 007333 – Supplementary General Conditions for Federally Funded/Assisted Construction Projects, which is incorporated into the contract by reference. Where the Missouri Prevailing Wage Law and the Davis-Bacon Act require payment of different wages for work performed under this contract, the Contractor and all Subcontractors shall pay the greater of the wages required under either law, on a classification by classification basis.

**ARTICLE 6. MINORITY/WOMEN/SERVICE DISABLED VETERAN BUSINESS ENTERPRISE PARTICIPATION**

The Contractor has been granted a waiver of the 10% MBE and 10% WBE and 3% SDVE participation goals. The Contractor agrees to secure the MBE/WBE/SDVE participation amounts for this project as follows: (OR)

The Contractor has met the MBE/WBE/SDVE participation goals and agrees to secure the MBE/WBE/SDVE participation amounts for this project as follows:

MBE/WBE/SDVE Firm: Subcontract Amt:\$  
MBE/WBE/SDVE Firm: Subcontract Amt:\$  
MBE/WBE/SDVE Firm: Subcontract Amt:\$

Total \$

MBE/WBE/SDVE assignments identified above shall not be changed without a contract change signed by the Owner.

The Director of the Division of Facilities Management, Design and Construction or his Designee shall be the final authority to resolve disputes and disagreements between the Contractor and the MBE/WBE/SDVE firms listed above when such disputes impact the subcontract amounts shown above.

**ARTICLE 7. CONTRACT DOCUMENTS**

The following documents are hereby incorporated into this contract by reference (all division/section numbers and titles are as utilized in the Project Manual published by the Owner for this Project):

- 1. Division 0 – Procurement and Contracting Information, including, but not limited to:
  - a. Invitation for Bid (Section 001116)
  - b. Instructions to Bidders (Section 002113)
  - c. Supplementary Instructions to Bidders (if applicable) (Section 002213)
  - d. The following documents as completed and executed by the Contractor and accepted by the Owner, if applicable:

- i. Bid Form (Section 004113)
- ii. Proposed Contractors Form (Section 004336)
- iii. MBE, WBE, SDVE Compliance Evaluation Form(s) (Section 004337)
- iv. MBE, WBE, SDVE Eligibility Determination Form for Joint Ventures (Section 004338)
  - v. MBE, WBE, SDVE Good Faith Effort (GFE) Determination Form (Section 004339)
  - vi. Missouri Service Disabled Veteran Business Form (Section 004340)
  - vii. Affidavit of Work Authorization (Section 004541)
  - viii. Affidavit for Affirmative Action (Section 005414)
- e. Performance and Payment Bond, completed and executed by the Contractor and surety (Section 006113)
- f. General Conditions (Section 007213)
- g. Supplementary Conditions (Section 007300)
- h. Supplementary General Conditions for Federally Funded/Assisted Construction Projects (Section 007333)
  - i. Wage Rate(s) (Section 007346)
- 2. Division 1 – General Requirements
- 3. All Drawings identified in the Project Manual
- 4. All Technical Specifications included in the Project Manual
- 5. Addenda, if applicable

**ARTICLE 8 – CERTIFICATION**

By signing this contract, the Contractor hereby re-certifies compliance with all legal requirements set forth in Section 6.0, Bidder’s Certifications of the Bid Form.

Further, if the Contractor provides any “personal information” as defined in §105.1500, RSMo concerning an entity exempt from federal income tax under Section 501(c) of the Internal Revenue Code of 1986, as amended, the Contractor understands and agrees that it is voluntarily choosing to enter into a state contract and providing such information for that purpose. The state will treat such personal information in accord with §105.1500, RSMo.

By signature below, the parties hereby execute this contract document.

**APPROVED:**

\_\_\_\_\_  
 Brian Yansen, Director  
 Division of Facilities Management,  
 Design and Construction

\_\_\_\_\_  
 Contractor’s Authorized Signature

I, Corporate Secretary, certify that I am Secretary of the corporation named above and that (CONTRACTOR NAME), who signed said contract on behalf of the corporation, was then (TITLE) of said corporation and that said contract was duly signed for and in behalf of the corporation by authority of its governing body, and is within the scope of its corporate powers.

\_\_\_\_\_  
*Corporate Secretary*



STATE OF MISSOURI  
 OFFICE OF ADMINISTRATION  
 DIVISION OF FACILITIES MANAGEMENT, DESIGN AND CONSTRUCTION  
**AFFIDAVIT FOR AFFIRMATIVE ACTION**

PROJECT NUMBER
----------------

NAME
------

First being duly sworn on oath states: that

he/she is the  sole proprietor  partner  officer or  manager or managing member of

NAME
------

a  sole proprietorship  partnership  
 limited liability company (LLC)

or  corporation, and as such, said proprietor, partner, or officer is duly authorized to make this

affidavit on behalf of said sole proprietorship, partnership, or corporation; that under the contract known as

PROJECT TITLE
---------------

Less than 50 persons in the aggregate will be employed and therefore, the applicable Affirmative Action requirements as set forth in Article 1.4 of the General Conditions of the State of Missouri have been met.

PRINT NAME & SIGNATURE
------------------------

DATE
------

--

**NOTARY INFORMATION**

NOTARY PUBLIC EMBOSSER SEAL
-----------------------------

STATE OF
----------

COUNTY (OR CITY OF ST. LOUIS)
-------------------------------

USE RUBBER STAMP IN CLEAR AREA BELOW
--------------------------------------

SUBSCRIBED AND SWORN BEFORE ME, THIS
--------------------------------------

DAY OF
--------

YEAR
------

NOTARY PUBLIC SIGNATURE
-------------------------

MY COMMISSION EXPIRES
-----------------------

NOTARY PUBLIC NAME (TYPED OR PRINTED)
---------------------------------------

**SECTION 006113 - PERFORMANCE AND PAYMENT BOND FORM**

KNOW ALL MEN BY THESE PRESENTS, THAT we \_\_\_\_\_

as principal, and \_\_\_\_\_

\_\_\_\_\_ as Surety, are held and firmly bound unto the

STATE OF MISSOURI. in the sum of \_\_\_\_\_ Dollars (\$ \_\_\_\_\_ )

for payment whereof the Principal and Surety bind themselves, their heirs, executors, administrators and successors, jointly and severally, firmly by these presents.

WHEREAS, the Principal has, by means of a written agreement dated the \_\_\_\_\_

day of \_\_\_\_\_, 20\_\_\_\_\_, enter into a contract with the State of Missouri for

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

(Insert Project Title and Number)

NOW, THEREFORE, if the Principal shall faithfully perform and fulfill all the undertakings, covenants, terms, conditions and agreements of said contract during the original term of said contract and any extensions thereof that may be granted by the State of Missouri, with or without notice to the Surety and during the life of any guaranty required under the contract; and shall also faithfully perform and fulfill all undertakings, covenants, terms, conditions and agreements of any and all duly authorized modifications of said contract that may hereafter be made with or without notice to the Surety; and shall also promptly make payment for materials incorporated, consumed or used in connection with the work set forth in the contract referred to above, and all insurance premiums, both compensation and all other kinds of insurance, on said work, and for all labor performed on such work, whether by subcontractor or otherwise, at not less than the prevailing hourly rate of wages for work of a similar character (exclusive of maintenance work) in the locality in which the work is performed and not less than the prevailing hourly rate of wages for legal holiday and overtime work (exclusive of maintenance work) in the locality in which the work is performed both as determined by the Department of Labor and Industrial Relations or determined by the Court of Appeal, as provided for in said contract and in any and all duly authorized modifications of said contract that may be hereafter made, with or without notice to the Surety, then, this obligation shall be void and of no effect, but it is expressly understood that if the Principal should make default in or should fail to strictly, faithfully and efficiently do, perform and comply with any or more of the covenants, agreements, stipulations, conditions, requirements or undertakings, as specified in or by the terms of said contract, and with the time therein named, then this obligation shall be valid and binding upon each of the parties hereto and this bond shall remain in full force and effect; and the same may be sued on at the instance of any material man, laborer, mechanic, subcontractor, individual, or otherwise to whom such payment is due, in the name of the State of Missouri, to the use of any such person.

AND, IT IS FURTHER specifically provided that any modifications which may hereinafter be made in the terms of the contract or in the work to be done under it or the giving by the Owner of any extension of the time for the performance of the contract or any other forbearance on the part of either the Owner or the Principal to the other, shall not in any way release the Principal and the Surety, or either or any of them, their heirs, executors, administrators and successors, from their liability hereunder, notice to the Surety of any such extension, modifications or forbearance being hereby waived.

IN WITNESS WHEREOF, the above bounden parties have executed the within instrument this \_\_\_\_\_ day of \_\_\_\_\_, 20 \_\_\_\_.

**AS APPLICABLE:**

**AN INDIVIDUAL**

Name: \_\_\_\_\_

Signature: \_\_\_\_\_

**A PARTNERSHIP**

Name of Partner: \_\_\_\_\_

Signature of Partner: \_\_\_\_\_

Name of Partner: \_\_\_\_\_

Signature of Partner: \_\_\_\_\_

**CORPORATION**

Firm Name: \_\_\_\_\_

Signature of President: \_\_\_\_\_

**SURETY**

Surety Name: \_\_\_\_\_

Attorney-in-Fact: \_\_\_\_\_

Address of Attorney-in-Fact: \_\_\_\_\_

Telephone Number of Attorney-in-Fact: \_\_\_\_\_

Signature Attorney-in-Fact: \_\_\_\_\_

**NOTE:** Surety shall attach Power of Attorney



STATE OF MISSOURI  
 OFFICE OF ADMINISTRATION  
 DIVISION OF FACILITIES MANAGEMENT, DESIGN AND CONSTRUCTION  
**PRODUCT SUBSTITUTION REQUEST**

PROJECT NUMBER

PROJECT TITLE AND LOCATION

CHECK APPROPRIATE BOX

- SUBSTITUTION PRIOR TO BID OPENING**  
 (Minimum of (5) working days prior to receipt of Bids as per Article 4 – Instructions to Bidders)
- SUBSTITUTION FOLLOWING AWARD**  
 (Maximum of (20) working days from Notice to Proceed as per Article 3 – General Conditions)

FROM: BIDDER/CONTRACTOR (PRINT COMPANY NAME)

TO: ARCHITECT/ENGINEER (PRINT COMPANY NAME)

Bidder/Contractor hereby requests acceptance of the following product or systems as a substitution in accordance with provisions of Division One of the Bidding Documents:

SPECIFIED PRODUCT OR SYSTEM

SPECIFICATION SECTION NO.

SUPPORTING DATA

- Product data for proposed substitution is attached (include description of product, standards, performance, and test data)
- Sample  Sample will be sent, if requested

**QUALITY COMPARISON**

	SPECIFIED PRODUCT	SUBSTITUTION REQUEST
NAME, BRAND		
CATALOG NO.		
MANUFACTURER		
VENDOR		

**PREVIOUS INSTALLATIONS**

PROJECT	ARCHITECT/ENGINEER	DATE INSTALLED
LOCATION		

**SIGNIFICANT VARIATIONS FROM SPECIFIED PRODUCT**

---

---

---

---

---

---

---

---

---

---

**REASON FOR SUBSTITUTION**

---

---

---

---

---

---

---

**DOES PROPOSED SUBSTITUTION AFFECT OTHER PARTS OF WORK?**

YES     NO

IF YES, EXPLAIN

---

---

---

---

---

---

---

**SUBSTITUTION REQUIRES DIMENSIONAL REVISION OR REDESIGN OF STRUCTURE OR A/E WORK**

YES     NO

**BIDDER'S/CONTRACTOR'S STATEMENT OF CONFORMANCE OF PROPOSED SUBSTITUTION TO CONTRACT REQUIREMENT:**

We have investigated the proposed substitution. We believe that it is equal or superior in all respects to specified product, except as stated above; that it will provide the same Warranty as specified product; that we have included complete implications of the substitution; that we will pay redesign and other costs caused by the substitution which subsequently become apparent; and that we will pay costs to modify other parts of the Work as may be needed, to make all parts of the Work complete and functioning as a result of the substitution.

BIDDER/CONTRACTOR

DATE

**REVIEW AND ACTION**

Resubmit Substitution Request with the following additional information:

---

Substitution is accepted.

Substitution is accepted with the following comments:

---

Substitution is not accepted.

ARCHITECT/ENGINEER

DATE





PROJECT NUMBER
----------------

KNOW ALL MEN BY THESE PRESENT THAT:                    hereinafter called "Subcontractor" who heretofore entered into an agreement with                    hereinafter called "Contractor", for the performance of work and/or furnishing of material for the construction of the project entitled

(PROJECT TITLE, PROJECT LOCATION, AND PROJECT NUMBER)

at

(ADDRESS OF PROJECT)

for the State of Missouri (Owner) which said subcontract is by this reference incorporated herein, in consideration of such final payment by Contractor.

DOES HEREBY:

1. ACKNOWLEDGE that they have been **PAID IN FULL** all sums due for work and materials contracted or done by their Subcontractors, Material Vendors, Equipment and Fixture Suppliers, Agents and Employees, or otherwise in the performance of the Work called for by the aforesaid Contract and all modifications or extras or additions thereto, for the construction of said project or otherwise.
2. RELEASE and fully, finally, and forever discharge the Owner from any and all suits, actions, claims, and demands for payment for work performed or materials supplied by Subcontractor in accordance with the requirements of the above referenced Contract.
1. REPRESENT that all of their Employees, Subcontractors, Material Vendors, Equipment and Fixture Suppliers, and everyone else has been **paid in full** all sums due them, or any of them, in connection with performance of said Work, or anything done or omitted by them, or any of them in connection with the construction of said improvements, or otherwise.

DATED this                    day of                    , 20                    .

NAME OF SUBCONTRACTOR

BY (TYPED OR PRINTED NAME)

SIGNATURE

TITLE

ORIGINAL: FILE/Closeout Documents



STATE OF MISSOURI  
 OFFICE OF ADMINISTRATION  
 DIVISION OF FACILITIES MANAGEMENT,  
 DESIGN AND CONSTRUCTION

**MBE/WBE/SDVE PROGRESS REPORT**

Remit with **ALL** Progress and Final Payments

(Please check appropriate box) CONSULTANT CONSTRUCTION

PAY APP NO.	PROJECT NUMBER
CHECK IF FINAL <input checked="" type="checkbox"/> <b>FINAL</b>	DATE

PROJECT TITLE
---------------

PROJECT LOCATION
------------------

FIRM
------

ORIGINAL CONTRACT SUM (Same as Line Item 1. on Form A of Application for Payment) \$	TOTAL CONTRACT SUM TO DATE (Same as Line Item 3. on Form A of Application for Payment) \$
---	--

THE TOTAL MBE/WBE/SDVE PARTICIPATION DOLLAR AMOUNT OF THIS PROJECT AS INDICATED IN THE ORIGINAL CONTRACT: \$
--

SELECT MBE, WBE, SDVE	TOTAL AMOUNT OF SUBCONTRACT	\$ AMOUNT PAID-TO-DATE	CONSULTANT/SUBCONSULTANT OR CONTRACTOR/SUBCONTRACTOR/SUPPLIER COMPANY NAME
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	
<input type="checkbox"/> MBE <input type="checkbox"/> WBE <input type="checkbox"/> SDVE	\$	\$	

Revised 05/21



STATE OF MISSOURI  
 OFFICE OF ADMINISTRATION  
 DIVISION OF FACILITIES MANAGEMENT, DESIGN AND CONSTRUCTION  
**AFFIDAVIT – COMPLIANCE WITH PREVAILING WAGE LAW**

PROJECT NUMBER
----------------

Before me, the undersigned Notary Public, in and for the County of \_\_\_\_\_

State of \_\_\_\_\_ personally came and appeared \_\_\_\_\_

(NAME)

\_\_\_\_\_ of the \_\_\_\_\_

(POSITION) (NAME OF THE COMPANY)

(a corporation) (a partnership) (a proprietorship) and after being duly sworn did depose and say that all provisions and requirements set out in Chapter 290, Sections 290.210 through and including 290.340, Missouri Revised Statutes, pertaining to the payment of wages to workmen employed on public works project have been fully satisfied and there has been no exception to the full and completed compliance with said provisions and requirements and with Wage Determination No: \_\_\_\_\_ issued by the Department of Labor and Industrial Relations, State of Missouri on the \_\_\_\_\_ day of \_\_\_\_\_ 20 \_\_\_\_\_ in carrying out the contract and working in connection with \_\_\_\_\_

(NAME OF PROJECT)

Located at \_\_\_\_\_ in \_\_\_\_\_ County

(NAME OF THE INSTITUTION)

Missouri, and completed on the \_\_\_\_\_ day of \_\_\_\_\_ 20 \_\_\_\_\_

SIGNATURE

**NOTARY INFORMATION**

NOTARY PUBLIC EMBOSSER OR BLACK INK RUBBER STAMP SEAL	STATE	COUNTY (OR CITY OF ST. LOUIS)
	SUBSCRIBED AND SWORN BEFORE ME, THIS	
	DAY OF	YEAR
	NOTARY PUBLIC SIGNATURE	MY COMMISSION EXPIRES
NOTARY PUBLIC NAME (TYPED OR PRINTED)		<b>USE RUBBER STAMP IN CLEAR AREA BELOW</b>

FILE: Closeout Documents

# GENERAL CONDITIONS

## INDEX

ARTICLE:

**1. General Provisions**

- 1.1. Definitions
- 1.2. Drawings and Specifications
- 1.3. Compliance with Laws, Permits, Regulations and Inspections
- 1.4. Nondiscrimination in Employment
- 1.5. Anti-Kickback
- 1.6. Patents and Royalties
- 1.7. Preference for American and Missouri Products and Services
- 1.8. Communications
- 1.9. Separate Contracts and Cooperation
- 1.10. Assignment of Contract
- 1.11. Indemnification
- 1.12. Disputes and Disagreements

**2. Owner/Designer Responsibilities**

**3. Contractor Responsibilities**

- 3.1. Acceptable Substitutions
- 3.2. Submittals
- 3.3. As-Built Drawings
- 3.4. Guaranty and Warranties
- 3.5. Operation and Maintenance Manuals
- 3.6. Other Contractor Responsibilities
- 3.7. Subcontracts

**4. Changes in the Work**

- 4.1. Changes in the Work
- 4.2. Changes in Completion Time

**5. Construction and Completion**

- 5.1. Construction Commencement
- 5.2. Project Construction
- 5.3. Project Completion
- 5.4. Payments

**6. Bond and Insurance**

- 6.1. Bond
- 6.2. Insurance

**7. Termination or Suspension of Contract**

- 7.1. For Site Conditions
- 7.2. For Cause
- 7.3. For Convenience

## SECTION 007213 - GENERAL CONDITIONS

- A. These General Conditions apply to each section of these specifications. The Contractor is subject to the provisions contained herein.
- B. The General Conditions are intended to define the relationship of the Owner, the Designer and the Contractor thereby establishing certain rules and provisions governing the operation and performance of the work so that the work may be performed in a safe, orderly, expeditious and workmanlike manner.

## ARTICLE 1 – GENERAL PROVISIONS

### ARTICLE 1.1 - DEFINITIONS

As used in these contract documents, the following terms shall have the meanings and refer to the parties designated in these definitions.

1. **"COMMISSIONER"**: The Commissioner of the Office of Administration.
2. **"CONSTRUCTION DOCUMENTS"**: The "Construction Documents" shall consist of the Project Manual, Drawings and Addenda.
3. **"CONSTRUCTION REPRESENTATIVE"**: Whenever the term "Construction Representative" is used, it shall mean the Owner's Representative at the work site.
4. **"CONTRACTOR"**: Party or parties who have entered into a contract with the Owner to furnish work under these specifications and drawings.
5. **"DESIGNER"**: When the term "Designer" is used herein, it shall refer to the Architect, Engineer, or Consultant of Record specified and defined in Paragraph 2.0 of the Supplemental Conditions, or his duly authorized representative. The Designer may be either a consultant or state employee.
6. **"DIRECTOR"**: Whenever the term "Director" is used, it shall mean the Director of the Division of Facilities Management, Design and Construction or his Designee, representing the Office of Administration, State of Missouri. The Director is the agent of the Owner.
7. **"DIVISION"**: Shall mean the Division of Facilities Management, Design and Construction, State of Missouri.

8. **"INCIDENTAL JOB BURDENS"**: Shall mean those expenses relating to the cost of work, incurred either in the home office or on the job-site, which are necessary in the course of doing business but are incidental to the job. Such costs include office supplies and equipment, postage, courier services, telephone expenses including long distance, water and ice and other similar expenses.
9. **"JOINT VENTURE"**: An association of two (2) or more businesses to carry out a single business enterprise for profit for which purpose they combine their property, capital, efforts, skills and knowledge.
10. **"OWNER"**: Whenever the term "Owner" is used, it shall mean the State of Missouri, acting by and through the Office of Administration, Division of Facilities Management, Design and Construction.
11. **"PROJECT"**: Wherever the term "Project" is used, it shall mean the work required to be completed by the construction contract.
12. **"PROJECT MANUAL"**: The "Project Manual" shall consist of Introductory Information, Invitation for Bid, Instructions to Bidders, Bid Documents, Additional Information, Standard Forms, General Conditions, Supplemental General Conditions, General Requirements and Technical Specifications.
13. **"SUBCONTRACTOR"**: Party or parties who contract under, or for the performance of part or this entire Contract between the Owner and Contractor. The subcontract may or may not be direct with the Contractor.
14. **"WORK"**: All supervision, labor, materials, tool, supplies, equipment, and any incidental operations and/or activities required by or reasonably inferable from the Contract Documents necessary to construct the Project and to produce the results intended by the Contract Documents in a safe, expeditious, orderly, and workmanlike manner, and in the best manner known to each respective trade.
15. **"WORKING DAYS"**: are all calendar days except Saturdays, Sundays and the following holidays: New Year's Day, Martin Luther King, Jr. Day, Lincoln Day, Washington's Birthday (observed), Truman Day, Memorial Day, Juneteenth, Independence Day, Labor Day, Columbus Day, Veterans Day (observed), Thanksgiving Day, Christmas Day.

## ARTICLE 1.2 DRAWINGS AND SPECIFICATIONS

- A. In case of discrepancy between drawings and specifications, specifications shall govern. Should discrepancies in architectural drawings, structural drawings and mechanical drawings occur, architectural drawings shall govern and, in case of conflict between structural and mechanical drawings, structural drawings shall govern.
- B. Specifications are separated into titled divisions for convenience of reference only and to facilitate letting of contracts and subcontracts. The Contractor is responsible for establishing the scope of work for subcontractors, which may cross titled divisions. Neither the Owner nor Designer will establish limits and jurisdiction of subcontracts.
- C. Figured dimensions take precedence over scaled measurements and details over smaller scale general drawings. In the event of conflict between any of the documents contained within the contract, the documents shall take precedence and be controlling in the following sequence: addenda, supplementary general conditions, general conditions, division 1 specifications, technical division specifications, drawings, bid form and instructions to bidders.
- D. Anything shown on drawings and not mentioned in these specifications or vice versa, as well as any incidental work which is obviously necessary to complete the project within the limits established by the drawings and specifications, although not shown on or described therein, shall be performed by the Contractor at no additional cost as a part of his contract.
- E. Upon encountering conditions differing materially from those indicated in the contract documents, the Contractor shall promptly notify the Designer and Construction Representative in writing before such conditions are disturbed. The Designer shall promptly investigate said conditions and report to the Owner, with a recommended course of action. If conditions do materially differ and cause an increase or decrease in contract cost or time required for completion of any portion of the work, a contract change will be initiated as outlined in Article 4 of these General Conditions.
- E. Only work included in the contract documents is authorized, and the Contractor shall do no work other than that described therein or in accordance with appropriately authorized and approved contract changes.

## ARTICLE 1.3 - COMPLIANCE WITH LAWS, PERMITS, REGULATIONS AND INSPECTIONS

- A. Since the Owner is the State of Missouri, municipal or political subdivisions, zoning ordinances, construction codes (other than licensing of trades), and other like ordinances are not applicable to construction on Owner's property, and Contractor will not be required to submit drawings and specifications to any municipal or political subdivision, authority, obtain construction permits or any other licenses (other than licensing of trades) or permits from or submit to inspections by any municipality or political subdivision relating to the construction for this project. All permits or licenses required by municipality or political subdivision for operation on property not belonging to Owner shall be obtained by and paid for by Contractor. Each Contractor shall comply with all applicable laws, ordinances, rules and regulations that pertain to the work of this contract.
- B. Contractors, subcontractors and their employees engaged in the businesses of electrical, mechanical, plumbing, carpentry, sprinkler system work, and other construction related trades shall be licensed to perform such work by the municipal or political subdivision where the project is located, if such licensure is required by local code. Local codes shall dictate the level (master, journeyman, and apprentice) and the number, type and ratio of licensed tradesmen required for this project within the jurisdiction of such municipal or political subdivision.
- C. Equipment and controls manufacturers and their authorized service and installation technicians that do not maintain an office within the jurisdiction of the municipal or political subdivision but are a listed or specified contractor or subcontractor on this project are exempt from Paragraph 1.3 B above.
- D. The Contractor shall post a copy of the wage determination issued for the project and included as a part of the contract documents, in a prominent and easily accessible location at the site of construction for the duration of the project.
- E. Any contractor or subcontractor to such contractor at any tier signing a contract to work on this project shall provide a ten-hour Occupational Safety and Health Administration (OSHA) construction safety program for their on-site employees which includes a course in construction safety and health approved by OSHA or a similar program approved by the Department of Labor and Industrial Relations which is at least as stringent as an approved OSHA program. The contractor shall

forfeit as a penalty to the public body on whose behalf the contract is made or awarded, two thousand five hundred dollars plus one hundred dollars for each employee employed by the contractor or subcontractor, for each calendar day, or portion thereof, such employee is employed without the required training.

#### **ARTICLE 1.4 - NONDISCRIMINATION IN EMPLOYMENT**

A. The Contractor and his subcontractors will not discriminate against individuals based on race, color, religion, national origin, sex, disability, or age, but may use restrictions which relate to bona fide occupational qualifications. Specifically, the Contractor and his subcontractors shall not discriminate:

1. Against recipients of service on the basis of race, color, religion, national origin, sex, disability or age.
2. Against any employee or applicant, for employment on the basis of race, color, religion, national origin, sex or otherwise qualified disability status.
3. Against any applicant for employment or employee on the basis of age, where such applicant or employee is between ages 40 and 70 and where such Contractor employs at least 20 persons.
4. Against any applicant for employment or employee on the basis of that person's status as a disabled or Vietnam-era veteran.

The Contractor and his Subcontractors will take affirmative action to insure applicants for employment and employees are treated equally without regard to race, color, religion, national origin, sex, disability, or age. Such action shall include, but not be limited to, the following: employment, upgrading, demotion and transfer; recruitment or recruitment advertising; and selection for training, including apprenticeship. The Contractor and his Subcontractors will give written notice of their commitments under this clause to any labor union with which they have bargaining or other agreements.

B. The Contractor and his subcontractors shall develop, implement, maintain and submit in writing to the Owner an affirmative action program if at least fifty (50) persons in the aggregate are employed under this contract. If less than fifty (50) persons in the aggregate are to be employed under this contract, the Contractor shall submit, in lieu of the written affirmative action program, a properly executed Affidavit for Affirmative Action

in the form included in the contract specifications. For the purpose of this section, an "affirmative action program" means positive action to influence all employment practices (including, but not limited to, recruiting, hiring, promoting and training) in providing equal employment opportunity regardless of race, color, sex, national origin, religion, age (where the person affected is between age 40 and 70), disabled and Vietnam-era veteran status, and disability. Such "affirmative action program" shall include:

1. A written policy statement committing the total organization to affirmative action and assigning management responsibilities and procedures for evaluation and dissemination;
2. The identification of a person designated to handle affirmative action;
3. The establishment of non-discriminatory selection standards, objective measures to analyze recruitment, an upward mobility system, a wage and salary structure, and standards applicable to lay-off, recall, discharge, demotion and discipline;
4. The exclusion of discrimination from all collective bargaining agreements; and
5. Performance of an internal audit of the reporting system to monitor execution and to provide for future planning.

In the enforcement of this non-discrimination clause, the Owner may use any reasonable procedures available, including, but not limited to: requests, reports, site visits and inspection of relevant documents of contractors and subcontractors.

C. In the event of the Contractor's or his subcontractor's noncompliance with any provisions of this Article of the Contract, the Owner may cancel this contract in whole or in part or require the Contractor to terminate his contract with the subcontractor.

#### **ARTICLE 1.5 - ANTI-KICKBACK**

No employee of the division, shall have or acquire any pecuniary interest, whether direct or indirect, in this contract or in any part hereof. No officer, employee, designer, attorney, or administrator of or for the Owner who is authorized in such capacity and on behalf of the Owner to exercise any legislative, executive, supervisory or other similar functions in connection with the construction of the project, shall have or acquire any pecuniary interest, whether direct or indirect, in this contract, any material supply contract, subcontract,

insurance contract, or any other contract pertaining to the project.

#### **ARTICLE 1.6 - PATENTS AND ROYALTIES**

- A. The Contractor shall hold and save the Owner and its officers, agents, servants and employees harmless from liabilities of any nature or kind, including cost and expenses, for, or on account of, any patented or unpatented invention, process, article or appliance manufactured or used in the performance of this contract, including its use by the Owner, unless otherwise specifically stipulated in the contract documents.
- B. If the Contractor uses any design, device or materials covered by letters, patent or copyright, the Contractor shall provide for such use by suitable agreement with the Owner of such patented or copyrighted design, device or material. It is mutually agreed and understood, without exception, that the contract prices shall include all royalties or costs arising from the use of such design, device or materials, in any way involved in the work. The Contractor and/or his sureties shall indemnify and save harmless the Owner of the project from any and all claims for infringement by reason of the use of such patented or copyrighted design, device or materials or any trademark or copyright in connection with work agreed to be performed under this contract and shall indemnify the Owner for any cost, expense or damage it may be obliged to pay by reason of such infringement at any time during the prosecution of the work or after completion of the work.

#### **ARTICLE 1.7 - PREFERENCE FOR AMERICAN AND MISSOURI PRODUCTS AND SERVICES**

- A. By virtue of statutory authority a preference will be given to Missouri labor and to products of mines, forests and quarries of the state of Missouri when they are found in marketable quantities in the state, and all such materials shall be of the best quality and suitable character that can be obtained at reasonable market prices, all as provided for in Section 8.280, Missouri Revised Statutes and Cumulative Supplements.
- B. Furthermore, pursuant to Section 34.076 Missouri Revised Statutes and Cumulative Supplements, a preference shall be given to those persons doing business as Missouri firms, corporations, or individuals, or which maintain Missouri offices or places of business, when the quality of performance promised is equal or better and the price quoted is the same or less. In addition, in order for a non-domiciliary bidder to be successful, his bid must be that same percentage lower than a domiciliary Missouri bidder's bid, as would be

required for a Missouri bidder to successfully bid in the non-domiciliary state.

- C. In accordance with the Missouri Domestic Products Procurement Act Section 34.350 RSMo and Cumulative Supplements any manufactured goods or commodities used or supplied in the performance of this contract or any subcontract thereto shall be manufactured, assembled or produced in the United States, unless the specified products are not manufactured, assembled or produced in the United States in sufficient quantities to meet the agency's requirements or cannot be manufactured, assembled or produced in the United States within the necessary time in sufficient quantities to meet the contract requirements, or if obtaining the specified products manufactured, assembled or produced in the United States would increase the cost of this contract for purchase of the product by more than ten percent.

#### **ARTICLE 1.8 - COMMUNICATIONS**

- A. All notices, requests, instructions, approvals and claims must be in writing and shall be delivered to the Designer and copied to the Construction Representative for the project except as required by Article 1.12 Disputes and Disagreements, or as otherwise specified by the Owner in writing as stated in Section 012600. Any such notice shall be deemed to have been given as of the time of actual receipt.
- B. The Contractor shall attend on-site progress and coordination meetings, as scheduled by the Construction Representative, no less than once a month.
- C. The Contractor shall ensure that major subcontractors and suppliers shall attend monthly progress meetings as necessary to coordinate the work, and as specifically requested by the Construction Representative.

#### **ARTICLE 1.9 - SEPARATE CONTRACTS AND COOPERATION**

- A. The Owner reserves the right to let other contracts in connection with this work. The Contractor shall afford other contractors reasonable opportunity for the introduction and storage of their materials and the execution of their work and shall properly connect and coordinate his work with theirs.
- B. The Contractor shall consult the drawings for all other contractors in connection with this work. Any work conflicting with the above shall be brought to the attention of the Owner's Representative before the work is performed. If the Contractor fails to do this, and constructs any



work which interferes with the work of another contractor, the Contractor shall remove any part so conflicting and rebuild same, as directed by the Owner's Representative at no additional cost to the Owner.

- C. Each contractor shall be required to coordinate his work with other contractors so as to afford others reasonable opportunity for execution of their work. No contractor shall delay any other contractor by neglecting to perform contract work at the proper time. If any contractor causes delay to another, they shall be liable directly to that contractor for such delay in addition to any liquidated damages which might be due the Owner.
- D. Should the Contractor or project associated subcontractors refuse to cooperate with the instructions and reasonable requests of other Contractors or other subcontractors in the overall coordinating of the work, the Owner may take such appropriate action and issue directions, as required, to avoid unnecessary and unwarranted delays.
- E. Each Contractor shall be responsible for damage done to Owner's or other Contractor's property by him/her or workers in his employ through their fault or negligence.
- F. Should a Contractor sustain any damage through any act or omission of any other Contractor having a contract with the Owner, the Contractor so damaged shall have no claim or cause of action against the Owner for such damage, but shall have a claim or cause of action against the other Contractor to recover any and all damages sustained by reason of the acts or omissions of such Contractor. The phrase "acts or omissions" as used in this section shall be defined to include, but not be limited to, any unreasonable delay on the part of any such contractors.

#### **ARTICLE 1.10 - ASSIGNMENT OF CONTRACT**

- A. No assignment by Contractor of any amount or any part of this contract or of the funds to be received there under will be recognized unless such assignment has had the written approval of the Director and the surety has been given due notice of such assignment and has furnished written consent thereto. In addition to the usual recitals in assignment contracts, the following language must be set forth: "It is agreed that the funds to be paid to the assignee under this assignment are subject to performance by the Contractor of this contract and to claims or liens for services rendered or materials supplied for the performance of the work called for in said contract in favor of all persons, firms or corporations rendering such services or supplying such materials."

#### **ARTICLE 1.11 - INDEMNIFICATION**

- A. Contractor agrees to indemnify and save harmless Owner and its respective commissioners, officers, officials, agents, consultants and employees and Designer, their agents, servants and employees, from and against any and all liability for damage arising from injuries to persons or damage to property occasioned by any acts or omissions of Contractor, any subcontractors, agents, servants or employees, including any and all expense, legal or otherwise, which may be incurred by Owner or Designer, its agents, servants or employees, in defense of any claim, action or suit.
- B. The obligations of the Contractor under this paragraph shall not extend to the liability of the Designer, his agents or employees, arising out of (1) the preparation or approval of maps, drawings, opinions, reports, surveys, contract changes, design or specifications, or (2) giving of or the failure to give directions or instructions by the Designer, his agents or employees as required by this contract documents provided such giving or failure to give is the primary cause of the injury or damage.

#### **ARTICLE 1.12 - DISPUTES AND DISAGREEMENTS**

It is hereby expressly agreed and understood that in case any controversy or difference of opinion arises during construction, best efforts will be given to resolution at the field level. Should those efforts be unsuccessful, the Contractor has the right to appeal in writing, the decision of the Director's Designee to the Director at Room 730 Truman Building, P.O. Box 809, Jefferson City, Missouri 65102. The decision of the Director shall be final and binding on all parties.

#### **ARTICLE 2 -- OWNER/DESIGNER RESPONSIBILITIES**

- A. The Owner shall give all orders and directions contemplated under this contract relative to the execution of the work. During progress of work the Owner will be represented at the project site by the Construction Representative and/or Designer, whose responsibilities are to see that this contract is properly fulfilled.
- B. The Owner shall at all times have access to the work whenever it is in preparation or progress. The Contractors shall provide proper facilities for such access and for inspection and supervision.
- C. All materials and workmanship used in the work shall be subject to the inspection of the Designer and Construction Representative, and any work which is deemed defective shall be removed, rebuilt or made good immediately upon notice.

The cost of such correction shall be borne by the Contractor. Contractor shall not be entitled to an extension of the contract completion date in order to remedy defective work. All rejected materials shall be immediately removed from the site of the work.

- D. If the Contractor fails to proceed at once with the correction of rejected defective materials or workmanship, the Owner may, by separate contract or otherwise, have the defects remedied or rejected. Materials removed from the site and charge the cost of the same against any monies which may be due the Contractor, without prejudice to any other rights or remedies of the Owner.
- E. Failure or neglect on the part of Owner to observe faulty work, or work done which is not in accordance with the drawings and specifications shall not relieve the Contractor from responsibility for correcting such work without additional compensation.
- F. The Owner shall have the right to direct the Contractor to uncover any completed work.
  - 1. If the Contractor fails to adequately notify the Construction Representative and/or Designer of an inspection as required by the Contract Documents, the Contractor shall, upon written request, uncover the work. The Contractor shall bear all costs associated with uncovering and again covering the work exposed.
  - 2. If the Contractor is directed to uncover work, which was not otherwise required by the Contract Documents to be inspected, and the work is found to be defective in any respect, no compensation shall be allowed for this work. If, however, such work is found to meet the requirements of this contract, the actual cost of labor and material necessarily involved in the examination and replacement plus 10% shall be allowed the Contractor.
- G. The Designer shall give all orders and directions contemplated under this contract relative to the scope of the work and shall give the initial interpretation of the contract documents.
- H. The Owner may file a written notice to the Contractor to dismiss immediately any subcontractors, project managers, superintendents, foremen, workers, watchmen or other employees whom the Owner may deem incompetent, careless or a hindrance to proper or timely execution of the work. The Contractor shall comply with such notice as promptly as practicable without detriment to the work or its progress.

- I. If in the Owner's judgment it becomes necessary at any time to accelerate work, when ordered by the Owner in writing, the Contractor shall redirect resources to such work items and execute such portions of the work as may be required to complete the work within the current approved contract schedule.

### **ARTICLE 3 -- CONTRACTOR RESPONSIBILITIES**

The Contractor shall register and utilize the Owner's eBuilder digital project management system for submission of documents described in the following sections. This includes but is not limited to submittals as required by designer, payment applications, Request for Information (RFI), construction change orders, Request for Proposals (RFP), Designer Supplemental Instructions (DSI), etc.

#### **ARTICLE 3.1 -- ACCEPTABLE SUBSTITUTIONS**

- A. The Contractor may request use of any article, device, product, material, fixture, form or type of construction which in the judgment of the Owner and Designer is equal in all respects to that named. Standard products of manufacturers other than those specified will be accepted when, prior to the ordering or use thereof, it is proven to the satisfaction of the Owner and Designer that they are equal in design, strength, durability, usefulness and convenience for the purpose intended.
- B. Any changes required in the details and dimensions indicated on the drawings for the substitution of products other than those specified shall be properly made at the expense of the Contractor requesting the substitution or change.
- C. The Contractor shall submit a request for such substitutions in writing to the Owner and Designer within twenty (20) working days after the date of the "Notice to Proceed." Thereafter no consideration will be given to alternate forms of accomplishing the work. This Article does not preclude the Owner from exercising the provisions of Article 4 hereof.
- D. Any request for substitution by the Contractor shall be submitted in accordance with SECTION 002113 - INSTRUCTIONS TO BIDDERS.
- E. When a material has been approved, no change in brand or make will be permitted unless:
  - 1. Written verification is received from the manufacturer stating they cannot make delivery on the date previously agreed, or
  - 2. Material delivered fails to comply with contract requirements.

**ARTICLE 3.2 -- SUBMITTALS**

- A. The Contractor’s submittals must be submitted with such promptness as to allow for review and approval so as not to cause delay in the work. The Contractor shall coordinate preparation and processing of submittals with performance of construction activities.

Coordinate each submittal with fabrication, purchasing, testing, delivery, other submittals, and related activities that require sequential activity.

Submit four (4) copies to the Designer and additional copies as required for the subcontractors and material suppliers. Also provide copies to meet the requirements for maintenance manuals.

- B. All subcontractors' shop drawings and schedules shall be submitted by the Contractor and shall bear evidence that Contractor has received, reviewed, and approved them. Any shop drawings and schedules submitted without this evidence will be returned to the Contractor for resubmission.
- C. The Contractor shall include with the shop drawing, a letter indicating any and all deviations from the drawings and/or specifications. Failure to notify the Designer of such deviations will be grounds for subsequent rejection of the related work or materials. If, in the opinion of the Designer, the deviations are not acceptable, the Contractor will be required to furnish the item as specified and indicated on the drawings.
- D. The Designer shall check shop drawings and schedules with reasonable promptness and approve them only if they conform to the design concept of the project and comply with the information given in the contract documents. The approval shall not relieve the Contractor from the responsibility to comply with the drawings and specifications, unless the Contractor has called the Designer's attention to the deviation, in writing, at the time of submission and the Designer has knowingly approved thereof. An approval of any such modification will be given only under the following conditions:
  - 1. It is in the best interest of the Owner
  - 2. It does not increase the contract sum and/or completion time
  - 3. It does not deviate from the design intent
  - 4. It is without prejudice to any and all rights under the surety bond.
- E. No extension of time will be granted because of the Contractor's failure to submit shop drawings and schedules in ample time to allow for review,

possible resubmission, and approval. Fabrication of work shall not commence until the Contractor has received approval. The Contractor shall furnish prints of approved shop drawings and schedules to all subcontractors whose work is in any way related to the work under this contract. Only prints bearing this approval will be allowed on the site of construction

- F. The Contractor shall maintain a complete file on-site of approved shop drawings available for use by the Construction Representative.

**ARTICLE 3.3 – AS-BUILT DRAWINGS**

- A. The Contractor shall update a complete set of the construction drawings, shop drawings and schedules of all work monthly by marking changes, and at the completion of their work (prior to submission of request for final payment) note all changes and turn the set over to the Construction Representative. The updates shall show all addenda, all field changes that were made to adapt to field conditions, changes resulting from contract changes or supplemental instructions, and all locations of structures, buried installations of piping, conduit, and utility services. All buried and concealed items both inside and outside shall be accurately located as to depth and referenced to permanent features such as interior or exterior wall faces and dimensions shall be given in a neat and legible manner in a contrasting colored pencil or ink. If approved by the Designer, an electronic file format may be provided.

**ARTICLE 3.4 – GUARANTY AND WARRANTIES**

- A. General Guaranty
  - 1. Neither the final certificate of payment nor any provision in the contract documents nor partial use or occupancy of the premises by the Owner shall constitute an acceptance of work not done in accordance with contract requirements.
  - 2. The Contractor or surety shall remedy any defects in the work and pay for any damage to property resulting there from which shall appear within a period of one (1) year from the date of substantial completion unless a longer period is otherwise specified or a differing guaranty period has been established in the substantial completion certificate. The Owner will give notice of observed defects with reasonable promptness.
  - 3. In case of default on the part of the Contractor in fulfilling this part of this contract, the Owner may correct the work or repair the

damage and the cost and expense incurred in such event shall be paid by or recoverable from the Contractor or surety.

4. The work will be free from defects not inherent in the quality required or permitted, and that the Work will conform to the requirements of the Contract Documents. Work not conforming to these requirements, including substitutions not properly approved and authorized, may be considered defective. The Contractor's guaranty excludes remedy for damage or defect caused by abuse, modifications not executed by the Contractor, improper or insufficient maintenance, improper operation, or normal wear and tear under normal usage. If required by the Owner, the Contractor shall furnish satisfactory evidence as to the kind and quality of materials and equipment

**B. Extended Warranty**

Manufacturer's certificates of warranty shall be obtained for all major equipment. Warranty shall be obtained for at least one year. Where a longer period is offered at no additional cost or called for in the specific equipment specifications, the longer period shall govern.

**ARTICLE 3.5 -- OPERATION AND MAINTENANCE MANUALS**

- A.** Immediately after equipment submittals are approved and no later than ten (10) working days prior to the substantial completion inspection, the Contractor shall provide to the Designer three (3) copies of operating instructions and service manuals, containing the following:

1. Start-up and Shut-down Procedures: Provide a step-by-step write up of all major equipment. When manufacturer's printed start-up, trouble shooting and shut-down procedures are available; they may be incorporated into the operating manual for reference.
2. Operating Instructions: Written operating instructions shall be included for the efficient and safe operation of all equipment.
3. Equipment List: List of all major equipment as installed shall be prepared to include model number, capacities, flow rate, name place data, shop drawings and air and water balance reports.
4. Service Instructions: Provide the following information for all pieces of equipment.

- a. Recommended spare parts including catalog number and name of local supplier or factory representative.
- b. Belt sizes, types, and lengths.
- c. Wiring diagrams.

5. Manufacturer's Certificate of Warranty as described in Article 3.4.

6. Prior to the final payment, furnish to the Designer three (4) copies of parts catalogs for each piece of equipment furnished by him/her on the project with the components identified by number for replacement ordering.

- B.** Submission of operating instructions shall be done in the following manner.

1. Manuals shall be in quadruplicate, and all materials shall be bound into volumes of standard 8½" x 11" hard binders. Large drawings too bulky to be folded into 8½" x 11" shall be separately bound or folded and in envelopes, cross referenced and indexed with the manuals.

2. The manuals shall identify project name, project number, and include the name and address of the Contractor, subcontractors and manufacturers who were involved with the activity described in that particular manual.

3. Internally subdivide the binder contents with permanent page dividers, logically organized with tab titles clearly printed under reinforced laminated plastic tabs.

4. Contents: Prepare a Table of Contents for each volume, with each product or system description identified.

**ARTICLE 3.6 – OTHER CONTRACTOR RESPONSIBILITIES**

- A.** The Contractor shall keep on site, during progress of the work, a competent superintendent satisfactory to the Construction Representative. The superintendent shall represent the Contractor and all agreements made by the superintendent shall be binding. The superintendent shall carefully study and compare all drawings, specifications and other instructions and shall promptly notify the Construction Representative and Designer, in writing, any error, inconsistency or omission which may be discovered. The superintendent shall coordinate all work on the project. Any change of the superintendent shall be approved by the Construction Representative.
- B.** Contractor shall, at all times, enforce strict discipline and good order among his employees,

and shall not employ on the work any unfit person or anyone not skilled in the work assigned to him/her.

- C. The Contractor shall supply sufficient labor, material, plant and equipment and pay when due any laborer, subcontractor or supplier for supplies furnished and otherwise prosecute the work with diligence to prevent work stoppage and insure completion thereof within the time specified.
- D. The Contractor and each of his subcontractors shall submit to the Construction Representative, through the Designer such schedules of quantities and costs, progress schedules, payrolls, reports, estimates, records and other data as the Owner may request concerning work performed or to be performed under this contract.
- E. The Contractor, subcontractors, and material suppliers shall upon written request, give the Owner access to all time cards, material invoices, payrolls, estimates, profit and loss statements, and all other direct or indirect costs related to this work.
- F. The Contractor shall be responsible for laying out all contract work such as layout of architectural, structural, mechanical and electrical work, which shall be coordinated with layouts of subcontractors for general construction work. The Contractor is also responsible for unloading, uncrating and handling of all materials and equipment to be erected or placed by him/her, whether furnished by Contractor or others. No extra charges or compensation will be allowed as a result of failure to verify dimensions before ordering materials or fabricating items.
- G. The Contractor must notify the Construction Representative at least one working day before placing concrete or burying underground utilities, pipelines, etc.
- H. Contractors shall prearrange time with the Construction Representative for the interruption of any facility operation. Unless otherwise specified in these documents, all connections, alterations or relocations as well as all other portions of the work will be performed during normal working hours.
- I. The Contractor shall coordinate all work so there will not be prolonged interruptions of existing equipment operation. Any existing plumbing, heating, ventilating, air conditioning or electrical disconnections necessary for the project, which affect portions of this construction or building or any other building must be scheduled with the Construction Representative to minimize or avoid any disruption of facility operations. In no case,

unless previously approved in writing by the Construction Representative, shall utilities be left disconnected at the end of a work day or over a weekend. Any interruption of utilities either intentionally or accidentally shall not relieve the Contractor responsible for the interruption from the responsibility to repair and restore the utility to normal service. Repairs and restoration shall be made before the workers responsible for the repair and restoration leave the job.

- J. Contractors shall limit operations and storage of materials to the area within the project, except as necessary to connect to existing utilities, and shall not encroach on neighboring property. The Contractor shall be responsible for repair of their damage to property on or off the project site occurring during construction of project. All such repairs shall be made to the satisfaction of the property owner.
- K. Unless otherwise permitted, all materials shall be new and both workmanship and materials shall be of the best quality.
- L. Unless otherwise provided and stipulated within these specifications, the Contractor shall furnish, construct, and/or install and pay for materials, devices, mechanisms, equipment, all necessary personnel, utilities including, but not limited to water, heat, light and electric power, transportation services, applicable taxes of every nature, and all other facilities necessary for the proper execution and completion of the work.
- M. Contractor shall carefully examine the plans and drawings and shall be responsible for the proper fitting of his material, equipment and apparatus into the building.
- N. The Contractor or subcontractors shall not overload, or permit others to overload, any part of any structure during the performance of this contract.
- O. All temporary shoring, bracing, etc., required for the removal of existing work and/or for the installation of new work shall be included in this contract. The Contractor shall make good, at no cost to the Owner, any damage caused by improper support or failure of shoring in any respect. Each Contractor shall be responsible for shoring required to protect his work or adjacent property and improvements of Owner and shall be responsible for shoring or for giving written notice to adjacent property owners. Shoring shall be removed only after completion of permanent supports.

- P. The Contractor shall provide at the proper time such material as is required for support of the work. If openings are required, whether shown on drawings or not, the Contractor shall see that they are properly constructed.
- Q. During the performance of work the Contractor shall be responsible for providing and maintaining warning signs, lights, signal devices, barricades, guard rails, fences and other devices appropriately located on site which will give proper and understandable warning to all persons of danger of entry onto land, structure or equipment.
- R. The Contractor shall be responsible for protection, including weather protection, and proper maintenance of all equipment and materials.
- S. The Contractor shall be responsible for care of the finished work and shall protect same from damage or defacement until substantial completion by the Owner. If the work is damaged by any cause, the Contractor shall immediately begin to make repairs in accordance with the drawings and specifications. Contractor shall be liable for all damage or loss unless attributable to the acts or omissions of the Owner or Designer. Any claim for reimbursement shall be submitted in accordance with Article 4. After substantial completion the Contractor will only be responsible for damage resulting from acts or omissions of the Contractor or subcontractors through final warranty.
- T. In the event the Contractor encounters an unforeseen hazardous material, the Contractor shall immediately stop work in the area affected and report the condition to the Owner and Designer in writing. The Contractor shall not be required, pursuant to Article 4, to perform, any work relating to hazardous materials.
- U. In an emergency affecting safety of persons or property, the Contractor shall act, at the Contractor's discretion, to prevent threatened damage, injury or loss. Additional compensation or extension of time claimed by the Contractor on account of an emergency shall be determined as provided in Article 4.
- V. Before commencing work, Contractors shall confer with the Construction Representative and facility representative and review any facility rules and regulations which may affect the conduct of the work.
- W. Project signs will only be erected on major projects and only as described in the specifications. If no sign is specified, none shall be erected.

## **ARTICLE 3.7 -- SUBCONTRACTS**

- A. Subcontractor assignments as identified in the bid form shall not be changed without written approval of the Owner. The Owner will not approve changes of a listed subcontractor unless the Contractor documents, to the satisfaction of the Owner that the subcontractor cannot or will not perform the work as specified.
- B. The Contractor is fully responsible to the Owner for the acts and omissions of all subcontractors and of persons either directly or indirectly employed by them.
- C. Every subcontractor shall be bound by the applicable terms and provisions of these contract documents, but no contractual relationship shall exist between any subcontractor and the Owner unless the right of the Contractor to proceed with the work is suspended or this contract is terminated as herein provided, and the Owner in writing elects to assume the subcontract.
- D. The Contractor shall upon receipt of "Notice to Proceed" and prior to submission of the first payment request, notify the Designer and Construction Representative in writing of the names of any subcontractors to be used in addition to those identified in the bid form and all major material suppliers proposed for all parts of the work.

## **ARTICLE 4 -- CHANGES IN THE WORK**

### **4.1 CHANGES IN THE WORK**

- A. The Construction Representative, without giving notice to the surety and without invalidating this contract, may order extra work or make changes by altering, adding to or deducting from the work, this contract sum being adjusted accordingly. All such work shall be executed under the conditions of the original contract. A claim for extension of time caused by any change must be adjusted at the time of ordering such change. No future request for time will be considered.
- B. Each Contract Change shall include all costs required to perform the work including all labor, material, equipment, overheads and profit, delay, disruptions, or other miscellaneous expenses. No subsequent requests for additional compensation including claims for delay, disruption, or reduced efficiency as a result of each change will be considered. Values from the Schedule of Values will not be binding as a basis for additions to or deductions from the contract price.
- C. The amount of any adjustment in this contract price for authorized changes shall be agreed upon

before such changes become effective and shall be determined, through submission of a request for proposal, as follows:

1. By an acceptable fixed price proposal from the Contractor. Breakdowns shall include all takeoff sheets of each Contractor and subcontractor. Breakdown shall include a listing of each item of material with unit prices and number of hours of labor for each task. Labor costs per hour shall be included with labor burden identified, which shall be not less than the prevailing wage rate, etc. Overhead and profit shall be shown separately for each subcontractor and the Contractor.
2. By a cost-plus-fixed-fee (time and material) basis with maximum price, total cost not to exceed said maximum. Breakdown shall include a listing of each item of material with unit prices and number of hours of labor for each task. Labor costs per hour shall be included with labor burden identified, which shall be not less than the prevailing wage rate, etc. Overhead and profit shall be shown separately for each subcontractor and the Contractor.
3. By unit prices contained in Contractor's original bid form and incorporated in the construction contract.

D. Overhead and Profit on Contract Changes shall be applied as follows:

1. The overhead and profit charge by the Contractor and all subcontractors shall be considered to include, but is not limited to: incidental job burdens, small truck (under 1 ton) expense, mileage, small hand tools, warranty costs, company benefits and general office overhead. Project supervision including field supervision and job site office expense shall be considered a part of overhead and profit unless a compensable time extension is granted.
2. The percentages for overhead and profit charged on Contract Changes shall be subject to the following limits: (a) the percentage mark-up for the Contractor shall be limited to the Contractor's fee; (b) fifteen percent (15%) maximum for Work directly performed by employees of a subcontractor, or sub-subcontractor; (c) five percent (5%) maximum for the Work performed or passed through to the Owner by the Contractor; (d) five percent (5%) maximum subcontractor's mark-up for Work performed by a sub-subcontractor and

passed through to the Owner by the subcontractor and Contractor; and (e) in no case shall the total overhead and profit paid by the Owner on any Contract Changes exceed twenty-five percent (25%) of the cost of materials, labor and equipment (exclusive of Contractor or any Subcontractor overhead and profit) necessary to put the contract change work in place.

3. The Contractor will be allowed to add the cost of Contractor's payment and performance bonding, builder's risk insurance, and general liability insurance to their cost of work. The above listed bonding and insurance cost shall not exceed 2% and shall be allowed on the total cost of the added work, including overhead and profit.
  4. On proposals covering both increases and decreases in the amount of this contract, the application of overhead and profit shall be on the net change in the cost of the work.
  5. The percentage(s) for overhead and profit to be credited to the Owner on Contract Changes that are solely decreases in the quantity of work or materials shall be the same as those for additive Contract Changes provided above.
- E. No claim for an addition to this contract sum shall be valid unless authorized as aforesaid in writing by the Owner. In the event that none of the foregoing methods are agreed upon, the Owner may order the Contractor to perform work on a time and material basis. The cost of such work shall be determined by the Contractor's actual labor and material cost to perform the work plus overhead and profit as outlined herein. The Designer and Construction Representative shall approve the Contractor's daily time and material invoices for the work involved.
- F. If the Contractor claims that any instructions involve extra cost under this contract, the Contractor shall give the Owner's Representative written notice thereof within a reasonable time after the receipt of such instructions, and in any event before proceeding to execute the work. No such claim shall be valid unless so made and authorized by the Owner, in writing.
- G. In an emergency affecting the safety of life or of the structure or of adjoining property, the Contractor, without special instruction or authorization from the Construction Representative, is hereby permitted to act at their discretion to prevent such threatened loss or injury. The Contractor shall submit a claim for

compensation for such emergency work in writing to the Owner's Representative.

#### **ARTICLE 4.2 – CHANGES IN COMPLETION TIME**

- A. Extension of the number of work days stipulated in the Contract for completion of the work with compensation may be made when:
  - 1. The contractor documents that proposed Changes in the work, as provided in Article 4.1, extends construction activities critical to contract completion date, OR
  - 2. The Owner suspends all work for convenience of the Owner as provided in Article 7.3, OR
  - 3. An Owner caused delay extends construction activities critical to contract completion (except as provided elsewhere in these General Conditions). The Contractor is to review the work activities yet to begin and evaluate the possibility of rescheduling the work to minimize the overall project delay.
- B. Extension of the number of work days stipulated in the Contract for completion of the work without compensation may be made when:
  - 1. Weather-related delays occur, subject to provisions for the inclusion of a specified number of "bad weather" days when provided for in Section 012100-Allowances, OR
  - 2. Labor strikes or acts of God occur, OR
  - 3. The work of the Contractor is delayed on account of conditions which were beyond the control of the Contractor, subcontractors or suppliers, and were not the result of their fault or negligence.
- C. No time extension or compensation will be provided for delays caused by or within the control of the Contractor, subcontractors or suppliers and for concurrent delays caused by the Owner.
- D. The Contractor shall notify the Owner promptly of any occurrence or conditions which in the Contractor's opinion results in a need for an extension of time. The notice shall be in writing and shall include all necessary supporting materials with details of any resultant costs and be submitted in time to permit full investigation and evaluation of the Contractor's claim. The Owner shall promptly acknowledge the Contractor's notice and, after recommendation from the Owner's Representative and/or Designer, shall provide a decision to the Contractor. Failure on the part of the Contractor to provide such notice and to detail the costs shall constitute a waiver by

the Contractor of any claim. Requests for extensions of time shall be for working days only.

#### **ARTICLE 5 - CONSTRUCTION AND COMPLETION**

##### **ARTICLE 5.1 – CONSTRUCTION COMMENCEMENT**

- A. Upon receipt of the "Intent to Award" letter, the Contractor must submit the following properly executed instruments to the Owner:
    - 1. Contract;
    - 2. Performance/payment bond as described in Article 6.1;
    - 3. Certificates of Insurance, or the actual policies themselves, showing that the Contractor has obtained the insurance coverage required by Article 6.2.
    - 4. Written Affirmative Action Plans as required in Article 1.4.
- Above referenced items must be received by the Owner within ten (10) working days after the effective date of the contract. If not received, the Owner may treat the failure to timely submit them as a refusal by the Contractor to accept a contract for this work and may retain as liquidated damages the Contractor's bid bond, cashier's check or certified check as provided in the Instructions to Bidders. Upon receipt the Owner will issue a "Notice to Proceed" with the work to the Contractor.
- B. Within the time frame noted in Section 013200 - Schedules, following receipt of the "Notice to Proceed", the Contractor shall submit to the Owner a progress schedule and schedule of values, showing activities through the end of the contract period. Should the Contractor not receive written notification from the Owner of the disapproval of the schedule of values within fifteen (15) working days, the Contractor may consider it approved for purpose of determining when the first monthly Application and Certification for Payment may be submitted.
  - C. The Contractor may commence work upon receipt of the Division of Facilities Management, Design and Construction's "Notice to Proceed" letter. Contractor shall prosecute the work with faithfulness and energy, and shall complete the entire work on or before the completion time stated in the contract documents or pay to the Owner the damages resulting from the failure to timely complete the work as set out within Article 5.4.



## ARTICLE 5.2 -- PROJECT CONSTRUCTION

- A. Each Contractor shall submit for the Owner's approval, in reproducible form, a progress schedule showing the rate of progress and the order of the work proposed to carry on various phases of the project. The schedule shall be in conformance with the requirements outlined in Section 013200 – Schedules.
- B. Contractor shall employ and supply a sufficient force of workers, material, and equipment and shall pay when due, any worker, subcontractor or supplier and otherwise prosecute the work with such diligence so as to maintain the rate of progress indicated on the progress schedule, prevent work stoppage, and insure completion of the project within the time specified.

## ARTICLE 5.3 -- PROJECT COMPLETION

- A. Substantial Completion. A Project is substantially complete when construction is essentially complete and work items remaining to be completed can be done without interfering with the Owner's ability to use the Project for its intended purpose.
  1. Once the Contractor has reached what they believe is Substantial Completion, the Contractor shall notify the Designer and the Construction Representative of the following:
    - a. That work is essentially complete with the exception of certain listed work items. The list shall be referred to as the "Contractor's Punch."
    - b. That all Operation and Maintenance Manuals have been assembled and submitted in accordance with Article 3.5A.
    - c. That the Work is ready for inspection by the Designer and Construction Representative. The Owner shall be entitled to a minimum of ten working days notice before the inspection shall be performed.
  2. If the work is acceptable, the Owner shall issue a Certificate of Substantial Completion, which shall set forth the responsibilities of the Owner and the Contractor for utilities, security, maintenance, damage to the work and risk of loss. The Certificate shall also identify those remaining items of work to be performed by the Contractor. All such work items shall be complete within 30 working days of the date of the Certificate, unless the Certificate specifies a different time. If the

Contractor shall be required to perform tests that must be delayed due to climatic conditions, it is understood that such tests and affected equipment will be identified on the Certificate and shall be accomplished by the Contractor at the earliest possible date. Performance of the tests may not be required before Substantial Completion can be issued. The date of the issuance of the Certificate of Substantial Completion shall determine whether or not the work was completed within the contract time and whether or not Liquidated Damages are due.

3. If the work is not acceptable, and the Owner does not issue a Certificate of Substantial Completion, the Owner shall be entitled to charge the Contractor with the Designer's and Owner's costs of re-inspection, including time and travel.
- B. Partial Occupancy. Contractor agrees that the Owner shall be permitted to occupy and use any completed or partially completed portions of the Project, when such occupancy and use is in the Owner's best interest. Owner shall notify Contractor of its desire and intention to take Partial Occupancy as soon as possible but at least ten (10) working days before the Owner intends to occupy. If the Contractor believes that the portion of the work the Owner intends to occupy is not ready for occupancy, the Contractor shall notify the Owner immediately. The Designer shall inspect the work in accordance with the procedures above. If the Contractor claims increased cost of the project or delay in completion as a result of the occupancy, he shall notify the Owner immediately but in all cases before occupancy occurs.
- C. Final Completion. The Project is finally complete when the Certificate of Substantial Completion has been issued and all work items identified therein as incomplete have been completed, and when all administrative items required by the contract have been completed. Final Completion entitles the Contractor to payment of the outstanding balance of the contract amount including all change orders and retainage. Within five (5) working days of the date of the Certificate of Substantial Completion, the Contractor shall identify the cost to complete any outstanding items of work. The Designer shall review the Contractor's estimate and either approve it or provide an independent estimate for all such items. If the Contractor fails to complete the remaining items within the time specified in the Certificate, the Owner may terminate the contract and go to the surety for project completion in accordance with Article 7.2 or release the contract balance to the Contractor less 150% of the

approved estimate to complete the outstanding items. Upon completion of the outstanding items, when a final cost has been established, any monies remaining shall be paid to the Contractor. Failure to complete items of work does not relieve the Contractor from the obligation to complete the administrative requirements of the contract, such as the provisions of Article 5.3 FAILURE TO COMPLETE ALL ITEMS OF WORK UNDER THE CONTRACT SHALL BE CONSIDERED A DEFAULT AND BE GROUNDS FOR CONTRACT TERMINATION AND DEBARMENT.

- D. Liquidated Damages. Contractor agrees that the Owner may deduct from the contract price and retain as liquidated damages, and not as penalty or forfeiture, the sum stipulated in this contract for each work day after the Contract Completion Day on which work is not Substantially Complete. Assessment of Liquidated Damages shall not relieve the Contractor or the surety of any responsibility or obligation under the Contract. In addition, the Owner may, without prejudice to any other rights, claims, or remedies the Owner may have including the right to Liquidated Damages, charge the Contractor for all additional expenses incurred by the Owner and/or Designer as the result of the extended contract period through Final Completion. Additional Expenses shall include but not be limited to the costs of additional inspections.
- E. Early Completion. The Contractor has the right to finish the work before the contract completion date; however, the Owner assumes no liability for any hindrances to the Contractor unless Owner caused delays result in a time extension to the contract completion date. The Contractor shall not be entitled to any claims for lost efficiencies or for delay if a Certificate of Substantial Completion is given on or before the Contract Completion Date.

#### **ARTICLE 5.4 -- PAYMENT TO CONTRACTOR**

- A. Payments on account of this contract will be made monthly in proportion to the work which has been completed. Request for payment must be submitted on the Owner's forms. No other pay request will be processed. Supporting breakdowns must be in the same format as Owner's forms and must provide the same level of detail. The Designer will, within 5 working days from receipt of the contractor's request for payment either issue a Certificate for Payment to the Owner, for such amount as the Designer determines is properly due, or notify the Contractor in writing of reasons for withholding a Certificate. The Owner shall make payment within 30 calendar days after the

"Application and Certification for Payment" has been received and certified by the Designer. The following items are to be attached to the contractor's pay request:

1. Updated construction schedule
  2. Certified payrolls consisting of name, occupation and craft, number of hours worked and actual wages paid for each individual employee, of the Contractor and all subcontractors working on the project
- B. The Owner shall retain 5 percent of the amount of each such payment application, except as allowed by Article 5.4, until final completion and acceptance of all work covered by this contract.
- C. Each payment made to Contractor shall be on account of the total amount payable to Contractor and all material and work covered by paid partial payment shall thereupon become the sole property of Owner. This provision shall not be construed as relieving Contractor from sole responsibility for care and protection of materials and work upon which payments have been made or restoration of any damaged work or as a waiver of the right of Owner to require fulfillment of all terms of this contract.
- D. Materials delivered to the work site and not incorporated in the work will be allowed in the Application and Certification for Payment on the basis of one hundred (100%) percent of value, subject to the 5% retainage providing that they are suitably stored on the site or in an approved warehouse in accordance with the following requirements:
1. Material has previously been approved through submittal and acceptance of shop drawings conforming to requirements of Article 3.2 of General Conditions.
  2. Delivery is made in accordance with the time frame on the approved schedule.
  3. Materials, equipment, etc., are properly stored and protected from damage and deterioration and remain so - if not, previously approved amounts will be deleted from subsequent pay applications.
  4. The payment request is accompanied by a breakdown identifying the material equipment, etc. in sufficient detail to establish quantity and value.
- E. The Contractor shall be allowed to include in the Application and Certification for Payment, one hundred (100%) of the value, subject to retainage,

of major equipment and material stored off the site if all of the following conditions are met:

1. The request for consideration of payment for materials stored off site is made at least 15 working days prior to submittal of the Application for Payment including such material. Only materials inspected will be considered for inclusion on Application for Payment requests.
  2. Materials stored in one location off site are valued in excess of \$25,000.
  3. That a Certificate of Insurance is provided indicating adequate protection from loss, theft conversion or damage for materials stored off site. This Certificate shall show the State of Missouri as an additional insured for this loss.
  4. The materials are stored in a facility approved and inspected, by the Construction Representative.
  5. Contractor shall be responsible for, Owner costs to inspect out of state facilities, and any delays in the completion of the work caused by damage to the material or for any other failure of the Contractor to have access to this material for the execution of the work.
- F. The Owner shall determine the amount, quality and acceptability of the work and materials which are to be paid for under this contract. In the event any questions shall arise between the parties, relative to this contract or specifications, determination or decision of the Owner or the Construction Representative and the Designer shall be a condition precedent to the right of the Contractor to receive any money or payment for work under this contract affected in any manner or to any extent by such question.
- G. Payments Withheld: The Owner may withhold or nullify in whole or part any certificate to such extent as may be necessary to protect the Owner from loss on account of:
1. Defective work not remedied. When a notice of noncompliance is issued on an item or items, corrective action shall be undertaken immediately. Until corrective action is completed, no monies will be paid and no additional time will be allowed for the item or items. The cost of corrective action(s) shall be borne by the Contractor.
  2. A reasonable doubt that this contract can be completed for the unpaid balance.
3. Failure of the Contractor to update as-built drawings monthly for review by the Construction Representative.
  4. Failure of the Contractor to update the construction schedule.
- When the Construction Representative is satisfied the Contractor has remedied above deficiencies, payment shall be released.
- H. Final Payment: Upon receipt of written notice from the Contractor to the Designer and Project Representative that the work is ready for final inspection and acceptance, the Designer and Project Representative, with the Contractor, shall promptly make such inspection. If the work is acceptable and the contract fully performed, the Construction Representative shall complete a final acceptance report and the Contractor will be directed to submit a final Application and Certification for Payment. If the Owner approves the same, the entire balance shall be due and payable, with the exception of deductions as provided for under Article 5.4.
1. Where the specifications provide for the performance by the Contractor of (certain tests for the purpose of balancing and checking the air conditioning and heating equipment and the Contractor shall have furnished and installed all such equipment in accordance with the specifications, but said test cannot then be made because of climatic conditions, such test shall may be considered as required under the provisions of the specifications, Section 013300 and this contract may be substantial Full payment will not be made until the tests have been made and the equipment and system is finally accepted. If the tests are not completed when scheduled, the Owner may deduct 150% of the value of the tests from the final payment.
  2. The final payment shall not become due until the Contractor delivers to the Construction Representative:
    - a) A complete file of releases, on the standard form included in the contract documents as "Final Receipt of Payment and Release Form", from subcontractors and material suppliers evidencing payment in full for services, equipment and materials, as the case may require, if the Owner approves, or a consent from the Surety to final payment accepting liability for any unpaid amounts.

- b) An Affidavit of Compliance with Prevailing Wage Law, in the form as included in this contract specifications, properly executed by each subcontractor, and the Contractor
  - c) Certified copies of all payrolls
  - d) As-built drawings
3. If any claim remains unsatisfied after all payments are made, the Contractor shall refund to the Owner all monies that the latter may be compelled to pay in discharging such a claim including all costs and a reasonable attorney's fee.
  4. Missouri statute requires prompt payment from the Owner to the Contractor within thirty calendar days and from the Contractor to his subcontractors within fifteen calendar days. Failure to make payments within the required time frame entitles the receiving party to charge interest at the rate of one and one half percent per month calculated from the expiration of the statutory time period until paid.
  5. The value of all unused unit price allowances and/or 150% of the value of the outstanding work items, and/or liquidated damages may be deducted from the final pay request without executing a Contract Change. Any unit price items which exceed the number of units in the contract may be added by Contract Change.

**ARTICLE 6 -- INSURANCE AND BONDS**

**ARTICLE 6.1 -- BOND**

- A. Contractor shall furnish a performance/payment bond in an amount equal to 100% of the contract price to guarantee faithful performance of the contract and 100% of the contract price to guarantee the payment of all persons performing labor on the project and furnishing materials in connection therewith under this contract as set forth in the standard form of performance and payment bond included in the contract documents. The surety on such bond shall be issued by a surety company authorized by the Missouri Department of Insurance to do business in the state of Missouri.
- B. All Performance/Payment Bonds furnished in response to this provision shall be provided by a bonding company with a rating of B+ or higher as established by A.M. Best Company, Inc. in their most recent publication.

**ARTICLE 6.2 – INSURANCE**

- A. The successful Contractor shall procure and maintain for the duration of the contract issued a policy or policies of insurance for the protection of both the Contractor and the Owner and their respective officers, officials, agents, consultants and employees. The Owner requires certification of insurance coverage from the Contractor prior to commencing work.
- B. Minimum Scope and Extent of Coverage
  1. General Liability
 

Commercial General Liability, ISO coverage form number or equivalent CG 00 01 ("occurrence" basis), or I-SO coverage form number CG 00 02, or ISO equivalent.

If ISO equivalent or manuscript general liability coverage forms are used, minimum coverage will be as follows: Premises/Operations; Independent Contractors; Products/Completed Operations; personal Injury; Broad Form Property Damage including Completed Operations; Broad Form Contractual Liability Coverage to include Contractor's obligations under Article 1.11 Indemnification and any other Special Hazards required by the work of the contract.
  2. Automobile Liability
 

Business Automobile Liability Insurance, ISO Coverage form number or equivalent CA 00 01 covering automobile liability, code 1 "ANY AUTO".
  3. Workers' Compensation and Employer's Liability
 

Statutory Workers' Compensation Insurance for Missouri and standard Employer's Liability Insurance, or the authorization to self-insure for such liability from the Missouri Division of Workers' Compensation.
  4. Builder's Risk or Installation Floater Insurance
 

Insurance upon the work and all materials, equipment, supplies, temporary structures and similar items which may be incident to the performance of the work and located at or adjacent to the site, against loss or damage from fire and such other casualties as are included in extended coverage in broad "All Risk" form, including coverage for Flood and Earthquake, in an amount not less than the replacement cost of the work or this contract price, whichever is greater, with loss payable

to Contractor and Owner as their respective interests may appear.

Contractor shall maintain sufficient insurance to cover the full value of the work and materials as the work progresses, and shall furnish Owner copies of all endorsements. If Builder's Risk Reporting- Form of Endorsement is used, Contractor shall make all reports as required therein so as to keep in force an amount of insurance which will equal the replacement cost of the work, materials, equipment, supplies, temporary structures, and other property covered thereby; and if, as a result of Contractor's failure to make any such report, the amount of insurance so recoverable shall be less than such replacement cost, Contractor's interest in the proceeds of such insurance, if any, shall be subordinated to Owner's interest to the end that Owner may receive full reimbursement for its loss.

C. Minimum Limits of Insurance

1. General Liability

Contractor

\$2,000,000 combined single limit per occurrence for bodily injury, personal injury, and property damage

\$2,000,000 annual aggregate

2. Automobile Liability

\$2,000,000 combined single limit per occurrence for bodily injury and property damage

3. Workers' Compensation and Employers Liability

Workers' Compensation limits as required by applicable State Statutes (generally unlimited) and minimum of \$1,000,000 limit per accident for Employer's Liability.

General Liability and Automobile Liability insurance may be arranged under individual policies for the full limits required or by a combination of underlying policies with the balance provided by a form-following Excess or Umbrella Liability policy.

D. Deductibles and Self-Insured Retentions

All deductibles, co-payment clauses, and self-insured retentions must be declared to and approved by the Owner. The Owner reserves the right to request the reduction or elimination of unacceptable deductibles or self-insured retentions,

as they would apply to the Owner, and their respective officers, officials, agents, consultants and employees. Alternatively, the Owner may request Contractor to procure a bond guaranteeing payment of losses and related investigations, claims administration, and defense expenses.

E. Other Insurance Provisions and Requirements

The respective insurance policies and coverage, as specified below, must contain, or be endorsed to contain the following conditions or provisions:

1. General Liability

The Owner, and its respective commissioners, officers, officials, agents, consultants and employees shall be endorsed as additional insured's by ISO form CG 20 26 Additional Insured - Designated Person or Organization. As additional insured's, they shall be covered as to work performed by or on behalf of the Contractor or as to liability which arises out of Contractor's activities or resulting from the performance of services or the delivery of goods called for by the Contract.

Contractor's insurance coverage shall be primary with respect to all additional insured's. Insurance of self-insurance programs maintained by the designated additional -insured's shall be excess of the Contractor's insurance and shall not contribute with it.

Additionally, the Contractor and Contractor's general liability insurer shall agree to waive all rights of subrogation against the Owner and any of their respective officers, officials, agents, consultants or employees for claims, losses, or expenses which arise out of Contractor's activities or result from the performance of services or the delivery of goods called for by the Contract.

Contractor's failure to comply with the terms and conditions of these insurance policies shall not affect or abridge coverage for the Owner, or for any of their officers, officials, agents, consultants or employees.

2. Automobile Insurance

The Owner, and their respective officers, officials, agents, consultants and employees shall be endorsed as additional insured's by ISO form CG 20 26 - Additional Insured Designated Person or Organization. As additional insured's, they shall be covered as to work performed by or on behalf of the Contractor or as to liability which arises out of Contractor's activities or resulting from the

performance of services or the delivery of goods called for by the Contract.

Contractor's insurance coverage shall be primary with respect to all additional insured's. Insurance or self-insurance programs maintained by the designated additional insured's shall be in excess of the Contractor's insurance and shall not contribute with it.

Additionally, the Contractor and Contractor's automobile insurer shall agree to waive all rights of subrogation against the Owner and any of their respective officers, officials, agents, consultants or employees for claims, losses, or expenses which arise out of Contractor's activities or result from the performance of services or the delivery of goods called for by the Contract.

Contractor's failure to comply with the terms and conditions of these insurance policies shall not affect or abridge coverage for the Owner or for any of its officers, officials, agents, consultants or employees.

3. Workers' Compensation/Employer's Liability

Contractor's workers' compensation insurance shall be endorsed with NCCI form WC 00 03 01 A - Alternative Employer Endorsement. The Alternative Employer Endorsement shall designate the Owner as "alternate employers."

4. All Coverages

Each insurance policy required by this section of the Contract shall contain a stipulation, endorsed if necessary, that the Owner will receive a minimum of a thirty (30) calendar day advance notice of any policy cancellation. Ten (10) calendar days advance notice is required for policy cancellation due to non-payment of premium.

F. Insurer Qualifications and Acceptability

Insurance required hereunder shall be issued by an A.M. Best, "B+" rated, Class IX insurance company approved to conduct insurance business in the state of Missouri.

G. Verification of Insurance Coverage

Prior to Owner issuing a Notice to Proceed, the Contractor shall furnish the Owner with Certificate(s) of Insurance and with any applicable original endorsements evidencing the required insurance coverage. The insurance certificates and endorsements are to be signed by a person authorized by that insurer to bind coverage on its

behalf. All certificates and endorsements received by the Owner are subject to review and approval by the Owner. The Owner reserves the right to require certified copies of all required policies at any time. If the scope of this contract will exceed one (1) year - or, if any of Contractor's applicable insurance coverage expires prior to completion of the work or services required under this contract - the Contractor will provide a renewal or replacement certificate before continuing work or services hereunder. If the Contractor fails to provide documentation of required insurance coverage, the Owner may issue a stop work order and no additional contract completion time and/or compensation shall be granted as a result thereof.

**ARTICLE 7 – SUSPENSION OR TERMINATION OF CONTRACT**

**ARTICLE 7.1 - FOR SITE CONDITIONS**

When conditions at the site of the proposed work are considered by the Owner to be unsatisfactory for prosecution of the work, the Contractor may be ordered in writing to suspend the work or any part thereof until reasonable conditions exist. When such suspension is not due to fault or negligence of the Contractor, time allowed for completion of such suspended work will be extended by a period of time equal to that lost due to delay occasioned by ordered suspension. This will be a no cost time extension.

**ARTICLE 7.2 - FOR CAUSE**

A. Termination or Suspension for Cause:

1. If the Contractor shall file for bankruptcy, or should make a general assignment for the benefit of the creditors, or if a receiver should be appointed on account of insolvency, or if the contractor should persistently or repeatedly refuse or fail to supply enough properly skilled workers or proper materials, or if the contractor should fail to make prompt payment to subcontractors or for material or labor, or persistently disregard laws, ordinances or the instructions of the Owner, or otherwise be guilty of a substantial violation of any provision of this contract, then the Owner may serve notice on the Contractor and the surety setting forth the violations and demanding compliance with this contract. Unless within ten (10) consecutive calendar days after serving such notice, such violations shall cease and satisfactory arrangements for correction be made, the Owner may suspend the Contractor's right to proceed with the work or terminate this contract.

2. In the event the Owner suspends Contractor's right to proceed with the work or terminates the contract, the Owner may demand that the Contractor's surety take over and complete the work on this contract, after the surety submits a written proposal to the Owner and receives written approval and upon the surety's failure or refusal to do so within ten (10) consecutive calendar days after demand therefore, the Owner may take over the work and prosecute the same to completion by bid or negotiated contract, or the Owner may elect to take possession of and utilize in completing the work such materials, supplies, appliances and plant as may be on the site of the work, and all subcontractors, if the Owner elects, shall be bound to perform their contracts.
- B. The Contractor and its surety shall be and remain liable to the Owner for any excess cost or damages occasioned to the Owner as a result of the actions above set forth.
- C. The Contractor in the event of such suspension or termination shall not be entitled to receive any further payments under this contract until the work is wholly finished. Then if the unpaid balance under this contract shall exceed all expenses of the Owner as certified by the Director, such excess shall be paid to the Contractor; but, if such expenses shall exceed the unpaid balance as certified by the Director, the Contractor and their surety shall be liable for and shall pay the difference and any damages to the Owner.
- D. In exercising Owner's right to secure completion of the work under any of the provisions hereof, the Director shall have the right to exercise Owner's sole discretion as to the manner, methods and reasonableness of costs of completing the work.
- E. The rights of the Owner to suspend or terminate as herein provided shall be cumulative and not exclusive and shall be in addition to any other remedy provided by law.
- F. The Contractor in the event of such suspension or termination may be declared ineligible for Owner contracts for a minimal period of twelve (12) months. Further, no contract will be awarded to any Contractor who lists in their bid form any subcontractor whose prior performance has contributed, as determined by the Owner, to a breach of a contract. In order to be considered for state-awarded contracts after this period, the Contractor/subcontractor will be required to forward acceptance reports to the Owner regarding successful completion of non-state projects during the intervening twelve (12) months from the date

of default. No contracts will be awarded to a subcontractor/Contractor until the ability to perform responsibly in the private sector has been proven to the Owner.

#### **ARTICLE 7.3 -- FOR CONVENIENCE**

- A. The Owner may terminate or suspend the Contract or any portion of the Work without cause at any time, and at the Owner's convenience. Notification of a termination or suspension shall be in writing and shall be given to the Contractor and their surety. If the Contract is suspended, the notice will contain the anticipated duration of the suspension or the conditions under which work will be permitted to resume. If appropriate, the Contractor will be requested to demobilize and re-mobilize and will be reimbursed time and costs associated with the suspension.
- B. Upon receipt of notification, the Contractor shall:
  1. Cease operations when directed.
  2. Take actions to protect the work and any stored materials.
  3. Place no further subcontracts or orders for material, supplies, services or facilities except as may be necessary to complete the portion of the Contract that has not been terminated. No claim for payment of materials or supplies ordered after the termination date shall be considered.
  4. Terminate all existing subcontracts, rentals, material, and equipment orders.
  5. Settle all outstanding liabilities arising from termination with subcontractors and suppliers.
  6. Transfer title and deliver to the Owner, work in progress, completed work, supplies and other material produced or acquire for the work terminated, and completed or partially completed plans, drawings information and other property that, if the Contract had been completed, would be required to be furnished to the Owner.
- C. For termination without cause and at the Owner's convenience, in addition to payment for work completed prior to date of termination, the Contractor may be entitled to payment of other documented costs directly associated with the early termination of the contract. Payment for anticipated profit and unapplied overhead will not be allowed.

## SECTION 007300 - SUPPLEMENTARY CONDITIONS

### 1.0 GENERAL:

A. These Supplementary General Conditions clarify, add, delete, or otherwise modify standard terms and conditions of DIVISION 0, BIDDING AND CONTRACTING REQUIREMENTS.

### 2.0 CONTACTS:

Designer: Regina Raineri  
CASCO  
12 Sunnen Dr. Suite 100  
St. Louis, MO, 63143  
Telephone: (314) 821-1100 x 145  
Email: [Regina.Raineri@thecdcompanies.com](mailto:Regina.Raineri@thecdcompanies.com)

Construction Representative: Randy Duncan  
Division of Facilities Management, Design and Construction  
709 Missouri Blvd (Upper Level)  
Jefferson City, MO 65109  
Telephone: (573) 619-4395  
Email: [Randy.Duncan@oa.mo.gov](mailto:Randy.Duncan@oa.mo.gov)

Project Manager: Ryan Abbott  
Division of Facilities Management, Design and Construction  
301 West High Street, Room 730  
Jefferson City, Missouri 65101  
Telephone: (573) 298-1967  
Email: [Ryan.Abbott@oa.mo.gov](mailto:Ryan.Abbott@oa.mo.gov)

Contract Specialist: April Howser  
Division of Facilities Management, Design and Construction  
301 West High Street, Room 730  
Jefferson City, Missouri 65101  
Telephone: 573-751-0053  
Email: [April.Howser@oa.mo.gov](mailto:April.Howser@oa.mo.gov)

### 3.0 NOTICE: ALL BID MATERIALS ARE DUE AT THE TIME OF BID SUBMITTAL. THERE IS NO SECOND SUBMITTAL FOR THIS PROJECT.

### 4.0 FURNISHING CONSTRUCTION DOCUMENTS:

- A. The Owner will furnish the Contractor with approximately 3 complete sets of drawings and specifications at no charge.
- B. The Owner will furnish the Contractor with approximately 3 sets of explanatory or change drawings at no charge.
- C. The Contractor may make copies of the documents as needed with no additional cost to the Owner.

### 5.0 SAFETY REQUIREMENTS


Contractor and subcontractors at any tier shall comply with RSMo 292.675 and Article 1.3, E, of Section 007213, General Conditions.



# Missouri

## Division of Labor Standards

### WAGE AND HOUR SECTION

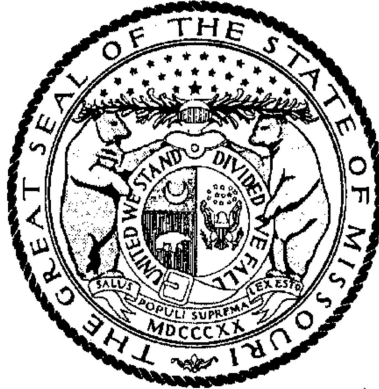

MICHAEL L. PARSON, Governor

# Annual Wage Order No. 31

Section 081  
**PHELPS COUNTY**

In accordance with Section 290.262 RSMo 2000, within thirty (30) days after a certified copy of this Annual Wage Order has been filed with the Secretary of State as indicated below, any person who may be affected by this Annual Wage Order may object by filing an objection in triplicate with the Labor and Industrial Relations Commission, P.O. Box 599, Jefferson City, MO 65102-0599. Such objections must set forth in writing the specific grounds of objection. Each objection shall certify that a copy has been furnished to the Division of Labor Standards, P.O. Box 449, Jefferson City, MO 65102-0449 pursuant to 8 CSR 20-5.010(1). A certified copy of the Annual Wage Order has been filed with the Secretary of State of Missouri.

Original Signed by \_\_\_\_\_

Todd Smith, Director  
Division of Labor Standards

Filed With Secretary of State: \_\_\_\_\_ **March 8, 2024**

Last Date Objections May Be Filed: **April 8, 2024**

Prepared by Missouri Department of Labor and Industrial Relations

OCCUPATIONAL TITLE	**Prevailing Hourly Rate
Asbestos Worker	\$61.37
Boilermaker	\$27.46*
Bricklayer-Stone Mason	\$55.63
Carpenter	\$62.01
Lather	
Linoleum Layer	
Millwright	
Pile Driver	
Cement Mason	\$57.93
Plasterer	
Communication Technician	\$27.46*
Electrician (Inside Wireman)	\$58.12
Electrician Outside Lineman	\$27.46*
Lineman Operator	
Lineman - Tree Trimmer	
Groundman	
Groundman - Tree Trimmer	
Elevator Constructor	\$27.46*
Glazier	\$25.90
Ironworker	\$27.46*
Laborer	\$46.97
General Laborer	
First Semi-Skilled	
Second Semi-Skilled	
Mason	\$27.46*
Marble Mason	
Marble Finisher	
Terrazzo Worker	
Terrazzo Finisher	
Tile Setter	
Tile Finisher	
Operating Engineer	\$70.56
Group I	
Group II	
Group III	
Group III-A	
Group IV	
Group V	
<b>Painter</b>	<b>\$48.22</b>
Plumber	\$71.18
Pipe Fitter	
Rofer	\$55.31
Sheet Metal Worker	\$70.63
Sprinkler Fitter	\$65.89
Truck Driver	\$27.46*
Truck Control Service Driver	
Group I	
Group II	
Group III	
Group IV	

\*The Division of Labor Standards received fewer than 1,000 reportable hours for this occupational title. The public works contracting minimum wage is established for this occupational title using data provided by Missouri Economic Research and Information Center.

\*\*The Prevailing Hourly Rate includes any applicable fringe benefit amounts for each occupational title as defined in RSMo Section 290.210.

Heavy Construction Rates for  
PHELPS County

Section 081

OCCUPATIONAL TITLE	**Prevailing Hourly Rate
Carpenter	\$27.46*
Millwright	
Pile Driver	
Electrician (Outside Lineman)	\$77.46
Lineman Operator	
Lineman - Tree Trimmer	
Groundman	
Groundman - Tree Trimmer	
Laborer	\$48.26
General Laborer	
Skilled Laborer	
Operating Engineer	\$63.22
Group I	
Group II	
Group III	
Group IV	
Truck Driver	\$27.46*
Truck Control Service Driver	
Group I	
Group II	
Group III	
Group IV	

Use Heavy Construction Rates on Highway and Heavy construction in accordance with the classifications of construction work established in 8 CSR 30-3.040(3).

Use Building Construction Rates on Building construction in accordance with the classifications of construction work established in 8 CSR 30-3.040(2).

If a worker is performing work on a heavy construction project within an occupational title that is not listed on the Heavy Construction Rate Sheet, use the rate for that occupational title as shown on the Building Construction Rate Sheet.

\*The Division of Labor Standards received fewer than 1,000 reportable hours for this occupational title. Public works contracting minimum wage is established for this occupational title using data provided by Missouri Economic Research and Information Center.

\*\*The Prevailing Hourly Rate includes any applicable fringe benefit amounts for each occupational title.

# OVERTIME and HOLIDAYS

## OVERTIME

For all work performed on a Sunday or a holiday, not less than twice (2x) the prevailing hourly rate of wages for work of a similar character in the locality in which the work is performed or the public works contracting minimum wage, whichever is applicable, shall be paid to all workers employed by or on behalf of any public body engaged in the construction of public works, exclusive of maintenance work.

For all overtime work performed, not less than one and one-half (1½) the prevailing hourly rate of wages for work of a similar character in the locality in which the work is performed or the public works contracting minimum wage, whichever is applicable, shall be paid to all workers employed by or on behalf of any public body engaged in the construction of public works, exclusive of maintenance work or contractual obligation. For purposes of this subdivision, "**overtime work**" shall include work that exceeds ten hours in one day and work in excess of forty hours in one calendar week; and

A thirty-minute lunch period on each calendar day shall be allowed for each worker on a public works project, provided that such time shall not be considered as time worked.

## HOLIDAYS

January first;  
The last Monday in May;  
July fourth;  
The first Monday in September;  
November eleventh;  
The fourth Thursday in November; and  
December twenty-fifth;

If any holiday falls on a Sunday, the following Monday shall be considered a holiday.

## SECTION 011000 – SUMMARY OF WORK

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and Division 1 Specification Sections apply to this Section.

#### 1.2 WORK COVERED BY CONTRACT DOCUMENTS

- A. The Project consists of mechanical room equipment replacement at the St. James Veterans Home.
1. Project Location: **St. James Veterans Home**  
**620 North Jefferson Street**  
**St. James, MO 65556**
  2. Owner: State of Missouri, Office of Administration, Division of Facilities Management, Design and Construction, Harry S Truman State Office Building, Post Office Box 809, 301 West High Street, Jefferson City, Missouri 65102.
- B. Contract Documents, dated **08.15.2025** were prepared for the Project by CASCO Diversified Corporation.

This project consists of the replacement of a portion of the hot water system. The existing system is made up of four water heaters and three storage tanks serving the laundry, kitchen, and the suites (two of the boilers and one storage tank loop). The two water heaters and storage tanks serving the laundry and kitchen have failed. The operational water heaters and tank have been repiped and are now carrying the entire load of the facility.

A new system design will replace the failed equipment with the heat source being provided by a closed loop boiler system. This system shall consist of three boilers (1250 MBH each, gas-fired), three dedicated boiler pumps, two heat exchangers (double wall, NSF approved for domestic water use), an expansion tank, pot feeder, and various valves and control components. Water treatment chemicals used for the closed loop shall be food grade compatible. Boilers shall be staged based on demand load to save energy. Boilers shall draw intake air from existing areaway, while the flue(s) shall be Type B venting through the roof utilizing the existing vent opening.

The domestic water side shall consist of (4) 300 gallon domestic hot water storage tanks, two circulating pumps that will circulate water between the storage tanks and heat exchangers, one domestic water expansion tank, and three mechanically operated domestic water mixing valves to control each systems final delivery temperature. Tank temperatures shall be maintained at 10F above final delivery temperature of the 150deg laundry service.

Replacement of the failed equipment with the new system shall be completed in phases as to maintain facility functions.

- Phase 1 Demo – Remove the two existing storage tanks and the expansion tank for laundry and kitchen, hot water recirculating pump for the laundry, the two

water heaters that are currently offline including their associated piping and flues, along with the thermostatic mixing valve serving laundry. Existing equipment to remain in operation shall be the (2) two Lochinvar Armor water heaters, the existing domestic water storage tank for the suites, plus their associated piping and flues. Existing water heaters and expansion tanks are to be returned to the owner.

- Phase 1 New Work – Installation of two new heat exchangers, three new boilers including natural gas piping to the boilers, new flue/intake ductwork for the new boilers (utilize existing roof vent), installation of (2) of the (4) new storage tanks, three new thermostatic mixing valves, and a new expansion tank. Also included in this phase are includes the installation of the two new hot water recirculating pumps that will serve the main building and laundry. One of the existing expansion tanks shall be relocated adjacent of the existing storage tank to allow existing domestic water system to remain in operation during construction.
- Phase 1 BMS – The Domestic hot water plant shall be connected to the existing building management system (BMS). Provide all necessary controllers, sensors, wiring, devices and programming. BMS shall control the boilers, secondary pumps, and heat exchanger control valves. Provide BACnet interface for boilers and thermostatic domestic water mixing valves. Monitor and trend hot water storage tank temperatures, primary and secondary hot water temperatures, three tempered hot water temperatures leaving the mixing valves.
- Phase 1 New Work Testing and Evaluation – The contractor in conjunction with St James' Facilities, will operate the Phase 1 New Work for a period of (1) one week. Through the additional valving, the testing and evaluation period will redirect the domestic water supply and return to supply the facility to allow evaluation of the operation of the equipment, adjusting as required. Phase 2 Demo will not commence until St James' Facilities approves continuing.
- Phase 2 Demo – Remove the remaining storage tank serving the building along with the existing thermostatic mixing valve, existing water heaters that are online, and all associated piping, valves, and other accessory items. Existing water heaters and expansion tanks are to be returned to the owner.
- Phase 2 New Work – Installation of remaining piping for second heat exchanger and two domestic water storage tanks.

- C. There are two Alternates included in the scope of work; the addition of electronically controlled thermostatic mixing valves and the addition of thermostatic operated balancing valves within the domestic water hot water return lines for the suites. All Alternates are defined in 012300 Alternates section.

### 1.3 WORK SEQUENCE

- A. The Work will be conducted in two main phases:
1. Phase 1 Demo, Phase 1 New Work, Phase 1 Testing and Evaluation
  2. Phase 2 Demo and Phase 2 New Work

#### **1.4 CONTRACTOR USE OF PREMISES**

- A. General: During the construction period the Contractor shall have full use of the premises for construction operations, including use of the site. The Contractor's use of the premises limited only by the Owner's right to perform work or to retain other contractors on portions of the Project.
- B. Use of the Site: Limit use of the premises to work in areas indicated. Confine operations to areas within contract limits indicated. Do not disturb portions of the site beyond the areas in which the Work is indicated.
  - 1. Owner Occupancy: Allow for Owner occupancy and use by the public.
  - 2. Driveways and Entrances: Keep driveways and entrances serving the premises clear and available to the Owner, the Owner's employees, and emergency vehicles at all times. Do not use these areas for parking or storage of materials. Schedule deliveries to minimize space and time requirements for storage of materials and equipment on-site.
- C. Use of the Existing Building: Maintain the existing building in a weathertight condition throughout the construction period. Repair damage cause by construction operations. Take all precautions necessary to protect the building and its occupants during the construction period.

#### **1.5 OCCUPANCY REQUIREMENTS**

- A. Full Owner Occupancy: The Owner will occupy the site and existing building during the entire construction period. Cooperate with the Owner during construction operations to minimize conflicts and facilitate owner usage. Perform the Work so as not to interfere with the Owner's operations.
- B. Partial Owner Occupancy: The Owner reserves the right to occupy and to place and install equipment in completed areas of the building prior to Substantial Completion, provided such occupancy does not interfere with completion of the Work. Such placing of equipment and partial occupancy shall not constitute acceptance of the total Work.
  - 1. The Designer will prepare a Certificate of Partial Occupancy for each specific portion of the Work to be occupied prior to substantial completion.
  - 2. Prior to partial Owner occupancy, mechanical and electrical systems shall be fully operational. Required inspections and tests shall have been successfully completed. Upon occupancy, the Owner will operate and maintain mechanical and electrical systems serving occupied portions for the building.
  - 3. Upon occupancy, the Owner will assume responsibility for maintenance and custodial service for occupied portions for the building.

#### **1.6 OWNER-FURNISHED PRODUCTS**

- A. The Owner will furnish latrine accessories as indicated in the drawings. The Work includes providing support systems to receive Owner's equipment, and mechanical and electrical connections.

1. The Owner will arrange for and deliver necessary shop drawings, product data, and samples to the Contractor.
2. The Owner will arrange and pay for delivery of Owner-furnished items according to the contractor's Construction Schedule.
3. The Contractor is responsible for receiving, unloading and handling Owner furnished items at the site.
4. Following delivery, the Contractor will inspect items delivered for damage. The Contractor shall not accept damaged items and shall notify the Owner of rejection of damaged items.
5. If Owner-furnished items are damaged, defective, or missing, the Owner will arrange for replacement.
6. The Owner will arrange for manufacturer's field services and for the delivery of manufacturer's warranties to the appropriate Contractor.
7. The Contractor shall designate delivery dates of Owner-furnished items in the Contractor's Construction Schedule.
8. The Contractor shall review shop drawings, product data and samples and return them to the Designer noting discrepancies or problems anticipated in use of the project.
9. The Contractor is responsible for protecting Owner-furnished items from damage, including damage from exposure to the elements. The Contractor shall repair or replace items damaged as a result of his operations.

## **1.7 MISCELLANEOUS PROVISIONS**

### **PART 2 - PRODUCTS (Not Applicable)**

### **PART 3 - EXECUTION**

#### **3.1 SCHEDULE OF PRODUCTS ORDERED IN ADVANCE**

**END OF SECTION 011000**



## **SECTION 012100 – ALLOWANCES**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes administrative and procedural requirements governing allowances.
  - 1. Certain items are specified in the Contract Documents by allowances. Allowances have been established in lieu of additional requirements and to defer selection of actual materials and equipment to a later date when additional information is available for evaluation. If necessary, additional requirements will be issued by Change Order.
- B. Types of allowances include the following:
  - 1. Lump-sum allowances.
  - 2. Weather allowances.
- C. Related Sections include the following:
  - 1. Division 1 Section "Contract Modification Procedures" for procedures for submitting and handling Change Orders for allowances.

#### **1.3 WEATHER ALLOWANCE**

- A. Included within the completion period for this project are a specified number of “bad weather” days (see Schedule of Allowances).
- B. The Contractor’s progress schedule shall clearly indicate the bad weather day allowance as an “activity” or “activities”. In the event weather conditions preclude performance of critical work activities for 50% or more of the Contractor’s scheduled workday, that day shall be declared unavailable for work due to weather (a “bad weather” day) and charged against the above allowance. Critical work activities will be determined by review of the Contractor’s current progress schedule.
- C. The Contractor’s Representative and the Construction Representative shall agree monthly on the number of “bad weather” days to be charged against the allowance. This determination will be documented in writing and be signed by the Contractor and the Construction Representatives. If there is a failure to agree on all or part of the “bad weather” days for a particular month, that disagreement shall be noted on this written document and signed by each party’s representative. Failure of the Contractor’s representative to sign the “bad weather” day documentation after it is presented, with or without the notes of disagreement, shall constitute agreement with the “bad weather” day determination contained in that document.

- D. There will be no modification to the time of contract performance due solely to the failure to deplete the “bad weather” day allowance.
- E. Once this allowance is depleted, a no cost Change Order time extension will be executed for “bad weather” days, as defined above, encountered during the remainder of the Project.

#### **1.4 SELECTION AND PURCHASE**

- A. At the earliest practical date after award of the Contract, Designer of the date when final selection and purchase of each product or system described by an allowance must be completed to avoid delaying the Work.
- B. At Designer's request, obtain proposals for each allowance for use in making final selections. Include recommendations that are relevant to performing the Work.
- C. Purchase products and systems selected by Designer from the designated supplier.

#### **1.5 SUBMITTALS**

- A. Submit proposals for purchase of products or systems included in allowances, in the form specified for Change Orders.
- B. Submit invoices or delivery slips to show actual quantities of materials delivered to the site for use in fulfillment of each allowance.
- C. Coordinate and process submittals for allowance items in same manner as for other portions of the Work.

#### **1.6 COORDINATION**

- A. Coordinate allowance items with other portions of the Work. Furnish templates as required to coordinate installation.

#### **1.7 [LUMP-SUM] ALLOWANCES**

- A. Unless otherwise indicated, Contractor's costs for receiving and handling at Project site, labor, installation, overhead and profit, and similar costs related to products and materials [selected by Designer] under allowance shall be included as part of the Contract Sum and not part of the allowance.

### **PART 2 - PRODUCTS (Not Used)**

### **PART 3 - EXECUTION**

#### **3.1 EXAMINATION**

- A. Examine products covered by an allowance promptly on delivery for damage or defects. Return damaged or defective products to manufacturer for replacement.

### **3.2 PREPARATION**

- A. Coordinate materials and their installation for each allowance with related materials and installations to ensure that each allowance item is completely integrated and interfaced with related work.

### **3.3 SCHEDULE OF ALLOWANCES**

- A. Weather Allowance: Included within the completion period for this Project 0 (zero) “bad weather” days.

**END OF SECTION 012100**

## **SECTION 012300 - ALTERNATES**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions, Bid Form and other Division 1 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes administrative and procedural requirements governing Alternates.

#### **1.3 DEFINITIONS**

- A. Definition: An alternate is an amount proposed by bidders and stated on the Bid Form for certain work defined in the Bidding Requirements that may be added to the Base Bid amount if the Owner decides to accept a corresponding change in either the amount of construction to be completed, or in the products, materials, equipment, systems, or installation methods described in the Contract Documents..

- 1. The cost for each alternate is the net addition to the Contract Sum to incorporate the Alternate into the Work. No other adjustments are made to the Contract Sum.

- B. No additional time will be allowed for alternate work unless the number of work days is so stated on the bid form.

#### **1.4 PROCEDURES**

- A. Coordination: Modify or adjust affected adjacent Work as necessary to completely and fully integrate the Alternate Work into the Project.

- 1. Include as part of each alternate, miscellaneous devices, accessory objects, and similar items incidental to or required for a complete installation whether or not mentioned as part of the Alternate.

- B. Notification: The award of the Contract will indicate whether alternates have been accepted or rejected.

- C. Execute accepted alternates under the same conditions as other Work of this Contract.

- D. Schedule: A “Schedule of Alternates” is included at the end of this Section. Specification Sections referenced in the Schedule contain requirements for materials necessary to achieve the Work described under each alternate.

**PART 2 - PRODUCTS (Not Applicable)**

**PART 3 - EXECUTION**

**A. SCHEDULE OF ALTERNATES**

- A. **Alternate No. 1:** Install electronically operated thermostatic mixing valves in lieu of mechanically operated mixing valves for the suites, kitchen and laundry areas.
- B. **Alternate No. 2:** Replace the existing balancing valves with thermostatically operated balancing valve stations, including check valves, thermometer, and stop valves.

**END OF SECTION 012300**

## **SECTION 012600 – CONTRACT MODIFICATION PROCEDURES**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section specifies administrative and procedural requirements for handling and processing Contract Modifications.
- B. Related Sections include the following:
  - 1. Division 1, Section 012100 "Allowances" for procedural requirements for handling and processing Allowances.
  - 2. Division 1, Section 013115 "Project Management Communications" for administrative requirements for communications.
  - 3. Division 0, Section 007213, Article 3.1 "Acceptable Substitutions" for administrative procedures for handling Requests for Substitutions made after Contract award.
  - 4. Division 0, Section 007213, Article 4.0 "Changes in the Work" for Change Order requirements.

#### **1.3 REQUESTS FOR INFORMATION**

- A. In the event that the Contractor or Subcontractor, at any tier, determines that some portion of the Drawings, Specifications, or other Contract Documents requires clarification or interpretation, the Contractor shall submit a "Request for Information" (RFI) in writing to the Designer. A RFI may only be submitted by the Contractor and shall only be submitted on the RFI forms provided by the Owner. The Contractor shall clearly and concisely set forth the issue for which clarification or interpretation is sought and why a response is needed. In the RFI, the Contractor shall set forth an interpretation or understanding of the requirement along with reasons why such an understanding was reached.
- B. Responses to RFI shall be issued within ten (10) working days of receipt of the Request from the Contractor unless the Designer determines that a longer time is necessary to provide an adequate response. If a longer time is determined necessary by the Designer, the Designer will, within five (5) working days of receipt of the request, notify the Contractor of the anticipated response time. If the Contractor submits a RFI on a time sensitive activity on the current project schedule, the Contractor shall not be entitled to any time extension due to the time it takes the Designer to respond to the request provided that the Designer responds within the ten (10) working days set forth above.

- C. Responses from the Designer will not change any requirement of the Contract Documents. In the event the Contractor believes that a response to a RFI will cause a change to the requirements of the Contract Document, the Contractor shall give written notice to the Designer requesting a Change Order for the work. Failure to give such written notice within ten (10) working days, shall waive the Contractor's right to seek additional time or cost under Article 4, "Changes in the Work" of the General Conditions.

#### **1.4 MINOR CHANGES IN THE WORK**

- A. Designer will issue supplemental instructions authorizing Minor Changes in the Work, not involving adjustment to the Contract Amount or the Contract Time, on "Designer's Supplemental Instructions" (DSI).

#### **1.5 PROPOSAL REQUESTS**

- A. The Designer or Owner Representative will issue a detailed description of proposed Changes in the Work that may require adjustment to the Contract Amount or the Contract Time. The proposed Change Description will be issued using the "Request for Proposal" (RFP) form. If necessary, the description will include supplemental or revised Drawings and Specifications.
  - 1. Proposal Requests issued by the Designer or Owner Representative are for information only. Do not consider them instructions either to stop work in progress or to execute the proposed change.
  - 2. Within ten (10) working days after receipt of Proposal Request, submit a proposal for the cost adjustments to the Contract Amount and the Contract Time necessary to execute the Change. The Contractor shall submit his proposal on the appropriate Change Order Detailed Breakdown form. Subcontractors may use the appropriate Change Order Detailed Breakdown form or submit their proposal on their letterhead provided the same level of detail is included. All proposals shall include:
    - a. A detailed breakdown of costs per Article 4.1 of the General Conditions.
    - b. If requesting additional time per Article 4.2 of the General Conditions, include an updated Contractor's Construction Schedule that indicates the effect of the Change including, but not limited to, changes in activity duration, start and finish times, and activity relationship.

#### **1.6 CHANGE ORDER PROCEDURES**

- A. On Owner's approval of a Proposal Request, the Designer or Owner Representative will issue a Change Order for signatures of Owner and Contractor on the "Change Order" form.

Design & Install New Domestic Water Plant  
Veterans Home Building  
St. James, MO

U2409-01

**PART 2 - PRODUCTS (Not Used)**

**PART 3 - EXECUTION (Not Used)**

**END OF SECTION 012600**



## **SECTION 013100 – COORDINATION**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes administrative provisions for coordinating construction operations on Projects including, but not limited to, the following:
  - 1. Coordination Drawings.
  - 2. Administrative and supervisory personnel.
  - 3. Project meetings.
- B. Each Contractor shall participate in coordination requirements. Certain areas of responsibility will be assigned to a specific Contractor.
- C. Related Sections include the following:
  - 1. Division 1, Section 013200 "Schedules" for preparing and submitting Contractor's Construction Schedule.
  - 2. Articles 1.8.B and 1.8.C of Section 007213 "General Conditions" for coordinating meetings onsite.
  - 3. Article 5.4.H of Section 007213 "General Conditions" for coordinating Closeout of the Contract.

#### **1.3 COORDINATION**

- A. Coordination: Coordinate construction operations included in different Sections of the Specifications to ensure efficient and orderly installation of each part of the Work. Coordinate construction operations included in different Sections, which depend on each other for proper installation, connection, and operation.
- B. Coordination: Each Contractor shall coordinate its construction operations with those of other contractors and entities to ensure efficient and orderly installation of each part of the Work. Each Contractor shall coordinate its operations with operations included in different Sections that depend on each other for proper installation, connection, and operation.
  - 1. Schedule construction operations in sequence required to obtain the best results where installation of one part of the Work depends on installation of other components, before or after its own installation.
  - 2. Coordinate installation of different components with other Contractors to ensure maximum accessibility for required maintenance, service, and repair.

3. Make adequate provisions to accommodate items scheduled for later installation.
  4. Where availability of space is limited, coordinate installation of different components to ensure maximum performance and accessibility for required maintenance, service, and repair of all components including mechanical and electrical.
- C. Prepare memoranda for distribution to each party involved outlining special procedures required for coordination. Include such items as required notices, reports, and list of attendees at meetings.
1. Prepare similar memoranda for Owner and separate Contractors if coordination of their Work is required.
- D. Administrative Procedures: Coordinate scheduling and timing of required administrative procedures with other construction activities and activities of other Contractors to avoid conflicts and to ensure orderly progress of the Work. Such administrative activities include, but are not limited to, the following:
1. Preparation of Contractor's Construction Schedule.
  2. Preparation of the Schedule of Values.
  3. Installation and removal of temporary facilities and controls.
  4. Delivery and processing of submittals.
  5. Progress meetings.
  6. Preinstallation conferences.
  7. Startup and adjustment of systems.
  8. Project Closeout activities.
- E. Conservation: Coordinate construction activities to ensure that operations are carried out with consideration given to conservation of energy, water, and materials.
1. Salvage materials and equipment involved in performance of, but not actually incorporated into, the Work. Refer to other Sections for disposition of salvaged materials that are designated as Owner's property.

#### **1.4 SUBMITTALS**

- A. Coordination Drawings: Prepare Coordination Drawings if limited space availability necessitates maximum utilization of space for efficient installation of different components or if coordination is required for installation of products and materials fabricated by separate entities.
- B. Key Personnel Names: Within fifteen (15) work days of starting construction operations, submit a list of key personnel assignments including superintendent and other personnel in attendance at Project site. Identify individuals and their duties and responsibilities; list addresses and telephone numbers including home and office telephone numbers. Provide names, addresses, and telephone numbers of individuals assigned as standbys in the absence of individuals assigned to Project.

1. Post copies of list in Project meeting room, in temporary field office, and by each temporary telephone. Keep list current at all times.

## 1.5 PROJECT MEETINGS

- A. The Owner's Construction Representative will schedule a Pre-Construction Meeting prior to beginning of construction. The date, time, and exact place of this meeting will be determined after Contract Award and notification of all interested parties. The Contractor shall arrange to have the Job Superintendent and all prime Subcontractors present at the meeting. During the Pre-Construction Meeting, the construction procedures and information necessary for submitting payment requests will be discussed and materials distributed along with any other pertinent information.
  1. Minutes: Designer will record and distribute meeting minutes.
- B. Progress Meetings: The Owner's Construction Representative will conduct Monthly Progress Meetings as stated in Articles 1.8.B and 1.8.C of Section 007213 "General Conditions".
  1. Minutes: Designer will record and distribute to Contractor the meeting minutes.
- C. Preinstallation Conferences: Contractor shall conduct a preinstallation conference at Project site before each construction activity that requires coordination with other construction.
  1. Attendees: Installer and representatives of Manufacturers and Fabricators involved in or affected by the installation and its coordination or integration with other materials and installations that have preceded or will follow, shall attend the meeting. Advise Designer and Construction Representative of scheduled meeting dates.
  2. Agenda: Review progress of other construction activities and preparations for the particular activity under consideration including requirements for the following:
    - a. Contract Documents
    - b. Options
    - c. Related RFIs
    - d. Related Change Orders
    - e. Purchases
    - f. Deliveries
    - g. Submittals
    - h. Review of mockups
    - i. Possible conflicts
    - j. Compatibility problems
    - k. Time schedules

- l. Weather limitations
  - m. Manufacturer's written recommendations
  - n. Warranty requirements
  - o. Compatibility of materials
  - p. Acceptability of substrates
  - q. Temporary facilities and controls
  - r. Space and access limitations
  - s. Regulations of authorities having jurisdiction
  - t. Testing and inspecting requirements
  - u. Installation procedures
  - v. Coordination with other Work
  - w. Required performance results
  - x. Protection of adjacent Work
  - y. Protection of construction and personnel
3. Contractor shall record significant conference discussions, agreements, and disagreements including required corrective measures and actions.
  4. Reporting: Distribute minutes of the meeting to each party present and to parties who should have been present.
  5. Do not proceed with installation if the conference cannot be successfully concluded. Initiate whatever actions are necessary to resolve impediments to performance of the Work and reconvene the conference at earliest feasible date.
  6. Revise paragraph below if Project requires holding progress meetings at different intervals. Insert special intervals such as "every third Tuesday" to suit special circumstances.
  7. Project name
  8. Name and address of Contractor
  9. Name and address of Designer
  10. RFI number including RFIs that were dropped and not submitted
  11. RFI description
  12. Date the RFI was submitted
  13. Date Designer's response was received
  14. Identification of related DSI or Proposal Request, as appropriate

Design & Install New Domestic Water Plant  
Veterans Home Building  
St. James, MO

U2409-01

**PART 2 - PRODUCTS (Not Used)**

**PART 3 - EXECUTION (Not Used)**

**END OF SECTION 013100**

## **SECTION 013115 - PROJECT MANAGEMENT COMMUNICATIONS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.
- B. Division 1, Section 013300 - Submittals
- C. Division 1, Section 012600 – Contract Modification Procedures

#### **1.2 SUMMARY**

- A. Project Management Communications: The Contractor shall use the Internet web based project management communications tool, E-Builder® ASP software, and protocols included in that software during this project. The use of project management communications as herein described does not replace or change any contractual responsibilities of the participants.
  - 1. Project management communications is available through E-Builder® as provided by "e-Builder®" in the form and manner required by the Owner.
  - 2. The project communications database is on-line and fully functional. User registration, electronic and computer equipment, and Internet connections are the responsibility of each project participant. The sharing of user accounts is prohibited
- B. Support: E-Builder® will provide on-going support through on-line help files.
- C. Copyrights and Ownership: Nothing in this specification or the subsequent communications supersedes the parties' obligations and rights for copyright or document ownership as established by the Contract Documents. The use of CAD files, processes or design information distributed in this system is intended only for the project specified herein.
- D. Purpose: The intent of using E-Builder® is to improve project work efforts by promoting timely initial communications and responses. Secondly, to reduce the number of paper documents while providing improved record keeping by creation of electronic document files
- E. Authorized Users: Access to the web site will be by individuals who are authorized users.
  - 1. Individuals shall complete the E-Builder New Company/User Request Form located at the following web site: <https://oa.mo.gov/facilities/vendor-links/contractor-forms>.  
Com[OA.FMDCE-BuilderSupport@oa.mo.gov](mailto:OA.FMDCE-BuilderSupport@oa.mo.gov).

2. Authorized users will be contacted directly and assigned a temporary user password.
  3. Individuals shall be responsible for the proper use of their passwords and access to data as agents of the company in which they are employed.
- F. Administrative Users: Administrative users have access and control of user licenses and all posted items. DO NOT POST PRIVATE OR YOUR COMPANY CONFIDENTIAL ITEMS IN THE DATABASE! Improper or abusive language toward any party or repeated posting of items intended to deceive or disrupt the work of the project will not be tolerated and will result in deletion of the offensive items and revocation of user license at the sole discretion of the Administrative User(s).
- G. Communications: The use of fax, email and courier communication for this project is discouraged in favor of using E-Builder® to send messages. Communication functions are as follows:
1. Document Integrity and Revisions:
    - a. Documents, comments, drawings and other records posted to the system shall remain for the project record. The authorship time and date shall be recorded for each document submitted to the system. Submitting a new document or record with a unique ID, authorship, and time stamp shall be the method used to make modifications or corrections.
    - b. The system shall make it easy to identify revised or superseded documents and their predecessors.
    - c. Server or Client side software enhancements during the life of the project shall not alter or restrict the content of data published by the system. System upgrades shall not affect access to older documents or software.
  2. Document Security:
    - a. The system shall provide a method for communication of documents. Documents shall allow security group assignment to respect the contractual parties communication except for Administrative Users. DO NOT POST PRIVATE OR YOUR COMPANY CONFIDENTIAL ITEMS IN THE DATABASE!
  3. Document Integration:
    - a. Documents of various types shall be logically related to one another and discoverable. For example, requests for information, daily field reports, supplemental sketches and photographs shall be capable of reference as related records.
  4. Reporting:
    - a. The system shall be capable of generating reports for work in progress, and logs for each document type. Summary reports generated by the system shall be available for team members.
  5. Notifications and Distribution:
    - a. Document distribution to project members shall be accomplished both within the extranet system and via email as appropriate. Project document

distribution to parties outside of the project communication system shall be accomplished by secure email of outgoing documents and attachments, readable by a standard email client.

6. Required Document Types:
  - a. RFI, Request for Information.
  - b. Submittals, including record numbering by drawing and specification section.
  - c. Transmittals, including record of documents and materials delivered in hard copy.
  - d. Meeting Minutes.
  - e. Application for Payments (Draft or Pencil).
  - f. Review Comments.
  - g. Field Reports.
  - h. Construction Photographs.
  - i. Drawings.
  - j. Supplemental Sketches.
  - k. Schedules.
  - l. Specifications.
  - m. Request for Proposals
  - n. Designer's Supplemental Instructions
  - o. Punch Lists
  
- H. Record Keeping: Except for paper documents, which require original signatures and large format documents (greater than 8½ x 11 inches), all other 8½ x 11 inches documents shall be submitted by transmission in electronic form to the E-Builder® web site by licensed users.
  - a. The Owner and his representatives, the Designer and his consultants, and the Contractor and his Sub Contractors and suppliers at every tier shall respond to documents received in electronic form on the web site, and consider them as if received in paper document form.
  - b. The Owner and his representatives, the Designer and his consultants, and the Contractor and his Sub Contractors and suppliers at every tier reserves the right to and shall reply or respond by transmissions in electronic form on the web site to documents actually received in paper document form.
  - c. The Owner and his representatives, the Designer and his consultants, and the Contractor and his Sub Contractors and suppliers at every tier reserves the right to and shall copy any paper document into electronic form and make same available on the web site.
  
- I. Minimum Equipment and Internet Connection: In addition to other requirements specified in this Section, the Owner and his representatives, the Construction Manager and his representatives, the Architect and his consultants, and the Contractor and his sub-contractors and suppliers at every tier required to have a user license(s) shall be responsible for the following:



1. Providing suitable computer systems for each licensed user at the users normal work location<sup>1</sup> with high-speed Internet access, i.e. DSL, local cable company's Internet connection, or T1 connection.
2. Each of the above referenced computer systems shall have the following minimum system<sup>2</sup> and software requirements:
  - a. Desktop configuration (Laptop configurations are similar and should be equal to or exceed desktop system.)
    - 1) Operating System: Windows XP or newer
    - 2) Internet Browser: Internet Explorer 6.01SP2+ (Recommend IE7.0+)
    - 3) Minimum Recommend Connection Speed: 256K or above
    - 4) Processor Speed: 1 Gigahertz and above
    - 5) RAM: 512 mb
    - 6) Operating system and software shall be properly licensed.
    - 7) Internet Explorer version 7 (current version is a free distribution for download). This specification is not intended to restrict the host server or client computers provided that industry standard HTTP clients may access the published content.
    - 8) Adobe Acrobat Reader (current version is a free distribution for download).
    - 9) Users should have the standard Microsoft Office Suite (current version must be purchased) or the equivalent.

**PART 2 - PRODUCTS (Not Applicable)**

**PART 3 - EXECUTION (Not Applicable.)**

**END OF SECTION 013115**

---

<sup>1</sup> The normal work location is the place where the user is assigned for more than one-half of his time working on this project.

<sup>2</sup> The minimum system herein will not be sufficient for many tasks and may not be able to process all documents and files stored in the E-Builder® Documents area.

## **SECTION 013200 – SCHEDULE – BAR CHART**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes requirements for a Bar Chart Schedule for the project construction activities, schedule of submittals, and schedule for testing.

### **PART 2 - PRODUCTS – (Not Applicable)**

### **PART 3 - EXECUTION**

#### **3.1 SUBMITTAL PROCEDURES**

- A. The Contractor shall submit to the Designer, within ten (10) working days following the Notice to Proceed, a Progress Schedule including Schedule of Values showing the rate of progress the Contractor agrees to maintain and the order in which he proposed to carry out the various phases of Work. No payments shall be made to the Contractor until the Progress Schedule has been approved by the Owner.
  - 1. The Schedule of Values must have the following line items included with the value of the item as indicated below:
    - a. O&M's (Owner's Manual)
      - 1) \$1,000,000.00 (One million) and under – 2% of the total contract amount
      - 2) Over \$1,000,000.00 (One million) – 1% of the total contract amount
    - b. Close Out Documents
      - 1) \$1,000,000.00 (One million) and under – 2% of the total contract amount
      - 2) Over \$1,000,000.00 (One million) – 1% of the total contract amount
    - c. General Conditions
      - 1) No more than 10%
- B. The Contractor shall submit an updated Schedule for presentation at each Monthly Progress Meeting. The Schedule shall be updated by the Contractor as necessary to reflect the current Schedule and its relationship to the original Schedule. The updated Schedule shall reflect any

changes in the logic, sequence, durations, or completion date. Payments to the Contractor shall be suspended if the Progress Schedule is not adequately updated to reflect actual conditions.

- C. The Contractor shall submit Progress Schedules to Subcontractors to permit coordinating their Progress Schedules to the general construction Work. The Contractor shall coordinate preparation and processing of Schedules and reports with performance of other construction activities.

### 3.2 CONSTRUCTION PROGRESS SCHEDULE – BAR CHART SCHEDULE

- A. Bar-Chart Schedule: The Contractor shall prepare a comprehensive, fully developed, horizontal bar chart-type Contractor’s Construction Schedule. The Contractor for general construction shall prepare the Construction Schedule for the entire Project. The Schedule shall show the percentage of work to be completed at any time, anticipated monthly payments by Owner, as well as significant dates (such as completion of excavation, concrete foundation work, underground lines, superstructure, rough-ins, enclosure, hanging of fixtures, etc.) which shall serve as check points to determine compliance with the approved Schedule. The Schedule shall also include an activity for the number of “bad” weather days specified in Section 012100 – Allowances.
  - 1. The Contractor shall provide a separate time bar for each significant construction activity. Provide a continuous vertical line to identify the first working day of each week.
    - a. If practical, use the same Schedule of Values breakdown for schedule time bars.
  - 2. The Contractor shall provide a base activity time bar showing duration for each construction activity. Each bar is to indicate start and completion dates for the activity. The Contractor is to place a contrasting bar below each original schedule activity time for indicating actual progress and planned remaining duration for the activity.
  - 3. The Contractor shall prepare the Schedule on a minimal number of separate sheets to readily show the data for the entire construction period.
  - 4. Secure time commitments for performing critical elements of the Work from parties involved. Coordinate each element on schedule with other construction activities. Include minor elements involved in the overall sequence of the Work. Show each activity in proper sequence. Indicate graphically the sequences necessary for completion of related portions of the Work.
  - 5. Coordinate the Contractor’s Construction Schedule with the Schedule of Values, list of subcontracts, Submittal Schedule, progress reports, payment requests, and other required schedules and reports.
  - 6. Indicate the Intent to Award and the Contract Substantial Completion dates on the schedule.
- B. Phasing: Provide notations on the schedule to show how the sequence of the Work is affected by the following:

1. Requirement for Phased completion
  2. Work by separate Contractors
  3. Work by the Owner
  4. Pre-purchased materials
  5. Coordination with existing construction
  6. Limitations of continued occupancies
  7. Un-interruptible services
  8. Partial Occupancy prior to Substantial Completion
  9. Site restrictions
  10. Provisions for future construction
  11. Seasonal variations
  12. Environmental control
- C. Work Stages: Use crosshatched bars to indicate important stages of construction for each major portion of the Work. Such stages include, but are not necessarily limited to, the following:
1. Subcontract awards
  2. Submittals
  3. Purchases
  4. Mockups
  5. Fabrication
  6. Sample testing
  7. Deliveries
  8. Installation
  9. Testing
  10. Adjusting
  11. Curing
  12. Startup and placement into final use and operation
- D. Area Separations: Provide a separate time bar to identify each major area of construction for each major portion of the Work. For the purposes of this Article, a “major area” is a story of construction, a separate building, or a similar significant construction element.
1. Indicate where each construction activity within a major area must be sequenced or integrated with other construction activities to provide for the following:
    - a. Structural completion.
    - b. Permanent space enclosure
    - c. Completion of mechanical installation

- d. Completion of the electrical portion of the Work
- e. Substantial Completion

### **3.3 SCHEDULE OF SUBMITTALS**

- A. Upon acceptance of the Construction Progress Schedule, prepare and submit a complete schedule of submittals. Coordinate the submittal schedule with Section 013300 SUBMITTALS, the approved Construction Progress Schedule, list of subcontracts, Schedule of Values and the list of products.
- B. Prepare the schedule in chronological order. Provide the following information
  - 1. Scheduled date for the first submittal
  - 2. Related Section number
  - 3. Submittal category
  - 4. Name of the Subcontractor
  - 5. Description of the part of the Work covered
  - 6. Scheduled date for resubmittal
  - 7. Scheduled date for the Designer's final release or approval
- C. Distribution: Following the Designer's response to the initial submittal schedule, print and distribute copies to the Designer, Owner, subcontractors, and other parties required to comply with submittal dates indicated.
  - 1. Post copies in the Project meeting room and temporary field office.
  - 2. When revisions are made, distribute to the same parties and post in the same locations. Delete parties from distribution when they have completed their assigned part of the Work and are no longer involved in construction activities.
- D. Schedule Updating: Revise the schedule after each meeting or other activity where revisions have been recognized or made. Issue the updated schedule concurrently with the report of each meeting.

### **3.4 SCHEDULE OF INSPECTIONS AND TESTS**

- A. Prepare a schedule of inspections, tests, and similar services required by the Contract Documents. Submit the schedule with (15) days of the date established for commencement of the Contract Work. The Contractor is to notify the testing agency at least (5) working days in advance of the required tests unless otherwise specified.
- B. Form: This schedule shall be in tabular form and shall include, but not be limited to, the following:
  - 1. Specification Section number
  - 2. Description of the test

3. Identification of applicable standards
  4. Identification of test methods
  5. Number of tests required
  6. Time schedule or time span for tests
  7. Entity responsible for performing tests
  8. Requirements for taking samples
  9. Unique characteristics of each service
- C. Distribution: Distribute the schedule to the Owner, Architect, and each party involved in performance of portions of the Work where inspections and tests are required.

**END OF SECTION 013200**

## **SECTION 013300 – SUBMITTALS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.
- B. Division 1, Section 013115 “Project Management Communications” for administrative requirements for communications.

#### **1.2 SUMMARY**

- A. This Section includes administrative and procedural requirements for submittals required for performance of the Work including the following:
  - 1. Shop Drawings
  - 2. Product Data
  - 3. Samples
  - 4. Quality Assurance Submittals
  - 5. Construction Photographs
  - 6. Operating and Maintenance Manuals
  - 7. Warranties
- B. Administrative Submittals: Refer to General and Supplementary Conditions other applicable Division 1 Sections and other Contract Documents for requirements for administrative submittals. Such submittals include, but are not limited to, the following:
  - 1. Construction Progress Schedule including Schedule of Values
  - 2. Performance and Payment Bonds
  - 3. Insurance Certificates
  - 4. Applications for Payment
  - 5. Certified Payroll Reports
  - 6. Partial and Final Receipt of Payment and Release Forms
  - 7. Affidavit – Compliance with Prevailing Wage Law
  - 8. Record Drawings
  - 9. Notifications, Permits, etc.
- C. The Contractor is obliged and responsible to check all shop drawings and schedules to assure compliance with contract plans and specifications. The Contractor is responsible for the content of the shop drawings and coordination with other contract work. Shop

drawings and schedules shall indicate, in detail, all parts of an Item or Work including erection and setting instructions and integration with the Work of other trades.

- D. The Contractor shall at all times make a copy, of all approved submittals, available on site to the Construction Representative.

### **1.3 SUBMITTAL PROCEDURES**

- A. The Contractor shall comply with the General and Supplementary Conditions and other applicable sections of the Contract Documents. The Contractor shall submit, with such promptness as to cause no delay in his work or in that of any other contractors, all required submittals indicated in Part 3.1 of this section and elsewhere in the Contract Documents. Coordinate preparation and processing of submittals with performance of construction activities. Transmit each submittal sufficiently in advance of performance of related construction activities to avoid delay.
  - 1. Coordinate each submittal with fabrication, purchasing, testing, delivery, other submittals, and related activities that require sequential activity.
  - 2. Coordinate transmittal of different types of submittals for related elements of the Work so processing will not be delayed by the need to review submittals concurrently for coordination.
    - a. The Designer reserves the right to withhold action on a submittal requiring coordination with other submittals until all related submittals are received.
- B. Each drawing and/or series of drawings submitted must be accompanied by a letter of transmittal giving a list of the titles and numbers of the drawings. Each series shall be numbered consecutively for ready reference and each drawing shall be marked with the following information:
  - 1. Date of Submission
  - 2. Name of Project
  - 3. Location
  - 4. Section Number of Specification
  - 5. State Project Number
  - 6. Name of Submitting Contractor
  - 7. Name of Subcontractor
  - 8. Indicate if Item is submitted as specified or as a substitution

### **1.4 SHOP DRAWINGS**

- A. Comply with the General Conditions, Article 3.2.
- B. The Contractor shall submit newly prepared information drawn accurately to scale. Highlight, encircle, or otherwise indicate deviations from the Contract Documents. Do not reproduce Contract Documents or copy standard information as the basis of Shop



Drawings. Standard information prepared without specific reference to the Project is not a Shop Drawing.

- C. Shop Drawings include fabrication and installation drawings, setting diagrams, schedules, patterns, templates, and similar drawings including the following information:
  - 1. Dimensions
  - 2. Identification of products and materials included by sheet and detail number
  - 3. Compliance with specified standards
  - 4. Notation of coordination requirements
  - 5. Notation of dimensions established by field measurement
  - 6. Sheet Size: Except for templates, patterns and similar full-size Drawings, submit Shop Drawings on sheets at least 8½"x11" but no larger than 36"x48".

## 1.5 PRODUCT DATA

- A. The Contractor shall comply with the General Conditions, Article 3.2.
- B. The Contractor shall collect Product Data into a single submittal for each element of construction or system. Product Data includes printed information, such as manufacturer's installation instructions, catalog cuts, standard color charts, roughing-in diagrams and templates, standard wiring diagrams, and performance curves.
  - 1. Mark each copy to show applicable choices and options. Where printed Product Data includes information on several products that are not required, mark copies to indicate the applicable information including the following information:
    - a. Manufacturer's printed recommendations
    - b. Compliance with Trade Association standards
    - c. Compliance with recognized Testing Agency standards
    - d. Application of Testing Agency labels and seals
    - e. Notation of dimensions verified by field measurement
    - f. Notation of coordination requirements
  - 2. Do not submit Product Data until compliance with requirements of the Contract Documents has been confirmed.

## 1.6 SAMPLES

- A. The Contractor shall comply with the General Conditions, Article 3.2.
- B. The Contractor shall submit full-size, fully fabricated samples, cured and finished as specified, and physically identical with the material or product proposed. Samples include partial sections of manufactured or fabricated components, cuts or containers of materials, color range sets, and swatches showing color, texture, and pattern.

1. The Contractor shall mount or display samples in the manner to facilitate review of qualities indicated. Prepare samples to match the Designer's sample including the following:
  - a. Specification Section number and reference
  - b. Generic description of the Sample
  - c. Sample source
  - d. Product name or name of the Manufacturer
  - e. Compliance with recognized standards
  - f. Availability and delivery time
2. The Contractor shall submit samples for review of size, kind, color, pattern, and texture. Submit samples for a final check of these characteristics with other elements and a comparison of these characteristics between the final submittal and the actual component as delivered and installed.
  - a. Where variation in color, pattern, texture, or other characteristic is inherent in the material or product represented, submit at least three (3) multiple units that show approximate limits of the variations.
  - b. Refer to other Specification Sections for requirements for samples that illustrate workmanship, fabrication techniques, details of assembly, connections, operation, and similar construction characteristics.
  - c. Refer to other Sections for samples to be returned to the Contractor for incorporation in the Work. Such samples must be undamaged at time of use. On the transmittal, indicate special requests regarding disposition of sample submittals.
  - d. Samples not incorporated into the Work, or otherwise designated as the Owner's property, are the property of the Contractor and shall be removed from the site prior to Substantial Completion.
3. Field samples are full-size examples erected onsite to illustrate finishes, coatings, or finish materials and to establish the Project standard.
  - a. The Contractor shall comply with submittal requirements to the fullest extent possible. The Contractor shall process transmittal forms to provide a record of activity.

## **1.7 QUALITY ASSURANCE DOCUMENTS**

- A. The Contractor shall comply with the General Conditions, Article 3.2
- B. The Contractor shall submit quality control submittals including design data, certifications, manufacturer's instructions, manufacturer's field reports, and other quality-control submittals as required under other Sections of the Specifications.
- C. Certifications: Where other Sections of the Specifications require certification that a product, material, or installation complies with specified requirements, submit a notarized certification from the Manufacturer certifying compliance with specified requirements.

1. Signature: Certification shall be signed by an officer of the Manufacturer or other individual authorized to contractually bind the Company.
- D. Inspection and Test Reports: The Contractor shall submit the required inspection and test reports from independent testing agencies as specified in this Section and in other Sections of the Contract Documents.
- E. Construction Photographs: The Contractor shall submit record construction photographs as specified in this Section and in other Sections of the Contract Documents.
1. The Contractor shall submit digital photographs. The Construction Administrator shall determine the quantity and naming convention at the preconstruction meeting.
  2. The Contractor shall identify each photograph with project name, location, number, date, time, and orientation.
  3. The Contractor shall submit progress photographs monthly unless specified otherwise. Photographs shall be taken one (1) week prior to submitting.
  4. The Contractor shall take four (4) site photographs from differing directions and a minimum of five (5) interior photographs indicating the relative progress of the Work.

**1.8 OPERATING AND MAINTENANCE MANUALS AND WARRANTIES**

- A. The Contractor shall submit all required manufacturer’s operating instructions, maintenance/service manuals, and warranties in accordance with the General Conditions, Article 3.5, and Supplementary Conditions along with this and other Sections of the Contract Documents.

**PART 2 - PRODUCTS (Not Applicable)**

**PART 3 - EXECUTION**

**3.1 REQUIRED SUBMITTALS**

<b>SPEC SECTION</b>	<b>TITLE</b>	<b>CATEGORY</b>
013200	Schedules	Construction Schedule
013200	Schedules	Schedule of Values
013200	Schedules	List of Subcontractors
013200	Schedules	Major Material Suppliers
013513.28	Site Security and Health Requirements	Construction Schedule
013513.28	Site Security and Health Requirements	List of Subcontractors
015000	Construction Facilities and Temporary Controls	Construction Schedule
017900	Demonstration and Training	Operation / Maintenance Manual

024119	Selective Demolition	Construction Schedule
033000	Cast-In-Place Concrete	Product Data
079200	Joint Sealants	Product Data
220510	Basic Plumbing Requirements	Operation / Maintenance Manual
220511	Common Work Results for Plumbing	Product Data
220519	Meters and Gages for Plumbing Piping	Product Data
220519	Meters and Gages for Plumbing Piping	Certification
220523	General-Duty Valves for Plumbing Piping	Product Data
220523	General-Duty Valves for Plumbing Piping	Operation / Maintenance Manual
220529	Hangers and Supports for Plumbing Piping and Equipment	Product Data
220529	Hangers and Supports for Plumbing Piping and Equipment	Certification
220553	Identification for Plumbing Piping and Equipment	Product Data
220719	Plumbing Insulation	Product Data
221119	Domestic Water Piping Specialties	Product Data
221119	Domestic Water Piping Specialties	Test Report
221119	Domestic Water Piping Specialties	Operation / Maintenance Manual
221123	Domestic Water Pumps	Product Data
221123	Domestic Water Pumps	Operation / Maintenance Manual
223400	Fuel-Fired, Domestic-Water Heaters	Product Data
223400	Fuel-Fired, Domestic-Water Heaters	Certification
223400	Fuel-Fired, Domestic-Water Heaters	Operation / Maintenance Manual
231123	Facility Natural-Gas Piping	Product Data
231123	Facility Natural-Gas Piping	Certification
231123	Facility Natural-Gas Piping	Test Report
231123	Facility Natural-Gas Piping	Operation / Maintenance Manual
232113	Hydronic Piping	Product Data
232116	Hydronic Piping Specialties	Product Data
232116	Hydronic Piping Specialties	Operation / Maintenance Manual
232123	Hydronic Pumps	Product Data
232123	Hydronic Pumps	Test Report
232123	Hydronic Pumps	Operation / Maintenance Manual
235233	Fire-Tube Boilers	Product Data
235233	Fire-Tube Boilers	Test Report

235233	Fire-Tube Boilers	Warranty
235233	Fire-Tube Boilers	Operation / Maintenance Manual
235700	Shell and Tube Heat Exchangers (Domestic)	Product Data
235700	Shell and Tube Heat Exchangers (Domestic)	Certification
235700	Shell and Tube Heat Exchangers (Domestic)	Warranty
235700	Shell and Tube Heat Exchangers (Domestic)	Operation / Maintenance Manual
262726	Wiring Devices	Product Data
262816	Enclosed Switches and Circuit Breakers	Product Data

**END OF SECTION 013300**

**SECTION 013513.28 - SITE SECURITY AND HEALTH REQUIREMENTS  
(VETERANS, STATE FAIR, MONG)**

**PART 1 - GENERAL**

**1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

**1.2 SUBMITTALS**

- A. List of required submittals:
  - 1. Materials Safety Data Sheets for all hazardous materials to be brought onsite.
  - 2. Schedule of proposed shutdowns, if applicable.
  - 3. A list of the names of all employees who will submit fingerprints for a background check, and the signed privacy documents identified below for each employee.

**PART 2 - PRODUCTS (Not Applicable)**

**PART 3 - EXECUTION**

**3.1 ACCESS TO THE SITE**

- A. The Contractor shall arrange with Facility Representatives to establish procedures for the controlled entry of workers and materials into the work areas at the Facility.
- B. The Contractor shall establish regular working hours with Facility Representatives. The Contractor must report changes in working hours or overtime to Facility Representatives and obtain approval twenty-four (24) hours ahead of time. The Contractor shall report emergency overtime to Facility Representatives as soon as it is evident that overtime is needed. The Contractor must obtain approval from Facility Representatives for all work performed after dark.
- C. The Contractor shall provide the name and phone number of the Contractor's employee or agent who is in charge onsite; this individual must be able to be contacted in case of emergency. The Contractor must be able to furnish names and address of all employees upon request.
- D. All construction personnel shall visibly display issued identification cards.

**3.2 FIRE PROTECTION, SAFETY, AND HEALTH CONTROLS**

- A. The Contractor shall take all necessary precautions to guard against and eliminate possible fire hazards.

1. Onsite burning is prohibited.
  2. The Contractor shall store all flammable or hazardous materials in proper containers located outside the buildings or offsite, if possible.
  3. The Contractor shall provide and maintain, in good order, during construction fire extinguishers as required by the National Fire Protection Association. In areas of flammable liquids, asphalt, or electrical hazards, 15-pound carbon dioxide or 20-pound dry chemical extinguishers shall be provided.
- B. The Contractor shall not obstruct streets or walks without permission from the Owner's Construction Representative and Facility Representatives.
- C. The Contractor's personnel shall not exceed the speed limit of 15 mph while at the Facility unless otherwise posted.
- D. The Contractor shall take all necessary, reasonable measures to reduce air and water pollution by any material or equipment used during construction. The Contractor shall keep volatile wastes in covered containers, and shall not dispose of volatile wastes or oils in storm or sanitary drains.
- E. The Contractor shall keep the project site neat, orderly, and in a safe condition at all times. The Contractor shall immediately remove all hazardous waste, and shall not allow rubbish to accumulate. The Contractor shall provide onsite containers for collection of rubbish and shall dispose of it at frequent intervals during the progress of the Work.
- F. Fire exits, alarm systems, and sprinkler systems shall remain fully operational at all times, unless written approval is received from the Owner's Construction Representative and the appropriate Facility Representative at least twenty-four (24) hours in advance. The Contractor shall submit a written time schedule for any proposed shutdowns.
- G. For all hazardous materials brought onsite, Material Safety Data Sheets shall be on site and readily available upon request at least a day before delivery.
- H. Alcoholic beverages or illegal substances shall not be brought upon the Facility premises. The Contractor's workers shall not be under the influence of any intoxicating substances while on the Facility premises.

### **3.3 SECURITY CLEARANCES AND RESTRICTIONS**

- A. **FMDC REQUIRED FINGERPRINTING FOR CRIMINAL BACKGROUND AND WARRANTS CHECK**
1. All employees of the Contractor are required to submit fingerprints to the Missouri State Highway Patrol to enable the Office of Administration, Division of Facilities Management, Design and Construction (FMDC) to receive state and national criminal background checks on such employees. FMDC reserves the right to prohibit any employee of the Contractor from performing work in or on the premises of any facility owned, operated, or utilized by the State of Missouri for any reason.
  2. The Contractor shall ensure all of its employees submit fingerprints to the Missouri State

Highway Patrol and pay for the cost of such background checks. The Contractor shall submit to FMDC via email to [FMDCSecurity@oa.mo.gov](mailto:FMDCSecurity@oa.mo.gov) a list of the names of the Contractor's employees who will be fingerprinted and a signed Missouri Applicant Fingerprint Privacy Notice, Applicant Privacy Rights and Privacy Act Statement for each employee. All employees of the Contractor approved by FMDC to work at a State facility must obtain a contractor ID badge from FMDC prior to beginning work on-site, unless the Director of FMDC, at the Director's discretion, waives the requirement for a contractor ID badge. The Contractor and its employees must comply with the process for background checks and contractor ID badges found on FMDC's website at: <https://oa.mo.gov/fmdc-contractor-id-badges>.

3. Pursuant to section 43.540, RSMo, FMDC participates in the Missouri Rap Back and National Rap Back programs as of August 28, 2018. This means that the Missouri State Highway Patrol, Central Records Repository, and the Federal Bureau of Investigation will retain the fingerprints submitted by each of the Contractor's employees, and those fingerprints will be searched against other fingerprints on file, including latent fingerprints. While retained, an employee's fingerprints may continue to be compared against other fingerprints submitted or retained by the Federal Bureau of Investigation, including latent fingerprints.
4. As part of the Missouri and National Rap Back programs, FMDC will receive notification if a new arrest is reported for an employee whose fingerprints have been submitted for FMDC after August 28, 2018. If the employee is performing work on a State contract at the time of the arrest notification, FMDC will request and receive the employee's updated criminal history records. If the employee is no longer performing work on a State contract, FMDC will not obtain updated criminal records.
5. Pursuant to section 43.540, RSMo, the Missouri State Highway Patrol will provide the results of the employee's background check directly to FMDC. FMDC may NOT release the results of a background check to the Contractor or provide the Contractor any information obtained from a background check, either verbally or in writing. FMDC will notify the Contractor only whether an employee is approved to work on State property.
6. Each employee who submits fingerprints to the Missouri State Highway Patrol has a right to obtain a copy of the results of his or her background check. The employee may challenge the accuracy and completeness of the information contained in a background check report and obtain a determination from the Missouri State Highway Patrol and/or the FBI regarding the validity of such challenge prior to FMDC making a final decision about his or her eligibility to perform work under a State contract.
7. The Contractor shall notify FMDC via email to [FMDCSecurity@oa.mo.gov](mailto:FMDCSecurity@oa.mo.gov) if an employee is terminated or resigns from employment with the Contractor. If the Contractor does not anticipate performing work on a State contract in the future, the Contractor may request that FMDC remove its employees from the Rap Back programs. However, if removed from the Rap Back programs, employees will be required to submit new fingerprints should the contractor be awarded another State contract.
8. Upon award of a Contract, the Contractor should contact FMDC at [FMDCSecurity@oa.mo.gov](mailto:FMDCSecurity@oa.mo.gov) to determine if its employees need to provide a new background check. If a Contractor's employee has previously submitted a fingerprint background check to FMDC as part of the Missouri and National Rap Back programs, the employee may not need to submit another fingerprint search for a period of three to six years, depending upon the circumstances. The Contractor understands and agrees that FMDC may require more frequent background checks without providing any explanation to the Contractor. The fact that an additional background check is requested by FMDC



does not indicate that the employee has a criminal record.

### **3.4 DISRUPTION OF UTILITIES**

- A. The Contractor shall give a minimum of seventy-two (72) hours written notice to the Construction Representative and the Facility Representative before disconnecting electric, gas, water, fire protection, or sewer service to any building.
- B. The Contractor shall give a minimum of seventy-two (72) hours written notice to the Construction Representative and Facility Representative before closing any access drives, and shall make temporary access available, if possible. The Contractor shall not obstruct streets, walks, or parking.

### **3.5 PROTECTION OF PERSONS AND PROPERTY**

#### **A. SAFETY PRECAUTIONS AND PROGRAMS**

- 1. The Contractor shall at all times conduct operations under this Contract in a manner to avoid the risk of bodily harm to persons or risk of damage to any property. The Contractor shall promptly take precautions which are necessary and adequate against conditions created during the progress of the Contractor's activities hereunder which involve a risk of bodily harm to persons or a risk of damage to property. The Contractor shall continuously inspect Work, materials, and equipment to discover and determine any such conditions and shall be solely responsible for discovery, determination, and correction of any such conditions. The Contractor shall comply with applicable safety laws, standards, codes, and regulations in the jurisdiction where the Work is being performed, specifically, but without limiting the generality of the foregoing, with rules regulations, and standards adopted pursuant to the Williams-Steiger Occupational Safety and Health Act of 1970 and applicable amendments.
- 2. All contractors, subcontractors and workers on this project are subject to the Construction Safety Training provisions 292.675 RSMo.
- 3. In the event the Contractor encounters on the site, material reasonably believed to be asbestos, polychlorinated biphenyl (PCB), lead, mercury, or other material known to be hazardous, which has not been rendered harmless, the Contractor shall immediately stop Work in the area affected and report the condition to the Owner's Representative and the Architect in writing. The Work in the affected area shall not thereafter be resumed except by written agreement of the Owner's Representative and Contractor if in fact the material is asbestos or polychlorinated biphenyl (PCB) and has not been rendered harmless. The Work in the affected area shall be resumed in the absence of asbestos or polychlorinated biphenyl (PCB), or when it has been rendered harmless by written agreement of the Owner's Representative and the Contractor. "Rendered Harmless" shall mean that levels of such materials are less than any applicable exposure standards, including but limited to OSHA regulations.

#### **B. SAFETY OF PERSONS AND PROPERTY**

- 1. The Contractor shall take reasonable precautions for safety of, and shall provide

protection to prevent damage, injury, or loss to:

- a. clients, staff, the public, construction personnel, and other persons who may be affected thereby;
  - b. the Work and materials and equipment to be incorporated therein, whether in storage on or off the site, under care, custody, or control of the Contractor or the Contractor's Subcontractors of any tier; and
  - c. other property at the site or adjacent thereto, such as trees, shrubs, lawns, walks, pavements, roadways, structures, and utilities not designated for removal, relocation, or replacement in the course of construction.
2. The Contractor shall give notices and comply with applicable laws, standards, codes, ordinances, rules, regulations, and lawful orders of public authorities bearing on safety of persons or property or their protection from damage, injury, or loss.
  3. The Contractor shall erect and maintain, as required by existing conditions and performance of the Contract, safeguards for safety and protection, including, but not limited to, posting danger signs and other warnings against hazards, promulgating safety regulations, and notifying owners and users of adjacent sites and utilities.
  4. When use or storage of explosives or other hazardous materials or equipment or unusual methods are necessary for execution of the Work, the Contractor shall exercise the highest degree of care and carry on such activities under supervision of properly qualified personnel.
  5. The Contractor shall promptly remedy damage and loss (other than damage or loss insured under property insurance required by the Contract Documents) to property referred to in this Section caused in whole or in part by the Contractor, a Subcontractor of any tier, or anyone directly or indirectly employed by any of them, or by anyone for whose acts they may be liable, and for which the Contractor is responsible under this Section, except damage or loss attributable solely to acts or omissions of Owner or the Architect or anyone directly or indirectly employed by either of them, or by anyone for whose acts either of them may be liable, and not attributable to the fault or negligence of the Contractor. The foregoing obligations of the Contractor are in addition to the Contractor's other obligations stated elsewhere in the Contract.
  6. The Contractor shall designate a responsible member of the Contractor's organization at the site whose duty shall be the prevention of accidents, and the maintaining, enforcing and supervising of safety precautions and programs. This person shall be the Contractor's superintendent unless otherwise designated by the Contractor in writing to the Owner's Representative and Architect. The Contractor shall hold regularly scheduled safety meetings to instruct Contractor personnel on safety practices, accident avoidance and prevention, and the Project Safety Program. The Contractor shall furnish safety equipment and enforce the use of such equipment by its employees and its subcontractors of any tier.
  7. The Contractor shall not load or permit any part of the construction or site to be loaded so as to endanger its safety.
  8. The Contractor shall promptly report in writing to the Owner all accidents arising out of or in connection with the Work which cause death, lost time injury, personal injury, or property damage, giving full details and statements of any witnesses. In addition, if death, serious personal injuries, or serious property damages are caused, the accident shall be reported immediately.
  9. The Contractor shall promptly notify in writing to the Owner of any claims for injury or

- damage to personal property related to the work, either by or against the Contractor.
10. The Owner assumes no responsibility or liability for the physical condition or safety of the Work site or any improvements located on the Work site. The Contractor shall be solely responsible for providing a safe place for the performance of the Work. The Owner shall not be required to make any adjustment in either the Contract Sum or Contract Time concerning any failure by the Contractor or any Subcontractor to comply with the requirements of this Paragraph.
  11. In no event shall the Owner have control over, charge of, or any responsibility for construction means, methods, techniques, sequences or procedures or for safety precautions and programs in connection with the Work, notwithstanding any of the rights and authority granted the Owner in the Contract Documents.
  12. The Contractor shall maintain at his own cost and expense, adequate, safe and sufficient walkways, platforms, scaffolds, ladders, hoists and all necessary, proper, and adequate equipment, apparatus, and appliances useful in carrying on the Work and which are necessary to make the place of Work safe and free from avoidable danger for clients, staff, the public and construction personnel, and as may be required by safety provisions of applicable laws, ordinances, rules regulations and building and construction codes.

**END OF SECTION 013513.28**

## **SECTION 015000 – CONSTRUCTION FACILITIES AND TEMPORARY CONTROLS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes requirements for construction facilities and temporary controls including temporary utilities, support facilities, security, and protection.
- B. Temporary utilities include, but are not limited to, the following:
  - 1. Water service and distribution
  - 2. Temporary electric power and light
  - 3. Temporary heat
  - 4. Ventilation
  - 5. Sanitary facilities, including drinking water
  - 6. Storm and sanitary sewer
- C. Support facilities include, but are not limited to, the following:
  - 1. Field offices and storage sheds
  - 2. Temporary roads and paving
  - 3. Dewatering facilities and drains
  - 4. Temporary enclosures
  - 5. Hoists and temporary elevator use
  - 6. Temporary project identification signs and bulletin boards
  - 7. Waste disposal services
  - 8. Rodent and pest control
  - 9. Construction aids and miscellaneous services and facilities
- D. Security and protection facilities include, but are not limited to, to following:
  - 1. Temporary fire protection
  - 2. Barricades, warning signs, and lights
  - 3. Sidewalk bridge or enclosure fence for the site
  - 4. Environmental protection

### 1.3 SUBMITTALS

- A. Temporary Utilities: Submit reports of tests, inspections, meter readings, and similar procedures performed on temporary utilities.
- B. Implementation and Termination Schedule: Within (15) days of the date established for commencement of the Work, submit a schedule indicating implementation and termination of each temporary utility.

### 1.4 QUALITY ASSURANCE

- A. Regulations: Comply with industry standards and applicable laws and regulations including, but not limited to, the following:
  - 1. Building code requirements
  - 2. Health and safety regulations
  - 3. Utility company regulations
  - 4. Police, fire department, and rescue squad rules
  - 5. Environmental protection regulations
- B. Standards: Comply with NFPA 241 “Standard for Safeguarding Construction, Alterations, and Demolition Operations”. ANSI A10 Series standards for “Safety Requirements for Construction and Demolition”, and NECA Electrical Design Library “Temporary Electrical Facilities”.
  - 1. Electrical Service: Comply with NEMA, NECA, and UL standards and regulations for temporary electric service. Install service in compliance with NFPA 70 “National Electric Code”.
- C. Inspections: Arrange for authorities having jurisdiction to inspect and test each temporary utility before use. Obtain required certifications and permits.

### 1.5 PROJECT CONDITIONS

- A. Temporary Utilities: Prepare a schedule indicating dates for implementation and termination of each temporary utility. At the earliest feasible time, when acceptable to the Owner, change over from use of temporary service to use of permanent service.
- B. Conditions of Use: Keep temporary services and facilities clean and neat in appearance. Operate in a safe and efficient manner. Relocate temporary services and facilities as the Work progresses. Do not overload facilities or permit them to interfere with progress. Take necessary fire-prevention measures. Do not allow hazardous, dangerous, or unsanitary conditions, or public nuisances to develop or persist onsite.

## **PART 2 - PRODUCTS**

### **2.1 EQUIPMENT**

- A. General: Provide new equipment. If acceptable to the Designer, the Contractor may use undamaged, previously used equipment in serviceable condition. Provide equipment suitable for use intended.
- B. Water Hoses: Provide ¾" (19mm), heavy-duty, abrasion-resistant, flexible rubber hoses 100' (30m) long, with pressure rating greater than the maximum pressure of the water distribution system. Provide adjustable shutoff nozzles at hose discharge.
- C. Electrical Outlets: Provide properly configured, NEMA-polarized outlets to prevent insertion of 110 to 120V plugs into higher voltage outlets. Provide receptacle outlets equipped with ground-fault circuit interrupters, reset button, and pilot light for connection of power tools and equipment.
- D. Electrical Power Cords: Provide grounded extension cords. Use hard-service cords where exposed to abrasion and traffic. Provide waterproof connectors to connect separate lengths of electric cords if single lengths will not reach areas where construction activities are in progress. Do not exceed safe length-voltage rating.
- E. Lamps and Light Fixtures: Provide general service incandescent lamps of wattage required for adequate illumination. Provide guard cages or tempered-glass enclosures where exposed to breakage. Provide exterior fixture where exposed to moisture.
- F. Heating Units: Provide temporary heating units that have been tested and labeled by UL, FM, or another recognized trade association related to the type of fuel being consumed.
- G. Temporary Offices: Provide prefabricated or mobile units or similar job-built construction with lockable entrances, operable windows, and serviceable finishes. Provide heated and air-conditioned units on foundations adequate for normal loading.
- H. Fire Extinguishers: Provide hand-carried, portable, UL-rated, Class A fire extinguishers for temporary offices and similar spaces. In other locations, provide hand-carried, portable, UL-rated, Class ABC, dry-chemical extinguishers, or a combination of extinguishers of NFPA-recommended classes for the exposures.
  - 1. Comply with NFPA 10 and NFPA 241 for classification, extinguishing agent, and size required by location and class of fire exposure.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Use qualified personnel for installation of temporary facilities. Locate facilities where they will serve the Project adequately and result in minimum interference with performance of the Work. Relocate and modify facilities as required.

- B. Provide each Facility ready for use when needed to avoid delay. Maintain and modify as required. Do not remove until facilities are no longer needed or are replaced by authorized use of completed permanent facilities.

### 3.2 TEMPORARY UTILITY INSTALLATION

- A. General: Engage the appropriate local utility company to install temporary service or connect to existing service. Where company provides only part of the service, provide the remainder with matching, compatible materials and equipment. Comply with company recommendations.
  - 1. Arrange with company and existing users for a time when service can be interrupted, if necessary, to make connections for temporary services.
  - 2. Provide adequate capacity at each stage of construction. Prior to temporary utility availability, provide trucked-in services.
  - 3. Obtain easements to bring temporary utilities to the site where the Owner's easements cannot be used for that purpose.
  - 4. Use Charges: Cost or use charges for temporary facilities are not chargeable to the Owner or Designer. Neither the Owner nor Designer will accept cost or use charges as a basis of claims for Change Order.
- B. Temporary Water Service: The Owner will provide water for construction purposes from the existing building system. All required temporary extensions shall be provided and removed by the Contractor. Connection points and methods of connection shall be designated and approved by the Construction Representative.
- C. Temporary Electric Power Service: The Owner will provide electric power for construction lighting and power tools. Contractors using such services shall pay all costs of temporary services, circuits, outlet, extensions, etc.
- D. Temporary Lighting: When overhead floor or roof deck has been installed, provide temporary lighting with local switching.
  - 1. Install and operate temporary lighting that will fulfill security and protection requirements without operating the entire system. Provide temporary lighting that will provide adequate illumination for construction operations and traffic conditions.
- E. Temporary Heating: Provide temporary heat required by construction activities for curing or drying of completed installations or for protection of installed construction from adverse effects of low temperatures or high humidity. Select safe equipment that will not have a harmful effect on completed installations or elements being installed. Coordinate ventilation requirements to produce the ambient condition required and minimize consumption of energy.
  - 1. Heating Facilities: Except where the Owner authorizes use of the permanent system, provide vented, self-contained, LP gas or fuel-oil heaters with individual space thermostatic control.

2. Use of gasoline-burning space heaters, open flame, or salamander heating units is prohibited.
- F. Temporary Toilets: The Owner will provide toilets and associated facilities within the building. All construction personnel will be allowed access only to those specific facilities designated by the Construction Representative.
- G. Wash Facilities: The Owner will provide wash facilities within the building. All construction personnel will be allowed access only to those specific facilities designated by the Construction Representative.
- H. Drinking-Water Facilities: The Owner will provide drinking water facilities within the building. All construction personnel will be allowed access only to those specific facilities designated by the Construction Representative.

### **3.3 SUPPORT FACILITIES INSTALLATION**

- A. General: Locate field offices, storage sheds, and other temporary construction and support facilities for easy access.
1. Maintain support facilities until near Substantial Completion. Remove prior to Substantial Completion. Personnel remaining after Substantial Completion will be permitted to use permanent facilities, under conditions acceptable to the Owner.
- B. Field Offices: Provide insulated, weathertight temporary offices of sufficient size to accommodate required office personnel at the Project site. Keep the office clean and orderly for use for small progress meetings. Furnish and equip office as follows:
1. Furnish with a desk and chairs, a 4-drawer file cabinet, plan table, plan rack, and a 6-shelf bookcase.
  2. Equip with a water cooler and private toilet complete with water closet, lavatory, and medicine cabinet unit with a mirror.
- C. Storage Facilities: Limited areas for storage of building materials are available onsite. Available storage areas are shown on the drawings. The Contractor shall provide his own security. Specific locations for storage and craning operations will be discussed at the Pre-Bid Meeting and the Pre-Construction Meeting.
- D. Construction Parking: Parking at the site will be provided in the areas designated at the Pre-Construction Meeting.
- E. Temporary Enclosures: Provide temporary enclosures for protection of construction, in progress and completed, from exposure, foul weather, other construction operations, and similar activities.
1. Where heat is needed and the permanent building enclosure is not complete, provide temporary enclosures where there is no other provision for containment of heat. Coordinate enclosure with ventilating and materials drying or curing requirements to avoid dangerous conditions and effects.



2. Install tarpaulins securely with incombustible wood framing and other materials. Close openings of 25SqFt (2.3SqM) or less with plywood or similar materials.
  3. Close openings through floor or roof decks and horizontal surfaces with load-bearing, wood-framed construction.
  4. Where temporary wood or plywood enclosure exceeds 100SqFt (9.2SqM) in area, use UL-labeled, fire-retardant-treated material for framing and main sheathing.
- F. Temporary Lifts and Hoists: Provide facilities for hoisting materials and employees. Truck cranes and similar devices used for hoisting materials are considered “tools and equipment” and not temporary facilities.
- G. Temporary Elevator Use: The Owner will allow use of elevators within the building. All construction personnel will be allowed access only to those specific elevators designated by the Construction Representative.
- H. Project Identification and Temporary Signs: Prepare project identification and other signs of size indicated. Install signs where indicated to inform the public and persons seeking entrance to the Project. Support on posts or framing of preservative-treated wood or steel. Do not permit installation of unauthorized signs.
1. Project Identification Signs: Engage an experienced sign painter to apply graphics. Comply with details indicated.
  2. Temporary Signs: Prepare signs to provide directional information to construction personnel and visitors.
- I. Temporary Exterior Lighting: Install exterior yard and sign lights so signs are visible when Work is being performed.
- J. Collection and Disposal of Waste: Collect waste from construction areas and elsewhere daily. Comply with requirements of NFPA 241 for removal of combustible waste material and debris. Enforce requirements strictly. Do not hold materials more than seven (7) days during normal weather or three (3) days when the temperature is expected to rise above 80°F (27°C). Handle hazardous, dangerous, or unsanitary waste materials separately from other waste by containerizing properly. Dispose of material lawfully.
- K. Rodent Pest Control: Before deep foundation work has been completed, retain a local exterminator or pest control company to recommend practices to minimize attraction and harboring of rodents, roaches, and other pests. Employ this service to perform extermination and control procedures are regular intervals so the Project will be free of pests and their residues at Substantial Completion. Perform control operations lawfully, using environmentally safe materials.

### **3.4 SECURITY AND PROTECTION FACILITIES INSTALLATION**

- A. Except for use of permanent fire protection as soon as available, do not change over from use of temporary security and protection facilities to permanent facilities until Substantial Completion, or longer, as requested by the Designer.

- B. Temporary Fire Protection: Until fire-protection needs are supplied by permanent facilities, install and maintain temporary fire-protection facilities of the types needed to protect against reasonable predictable and controllable fire losses. Comply with NFPA 10 “Standard for Portable Fire Extinguishers” and NFPA 241 “Standard for Safeguarding Construction, Alterations, and Demolition Operations”.
1. Locate fire extinguishers where convenient and effective for their intended purpose, but not less than one (1) extinguisher on each floor at or near each usable stairwell.
  2. Store combustible materials in containers in fire-safe locations.
  3. Maintain unobstructed access to fire extinguishers, fire hydrants, temporary fire-protection facilities, stairways, and other access routes for fighting fires. Prohibit smoking in hazardous fire-exposure areas.
  4. Provide supervision of welding operations, combustion-type temporary heating units, and similar sources of fire ignition.
- C. Permanent Fire Protection: At the earliest feasible date in each area of the Project complete installation of the permanent fire-protection facility including connected services and place into operation and use. Instruct key personnel on use of facilities.
- D. Barricades, Warning Signs, and Lights: Comply with standards and code requirements for erection of structurally adequate barricades. Paint with appropriate colors, graphics, and warning signs to inform personnel and the public of the hazard being protected against. Where appropriate and needed, provide lighting including flashing red or amber lights.
- E. Enclosure Fence: Before excavation begins, install an enclosure fence with lockable entrance gates. Locate where indicated, or enclose the entire site or the portion determined sufficient to accommodate construction operations. Install in a manner that will prevent people, dogs, and other animals from easily entering the site, except by the entrance gates.
1. Provide open-mesh, chainlink fencing with posts set in a compacted mixture of gravel and earth.
  2. Provide plywood fence, 8’ (2.5m) high, framed with (4) 2”x4” (50mm x 100mm) rails, and preservative-treated wood posts spaced not more than 8’ (2.5m) apart.
- F. Covered Walkway: Erect a structurally adequate, protective covered walkway for passage of persons along the adjacent public street. Coordinate with entrance gates, other facilities, and obstructions. Comply with regulations of authorities having jurisdiction.
1. Construct covered walkways using scaffold or shoring framing. Provide wood plank overhead decking, protective plywood enclosure walls, handrails, barricades, warning signs, lights, safe and well-drained walkways, and similar provisions for protection and safe passage. Extend the back wall beyond the structure to complete the enclosure fence. Paint and maintain in a manner acceptable to the Owner and the Designer.

- G. Security Enclosure and Lockup: Install substantial temporary enclosure of partially completed areas of construction. Provide locking entrances to prevent unauthorized entrance, vandalism, theft, and similar violations of security.
  - 1. Storage: Where materials and equipment must be stored and are of value or attractive for theft, provide a secure lockup. Enforce discipline in connection with the installation and release of material to minimize the opportunity for theft and vandalism.
- H. Environmental Protection: Provide protection, operate temporary facilities, and conduct construction in ways and by methods that comply with environmental regulations and minimize the possibility that air, waterways, and subsoil might be contaminated or polluted or that other undesirable effects might result. Avoid use of tools and equipment that produce harmful noise. Restrict use of noisemaking tools and equipment to hours that will minimize complaints from persons or firms near the site.

### **3.5 OPERATION, TERMINATION AND REMOVAL**

- A. Supervision: Enforce strict discipline in use of temporary facilities. Limit availability of temporary facilities to essential and intended uses to minimize waste and abuse.
- B. Maintenance: Maintain facilities in good operating condition until removal. Protect from damage by freezing temperatures and similar elements.
  - 1. Maintain operation of temporary enclosures, heating, cooling, humidity control, ventilation, and similar facilities on a 24-hour basis where required to achieve indicated results and to avoid possibility of damage.
  - 2. Protection: Prevent water-filled piping from freezing. Maintain markers for underground lines. Protect from damage during excavation operations.
- C. Termination and Removal: Unless the Designer requests that it be maintained longer, remove each temporary facility when the need has ended, when replaced by authorized use of a permanent facility, or no later than Substantial Completion. Complete or, if necessary, restore permanent construction that may have been delayed because of interference with the temporary facility. Repair damaged Work, clean exposed surfaces, and replace construction that cannot be satisfactorily repaired.
  - 1. Materials and facilities that constitute temporary facilities are the Contractor's property. The Owner reserves the right to take possession of project identification signs.
  - 2. At Substantial Completion, clean and renovate permanent facilities used during the construction period including, but not limited to, the following:
    - a. Replace air filters and clean inside of ductwork and housing.
    - b. Replace significantly worn parts and parts subject to unusual operating conditions.
    - c. Replace lamps burned out or noticeably dimmed by hours of use.

**END OF SECTION 015000**

## **SECTION 017400 – CLEANING**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract including General and Supplementary Conditions, Bid Form, and other Division 1 Specification Sections apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes administrative and procedural requirements for cleaning during the Project.
- B. Environmental Requirements: Conduct cleaning and waste-disposal operations in compliance with local laws and ordinances. Comply fully with federal and local environmental and anti-pollution regulations.
  - 1. Do not dispose of volatile wastes such as mineral spirits, oil, or paint thinner in storm or sanitary drains.
  - 2. Burning or burying of debris, rubbish, or other waste material on the premises is not permitted.

### **PART 2 - PRODUCTS**

#### **2.1 MATERIALS**

- A. Cleaning Agents: Use cleaning materials and agents recommended by the manufacturer or fabricator for the surface to be cleaned. Do not use cleaning agents that are potentially hazardous to health or property or that might damage finished surfaces.

### **PART 3 - EXECUTION**

#### **3.1 PROGRESS CLEANING**

- A. General
  - 1. Retain all stored items in an orderly arrangement allowing maximum access, not impending drainage or traffic, and providing the required protection of materials.
  - 2. Do not allow the accumulation of scrap, debris, waste material, and other items not required for construction of this Work.
  - 3. At least twice each month, and more often if necessary, completely remove all scrap, debris, and waste material from the jobsite.
  - 4. Provide adequate storage for all items awaiting removal from the jobsite, observing all requirements for fire protection and protection of the ecology.

B. Site

1. Daily, inspect the site and pick up all scrap, debris, and waste material. Remove all such items to the place designated for their storage.
2. Weekly, inspect all arrangements of materials stored onsite. Re-stack, tidy, or otherwise service all material arrangements.
3. Maintain the site in a neat and orderly condition at all times.

C. Structures

1. Daily, inspect the structures and pick up all scrap, debris, and waste material. Remove all such items to the place designated for their storage.
2. Weekly, sweep all interior spaces clean. "Clean" for the purposes of this paragraph, shall be interpreted as meaning free from dust and other material capable of being removed by use of reasonable effort and handheld broom.
3. In preparation for installation of succeeding materials, clean the structures or pertinent portions thereof to the degree of cleanliness recommended by the manufacturer of the succeeding material, using all equipment and materials required to achieve the required cleanliness.
4. Following the installation of finish floor materials, clean the finish floor daily while work is being performed in the space in which finish materials have been installed. "Clean" for the purposes of this subparagraph, shall be interpreted as meaning free from all foreign material which, in the opinion of the Construction Representative, may be injurious to the finish of the finish floor material.

### 3.2 FINAL CLEANING

- A. General: Provide final cleaning operations when indicated. Employ experienced workers or professional cleaners for final cleaning. Clean each surface or unit of Work to the condition expected from a commercial building cleaning and maintenance program. Comply with manufacturer's instructions.
- B. Complete the following cleaning operations before requesting inspection for certification of Substantial Completion for the entire Project or a portion of the Project.
1. Clean the Project Site, yard and grounds, in areas disturbed by construction activities including landscape development areas, of rubbish, waste material, litter, and foreign substances.
  2. Sweep paved areas broom clean. Rake grounds that are neither planted nor paved to a smooth, even-textured surface.
  3. Remove petrochemical spills, stains, and other foreign deposits.
  4. Remove tools, construction equipment, machinery, and surplus material from the site.
  5. Remove snow and ice to provide safe access to the building.

6. Clean exposed exterior and interior hard-surfaced finishes to a dirt-free condition, free of stains, films, and similar foreign substances. Avoid disturbing natural weathering of exterior surfaces. Restore reflective surfaces to their original condition.
  7. Remove debris and surface dust from limited access spaces, including roofs, plenums, shafts, trenches, equipment vaults, manholes, attics, and similar spaces.
  8. Broom clean concrete floors in unoccupied spaces.
  9. Vacuum clean carpet and similar soft surfaces removing debris and excess nap. Shampoo, if required.
  10. Clean transparent material, including mirrors and glass in doors and windows. Remove glazing compounds and other substances that are noticeable vision-obscuring materials. Replace chipped or broken glass and other damaged transparent materials. Polish mirrors and glass, taking care not to scratch surfaces.
  11. Remove labels that are not permanent labels.
  12. Touch up and otherwise repair and restore marred, exposed finishes and surfaces. Replace finishes and surfaces that cannot be satisfactorily repaired or restored or that already show evidence of repair or restoration.
    - a. Do not paint over "UL" and similar labels, including mechanical and electrical nameplates.
  13. Wipe surfaces of mechanical and electrical equipment, elevator equipment, and similar equipment. Remove excess lubrication, paint and mortar droppings, and other foreign substances.
  14. Clean plumbing fixtures to a sanitary condition free of stains, including stains resulting from water exposure.
  15. Replace disposable air filters and clean permanent air filters. Clean exposed surfaces of diffusers, registers, and grills.
  16. Clean ducts, blowers, and coils if units were operated without filters during construction
  17. Clean food-service equipment to a sanitary condition, ready and acceptable for its intended use.
  18. Clean light fixtures, lamps, globes, and reflectors to function with full efficiency. Replace burned-out bulbs and defective and noisy starters in fluorescent and mercury vapor fixtures.
  19. Leave the Project clean and ready for occupancy.
- C. Pest Control: Engage an experienced, licensed exterminator to make a final inspection and rid the Project of rodents, insects, and other pests. Comply with regulations of local authorities.
- D. Removal of Protection: Remove temporary protection and facilities installed during construction to protect previously completed installations during the remainder of the construction period.

- E. Compliances: Comply with governing regulations and safety standards for cleaning operations. Remove waste materials from the site and dispose of lawfully.
  - 1. Where extra materials of value remain after Final Acceptance by the Owner, they become the Owner's property.

**END OF SECTION 017400**



## **SECTION 017900 - DEMONSTRATION AND TRAINING**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section includes administrative and procedural requirements for instructing Owner's personnel, including the following:
  - 1. Demonstration of operation of systems, subsystems, and equipment.
  - 2. Training in operation and maintenance of systems, subsystems, and equipment.
  - 3. Demonstration and training video recordings.

#### **1.3 INFORMATIONAL SUBMITTALS**

- A. Instruction Program: Submit outline of instructional program for demonstration and training, including a list of training modules and a schedule of proposed dates, times, length of instruction time, and instructors' names for each training module. Include learning objective and outline for each training module.
- B. Attendance Record: For each training module, submit list of participants and length of instruction time.
- C. Evaluations: For each participant and for each training module, submit results and documentation of performance-based test.

#### **1.4 CLOSEOUT SUBMITTALS**

- A. Demonstration and Training Video Recordings: Submit two copies within seven days of end of each training module.
  - 1. Identification: On each copy, provide an applied label with the following information:
    - a. Name of Project.
    - b. Name and address of videographer.
    - c. Name of Architect.
    - d. Name of Construction Manager.
    - e. Name of Contractor.
    - f. Date of video recording.
  - 2. Transcript: Prepared in PDF electronic format. Include a cover sheet with same label information as the corresponding video recording and a table of contents with links to corresponding training components. Include name of Project and date of video recording on each page.

3. At completion of training, submit complete training manual(s) for Owner's use in PDF electronic file format on compact disc.

## **1.5 QUALITY ASSURANCE**

- A. Facilitator Qualifications: A firm or individual experienced in training or educating maintenance personnel in a training program similar in content and extent to that indicated for this Project, and whose work has resulted in training or education with a record of successful learning performance.
- B. Instructor Qualifications: A factory-authorized service representative experienced in operation and maintenance procedures and training.
- C. Preinstruction Conference: Conduct conference at Project site to comply with requirements in Section 013100 "Coordination". Review methods and procedures related to demonstration and training including, but not limited to, the following:
  1. Inspect and discuss locations and other facilities required for instruction.
  2. Review and finalize instruction schedule and verify availability of educational materials, instructors' personnel, audiovisual equipment, and facilities needed to avoid delays.
  3. Review required content of instruction.
  4. For instruction that must occur outside, review weather and forecasted weather conditions and procedures to follow if conditions are unfavorable.

## **1.6 COORDINATION**

- A. Coordinate instruction schedule with Owner's operations. Adjust schedule as required to minimize disrupting Owner's operations and to ensure availability of Owner's personnel.
- B. Coordinate instructors, including providing notification of dates, times, length of instruction time, and course content.
- C. Coordinate content of training modules with content of approved emergency, operation, and maintenance manuals. Do not submit instruction program until operation and maintenance data has been reviewed and approved by Architect.

## **PART 2 - PRODUCTS**

### **2.1 INSTRUCTION PROGRAM**

- A. Program Structure: Develop an instruction program that includes individual training modules for each system and for equipment not part of a system, as required by individual Specification Sections.
- B. Training Modules: Develop a learning objective and teaching outline for each module. Include a description of specific skills and knowledge that participant is expected to master. For each module, include instruction for the following as applicable to the system, equipment, or component:
  1. Basis of System Design, Operational Requirements, and Criteria: Include the following:

- a. System, subsystem, and equipment descriptions.
  - b. Performance and design criteria if Contractor is delegated design responsibility.
  - c. Operating standards.
  - d. Regulatory requirements.
  - e. Equipment function.
  - f. Operating characteristics.
  - g. Limiting conditions.
  - h. Performance curves.
2. Documentation: Review the following items in detail:
- a. Emergency manuals.
  - b. Operations manuals.
  - c. Maintenance manuals.
  - d. Project record documents.
  - e. Identification systems.
  - f. Warranties and bonds.
  - g. Maintenance service agreements and similar continuing commitments.
3. Emergencies: Include the following, as applicable:
- a. Instructions on meaning of warnings, trouble indications, and error messages.
  - b. Instructions on stopping.
  - c. Shutdown instructions for each type of emergency.
  - d. Operating instructions for conditions outside of normal operating limits.
  - e. Sequences for electric or electronic systems.
  - f. Special operating instructions and procedures.
4. Operations: Include the following, as applicable:
- a. Startup procedures.
  - b. Equipment or system break-in procedures.
  - c. Routine and normal operating instructions.
  - d. Regulation and control procedures.
  - e. Control sequences.
  - f. Safety procedures.
  - g. Instructions on stopping.
  - h. Normal shutdown instructions.
  - i. Operating procedures for emergencies.
  - j. Operating procedures for system, subsystem, or equipment failure.
  - k. Seasonal and weekend operating instructions.
  - l. Required sequences for electric or electronic systems.
  - m. Special operating instructions and procedures.
5. Adjustments: Include the following:
- a. Alignments.
  - b. Checking adjustments.
  - c. Noise and vibration adjustments.
  - d. Economy and efficiency adjustments.

6. Troubleshooting: Include the following:
  - a. Diagnostic instructions.
  - b. Test and inspection procedures.
7. Maintenance: Include the following:
  - a. Inspection procedures.
  - b. Types of cleaning agents to be used and methods of cleaning.
  - c. List of cleaning agents and methods of cleaning detrimental to product.
  - d. Procedures for routine cleaning
  - e. Procedures for preventive maintenance.
  - f. Procedures for routine maintenance.
  - g. Instruction on use of special tools.
8. Repairs: Include the following:
  - a. Diagnosis instructions.
  - b. Repair instructions.
  - c. Disassembly; component removal, repair, and replacement; and reassembly instructions.
  - d. Instructions for identifying parts and components.
  - e. Review of spare parts needed for operation and maintenance.

### **PART 3 - EXECUTION**

#### **3.1 PREPARATION**

- A. Assemble educational materials necessary for instruction, including documentation and training module. Assemble training modules into a training manual organized in coordination with requirements in Section 007213 "General Conditions".
- B. Set up instructional equipment at instruction location.

#### **3.2 INSTRUCTION**

- A. Engage qualified instructors to instruct Owner's personnel to adjust, operate, and maintain systems, subsystems, and equipment not part of a system.
  1. Architect will furnish an instructor to describe basis of system design, operational requirements, criteria, and regulatory requirements.
  2. Owner will furnish an instructor to describe Owner's operational philosophy.
  3. Owner will furnish Contractor with names and positions of participants.
- B. Scheduling: Provide instruction at mutually agreed on times. For equipment that requires seasonal operation, provide similar instruction at start of each season.
  1. Schedule training with Owner with at least seven days' advance notice.

- C. Training Location and Reference Material: Conduct training on-site in the completed and fully operational facility using the actual equipment in-place. Conduct training using final operation and maintenance data submittals.
- D. Cleanup: Collect used and leftover educational materials and remove from Project site. Remove instructional equipment. Restore systems and equipment to condition existing before initial training use.

### **3.3 DEMONSTRATION AND TRAINING VIDEO RECORDINGS**

- A. General: Engage a qualified commercial videographer to record demonstration and training video recordings. Record each training module separately. Include classroom instructions and demonstrations, board diagrams, and other visual aids, but not student practice.
  - 1. At beginning of each training module, record each chart containing learning objective and lesson outline.
- B. Video: Provide minimum 640 x 480 video resolution converted to format file type acceptable to Owner, on electronic media.
  - 1. Electronic Media: Read-only format compact disc acceptable to Owner, with commercial-grade graphic label.
  - 2. File Hierarchy: Organize folder structure and file locations according to project manual table of contents. Provide complete screen-based menu.
  - 3. File Names: Utilize file names based upon name of equipment generally described in video segment, as identified in Project specifications.
  - 4. Contractor and Installer Contact File: Using appropriate software, create a file for inclusion on the Equipment Demonstration and Training DVD that describes the following for each Contractor involved on the Project, arranged according to Project table of contents:
    - a. Name of Contractor/Installer.
    - b. Business address.
    - c. Business phone number.
    - d. Point of contact.
    - e. E-mail address.
- C. Recording: Mount camera on tripod before starting recording, unless otherwise necessary to adequately cover area of demonstration and training. Display continuous running time.
  - 1. Film training session(s) in segments not to exceed 15 minutes.
    - a. Produce segments to present a single significant piece of equipment per segment.
    - b. Organize segments with multiple pieces of equipment to follow order of Project Manual table of contents.
    - c. Where a training session on a particular piece of equipment exceeds 15 minutes, stop filming and pause training session. Begin training session again upon commencement of new filming segment.
- D. Light Levels: Verify light levels are adequate to properly light equipment. Verify equipment markings are clearly visible prior to recording.

1. Furnish additional portable lighting as required.
- E. Narration: Describe scenes on video recording by audio narration by microphone while video recording is recorded. Include description of items being viewed.
- F. Transcript: Provide a transcript of the narration. Display images and running time captured from videotape opposite the corresponding narration segment.
- G. Preproduced Video Recordings: Provide video recordings used as a component of training modules in same format as recordings of live training.

**END OF SECTION 017900**

## **SECTION 024119 - SELECTIVE DEMOLITION**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section Includes:
  - 1. Demolition and removal of selected portions of building or structure.
- B. Related Requirements:
  - 1. Section 011000 "Summary" for restrictions on use of the premises, Owner-occupancy requirements, and phasing requirements.

#### **1.3 DEFINITIONS**

- A. Remove: Detach items from existing construction and dispose of them off-site unless indicated to be salvaged or reinstalled.
- B. Remove and Reinstall: Detach items from existing construction, in a manner to prevent damage, prepare for reuse, and reinstall where indicated.
- C. Existing to Remain: Leave existing items that are not to be removed and that are not otherwise indicated to be salvaged or reinstalled.
- D. Dismantle: To remove by disassembling or detaching an item from a surface, using gentle methods and equipment to prevent damage to the item and surfaces; disposing of items unless indicated to be salvaged or reinstalled.

#### **1.4 MATERIALS OWNERSHIP**

- A. Unless otherwise indicated, demolition waste becomes property of Contractor.
- B. Historic items, relics, antiques, and similar objects including, but not limited to, cornerstones and their contents, commemorative plaques and tablets, and other items of interest or value to Owner that may be uncovered during demolition remain the property of Owner.
  - 1. Carefully salvage in a manner to prevent damage and promptly return to Owner.

## **1.5 PREINSTALLATION MEETINGS**

- A. Predemolition Conference: Conduct conference at Project site.
  - 1. Inspect and discuss condition of construction to be selectively demolished.
  - 2. Review structural load limitations of existing structure.
  - 3. Review and finalize selective demolition schedule and verify availability of materials, demolition personnel, equipment, and facilities needed to make progress and avoid delays.
  - 4. Review requirements of work performed by other trades that rely on substrates exposed by selective demolition operations.
  - 5. Review areas where existing construction is to remain and requires protection.

## **1.6 INFORMATIONAL SUBMITTALS**

- A. Proposed Protection Measures: Submit report, including Drawings, that indicates the measures proposed for protecting individuals and property, for dust control and, for noise control. Indicate proposed locations and construction of barriers.
- B. Schedule of Selective Demolition Activities: Indicate the following:
  - 1. Detailed sequence of selective demolition and removal work, with starting and ending dates for each activity. Ensure Owner's on-site operations are uninterrupted.
  - 2. Interruption of utility services. Indicate how long utility services will be interrupted.
  - 3. Coordination for shutoff, capping, and continuation of utility services.
  - 4. Coordination of Owner's continuing occupancy of portions of existing building and of Owner's partial occupancy of completed Work.
- C. Predemolition Photographs or Video: Show existing conditions of adjoining construction, including finish surfaces, that might be misconstrued as damage caused by demolition operations.
- D. Warranties: Documentation indicating that existing warranties are still in effect after completion of selective demolition.

## **1.7 CLOSEOUT SUBMITTALS**

- A. Inventory: Submit a list of items that have been removed and salvaged.

## **1.8 FIELD CONDITIONS**

- A. Owner will occupy portions of building immediately adjacent to selective demolition area. Conduct selective demolition so Owner's operations will not be disrupted.
- B. Conditions existing at time of inspection for bidding purpose will be maintained by Owner as far as practical.



- C. Notify Architect of discrepancies between existing conditions and Drawings before proceeding with selective demolition.
- D. Hazardous Materials: It is not expected that hazardous materials will be encountered in the Work.
  - 1. If suspected hazardous materials are encountered, do not disturb; immediately notify Architect and Owner.
- E. Storage or sale of removed items or materials on-site is not permitted.
- F. Utility Service: Maintain existing utilities indicated to remain in service and protect them against damage during selective demolition operations.
  - 1. Maintain fire-protection facilities in service during selective demolition operations.

## **1.9 COORDINATION**

- A. Arrange selective demolition schedule so as not to interfere with Owner's operations.

## **PART 2 - PRODUCTS**

### **2.1 PERFORMANCE REQUIREMENTS**

- A. Regulatory Requirements: Comply with governing EPA notification regulations before beginning selective demolition. Comply with hauling and disposal regulations of authorities having jurisdiction.
- B. Standards: Comply with ASSP A10.6 and NFPA 241.

## **PART 3 - EXECUTION**

### **3.1 EXAMINATION**

- A. Verify that utilities have been disconnected and capped before starting selective demolition operations.
- B. Review Project Record Documents of existing construction or other existing condition information provided by Owner. Owner does not guarantee that existing conditions are same as those indicated in Project Record Documents.
- C. Survey of Existing Conditions: Record existing conditions by use of preconstruction photographs or video.
  - 1. Inventory and record the condition of items to be removed and salvaged. Provide photographs or video of conditions that might be misconstrued as damage caused by salvage operations.

2. Before selective demolition or removal of existing building elements that will be reproduced or duplicated in final Work, make permanent record of measurements, materials, and construction details required to make exact reproduction.

### **3.2 UTILITY SERVICES AND MECHANICAL/ELECTRICAL SYSTEMS**

- A. Existing Services/Systems to Remain: Maintain services/systems indicated to remain and protect them against damage.
- B. Existing Services/Systems to Be Removed, Relocated, or Abandoned: Locate, identify, disconnect, and seal or cap off utility services and mechanical/electrical systems serving areas to be selectively demolished.
  1. Owner will arrange to shut off indicated services/systems when requested by Contractor.
  2. Arrange to shut off utilities with utility companies.
  3. If services/systems are required to be removed, relocated, or abandoned, provide temporary services/systems that bypass area of selective demolition and that maintain continuity of services/systems to other parts of building.
  4. Disconnect, demolish, and remove fire-suppression systems, plumbing, and HVAC systems, equipment, and components indicated on Drawings to be removed.
    - a. Piping to Be Removed: Remove portion of piping indicated to be removed and cap or plug remaining piping with same or compatible piping material.
    - b. Piping to Be Abandoned in Place: Drain piping and cap or plug piping with same or compatible piping material and leave in place.
    - c. Equipment to Be Removed: Disconnect and cap services and remove equipment.
    - d. Equipment to Be Removed and Reinstalled: Disconnect and cap services and remove, clean, and store equipment; when appropriate, reinstall, reconnect, and make equipment operational.
    - e. Equipment to Be Removed and Salvaged: Disconnect and cap services and remove equipment and deliver to Owner.

### **3.3 PROTECTION**

- A. Temporary Protection: Provide temporary barricades and other protection required to prevent injury to people and damage to adjacent buildings and facilities to remain.
  1. Provide protection to ensure safe passage of people around selective demolition area and to and from occupied portions of building.
  2. Provide temporary weather protection, during interval between selective demolition of existing construction on exterior surfaces and new construction, to prevent water leakage and damage to structure and interior areas.
  3. Protect walls, ceilings, floors, and other existing finish work that are to remain or that are exposed during selective demolition operations.
  4. Cover and protect furniture, furnishings, and equipment that have not been removed.
  5. Comply with requirements for temporary enclosures, dust control, heating, and cooling specified in Section 015000 "Temporary Facilities and Controls."

- B. Temporary Shoring: Design, provide, and maintain shoring, bracing, and structural supports as required to preserve stability and prevent movement, settlement, or collapse of construction and finishes to remain, and to prevent unexpected or uncontrolled movement or collapse of construction being demolished.
  - 1. Strengthen or add new supports when required during progress of selective demolition.
- C. Remove temporary barricades and protections where hazards no longer exist.

### 3.4 SELECTIVE DEMOLITION, GENERAL

- A. General: Demolish and remove existing construction only to the extent required by new construction and as indicated. Use methods required to complete the Work within limitations of governing regulations and as follows:
  - 1. Proceed with selective demolition systematically, from higher to lower level. Complete selective demolition operations above each floor or tier before disturbing supporting members on the next lower level.
  - 2. Neatly cut openings and holes plumb, square, and true to dimensions required. Use cutting methods least likely to damage construction to remain or adjoining construction. Use hand tools or small power tools designed for sawing or grinding, not hammering and chopping. Temporarily cover openings to remain.
  - 3. Cut or drill from the exposed or finished side into concealed surfaces to avoid marring existing finished surfaces.
  - 4. Do not use cutting torches until work area is cleared of flammable materials. At concealed spaces, such as duct and pipe interiors, verify condition and contents of hidden space before starting flame-cutting operations. Maintain portable fire-suppression devices during flame-cutting operations.
  - 5. Maintain fire watch during and for at least 4 hours after flame-cutting operations.
  - 6. Maintain adequate ventilation when using cutting torches.
  - 7. Remove decayed, vermin-infested, or otherwise dangerous or unsuitable materials and promptly dispose of off-site.
  - 8. Remove structural framing members and lower to ground by method suitable to avoid free fall and to prevent ground impact or dust generation.
  - 9. Locate selective demolition equipment and remove debris and materials so as not to impose excessive loads on supporting walls, floors, or framing.
  - 10. Dispose of demolished items and materials promptly
- B. Site Access and Temporary Controls: Conduct selective demolition and debris-removal operations to ensure minimum interference with roads, streets, walks, walkways, and other adjacent occupied and used facilities.
- C. Removed and Salvaged Items: Confirm with owner if any items are to be retained.
- D. Removed and Reinstalled Items:
  - 1. Clean and repair items to functional condition adequate for intended reuse.
  - 2. Pack or crate items after cleaning and repairing. Identify contents of containers.
  - 3. Protect items from damage during transport and storage.

4. Reinstall items in locations indicated. Comply with installation requirements for new materials and equipment. Provide connections, supports, and miscellaneous materials necessary to make item functional for use indicated.
- E. Existing Items to Remain: Protect construction indicated to remain against damage and soiling during selective demolition. When permitted by Architect, items may be removed to a suitable, protected storage location during selective demolition, cleaned and reinstalled in their original locations after selective demolition operations are complete.

### **3.5 SELECTIVE DEMOLITION PROCEDURES FOR SPECIFIC MATERIALS**

- A. Concrete Slabs-on-Grade: Saw-cut perimeter of area to be demolished, and then break up and remove.

### **3.6 DISPOSAL OF DEMOLISHED MATERIALS**

- A. Remove demolition waste materials from Project site and dispose of them in an EPA-approved construction and demolition waste landfill acceptable to authorities having jurisdiction.
  1. Do not allow demolished materials to accumulate on-site.
  2. Remove and transport debris in a manner that will prevent spillage on adjacent surfaces and areas.
  3. Remove debris from elevated portions of building by chute, hoist, or other device that will convey debris to grade level in a controlled descent.
- B. Burning: Do not burn demolished materials.

### **3.7 CLEANING**

- A. Clean adjacent structures and improvements of dust, dirt, and debris caused by selective demolition operations. Return adjacent areas to condition existing before selective demolition operations began.

**END OF SECTION 024119**

## **SECTION 033000 - CAST-IN-PLACE CONCRETE**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section includes cast-in-place concrete, including formwork, reinforcement, concrete materials, mixture design, placement procedures, and finishes.

#### **1.3 DEFINITIONS**

- A. Cementitious Materials: Portland cement alone or in combination with one or more of the following: blended hydraulic cement, fly ash, slag cement, other pozzolans, and silica fume; materials subject to compliance with requirements.
- B. W/C Ratio: The ratio by weight of water to cementitious materials.

#### **1.4 PREINSTALLATION MEETINGS**

1. Before submitting design mixtures, review concrete design mixture and examine procedures for ensuring quality of concrete materials. Require representatives of each entity directly concerned with cast-in-place concrete to attend, including the following:
  - a. Contractor's superintendent.
  - b. Independent testing agency responsible for concrete design mixtures.
  - c. Ready-mix concrete manufacturer.
  - d. Concrete Subcontractor.
2. Review special inspection and testing and inspecting agency procedures for field quality control, concrete finishes and finishing, cold- and hot-weather concreting procedures, curing procedures, construction contraction and isolation joints, and joint-filler strips, semirigid joint fillers, forms and form removal limitations, shoring and reshoring procedures, vapor-retarder installation, anchor rod and anchorage device installation tolerances, steel reinforcement installation, methods for achieving specified floor and slab flatness and levelness, floor and slab flatness and levelness measurement, and concrete protection.

## 1.5 ACTION SUBMITTALS

- A. Product Data: For each type of product.
- B. Design Mixtures: For each concrete mixture. Submit alternate design mixtures when characteristics of materials, Project conditions, weather, test results, or other circumstances warrant adjustments.
  - 1. Indicate amounts of mixing water to be withheld for later addition at Project site.
- C. Steel Reinforcement Shop Drawings: Placing Drawings that detail fabrication, bending, and placement. Include bar sizes, lengths, material, grade, bar schedules, stirrup spacing, bent bar diagrams, bar arrangement, splices and laps, mechanical connections, tie spacing, hoop spacing, and supports for concrete reinforcement.
- D. Construction Joint Layout: Indicate proposed construction joints required to construct the structure.
  - 1. Location of construction joints is subject to approval of the Architect.

## 1.6 INFORMATIONAL SUBMITTALS

- A. Qualification Data: For Installer
- B. Welding certificates.
- C. Material Certificates: For each of the following, signed by manufacturers:
  - 1. Cementitious materials.
  - 2. Admixtures.
  - 3. Form materials and form-release agents.
  - 4. Steel reinforcement and accessories.
  - 5. Curing compounds.
  - 6. Floor and slab treatments.
  - 7. Adhesives.
  - 8. Vapor retarders.
  - 9. Semirigid joint filler.
  - 10. Joint-filler strips.
- D. Material Test Reports: For the following, from a qualified testing agency:
  - 1. Aggregates: Include service record data indicating absence of deleterious expansion of concrete due to alkali aggregate reactivity.
- E. Formwork Shop Drawings: Prepared by or under the supervision of a qualified professional engineer, detailing fabrication, assembly, and support of formwork.
  - 1. Shoring and Reshoring: Indicate proposed schedule and sequence of stripping formwork, shoring removal, and reshoring installation and removal.

- F. Floor surface flatness and levelness measurements indicating compliance with specified tolerances.
- G. Field quality-control reports.
- H. Minutes of preinstallation conference.

### **1.7 QUALITY ASSURANCE**

- A. Installer Qualifications: A qualified installer who employs on Project personnel qualified as ACI-certified Flatwork Technician and Finisher and a supervisor who is an ACI-certified Concrete Flatwork Technician.
- B. Manufacturer Qualifications: A firm experienced in manufacturing ready-mixed concrete products and that complies with ASTM C 94/C 94M requirements for production facilities and equipment.
  - 1. Manufacturer certified according to NRMCA's "Certification of Ready Mixed Concrete Production Facilities."
- C. Testing Agency Qualifications: An independent agency, qualified according to ASTM C 1077 and ASTM E 329 for testing indicated.
  - 1. Personnel conducting field tests shall be qualified as ACI Concrete Field Testing Technician, Grade 1, according to ACI CP-1 or an equivalent certification program.
  - 2. Personnel performing laboratory tests shall be ACI-certified Concrete Strength Testing Technician and Concrete Laboratory Testing Technician, Grade I. Testing agency laboratory supervisor shall be an ACI-certified Concrete Laboratory Testing Technician, Grade II.

### **1.8 PRECONSTRUCTION TESTING**

- A. Preconstruction Testing Service: Contractor shall engage a qualified testing agency to perform preconstruction testing on concrete mixtures.

### **1.9 DELIVERY, STORAGE, AND HANDLING**

- A. Steel Reinforcement: Deliver, store, and handle steel reinforcement to prevent bending and damage. Avoid damaging coatings on steel reinforcement.

### **1.10 FIELD CONDITIONS**

- A. Cold-Weather Placement: Comply with ACI 306.1 and as follows. Protect concrete work from physical damage or reduced strength that could be caused by frost, freezing actions, or low temperatures.

1. When average high and low temperature is expected to fall below 40 deg F for three successive days, maintain delivered concrete mixture temperature within the temperature range required by ACI 301.
2. Do not use frozen materials or materials containing ice or snow. Do not place concrete on frozen subgrade or on subgrade containing frozen materials.
3. Do not use calcium chloride, salt, or other materials containing antifreeze agents or chemical accelerators unless otherwise specified and approved in mixture designs.

B. Hot-Weather Placement: Comply with ACI 301 and as follows:

1. Maintain concrete temperature below 90 deg F at time of placement. Chilled mixing water or chopped ice may be used to control temperature, provided water equivalent of ice is calculated to total amount of mixing water. Using liquid nitrogen to cool concrete is Contractor's option.
2. Fog-spray forms, steel reinforcement, and subgrade just before placing concrete. Keep subgrade uniformly moist without standing water, soft spots, or dry areas.

## **PART 2 - PRODUCTS**

### **2.1 CONCRETE, GENERAL**

A. ACI Publications: Comply with the following unless modified by requirements in the Contract Documents:

1. ACI 301.
2. ACI 117.

### **2.2 FORM-FACING MATERIALS**

A. Smooth-Formed Finished Concrete: Form-facing panels that provide continuous, true, and smooth concrete surfaces. Furnish in largest practicable sizes to minimize number of joints.

1. Plywood, metal, or other approved panel materials.
2. Exterior-grade plywood panels, suitable for concrete forms, complying with DOC PS 1, and as follows:
  - a. High-density overlay, Class 1 or better.
  - b. Medium-density overlay, Class 1 or better; mill-release agent treated and edge sealed.
  - c. Structural 1, B-B or better; mill oiled and edge sealed.
  - d. B-B (Concrete Form), Class 1 or better; mill oiled and edge sealed.
3. Overlaid Finnish birch plywood.

B. Rough-Formed Finished Concrete: Plywood, lumber, metal, or another approved material. Provide lumber dressed on at least two edges and one side for tight fit.



- C. Pan-Type Forms: Glass-fiber-reinforced plastic or formed steel, stiffened to resist plastic concrete loads without detrimental deformation.
- D. Void Forms: Biodegradable paper surface, treated for moisture resistance, structurally sufficient to support weight of plastic concrete and other superimposed loads.
- E. Chamfer Strips: Wood, metal, PVC, or rubber strips, 3/4 by 3/4 inch, minimum.
- F. Form-Release Agent: Commercially formulated form-release agent that does not bond with, stain, or adversely affect concrete surfaces and does not impair subsequent treatments of concrete surfaces.
  - 1. Formulate form-release agent with rust inhibitor for steel form-facing materials.
- G. Form Ties: Factory-fabricated, removable or snap-off glass-fiber-reinforced plastic or metal form ties designed to resist lateral pressure of fresh concrete on forms and to prevent spalling of concrete on removal.
  - 1. Furnish units that leave no corrodible metal closer than 1 inch to the plane of exposed concrete surface.
  - 2. Furnish ties that, when removed, leave holes no larger than 1 inch in diameter in concrete surface.
  - 3. Furnish ties with integral water-barrier plates to walls indicated to receive dampproofing or waterproofing.

### **2.3 STEEL REINFORCEMENT**

- A. Reinforcing Bars: ASTM A 615, Grade 60, deformed.
- B. Plain-Steel Welded-Wire Reinforcement: ASTM A 1064, plain, fabricated from as-drawn steel wire into flat sheets.
- C. Deformed-Steel Welded-Wire Reinforcement: ASTM A 1064, flat sheet.

### **2.4 REINFORCEMENT ACCESSORIES**

- A. Joint Dowel Bars: ASTM A 615, Grade 60, plain-steel bars, cut true to length with ends square and free of burrs.
- B. Bar Supports: Bolsters, chairs, spacers, and other devices for spacing, supporting, and fastening reinforcing bars and welded-wire reinforcement in place. Manufacture bar supports from steel wire, plastic, or precast concrete according to CRSI's "Manual of Standard Practice," of greater compressive strength than concrete and as follows:
  - 1. For concrete surfaces exposed to view, where legs of wire bar supports contact forms, use CRSI Class 1 plastic-protected steel wire or CRSI Class 2 stainless-steel bar supports.

## 2.5 CONCRETE MATERIALS

- A. Source Limitations: Obtain each type or class of cementitious material of the same brand from the same manufacturer's plant, obtain aggregate from single source, and obtain admixtures from single source from single manufacturer.
- B. Cementitious Materials:
  - 1. Portland Cement: ASTM C 150, Type I/II.
- C. Normal-Weight Aggregates: ASTM C 33, class 4S coarse aggregate or better, graded. Provide aggregates from a single source.
  - 1. Coarse Aggregate: AASHTO #57.
  - 2. Fine Aggregate: Free of materials with deleterious reactivity to alkali in cement.
- D. Air-Entraining Admixture: ASTM C 260.
- E. Chemical Admixtures: Certified by manufacturer to be compatible with other admixtures and that do not contribute water-soluble chloride ions exceeding those permitted in hardened concrete. Do not use calcium chloride or admixtures containing calcium chloride.
  - 1. Water-Reducing Admixture: ASTM C 494, Type A.
  - 2. Retarding Admixture: ASTM C 494, Type B.
  - 3. Water-Reducing and Retarding Admixture: ASTM C 494, Type D.
  - 4. High-Range, Water-Reducing Admixture: ASTM C 494, Type F.
  - 5. High-Range, Water-Reducing and Retarding Admixture: ASTM C 494, Type G.
  - 6. Plasticizing and Retarding Admixture: ASTM C 1017, Type II.
- F. Water: ASTM C 94 and potable.

## 2.6 INJECTABLE ANCHORING ADHESIVES

- A. Two-component, high-strength, fast-cure, injectable structural adhesive designed to anchor reinforcing bars and threaded rods into normal weight, hardened concrete. Rated for 130° maximum short-term temperature, and 110° maximum long-term temperature.

## 2.7 VAPOR RETARDERS

- A. Sheet Vapor Retarder: Polyethylene sheet, ASTM D 4397, not less than 10 mils thick.

## 2.8 CURING MATERIALS

- A. Evaporation Retarder: Waterborne, monomolecular film forming, manufactured for application to fresh concrete.
- B. Absorptive Cover: AASHTO M 182, Class 2, burlap cloth made from jute or kenaf, weighing approximately 9 oz./sq. yd. (305 g/sq. m) when dry.

- C. Moisture-Retaining Cover: ASTM C 171, polyethylene film or white burlap-polyethylene sheet.
- D. Water: Potable.
- E. Clear, Waterborne, Membrane-Forming Curing Compound: ASTM C 309, Type 1, Class B, dissipating.

## **2.9 RELATED MATERIALS**

- A. Expansion- and Isolation-Joint-Filler Strips: ASTM D 1751, asphalt-saturated cellulosic fiber.

## **2.10 CONCRETE MIXTURES, GENERAL**

- A. Prepare design mixtures for each type and strength of concrete, proportioned on the basis of laboratory trial mixture or field test data, or both, according to ACI 301.
  - 1. Use a qualified independent testing agency for preparing and reporting proposed mixture designs based on laboratory trial mixtures.
- B. Cementitious Materials: Cementitious materials should be limited to portland cement.
- C. Limit water-soluble, chloride-ion content in hardened concrete to 0.06 percent by weight of cement.
- D. Admixtures: Use admixtures according to manufacturer's written instructions.
  - 1. Use water-reducing admixture in concrete, as required, for placement and workability.
  - 2. Use water-reducing and -retarding admixture when required by high temperatures, low humidity, or other adverse placement conditions.
  - 3. Use water-reducing admixture in pumped concrete, concrete for heavy-use industrial slabs and parking structure slabs, concrete required to be watertight, and concrete with a w/c ratio below 0.50.
  - 4. Use corrosion-inhibiting admixture in concrete mixtures where indicated.

## **2.11 CONCRETE MIXTURES FOR BUILDING ELEMENTS**

- A. Footings: Normal-weight concrete.
  - 1. Minimum Compressive Strength: 3000 psi at 28 days.
  - 2. Minimum Portland Cement Content: 470 lbs./cu. yd.
  - 3. Slump Limit: 8 inches for concrete with verified slump of 4 inches before adding water-reducing admixture, plus or minus 1 inch.
- B. Interior slabs-on-Grade: Normal-weight concrete.
  - 1. Minimum Compressive Strength: 3000 psi at 28 days.
  - 2. Minimum Portland Cement Content: 470 lbs./cu. yd.

3. Slump Limit: 8 inches for concrete with verified slump of 4 inches before adding water-reducing admixture, plus or minus 1 inch.
  4. Air Content: Do not allow air content of trowel-finished floors to exceed 3 percent.
- C. Exterior slabs-on-Grade: Normal-weight concrete.
1. Minimum Compressive Strength: 4000 psi at 28 days.
  2. Minimum Portland Cement Content: 611 lbs./cu. yd.
  3. Slump Limit: 8 inches for concrete with verified slump of 4 inches before adding water-reducing admixture, plus or minus 1 inch.
  4. Air Content: 5.5 percent, plus or minus 1.5 percent at point of delivery for 1-1/2-inch nominal maximum aggregate size.

## **2.12 FABRICATING REINFORCEMENT**

- A. Fabricate steel reinforcement according to CRSI's "Manual of Standard Practice."

## **2.13 CONCRETE MIXING**

- A. Ready-Mixed Concrete: Measure, batch, mix, and deliver concrete according to ASTM C 94, and furnish batch ticket information.
1. When air temperature is between 85 and 90 deg F, reduce mixing and delivery time from 1-1/2 hours to 75 minutes; when air temperature is above 90 deg F, reduce mixing and delivery time to 60 minutes.
- B. Project-Site Mixing: Measure, batch, and mix concrete materials and concrete according to ASTM C 94/C 94M. Mix concrete materials in appropriate drum-type batch machine mixer.
1. For mixer capacity of 1 cu. yd. or smaller, continue mixing at least 1-1/2 minutes, but not more than 5 minutes after ingredients are in mixer, before any part of batch is released.
  2. For mixer capacity larger than 1 cu. yd., increase mixing time by 15 seconds for each additional 1 cu. yd.
  3. Provide batch ticket for each batch discharged and used in the Work, indicating Project identification name and number, date, mixture type, mixture time, quantity, and amount of water added. Record approximate location of final deposit in structure.

## **PART 3 - EXECUTION**

### **3.1 FORMWORK INSTALLATION**

- A. Design, erect, shore, brace, and maintain formwork, according to ACI 301, to support vertical, lateral, static, and dynamic loads, and construction loads that might be applied, until structure can support such loads.
- B. Construct formwork so concrete members and structures are of size, shape, alignment, elevation, and position indicated, within tolerance limits of ACI 117.

- C. Limit concrete surface irregularities, designated by ACI 347 as abrupt or gradual, as follows:
  - 1. Class A, 1/8 inch for smooth-formed finished surfaces.
  - 2. Class C, 1/2 inch for rough-formed finished surfaces.
- D. Construct forms tight enough to prevent loss of concrete mortar.
- E. Construct forms for easy removal without hammering or prying against concrete surfaces. Provide crush or wrecking plates where stripping may damage cast-concrete surfaces. Provide top forms for inclined surfaces steeper than 1.5 horizontal to 1 vertical.
  - 1. Install keyways, reglets, recesses, and the like, for easy removal.
  - 2. Do not use rust-stained steel form-facing material.
- F. Set edge forms, bulkheads, and intermediate screed strips for slabs to achieve required elevations and slopes in finished concrete surfaces. Provide and secure units to support screed strips; use strike-off templates or compacting-type screeds.
- G. Provide temporary openings for cleanouts and inspection ports where interior area of formwork is inaccessible. Close openings with panels tightly fitted to forms and securely braced to prevent loss of concrete mortar. Locate temporary openings in forms at inconspicuous locations.
- H. Chamfer exterior corners and edges of permanently exposed concrete.
- I. Form openings, chases, offsets, sinkages, keyways, reglets, blocking, screeds, and bulkheads required in the Work. Determine sizes and locations from trades providing such items.
- J. Clean forms and adjacent surfaces to receive concrete. Remove chips, wood, sawdust, dirt, and other debris just before placing concrete.
- K. Retighten forms and bracing before placing concrete, as required, to prevent mortar leaks and maintain proper alignment.
- L. Coat contact surfaces of forms with form-release agent, according to manufacturer's written instructions, before placing reinforcement.

### **3.2 EMBEDDED ITEM INSTALLATION**

- A. Place and secure anchorage devices and other embedded items required for adjoining work that is attached to or supported by cast-in-place concrete. Use setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
  - 1. Install anchor rods, accurately located, to elevations required and complying with tolerances in Section 7.5 of AISC 303.
  - 2. Install reglets to receive waterproofing and to receive through-wall flashings in outer face of concrete frame at exterior walls, where flashing is shown at lintels, shelf angles, and other conditions.
  - 3. Install dovetail anchor slots in concrete structures as indicated.

### **3.3 REMOVING AND REUSING FORMS**

- A. General: Formwork for sides of beams, walls, columns, and similar parts of the Work that does not support weight of concrete may be removed after cumulatively curing at not less than 50 deg F for 24 hours after placing concrete. Concrete has to be hard enough to not be damaged by form-removal operations, and curing and protection operations need to be maintained.
- B. Clean and repair surfaces of forms to be reused in the Work. Split, frayed, delaminated, or otherwise damaged form-facing material are not acceptable for exposed surfaces. Apply new form-release agent.
- C. When forms are reused, clean surfaces, remove fins and laitance, and tighten to close joints. Align and secure joints to avoid offsets. Do not use patched forms for exposed concrete surfaces unless approved by Architect.

### **3.4 VAPOR-RETARDER INSTALLATION**

- A. Sheet Vapor Retarders: Place, protect, and repair sheet vapor retarder according to ASTM E 1643 and manufacturer's written instructions.
  - 1. Lap joints 6 inches and seal with manufacturer's recommended tape.
- B. Bituminous Vapor Retarders: Place, protect, and repair bituminous vapor retarder according to manufacturer's written instructions.

### **3.5 STEEL REINFORCEMENT INSTALLATION**

- A. General: Comply with CRSI's "Manual of Standard Practice" for fabricating, placing, and supporting reinforcement.
  - 1. Do not cut or puncture vapor retarder. Repair damage and reseal vapor retarder before placing concrete.
- B. Clean reinforcement of loose rust and mill scale, earth, ice, and other foreign materials that reduce bond to concrete.
- C. Accurately position, support, and secure reinforcement against displacement. Locate and support reinforcement with bar supports to maintain minimum concrete cover. Do not tack weld crossing reinforcing bars.
- D. Set wire ties with ends directed into concrete, not toward exposed concrete surfaces.
- E. Install welded-wire reinforcement in longest practicable lengths on bar supports spaced to minimize sagging. Lap edges and ends of adjoining sheets at least one mesh spacing. Offset laps of adjoining sheet widths to prevent continuous laps in either direction. Lace overlaps with wire.

### 3.6 JOINTS

- A. General: Construct joints true to line with faces perpendicular to surface plane of concrete.
- B. Construction Joints: Install so strength and appearance of concrete are not impaired, at locations indicated or as approved by Architect.
  - 1. Place joints perpendicular to main reinforcement. Continue reinforcement across construction joints unless otherwise indicated. Do not continue reinforcement through sides of strip placements of floors and slabs.
  - 2. Form keyed joints as indicated. Embed keys at least 1-1/2 inches into concrete.
  - 3. Use a bonding agent at locations where fresh concrete is placed against hardened or partially hardened concrete surfaces.
- C. Contraction Joints in Slabs-on-Grade: Form weakened-plane contraction joints, sectioning concrete into areas as indicated. Construct contraction joints for a depth equal to at least one-fourth of concrete thickness as follows:
  - 1. Grooved Joints: Form contraction joints after initial floating by grooving and finishing each edge of joint to a radius of 1/8 inch. Repeat grooving of contraction joints after applying surface finishes. Eliminate groover tool marks on concrete surfaces.
  - 2. Sawed Joints: Form contraction joints with power saws equipped with shatterproof abrasive or diamond-rimmed blades. Cut 1/8-inch- wide joints into concrete when cutting action does not tear, abrade, or otherwise damage surface and before concrete develops random contraction cracks.
- D. Isolation Joints in Slabs-on-Grade: After removing formwork, install joint-filler strips at slab junctions with vertical surfaces, such as column pedestals, foundation walls, grade beams, and other locations, as indicated.
  - 1. Extend joint-filler strips full width and depth of joint, terminating flush with finished concrete surface unless otherwise indicated.
  - 2. Terminate full-width joint-filler strips not less than 1/2 inch or more than 1 inch below finished concrete surface where joint sealants, specified in Section 079200 "Joint Sealants," are indicated.
  - 3. Install joint-filler strips in lengths as long as practicable. Where more than one length is required, lace or clip sections together.
- E. Doweled Joints: Install dowel bars and support assemblies at joints where indicated. Lubricate or asphalt coat one-half of dowel length to prevent concrete bonding to one side of joint.

### 3.7 CONCRETE PLACEMENT

- A. Before placing concrete, verify that installation of formwork, reinforcement, and embedded items is complete and that required inspections are completed.
- B. Do not add water to concrete during delivery, at Project site, or during placement unless approved by Architect.

- C. Before test sampling and placing concrete, water may be added at Project site, subject to limitations of ACI 301.
  - 1. Do not add water to concrete after adding water-reducing admixtures to mixture.
- D. Deposit concrete continuously in one layer or in horizontal layers of such thickness that no new concrete is placed on concrete that has hardened enough to cause seams or planes of weakness. If a section cannot be placed continuously, provide construction joints as indicated. Deposit concrete to avoid segregation.
  - 1. Deposit concrete in horizontal layers of depth not to exceed formwork design pressures and in a manner to avoid inclined construction joints.
  - 2. Consolidate placed concrete with mechanical vibrating equipment according to ACI 301.
  - 3. Do not use vibrators to transport concrete inside forms. Insert and withdraw vibrators vertically at uniformly spaced locations to rapidly penetrate placed layer and at least 6 inches into preceding layer. Do not insert vibrators into lower layers of concrete that have begun to lose plasticity. At each insertion, limit duration of vibration to time necessary to consolidate concrete and complete embedment of reinforcement and other embedded items without causing mixture constituents to segregate.
- E. Deposit and consolidate concrete for floors and slabs in a continuous operation, within limits of construction joints, until placement of a panel or section is complete.
  - 1. Consolidate concrete during placement operations, so concrete is thoroughly worked around reinforcement and other embedded items and into corners.
  - 2. Maintain reinforcement in position on chairs during concrete placement.
  - 3. Screenshot slab surfaces with a straightedge and strike off to correct elevations.
  - 4. Slope surfaces uniformly to drains where required.
  - 5. Begin initial floating using bull floats or darbies to form a uniform and open-textured surface plane, before excess bleedwater appears on the surface. Do not further disturb slab surfaces before starting finishing operations.

### **3.8 FINISHING FORMED SURFACES**

- A. Rough-Formed Finish: As-cast concrete texture imparted by form-facing material with tie holes and defects repaired and patched. Remove fins and other projections that exceed specified limits on formed-surface irregularities.
  - 1. Apply to concrete surfaces not exposed to public view.
- B. Related Unformed Surfaces: At tops of walls, horizontal offsets, and similar unformed surfaces adjacent to formed surfaces, strike off smooth and finish with a texture matching adjacent formed surfaces. Continue final surface treatment of formed surfaces uniformly across adjacent unformed surfaces unless otherwise indicated.



### **3.9 FINISHING FLOORS AND SLABS**

- A. General: Comply with ACI 302.1R recommendations for screeding, restraightening, and finishing operations for concrete surfaces. Do not wet concrete surfaces.
- B. Trowel Finish: After applying float finish, apply first troweling and consolidate concrete by hand or power-driven trowel. Continue troweling passes and restraighten until surface is free of trowel marks and uniform in texture and appearance. Grind smooth any surface defects that would telegraph through applied coatings or floor coverings.
  - 1. Apply a trowel finish to surfaces exposed to view.
  - 2. Finish surfaces to the following tolerances, according to ASTM E 1155, for a randomly trafficked floor surface:
    - a. Specified overall values of flatness, F(F) 35; and of levelness, F(L) 25; with minimum local values of flatness, F(F) 24; and of levelness, F(L) 17; for slabs-on-grade.
  - 3. Finish and measure surface, so gap at any point between concrete surface and an unlevelled, freestanding, 10-ft.-long straightedge resting on two high spots and placed anywhere on the surface does not exceed 1/8 inch.
- C. Broom Finish: Apply a broom finish to exterior concrete slabs.
  - 1. Immediately after float finishing, slightly roughen trafficked surface by brooming with fiber-bristle broom perpendicular to main traffic route. Coordinate required final finish with Architect before application.

### **3.10 MISCELLANEOUS CONCRETE ITEM INSTALLATION**

- A. Filling In: Fill in holes and openings left in concrete structures after work of other trades is in place unless otherwise indicated. Mix, place, and cure concrete, as specified, to blend with in-place construction. Provide other miscellaneous concrete filling indicated or required to complete the Work.

### **3.11 CONCRETE PROTECTING AND CURING**

- A. General: Protect freshly placed concrete from premature drying and excessive cold or hot temperatures. Comply with ACI 306.1 for cold-weather protection and ACI 301 for hot-weather protection during curing.
- B. Evaporation Retarder: Apply evaporation retarder to unformed concrete surfaces if hot, dry, or windy conditions cause moisture loss approaching 0.2 lb/sq. ft. x h before and during finishing operations. Apply according to manufacturer's written instructions after placing, screeding, and bull floating or darbying concrete, but before float finishing.
- C. Unformed Surfaces: Begin curing immediately after finishing concrete. Cure unformed surfaces, including floors and slabs, concrete floor toppings, and other surfaces.

- D. Cure concrete according to ACI 308.1, by one or a combination of the following methods:
1. Moisture Curing: Keep surfaces continuously moist for not less than seven days with the following materials:
    - a. Water.
    - b. Continuous water-fog spray.
    - c. Absorptive cover, water saturated, and kept continuously wet. Cover concrete surfaces and edges with 12-inch lap over adjacent absorptive covers.
  2. Moisture-Retaining-Cover Curing: Cover concrete surfaces with moisture-retaining cover for curing concrete, placed in widest practicable width, with sides and ends lapped at least 12 inches, and sealed by waterproof tape or adhesive. Cure for not less than seven days. Immediately repair any holes or tears during curing period, using cover material and waterproof tape.
    - a. Moisture cure or use moisture-retaining covers to cure concrete surfaces to receive floor coverings.
    - b. Moisture cure or use moisture-retaining covers to cure concrete surfaces to receive penetrating liquid floor treatments.
    - c. Cure concrete surfaces to receive floor coverings with either a moisture-retaining cover or a curing compound that the manufacturer certifies does not interfere with bonding of floor covering used on Project.
  3. Curing Compound: Apply uniformly in continuous operation by power spray or roller according to manufacturer's written instructions. Recoat areas subjected to heavy rainfall within three hours after initial application. Maintain continuity of coating and repair damage during curing period.
    - a. Removal: After curing period has elapsed, remove curing compound without damaging concrete surfaces by method recommended by curing compound manufacturer.
  4. Curing and Sealing Compound: Apply uniformly to floors and slabs indicated in a continuous operation by power spray or roller according to manufacturer's written instructions. Recoat areas subjected to heavy rainfall within three hours after initial application. Repeat process 24 hours later and apply a second coat. Maintain continuity of coating and repair damage during curing period.

### 3.12 LIQUID FLOOR TREATMENT APPLICATION

- A. Penetrating Liquid Floor Treatment: Prepare, apply, and finish penetrating liquid floor treatment according to manufacturer's written instructions.
1. Remove curing compounds, sealers, oil, dirt, laitance, and other contaminants and complete surface repairs.
  2. Do not apply to concrete that is less than 14 days' old.

3. Apply liquid until surface is saturated, scrubbing into surface until a gel forms; rewet; and repeat brooming or scrubbing. Rinse with water; remove excess material until surface is dry. Apply a second coat in a similar manner if surface is rough or porous.
- B. Sealing Coat: Uniformly apply a continuous sealing coat of curing and sealing compound to hardened concrete by power spray or roller according to manufacturer's written instructions.

### **3.13 JOINT FILLING**

- A. Prepare, clean, and install joint filler according to manufacturer's written instructions.
1. Defer joint filling until concrete has aged at least one month(s). Do not fill joints until construction traffic has permanently ceased.
- B. Remove dirt, debris, saw cuttings, curing compounds, and sealers from joints; leave contact faces of joints clean and dry.
- C. Install semirigid joint filler full depth in saw-cut joints and at least 2 inches deep in formed joints. Overfill joint and trim joint filler flush with top of joint after hardening.

### **3.14 CONCRETE SURFACE REPAIRS**

- A. Defective Concrete: Repair and patch defective areas when approved by Architect. Remove and replace concrete that cannot be repaired and patched to Architect's approval.
- B. Patching Mortar: Mix dry-pack patching mortar, consisting of 1 part portland cement to 2-1/2 parts fine aggregate passing a No. 16 sieve, using only enough water for handling and placing.
- C. Repairing Formed Surfaces: Surface defects include cracks, spalls, air bubbles, honeycombs, rock pockets, fins and other projections on the surface.
1. Immediately after form removal, cut out honeycombs, rock pockets, and voids more than 1/2 inch in any dimension to solid concrete. Limit cut depth to 3/4 inch. Make edges of cuts perpendicular to concrete surface. Clean, dampen with water, and brush-coat holes and voids with bonding agent. Fill and compact with patching mortar before bonding agent has dried. Fill form-tie voids with patching mortar or cone plugs secured in place with bonding agent.
  2. Repair defects on concealed formed surfaces that affect concrete's durability and structural performance as determined by Architect.
- D. Repairing Unformed Surfaces: Test unformed surfaces, such as floors and slabs, for finish and verify surface tolerances specified for each surface. Correct low and high areas. Test surfaces sloped to drain for trueness of slope and smoothness; use a sloped template.
1. Repair finished surfaces containing defects. Surface defects include spalls, popouts, honeycombs, rock pockets, crazing and cracks in excess of 0.01 inch wide or that penetrate to reinforcement or completely through unreinforced sections regardless of width, and other objectionable conditions.

2. After concrete has cured at least 14 days, correct high areas by grinding.
  3. Correct localized low areas during or immediately after completing surface finishing operations by cutting out low areas and replacing with patching mortar. Finish repaired areas to blend into adjacent concrete.
  4. Correct other low areas scheduled to receive floor coverings with a repair underlayment. Prepare, mix, and apply repair underlayment and primer according to manufacturer's written instructions to produce a smooth, uniform, plane, and level surface. Feather edges to match adjacent floor elevations.
  5. Correct other low areas scheduled to remain exposed with a repair topping. Cut out low areas to ensure a minimum repair topping depth of 1/4 inch to match adjacent floor elevations. Prepare, mix, and apply repair topping and primer according to manufacturer's written instructions to produce a smooth, uniform, plane, and level surface.
  6. Repair defective areas, except random cracks and single holes 1 inch or less in diameter, by cutting out and replacing with fresh concrete. Remove defective areas with clean, square cuts and expose steel reinforcement with at least a 3/4-inch clearance all around. Dampen concrete surfaces in contact with patching concrete and apply bonding agent. Mix patching concrete of same materials and mixture as original concrete, except without coarse aggregate. Place, compact, and finish to blend with adjacent finished concrete. Cure in same manner as adjacent concrete.
  7. Repair random cracks and single holes 1 inch or less in diameter with patching mortar. Groove top of cracks and cut out holes to sound concrete and clean off dust, dirt, and loose particles. Dampen cleaned concrete surfaces and apply bonding agent. Place patching mortar before bonding agent has dried. Compact patching mortar and finish to match adjacent concrete. Keep patched area continuously moist for at least 72 hours.
- E. Perform structural repairs of concrete, subject to Architect's approval, using epoxy adhesive and patching mortar.
- F. Repair materials and installation not specified above may be used, subject to Architect's approval.

### **3.15 FIELD QUALITY CONTROL**

- A. Special Inspections: Contractor shall engage a special inspector and qualified testing and inspecting agency to perform field tests and inspections and prepare test reports.
- B. Testing Agency: Engage a qualified testing and inspecting agency to perform tests and inspections and to submit reports.
- C. Inspections:
1. Steel reinforcement placement.
  2. Headed bolts and studs.
  3. Verification of use of required design mixture.
  4. Concrete placement, including conveying and depositing.
  5. Curing procedures and maintenance of curing temperature.
- D. Concrete Tests: Testing of composite samples of fresh concrete obtained according to ASTM C 172 shall be performed according to the following requirements:

1. Testing Frequency: Obtain one composite sample for each day's pour of each concrete mixture exceeding 5 cu. yd., but less than 25 cu. yd., plus one set for each additional 50 cu. yd. or fraction thereof.
2. Testing Frequency: Obtain at least one composite sample for each 100 cu. yd. or fraction thereof of each concrete mixture placed each day.
  - a. When frequency of testing provides fewer than five compressive-strength tests for each concrete mixture, testing shall be conducted from at least five randomly selected batches or from each batch if fewer than five are used.
3. Slump: ASTM C 143; one test at point of placement for each composite sample, but not less than one test for each day's pour of each concrete mixture. Perform additional tests when concrete consistency appears to change.
4. Air Content: ASTM C 231, pressure method, for normal-weight concrete; one test for each composite sample, but not less than one test for each day's pour of each concrete mixture.
5. Concrete Temperature: ASTM C 1064; one test hourly when air temperature is 40 deg F and below or 80 deg F and above, and one test for each composite sample.
6. Compression Test Specimens: ASTM C 31.
  - a. Cast and laboratory cure two sets of two standard cylinder specimens for each composite sample.
  - b. Cast and field cure two sets of two standard cylinder specimens for each composite sample.
7. Compressive-Strength Tests: ASTM C 39; test one set of two laboratory-cured specimens at 7 days and one set of two specimens at 28 days.
  - a. Test one set of two field-cured specimens at 7 days and one set of two specimens at 28 days.
  - b. A compressive-strength test shall be the average compressive strength from a set of two specimens obtained from same composite sample and tested at age indicated.
8. When strength of field-cured cylinders is less than 85 percent of companion laboratory-cured cylinders, Contractor shall evaluate operations and provide corrective procedures for protecting and curing in-place concrete.
9. Strength of each concrete mixture will be satisfactory if every average of any three consecutive compressive-strength tests equals or exceeds specified compressive strength and no compressive-strength test value falls below specified compressive strength by more than 500 psi.
10. Test results shall be reported in writing to Architect, concrete manufacturer, and Contractor within 48 hours of testing. Reports of compressive-strength tests shall contain Project identification name and number, date of concrete placement, name of concrete testing and inspecting agency, location of concrete batch in Work, design compressive strength at 28 days, concrete mixture proportions and materials, compressive breaking strength, and type of break for both 7- and 28-day tests.
11. Nondestructive Testing: Impact hammer, sonoscope, or other nondestructive device may be permitted by Architect but will not be used as sole basis for approval or rejection of concrete.

12. Additional Tests: Testing and inspecting agency shall make additional tests of concrete when test results indicate that slump, air entrainment, compressive strengths, or other requirements have not been met, as directed by Architect. Testing and inspecting agency may conduct tests to determine adequacy of concrete by cored cylinders complying with ASTM C 42 or by other methods as directed by Architect.
  13. Additional testing and inspecting, at Contractor's expense, will be performed to determine compliance of replaced or additional work with specified requirements.
  14. Correct deficiencies in the Work that test reports and inspections indicate do not comply with the Contract Documents.
- E. Measure floor and slab flatness and levelness according to ASTM E 1155 within 48 hours of finishing.

### **3.16 PROTECTION OF LIQUID FLOOR TREATMENTS**

- A. Protect liquid floor treatment from damage and wear during the remainder of construction period. Use protective methods and materials, including temporary covering, recommended in writing by liquid floor treatments installer.

**END OF SECTION 033000**

## **SECTION 079200 -JOINT SEALANTS**

### **PART 1 - GENERAL**

#### **1.1 SUMMARY**

- A. Section Includes:
  - 1. Silicone joint sealants.
  - 2. Latex joint sealants.
  - 3. Solvent-Release sealants.

#### **1.2 PRECONSTRUCTION TESTING**

- A. Preconstruction Compatibility and Adhesion Testing: Submit to joint-sealant manufacturers eight samples of materials that will contact or affect joint sealants. Use ASTM C 1087 to determine whether priming and other specific joint preparation techniques are required to obtain rapid, optimum adhesion of joint sealants to joint substrates.
- B. Preconstruction Field-Adhesion Testing: Before installing sealants, field test their adhesion to Project joint substrates. Test joint sealants according to Method A, Field-Applied Sealant Joint Hand Pull Tab, in Appendix X1 in ASTM C 1193 or Method A, Tail Procedure, in ASTM C 1521.

#### **1.3 SUBMITTALS**

- A. Product Data: For each joint-sealant product indicated.
  - 1. Joint-sealant manufacturer and product name.
- B. Product test reports.
- C. Warranties.

#### **1.4 DELIVERY, STORAGE, AND HANDLING**

- A. Deliver materials to Project site in original unopened containers or bundles with labels indicating manufacturer, product name and designation, color, expiration date, pot life, curing time, and mixing instructions for multicomponent materials.
- B. Store and handle materials in compliance with manufacturer's written instructions to prevent their deterioration or damage due to moisture, high or low temperatures, contaminants, or other causes.

#### **1.5 PROJECT CONDITIONS**

- A. Environmental Limitations: Do not proceed with installation of joint sealants under the following conditions:
  - 1. When ambient and substrate temperature conditions are outside limits permitted by joint sealant manufacturer.

2. When ambient and substrate temperature conditions are outside limits permitted by joint sealant manufacturer or are below 40 deg F (4.4 deg C).
3. When joint substrates are wet.

- B. Joint-Width Conditions: Do not proceed with installation of joint sealants where joint widths are less than those allowed by joint sealant manufacturer for applications indicated.
- C. Joint-Substrate Conditions: Do not proceed with installation of joint sealants until contaminants capable of interfering with adhesion are removed from joint substrates.

## 1.6 WARRANTY

- A. Special Installer's Warranty: Manufacturer's standard form in which Installer agrees to repair or replace joint sealants that do not comply with performance and other requirements specified in this Section within specified warranty period.
1. Warranty Period: Two years from date of Substantial Completion.
- B. Special Manufacturer's Warranty: Manufacturer's standard form in which joint- sealant manufacturer agrees to furnish joint sealants to repair or replace those that do not comply with performance and other requirements specified in this Section within specified warranty period.
1. Warranty Period: Two years from date of Substantial Completion.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
1. Dow Corning Corporation. Silicon, color: charcoal
  2. Pecora Corporation.
  3. Sika Corporation; Construction Products Division.
  4. Tremco Incorporated. Acrylic latex sealant

### 2.2 MATERIALS, GENERAL

- A. Compatibility: Provide joint sealants, joint fillers, and other related materials that are compatible with one another and with joint substrates under service and application conditions. Joint sealant to have a shore hardness of 70 minimum.
1. Colors of Exposed Joint Sealants: As selected by Architect from manufacturer's standard colors.

### 2.3 SILICONE JOINT SEALANTS

- A. Elastomeric Sealants: Comply with ASTM C 920.
1. Single-component, mildew-resistant silicone sealant, Type S; Grade NS; Class 25; Uses NT, G, A, and O; formulated with fungicide. Use for interior sealant joints in



- ceramic tile, stone, and other hard surfaces in toilet rooms and around plumbing fixtures.
2. Single-component, nonsag urethane sealant, Type S; Grade NS; Class 25; and Uses NT, M, A, and O. Use at control and expansion joints in masonry and all substrate joints in contact with concrete.

### **PART 3 - EXECUTION**

#### **3.1 PREPARATION**

- A. Surface Cleaning of Joints: Clean out joints immediately before installing joint sealants to comply with joint-sealant manufacturer's written instructions.
  1. Remove laitance and form-release agents from concrete.
  2. Clean nonporous joint substrate surfaces with chemical cleaners or other means that do not stain, harm substrates, or leave residues capable of interfering with adhesion of joint sealants.
- B. Joint Priming: Prime joint substrates where recommended by joint-sealant manufacturer or as indicated by preconstruction joint-sealant-substrate tests or prior experience. Apply primer to comply with joint-sealant manufacturer's written instructions. Confine primers to areas of joint-sealant bond; do not allow spillage or migration onto adjoining surfaces.
- C. Masking Tape: Use masking tape where required to prevent contact of sealant or primer with adjoining surfaces that otherwise would be permanently stained or damaged by such contact or by cleaning methods required to remove sealant smears. Remove tape immediately after tooling without disturbing joint seal.

#### **3.2 INSTALLATION**

- A. Sealant Installation Standard: Comply with recommendations in ASTM C 1193 for use of joint sealants as applicable to materials, applications, and conditions indicated.
- B. Install sealant backings of kind indicated to support sealants during application and at position required to produce cross-sectional shapes and depths of installed sealants relative to joint widths that allow optimum sealant movement capability.
  1. Do not leave gaps between ends of sealant backings.
  2. Do not stretch, twist, puncture, or tear sealant backings.
  3. Remove absorbent sealant backings that have become wet before sealant application and replace them with dry materials.
- C. Install bond-breaker tape behind sealants where sealant backings are not used between sealants and backs of joints.
- D. Install sealants using proven techniques that comply with the following and at the same time backings are installed:
  1. Place sealants so they directly contact and fully wet joint substrates.
  2. Completely fill recesses in each joint configuration.
  3. Produce uniform, cross-sectional shapes and depths relative to joint widths that allow

optimum sealant movement capability.

- E. Tooling of Nonsag Sealants: Immediately after sealant application and before skinning or curing begins, tool sealants according to requirements specified in subparagraphs below to form smooth, uniform beads of configuration indicated; to eliminate air pockets; and to ensure contact and adhesion of sealant with sides of joint.
  - 1. Remove excess sealant from surfaces adjacent to joints.
  - 2. Use tooling agents that are approved in writing by sealant manufacturer and that do not discolor sealants or adjacent surfaces.
  - 3. Provide concave joint profile per Figure 8A in ASTM C 1193, unless otherwise indicated.
  
- F. Clean off excess sealant or sealant smears adjacent to joints as the Work progresses by methods and with cleaning materials approved in writing by manufacturers of joint sealants and of products in which joints occur.

**END OF SECTION 079200**

## **SECTION 220510 – BASIC PLUMBING REQUIREMENTS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this and the other sections of Division 22.

#### **1.2 SUMMARY**

- A. This Section includes general administrative and procedural requirements for mechanical installations. The following administrative and procedural requirements are included in this Section to expand the requirements specified in Division 1:
  - 1. Submittals
  - 2. Material and Equipment Selection
  - 3. Coordination drawings
  - 4. Record documents
  - 5. Maintenance manuals

#### **1.3 SUBMITTALS**

- A. General: Follow the procedures specified in Division 1. In addition to the requirements specified in Division 1, comply with the following:
  - 1. Increase by two (2) the quantity of copies required by Division 1 for submittals.
  - 2. Submit line-by-line specification verification for equipment other than the “basis of design” as further described in the following article “Material and Equipment Selection”.
  - 3. Prepare and submit Coordination Drawings as further described herein.
    - a. The Engineer shall receive one copy of all coordination drawings supplied to the Owner as required in this specification. It is the responsibility of the Contractor to coordinate the work as outlined herein. Receipt by the Engineer of a copy of the coordination drawings is to verify conformance to the submittal requirements set forth in this specification section. It is not an admission by the Engineer as to the accuracy or completeness of the coordination proposed.
  - 4. Provide a list of all equipment, including type and all nameplate information and where it is located. Refer to drawings for required tagging information for labeling each piece of equipment. A copy of this list shall be provided to the Owner in Microsoft Excel format, and included in the operation and maintenance manual.
  - 5. Comply with each individual Section for additional submittal requirements.

#### 1.4 MATERIAL AND EQUIPMENT SELECTION

- A. Product Options: The specification of each item of major equipment required for the project may include a list of manufacturers, with one “basis of design” manufacturer, type, and model identified by virtue of their being the first listed manufacturer in the specifications. Where several manufacturers in addition to the “basis of design” manufacturer are listed in the specifications, it shall be understood that the words “or approved equal by” are implied to precede each of the other manufacturer’s names.
- B. The manufacturers other than the “basis of design” may be furnished at the contractor’s option in lieu of the “basis of design” product, provided that the selected manufacturer’s product is equal in all material and functional respects. Additional work required for equipment that is other than the “basis of design”, shall be at the expense of the contractor. In addition to submittal requirements that may be specified in this section, submit a line-by-line written verification of the applicable specification section(s) identifying compliance with or variations from the specified features, materials, performance, capacities, weight, size, durability, energy consumption and efficiency, warranty, and visual impact (if exposed to view by other than maintenance persons). The burden of proof of manufacturer/product equality is on the contractor.
- C. Where a product is not scheduled on the drawings and, therefore, where no “basis of design” is indicated, the first listed manufacturer in the specifications shall be deemed as “basis of design”.
- D. Products of manufacturers not listed in the Contract Documents are considered Substitutions and are not permitted, except as provided under the General and Supplementary Conditions and Division 1 Specifications. Full compliance with Division 1 section “Substitution Procedures” is mandatory for acceptance of products or manufacturers not listed.
- E. Listing of a manufacturer does not imply approval of that manufacturer’s standard product or products. Rather, listing of a manufacturer indicates only a general acceptance of that manufacturer’s name and reputation. Final approval is subject to full compliance with these Contract Documents.
- F. Model numbers identified on the Drawings notwithstanding, all equipment must comply with the requirements of these Contract Documents. Do not assume that a manufacturer’s standard product is acceptable as is. For example, one or more custom modifications, custom colors or finishes, manufacturer’s options, and/or accessories may be required to meet the specified requirements.
- G. Where drawings indicate sizes, profiles, connections, and dimensional requirements of material and equipment, these are based on the “basis of design” manufacturer, type and model indicated. In the event that equipment of power, dimensions, capacities, layout, connections, and/or ratings differing from the “basis of design” are selected by the contractor and approved by the Owner’s representative, any necessary adjustments are the contractor’s responsibility. All connecting mechanical and electrical services, circuit breakers, conduit, motors, bases, pipe and duct sizes, pipe and duct layout, and the like shall be adjusted by the contractor to suit the equipment provided. No additional costs will be approved for these changes. Should revisions to the design because of

contractor's selection of manufacturer, type, or model other than the "basis of design" require additional review and/or redesign by an Architect or Engineer, the contractor shall reimburse the Owner for Owner's added professional fee expenses.

- H. Where two or more materials are listed in the "Part 2 – Products" subsection of any Division 22 section, do not assume that the selection of materials is the contractor's option. Refer to "Part 3 – Execution" subsection of that same Division 22 section for an explanation of which specific material(s) shall be used for which specific application(s). For example, Part 2 may list several types and grades of piping, and Part 3 will describe which type and grade of pipe to use for a given application.
- I. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems, and have been coordinated, as much as possible, based on available information and field observations. Deviations to layout that may require additional fittings, and are within 6'-0" of design document layout, shall be at the expense of the contractor. Deviations to layout shall be documented on the coordination drawings. Indicated locations and arrangements were used to size pipe and calculate friction loss, expansion, pump sizing, and other design considerations. Install piping as indicated, unless deviations to layout are approved on Coordination Drawings.

## **1.5 COORDINATION DRAWINGS**

- A. Prepare project coordination drawings to a scale of  $\frac{1}{4}'' = 1'-0''$  or larger. Detail major elements, components, and systems of mechanical equipment and materials in relationship with other systems, installations, and building components. Show space requirements for installation and access. Indicate if sequence and coordination of installations are important to efficient flow of the Work.

## **1.6 RECORD DOCUMENTS**

- A. Prepare record documents in accordance with the requirements in Division 1. In addition to the requirements specified in Division 1, indicate the following installed conditions:
  - 1. Mains and branches of piping systems, with valves and control devices located and numbered, concealed unions located, and with items requiring maintenance located (i.e., traps, strainers, expansion compensators, tanks, etc.). Indicate actual inverts and horizontal locations of all underground piping.
  - 2. Valve location diagrams, complete with valve tag chart. Refer to Section 220523.
  - 3. Equipment locations (exposed and concealed), dimensioned from prominent building lines.
  - 4. Approved substitutions, Contract Modifications, and actual equipment and materials installed.
  - 5. Contract Modifications, actual equipment and materials installed.

## **1.7 MAINTENANCE MANUALS**

- A. Prepare maintenance manuals in accordance with Division 1. In addition to the requirements

specified in Division 1, include the following information for equipment items:

1. Description of function, normal operating characteristics and limitations, performance curves, engineering data and tests, and complete nomenclature and commercial numbers of replacement parts.
2. Manufacturer's printed operating procedures to include start-up, break-in, and routine and normal operating instructions; regulation, control, stopping, shutdown, and emergency instructions; and summer and winter operating instructions.
3. Maintenance procedures for routine preventative maintenance and troubleshooting; disassembly, repair, and reassembly; aligning and adjusting instructions.
4. Servicing instructions and lubrication charts and schedules.

**PART 2 - PRODUCTS (NOT APPLICABLE)**

**PART 3 - EXECUTION (NOT APPLICABLE)**

**END OF SECTION 220510**

## **SECTION 220511 – COMMON WORK RESULTS FOR PLUMBING**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes the following:
  - 1. Piping materials and installation instructions common to most piping systems.
  - 2. Transition fittings.
  - 3. Dielectric fittings.
  - 4. Mechanical sleeve seals.
  - 5. Sleeves.
  - 6. Escutcheons.
  - 7. Grout.
  - 8. Equipment installation requirements common to equipment sections.
  - 9. Painting and finishing.
  - 10. Concrete bases.
  - 11. Supports and anchorages.

#### **1.3 DEFINITIONS**

- A. Finished Spaces: Spaces other than mechanical and electrical equipment rooms, furred spaces, pipe chases, unheated spaces immediately below roof, spaces above ceilings, unexcavated spaces, crawlspaces, and tunnels.
- B. Exposed, Interior Installations: Exposed to view indoors. Examples include finished occupied spaces and mechanical equipment rooms.
- C. Exposed, Exterior Installations: Exposed to view outdoors or subject to outdoor ambient temperatures and weather conditions. Examples include rooftop locations.
- D. Concealed, Interior Installations: Concealed from view and protected from physical contact by building occupants. Examples include above ceilings and in chases.
- E. Concealed, Exterior Installations: Concealed from view and protected from weather conditions and physical contact by building occupants but subject to outdoor ambient temperatures. Examples include installations within unheated shelters.

- F. The following are industry abbreviations for plastic materials:
  - 1. ABS: Acrylonitrile-butadiene-styrene plastic.
  - 2. CPVC: Chlorinated polyvinyl chloride plastic.
  - 3. PVC: Polyvinyl chloride plastic.
  
- G. The following are industry abbreviations for rubber materials:
  - 1. EPDM: Ethylene-propylene-diene terpolymer rubber.
  - 2. NBR: Acrylonitrile-butadiene rubber.

#### **1.4 SUBMITTALS**

- A. Product Data: For the following:
  - 1. Transition fittings.
  - 2. Dielectric fittings.
  - 3. Mechanical sleeve seals.
  - 4. Escutcheons.
  
- B. Welding certificates.

#### **1.5 QUALITY ASSURANCE**

- A. Steel Support Welding: Qualify processes and operators according to AWS D1.1, "Structural Welding Code--Steel."
  
- B. Electrical Characteristics for Plumbing Equipment: Equipment of higher electrical characteristics may be furnished provided such proposed equipment is approved in writing and connecting electrical services, circuit breakers, and conduit sizes are appropriately modified. If minimum energy ratings or efficiencies are specified, equipment shall comply with requirements.

#### **1.6 DELIVERY, STORAGE, AND HANDLING**

- A. Deliver pipes and tubes with factory-applied end caps. Maintain end caps through shipping, storage, and handling to prevent pipe end damage and to prevent entrance of dirt, debris, and moisture.
  
- B. Store plastic pipes protected from direct sunlight. Support to prevent sagging and bending.



## **1.7 COORDINATION**

- A. Arrange for pipe spaces, chases, slots, and openings in building structure during progress of construction, to allow for plumbing installations.
- B. Coordinate installation of required supporting devices and set sleeves in poured-in-place concrete and other structural components as they are constructed.
- C. Coordinate requirements for access panels and doors for plumbing items requiring access that are concealed behind finished surfaces. Access panels and doors are specified in Division 8 Section "Access Doors and Frames."

## **PART 2 - PRODUCTS**

### **2.1 MANUFACTURERS**

- A. In other Part 2 articles where subparagraph titles below introduce lists, the following requirements apply for product selection:
  - 1. Manufacturers: Subject to compliance with requirements, provide products by the manufacturers specified.
  - 2. The specification of each item of major equipment required for the project may include a list of manufacturers, with one "basis of design" manufacturer, type, and model identified by virtue of their being the first listed manufacturer in the specifications.

### **2.2 PIPE, TUBE, AND FITTINGS**

- A. Refer to individual Division 22 piping Sections for pipe, tube, and fitting materials and joining methods.
- B. Pipe Threads: ASME B1.20.1 for factory-threaded pipe and pipe fittings.

### **2.3 JOINING MATERIALS**

- A. Refer to individual Division 22 piping Sections for special joining materials not listed below.
- B. Pipe-Flange Gasket Materials: Suitable for chemical and thermal conditions of piping system contents.
  - 1. ASME B16.21, nonmetallic, flat, asbestos-free, 1/8-inch maximum thickness unless thickness or specific material is indicated.
    - a. Full-Face Type: For flat-face, Class 125, cast-iron and cast-bronze flanges.
    - b. Narrow-Face Type: For raised-face, Class 250, cast-iron and steel flanges.
- C. Flange Bolts and Nuts: ASME B18.2.1, carbon steel, unless otherwise indicated.

- D. Solder Filler Metals: ASTM B 32, lead-free alloys. Include water-flushable flux according to ASTM B 813.
- E. Brazing Filler Metals: AWS A5.8, BCuP Series, copper-phosphorus alloys for general-duty brazing, unless otherwise indicated; and AWS A5.8, BAg1, silver alloy for refrigerant piping, unless otherwise indicated.
- F. Welding Filler Metals: Comply with AWS D10.12 for welding materials appropriate for wall thickness and chemical analysis of steel pipe being welded.

## 2.4 DIELECTRIC FITTINGS

- A. Description: Combination fitting of copper alloy and ferrous materials with threaded, solder-joint, plain, or weld-neck end connections that match piping system materials.
- B. Insulating Material: Suitable for system fluid, pressure, and temperature.
- C. Dielectric Unions: Factory-fabricated, union assembly, for 250-psig minimum working pressure at 180 deg F.
  - 1. Manufacturers:
    - a. Capitol Manufacturing Co.
    - b. Eclipse, Inc.
    - c. Hart Industries, International, Inc.
    - d. Watts Industries, Inc.; Water Products Div.
    - e. Zurn Industries, Inc.; Wilkins Div.
- D. Dielectric Flanges: Factory-fabricated, companion-flange assembly, for 220- or 300-psig minimum working pressure as required to suit system pressures.
  - 1. Manufacturers:
    - a. Capitol Manufacturing Co.
    - b. Epco Sales, Inc.
    - c. Watts Industries, Inc.; Water Products Div.
- E. Dielectric-Flange Kits: Companion-flange assembly for field assembly. Include flanges, full-face- or ring-type neoprene or phenolic gasket, phenolic or polyethylene bolt sleeves, phenolic washers, and steel backing washers.
  - 1. Manufacturers:
    - a. Advance Products & Systems, Inc.
    - b. Calpico, Inc.
    - c. Pipeline Seal and Insulator, Inc.
  - 2. Separate companion flanges and steel bolts and nuts shall have 220- or 300-psig minimum working pressure where required to suit system pressures.

- F. Dielectric Couplings: Galvanized-steel coupling with inert and noncorrosive, thermoplastic lining; threaded ends; and 300-psig minimum working pressure at 225 deg F.
  - 1. Manufacturers:
    - a. Calpico, Inc.
    - b. Lochinvar Corp.
- G. Dielectric Nipples: Electroplated steel nipple with inert and noncorrosive, thermoplastic lining; plain, threaded, or grooved ends; and 300-psig minimum working pressure at 225 deg F.
  - 1. Manufacturers:
    - a. Perfection Corp.
    - b. Precision Plumbing Products, Inc.
    - c. Sioux Chief Manufacturing Co., Inc.
    - d. Victaulic Co. of America.

## **2.5 MECHANICAL SLEEVE SEALS**

- A. Description: Modular sealing element unit, designed for field assembly, to fill annular space between pipe and sleeve.
  - 1. Manufacturers:
    - a. Advance Products & Systems, Inc.
    - b. Calpico, Inc.
    - c. Metraflex Co.
    - d. Pipeline Seal and Insulator, Inc.
  - 2. Sealing Elements: EPDM interlocking links shaped to fit surface of pipe. Include type and number required for pipe material and size of pipe.
  - 3. Pressure Plates: Stainless steel. Include two for each sealing element.
  - 4. Connecting Bolts and Nuts: Carbon steel with corrosion-resistant coating of length required to secure pressure plates to sealing elements. Include one for each sealing element.

## **2.6 SLEEVES**

- A. Galvanized-Steel Sheet: 0.0239-inch minimum thickness; round tube closed with welded longitudinal joint.
- B. Steel Pipe: ASTM A 53, Type E, Grade B, Schedule 40, galvanized, plain ends.
- C. Cast Iron: Cast or fabricated "wall pipe" equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop, unless otherwise indicated.

## 2.7 GROUT

- A. Description: ASTM C 1107, Grade B, nonshrink and nonmetallic, dry hydraulic-cement grout.
  - 1. Characteristics: Post-hardening, volume-adjusting, nonstaining, noncorrosive, nongaseous, and recommended for interior and exterior applications.
  - 2. Design Mix: 5000-psi, 28-day compressive strength.
  - 3. Packaging: Premixed and factory packaged.

## PART 3 - EXECUTION

### 3.1 PIPING SYSTEMS - COMMON REQUIREMENTS

- A. Install piping according to the following requirements and Division 22 Sections specifying piping systems.
- B. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems. Indicated locations and arrangements were used to size pipe and calculate friction loss, expansion, and other design considerations. Install piping as indicated unless deviations to layout are approved on Coordination Drawings.
- C. Install piping in concealed locations, unless otherwise indicated and except in equipment rooms and service areas.
- D. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise. Coordinate piping location and installation with all trades involved in work.
- E. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal.
- F. Install piping to permit valve servicing.
- G. Install piping at indicated slopes.
- H. Install piping free of sags and bends.
- I. Install fittings for changes in direction and branch connections.
- J. Install piping to allow application of insulation.
- K. Select system components with pressure rating equal to or greater than system operating pressure.
- L. Install escutcheons for penetrations of walls, ceilings, and floors according to the following:
  - 1. New Piping:
    - a. Chrome-Plated Piping: One-piece, cast-brass type with polished chrome-plated finish.

- b. Insulated Piping: One-piece, stamped-steel type with spring clips.
  - c. Bare Piping at Wall and Floor Penetrations in Finished Spaces: One-piece, cast-brass type with polished chrome-plated finish.
  - d. Bare Piping at Ceiling Penetrations in Finished Spaces: One-piece, cast-brass type with polished chrome-plated finish.
  - e. Bare Piping at Floor Penetrations in Equipment Rooms: One-piece, floor-plate type.
2. Existing Piping: Use the following:
- a. Bare Piping at Wall and Floor Penetrations in Finished Spaces: Split-casting, cast-brass type with chrome-plated finish.
  - b. Bare Piping at Ceiling Penetrations in Finished Spaces: Split-casting, cast-brass type with chrome-plated finish.
- M. Sleeves are not required for core-drilled holes.
- N. Permanent sleeves are not required for holes formed by removable PE sleeves.
- O. Install sleeves for pipes passing through concrete and masonry walls and concrete floor and roof slabs.
- P. Install sleeves for pipes passing through concrete and masonry walls, gypsum-board partitions, and concrete floor and roof slabs.
- 1. Cut sleeves to length for mounting flush with both surfaces.
    - a. Exception: Extend sleeves installed in floors of mechanical equipment areas or other wet areas 2 inches above finished floor level. Extend cast-iron sleeve fittings below floor slab as required to secure clamping ring if ring is specified.
  - 2. Install sleeves in new walls and slabs as new walls and slabs are constructed.
  - 3. Install sleeves that are large enough to provide 1/4-inch annular clear space between sleeve and pipe or pipe insulation. Use the following sleeve materials:
    - a. Steel Pipe Sleeves: For pipes smaller than NPS 6.
    - b. Steel Sheet Sleeves: For pipes NPS 6 and larger, penetrating gypsum-board partitions.
  - 4. Except for underground wall penetrations, seal annular space between sleeve and pipe or pipe insulation, using joint sealants appropriate for size, depth, and location of joint. Refer to Division 7 Section "Joint Sealants" for materials and installation.
- Q. Aboveground, Exterior-Wall Pipe Penetrations: Seal penetrations using sleeves and mechanical sleeve seals. Select sleeve size to allow for 1-inch annular clear space between pipe and sleeve for installing mechanical sleeve seals.
- 1. Install steel pipe for sleeves smaller than 6 inches in diameter.
  - 2. Install cast-iron "wall pipes" for sleeves 6 inches and larger in diameter.
  - 3. Mechanical Sleeve Seal Installation: Select type and number of sealing elements required for pipe material and size. Position pipe in center of sleeve. Assemble

mechanical sleeve seals and install in annular space between pipe and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.

- R. Underground, Exterior-Wall Pipe Penetrations: Install cast-iron "wall pipes" for sleeves. Seal pipe penetrations using mechanical sleeve seals. Select sleeve size to allow for 1-inch annular clear space between pipe and sleeve for installing mechanical sleeve seals.
  - 1. Mechanical Sleeve Seal Installation: Select type and number of sealing elements required for pipe material and size. Position pipe in center of sleeve. Assemble mechanical sleeve seals and install in annular space between pipe and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.
- S. Fire-Barrier Penetrations: Maintain indicated fire rating of walls, partitions, ceilings, and floors at pipe penetrations. Seal pipe penetrations with firestop materials. Refer to Division 7 Section "Firestopping" for additional requirements.
- T. Verify final equipment locations for roughing-in.
- U. Refer to equipment specifications in other Sections of these Specifications for roughing-in requirements.

### **3.2 PIPING JOINT CONSTRUCTION**

- A. Join pipe and fittings according to the following requirements and Division 22 Sections specifying piping systems.
- B. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.
- C. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.
- D. Soldered Joints: Apply ASTM B 813, water-flushable flux, unless otherwise indicated, to tube end. Construct joints according to ASTM B 828 or CDA's "Copper Tube Handbook," using lead-free solder alloy complying with ASTM B 32.
- E. Brazed Joints: Construct joints according to AWS's "Brazing Handbook," "Pipe and Tube" Chapter, using copper-phosphorus brazing filler metal complying with AWS A5.8.
- F. Threaded Joints: Thread pipe with tapered pipe threads according to ASME B1.20.1. Cut threads full and clean using sharp dies. Ream threaded pipe ends to remove burrs and restore full ID. Join pipe fittings and valves as follows:
  - 1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is specified.
  - 2. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged. Do not use pipe sections that have cracked or open welds.

- G. Welded Joints: Construct joints according to AWS D10.12, using qualified processes and welding operators according to Part 1 "Quality Assurance" Article.
- H. Flanged Joints: Select appropriate gasket material, size, type, and thickness for service application. Install gasket concentrically positioned. Use suitable lubricants on bolt threads.

### **3.3 PIPING CONNECTIONS**

- A. Make connections according to the following, unless otherwise indicated:
  - 1. Install unions, in piping NPS 2 and smaller, adjacent to each valve and at final connection to each piece of equipment.
  - 2. Install flanges, in piping NPS 2-1/2 and larger, adjacent to flanged valves and at final connection to each piece of equipment.
  - 3. Wet Piping Systems: Install dielectric coupling and nipple fittings to connect piping materials of dissimilar metals.

### **3.4 EQUIPMENT INSTALLATION - COMMON REQUIREMENTS**

- A. Install equipment to allow maximum possible headroom unless specific mounting heights are not indicated.
- B. Install equipment level and plumb, parallel and perpendicular to other building systems and components in exposed interior spaces, unless otherwise indicated.
- C. Install plumbing equipment to facilitate service, maintenance, and repair or replacement of components. Connect equipment for ease of disconnecting, with minimum interference to other installations. Extend grease fittings to accessible locations.
- D. Install equipment to allow right of way for piping installed at required slope.

### **3.5 PAINTING**

- A. Painting of plumbing systems, equipment, and components is specified in Division 9 Sections "Interior Painting" and "Exterior Painting."
- B. Damage and Touchup: Repair marred and damaged factory-painted finishes with materials and procedures to match original factory finish.

### **3.6 CONCRETE BASES**

- A. Concrete Bases: Anchor equipment to concrete base according to equipment manufacturer's written instructions and according to seismic codes at Project.
  - 1. Construct concrete bases of dimensions indicated, but not less than 4 inches larger in both directions than supported unit.

2. Install dowel rods to connect concrete base to concrete floor. Unless otherwise indicated, install dowel rods on 18-inch centers around the full perimeter of the base.
3. Install epoxy-coated anchor bolts for supported equipment that extend through concrete base, and anchor into structural concrete floor.
4. Place and secure anchorage devices. Use supported equipment manufacturer's setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
5. Install anchor bolts to elevations required for proper attachment to supported equipment.
6. Install anchor bolts according to anchor-bolt manufacturer's written instructions.
7. Use 3000-psi, 28-day compressive-strength concrete and reinforcement as specified in Division 3 Section "Cast-in-Place Concrete."

### **3.7 ERECTION OF METAL SUPPORTS AND ANCHORAGES**

- A. Refer to Division 5 Section "Metal Fabrications" for structural steel.
- B. Cut, fit, and place miscellaneous metal supports accurately in location, alignment, and elevation to support and anchor plumbing materials and equipment.
- C. Field Welding: Comply with AWS D1.1.

### **3.8 GROUTING**

- A. Mix and install grout for plumbing equipment base bearing surfaces, pump and other equipment base plates, and anchors.
- B. Clean surfaces that will come into contact with grout.
- C. Provide forms as required for placement of grout.
- D. Avoid air entrapment during placement of grout.
- E. Place grout, completely filling equipment bases.
- F. Place grout on concrete bases and provide smooth bearing surface for equipment.
- G. Place grout around anchors.
- H. Cure placed grout.

**END OF SECTION 220511**



## **SECTION 220513 – COMMON MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section includes general requirements for single-phase and polyphase, general-purpose, horizontal, small and medium, squirrel-cage induction motors for use on ac power systems up to 600 V and installed at equipment manufacturer's factory or shipped separately by equipment manufacturer for field installation.

#### **1.3 COORDINATION**

- A. Coordinate features of motors, installed units, and accessory devices to be compatible with the following:
  - 1. Motor controllers.
  - 2. Torque, speed, and horsepower requirements of the load.
  - 3. Ratings and characteristics of supply circuit and required control sequence.
  - 4. Ambient and environmental conditions of installation location.

### **PART 2 - PRODUCTS**

#### **2.1 GENERAL MOTOR REQUIREMENTS**

- A. Comply with requirements in this Section except when stricter requirements are specified in plumbing equipment schedules or Sections.
- B. Comply with NEMA MG 1 unless otherwise indicated.
- C. Comply with IEEE 841 for severe-duty motors.

#### **2.2 MOTOR CHARACTERISTICS**

- A. Duty: Continuous duty at ambient temperature of 40 deg C and at altitude of 3300 feet above sea level.
- B. Capacity and Torque Characteristics: Sufficient to start, accelerate, and operate connected loads at designated speeds, at installed altitude and environment, with indicated operating sequence, and without exceeding nameplate ratings or considering service factor.

## 2.3 POLYPHASE MOTORS

- A. Description: NEMA MG 1, Design B, medium induction motor.
- B. Efficiency: Energy efficient, as defined in NEMA MG 1.
- C. Service Factor: 1.15.
- D. Multispeed Motors: Variable torque.
  - 1. For motors with 2:1 speed ratio, consequent pole, single winding.
  - 2. For motors with other than 2:1 speed ratio, separate winding for each speed.
- E. Multispeed Motors: Separate winding for each speed.
- F. Rotor: Random-wound, squirrel cage.
- G. Bearings: Regreasable, shielded, antifriction ball bearings suitable for radial and thrust loading.
- H. Temperature Rise: Match insulation rating.
- I. Insulation: Class F.
- J. Code Letter Designation:
  - 1. Motors 15 HP and Larger: NEMA starting Code F or Code G.
  - 2. Motors Smaller than 15 HP: Manufacturer's standard starting characteristic.
- K. Enclosure Material: Cast iron for motor frame sizes 324T and larger; rolled steel for motor frame sizes smaller than 324T.

## 2.4 POLYPHASE MOTORS WITH ADDITIONAL REQUIREMENTS

- A. Motors Used with Reduced-Voltage and Multispeed Controllers: Match wiring connection requirements for controller with required motor leads. Provide terminals in motor terminal box, suited to control method.
- B. Motors Used with Variable Frequency Controllers: Ratings, characteristics, and features coordinated with and approved by controller manufacturer.
  - 1. Windings: Copper magnet wire with moisture-resistant insulation varnish, designed and tested to resist transient spikes, high frequencies, and short time rise pulses produced by pulse-width modulated inverters.
  - 2. Energy- and Premium-Efficient Motors: Class B temperature rise; Class F insulation.
  - 3. Inverter-Duty Motors: Class F temperature rise; Class H insulation.
  - 4. Thermal Protection: Comply with NEMA MG 1 requirements for thermally protected motors.
- C. Severe-Duty Motors: Comply with IEEE 841, with 1.15 minimum service factor.

## **2.5 SINGLE-PHASE MOTORS**

- A. Motors larger than 1/20 hp shall be one of the following, to suit starting torque and requirements of specific motor application:
  - 1. Permanent-split capacitor.
  - 2. Split phase.
  - 3. Capacitor start, inductor run.
  - 4. Capacitor start, capacitor run.
- B. Multispeed Motors: Variable-torque, permanent-split-capacitor type.
- C. Bearings: Prelubricated, antifriction ball bearings or sleeve bearings suitable for radial and thrust loading.
- D. Motors 1/20 HP and Smaller: Shaded-pole type.
- E. Thermal Protection: Internal protection to automatically open power supply circuit to motor when winding temperature exceeds a safe value calibrated to temperature rating of motor insulation. Thermal-protection device shall automatically reset when motor temperature returns to normal range.

### **PART 3 - EXECUTION (Not Applicable)**

**END OF SECTION 220513**

## **SECTION 220519 – METERS AND GAGES FOR PLUMBING PIPING**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section Includes:
  - 1. Thermometers.
  - 2. Gages.
  - 3. Test plugs.

#### **1.3 DEFINITIONS**

- A. CR: Chlorosulfonated polyethylene synthetic rubber.
- B. EPDM: Ethylene-propylene-diene terpolymer rubber.

#### **1.4 SUBMITTALS**

- A. Product Data: For each type of product indicated; include performance curves.
- B. Shop Drawings: Schedule for thermometers and gages indicating manufacturer's number, scale range and location for each.
- C. Product Certificates: For each type of thermometer and gage, signed by product manufacturer.

### **PART 2 - PRODUCTS**

#### **2.1 PLASTIC-CASE, LIQUID-IN-GLASS THERMOMETERS**

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Ernst Gage Co.
  - 2. Marsh Bellofram.
  - 3. Trerice, H. O. Co.

4. Weksler Instruments Operating Unit; Dresser Industries; Instrument Div.
- B. Case: Plastic, 9 inches long.
- C. Tube: Red or blue reading, organic-liquid filled, with magnifying lens.
- D. Tube Background: Satin-faced, nonreflective aluminum with permanently etched scale markings.
- E. Window: Glass or plastic.
- F. Connector: Adjustable type, 180 degrees in vertical plane, 360 degrees in horizontal plane, with locking device.
- G. Stem: Metal, for thermowell installation and of length to suit installation.
- H. Accuracy: Plus or minus 1 percent of range or plus or minus 1 scale division to maximum of 1.5 percent of range.

## **2.2 BIMETALLIC-ACTUATED DIAL THERMOMETERS**

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  1. Ashcroft Commercial Instrument Operations; Dresser Industries; Instrument Div.
  2. Ernst Gage Co.
  3. Marsh Bellofram.
  4. Palmer - Wahl Instruments Inc.
  5. Terice, H. O. Co.
  6. Weiss Instruments, Inc.
  7. Weksler Instruments Operating Unit; Dresser Industries; Instrument Div.
- B. Description: Direct-mounting, bimetallic-actuated dial thermometers complying with ASME B40.3.
- C. Case: Liquid-filled type, stainless steel with 5-inch diameter.
- D. Element: Bimetal coil.
- E. Dial: Satin-faced, nonreflective aluminum with permanently etched scale markings.
- F. Pointer: Red or other dark-color metal.
- G. Window: Glass.
- H. Ring: Stainless steel.

- I. Connector: Adjustable angle type.
- J. Stem: Metal, for thermowell installation and of length to suit installation.
- K. Accuracy: Plus or minus 1 percent of range or plus or minus 1 scale division to maximum of 1.5 percent of range.

### **2.3 THERMOWELLS**

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. AMETEK, Inc.; U.S. Gauge Div.
  - 2. Ernst Gage Co.
  - 3. Palmer - Wahl Instruments Inc.
  - 4. Trerice, H. O. Co.
  - 5. Weiss Instruments, Inc.
  - 6. Weksler Instruments Operating Unit; Dresser Industries; Instrument Div.
- B. Manufacturers: Same as manufacturer of thermometer being used.
- C. Description: Pressure-tight, socket-type metal fitting made for insertion into piping and of type, diameter, and length required to hold thermometer.

### **2.4 PRESSURE GAGES**

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. AMETEK, Inc.; U.S. Gauge Div.
  - 2. Ernst Gage Co.
  - 3. Palmer - Wahl Instruments Inc.
  - 4. Trerice, H. O. Co.
  - 5. Weiss Instruments, Inc.
  - 6. Weksler Instruments Operating Unit; Dresser Industries; Instrument Div.
- B. Direct-Mounting, Dial-Type Pressure Gages: Indicating-dial type complying with ASME B40.100.
  - 1. Case: Dry type, stainless steel or cast aluminum, 4-1/2-inch diameter.
  - 2. Pressure-Element Assembly: Bourdon tube, unless otherwise indicated.
  - 3. Pressure Connection: Brass, NPS 1/4, bottom-outlet type unless back-outlet type is indicated.
  - 4. Movement: Mechanical, with link to pressure element and connection to pointer.

5. Dial: Satin-faced, nonreflective aluminum with permanently etched scale markings.
6. Pointer: Red or other dark-color metal.
7. Window: Glass.
8. Ring: Stainless steel.
9. Accuracy: Grade A, plus or minus 1 percent of middle half scale.
10. Vacuum-Pressure Range: 30-in. Hg of vacuum to 22 psig of pressure.
11. Range for Fluids under Pressure: Two times operating pressure.

C. Pressure-Gage Fittings:

1. Valves: NPS 1/4 brass or stainless-steel needle type.
2. Snubbers: ASME B40.5, NPS 1/4 brass bushing with corrosion-resistant, porous-metal disc of material suitable for system fluid and working pressure.

## 2.5 TEST PLUGS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
1. Flow Design, Inc.
  2. MG Piping Products Co.
  3. National Meter, Inc.
  4. Peterson Equipment Co., Inc.
  5. Sisco Manufacturing Co.
  6. Terice, H. O. Co.
  7. Watts Industries, Inc.; Water Products Div.
- B. Description: Corrosion-resistant brass or stainless-steel body with core inserts and gasketed and threaded cap, with extended stem for units to be installed in insulated piping.
- C. Minimum Pressure and Temperature Rating: 500 psig at 200 deg F.
- D. Core Inserts: One or two self-sealing rubber valves.
1. Insert material for water service at 20 to 200 deg F shall be CR.
  2. Insert material for water service at minus 30 to plus 275 deg F shall be EPDM.
- E. Test Kit: Furnish one test kit containing one pressure gage and adaptor, two thermometer(s), and carrying case. Pressure gage, adapter probes, and thermometer sensing elements shall be of diameter to fit test plugs and of length to project into piping.
1. Pressure Gage: Small bourdon-tube insertion type with 2- to 3-inch-diameter dial and probe. Dial range shall be 0 to 200 psig.
  2. Low-Range Thermometer: Small bimetallic insertion type with 1- to 2-inch-diameter dial and tapered-end sensing element. Dial ranges shall be 25 to 125 deg F.

3. High-Range Thermometer: Small bimetallic insertion type with 1- to 2-inch-diameter dial and tapered-end sensing element. Dial ranges shall be 0 to 220 deg F.
4. Carrying case shall have formed instrument padding.

### **PART 3 - EXECUTION**

#### **3.1 THERMOMETER APPLICATIONS**

- A. Install liquid-in-glass direct-mounting, or bimetallic-actuated dial thermometers in the outlet of each domestic, hot-water storage tank.
- B. Provide the following temperature ranges for thermometers:
  1. Domestic Hot Water: 30 to 180 deg F, with 2-degree scale divisions.
  2. Domestic Cold Water: 0 to 100 deg F, with 2-degree scale divisions.

#### **3.2 GAGE APPLICATIONS**

- A. Install dry-case-type pressure gages for discharge of each pressure-reducing valve.
- B. Install dry-case-type pressure gages at suction and discharge of each pump.

#### **3.3 INSTALLATIONS**

- A. Install direct-mounting thermometers and adjust vertical and tilted positions.
- B. Install remote-mounting dial thermometers on panel, with tubing connecting panel and thermometer bulb supported to prevent kinks. Use minimum tubing length.
- C. Install thermowells with socket extending to center of pipe and in vertical position in piping tees where thermometers are indicated.
- D. Install direct-mounting pressure gages in piping tees with pressure gage located on pipe at most readable position.
- E. Install needle-valve and snubber fitting in piping for each pressure gage.
- F. Install test plugs in tees in piping.
- G. Install permanent indicators on walls or brackets in accessible and readable positions.
- H. Install connection fittings for attachment to portable indicators in accessible locations.
- I. Install thermometers and gages adjacent to machines and equipment to allow service and maintenance for thermometers, gages, machines, and equipment.



- J. Adjust faces of thermometers and gages to proper angle for best visibility.

**END OF SECTION 220519**

## **SECTION 220523 – GENERAL-DUTY VALVES FOR PLUMBING PIPING**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes general duty valves common to plumbing piping systems. Related Sections: The following Sections contain requirements that relate to this Section:
  - 1. Special purpose valves are specified in Division 22 piping system Sections.
  - 2. Valve tags and charts are specified in Division 22 Section " IDENTIFICATION FOR PLUMBING PIPING AND EQUIPMENT."
- B. Section 220511 "COMMON WORK RESULTS FOR PLUMBING".

#### **1.3 SUBMITTALS**

- A. General: Submit each item in this Article according to the Conditions of the Contract and Section 22 Specification Sections.
- B. Product Data for each valve type. Include body material, valve design, pressure and temperature classification, end connection details, seating materials, trim material and arrangement, dimensions and required clearances, and installation instructions. Include list indicating valve and its application.
- C. Maintenance data for valves to include in the operation and maintenance manual specified in Division 1. Include detailed manufacturer's instructions on adjusting, servicing, disassembling, and repairing.

#### **1.4 QUALITY ASSURANCE**

- A. ASTM Compliance: Brass valves- ASTM B-61, ASTM B-62, and ASTM B-584. Silicon Brass- ASTM B-371 Alloy 694 or ASTM B-99 Alloy 651. Only valves containing 15% or less of zinc will be acceptable.
- B. ASME Compliance: Comply with ASME B31.9 for building services piping and ASME B31.1 for power piping.

- C. ASME Compliance for Ferrous Valves: ASME B16.10 and ASME B16.34 for dimension and design criteria.
- D. MSS Compliance: Comply with the various MSS Standard Practice documents referenced.
- E. NSF Compliance: NSF 61 for valve materials for potable water.

## 1.5 DELIVERY, STORAGE, AND HANDLING

- A. Prepare valves for shipping as follows:
  - 1. Protect internal parts against rust and corrosion.
  - 2. Protect threads, flange faces, and grooves.
  - 3. Set ball valves open to minimize exposure of functional surfaces.
  - 4. Set butterfly valves closed or slightly open.
  - 5. Block check valves in either closed or open position.
- B. Use the following precautions during storage:
  - 1. Maintain valve end protection.
  - 2. Store indoors and maintain valve temperature higher than ambient dew-point temperature. If outdoor storage is necessary, store valves off the ground in watertight enclosures.
- C. Use a sling to handle large valves. Rig to avoid damage to exposed parts. Do not use handwheels and stems as lifting or rigging points.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Ball Valves:
    - a. Conbraco Industries, Inc.; Apollo Division.
    - b. Hammond Valve Corporation.
    - c. NIBCO Inc.
    - d. Stockham Valves & Fittings, Inc.
    - e. Watts
    - f. Jomar Valves
  - 2. Butterfly Valves:
    - a. General Signal; DeZurik Unit.
    - b. Grinnell Corp.

- c. Hammond Valve Corporation.
  - d. Keystone Valve USA, Inc.
  - e. NIBCO Inc.
  - f. Stockham Valves & Fittings, Inc.
  - g. Watts
  - h. Jomar Valves
3. Swing Check Valves:
- a. Cla-Val Co.
  - b. Hammond Valve Corporation.
  - c. NIBCO Inc.
  - d. Powell: Wm. Powell Company (The).
  - e. Stockham Valves & Fittings, Inc.
  - f. Watts
  - g. Jomar Valves
4. Wafer Check Valves:
- a. Hammond Valve Corporation.
  - b. NIBCO Inc.
  - c. Stockham Valves & Fittings, Inc.
  - d. Watts
5. Calibrated Balancing Valves:
- a. Armstrong Pumps, Inc.
  - b. ITT Fluid Technology Corp.; ITT Bell & Gossett Div.
  - c. Taco, Inc.
  - d. Jomar Valves
6. Thermostatic Balancing Valves
- a. Jomar Valves
  - b. Circuit Solver by ThermOmegaTech
  - c. Watts

## 2.2 BASIC, COMMON FEATURES

- A. Pressure and Temperature Ratings: As indicated in the "Application Schedule" of Part 3 of this Section and as required to suit system pressures and temperatures.
- B. Sizes: Same size as upstream pipe, unless otherwise indicated.
- C. Operators: Use specified operators and handwheels, except provide the following special operator features:

1. Handwheels: For valves other than quarter turn.
  2. Lever Handles: For quarter-turn valves 4 inches and smaller.
  3. Gear-Drive Operators: For quarter-turn valves 6 inches and larger.
- D. Extended Stems: Where insulation is indicated or specified, provide extended stems arranged to receive insulation.
- E. Bypass and Drain Connections: Comply with MSS SP-45 bypass and drain connections.
- F. Threads: ASME B1.20.1.
- G. Flanges: ASME B16.1 for cast iron, ASME B16.5 for steel, and ASME B16.24 for bronze valves.

### **2.3 BALL VALVES**

- A. Ball Valves, 4 Inches and Smaller: MSS SP-110, Class 150, 600-psi CWP, ASTM B 584 bronze body and bonnet, 2-piece construction; chrome-plated brass ball, full port for 1-inch valves and smaller and conventional port for 1-1/4-inch valves and larger; blowout proof; bronze or brass stem; teflon seats and seals; threaded or soldered end connections:
1. Operator: Vinyl-covered steel lever handle.
  2. Operator: Lever operators with lock where called for on the drawings.
  3. Stem Extension: For valves installed in insulated piping.
  4. Memory Stop: For operator handles.

### **2.4 BUTTERFLY VALVES**

- A. Butterfly Valves: MSS SP-67, 200-psi CWP, 150-psi maximum pressure differential, ASTM A 126 cast-iron body and bonnet, extended neck, stainless-steel stem, field-replaceable EPDM or Buna N sleeve and stem seals, wafer, lug, or grooved style:
1. Disc Type: Nickel-plated ductile iron.
  2. Disc Type: Epoxy-coated ductile iron.
  3. Operator for Sizes 2-1/2 Inches to 4 Inches : Lever handle with latch lock.
  4. Operator for Sizes 6 Inches and larger: Gear operator with position indicator.
  5. Operator for Sizes 6 Inches and Larger, 96 Inches or Higher above Floor: Chain-wheel operator.

### **2.5 CHECK VALVES**

- A. Swing Check Valves, 2-1/2 Inches and Smaller: MSS SP-80; Class 125, 200-psi CWP, or Class 150, 300-psi CWP; horizontal swing, Y-pattern, ASTM B 62 cast-bronze body and cap, rotating bronze disc with rubber seat or composition seat, threaded or soldered end connections:

- B. Swing Check Valves, 3 Inches and Larger: MSS SP-71, Class 125, 200-psi CWP, ASTM A 126 cast-iron body and bolted cap, horizontal-swing bronze disc, flanged or grooved end connections.
- C. Wafer Check Valves: Class 125, 200-psi CWP, ASTM A 126 cast-iron body, bronze disc/plates, stainless-steel pins and springs, Buna N seals, installed between flanges.
- D. Check Valves-Vertical Position: Check Valves used in vertical position shall be Mueller Steam Specialty Co., Figure 105-BP glove type, bronze body, flanged ends, 175# W.W.P., seats and disc of composition bronze, guide pins and bushings of silicon bronze, phosphor bronze springs. The units shall be designed for quiet action and positive protection against water hammer.

## **2.6 THERMOSTATIC BALANCING VALVES**

- A. Furnish and install in the hot water recirculating branches, as shown on the drawings, an adjustable thermostatic balancing valve utilizing a thermostatic cartridge allowing system balancing based on temperature as opposed to pressure or flow. Valve shall be certified to NSF 61 and NSF 672 and shall be field adjustable from 95 degrees to 140 degrees Fahrenheit. Valve shall be equipped with the capability of a thermal disinfection treatment to 160 degrees Fahrenheit.
- B. Field adjustable thermostatic balancing valves shall include as part of the assembly an integral check valve, strainer, and ball valves for maintenance on both the upstream and downstream side of the valve.
- C. Non-field adjustable thermostatic balancing valve assembly shall include an integral check valve, strainer, and ball valves for maintenance on both the upstream and downstream side of the valve. Valves be set to open at 115 degrees Fahrenheit.

## **PART 3 - EXECUTION**

### **3.1 EXAMINATION**

- A. Examine piping system for compliance with requirements for installation tolerances and other conditions affecting performance of valves. Do not proceed with installation until unsatisfactory conditions have been corrected.
- B. Examine valve interior for cleanliness, freedom from foreign matter, and corrosion. Remove special packing materials, such as blocks, used to prevent disc movement during shipping and handling.
- C. Operate valves from fully open to fully closed positions. Examine guides and seats made accessible by such operation.
- D. Examine threads on valve and mating pipe for form and cleanliness.

- E. Examine mating flange faces for conditions that might cause leakage. Check bolting for proper size, length, and material. Check gasket material for proper size, material composition suitable for service, and freedom from defects and damage.
- F. Do not attempt to repair defective valves; replace with new valves.

### **3.2 INSTALLATION**

- A. Install valves as indicated, according to manufacturer's written instructions.
- B. Piping installation requirements are specified in other Division 22 Sections. Drawings indicate the general arrangement of piping, fittings, and specialties.
- C. Install valves with unions or flanges at each piece of equipment arranged to allow servicing, maintenance, and equipment removal without system shutdown.
- D. Locate valves for easy access and provide separate support where necessary.
- E. Install valves in horizontal piping with stem at or above the center of the pipe.
- F. Install valves in a position to allow full stem movement.
- G. For chain-wheel operators, extend chains to 60 inches above finished floor elevation.
- H. Installation of Check Valves: Install for proper direction of flow as follows:
  - 1. Swing Check Valves: Horizontal position with hinge pin level.
  - 2. Wafer Check Valves: Horizontal or vertical position, between flanges.

### **3.3 THREADED CONNECTIONS**

- A. Note the internal length of threads in valve ends and proximity of valve internal seat or wall to determine how far pipe should be threaded into valve.
- B. Align threads at point of assembly.
- C. Apply appropriate tape or thread compound to the external pipe threads, except where dry seal threading is specified.
- D. Assemble joint, wrench tight. Wrench on valve shall be on the valve end into which the pipe is being threaded.

### **3.4 FLANGED CONNECTIONS**

- A. Align flange surfaces parallel.

- B. Assemble joints by sequencing bolt tightening to make initial contact of flanges and gaskets as flat and parallel as possible. Use suitable lubricants on bolt threads. Tighten bolts gradually and uniformly with a torque wrench.
- C. For dead-end service, butterfly valves require flanges both upstream and downstream for proper shutoff and retention.

### **3.5 VALVE END SELECTION**

- A. Select valves with the following ends or types of pipe/tube connections:
  - 1. Copper Tube Size, 2 Inches and Smaller: Threaded ends.
  - 2. Copper Tube Size 2-1/2 Inches and Larger: Flanged ends.

### **3.6 APPLICATION SCHEDULE**

- A. General Application: Use gate, ball, and butterfly valves for shutoff duty; globe, ball, and butterfly for throttling duty. Refer to piping system Specification Sections for specific valve applications and arrangements.
- B. Domestic Water Systems: Use the following valve types:
  - 1. Ball Valves: Class 150, 600-psi CWP, with stem extension.
  - 2. Butterfly Valves: Nickel-plated ductile iron or elastomer-coated ductile iron disc; EPDM or Buna N sleeve and stem seals.
  - 3. Bronze Swing Check: Class 125, with rubber seat.
  - 4. Check Valves: Class 125, swing or wafer type as indicated.

### **3.7 DOMESTIC HOT WATER RETURN SYSTEM BALANCING**

- A. This Contractor shall obtain the services of an independent firm to perform the hot water return system balancing. A Professional Engineer shall supervise all work and certify the balance report.
- B. The Plumbing Contractor shall:
  - 1. Install all domestic hot water recirculating balancing valves indicated to be installed under this contract in a manner that will leave them accessible and readily adjustable. All hose connections and dial face shall be turned down or horizontal for ease of attachments and reading.
  - 2. He shall pre-set all balancing valves installed by him as directed by the Engineer.
  - 3. Provide the balance firm with one copy of the plumbing plans indicating the exact location of all devices.
  - 4. Place the plumbing equipment into full operation, domestic hot water heaters and hot water recirculating pumps and continue operating the equipment during the balancing.



5. Open all valves throughout the domestic hot water system.
  6. Aid the balancing firm in locating and adjusting all balancing valves.
- C. The balance firm shall adjust the flow through all balancing elements to within 5% of design conditions.
- D. The balance firm shall prepare and submit to the Engineer four copies of the test and balance report.
- E. The balance firm shall provide a one year warranty during which time additional adjustments may be required.

### **3.8 ADJUSTING**

- A. Adjust or replace packing after piping systems have been tested and put into service, but before final adjusting and balancing. Replace valves if leak persists.

**END OF SECTION 220523**

## **SECTION 220529 – HANGERS AND SUPPORTS FOR PLUMBING PIPING AND EQUIPMENT**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes the following hangers and supports for plumbing system piping and equipment:
  - 1. Steel pipe hangers and supports.
  - 2. Trapeze pipe hangers.
  - 3. Thermal-hanger shield inserts.
  - 4. Fastener systems.
  - 5. Pipe stands.
  - 6. Pipe positioning systems.
  - 7. Equipment supports.

#### **1.3 DEFINITIONS**

- A. MSS: Manufacturers Standardization Society for The Valve and Fittings Industry Inc.
- B. Terminology: As defined in MSS SP-90, "Guidelines on Terminology for Pipe Hangers and Supports."

#### **1.4 PERFORMANCE REQUIREMENTS**

- A. Design supports for multiple pipes, including pipe stands, capable of supporting combined weight of supported systems, system contents, and test water.
- B. Design equipment supports capable of supporting combined operating weight of supported equipment and connected systems and components.
- C. Design seismic-restraint hangers and supports for piping and equipment and obtain approval from authorities having jurisdiction.

## **1.5 SUBMITTALS**

- A. Product Data: For the following:
  - 1. Steel pipe hangers and supports.
  - 2. Thermal-hanger shield inserts.
  - 3. Powder-actuated fastener systems.
  - 4. Pipe positioning systems.
- B. Shop Drawings: Show fabrication and installation details and include calculations for the following:
  - 1. Trapeze pipe hangers. Include Product Data for components.
  - 2. Metal framing systems. Include Product Data for components.
  - 3. Pipe stands. Include Product Data for components.
  - 4. Equipment supports.
- C. Welding certificates.

## **1.6 QUALITY ASSURANCE**

- A. Welding: Qualify procedures and personnel according to AWS D1.1, "Structural Welding Code--Steel."

## **PART 2 - PRODUCTS**

### **2.1 MANUFACTURERS**

- A. In other Part 2 articles where titles below introduce lists, the following requirements apply to product selection:
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the manufacturers specified.

### **2.2 STEEL PIPE HANGERS AND SUPPORTS**

- A. Description: MSS SP-58, Types 1 through 58, factory-fabricated components. Refer to Part 3 "Hanger and Support Applications" Article for where to use specific hanger and support types.
- B. Manufacturers:
  - 1. B-Line Systems, Inc.; a division of Cooper Industries.
  - 2. Empire Industries, Inc.
  - 3. Globe Pipe Hanger Products, Inc.
  - 4. Grinnell Corp.

5. GS Metals Corp.
6. National Pipe Hanger Corporation.
7. Piping Technology & Products, Inc.
8. Tolco Inc.

C. Galvanized, Metallic Coatings: Pregalvanized or hot dipped.

D. Nonmetallic Coatings: Plastic coating, jacket, or liner.

E. Padded Hangers: Hanger with fiberglass or other pipe insulation pad or cushion for support of bearing surface of piping.

### **2.3 TRAPEZE PIPE HANGERS**

A. Description: MSS SP-69, Type 59, shop- or field-fabricated pipe-support assembly made from structural-steel shapes with MSS SP-58 hanger rods, nuts, saddles, and U-bolts.

### **2.4 METAL FRAMING SYSTEMS**

A. Description: MFMA-3, Shop or field fabricated pipe support assembly made of steel channels and other components.

B. Manufacturers:

1. B-Line Systems, Inc.; A Division of Cooper Industries.
2. Erico/Michigan Hanger Co.; Eri strut Division.
3. GS Metals Corporation.
4. Tolco, Inc.
5. Unistrut Corp.; Tyco International, Ltd.

C. Nonmetallic Coatings: Plastic coating, jacket or liner.

### **2.5 THERMAL-HANGER SHIELD INSERTS**

A. Description: 100-psig-minimum, compressive-strength insulation insert encased in sheet metal shield.

B. Manufacturers:

1. Carpenter & Paterson, Inc.
2. ERICO/Michigan Hanger Co.
3. PHS Industries, Inc.
4. Pipe Shields, Inc.
5. Rilco Manufacturing Company, Inc.

- C. For Trapeze or Clamped Systems: Insert and shield shall cover entire circumference of pipe.
- D. For Clevis or Band Hangers: Insert and shield shall cover lower 180 degrees of pipe.
- E. Insert Length: Extend 2 inches beyond sheet metal shield for piping operating below ambient air temperature.

## **2.6 FASTENER SYSTEMS**

- A. Powder-Actuated Fasteners: Threaded-steel stud, for use in hardened portland cement concrete with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.
  - 1. Manufacturers:
    - a. Hilti, Inc.
    - b. ITW Ramset/Red Head.
    - c. Masterset Fastening Systems, Inc.
    - d. MKT Fastening, LLC.
    - e. Powers Fasteners.
- B. Mechanical-Expansion Anchors: Insert-wedge-type zinc-coated steel, for use in hardened portland cement concrete with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.
  - 1. Manufacturers:
    - a. B-Line Systems, Inc.; a division of Cooper Industries.
    - b. Empire Industries, Inc.
    - c. Hilti, Inc.
    - d. ITW Ramset/Red Head.
    - e. MKT Fastening, LLC.
    - f. Powers Fasteners.

## **2.7 PIPE STAND FABRICATION**

- A. Pipe Stands, General: Shop or field-fabricated assemblies made of manufactured corrosion-resistant components to support roof-mounted piping.

## **2.8 PIPE POSITIONING SYSTEMS**

- A. Description: IAPMO PS 42, system of metal brackets, clips, and straps for positioning piping in pipe spaces for plumbing fixtures for commercial applications.
- B. Manufacturers:

1. C & S Mfg. Corp.
2. HOLDRITE Corp.; Hubbard Enterprises.
3. Samco Stamping, Inc.

## **2.9 EQUIPMENT SUPPORTS**

- A. Description: Welded, shop- or field-fabricated equipment support made from structural-steel shapes.

## **2.10 MISCELLANEOUS MATERIALS**

- A. Structural Steel: ASTM A 36/A 36M, steel plates, shapes, and bars; black and galvanized.
- B. Grout: ASTM C 1107, factory-mixed and -packaged, dry, hydraulic-cement, nonshrink and nonmetallic grout; suitable for interior and exterior applications.
  1. Properties: Nonstaining, noncorrosive, and nongaseous.
  2. Design Mix: 5000-psi, 28-day compressive strength.

## **PART 3 - EXECUTION**

### **3.1 HANGER AND SUPPORT APPLICATIONS**

- A. Specific hanger and support requirements are specified in Sections specifying piping systems and equipment.
- B. Comply with MSS SP-69 for pipe hanger selections and applications that are not specified in piping system Sections.
- C. Use hangers and supports with galvanized, metallic coatings for piping and equipment that will not have field-applied finish.
- D. Use nonmetallic coatings on attachments for electrolytic protection where attachments are in direct contact with copper tubing.
- E. Use padded hangers for piping that is subject to scratching.
- F. Horizontal-Piping Hangers and Supports: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
  1. Adjustable, Steel Clevis Hangers (MSS Type 1): For suspension of noninsulated or insulated stationary pipes, NPS 1/2 to NPS 30.
  2. Pipe Hangers (MSS Type 5): For suspension of pipes, NPS 1/2 to NPS 4, to allow off-center closure for hanger installation before pipe erection.

3. Adjustable, Swivel Split- or Solid-Ring Hangers (MSS Type 6): For suspension of noninsulated stationary pipes, NPS 3/4 to NPS 8.
  4. Adjustable, Steel Band Hangers (MSS Type 7): For suspension of noninsulated stationary pipes, NPS 1/2 to NPS 8.
  5. Split Pipe-Ring with or without Turnbuckle-Adjustment Hangers (MSS Type 11): For suspension of noninsulated stationary pipes, NPS 3/8 to NPS 8.
  6. U-Bolts (MSS Type 24): For support of heavy pipes, NPS 1/2 to NPS 30.
  7. Adjustable, Pipe Saddle Supports (MSS Type 38): For stanchion-type support for pipes, NPS 2-1/2 to NPS 36, if vertical adjustment is required, with steel pipe base stanchion support and cast-iron floor flange.
  8. Complete Pipe Rolls (MSS Type 44): For support of pipes, NPS 2 to NPS 42, if longitudinal movement caused by expansion and contraction might occur but vertical adjustment is not necessary.
  9. Pipe Roll and Plate Units (MSS Type 45): For support of pipes, NPS 2 to NPS 24, if small horizontal movement caused by expansion and contraction might occur and vertical adjustment is not necessary.
- G. Vertical-Piping Clamps: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Extension Pipe or Riser Clamps (MSS Type 8): For support of pipe risers, NPS 3/4 to NPS 20.
  2. Carbon- or Alloy-Steel Riser Clamps (MSS Type 42): For support of pipe risers, NPS 3/4 to NPS 20, if longer ends are required for riser clamps.
- H. Hanger-Rod Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Steel Turnbuckles (MSS Type 13): For adjustment up to 6 inches for heavy loads.
  2. Steel Clevises (MSS Type 14): For 120 to 450 deg F piping installations.
  3. Malleable-Iron Sockets (MSS Type 16): For attaching hanger rods to various types of building attachments.
  4. Steel Weldless Eye Nuts (MSS Type 17): For 120 to 450 deg F piping installations.
- I. Building Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Top-Beam C-Clamps (MSS Type 19): For use under roof installations with bar-joint construction to attach to top flange of structural shape.
  2. Side-Beam or Channel Clamps (MSS Type 20): For attaching to bottom flange of beams, channels, or angles.
  3. Center-Beam Clamps (MSS Type 21): For attaching to center of bottom flange of beams.
  4. C-Clamps (MSS Type 23): For structural shapes.
  5. Side-Beam Clamps (MSS Type 27): For bottom of steel I-beams.

6. Steel-Beam Clamps with Eye Nuts (MSS Type 28): For attaching to bottom of steel I-beams for heavy loads.
  7. Malleable Beam Clamps with Extension Pieces (MSS Type 30): For attaching to structural steel.
- J. Saddles and Shields: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Protection Shields (MSS Type 40): Of length recommended in writing by manufacturer to prevent crushing insulation.
  2. Thermal-Hanger Shield Inserts: For supporting insulated pipe.
- K. Comply with MSS SP-69 for trapeze pipe hanger selections and applications that are not specified in piping system Sections.
- L. Comply with MFMA-102 for metal framing system selections and applications that are not specified in piping system Sections.
- M. Use pipe positioning systems in pipe spaces behind plumbing fixtures to support supply and waste piping for plumbing fixtures.

### **3.2 HANGER AND SUPPORT INSTALLATION**

- A. Steel Pipe Hanger Installation: Comply with MSS SP-69 and MSS SP-89. Install hangers, supports, clamps, and attachments as required to properly support piping from building structure.
- B. Trapeze Pipe Hanger Installation: Comply with MSS SP-69 and MSS SP-89. Arrange for grouping of parallel runs of horizontal piping and support together on field-fabricated trapeze pipe hangers.
1. Pipes of Various Sizes: Support together and space trapezes for smallest pipe size or install intermediate supports for smaller diameter pipes as specified above for individual pipe hangers.
  2. Field fabricate from ASTM A 36/A 36M, steel shapes selected for loads being supported. Weld steel according to AWS D1.1.
- C. Thermal-Hanger Shield Installation: Install in pipe hanger or shield for insulated piping.
- D. Pipe Stand Installation:
1. Pipe Stand Types: Assemble components and mount on smooth roof surface. Do not penetrate roof membrane.
- E. Pipe Positioning System Installation: Install support devices to make rigid supply and waste piping connections to each plumbing fixture. Refer to Division 15 Section "Plumbing Fixtures" for plumbing fixtures. Support devices shall be such that applied insulation undisturbed within supporting system.



- F. Install hangers and supports complete with necessary inserts, bolts, rods, nuts, washers, and other accessories.
- G. Equipment Support Installation: Fabricate from welded-structural-steel shapes.
- H. Install hangers and supports to allow controlled thermal and seismic movement of piping systems, to permit freedom of movement between pipe anchors, and to facilitate action of expansion joints, expansion loops, expansion bends, and similar units.
- I. Install lateral bracing with pipe hangers and supports to prevent swaying.
- J. Install building attachments within concrete slabs or attach to structural steel. Install additional attachments at concentrated loads, including valves, flanges, and strainers, NPS 2-1/2 and larger and at changes in direction of piping. Install concrete inserts before concrete is placed; fasten inserts to forms and install reinforcing bars through openings at top of inserts.
- K. Load Distribution: Install hangers and supports so piping live and dead loads and stresses from movement will not be transmitted to connected equipment.
- L. Pipe Slopes: Install hangers and supports to provide indicated pipe slopes and so maximum pipe deflections allowed by ASME B31.9 (for building services piping) are not exceeded.
- M. Insulated Piping: Comply with the following:
  - 1. Attach clamps and spacers to piping.
    - a. Piping Operating above Ambient Air Temperature: Clamp may project through insulation.
    - b. Piping Operating below Ambient Air Temperature: Use thermal-hanger shield insert with clamp sized to match OD of insert.
    - c. Do not exceed pipe stress limits according to ASME B31.9 for building services piping.
  - 2. Install MSS SP-58, Type 40, protective shields on cold piping with vapor barrier. Shields shall span an arc of 180 degrees.
    - a. Option: Thermal-hanger shield inserts may be used. Include steel weight-distribution plate for pipe NPS 4 and larger if pipe is installed on rollers.
  - 3. Shield Dimensions for Pipe: Not less than the following:
    - a. NPS 1/4 to NPS 3-1/2: 12 inches long and 0.048 inch thick.
    - b. NPS 4: 12 inches long and 0.06 inch thick.
    - c. NPS 5 and NPS 6: 18 inches long and 0.06 inch thick.
  - 4. Insert Material: Length at least as long as protective shield.
  - 5. Thermal-Hanger Shields: Install with insulation same thickness as piping insulation.

### **3.3 EQUIPMENT SUPPORTS**

- A. Fabricate structural-steel stands to support equipment above floor.

- B. Grouting: Place grout under supports for equipment and make smooth bearing surface.
- C. Provide lateral bracing, to prevent swaying, for equipment supports.

### **3.4 METAL FABRICATIONS**

- A. Cut, drill, and fit miscellaneous metal fabrications for trapeze pipe hangers and equipment supports.
- B. Fit exposed connections together to form hairline joints. Field weld connections that cannot be shop welded because of shipping size limitations.
- C. Field Welding: Comply with AWS D1.1 procedures for shielded metal arc welding, appearance and quality of welds, and methods used in correcting welding work, and with the following:
  - 1. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals.
  - 2. Obtain fusion without undercut or overlap.
  - 3. Remove welding flux immediately.
  - 4. Finish welds at exposed connections so no roughness shows after finishing and contours of welded surfaces match adjacent contours.

### **3.5 ADJUSTING**

- A. Hanger Adjustments: Adjust hangers to distribute loads equally on attachments and to achieve indicated slope of pipe.
- B. Trim excess length of continuous-thread hanger and support rods to 1-1/2 inches.

### **3.6 PAINTING**

- A. Touch Up: Clean field welds and abraded areas of shop paint. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting. Comply with SSPC-PA 1 requirements for touching up field-painted surfaces.
  - 1. Apply paint by brush or spray to provide minimum dry film thickness of 2.0 mils.
- B. Touch Up: Cleaning and touchup painting of field welds, bolted connections, and abraded areas of shop paint on miscellaneous metal are specified in Division 9 painting Sections.
- C. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A 780.

**END OF SECTION 220529**

## **SECTION 220553 – IDENTIFICATION FOR PLUMBING PIPING AND EQUIPMENT**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section Includes:
  - 1. Equipment labels.
  - 2. Warning signs and labels.
  - 3. Pipe labels.
  - 4. Stencils.
  - 5. Valve tags.
  - 6. Warning tags.

#### **1.3 SUBMITTALS**

- A. Product Data: For each type of product indicated.
- B. Samples: For color, letter style, and graphic representation required for each identification material and device.
- C. Equipment Label Schedule: Include a listing of all equipment to be labeled with the proposed content for each label.
- D. Valve numbering scheme.
- E. Valve Schedules: For each piping system to include in maintenance manuals.

#### **1.4 COORDINATION**

- A. Coordinate installation of identifying devices with completion of covering and painting of surfaces where devices are to be applied.
- B. Coordinate installation of identifying devices with locations of access panels and doors.
- C. Install identifying devices before installing acoustical ceilings and similar concealment.

## **PART 2 - PRODUCTS**

### **2.1 EQUIPMENT LABELS**

- A. Metal Labels for Equipment:
1. Material and Thickness: Brass, 0.032-inch, Aluminum, 0.032-inch or anodized aluminum, 0.032-inch minimum thickness, and having predrilled or stamped holes for attachment hardware.
  2. Minimum Label Size: Length and width vary for required label content, but not less than 2-1/2 by 3/4 inch.
  3. Minimum Letter Size: 1/4 inch for name of units if viewing distance is less than 24 inches, 1/2 inch for viewing distances up to 72 inches, and proportionately larger lettering for greater viewing distances. Include secondary lettering two-thirds to three-fourths the size of principal lettering.
  4. Fasteners: Stainless-steel rivets or self-tapping screws.
  5. Adhesive: Contact-type permanent adhesive, compatible with label and with substrate.
- B. Label Content: Include equipment's Drawing designation or unique equipment number, Drawing numbers where equipment is indicated (plans, details, and schedules), plus the Specification Section number and title where equipment is specified.
- C. Equipment Label Schedule: For each item of equipment to be labeled, on 8-1/2-by-11-inch bond paper. Tabulate equipment identification number and identify Drawing numbers where equipment is indicated (plans, details, and schedules), plus the Specification Section number and title where equipment is specified. Equipment schedule shall be included in operation and maintenance data.

### **2.2 WARNING SIGNS AND LABELS**

- A. Material and Thickness: Multilayer, multicolor, plastic labels for mechanical engraving, 1/16 inch thick, and having predrilled holes for attachment hardware.
- B. Letter Color: Black.
- C. Background Color: Yellow.
- D. Maximum Temperature: Able to withstand temperatures up to 160 deg F.
- E. Minimum Label Size: Length and width vary for required label content, but not less than 2 inch by 5 inch.
- F. Minimum Letter Size: 1/4 inch for name of units if viewing distance is less than 24 inches, 1/2 inch for viewing distances up to 72 inches, and proportionately larger lettering for greater

viewing distances. Include secondary lettering two-thirds to three-fourths the size of principal lettering.

- G. Fasteners: Stainless-steel rivets or self-tapping screws.
- H. Adhesive: Contact-type permanent adhesive, compatible with label and with substrate.
- I. Label Content: Include caution and warning information, plus emergency notification instructions.

### **2.3 PIPE LABELS**

- A. General Requirements for Manufactured Pipe Labels: Preprinted, color-coded, with lettering indicating service, and showing flow direction.
- B. Pretensioned Pipe Labels: Precoiled, semirigid plastic formed to partially cover circumference of pipe and to attach to pipe without fasteners or adhesive.
- C. Self-Adhesive Pipe Labels: Printed vinyl with pressure-sensitive, permanent-adhesive backing.
- D. Pipe Label Contents: Include identification of piping service using same designations or abbreviations as used on Drawings, pipe size, and an arrow indicating flow direction.
  - 1. Flow-Direction Arrows: Integral with piping system service lettering to accommodate both directions or as separate unit on each pipe label to indicate flow direction.
  - 2. Lettering Size: At least 1-1/2 inches high.

### **2.4 VALVE TAGS**

- A. Valve Tags: Stamped or engraved with 1/4-inch letters for piping system abbreviation and 1/2-inch numbers.
  - 1. Tag Material: 1/2" Diameter, Brass, 0.032-inch, minimum thickness, and having predrilled or stamped holes for attachment hardware.
  - 2. Fasteners: Brass #6 bead chain or #16 brass jack chain.
- B. Valve Schedules: For each piping system, on 8-1/2-by-11-inch bond paper. Tabulate valve number, piping system, system abbreviation (as shown on valve tag), location of valve (room or space), normal-operating position (open, closed, or modulating), and variations for identification. Mark valves for emergency shutoff and similar special uses.
  - 1. Valve-tag schedule shall be included in operation and maintenance data.

### **2.5 WARNING TAGS**

- A. Warning Tags: Preprinted or partially preprinted, accident-prevention tags, of plasticized card stock with matte finish suitable for writing.

1. Size: 2 by 5 inches minimum.
2. Fasteners: Brass grommet and wire.
3. Nomenclature: Large-size primary caption such as "DANGER," "CAUTION," or "DO NOT OPERATE."
4. Color: Yellow background with black lettering.

### **PART 3 - EXECUTION**

#### **3.1 PREPARATION**

- A. Clean piping and equipment surfaces of substances that could impair bond of identification devices, including dirt, oil, grease, release agents, and incompatible primers, paints, and encapsulants.

#### **3.2 EQUIPMENT LABEL INSTALLATION**

- A. Install or permanently fasten labels on each major item of mechanical equipment.
- B. Locate equipment labels where accessible and visible.

#### **3.3 PIPE LABEL INSTALLATION**

- A. Piping Color-Coding: Painting of piping is specified in Division 9 Section "High-Performance Coatings."
- B. Locate pipe labels where piping is exposed or above accessible ceilings in finished spaces; machine rooms; accessible maintenance spaces such as shafts, tunnels, and plenums; and exterior exposed locations as follows:
  1. Near each valve and control device.
  2. Near each branch connection, excluding short takeoffs for fixtures and terminal units. Where flow pattern is not obvious, mark each pipe at branch.
  3. Near penetrations through walls, floors, ceilings, and inaccessible enclosures.
  4. At access doors, manholes, and similar access points that permit view of concealed piping.
  5. Near major equipment items and other points of origination and termination.
  6. Spaced at maximum intervals of 25 feet along each run.
- C. Pipe Label Color Schedule:
  1. Domestic Water Piping:
    - a. Background Color: White.

- b. Letter Color: Green.
- 2. Sanitary Waste, Vent and Storm Drainage Piping:
  - a. Background Color: White.
  - b. Letter Color: Red.

### **3.4 VALVE-TAG INSTALLATION**

- A. Install tags on valves and control devices in piping systems, except check valves; valves within factory-fabricated equipment units; shutoff valves; faucets; convenience and lawn-watering hose connections; and similar roughing-in connections of end-use fixtures and units. List tagged valves in a valve schedule.
- B. Valve-Tag Application Schedule: Tag valves according to size, shape, and color scheme and with captions similar to those indicated in the following subparagraphs:
  - 1. Valve-Tag Size and Shape:
    - a. Cold Water: 1-1/2 inches, round.
    - b. Hot Water: 1-1/2 inches, round.
  - 2. Chains shall be attached to valve lever handle or around valve system.
  - 3. Valve tags located above lay-in ceiling shall be hung where tag hangs below the level of the piping.

### **3.5 WARNING-TAG INSTALLATION**

- A. Write required message on, and attach warning tags to, equipment and other items where required.

**END OF SECTION 220553**

## **SECTION 220719 – PLUMBING INSULATION**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section Includes:
  - 1. Insulation Materials:
    - a. Flexible elastomeric.
    - b. Mineral fiber.
  - 2. Adhesives.
  - 3. Mastics.
  - 4. Lagging adhesives.
  - 5. Sealants.
  - 6. Factory-applied jackets.
  - 7. Field-applied fabric-reinforcing mesh.
  - 8. Field-applied cloths.
  - 9. Field-applied jackets.
  - 10. Tapes.
  - 11. Securements.
  - 12. Corner angles.

#### **1.3 SUBMITTALS**

- A. Product Data: For each type of product indicated. Include thermal conductivity, thickness, and jackets (both factory and field applied, if any).
- B. Shop Drawings:
  - 1. Application of protective shields, saddles, and inserts at hangers for each type of insulation and hanger.
  - 2. Insulation application at pipe expansion joints for each type of insulation.
  - 3. Insulation application at elbows, fittings, flanges, valves, and specialties for each type of insulation.
  - 4. Removable insulation at piping specialties, equipment connections, and access panels.
  - 5. Application of field-applied jackets.



#### **1.4 QUALITY ASSURANCE**

- A. Installer Qualifications: Skilled mechanics who have successfully completed an apprenticeship program or another craft training program certified by the Department of Labor, Bureau of Apprenticeship and Training.
- B. Fire-Test-Response Characteristics: Insulation and related materials shall have fire-test-response characteristics indicated, as determined by testing identical products per ASTM E 84, by a testing and inspecting agency acceptable to authorities having jurisdiction. Factory label insulation and jacket materials and adhesive, mastic, tapes, and cement material containers, with appropriate markings of applicable testing and inspecting agency.
  - 1. Insulation Installed Indoors: Flame-spread index of 25 or less, and smoke-developed index of 50 or less.

#### **1.5 DELIVERY, STORAGE, AND HANDLING**

- A. Packaging: Insulation material containers shall be marked by manufacturer with appropriate ASTM standard designation, type and grade, and maximum use temperature.

#### **1.6 COORDINATION**

- A. Coordinate size and location of supports, hangers, and insulation shields specified in Division 22 Section "Hangers and Supports."
- B. Coordinate clearance requirements with piping Installer for piping insulation application. Before preparing piping Shop Drawings, establish and maintain clearance requirements for installation of insulation and field-applied jackets and finishes and for space required for maintenance.

#### **1.7 SCHEDULING**

- A. Schedule insulation application after pressure testing systems. Insulation application may begin on segments that have satisfactory test results.

### **PART 2 - PRODUCTS**

#### **2.1 INSULATION MATERIALS**

- A. Comply with requirements in Part 3 schedule articles for where insulating materials shall be applied.
- B. Products shall not contain asbestos, lead, mercury, or mercury compounds.
- C. Products that come in contact with stainless steel shall have a leachable chloride content of less than 50 ppm when tested according to ASTM C 871.

- D. Foam insulation materials shall not use CFC or HCFC blowing agents in the manufacturing process.
- E. Flexible Elastomeric: Closed cell or expanded rubber materials comply with ASTM C534, Type I for tubular materials and Type II for sheet materials.
  - 1. Products: Subject to compliance with requirements, provide the following:
    - a. Aeroflex USA, Inc.; Aerocel.
    - b. Armacell, LLP; Armaflex.
    - c. RBX Corp.; Insul-Sheet 1800 and Insul Tube 180.
- F. Mineral-Fiber, Preformed Pipe Insulation:
  - 1. Products: Subject to compliance with requirements, provide the following:
    - a. Fibrex Insulations Inc.; Coreplus 1200.
    - b. Johns Manville; Micro-Lok.
    - c. Knauf Insulation; 1000(Pipe Insulation.
    - d. Manson Insulation Inc.; Alley-K.
    - e. Owens Corning; Fiberglas Pipe Insulation.
  - 2. Type I, 850 deg F Materials: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C 547, Type I, Grade A, with factory-applied ASJ. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.

## 2.2 ADHESIVES

- A. Materials shall be compatible with insulation materials, jackets, and substrates and for bonding insulation to itself and to surfaces to be insulated, unless otherwise indicated.
- B. Flexible Elastomeric Adhesive: Comply with MIL-A-24179A, Type II, Class 1.
  - 1. Products: Subject to compliance with requirements, provide the following:
    - a. Aeroflex USA, Inc.; Aero seal.
    - b. Armacell, LLC; 520 Adhesive.
    - c. RBX Corp.; Rubatex Contact Adhesive.
- C. Mineral-Fiber Adhesive: Comply with MIL-A-3316C, Class 2, Grade A.
  - 1. Products: Subject to compliance with requirements, provide the following:
    - a. Childers Products, Division of ITW; CP-82.
    - b. Foster Products Corporation, H. B. Fuller Company; 85-20.
    - c. ITW TACC, Division of Illinois Tool Works; S-90/80.
    - d. Marathon Industries, Inc.; 225.
    - e. Mon-Eco Industries, Inc.; 22-25.

### 2.3 MASTICS

- A. Materials shall be compatible with insulation materials, jackets, and substrates; comply with MIL-C-19565C, Type II.
- B. Vapor-Barrier Mastic: Solvent based; suitable for indoor use on below ambient services.
  - 1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Childers Products, Division of ITW; CP-30.
    - b. Foster Products Corporation, H. B. Fuller Company; 30-35.
    - c. ITW TACC, Division of Illinois Tool Works; CB-25.
    - d. Marathon Industries, Inc.; 501.
    - e. Mon-Eco Industries, Inc.; 55-10.
  - 2. Water-Vapor Permeance: ASTM F 1249, 0.05 perm at 35-mil dry film thickness.
  - 3. Service Temperature Range: 0 to 180 deg F.
  - 4. Solids Content: ASTM D 1644, 44 percent by volume and 62 percent by weight.
  - 5. Color: White.

### 2.4 LAGGING ADHESIVES

- A. Description: Comply with MIL-A-3316C Class I, Grade A and shall be compatible with insulation materials, jackets, and substrates.
  - 1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Childers Products, Division of ITW; CP-52.
    - b. Foster Products Corporation, H. B. Fuller Company; 81-42.
    - c. Marathon Industries, Inc.; 130.
    - d. Mon-Eco Industries, Inc.; 11-30.
    - e. Vimasco Corporation; 136.
  - 2. Fire-resistant, water-based lagging adhesive and coating for use indoors to adhere fire-resistant lagging cloths over equipment and pipe insulation.
  - 3. Service Temperature Range: Minus 50 to plus 180 deg F.
  - 4. Color: White.

### 2.5 SEALANTS

- A. Joint Sealants:
  - 1. Materials shall be compatible with insulation materials, jackets, and substrates.
  - 2. Permanently flexible, elastomeric sealant.
  - 3. Service Temperature Range: Minus 100 to plus 300 deg F.
  - 4. Color: White.

## 2.6 FACTORY-APPLIED JACKETS

- A. Insulation system schedules indicate factory-applied jackets on various applications. When factory-applied jackets are indicated, comply with the following:
1. ASJ: White, kraft-paper, fiberglass-reinforced scrim with aluminum-foil backing; complying with ASTM C 1136, Type I.
  2. ASJ-SSL: ASJ with self-sealing, pressure-sensitive, acrylic-based adhesive covered by a removable protective strip; complying with ASTM C 1136, Type I.
  3. PVDC Jacket for Indoor Applications: 4-mil- thick, white PVDC biaxially oriented barrier film with a permeance at 0.02 perms when tested according to ASTM E 96 and with a flame-spread index of 5 and a smoke-developed index of 20 when tested according to ASTM E 84.
    - a. Products: Subject to compliance with requirements, provide the following:
      - 1) Dow Chemical Company (The); Saran 540 Vapor Retarder Film and Saran 560 Vapor Retarder Film.
  4. PVDC-SSL Jacket: PVDC jacket with a self-sealing, pressure-sensitive, acrylic-based adhesive covered by a removable protective strip.
    - a. Products: Subject to compliance with requirements, provide the following:
      - 1) Dow Chemical Company (The); Saran 540 Vapor Retarder Film and Saran 560 Vapor Retarder Film.

## 2.7 FIELD-APPLIED FABRIC-REINFORCING MESH

- A. Woven Glass-Fiber Fabric for Pipe Insulation: Approximately 2 oz./sq. yd. with a thread count of 10 strands by 10 strands/sq. inch for covering pipe and pipe fittings.
1. Products: Subject to compliance with requirements, provide the following:
    - a. Vimasco Corporation; Elastafab 894.
- B. Woven Glass-Fiber Fabric for Equipment Insulation: Approximately 6 oz./sq. yd. with a thread count of 5 strands by 5 strands/sq. inch for covering equipment.
1. Products: Subject to compliance with requirements, provide the following:
    - a. Childers Products, Division of ITW; Chil-Glas No. 5.

## 2.8 FIELD-APPLIED CLOTHS

- A. Woven Glass-Fiber Fabric: Comply with MIL-C-20079H, Type I, plain weave, and presized a minimum of 8 oz./sq. yd.
1. Products: Subject to compliance with requirements, provide the following:
    - a. Alpha Associates, Inc.; Alpha-Maritex 84215 and 84217/9485RW, Luben 59.

## 2.9 FIELD-APPLIED JACKETS

- A. Field-applied jackets shall comply with ASTM C 921, Type I, unless otherwise indicated.
- B. PVC Jacket: High-impact-resistant, UV-resistant PVC complying with ASTM D 1784, Class 16354-C; thickness as scheduled; roll stock ready for shop or field cutting and forming. Thickness is indicated in field-applied jacket schedules.
  - 1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Johns Manville; Zeston.
    - b. P.I.C. Plastics, Inc.; FG Series.
    - c. Proto PVC Corporation; LoSmoke.
    - d. Speedline Corporation; SmokeSafe.
  - 2. Adhesive: As recommended by jacket material manufacturer.
  - 3. Color: White Color-code jackets based on system or Color as selected by Architect.
  - 4. Factory-fabricated fitting covers to match jacket if available; otherwise, field fabricate.
    - a. Shapes: 45- and 90-degree, short- and long-radius elbows, tees, valves, flanges, unions, reducers, end caps, soil-pipe hubs, traps, mechanical joints, and P-trap and supply covers for lavatories.
  - 5. Factory-fabricated tank heads and tank side panels.
- C. Metal Jacket:
  - 1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Childers Products, Division of ITW; Metal Jacketing Systems.
    - b. PABCO Metals Corporation; Surefit.
    - c. RPR Products, Inc.; Insul-Mate.
  - 2. Aluminum Jacket: Comply with ASTM B 209, Alloy 3003, 3005, 3105 or 5005, Temper H-14.
    - a. Factory cut and rolled to size.
    - b. Finish and thickness are indicated in field-applied jacket schedules.
    - c. Moisture Barrier for Indoor Applications: 3-mil-thick, heat-bonded polyethylene and kraft paper.
    - d. Factory-Fabricated Fitting Covers:
      - 1) Same material, finish, and thickness as jacket.
      - 2) Preformed 2-piece or gore, 45- and 90-degree, short- and long-radius elbows.
      - 3) Tee covers.
      - 4) Flange and union covers.
      - 5) End caps.
      - 6) Beveled collars.
      - 7) Valve covers.

- 8) Field fabricate fitting covers only if factory-fabricated fitting covers are not available.

## 2.10 TAPES

- A. ASJ Tape: White vapor-retarder tape matching factory-applied jacket with acrylic adhesive, complying with ASTM C 1136.
1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Avery Dennison Corporation, Specialty Tapes Division; Fasson 0835.
    - b. Compac Corp.; 104 and 105.
    - c. Ideal Tape Co., Inc., an American Biltrite Company; 428 AWF ASJ.
    - d. Venture Tape; 1540 CW Plus, 1542 CW Plus, and 1542 CW Plus/SQ.
  2. Width: 3 inches.
  3. Thickness: 11.5 mils.
  4. Adhesion: 90 ounces force/inch in width.
  5. Elongation: 2 percent.
  6. Tensile Strength: 40 lbf/inch in width.
  7. ASJ Tape Disks and Squares: Precut disks or squares of ASJ tape.
- B. PVC Tape: White vapor-retarder tape matching field-applied PVC jacket with acrylic adhesive. Suitable for indoor and outdoor applications.
1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Avery Dennison Corporation, Specialty Tapes Division; Fasson 0555.
    - b. Compac Corp.; 130.
    - c. Ideal Tape Co., Inc., an American Biltrite Company; 370 White PVC tape.
    - d. Venture Tape; 1506 CW NS.
  2. Width: 2 inches.
  3. Thickness: 6 mils.
  4. Adhesion: 64 ounces force/inch in width.
  5. Elongation: 500 percent.
  6. Tensile Strength: 18 lbf/inch in width.
- C. PVDC Tape: White vapor-retarder PVDC tape with acrylic adhesive.
1. Products: Subject to compliance with requirements, provide the following:
    - a. Dow Chemical Company (The); Saran 540 Vapor Retarder Tape.
  2. Width: 3 inches.
  3. Film Thickness: 4 mils.
  4. Adhesive Thickness: 1.5 mils.
  5. Elongation at Break: 145 percent.

6. Tensile Strength: 55 lbf/inch in width.

## 2.11 SECUREMENTS

### A. Bands:

1. Products: Subject to compliance with requirements, provide one of the following:
  - a. Childers Products; Bands.
  - b. PABCO Metals Corporation; Bands.
  - c. RPR Products, Inc.; Bands.
2. Stainless Steel: ASTM A 167 or ASTM A 240/A 240M, Type 304 or Type 316; 0.015 inch thick, 1/2 inch wide with wing or closed seal.
3. Aluminum: ASTM B 209, Alloy 3003, 3005, 3105, or 5005; Temper H-14, 0.020 inch thick, 3/4 inch wide with wing or closed seal.
4. Springs: Twin spring set constructed of stainless steel with ends flat and slotted to accept metal bands. Spring size determined by manufacturer for application.

### B. Insulation Pins and Hangers:

1. Metal, Adhesively Attached, Perforated-Base Insulation Hangers: Baseplate welded to projecting spindle that is capable of holding insulation, of thickness indicated, securely in position indicated when self-locking washer is in place. Comply with the following requirements:
  - a. Products: Subject to compliance with requirements, provide one of the following:
    - 1) AGM Industries, Inc.; Tactoo Insul-Hangers, Series T.
    - 2) GEMCO; Perforated Base.
    - 3) Midwest Fasteners, Inc.; Spindle.
  - b. Baseplate: Perforated, galvanized carbon-steel sheet, 0.030 inch thick by 2 inches square.
  - c. Spindle: Copper- or zinc-coated, low carbon steel, fully annealed, 0.106-inch- diameter shank, length to suit depth of insulation indicated.
  - d. Adhesive: Recommended by hanger manufacturer. Product with demonstrated capability to bond insulation hanger securely to substrates indicated without damaging insulation, hangers, and substrates.
2. Insulation-Retaining Washers: Self-locking washers formed from 0.016-inch- thick, galvanized-steel sheet, with beveled edge sized as required to hold insulation securely in place but not less than 1-1/2 inches in diameter.
  - a. Products: Subject to compliance with requirements, provide one of the following:
    - 1) AGM Industries, Inc.; RC-150.
    - 2) GEMCO; R-150.
    - 3) Midwest Fasteners, Inc.; WA-150.
    - 4) Nelson Stud Welding; Speed Clips.

- b. Protect ends with capped self-locking washers incorporating a spring steel insert to ensure permanent retention of cap in exposed locations.
- 3. Nonmetal Insulation-Retaining Washers: Self-locking washers formed from 0.016-inch- thick nylon sheet, with beveled edge sized as required to hold insulation securely in place but not less than 1-1/2 inches in diameter.
  - a. Products: Subject to compliance with requirements, provide one of the following:
    - 1) GEMCO.
    - 2) Midwest Fasteners, Inc.

## **2.12 CORNER ANGLES**

- A. PVC Corner Angles: 30 mils thick, minimum 1 by 1 inch, PVC according to ASTM D 1784, Class 16354-C. White or color-coded to match adjacent surface.
- B. Aluminum Corner Angles: 0.040 inch thick, minimum 1 by 1 inch, aluminum according to ASTM B 209, Alloy 3003, 3005, 3105 or 5005; Temper H-14.

## **PART 3 - EXECUTION**

### **3.1 EXAMINATION**

- A. Examine substrates and conditions for compliance with requirements for installation and other conditions affecting performance of insulation application.
  - 1. Verify that systems and equipment to be insulated have been tested and are free of defects.
  - 2. Verify that surfaces to be insulated are clean and dry.
  - 3. Proceed with installation only after unsatisfactory conditions have been corrected.

### **3.2 PREPARATION**

- A. Surface Preparation: Clean and dry surfaces to receive insulation. Remove materials that will adversely affect insulation application.
- B. Mix insulating cements with clean potable water; if insulating cements are to be in contact with stainless-steel surfaces, use demineralized water.

### **3.3 GENERAL INSTALLATION REQUIREMENTS**

- A. Install insulation materials, accessories, and finishes with smooth, straight, and even surfaces; free of voids throughout the length of equipment and piping including fittings, valves, and specialties.



- B. Install insulation materials, forms, vapor barriers or retarders, jackets, and thicknesses required for each item of equipment and pipe system as specified in insulation system schedules.
- C. Install accessories compatible with insulation materials and suitable for the service. Install accessories that do not corrode, soften, or otherwise attack insulation or jacket in either wet or dry state.
- D. Install insulation with longitudinal seams at top and bottom of horizontal runs.
- E. Install multiple layers of insulation with longitudinal and end seams staggered.
- F. Do not weld brackets, clips, or other attachment devices to piping, fittings, and specialties.
- G. Keep insulation materials dry during application and finishing.
- H. Install insulation with tight longitudinal seams and end joints. Bond seams and joints with adhesive recommended by insulation material manufacturer.
- I. Install insulation with least number of joints practical.
- J. Where vapor barrier is indicated, seal joints, seams, and penetrations in insulation at hangers, supports, anchors, and other projections with vapor-barrier mastic.
  - 1. Install insulation continuously through hangers and around anchor attachments.
  - 2. For insulation application where vapor barriers are indicated, extend insulation on anchor legs from point of attachment to supported item to point of attachment to structure. Taper and seal ends at attachment to structure with vapor-barrier mastic.
  - 3. Install insert materials and install insulation to tightly join the insert. Seal insulation to insulation inserts with adhesive or sealing compound recommended by insulation material manufacturer.
  - 4. Cover inserts with jacket material matching adjacent pipe insulation. Install shields over jacket, arranged to protect jacket from tear or puncture by hanger, support, and shield.
- K. Apply adhesives, mastics, and sealants at manufacturer's recommended coverage rate and wet and dry film thicknesses.
- L. Install insulation with factory-applied jackets as follows:
  - 1. Draw jacket tight and smooth.
  - 2. Cover circumferential joints with 3-inch- wide strips, of same material as insulation jacket. Secure strips with adhesive and outward clinching staples along both edges of strip, spaced 4 inches o.c.
  - 3. Overlap jacket longitudinal seams at least 1-1/2 inches. Install insulation with longitudinal seams at bottom of pipe. Clean and dry surface to receive self-sealing lap. Staple laps with outward clinching staples along edge at 4 inches o.c.
    - a. For below ambient services, apply vapor-barrier mastic over staples.
  - 4. Cover joints and seams with tape as recommended by insulation material manufacturer to maintain vapor seal.

5. Where vapor barriers are indicated, apply vapor-barrier mastic on seams and joints and at ends adjacent to pipe flanges and fittings.
- M. Cut insulation in a manner to avoid compressing insulation more than 75 percent of its nominal thickness.
- N. Finish installation with systems at operating conditions. Repair joint separations and cracking due to thermal movement.
- O. Repair damaged insulation facings by applying same facing material over damaged areas. Extend patches at least 4 inches beyond damaged areas. Adhere, staple, and seal patches similar to butt joints.
- P. For above ambient services, do not install insulation to the following:
  1. Vibration-control devices.
  2. Testing agency labels and stamps.
  3. Nameplates and data plates.
  4. Manholes.
  5. Handholes.
  6. Cleanouts.

### **3.4 PENETRATIONS**

- A. Insulation Installation at Interior Wall and Partition Penetrations (That Are Not Fire Rated): Install insulation continuously through walls and partitions.
- B. Insulation Installation at Fire-Rated Wall and Partition Penetrations: Install insulation continuously through penetrations of fire-rated walls and partitions.
  1. Comply with requirements in Division 7 Section "Through-Penetration Firestop Systems" for firestopping and fire-resistive joint sealers.
- C. Insulation Installation at Floor Penetrations:
  1. Pipe: Install insulation continuously through floor penetrations.
  2. Seal penetrations through fire-rated assemblies. Comply with requirements in Division 7 Section "Firestopping"

### **3.5 GENERAL PIPE INSULATION INSTALLATION**

- A. Requirements in this article generally apply to all insulation materials except where more specific requirements are specified in various pipe insulation material installation articles.
- B. Insulation Installation on Fittings, Valves, Strainers, Flanges, and Unions:
  1. Install insulation over fittings, valves, strainers, flanges, unions, and other specialties with continuous thermal and vapor-retarder integrity, unless otherwise indicated.

2. Insulate pipe elbows using preformed fitting insulation or mitered fittings made from same material and density as adjacent pipe insulation. Each piece shall be butted tightly against adjoining piece and bonded with adhesive. Fill joints, seams, voids, and irregular surfaces with insulating cement finished to a smooth, hard, and uniform contour that is uniform with adjoining pipe insulation.
  3. Insulate tee fittings with preformed fitting insulation or sectional pipe insulation of same material and thickness as used for adjacent pipe. Cut sectional pipe insulation to fit. Butt each section closely to the next and hold in place with tie wire. Bond pieces with adhesive.
  4. Insulate valves using preformed fitting insulation or sectional pipe insulation of same material, density, and thickness as used for adjacent pipe. Overlap adjoining pipe insulation by not less than two times the thickness of pipe insulation, or one pipe diameter, whichever is thicker. For valves, insulate up to and including the bonnets, valve stuffing-box studs, bolts, and nuts. Fill joints, seams, and irregular surfaces with insulating cement.
  5. Insulate strainers using preformed fitting insulation or sectional pipe insulation of same material, density, and thickness as used for adjacent pipe. Overlap adjoining pipe insulation by not less than two times the thickness of pipe insulation, or one pipe diameter, whichever is thicker. Fill joints, seams, and irregular surfaces with insulating cement. Insulate strainers so strainer basket flange or plug can be easily removed and replaced without damaging the insulation and jacket. Provide a removable reusable insulation cover. For below ambient services, provide a design that maintains vapor barrier.
  6. Insulate flanges and unions using a section of oversized preformed pipe insulation. Overlap adjoining pipe insulation by not less than two times the thickness of pipe insulation, or one pipe diameter, whichever is thicker.
  7. Cover segmented insulated surfaces with a layer of finishing cement and coat with a mastic. Install vapor-barrier mastic for below ambient services and a breather mastic for above ambient services. Reinforce the mastic with fabric-reinforcing mesh. Trowel the mastic to a smooth and well-shaped contour.
  8. For services not specified to receive a field-applied jacket except for flexible elastomeric and polyolefin, install fitted PVC cover over elbows, tees, strainers, valves, flanges, and unions. Terminate ends with PVC end caps. Tape PVC covers to adjoining insulation facing using PVC tape.
  9. Stencil or label the outside insulation jacket of each union with the word "UNION." Match size and color of pipe labels.
- C. Insulate instrument connections for thermometers, pressure gages, pressure temperature taps, test connections, flow meters, sensors, switches, and transmitters on insulated pipes, vessels, and equipment. Shape insulation at these connections by tapering it to and around the connection with insulating cement and finish with finishing cement, mastic, and flashing sealant.
- D. Install removable insulation covers at locations indicated. Installation shall conform to the following:

1. Make removable flange and union insulation from sectional pipe insulation of same thickness as that on adjoining pipe. Install same insulation jacket as adjoining pipe insulation.
2. When flange and union covers are made from sectional pipe insulation, extend insulation from flanges or union long at least two times the insulation thickness over adjacent pipe insulation on each side of flange or union. Secure flange cover in place with stainless-steel or aluminum bands. Select band material compatible with insulation and jacket.
3. Construct removable valve insulation covers in same manner as for flanges except divide the two-part section on the vertical center line of valve body.
4. When covers are made from block insulation, make two halves, each consisting of mitered blocks wired to stainless-steel fabric. Secure this wire frame, with its attached insulation, to flanges with tie wire. Extend insulation at least 2 inches over adjacent pipe insulation on each side of valve. Fill space between flange or union cover and pipe insulation with insulating cement. Finish cover assembly with insulating cement applied in two coats. After first coat is dry, apply and trowel second coat to a smooth finish.
5. Unless a PVC jacket is indicated in field-applied jacket schedules, finish exposed surfaces with a metal jacket.

### 3.6 MINERAL-FIBER INSULATION INSTALLATION

#### A. Insulation Installation on Straight Pipes and Tubes:

1. Secure each layer of preformed pipe insulation to pipe with wire or bands and tighten bands without deforming insulation materials.
2. Where vapor barriers are indicated, seal longitudinal seams, end joints, and protrusions with vapor-barrier mastic and joint sealant.
3. For insulation with factory-applied jackets on above ambient surfaces, secure laps with outward clinched staples at 6 inches o.c.
4. For insulation with factory-applied jackets on below ambient surfaces, do not staple longitudinal tabs but secure tabs with additional adhesive as recommended by insulation material manufacturer and seal with vapor-barrier mastic and flashing sealant.

#### B. Insulation Installation on Pipe Fittings and Elbows:

1. Install preformed sections of same material as straight segments of pipe insulation when available.
2. When preformed insulation elbows and fittings are not available, install mitered sections of pipe insulation, to a thickness equal to adjoining pipe insulation. Secure insulation materials with wire or bands.

#### C. Insulation Installation on Valves and Pipe Specialties:

1. Install preformed sections of same material as straight segments of pipe insulation when available.
2. When preformed sections are not available, install mitered sections of pipe insulation to valve body.

3. Arrange insulation to permit access to packing and to allow valve operation without disturbing insulation.
4. Install insulation to flanges as specified for flange insulation application.

### **3.7 FLEXIBLE ELASTOMERIC INSULATION INSTALLATION**

- A. Seal longitudinal seams and end joints with manufacturers recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.
- B. Insulation Installation on Pipe Flanges:
  1. Install pipe insulation to outer diameter of pipe flange.
  2. Make width of insulation section same as overall width of flange and bolts, plus twice the thickness of pipe insulation.
  3. Fill voids between inner circumference of flange insulation and outer circumference of adjacent straight pipe segments with cut sections of sheet insulation of same thickness as pipe insulation.
  4. Secure insulation to flanges and seal seams with manufacturers recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.
- C. Insulation Installation on Pipe Fittings and Elbows:
  1. Install mitered sections of pipe insulation.
  2. Secure insulation materials and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.
- D. Insulation Installation on Valves and Pipe Specialties:
  1. Install preformed valve covers manufactured of same material as pipe insulation when available.
  2. When preformed valve covers are not available, install cut sections of pipe and sheet insulation to valve body. Arrange insulation to permit access to packing and to allow valve operation without disturbing insulation.
  3. Install insulation to flanges as specified for flange insulation application.
  4. Secure insulation to valves and specialties and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.

### **3.8 FIELD-APPLIED JACKET INSTALLATION**

- A. Where glass-cloth jackets are indicated, install directly over bare insulation or insulation with factory-applied jackets.
  1. Draw jacket smooth and tight to surface with 2-inch overlap at seams and joints.
  2. Embed glass cloth between two 0.062-inch- thick coats of lagging adhesive.
  3. Completely encapsulate insulation with coating, leaving no exposed insulation.

- B. Where PVC jackets are indicated, install with 1-inch overlap at longitudinal seams and end joints; for horizontal applications, install with longitudinal seams along top and bottom of tanks and vessels. Seal with manufacturer's recommended adhesive.
  - 1. Apply two continuous beads of adhesive to seams and joints, one bead under lap and the finish bead along seam and joint edge.
- C. Where metal jackets are indicated, install with 2-inch overlap at longitudinal seams and end joints. Overlap longitudinal seams arranged to shed water. Seal end joints with weatherproof sealant recommended by insulation manufacturer. Secure jacket with stainless-steel bands 12 inches o.c. and at end joints.
- D. Where PVDC jackets are indicated, install as follows:
  - 1. Apply three separate wraps of filament tape per insulation section to secure pipe insulation to pipe prior to installation of PVDC jacket.
  - 2. Wrap factory-presize jackets around individual pipe insulation sections with one end overlapping the previously installed sheet. Install presize jacket with an approximate overlap at butt joint of 2 inches over the previous section. Adhere lap seal using adhesive or SSL, and then apply 1-1/4 circumferences of appropriate PVDC tape around overlapped butt joint.
  - 3. Continuous jacket can be spiral wrapped around a length of pipe insulation. Apply adhesive or PVDC tape at overlapped spiral edge. When electing to use adhesives, refer to manufacturer's written instructions for application of adhesives along this spiral edge to maintain a permanent bond.
  - 4. Jacket can be wrapped in cigarette fashion along length of roll for insulation systems with an outer circumference of 33-1/2 inches or less. The 33-1/2-inch- circumference limit allows for 2-inch- overlap seal. Using the length of roll allows for longer sections of jacket to be installed at one time. Use adhesive on the lap seal. Visually inspect lap seal for "fishmouthing," and use PVDC tape along lap seal to secure joint.
  - 5. Repair holes or tears in PVDC jacket by placing PVDC tape over the hole or tear and wrapping a minimum of 1-1/4 circumferences to avoid damage to tape edges.

### 3.9 FINISHES

- A. Equipment and Pipe Insulation with ASJ, Glass-Cloth, or Other Paintable Jacket Material: Paint jacket with paint system identified below and as specified in Division 9 painting Sections.
  - 1. Flat Acrylic Finish: Two finish coats over a primer that is compatible with jacket material and finish coat paint. Add fungicidal agent to render fabric mildew proof.
    - a. Finish Coat Material: Interior, flat, latex-emulsion size.
- B. Color: Final color as selected by Architect. Vary first and second coats to allow visual inspection of the completed Work.
- C. Do not field paint aluminum or stainless-steel jackets.

### **3.10 FIELD QUALITY CONTROL**

- A. Testing Agency: Engage a qualified testing agency to perform tests and inspections.
- B. Perform tests and inspections.
- C. Tests and Inspections:
  - 1. Inspect field-insulated equipment, randomly selected by Architect, by removing field-applied jacket and insulation in layers in reverse order of their installation. Extent of inspection shall be limited to one location(s) for each type of equipment defined in the "Equipment Insulation Schedule" Article. For large equipment, remove only a portion adequate to determine compliance.
  - 2. Inspect pipe, fittings, strainers, and valves, randomly selected by Architect, by removing field-applied jacket and insulation in layers in reverse order of their installation. Extent of inspection shall be limited to three locations of straight pipe, three locations of threaded fittings, three locations of welded fittings, two locations of threaded strainers, two locations of welded strainers, three locations of threaded valves, and three locations of flanged valves for each pipe service defined in the "Piping Insulation Schedule, General" Article.
- D. All insulation applications will be considered defective Work if sample inspection reveals noncompliance with requirements.

### **3.11 PIPING INSULATION SCHEDULE, GENERAL**

- A. Acceptable preformed pipe and tubular insulation materials and thicknesses are identified for each piping system and pipe size range. If more than one material is listed for a piping system, selection from materials listed is Contractor's option.
- B. Pipe insulation exposed in return air plenums shall be noncombustible or shall be listed and labeled as having a flame spread index of not more than 25 and a smoke-developed index of not more than 50 when tested in accordance with ASTM E 84 or UL 723.
- C. Items Not Insulated: Unless otherwise indicated, do not install insulation on the following:
  - 1. Underground piping.
  - 2. Chrome-plated pipes and fittings unless there is a potential for personnel injury.

### **3.12 INDOOR PIPING INSULATION SCHEDULE**

- A. Domestic Cold Water:
  - 1. NPS 2 and Smaller: Insulation shall be the following:
    - a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1 inch thick.
  - 2. NPS 2-1/2 and Larger: Insulation shall be the following:
    - a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1½ inch thick.

- B. Domestic Hot and Recirculated Hot Water:
  - 1. NPS 2 and Smaller: Insulation shall be the following:
    - a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1 inch thick.
  - 2. NPS 2-1/2 and Larger: Insulation shall be the following:
    - a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1½ inch thick.
- C. Stormwater and Overflow (all horizontal and vertical piping):
  - 1. All Pipe Sizes: Insulation shall be the following:
    - a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1 inch thick.
- D. Roof Drain and Overflow Drain Bodies:
  - 1. All Pipe Sizes: Insulation shall be the following:
    - a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1 inch thick.
- E. Exposed Sanitary Drains, Domestic Water, Domestic Hot Water, and Stops for Plumbing Fixtures for People with Disabilities:
  - 1. All Pipe Sizes: Insulation shall be the following:
    - a. Flexible Elastomeric: 3/4 inch thick.
    - b. Polyolefin: 3/4 inch thick.

### **3.13 INDOOR, FIELD-APPLIED JACKET SCHEDULE**

- A. Install jacket over insulation material. For insulation with factory-applied jacket, install the field-applied jacket over the factory-applied jacket.
- B. If more than one material is listed, selection from materials listed is Contractor's option.
- C. Equipment, Concealed:
  - 1. None.
- D. Piping, Exposed:
  - 1. PVC: 30 mils thick.
  - 2. Aluminum, Smooth: 0.032 inch thick.
  - 3. Painted Aluminum, Smooth: 0.032 inch thick.

**END OF SECTION 220719**



## **SECTION 221116 – DOMESTIC WATER PIPING**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes Domestic Water Piping from locations indicated to fixtures and equipment inside building.

#### **1.3 DEFINITIONS**

- A. Water Service Piping: Water piping outside building that conveys water to building.
- B. Service Entrance Piping: Water piping at entry into building between water service piping and Domestic Water Piping.
- C. Domestic Water Piping: Water piping inside building that conveys water to fixtures and equipment throughout the building.
- D. The following are industry abbreviations for plastic piping materials:
  - 1. CPVC: Chlorinated polyvinyl chloride.
  - 2. PVC: Polyvinyl chloride.

#### **1.4 SYSTEM PERFORMANCE REQUIREMENTS**

- A. Provide components and installation capable of producing piping systems with the following minimum working-pressure ratings, unless otherwise indicated:
  - 1. Combined Fire-Protection and Domestic, Service Entrance Piping: 200 psig.
  - 2. Service Entrance Piping: 150 psig.
  - 3. Domestic Water Piping: 150 psig.

#### **1.5 QUALITY ASSURANCE**

- A. Provide listing/approval stamp, label, or other marking on piping made to specified standards.

### **PART 2 - PRODUCTS**

## 2.1 COPPER TUBE AND FITTINGS

- A. Hard Copper Tube: ASTM B 88, Type L and ASTM B 88, Type M water tube, drawn temper.
- B. Tube in "Soft Copper Tube" Paragraph below is available in NPS 1/8 to NPS 12 (DN 6 to DN 300).
- C. Soft Copper Tube: ASTM B 88, Type K water tube, annealed temper.
- D. Fittings in "Cast-Copper, Solder-Joint Fittings" Paragraph below are available in NPS 1/4 to NPS 12 (DN 8 to DN 300).
- E. Cast-Copper, Solder-Joint Fittings: ASME B16.18, pressure fittings.
- F. Fittings in "Wrought-Copper, Solder-Joint Fittings" Paragraph below are available in NPS 1/4 to NPS 8 (DN 8 to DN 200).
- G. Wrought-Copper, Solder-Joint Fittings: ASME B16.22, wrought-copper pressure fittings.
- H. Flanges in "Bronze Flanges" Paragraph below are available in NPS 1/2 to NPS 12 (DN 15 to DN 300).
- I. Bronze Flanges: ASME B16.24, Class 150, with solder-joint ends.
- J. Unions in "Copper Unions" Paragraph below are available in NPS 1/4 to NPS 4 (DN 8 to DN 100).
- K. Copper Unions:
  - 1. MSS SP-123.
  - 2. Cast-copper-alloy, hexagonal-stock body.
  - 3. Ball-and-socket, metal-to-metal seating surfaces.
  - 4. Solder-joint or threaded ends.
- L. Copper Pressure-Seal-Joint Fittings:
  - 1. Fittings for NPS 2 (DN 50) and Smaller: Wrought-copper fitting with EPDM-rubber, O-ring seal in each end.
  - 2. Fittings for NPS 2-1/2 to NPS 4 (DN 65 to DN 100): Cast-bronze or wrought-copper fitting with EPDM-rubber, O-ring seal in each end.
- M. Appurtenances for Grooved-End Copper Tubing:
  - 1. Bronze Fittings for Grooved-End, Copper Tubing: ASTM B 75 (ASTM B 75M) copper tube or ASTM B 584 bronze castings.
  - 2. Mechanical Couplings for Grooved-End Copper Tubing:
    - a. Copper-tube dimensions and design similar to AWWA C606.
    - b. Ferrous housing sections.
    - c. EPDM-rubber gaskets suitable for hot and cold water.

- d. Bolts and nuts.
- e. Minimum Pressure Rating: 300 psig (2070 kPa).

## **2.2 JOINING MATERIALS**

- A. General: Applications of the following piping joining materials are indicated in Part 3 "Piping Applications" Article.
- B. Solder: ASTM B 32, Alloy Sn95; lead free.
- C. Transition Couplings: Coupling or other manufactured fitting same size as, with pressure rating at least equal to, and with ends compatible with piping to be joined.

## **PART 3 - EXECUTION**

### **3.1 PIPING APPLICATIONS**

- A. Transition and special fittings with pressure ratings at least equal to piping pressure rating may be used in applications below, unless otherwise indicated.
- B. Flanges may be used on aboveground piping, unless otherwise indicated.
- C. Aboveground, Domestic Water Piping Mains: Use the following:
  - 1. 2-1/2-Inch NPS and Smaller: Hard copper tube, Type L; copper, solder-joint fittings; and soldered joints.
  - 2. 3 to 4-Inch NPS : Hard copper tube, Type L; copper, solder-joint fittings; and soldered joints.
- D. Aboveground, Domestic Water Piping Branches (downstream of shut-off valves): Use the following:
  - 1. 2-1/2-Inch NPS and Smaller: Hard copper tube, Type L; copper, solder-joint fittings; and soldered joints.
  - 2. 3 to 4-Inch NPS : Hard copper tube, Type L; copper, solder-joint fittings; and soldered joints.

### **3.2 VALVE APPLICATIONS**

- A. Drawings indicate valve types to be used. Where specific valve types are not indicated, the following requirements apply:
  - 1. Shutoff Duty: Use ball, or butterfly valves.
- B. Grooved-end butterfly valves may be used with grooved-end piping.

### **3.3 PIPING INSTALLATION, GENERAL**

- A. Refer to Division 22 Section "Basic Plumbing Requirements" for basic piping installation.

### **3.4 SERVICE ENTRANCE PIPING INSTALLATION**

- A. Extend service entrance piping to exterior water service piping in sizes and locations indicated for service entrances into building.
- B. Install shutoff valve, hose-end drain valve, strainer, pressure gage, and test tee with valve, inside building at each service entrance pipe.
- C. Install cast-iron sleeve with water stop and mechanical sleeve seal at each service entrance pipe penetration through foundation wall. Select number of interlocking rubber links required to make installation watertight. Refer to Division 22 Section "Basic Mechanical Materials and Methods" for sleeves and mechanical sleeve seals.
- D. Install wall penetration system at each service entrance pipe penetration through foundation wall. Make installation watertight. Refer to Division 22 Section "Basic Mechanical Materials and Methods" for wall penetration systems.

### **3.5 DOMESTIC WATER PIPING INSTALLATION**

- A. Install piping with 0.25 percent slope downward toward drain.

### **3.6 JOINT CONSTRUCTION**

- A. Refer to Division 22 Section "Basic Plumbing Requirements" for basic piping joint construction.
- B. Grooved Joints: Assemble joints with coupling, gasket, lubricant, and bolts according to coupling and fitting manufacturer's written instructions.

### **3.7 VALVE INSTALLATION**

- A. Sectional Valves: Install sectional valves close to main on each branch and riser serving plumbing fixtures or equipment, and where indicated. Use ball valves for piping 2-inch NPS and smaller. Use butterfly valves for piping 2-1/2-inch NPS and larger.
- B. Shutoff Valves: Install shutoff valve on each water supply to equipment, on each supply to plumbing fixtures without supply stops, and where indicated. Use ball valves for piping 2-inch NPS and smaller. Use butterfly valves for piping 2-1/2-inch NPS and larger.
- C. Drain Valves: Install drain valves for equipment, at base of each water riser, at low points in horizontal piping, and where required to drain water piping.
  - 1. Install hose-end drain valves at low points in water mains, risers, and branches.

- D. Balancing Valves: Install in each hot-water circulation return branch, discharge side of each pump and circulator, and where indicated.

### 3.8 HANGER AND SUPPORT INSTALATION

- A. Comply with requirements in Division 22 Section "Hangers and Supports for Plumbing Piping and Equipment" for pipe hanger and support products and installation.
  - 1. Vertical Piping: MSS Type 8 or 42, clamps.
  - 2. Individual, Straight, Horizontal Piping Runs:
    - a. 100 Feet (30 m) and Less: MSS Type 1, adjustable, steel clevis hangers.
    - b. Longer Than 100 Feet (30 m): MSS Type 43, adjustable roller hangers.
    - c. Longer Than 100 Feet (30 m) If Indicated: MSS Type 49, spring cushion rolls.
  - 3. Multiple, Straight, Horizontal Piping Runs 100 Feet (30 m) or Longer: MSS Type 44, pipe rolls. Support pipe rolls on trapeze.
  - 4. Base of Vertical Piping: MSS Type 52, spring hangers.
- B. Support vertical piping and tubing at base and at each floor.
- C. Rod diameter may be reduced one size for double-rod hangers, to a minimum of 3/8 inch (10 mm).
- D. Install hangers for copper tubing with the following maximum horizontal spacing and minimum rod diameters:
  - 1. NPS 3/4 (DN 20) and Smaller: 60 inches (1500 mm) with 3/8-inch (10-mm) rod.
  - 2. NPS 1 and NPS 1-1/4 (DN 25 and DN 32): 72 inches (1800 mm) with 3/8-inch (10-mm) rod.
  - 3. NPS 1-1/2 and NPS 2 (DN 40 and DN 50): 96 inches (2400 mm) with 3/8-inch (10-mm) rod.
  - 4. NPS 2-1/2 (DN 65): 108 inches (2700 mm) with 1/2-inch (13-mm) rod.
  - 5. NPS 3 to NPS 5 (DN 80 to DN 125): 10 feet (3 m) with 1/2-inch (13-mm) rod.
  - 6. NPS 6 (DN 150): 10 feet (3 m) with 5/8-inch (16-mm) rod.
  - 7. NPS 8 (DN 200): 10 feet (3 m) with 3/4-inch (19-mm) rod.
- E. Install supports for vertical copper tubing every 10 feet (3 m).
- F. Install hangers for galvanized steel piping with the following maximum horizontal spacing and minimum rod diameters:
  - 1. NPS 8 to NPS 12 (DN 200 to DN 300): 12 feet (3.7 m) with 7/8-inch (22-mm) rod.
- G. Install supports for vertical steel piping every 15 feet (4.5 m).
- H. Support piping and tubing not listed in this article according to MSS SP-69 and manufacturer's written instructions.

### 3.9 CONNECTIONS

- A. Connect service entrance piping to exterior water service piping. Use transition fitting to join dissimilar piping materials.
- B. Connect Domestic Water Piping to service entrance piping at shutoff valve, and extend to and connect to the following:
  - 1. Booster Systems: Connect cold-water suction and discharge piping.
  - 2. Water Heaters: Connect cold-water supply and hot-water outlet piping in sizes indicated, but not smaller than sizes of water heater connections.
  - 3. Plumbing Fixtures: Connect hot- and cold-water supply piping in sizes indicated, but not smaller than required by plumbing code. Refer to Division 22 Section "Plumbing Fixtures."
  - 4. Equipment: Connect hot- and cold-water supply piping as indicated. Provide shutoff valve and union for each connection. Use flanges instead of unions for connections 2-1/2-inch NPS and larger.

### 3.10 FIELD QUALITY CONTROL

- A. Inspect Domestic Water Piping as follows:
  - 1. Inspect service entrance piping and Domestic Water Piping as follows:
    - a. Do not enclose, cover, or put piping into operation until it is inspected and approved by authorities having jurisdiction.
    - b. During installation, notify authorities having jurisdiction at least 24 hours before inspection must be made. Perform tests specified below in presence of authorities having jurisdiction.
    - c. Roughing-In Inspection: Arrange for inspection of piping before concealing or closing-in after roughing-in and before setting fixtures.
    - d. Final Inspection: Arrange for final inspection by authorities having jurisdiction to observe tests specified below and to ensure compliance with requirements.
    - e. Reinspection: If authorities having jurisdiction find that piping will not pass test or inspection, make required corrections and arrange for reinspection.
    - f. Reports: Prepare inspection reports and have them signed by authorities having jurisdiction.
  - 2. Test service entrance piping and Domestic Water Piping as follows:
    - a. Test for leaks and defects in new piping and parts of existing piping that have been altered, extended, or repaired. If testing is performed in segments, submit separate report for each test, complete with diagram of portion of piping tested.
    - b. Leave uncovered and unconcealed new, altered, extended, or replaced water piping until it has been tested and approved. Expose work that has been covered or concealed before it has been tested and approved.
    - c. Cap and subject piping to static water pressure of 150 psig. Isolate test source and allow to stand for 4 hours. Leaks and loss in test pressure constitute defects that

must be repaired.

- d. Repair leaks and defects with new materials and retest piping or portion thereof until satisfactory results are obtained.
- e. Prepare reports for tests and required corrective action.

### **3.11 CLEANING**

- A. Clean and disinfect service entrance piping and Domestic Water Piping as follows:
  1. Purge new piping and parts of existing water piping that have been altered, extended, or repaired before using.
  2. Use purging and disinfecting procedure prescribed by authorities having jurisdiction or, if method is not prescribed, procedure described in either AWWA C651 or AWWA C652 or as described below:
    - a. Flush piping system with clean, potable water until dirty water does not appear at outlets.
    - b. Fill and isolate system according to either of the following:
      - 1) Fill system or part thereof with water/chlorine solution with at least 50 ppm of chlorine. Isolate with valves and allow to stand for 24 hours.
      - 2) Fill system or part thereof with water/chlorine solution with at least 200 ppm of chlorine. Isolate and allow to stand for 3 hours.
    - c. Flush system with clean, potable water until chlorine is no longer in water coming from system after the standing time.
    - d. Submit water samples in sterile bottles to authorities having jurisdiction. Repeat procedure if biological examination shows contamination.
- B. Prepare and submit reports for purging and disinfecting activities.
- C. Clean interior of piping system. Remove dirt and debris as work progresses.

### **3.12 COMMISSIONING**

- A. Fill water piping. Check components to determine that they are not air bound and that piping is full of water.
- B. Perform the following steps before putting into operation:
- C. Close drain valves, hydrants, and hose bibbs.
  1. Open shutoff valves to fully open position.
  2. Set balancing valves to proper setting.
  3. Remove plugs used during testing of piping and plugs used for temporary sealing of piping during installation.
  4. Remove and clean strainer screens. Close drain valves and replace drain plugs.
  5. Remove filter cartridges from housings and verify that cartridges are as specified for

application where used and that cartridges are clean and ready for use.

- D. Check plumbing equipment and verify proper settings, adjustments, and operation. Do not operate water heaters before filling with water.
- E. Check plumbing specialties and verify proper settings, adjustments, and operation.
  - 1. Water-Pressure Regulators: Set outlet pressure at 80 psig maximum, unless otherwise indicated.
- F. Energize pumps and verify proper operation.

**END OF SECTION 221116**



## **SECTION 221119 – DOMESTIC WATER PIPING SPECIALTIES**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes the following domestic water piping specialties:
  - 1. Vacuum breakers.
  - 2. Thermostatic mixing valves.
  - 3. Strainers.
  - 4. Hose bibbs.
  - 5. Wall hydrants.
  - 6. Drain valves.
  - 7. Water hammer arresters.
  - 8. Air vents.
- B. Related Sections include the following:
  - 1. Division 22 Section "Meters and Gages for Plumbing Piping" for thermometers, pressure gages, and flow meters in domestic water piping.

#### **1.3 PERFORMANCE REQUIREMENTS**

- A. Minimum Working Pressure for Domestic Water Piping Specialties: 125 psig, unless otherwise indicated.

#### **1.4 SUBMITTALS**

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: Diagram power, signal, and control wiring.
- C. Field quality-control test reports.
- D. Operation and Maintenance Data: For domestic water piping specialties to include in emergency, operation, and maintenance manuals.

## **1.5 QUALITY ASSURANCE**

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- B. NSF Compliance:
  - 1. Comply with NSF 61, "Drinking Water System Components - Health Effects; Sections 1 through 9."

## **PART 2 - PRODUCTS**

### **2.1 VACUUM BREAKERS**

- A. Pipe-Applied, Atmospheric-Type Vacuum Breakers:
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Ames Co.
    - b. Conbraco Industries, Inc.
    - c. Watts Industries, Inc.; Water Products Div.
    - d. Zurn Plumbing Products Group; Wilkins Div.
  - 2. Standard: ASSE 1001.
  - 3. Size: NPS 1/4 to NPS 3, as required to match connected piping.
  - 4. Body: Bronze.
  - 5. Inlet and Outlet Connections: Threaded.
  - 6. Finish: Chrome plated.
- B. Hose-Connection Vacuum Breakers:
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Conbraco Industries, Inc.
    - b. Watts Industries, Inc.; Water Products Div.
    - c. Woodford Manufacturing Company.
    - d. Zurn Plumbing Products Group; Light Commercial Operation.
  - 2. Standard: ASSE 1011.
  - 3. Body: Bronze, nonremovable, with manual drain.
  - 4. Outlet Connection: Garden-hose threaded complying with ASME B1.20.7.
  - 5. Finish: Chrome or nickel plated.

## 2.2 TEMPERATURE-ACTUATED, WATER MIXING VALVES

- A. Primary, Thermostatic, Water Mixing Valves:
1. Manufacturers:
    - a. Leonard.
    - b. Watts.
    - c. Bradley Corp.
  2. Standard: ASSE 1017.
  3. Pressure Rating: 125 psig (860 kPa) minimum unless otherwise indicated.
  4. Type: Exposed-mounted, thermostatically controlled, water mixing valve.
  5. Material: Bronze body with corrosion-resistant interior components.
  6. Connections: Threaded union inlets and outlet.
  7. Accessories: Manual temperature control, check stops on hot- and cold-water supplies, and adjustable, temperature-control handle.
  8. Tempered-Water Setting: See sheet P-602.
  9. Tempered-Water Design Flow Rate: See sheet P-602.
  10. Selected Valve Flow Rate at 10-psig Pressure Drop: See sheet P-602.
  11. Pressure Drop at Design Flow Rate: See sheet P-602.
  12. Valve Finish: Rough bronze.
  13. Piping Finish: Copper.
- B. Primary, Electronic, Water Mixing Valve Assemblies – Alternate #1:
1. Manufacturers:
    - a. Leonard.
    - b. Watts.
    - c. Bradley Corp.
  2. Standard: ASSE 1017.
  3. Pressure Rating: 125 psig (860 kPa) minimum unless otherwise indicated.
  4. Type: Exposed, electronically controlled, water mixing valve.
  5. Material: Bronze body with corrosion-resistant interior components.
  6. Connections: Threaded or solder joint inlets and outlet.
  7. Accessories: Manual temperature override control, check stops on hot- and cold-water supplies, and automatic hot- and cold-water shutoff upon inlet supply failure.
  8. Tempered-Water Setting: See sheet P-602.
  9. Tempered-Water Design Flow Rate: See sheet P-602.
  10. Selected Valve Flow Rate at 10-psig Pressure Drop: See sheet P-602.
  11. Pressure Drop at Design Flow Rate: See sheet P-602.
  12. Valve Finish: Bronze.

13. Digital temperature control and monitoring module.
  - a. Controls temperature within plus or minus 2 deg F (1 deg C).
  - b. User programmable at module or through BAS.
  - c. ASHRAE 188 compliance.
  - d. Local and remote monitoring.
  - e. BACNet, Modbus, Metasys, Ethernet protocol language(s).
  - f. 120 V ac, 60 Hz.
  - g. Battery backup.

### **2.3 BACKFLOW PREVENTERS**

#### **A. Reduced-Pressure-Principle Backflow Preventers:**

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Watts Industries, Inc.; Water Products Div
  - b. Conbraco Industries, Inc.
  - c. Ames
  - d. Zurn Plumbing Products Group; Wilkins Div.
2. Standard: ASSE 1013.
3. Operation: Continuous-pressure applications.
4. Pressure Loss: 12 psig maximum, through middle 1/3 of flow range.
5. Size: See plans.
6. Pressure Loss at Design Flow Rate: 10 psig for sizes NPS 2 and smaller.
7. Body: Bronze for NPS 2 and smaller.
8. End Connections: Solder or flanged.
9. Configuration: Designed for horizontal, straight through flow.
10. Accessories:
  - a. Valves: Ball type with threaded ends on inlet and outlet of NPS 3 and smaller.
  - b. Air-Gap Fitting: ASME A112.1.2, matching backflow-preventer connection.

### **2.4 STRAINERS FOR DOMESTIC WATER PIPING**

#### **A. Y-Pattern Strainers:**

1. Pressure Rating: 125 psig minimum, unless otherwise indicated.
2. Body: Bronze for NPS 2 and smaller.
3. End Connections: Threaded for NPS 2 and smaller.
4. Screen: Stainless steel with round perforations, unless otherwise indicated.
5. Perforation Size:

- a. Strainers NPS 3 and Smaller: 0.020 inch.
6. Drain: Factory-installed, hose-end drain valve.

## 2.5 WALL HYDRANTS

### A. Nonfreeze Wall Hydrants/Hose Bibbs:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
  - b. Chicago Faucets
  - c. Watts Industries.
  - d. Woodford Manufacturing Company.
  - e. Zurn Plumbing Products Group; Specification Drainage Operation.
2. Standard: ASME A112.21.3M for concealed exposed-outlet, self-draining wall hydrants.
3. Pressure Rating: 125 psig.
4. Operation: Loose key.
5. Casing and Operating Rod: Of length required to match wall thickness. Include wall clamp.
6. Inlet: NPS 3/4.
7. Outlet: Concealed, with integral vacuum breaker and garden-hose thread complying with ASME B1.20.7.
8. Box: Deep, flush mounting with cover.
9. Box and Cover Finish: Polished nickel bronze.
10. Nozzle and Wall-Plate Finish: Rough bronze.
11. Operating Keys(s): One with each wall hydrant.

## 2.6 DRAIN VALVES

### A. Ball-Valve-Type, Hose-End Drain Valves:

1. Standard: MSS SP-110 for standard-port, two-piece ball valves.
2. Pressure Rating: 400-psig minimum CWP.
3. Size: NPS 3/4.
4. Body: Copper alloy.
5. Ball: Chrome-plated brass.
6. Seats and Seals: Replaceable.
7. Handle: Vinyl-covered steel.
8. Inlet: Threaded or solder joint.

9. Outlet: Threaded, short nipple with garden-hose thread complying with ASME B1.20.7 and cap with brass chain.

## **2.7 WATER HAMMER ARRESTERS**

- A. Water Hammer Arresters:
  1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Sioux Chief Manufacturing Company, Inc.
    - b. PPP Inc.
    - c. Zurn Plumbing Products Group; Specification Drainage Operation.
  2. Standard: ASSE 1010 or PDI-WH 201.
  3. Type: Copper tube with piston.
  4. Size: ASSE 1010, Sizes AA and A through F or PDI-WH 201, Sizes A through F.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Refer to Division 21 Section "Basic Plumbing Requirements" for piping joining materials, joint construction, and basic installation requirements.
- B. Install backflow preventers in each water supply to mechanical equipment and systems and to other equipment and water systems that may be sources of contamination. Comply with authorities having jurisdiction.
  1. Locate backflow preventers in same room as connected equipment or system.
  2. Install drain for backflow preventers with atmospheric-vent drain connection with air-gap fitting, fixed air-gap fitting, and pipe to floor drain. Locate air-gap device attached to or under backflow preventer. Simple air breaks are not acceptable for this application.
  3. Do not install bypass piping around backflow preventers.
- C. Install thermostatic mixing valves with check stops or shutoff valves on inlets and with shutoff valve on outlet.
  1. Install thermometers and water regulators if specified.
- D. Install water hammer arresters in water piping according to PDI-WH 201 above ceiling with access panel in ceiling.

### **3.2 CONNECTIONS**

- A. Piping installation requirements are specified in other Division 21 Sections. Drawings indicate general arrangement of piping and specialties.

- B. Ground equipment according to Division 26 Section "Grounding and Bonding."
- C. Connect wiring according to Division 26 Section "Conductors and Cables."

### **3.3 LABELING AND IDENTIFYING**

- A. Equipment Nameplates and Signs: Install engraved plastic-laminate equipment nameplate or sign on or near each of the following:
  - 1. Pressure vacuum breakers.
  - 2. Reduced-pressure-principle backflow preventers.
  - 3. Primary water tempering valves.
- B. Distinguish among multiple units, inform operator of operational requirements, indicate safety and emergency precautions, and warn of hazards and improper operations, in addition to identifying unit. Nameplates and signs are specified in Division 15 Section "Mechanical Identification."

### **3.4 FIELD QUALITY CONTROL**

- A. Perform the following tests and prepare test reports:
  - 1. Test each pressure vacuum breaker and reduced-pressure-principle backflow preventer according to authorities having jurisdiction and the device's reference standard.
- B. Remove and replace malfunctioning domestic water piping specialties and retest as specified above.

### **3.5 ADJUSTING**

- A. Set field-adjustable temperature set points of Thermostatic mixing valves.

**END OF SECTION 221119**

## **SECTION 221123 – DOMESTIC WATER PUMPS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section Includes:
  1. In-line, seal-less centrifugal pumps.
  2. Horizontally mounted, in-line, separately coupled centrifugal pumps.
  3. Horizontally mounted, in-line, close-coupled centrifugal pumps.
  4. Vertically mounted, in-line, close-coupled centrifugal pumps.

#### **1.3 DEFINITIONS**

- A. Low Voltage: As defined in NFPA 70 for circuits and equipment operating at less than 50 V or for remote-control, signaling power-limited circuits.

#### **1.4 SUBMITTALS**

- A. Product Data: For each type of product indicated. Include materials of construction, rated capacities, certified performance curves with operating points plotted on curves, operating characteristics, electrical characteristics, and furnished specialties and accessories.
- B. Operation and Maintenance Data: For domestic water pumps to include in operation and maintenance manuals.

#### **1.5 QUALITY ASSURANCE**

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. UL Compliance: Comply with UL 778 for motor-operated water pumps.

#### **1.6 DELIVERY, STORAGE, AND HANDLING**

- A. Retain shipping flange protective covers and protective coatings during storage.



- B. Protect bearings and couplings against damage.
- C. Comply with pump manufacturer's written rigging instructions for handling.

### 1.7 COORDINATION

- A. Coordinate sizes and locations of concrete bases with actual equipment provided.

## PART 2 - PRODUCTS

### 2.1 IN-LINE CIRCULATORS

- A. Basis-of-Design Product: Subject to compliance with requirements, provide comparable product by one of the following:
  - 1. Armstrong Pumps Inc.
  - 2. Bell & Gossett Domestic Pump; ITT Corporation.
  - 3. Grundfos Pumps Corp.
- B. Description: Factory-assembled and -tested, in-line, close-coupled, canned-motor, sealless, overhung-impeller centrifugal pumps.
- C. Pump Construction:
  - 1. Pump and Motor Assembly: Hermetically sealed, replaceable-cartridge type with motor and impeller on common shaft and designed for installation with pump and motor shaft horizontal.
  - 2. Casing: Bronze, with threaded or companion-flange connections.
  - 3. Impeller: Non-Ferrous.
  - 4. Motor: Single speed, unless otherwise indicated.
- D. Capacities and Characteristics:
  - 1. Refer to schedule on drawings for capacities.
  - 2. Refer to Equipment Data Schedule on the electrical plans for motor characteristics.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine roughing-in of domestic-water-piping system to verify actual locations of connections before pump installation.

### 3.2 PUMP INSTALLATION

- A. Comply with HI 1.4.
- B. Install in-line, centrifugal pumps with shaft horizontal unless otherwise indicated.
- C. Install vertically mounted, in-line, close-coupled centrifugal pumps with shaft vertical.
- D. Install continuous-thread hanger rods and spring hangers with vertical-limit stop of size required to support pump weight.
  - 1. Comply with requirements for vibration isolation devices specified in Division 22 Section "Vibration and Seismic Controls for Plumbing Piping and Equipment." Fabricate brackets or supports as required.
  - 2. Comply with requirements for hangers and supports specified in Division 22 Section "Hangers and Supports for Plumbing Piping and Equipment."
- E. Install pressure switches in water supply piping.
- F. Install thermostats in hot-water return piping.

### 3.3 CONNECTIONS

- A. Comply with requirements for piping specified in Division 22 Section "Domestic Water Piping." Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Install piping adjacent to pumps to allow service and maintenance.
- C. Connect domestic water piping to pumps. Install suction and discharge piping equal to or greater than size of pump nozzles.
  - 1. Install flexible connectors adjacent to pumps in suction and discharge piping of the following pumps:
    - a. Horizontally mounted, in-line, separately coupled centrifugal pumps.
    - b. Horizontally mounted, in-line, close-coupled centrifugal pumps.
    - c. Vertically mounted, in-line, close-coupled centrifugal pumps.
    - d. Comply with requirements for flexible connectors specified in Division 22 Section "Domestic Water Piping."
  - 2. Install shutoff valve and strainer on suction side of each pump, and check, shutoff, and throttling valves on discharge side of each pump. Install valves same size as connected piping. Comply with requirements for valves specified in Division 22 Section "General-Duty Valves for Plumbing Piping" and comply with requirements for strainers specified in Division 22 Section "Domestic Water Piping Specialties."
  - 3. Install pressure gage at suction of each pump and pressure gage at discharge of each pump. Install at integral pressure-gage tappings where provided or install pressure-gage connectors in suction and discharge piping around pumps. Comply with requirements for

pressure gages and snubbers specified in Division 22 Section "Meters and Gages for Plumbing Piping."

- D. Comply with Division 26 Sections for electrical connections, and wiring methods.
- E. Connect pressure switches, thermostats, to pumps that they control.
- F. Interlock pump between water heater and hot-water storage tank with water heater burner and time-delay relay.

### **3.4 IDENTIFICATION**

- A. Comply with requirements for identification specified in Division 22 Section "Identification for Plumbing Piping and Equipment" for identification of pumps.

### **3.5 STARTUP SERVICE**

- A. Engage a factory-authorized service representative to perform startup service.
  - 1. Complete installation and startup checks according to manufacturer's written instructions.
  - 2. Check piping connections for tightness.
  - 3. Clean strainers on suction piping.
  - 4. Set pressure switches, thermostats, for automatic starting and stopping operation of pumps.
  - 5. Perform the following startup checks for each pump before starting:
    - a. Verify bearing lubrication.
    - b. Verify that pump is free to rotate by hand and that pump for handling hot liquid is free to rotate with pump hot and cold. If pump is bound or drags, do not operate until cause of trouble is determined and corrected.
    - c. Verify that pump is rotating in the correct direction.
  - 6. Prime pump by opening suction valves and closing drains, and prepare pump for operation.
  - 7. Start motor.
  - 8. Open discharge valve slowly.
  - 9. Adjust temperature settings on thermostats.
  - 10. Adjust timer settings.

### **3.6 ADJUSTING**

- A. Adjust domestic water pumps to function smoothly, and lubricate as recommended by manufacturer.
- B. Adjust initial temperature set points.

- C. Set field-adjustable switches and circuit-breaker trip ranges as indicated.

**END OF SECTION 221123**

## **SECTION 223450 – COMMERCIAL HOT WATER STORAGE TANKS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section Includes:
  - 1. Domestic hot water storage tanks.
  - 2. Domestic-water heater accessories.

#### **1.3 SUBMITTALS**

- A. Product Data: For each type and size of domestic-water storage tank and accessories. Include rated capacities, operating characteristics, electrical characteristics, and furnished specialties and accessories.
- B. Product Certificates: For each type of commercial, domestic hot water storage tank, from manufacturer.

Operation and Maintenance Data: For domestic hot water storage tank to include in emergency, operation, and maintenance manuals.

#### **1.4 QUALITY ASSURANCE**

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. NSF Compliance: Fabricate and label equipment components that will be in contact with potable water to comply with NSF 61, "Drinking Water System Components - Health Effects."

#### **1.5 COORDINATION**

- A. Coordinate sizes and locations of concrete bases with actual equipment provided.

#### **1.6 WARRANTY**

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace components of domestic hot water storage tank that fail in materials or workmanship

within specified warranty period.

1. Failures include, but are not limited to, the following:
  - a. Structural failures including storage tank and supports.  
Deterioration of metals, metal finishes, and other materials beyond normal use.
2. Warranty Periods: From date of Substantial Completion.
  - a. Commercial, Domestic Hot Water Storage Tank:
    - 1) Storage Tank: Fifteen (15) years.

## **PART 2 - PRODUCTS**

### **2.1 COMMERCIAL, HOT WATER STORAGE TANK**

#### **A. Commercial, hot water, storage tank:**

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:  
PVI Industries  
Niles Steel Tank  
AERCO a Watts Brand
2. Standard: ANSI Z21.10.3/CSA 4.3.  
Storage-Tank Construction: ASME, ASHRAE 90.1, NSF 61 Duplex 2205 Duplex stainless steel with 150-psig working-pressure rating.
  - a. Tappings: Factory fabricated of materials compatible with tank. Attach tappings to tank before testing.
    - 1) NPS 2 (DN 50) and Smaller: Threaded ends according to ASME B1.20.1.  
NPS 2-1/2 (DN 65) and Larger: Flanged ends according to ASME B16.5 for steel and stainless-steel flanges and according to ASME B16.24 for copper and copper-alloy flanges.
  - b. Interior Finish: Comply with NSF 61 barrier materials for potable-water tank linings, including extending finish into and through tank fittings and outlets.
3. Factory-Installed Storage-Tank Appurtenances:
  - a. Anode Rod: Replaceable magnesium.  
Dip Tube: Required unless cold-water inlet is near bottom of tank.  
Drain Valve: Corrosion-resistant metal complying with ASSE 1005.  
Insulation: Comply with ASHRAE/IESNA 90.1. Surround entire storage tank except connections and controls.  
Jacket: Steel with enameled finish.

### **2.2 DOMESTIC-WATER HEATER ACCESSORIES**

- A. Domestic-Water Expansion Tanks:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. AMTROL Inc.
    - b. Flexcon Industries.
    - c. Honeywell International Inc.
    - d. Pentair Pump Group (The); Myers.
    - e. Smith, A. O. Water Products Co.; a division of A. O. Smith Corporation.
    - f. State Industries.
    - g. Taco, Inc.
  2. Description: Steel, pressure-rated tank constructed with welded joints and factory-installed butyl-rubber diaphragm. Include air precharge to minimum system-operating pressure at tank.  
Construction:
    - a. Tappings: Factory-fabricated steel, welded to tank before testing and labeling. Include ASME B1.20.1 pipe thread.  
Interior Finish: Comply with NSF 61 barrier materials for potable-water tank linings, including extending finish into and through tank fittings and outlets.
  3. Capacity and Characteristics:
    - a. Working-Pressure Rating: 100 psig .  
Capacity Acceptable: 60 gallons acceptance volume per water heater minimum.
- B. Piping-Type Heat Traps: Field-fabricated piping arrangement according to ASHRAE/IESNA 90.1 or ASHRAE 90.2.
- Gas Shutoff Valves: ANSI Z21.15/CSA 9.1-M, manually operated. Furnish for installation in piping.

### **PART 3 - EXECUTION**

#### **3.1 DOMESTIC-WATER HEATER INSTALLATION**

- A. Commercial, Domestic-Water Storage Tank Mounting: Install commercial domestic-water storage tank on concrete base. Comply with requirements for concrete base specified in Division 03 Section "Cast-in-Place Concrete."
- Maintain manufacturer's recommended clearances.
- Arrange units so controls and devices that require servicing are accessible.
- Install dowel rods to connect concrete base to concrete floor. Unless otherwise indicated, install dowel rods on 18-inch centers around the full perimeter of concrete base.

For supported equipment, install epoxy-coated anchor bolts that extend through concrete base and anchor into structural concrete floor.

Place and secure anchorage devices. Use setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.

Install anchor bolts to elevations required for proper attachment to supported equipment.

- B. Install domestic-water storage tanks level and plumb, according to layout drawings, original design, and referenced standards. Maintain manufacturer's recommended clearances. Arrange units so controls and devices needing service are accessible.
  - 1. Install shutoff valves on domestic-water-supply piping to domestic-water heaters and on domestic-hot-water outlet piping. Comply with requirements for shutoff valves specified in Division 22 Section "General-Duty Valves for Plumbing Piping."
- C. Install combination temperature-and-pressure relief valves in top portion of storage tanks. Use relief valves with sensing elements that extend into tanks. Extend commercial-water-heater relief-valve outlet, with drain piping same as domestic-water piping in continuous downward pitch, and discharge by positive air gap onto closest floor drain.

Install combination temperature-and-pressure relief valves in water piping for domestic-water heaters without storage. Extend commercial-water-heater relief-valve outlet, with drain piping same as domestic-water piping in continuous downward pitch, and discharge by positive air gap onto closest floor drain.

Install water-storage tank drain piping as indirect waste to spill by positive air gap into open drains or over floor drains. Install hose-end drain valves at low points in water piping for domestic-water heaters that do not have tank drains. Comply with requirements for hose-end drain valves specified in Division 22 Section "Domestic Water Piping Specialties."

Install thermometer on outlet piping of domestic-water storage tanks. Comply with requirements for thermometers specified in Division 22 Section "Meters and Gages for Plumbing Piping."

Cold water and hot water piping shall be installed with equal pipe lengths to each heater to balance the flow between storage tanks. Piping shall comply with the manufacturer's installation instructions.

Install piping-type heat traps on inlet and outlet piping of domestic-water heater storage tanks without integral or fitting-type heat traps.

Fill domestic-water storage tanks with water.

Charge domestic-water compression tanks with air.

### **3.2 CONNECTIONS**

- A. Comply with requirements for domestic-water piping specified in Division 22 Section "Domestic Water Piping."



Comply with requirements for gas piping specified in Division 22 Section " Natural-Gas Piping."

Drawings indicate general arrangement of piping, fittings, and specialties.

Where installing piping adjacent to fuel-fired, domestic-water heaters, allow space for service and maintenance of water heaters. Arrange piping for easy removal of domestic-water heaters.

### **3.3 IDENTIFICATION**

- A. Identify system components. Comply with requirements for identification specified in Division 22 Section "Identification for Plumbing Piping and Equipment."

### **3.4 FIELD QUALITY CONTROL**

- A. Perform tests and inspections.
  - 1. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect components, assemblies, and equipment installations, including connections, and to assist in testing.
    - Leak Test: After installation, charge system and test for leaks. Repair leaks and retest until no leaks exist.
    - Operational Test: After electrical circuitry has been energized, start units to confirm proper operation.
    - Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.

Prepare test and inspection reports.

### **3.5 DEMONSTRATION**

- A. Train Owner's maintenance personnel to adjust, operate, and maintain commercial, gas-fired, storage, domestic-water heaters.

**END OF SECTION 223400**

## **SECTION 230900 - INSTRUMENTATION AND CONTROL FOR HVAC**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes control equipment for HVAC systems and components.
- B. Contractor shall be responsible for a complete and operational IP based control system as described within these contract documents.
- C. Contractor shall be responsible for ensuring that new control system does not interfere with existing control system within the Forensics building of this project.

#### **1.3 DEFINITIONS**

- A. DDC: Direct digital control.
- B. I/O: Input/output.
- C. BACnet: Building Automation Control Network Protocol, ASHRAE 135. A communications protocol allowing devices to communicate data over and services over a network. .
- D. MS/TP: Master slave/token passing.
- E. PC: Personal computer.
- F. PID: Proportional plus integral plus derivative.
- G. RTD: Resistance temperature detector.

#### **1.4 SYSTEM PERFORMANCE**

- A. Comply with the following performance requirements:
  - 1. Graphic Display: Display graphic with minimum 20 dynamic points with current data within 10 seconds.
  - 2. Graphic Refresh: Update graphic with minimum 20 dynamic points with current data within 8 seconds.
  - 3. Object Command: Reaction time of less than two seconds between operator command of a binary object and device reaction.
  - 4. Object Scan: Transmit change of state and change of analog values to control units

- or workstation within six seconds.
5. Alarm Response Time: Annunciate alarm at workstation within 45 seconds. Multiple workstations must receive alarms within five seconds of each other.
  6. Program Execution Frequency: Run capability of applications as often as five seconds, but selected consistent with mechanical process under control.
  7. Performance: Programmable controllers shall execute DDC PID control loops, and scan and update process values and outputs at least once per second.
  8. Reporting Accuracy and Stability of Control: Report values and maintain measured variables within tolerances as follows:
    - a. Water Temperature: Plus or minus 1 deg F.
    - b. Water Flow: Plus or minus 5 percent of full scale.
    - c. Water Pressure: Plus or minus 2 percent of full scale.
    - d. Space Temperature: Plus or minus 1 deg F.
    - e. Ducted Air Temperature: Plus or minus 1 deg F.
    - f. Outside Air Temperature: Plus or minus 2 deg F.
    - g. Dew Point Temperature: Plus or minus 3 deg F.
    - h. Temperature Differential: Plus or minus 0.25 deg F.
    - i. Relative Humidity: Plus or minus 5 percent.
    - j. Airflow (Pressurized Spaces): Plus or minus 3 percent of full scale.
    - k. Airflow (Measuring Stations): Plus or minus 5 percent of full scale.
    - l. Airflow (Terminal): Plus or minus 10 percent of full scale.
    - m. Air Pressure (Space): Plus or minus 0.01-inch wg.
    - n. Air Pressure (Ducts): Plus or minus 0.1-inch wg.
    - o. Carbon Monoxide: Plus or minus 5 percent of reading.
    - p. Carbon Dioxide: Plus or minus 50 ppm.
    - q. Electrical: Plus or minus 5 percent of reading.

## 1.5 SEQUENCE OF OPERATION

- A. Refer to drawings for sequence of operation. Contractor shall provide all points listed as well as any points required to provide the sequence of operation as well as to follow any existing building standards.

## 1.6 ACTION SUBMITTALS

- A. Product Data: Include manufacturer's technical literature for each control device. Indicate dimensions, capacities, performance characteristics, electrical characteristics, finishes for materials, and installation and startup instructions for each type of product indicated.
  1. DDC System Hardware: Bill of materials of equipment indicating quantity, manufacturer, and model number. Include technical data for operator workstation equipment, interface equipment, control units, transducers/transmitters, sensors, actuators, valves, relays/switches, control panels, and operator interface equipment.
  2. Control System Software: Include technical data for operating system software, operator interface, color graphics, and other third-party applications.
  3. Controlled Systems: Instrumentation list with element name, type of device, manufacturer, model number, and product data. Include written description of sequence of operation including schematic diagram.

- B. Shop Drawings: Detail equipment assemblies and indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
  - 1. Bill of materials of equipment indicating quantity, manufacturer, and model number.
  - 2. Schematic flow diagrams showing fans, pumps, coils, dampers, valves, and control devices.
  - 3. Wiring Diagrams: Power, signal, and control wiring.
  - 4. Details of control panel faces, including controls, instruments, and labeling.
  - 5. Written description of sequence of operation.
  - 6. Schedule of dampers including size, leakage, and flow characteristics.
  - 7. Schedule of valves including flow characteristics.
  - 8. DDC System Hardware:
    - a. Wiring diagrams for control units with termination numbers.
    - b. Schematic diagrams and floor plans for field sensors and control hardware.
    - c. Schematic diagrams for control, communication, and power wiring, showing trunk data conductors and wiring between operator workstation and control unit locations.
  - 9. Control System Software: List of color graphics indicating monitored systems, data (connected and calculated) point addresses, output schedule, and operator notations.
  - 10. Controlled Systems:
    - a. Schematic diagrams of each controlled system with control points labeled and control elements graphically shown, with wiring.
    - b. Scaled drawings showing mounting, routing, and wiring of elements including bases and special construction.
    - c. Written description of sequence of operation including schematic diagram.
    - d. Points list.
- C. Samples for Initial Selection: For each color required, of each type of thermostat or sensor cover with factory-applied color finishes.
- D. Samples for Verification: For each color required, of each type of thermostat or sensor cover.

## 1.7 INFORMATIONAL SUBMITTALS

- A. Data Communications Protocol Certificates: Certify that each proposed DDC system component complies with ASHRAE 135.
- B. Software Upgrade Kit: For Owner to use in modifying software to suit future systems revisions or monitoring and control revisions.
- C. Field quality-control test reports.

## 1.8 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For HVAC instrumentation and control system to include in emergency, operation, and maintenance manuals. Also include the following:
  - 1. Maintenance instructions and lists of spare parts for each type of control device and compressed-air station.
  - 2. Interconnection wiring diagrams with identified and numbered system components and devices.
  - 3. Keyboard illustrations and step-by-step procedures indexed for each operator function.
  - 4. Inspection period, cleaning methods, cleaning materials recommended, and calibration tolerances.
  - 5. Calibration records and list of set points.
  
- B. Software and Firmware Operational Documentation: Include the following:
  - 1. Software operating and upgrade manuals.
  - 2. Program Software Backup: On a magnetic media or compact disc, complete with data files.
  - 3. Device address list.
  - 4. Printout of software application and graphic screens.
  - 5. Software license required by and installed for DDC workstations and control systems.

## **1.9 QUALITY ASSURANCE**

- A. Installer Qualifications: Automatic control system manufacturer's authorized representative who is trained and approved for installation of system components required for this Project.
  
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
  
- C. Comply with ASHRAE 135 for DDC system components.

## **1.10 DELIVERY, STORAGE, AND HANDLING**

- A. System Software: Update to latest version of software at Project completion.

## **1.11 COORDINATION**

- A. Coordinate location of thermostats, humidistats, and other exposed control sensors with plans and room details before installation.
  
- B. Coordinate equipment with existing fire alarm control system.
  
- C. Coordinate supply of conditioned electrical branch circuits for control units and operator workstation.

- D. Coordinate equipment with Division 26.
- E. Coordinate exposed sensors with owner to determine which sensors shall be ligature proof.

## **PART 2 - PRODUCTS**

### **2.1 CONTROL SYSTEM**

- A. Control system shall consist of sensors, indicators, actuators, final control elements, interface equipment, other apparatus, accessories to control mechanical systems, and software connected to distributed controllers operating in multiuser, multitasking environment on token-passing network and programmed to control mechanical systems. An operator workstation permits interface with the network via dynamic color graphics with each mechanical system, building floor plan, and control device depicted by point-and-click graphics.

### **2.2 DDC EQUIPMENT**

- A. Owner has an existing Schneider Electric building automation system. The Controls Contractor shall modify the existing system to accommodate all new work as described in the Contract documents (drawings, specifications, and sequences). This includes (but is not limited to) the following: sensors, local controllers, software programming, wiring and communication, alarms, setpoints, and system displays and graphics.
- B. Local Control Units: Modular, comprising processor board with electronically programmable, nonvolatile, read-only memory; and backup power source.
  - 1. Units monitor or control each I/O point, process information, and download from or upload to operator workstation or diagnostic terminal unit.
  - 2. Stand-alone mode control functions operate regardless of network status.
  - 3. Functions include the following:
    - a. Global communications.
    - b. Discrete/digital, analog, and pulse I/O.
    - c. Monitoring, controlling, or addressing data points.
  - 4. Local operator interface provides for download from or upload to operator workstation or diagnostic terminal unit.
  - 5. ASHRAE 135 Compliance: Control units shall use ASHRAE 135 protocol and communicate using ISO 8802-3 (Ethernet) datalink/physical layer protocol.
- C. I/O Interface: Hardwired inputs and outputs may tie into system through controllers. Protect points so that shorting will cause no damage to controllers.
  - 1. Binary Inputs: Allow monitoring of on-off signals without external power.
  - 2. Pulse Accumulation Inputs: Accept up to 10 pulses per second.
  - 3. Analog Inputs: Allow monitoring of low-voltage (0- to 10-V dc), current (4 to 20 mA), or resistance signals.

4. Binary Outputs: Provide on-off or pulsed low-voltage signal, selectable for normally open or normally closed operation.
  5. Analog Outputs: Provide modulating signal, either low voltage (0- to 10-V dc) or current (4 to 20 mA).
  6. Tri-State Outputs: Provide two coordinated binary outputs for control of three-point, floating-type electronic actuators.
  7. Universal I/Os: Provide software selectable binary or analog outputs.
- D. Power Supplies: Transformers with Class 2 current-limiting type or overcurrent protection; limit connected loads to 80 percent of rated capacity. DC power supply shall match output current and voltage requirements and be full-wave rectifier type with the following:
1. Output ripple of 5.0 mV maximum peak to peak.
  2. Combined 1 percent line and load regulation with 100-mic.sec. response time for 50 percent load changes.
  3. Built-in overvoltage and overcurrent protection and be able to withstand 150 percent overload for at least 3 seconds without failure.
- E. Power Line Filtering: Internal or external transient voltage and surge suppression for workstations or controllers with the following:
1. Minimum dielectric strength of 1000 V.
  2. Maximum response time of 10 nanoseconds.
  3. Minimum transverse-mode noise attenuation of 65 dB.
  4. Minimum common-mode noise attenuation of 150 dB at 40 to 100 Hz.

### 2.3 UNITARY CONTROLLERS

- A. Unitized, capable of stand-alone operation with sufficient memory to support its operating system, database, and programming requirements, and with sufficient I/O capacity for the application.
1. Configuration: Local keypad and display; diagnostic LEDs for power, communication, and processor; wiring termination to terminal strip or card connected with ribbon cable; memory with bios; and 72-hour battery backup.
  2. Operating System: Manage I/O communication to allow distributed controllers to share real and virtual object information and allow central monitoring and alarms. Perform automatic system diagnostics; monitor system and report failures.
  3. ASHRAE 135 Compliance: Communicate using read (execute and initiate) and write (execute and initiate) property services defined in ASHRAE 135. Reside on network using MS/TP datalink/physical layer protocol and have service communication port for connection to diagnostic terminal unit.
  4. Enclosure: Dustproof rated for operation at 32 to 120 deg F.

### 2.4 ANALOG CONTROLLERS

- A. Step Controllers: 6- or 10-stage type, with heavy-duty switching rated to handle loads and operated by electric motor.

- B. Electronic Controllers: Wheatstone-bridge-amplifier type, in steel enclosure with provision for remote-resistance readjustment. Identify adjustments on controllers, including proportional band and authority.
  - 1. Single controllers can be integral with control motor if provided with accessible control readjustment potentiometer.
- C. Speed Controllers: Solid-state model providing field-adjustable proportional control of motor speed from maximum to minimum of 55 percent and on-off action below minimum motor / pump speed. Controller shall briefly apply full voltage, when motor is started, to rapidly bring motor up to minimum speed. Equip with filtered circuit to eliminate radio interference.

## 2.5 ELECTRONIC SENSORS

- A. Description: Vibration and corrosion resistant; for wall, immersion, or duct mounting as required.
- B. Thermistor Temperature Sensors and Transmitters:
  - 1. Accuracy: Plus or minus 0.5 deg F at calibration point.
  - 2. Wire: Twisted, shielded-pair cable.
  - 3. Insertion Elements for Liquids: Brass or stainless-steel socket with minimum insertion length of 2-1/2 inches.
  - 4. Outside-Air Sensors: Watertight inlet fitting, shielded from direct sunlight.
  - 5. Room Security Sensors: Stainless-steel cover plate with insulated back and security screws.
- C. Pressure Transmitters/Transducers:
  - 1. Water Pressure Transducers: Stainless-steel diaphragm construction, suitable for service; minimum 150-psig operating pressure; linear output 4 to 20 mA.
  - 2. Water Differential-Pressure Transducers: Stainless-steel diaphragm construction, suitable for service; minimum 150-psig operating pressure and tested to 300- psig; linear output 4 to 20 mA.
  - 3. Differential-Pressure Switch (Water): Snap acting, with pilot-duty rating and with suitable scale range and differential.

## 2.6 STATUS SENSORS

- A. Status Inputs for Fans: Differential-pressure switch with pilot-duty rating and with adjustable range of 0- to 5-inch wg.
- B. Status Inputs for Electric Motors: Comply with ISA 50.00.01, current-sensing fixed- or split-core transformers with self-powered transmitter, adjustable and suitable for 175 percent of rated motor current.
- C. Voltage Transmitter (100- to 600-V ac): Comply with ISA 50.00.01, single-loop, self-



powered transmitter, adjustable, with suitable range and 1 percent full-scale accuracy.

- D. Current Switches: Self-powered, solid-state with adjustable trip current, selected to match current and system output requirements.
- E. Electronic Valve Position Indicator: Visual scale indicating percent of travel and 2- to 10-V dc, feedback signal.
- F. Water-Flow Switches: Bellows-actuated mercury or snap-acting type with pilot-duty rating, stainless-steel or bronze paddle, with appropriate range and differential adjustment, in NEMA 250, Type 1 enclosure.

## 2.7 THERMOSTATS

- A. Immersion Thermostat: Remote-bulb or bimetal rod-and-tube type, proportioning action with adjustable throttling range and adjustable set point.

## 2.8 ACTUATORS

- A. Electric Motors: Size to operate with sufficient reserve power to provide smooth modulating action or two-position action.
  - 1. Permanent Split-Capacitor or Shaded-Pole Type: Gear trains completely oil immersed and sealed. Equip spring-return motors with integral spiral-spring mechanism in housings designed for easy removal for service or adjustment of limit switches, auxiliary switches, or feedback potentiometer.
  - 2. Nonspring-Return Motors for Valves Larger Than NPS 2-1/2: Size for running torque of 150 in. x lbf and breakaway torque of 300 in. x lbf.
  - 3. Spring-Return Motors for Valves Larger Than NPS 2-1/2: Size for running and breakaway torque of 150 in. x lbf.
  - 4. Nonspring-Return Motors for Dampers Larger Than 25 Sq. Ft.: Size for running torque of 150 in. x lbf and breakaway torque of 300 in. x lbf.
  - 5. Spring-Return Motors for Dampers Larger Than 25 Sq. Ft.: Size for running and breakaway torque of 150 in. x lbf.
- B. Electronic Actuators: Direct-coupled type designed for minimum 60,000 full-stroke cycles at rated torque.
  - 1. Valves: Size for torque required for valve close off at maximum pump differential pressure.
  - 2. Coupling: V-bolt and V-shaped, toothed cradle.
  - 3. Overload Protection: Electronic overload or digital rotation-sensing circuitry.
  - 4. Fail-Safe Operation: Mechanical, spring-return mechanism. Provide external, manual gear release on nonspring-return actuators.
  - 5. Power Requirements (Two-Position Spring Return): 24-V ac.
  - 6. Power Requirements (Modulating): Maximum 10 VA at 24-V ac or 8 W at 24-V dc.
  - 7. Proportional Signal: 2- to 10-V dc or 4 to 20 mA, and 2- to 10-V dc position feedback signal.
  - 8. Temperature Rating: 40 to 104 deg F.
  - 9. Run Time: 30 seconds.

## **2.9 CONTROL VALVES**

- A. Control Valves: Factory fabricated, of type, body material, and pressure class based on maximum pressure and temperature rating of piping system, unless otherwise indicated.
- B. Hydronic system globe valves shall have the following characteristics:
  - 1. NPS 2 and Smaller: Class 125 bronze body, bronze trim, rising stem, renewable composition disc, and screwed ends with backseating capacity repackable under pressure.
  - 2. NPS 2-1/2 and Larger: Class 125 iron body, bronze trim, rising stem, plug-type disc, flanged ends, and renewable seat and disc.
  - 3. Internal Construction: Replaceable plugs and stainless-steel or brass seats.
    - a. Single-Seated Valves: Cage trim provides seating and guiding surfaces for plug on top and bottom.
    - b. Double-Seated Valves: Balanced plug; cage trim provides seating and guiding surfaces for plugs on top and bottom.
  - 4. Sizing: 5-psig maximum pressure drop at design flow rate or the following:
    - a. Two Position: Line size.
    - b. Two-Way Modulating: Either the value specified above or twice the load pressure drop, whichever is more.
    - c. Three-Way Modulating: Twice the load pressure drop, but not more than value specified above.
  - 5. Flow Characteristics: Two-way valves shall have equal percentage characteristics; three-way valves shall have linear characteristics.
  - 6. Close-Off (Differential) Pressure Rating: Combination of actuator and trim shall provide minimum close-off pressure rating of 150 percent of total system (pump) head for two-way valves and 100 percent of pressure differential across valve or 100 percent of total system (pump) head.

## **2.10 CONTROL CABLE**

- A. Control cable shall be compatible with an IP-Based building automation system.

## **PART 3 - EXECUTION**

### **3.1 EXAMINATION**

- A. Verify that power supply is available to control units and operator workstation.
- B. Verify that on duct-, pipe-, and equipment-mounted devices are installed before proceeding

with installation.

### **3.2 INSTALLATION**

- A. Install software in control units and operator workstation(s). Implement all features of programs to specified requirements and as appropriate to sequence of operation.
- B. Connect and configure equipment and software to achieve sequence of operation specified.
- C. Verify location of thermostats and other exposed control sensors with Drawings and room details before installation.
- D. Install hydronic instrument wells, valves, and other accessories according to Section 232113 Hydronic Piping."

### **3.3 ELECTRICAL WIRING AND CONNECTION INSTALLATION**

- A. Install raceways, boxes, and cabinets according to Section 260533 "Raceways and Boxes for Electrical Systems."
- B. Install signal and communication cable according to Section 260519 "Low-Voltage Electrical Power Conductors and Cables."
  - 1. Conceal cable, except in mechanical rooms and areas where other conduit and piping are exposed.
  - 2. Install exposed cable in raceway.
  - 3. Install concealed cable in raceway.
  - 4. Bundle and harness multiconductor instrument cable in place of single cables where several cables follow a common path.
  - 5. Fasten flexible conductors, bridging cabinets and doors, along hinge side; protect against abrasion. Tie and support conductors.
  - 6. Number-code or color-code conductors for future identification and service of control system, except local individual room control cables.
  - 7. Install wire and cable with sufficient slack and flexible connections to allow for vibration of piping and equipment.
- C. Connect manual-reset limit controls independent of manual-control switch positions. Automatic duct heater resets may be connected in interlock circuit of power controllers.
- D. Connect hand-off-auto selector switches to override automatic interlock controls when switch is in hand position.

### **3.4 FIELD QUALITY CONTROL**

- A. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect, test, and adjust field-assembled components and equipment installation, including connections, and to assist in field testing. Report results in writing.
- B. Perform the following field tests and inspections and prepare test reports:

1. Operational Test: After electrical circuitry has been energized, start units to confirm proper unit operation. Remove and replace malfunctioning units and retest.
  2. Test and adjust controls and safeties.
  3. Leak Test: After installation, charge system and test for leaks. Repair leaks and retest until no leaks exist.
  4. Test calibration of electronic controllers by disconnecting input sensors and stimulating operation with compatible signal generator.
  5. Test each point through its full operating range to verify that safety and operating control set points are as required.
  6. Test each control loop to verify stable mode of operation and compliance with sequence of operation. Adjust PID actions.
  7. Test each system for compliance with sequence of operation.
  8. Test software and hardware interlocks.
- C. Replace damaged or malfunctioning controls and equipment and repeat testing procedures.

### 3.5 ADJUSTING

A. Calibrating and Adjusting:

1. Calibrate instruments.
2. Make three-point calibration test for both linearity and accuracy for each analog instrument.
3. Calibrate equipment and procedures using manufacturer's written recommendations and instruction manuals. Use test equipment with accuracy at least double that of instrument being calibrated.
4. Control System Inputs and Outputs:
  - a. Check analog inputs at 0, 50, and 100 percent of span.
  - b. Check analog outputs using milliamper meter at 0, 50, and 100 percent output.
  - c. Check digital inputs using jumper wire.
  - d. Check digital outputs using ohmmeter to test for contact making or breaking.
  - e. Check resistance temperature inputs at 0, 50, and 100 percent of span using a precision-resistant source.
5. Flow:
  - a. Set differential pressure flow transmitters for 0 and 100 percent values with 3-point calibration accomplished at 50, 90, and 100 percent of span.
  - b. Manually operate flow switches to verify that they make or break contact.
6. Pressure:
  - a. Calibrate pressure transmitters at 0, 50, and 100 percent of span.
  - b. Calibrate pressure switches to make or break contacts, with adjustable differential set at minimum.
7. Temperature:

- a. Calibrate resistance temperature transmitters at 0, 50, and 100 percent of span using a precision-resistance source.
  - b. Calibrate temperature switches to make or break contacts.
8. Stroke and adjust control valves without positioners, following the manufacturer's recommended procedure, so that valve is 100 percent open and closed.
  9. Stroke and adjust control valves with positioners, following manufacturer's recommended procedure, so that valve is 0, 50, and 100 percent closed.
  10. Provide diagnostic and test instruments for calibration and adjustment of system.
  11. Provide written description of procedures and equipment for calibrating each type of instrument. Submit procedures review and approval before initiating startup procedures.
- B. Adjust initial temperature and humidity set points.
- C. Occupancy Adjustments: When requested within 12 months of date of Substantial Completion, provide on-site assistance in adjusting system to suit actual occupied conditions. Provide up to three visits to Project during other than normal occupancy hours for this purpose.

### **3.6 DEMONSTRATION**

- A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, and maintain HVAC instrumentation and controls.

**END OF SECTION 230900**

## **SECTION 231123 - FACILITY NATURAL-GAS PIPING**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section Includes:
  - 1. Pipes, tubes, and fittings.
  - 2. Piping specialties.
  - 3. Piping and tubing joining materials.
  - 4. Manual gas shutoff valves.
  - 5. Motorized gas valves.
  - 6. Pressure regulators.
  - 7. Service meters.
  - 8. Dielectric fittings.

#### **1.3 DEFINITIONS**

- A. Exposed, Exterior Installations: Exposed to view outdoors or subject to outdoor ambient temperatures and weather conditions. Examples include rooftop locations.
- B. Exposed, Interior Installations: Exposed to view indoors. Examples include finished occupied spaces and mechanical equipment rooms.
- C. Finished Spaces: Spaces other than mechanical and electrical equipment rooms, furred spaces, pipe and duct shafts, unheated spaces immediately below roof, spaces above ceilings, unexcavated spaces, crawlspaces, and tunnels.

#### **1.4 ACTION SUBMITTALS**

- A. Product Data: For each type of the following:
  - 1. Piping specialties.
  - 2. Corrugated, stainless-steel tubing with associated components.
  - 3. Valves. Include pressure rating, capacity, settings, and electrical connection data of selected models.
  - 4. Pressure regulators. Indicate pressure ratings and capacities.
  - 5. Service meters. Indicate pressure ratings and capacities.
  - 6. Dielectric fittings.

- B. Shop Drawings: For facility natural-gas piping layout. Include plans, piping layout and elevations, sections, and details for fabrication of pipe anchors, hangers, supports for multiple pipes, alignment guides, expansion joints and loops, and attachments of the same to building structure. Detail location of anchors, alignment guides, and expansion joints and loops.
  - 1. Shop Drawing Scale: 1/4 inch per foot.
- C. Delegated-Design Submittal: For natural-gas piping and equipment indicated to comply with performance requirements and design criteria, including analysis data signed and sealed by the qualified professional engineer responsible for their preparation.
  - 1. Detail fabrication and assembly of seismic restraints.
  - 2. Design Calculations: Calculate requirements for selecting seismic restraints.

### **1.5 INFORMATIONAL SUBMITTALS**

- A. Welding certificates.
- B. Field quality-control reports.

### **1.6 CLOSEOUT SUBMITTALS**

- A. Operation and Maintenance Data: For motorized gas valves and pressure regulators to include in emergency, operation, and maintenance manuals.

### **1.7 QUALITY ASSURANCE**

- A. Pipe Welding Qualifications: Qualify procedures and operators according to ASME Boiler and Pressure Vessel Code.
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

### **1.8 DELIVERY, STORAGE, AND HANDLING**

- A. Handling Flammable Liquids: Remove and dispose of liquids from existing natural-gas piping according to requirements of authorities having jurisdiction.
- B. Deliver pipes and tubes with factory-applied end caps. Maintain end caps through shipping, storage, and handling to prevent pipe end damage and to prevent entrance of dirt, debris, and moisture.
- C. Store and handle pipes and tubes having factory-applied protective coatings to avoid damaging coating, and protect from direct sunlight.
- D. Protect stored PE pipes and valves from direct sunlight.

## **1.9 PROJECT CONDITIONS**

- A. Interruption of Existing Natural-Gas Service: Do not interrupt natural-gas service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide purging and startup of natural-gas supply according to requirements indicated:
  - 1. Notify Owner no fewer than seven (7) days in advance of proposed interruption of natural-gas service.
  - 2. Do not proceed with interruption of natural-gas service without Owner's written permission.

## **1.10 COORDINATION**

- A. Coordinate sizes and locations of concrete bases with actual equipment provided.
- B. Coordinate requirements for access panels and doors for valves installed concealed behind finished surfaces.

## **PART 2 - PRODUCTS**

### **2.1 PERFORMANCE REQUIREMENTS**

- A. Minimum Operating-Pressure Ratings:
  - 1. Piping and Valves: 100 psig minimum unless otherwise indicated.
  - 2. Service Regulators: 100 psig minimum unless otherwise indicated.
  - 3. Minimum Operating Pressure of Service Meter: 5 psig.
- B. Natural-Gas System Pressures within Buildings: Two pressure ranges. Primary pressure is more than 0.5 psig but not more than 2 psig, and is reduced to secondary pressure of 0.5 psig or less.
- C. Delegated Design: Design restraints and anchors for natural-gas piping and equipment, including comprehensive engineering analysis by a qualified professional engineer, using performance requirements and design criteria indicated.

### **2.2 PIPES, TUBES, AND FITTINGS**

- A. Steel Pipe: ASTM A53/A53M, black steel, Schedule 40, Type E or S, Grade B.
  - 1. Malleable-Iron Threaded Fittings: ASME B16.3, Class 150, standard pattern.
  - 2. Wrought-Steel Welding Fittings: ASTM A234/A234M for butt welding and socket welding.
  - 3. Unions: ASME B16.39, Class 150, malleable iron with brass-to-iron seat, ground joint, and threaded ends.
  - 4. Forged-Steel Flanges and Flanged Fittings: ASME B16.5, minimum Class 150, including bolts, nuts, and gaskets of the following material group, end connections, and facings:



- a. Material Group: 1.1.
- b. End Connections: Threaded or butt welding to match pipe.
- c. Lapped Face: Not permitted underground.
- d. Gasket Materials: ASME B16.20, metallic, flat, asbestos free, aluminum o-rings, and spiral-wound metal gaskets.
- e. Bolts and Nuts: ASME B18.2.1, carbon steel aboveground and stainless steel underground.

B. Corrugated, Stainless-Steel Tubing: Comply with ANSI/IAS LC 1.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. TracPipe CounterStrike; Omega Flex, Inc.
  - b. Tru-Flex Metal Hose Corp.
  - c. Ward Manufacturing LLC.
2. Tubing: ASTM A240/A240M, corrugated, Series 300 stainless steel.
3. Coating: PE with flame retardant.
  - a. Surface-Burning Characteristics: As determined by testing identical products according to ASTM E84 by a qualified testing agency. Identify products with appropriate markings of applicable testing agency.
    - 1) Flame-Spread Index: 25 or less.
    - 2) Smoke-Developed Index: 50 or less.
4. Fittings: Copper-alloy mechanical fittings with ends made to fit and listed for use with corrugated stainless-steel tubing and capable of metal-to-metal seal without gaskets. Include brazing socket or threaded ends complying with ASME B1.20.1.
5. Striker Plates: Steel, designed to protect tubing from penetrations.
6. Manifolds: Malleable iron or steel with factory-applied protective coating. Threaded connections shall comply with ASME B1.20.1 for pipe inlet and corrugated tubing outlets.
7. Operating-Pressure Rating: 5 psig (34.5 kPa).

C. Drawn-Temper Copper Tube: Comply with ASTM B837, Type G.

1. Copper Fittings: ASME B16.22, wrought copper, and streamlined pattern.
2. Bronze Flanges and Flanged Fittings: ASME B16.24, Class 150.
  - a. Gasket Material: ASME B16.20, metallic, flat, asbestos free, aluminum o-rings, and spiral-wound metal gaskets.
  - b. Bolts and Nuts: ASME B18.2.1, carbon steel or stainless steel.

## 2.3 PIPING SPECIALTIES

A. Appliance Flexible Connectors:

1. Indoor, Fixed-Appliance Flexible Connectors: Comply with ANSI Z21.24.

2. Indoor, Movable-Appliance Flexible Connectors: Comply with ANSI Z21.69.
3. Outdoor, Appliance Flexible Connectors: Comply with ANSI Z21.75.
4. Corrugated stainless-steel tubing with polymer coating.
5. Operating-Pressure Rating: 0.5 psig.
6. End Fittings: Zinc-coated steel.
7. Threaded Ends: Comply with ASME B1.20.1.
8. Maximum Length: 72 inches.

B. Y-Pattern Strainers:

1. Body: ASTM A126, Class B, cast iron with bolted cover and bottom drain connection.
2. End Connections: Threaded ends for NPS 2 and smaller; flanged ends for NPS 2-1/2 and larger.
3. Strainer Screen: 40-mesh startup strainer, and perforated stainless-steel basket with 50 percent free area.
4. CWP Rating: 125 psig.

C. Weatherproof Vent Cap: Cast- or malleable-iron increaser fitting with corrosion-resistant wire screen, with free area at least equal to cross-sectional area of connecting pipe and threaded-end connection.

## 2.4 JOINING MATERIALS

- A. Joint Compound and Tape: Suitable for natural gas.
- B. Welding Filler Metals: Comply with AWS D10.12/D10.12M for welding materials appropriate for wall thickness and chemical analysis of steel pipe being welded.
- C. Brazing Filler Metals: Alloy with melting point greater than 1000 deg F complying with AWS A5.8/A5.8M. Brazing alloys containing more than 0.05 percent phosphorus are prohibited.

## 2.5 MANUAL GAS SHUTOFF VALVES

A. General Requirements for Metallic Valves, NPS 2 and Smaller: Comply with ASME B16.33.

1. CWP Rating: 125 psig .
2. Threaded Ends: Comply with ASME B1.20.1.
3. Dryseal Threads on Flare Ends: Comply with ASME B1.20.3.
4. Tamperproof Feature: Locking feature for valves indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
5. Listing: Listed and labeled by an NRTL acceptable to authorities having jurisdiction for valves 1 inch and smaller.
6. Service Mark: Valves 1-1/4 inches to NPS 2 shall have initials "WOG" permanently marked on valve body.

B. General Requirements for Metallic Valves, NPS 2-1/2 and Larger: Comply with ASME B16.38.

1. CWP Rating: 125 psig.

2. Flanged Ends: Comply with ASME B16.5 for steel flanges.
  3. Tamperproof Feature: Locking feature for valves indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
  4. Service Mark: Initials "WOG" shall be permanently marked on valve body.
- C. Two-Piece, Full-Port, Bronze Ball Valves with Bronze Trim: MSS SP-110.
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Apollo Valves; a part of Aalberts Integrated Piping Systems.
    - b. BrassCraft Manufacturing Co.; a Masco company.
    - c. Perfection Corporation.
  2. Body: Bronze, complying with ASTM B584.
  3. Ball: Chrome-plated bronze.
  4. Stem: Bronze; blowout proof.
  5. Seats: Reinforced TFE; blowout proof.
  6. Packing: Threaded-body packnut design with adjustable-stem packing.
  7. Ends: Threaded, flared, or socket as indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
  8. CWP Rating: 600 psig.
  9. Listing: Valves NPS 1 and smaller shall be listed and labeled by an NRTL acceptable to authorities having jurisdiction.
  10. Service: Suitable for natural-gas service with "WOG" indicated on valve body.
- D. Bronze Plug Valves: MSS SP-78.
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. A.Y. McDonald Mfg. Co.
    - b. Lee Brass Company.
  2. Body: Bronze, complying with ASTM B584.
  3. Plug: Bronze.
  4. Ends: Threaded, socket, or flanged as indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
  5. Operator: Square head or lug type with tamperproof feature where indicated.
  6. Pressure Class: 125 psig.
  7. Listing: Valves NPS 1 and smaller shall be listed and labeled by an NRTL acceptable to authorities having jurisdiction.
  8. Service: Suitable for natural-gas service with "WOG" indicated on valve body.
- E. Cast-Iron, Nonlubricated Plug Valves: MSS SP-78.
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. A.Y. McDonald Mfg. Co.
    - b. Mueller Co. LLC; Mueller Water Products, Inc.

- c. XOMOX; Crane ChemPharma & Energy.
2. Body: Cast iron, complying with ASTM A126, Class B.
3. Plug: Bronze or nickel-plated cast iron.
4. Seat: Coated with thermoplastic.
5. Stem Seal: Compatible with natural gas.
6. Ends: Threaded or flanged as indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
7. Operator: Square head or lug type with tamperproof feature where indicated.
8. Pressure Class: 125 psig.
9. Listing: Valves NPS 1 and smaller shall be listed and labeled by an NRTL acceptable to authorities having jurisdiction.
10. Service: Suitable for natural-gas service with "WOG" indicated on valve body.

## 2.6 MOTORIZED GAS VALVES

### A. Automatic Gas Valves: Comply with ANSI Z21.21.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Eaton.
  - b. Honeywell Building Solutions; Honeywell International, Inc.
  - c. Johnson Controls, Inc.
2. Body: Brass or aluminum.
3. Seats and Disc: Nitrile rubber.
4. Springs and Valve Trim: Stainless steel.
5. Normally closed.
6. Visual position indicator.
7. Electrical operator for actuation by appliance automatic shutoff device.

### B. Electrically Operated Valves: Comply with UL 429.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. American Gas Safety, LLC.
  - b. Parker (Parker Hannifin).
  - c. WATTS; A Watts Water Technologies Company.
2. Pilot operated.
3. Body: Brass or aluminum.
4. Seats and Disc: Nitrile rubber.
5. Springs and Valve Trim: Stainless steel.
6. 120-V ac, 60 Hz, Class B, continuous-duty molded coil, and replaceable.
7. NEMA ICS 6, Type 4, coil enclosure.
8. Normally closed.
9. Visual position indicator.

## 2.7 PRESSURE REGULATORS

### A. General Requirements:

1. Single stage and suitable for natural gas.
2. Steel jacket and corrosion-resistant components.
3. Elevation compensator.
4. End Connections: Threaded for regulators NPS 2 and smaller; flanged for regulators NPS 2-1/2 and larger.

### B. Line Pressure Regulators: Comply with ANSI Z21.80.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. American Meter Company.
  - b. Eclipse Innovative Thermal Technologies.
  - c. Fischer; Emerson Electric Co., Automation Solutions.
2. Body and Diaphragm Case: Cast iron or die-cast aluminum.
3. Springs: Zinc-plated steel; interchangeable.
4. Diaphragm Plate: Zinc-plated steel.
5. Seat Disc: Nitrile rubber resistant to gas impurities, abrasion, and deformation at the valve port.
6. Orifice: Aluminum; interchangeable.
7. Seal Plug: Ultraviolet-stabilized, mineral-filled nylon.
8. Single-port, self-contained regulator with orifice no larger than required at maximum pressure inlet, and no pressure sensing piping external to the regulator.
9. Pressure regulator shall maintain discharge pressure setting downstream, and not exceed 150 percent of design discharge pressure at shutoff.
10. Overpressure Protection Device: Factory mounted on pressure regulator.
11. Atmospheric Vent: Factory- or field-installed, stainless-steel screen in opening if not connected to vent piping.
12. Maximum Inlet Pressure: 5 psig.

### C. Appliance Pressure Regulators: Comply with ANSI Z21.18.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Eaton.
  - b. Harper Wyman Co.
  - c. Maxitrol Company.
2. Body and Diaphragm Case: Die-cast aluminum.
3. Springs: Zinc-plated steel; interchangeable.
4. Diaphragm Plate: Zinc-plated steel.
5. Seat Disc: Nitrile rubber.
6. Seal Plug: Ultraviolet-stabilized, mineral-filled nylon.
7. Factory-Applied Finish: Minimum three-layer polyester and polyurethane paint finish.

8. Regulator may include vent limiting device, instead of vent connection, if approved by authorities having jurisdiction.
9. Maximum Inlet Pressure: 5 psig.

## 2.8 DIELECTRIC FITTINGS

- A. General Requirements: Assembly of copper alloy and ferrous materials with separating nonconductive insulating material. Include end connections compatible with pipes to be joined.
- B. Dielectric Unions:
  1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. GF Piping Systems: Georg Fischer LLC.
    - b. WATTS; A Watts Water Technologies Company.
    - c. Wilkins.
  2. Description:
    - a. Standard: ASSE 1079.
    - b. Pressure Rating: 125 psig minimum at 200 deg F.
    - c. End Connections: Solder-joint copper alloy and threaded ferrous.

## 2.9 LABELING AND IDENTIFYING

- A. Detectable Warning Tape: Acid- and alkali-resistant, PE film warning tape manufactured for marking and identifying underground utilities, a minimum of 6 inches wide and 4 mils thick, continuously inscribed with a description of utility, with metallic core encased in a protective jacket for corrosion protection, detectable by metal detector when tape is buried up to 30 inches deep; colored yellow.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine roughing-in for natural-gas piping system to verify actual locations of piping connections before equipment installation.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 PREPARATION

- A. Close equipment shutoff valves before turning off natural gas to premises or piping section.
- B. Inspect natural-gas piping according to the International Fuel Gas Code to determine that natural-gas utilization devices are turned off in piping section affected.

- C. Comply with the International Fuel Gas Code requirements for prevention of accidental ignition.

### 3.3 INDOOR PIPING INSTALLATION

- A. Comply with the International Fuel Gas Code for installation and purging of natural-gas piping.
- B. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems. Indicated locations and arrangements are used to size pipe and calculate friction loss, expansion, and other design considerations. Install piping as indicated unless deviations to layout are approved on Coordination Drawings.
- C. Arrange for pipe spaces, chases, slots, sleeves, and openings in building structure during progress of construction, to allow for mechanical installations.
- D. Install piping in concealed locations unless otherwise indicated and except in equipment rooms and service areas.
- E. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- F. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal.
- G. Locate valves for easy access.
- H. Install natural-gas piping at uniform grade of 2 percent down toward drip and sediment traps.
- I. Install piping free of sags and bends.
- J. Install fittings for changes in direction and branch connections.
- K. Verify final equipment locations for roughing-in.
- L. Comply with requirements in Sections specifying gas-fired appliances and equipment for roughing-in requirements.
- M. Drips and Sediment Traps: Install drips at points where condensate may collect, including service-meter outlets. Locate where accessible to permit cleaning and emptying. Do not install where condensate is subject to freezing.
  - 1. Construct drips and sediment traps using tee fitting with bottom outlet plugged or capped. Use nipple a minimum length of 3 pipe diameters, but not less than 3 inches (75 mm) long and same size as connected pipe. Install with space below bottom of drip to remove plug or cap.
- N. Extend relief vent connections for service regulators, line regulators, and overpressure protection devices to outdoors and terminate with weatherproof vent cap.
- O. Conceal pipe installations in walls, pipe spaces, utility spaces, above ceilings, below grade or floors, and in floor channels unless indicated to be exposed to view.

- P. Concealed Location Installations: Except as specified below, install concealed natural-gas piping and piping installed under the building in containment conduit constructed of steel pipe with welded joints as described in Part 2. Install a vent pipe from containment conduit to outdoors and terminate with weatherproof vent cap.
  - 1. Prohibited Locations:
    - a. Do not install natural-gas piping in or through circulating air ducts, clothes or trash chutes, chimneys or gas vents (flues), ventilating ducts, or dumbwaiter or elevator shafts.
    - b. Do not install natural-gas piping in solid walls or partitions.
- Q. Use eccentric reducer fittings to make reductions in pipe sizes. Install fittings with level side down.
- R. Connect branch piping from top or side of horizontal piping.
- S. Install unions in pipes NPS 2 and smaller, adjacent to each valve, at final connection to each piece of equipment. Unions are not required at flanged connections.
- T. Do not use natural-gas piping as grounding electrode.
- U. Install strainer on inlet of each line-pressure regulator and automatic or electrically operated valve.
- V. Install pressure gage downstream from each line regulator. Pressure gages are specified in Section 230519 "Meters and Gages for HVAC Piping."
- W. Install sleeves for piping penetrations of walls, ceilings, and floors. Comply with requirements for sleeves specified in Section 230517 "Sleeves and Sleeve Seals for HVAC Piping."
- X. Install escutcheons for piping penetrations of walls, ceilings, and floors. Comply with requirements for escutcheons specified in Section 230518 "Escutcheons for HVAC Piping."

### **3.4 VALVE INSTALLATION**

- A. Install manual gas shutoff valve for each gas appliance ahead of corrugated stainless-steel tubing, aluminum, or copper connector.
- B. Install underground valves with valve boxes.
- C. Install regulators and overpressure protection devices with maintenance access space adequate for servicing and testing.
- D. Install earthquake valves aboveground outside buildings according to listing.
- E. Install anode for metallic valves in underground PE piping.



### 3.5 PIPING JOINT CONSTRUCTION

- A. Ream ends of pipes and tubes and remove burrs.
- B. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.
- C. Threaded Joints:
  - 1. Thread pipe with tapered pipe threads complying with ASME B1.20.1.
  - 2. Cut threads full and clean using sharp dies.
  - 3. Ream threaded pipe ends to remove burrs and restore full inside diameter of pipe.
  - 4. Apply appropriate tape or thread compound to external pipe threads unless dryseal threading is specified.
  - 5. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged. Do not use pipe sections that have cracked or open welds.
- D. Welded Joints:
  - 1. Construct joints according to AWS D10.12/D10.12M, using qualified processes and welding operators.
  - 2. Bevel plain ends of steel pipe.
  - 3. Patch factory-applied protective coating as recommended by manufacturer at field welds and where damage to coating occurs during construction.
- E. Brazed Joints: Construct joints according to AWS's "Brazing Handbook," "Pipe and Tube" Chapter.
- F. Flanged Joints: Install gasket material, size, type, and thickness appropriate for natural-gas service. Install gasket concentrically positioned.
- G. Flared Joints: Cut tubing with roll cutting tool. Flare tube end with tool to result in flare dimensions complying with SAE J513. Tighten finger tight, then use wrench. Do not overtighten.
- H. PE Piping Heat-Fusion Joints: Clean and dry joining surfaces by wiping with clean cloth or paper towels. Join according to ASTM D2657.
  - 1. Plain-End Pipe and Fittings: Use butt fusion.
  - 2. Plain-End Pipe and Socket Fittings: Use socket fusion.

### 3.6 HANGER AND SUPPORT INSTALLATION

- A. Comply with requirements for seismic-restraint devices specified in Section 230548 "Vibration and Seismic Controls for HVAC."
- B. Comply with requirements for pipe hangers and supports specified in Section 230529 "Hangers and Supports for HVAC Piping and Equipment."

- C. Install hangers for steel piping and copper tubing, with maximum horizontal spacing and minimum rod diameters, to comply with MSS-58, locally enforced codes, and authorities having jurisdiction requirements, whichever are most stringent.
- D. Install hangers for corrugated stainless-steel tubing, with maximum horizontal spacing and minimum rod diameters, to comply with manufacturer's written instructions, locally enforced codes, and authorities having jurisdiction requirements, whichever are most stringent.
- E. Support horizontal piping within 12 inches of each fitting.
- F. Support vertical runs of steel piping and copper tubing to comply with MSS-58, locally enforced codes, and authorities having jurisdiction requirements, whichever are most stringent.
- G. Support vertical runs of corrugated stainless-steel tubing to comply with manufacturer's written instructions, locally enforced codes, and authorities having jurisdiction requirements, whichever are most stringent.

### **3.7 CONNECTIONS**

- A. Install natural-gas piping electrically continuous, and bonded to gas appliance equipment grounding conductor of the circuit powering the appliance according to NFPA 70.
- B. Install piping adjacent to appliances to allow service and maintenance of appliances.
- C. Connect piping to appliances using manual gas shutoff valves and unions. Install valve within 72 inches of each gas-fired appliance and equipment. Install union between valve and appliances or equipment.
- D. Sediment Traps: Install tee fitting with capped nipple in bottom to form drip, as close as practical to inlet of each appliance.

### **3.8 LABELING AND IDENTIFYING**

- A. Install detectable warning tape directly above gas piping, 12 inches below finished grade, except 6 inches below subgrade under pavements and slabs.

### **3.9 PAINTING**

- A. Paint exposed, interior metal piping, valves, service regulators, service meters and meter bars, earthquake valves, and piping specialties, except components, with factory-applied paint or protective coating.
  - 1. Latex Over Alkyd Primer System: MPI INT 5.1Q.
    - a. Prime Coat: Quick-drying alkyd metal primer.
    - b. Intermediate Coat: Interior latex matching topcoat.
    - c. Topcoat: Interior latex (flat).
    - d. Color: Gray.

- B. Damage and Touchup: Repair marred and damaged factory-applied finishes with materials and by procedures to match original factory finish.

### **3.10 FIELD QUALITY CONTROL**

- A. Perform tests and inspections.
- B. Tests and Inspections:
  - 1. Test, inspect, and purge natural gas according to the International Fuel Gas Code and authorities having jurisdiction.
- C. Natural-gas piping will be considered defective if it does not pass tests and inspections.
- D. Prepare test and inspection reports.

### **3.11 INDOOR PIPING SCHEDULE:**

- A. Aboveground, branch piping shall be one of the following:
  - 1. Corrugated stainless-steel tubing with mechanical fittings having socket or threaded ends to match adjacent piping.
  - 2. Annealed-temper, copper tube with wrought-copper fittings and brazed joints.
  - 3. Steel pipe with malleable-iron fittings and threaded joints.

### **3.12 ABOVEGROUND MANUAL GAS SHUTOFF VALVE SCHEDULE**

- A. Valves for pipe sizes NPS 2 and smaller at service meter shall be one of the following:
  - 1. One-piece, bronze ball valve with bronze trim.
  - 2. Two-piece, full regular-port, bronze ball valves with bronze trim.
  - 3. Bronze plug valve.
- B. Valves for pipe sizes NPS 2-1/2 and larger at service meter shall be one of the following:
  - 1. Two-piece, full-port, bronze ball valves with bronze trim.
  - 2. Bronze plug valve.
  - 3. Cast-iron, nonlubricated plug valve.
- C. Valves in branch piping for single appliance shall be one of the following:
  - 1. One-piece, bronze ball valve with bronze trim.
  - 2. Two-piece, full port, bronze ball valves with bronze trim.
  - 3. Bronze plug valve.

**END OF SECTION 231123**

## **SECTION 232113 - HYDRONIC PIPING**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. This specification is to be used for the primary (closed loop) heating piping that is on the boiler side of the system.
- B. Section Includes:
  - 1. Copper tube and fittings.
  - 2. Steel pipe and fittings.
  - 3. Joining materials.
  - 4. Transition fittings.
  - 5. Dielectric fittings.
  - 6. Bypass chemical feeder.

#### **1.3 ACTION SUBMITTALS**

- A. Product Data: For each type of the following:
  - 1. Pipe and tube.
  - 2. Fittings.
  - 3. Joining materials.
  - 4. Transition fittings.
  - 5. Bypass chemical feeder.
- B. Delegated-Design Submittal:
  - 1. Design calculations and detailed fabrication and assembly of pipe anchors and alignment guides, hangers and supports for multiple pipes, expansion joints and loops, and attachments of the same to the building structure.
  - 2. Locations of pipe anchors and alignment guides and expansion joints and loops.

#### **1.4 INFORMATIONAL SUBMITTALS**

- A. Coordination Drawings: These shall be created if major components are different than the basis of design (dimensions, clearances, piping connections, etc.). Piping layout, or BIM model, drawn to scale, showing the items described in this Section, and coordinated with all building trades.

## 1.5 QUALITY ASSURANCE

- A. Installer Qualifications:
- B. Steel Support Welding: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."
- C. Pipe Welding: Qualify procedures and operators according to ASME Boiler and Pressure Vessel Code: Section IX.
  - 1. Comply with ASME B31.9, "Building Services Piping," for materials, products, and installation.
  - 2. Certify that each welder has passed AWS qualification tests for welding processes involved and that certification is current.

## PART 2 - PRODUCTS

### 2.1 PERFORMANCE REQUIREMENTS

- A. Hydronic piping components and installation shall be capable of withstanding the following minimum working pressure and temperature unless otherwise indicated:
  - 1. Primary Hot-Water Closed Loop Piping: 100 psig at 200 deg F.
  - 2. Makeup-Water Piping: 80 psig at 150 deg F.
  - 3. Air-Vent Piping: 200 deg F.
  - 4. Safety-Valve-Inlet and -Outlet Piping: Equal to the pressure of the piping system to which it is attached.

### 2.2 COPPER TUBE AND FITTINGS

- A. Hard Copper Tube: ASTM B 88, Type L and ASTM B 88, Type M water tube, drawn temper.
- B. Tube in "Soft Copper Tube" Paragraph below is available in NPS 1/8 to NPS 12.
- C. Soft Copper Tube: ASTM B 88, Type K water tube, annealed temper.
- D. Fittings in "Cast-Copper, Solder-Joint Fittings" Paragraph below are available in NPS 1/4 to NPS 12.
- E. Cast-Copper, Solder-Joint Fittings: ASME B16.18, pressure fittings.
- F. Fittings in "Wrought-Copper, Solder-Joint Fittings" Paragraph below are available in NPS 1/4 to NPS 8.
- G. Wrought-Copper, Solder-Joint Fittings: ASME B16.22, wrought-copper pressure fittings.
- H. Flanges in "Bronze Flanges" Paragraph below are available in NPS 1/2 to NPS 12.
- I. Bronze Flanges: ASME B16.24, Class 150, with solder-joint ends.

- J. Unions in "Copper Unions" Paragraph below are available in NPS 1/4 to NPS 4.
- K. Copper Unions:
  - 1. MSS SP-123.
  - 2. Cast-copper-alloy, hexagonal-stock body.
  - 3. Ball-and-socket, metal-to-metal seating surfaces.
  - 4. Solder-joint or threaded ends.
- L. Copper Pressure-Seal-Joint Fittings:
  - 1. Fittings for NPS 2 and Smaller: Wrought-copper fitting with EPDM-rubber, O-ring seal in each end.
  - 2. Fittings for NPS 2-1/2 to NPS 4: Cast-bronze or wrought-copper fitting with EPDM-rubber, O-ring seal in each end.
- M. Appurtenances for Grooved-End Copper Tubing:
  - 1. Bronze Fittings for Grooved-End, Copper Tubing: ASTM B 75 copper tube or ASTM B 584 bronze castings.
  - 2. Mechanical Couplings for Grooved-End Copper Tubing:
    - a. Copper-tube dimensions and design similar to AWWA C606.
    - b. Ferrous housing sections.
    - c. EPDM-rubber gaskets suitable for hot and cold water.
    - d. Bolts and nuts.
    - e. Minimum Pressure Rating: 300 psig.

### **2.3 STEEL PIPE AND FITTINGS**

- A. Steel Pipe: ASTM A53, black steel with plain ends; welded and seamless, Grade B, and wall thickness as indicated in "Piping Applications" Article.
- B. Cast-Iron Threaded Fittings: ASME B16.4; Classes 125 and 250 as indicated in "Piping Applications" Article.
- C. Malleable-Iron Threaded Fittings: ASME B16.3, Classes 150 and 300 as indicated in "Piping Applications" Article.
- D. Malleable-Iron Unions: ASME B16.39; Classes 150, 250, and 300 as indicated in "Piping Applications" Article.
- E. Cast-Iron Pipe Flanges and Flanged Fittings: ASME B16.1, Classes 25, 125, and 250; raised ground face, and bolt holes spot faced as indicated in "Piping Applications" Article.
- F. Wrought-Steel Fittings: ASTM A234, wall thickness to match adjoining pipe.
- G. Wrought Cast- and Forged-Steel Flanges and Flanged Fittings: ASME B16.5, including bolts, nuts, and gaskets of the following material group, end connections, and facings:
  - 1. Material Group: 1.1.
  - 2. End Connections: Butt welding.
  - 3. Facings: Raised face.
- H. Grooved Mechanical-Joint Fittings and Couplings:

1. Joint Fittings: ASTM A536, Grade 65-45-12 ductile iron; ASTM A47, Grade 32510 malleable iron; ASTM A53, Type F, E, or S, Grade B fabricated steel; or ASTM A106, Grade B steel fittings with grooves or shoulders constructed to accept grooved-end couplings; with nuts, bolts, locking pin, locking toggle, or lugs to secure grooved pipe and fittings.
  2. Couplings: Ductile- or malleable-iron housing and EPDM or nitrile gasket of central cavity pressure-responsive design; with nuts, bolts, locking pin, locking toggle, or lugs to secure grooved pipe and fittings.
- I. Steel Pipe Nipples: ASTM A733, made of same materials and wall thicknesses as pipe in which they are installed.

## 2.4 JOINING MATERIALS

- A. Pipe-Flange Gasket Materials: Suitable for chemical and thermal conditions of piping system contents.
1. ASME B16.21, nonmetallic, flat, asbestos free, 1/8-inch maximum thickness unless otherwise indicated.
    - a. Full-Face Type: For flat-face, Class 125, cast-iron and cast-bronze flanges.
    - b. Narrow-Face Type: For raised-face, Class 250, cast-iron and steel flanges.
- B. Flange Bolts and Nuts: ASME B18.2.1, carbon steel, unless otherwise indicated.
- C. Plastic, Pipe-Flange Gasket, Bolts, and Nuts: Type and material recommended by piping system manufacturer unless otherwise indicated.
- D. Solder Filler Metals: ASTM B32, lead-free alloys. Include water-flushable flux according to ASTM B813.
- E. Brazing Filler Metals: AWS A5.8, BCuP Series, copper-phosphorus alloys for joining copper with copper; or BAg-1, silver alloy for joining copper with bronze or steel.
- F. Welding Filler Metals: Comply with AWS D10.12 for welding materials appropriate for wall thickness and chemical analysis of steel pipe being welded.

## 2.5 DIELECTRIC FITTINGS

- A. General Requirements: Assembly of copper alloy and ferrous materials with separating nonconductive insulating material. Include end connections compatible with pipes to be joined.
- B. Dielectric Unions:
  1. Description:
    - a. Standard: ASSE 1079.
    - b. Pressure Rating: 125 psig minimum at 180 deg F.
    - c. End Connections: Solder-joint copper alloy and threaded ferrous.
- C. Dielectric Flanges:

1. Description:
  - a. Standard: ASSE 1079.
  - b. Factory-fabricated, bolted, companion-flange assembly.
  - c. Pressure Rating: 125 psig minimum at 180 deg F.
  - d. End Connections: Solder-joint copper alloy and threaded ferrous; threaded solder-joint copper alloy and threaded ferrous.

## 2.6 BYPASS CHEMICAL FEEDER

- A. Description: Welded steel construction; 125-psig working pressure; 5-gal. capacity; with fill funnel and inlet, outlet, and drain valves.
  1. Chemicals: Specially formulated, based on analysis of makeup water, to prevent accumulation of scale and corrosion in piping and connected equipment.

## PART 3 - EXECUTION

### 3.1 PIPING APPLICATIONS

- A. Hot-water heating piping, aboveground, NPS 2 and smaller, shall be any of the following:
  1. Hard copper tube, Type L; copper, solder-joint fittings; and soldered joints.
  2. Schedule 40, Grade B steel pipe; Class 125, cast-iron fittings; cast-iron flanges and flange fittings; and threaded joints.
- B. Hot-water heating piping, aboveground, NPS 2-1/2 and larger, shall be any of the following:
  1. Hard copper tube, Type L; copper, solder-joint fittings; and soldered joints.
  2. Schedule 40 steel pipe, wrought-steel fittings and wrought-cast or forged-steel flanges and flange fittings, and welded and flanged joints.
- C. Makeup-water piping installed aboveground shall be the following:
  1. Hard copper tube, Type L; copper, solder-joint fittings; and soldered joints.
- D. Makeup-Water Piping Installed Belowground and within Slabs: Type K, annealed-temper copper tubing, wrought-copper fittings, and soldered joints. Use the fewest possible joints.
- E. Air-Vent Piping:
  1. Inlet: Same as service where installed with metal-to-plastic transition fittings for plastic piping systems according to piping manufacturer's written instructions.
  2. Outlet: Type K, annealed-temper copper tubing with soldered or flared joints.
- F. Safety-Valve-Inlet and -Outlet Piping for Hot-Water Piping: Same materials and joining methods as for piping specified for the service in which safety valve is installed with metal-to-plastic transition fittings for plastic piping systems according to piping manufacturer's written instructions.



### 3.2 INSTALLATION OF PIPING

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems. Indicated locations and arrangements are used to size pipe and calculate friction loss, expansion, and other design considerations. Install piping as indicated unless deviations to layout are approved on Coordination Drawings.
- B. Install piping in concealed locations unless otherwise indicated and except in equipment rooms and service areas.
- C. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- D. Install piping to permit valve servicing.
- E. Install piping at indicated slopes.
- F. Install piping free of sags and bends.
- G. Install fittings for changes in direction and branch connections.
- H. Install piping to allow application of insulation.
- I. Select system components with pressure rating equal to or greater than system operating pressure.
- J. Install groups of pipes parallel to each other, spaced to permit applying insulation and servicing of valves.
- K. Install drains, consisting of a tee fitting, NPS 3/4 ball valve, and short NPS 3/4 threaded nipple with cap, at low points in piping system mains and elsewhere as required for system drainage.
- L. Install piping at a uniform grade of 0.2 percent upward in direction of flow.
- M. Reduce pipe sizes using eccentric reducer fitting installed with level side up.
- N. Install branch connections to mains using mechanically formed tee fittings in main pipe, with the branch connected to the bottom of the main pipe. For up-feed risers, connect the branch to the top of the main pipe.
- O. Install valves according to the following:
  - 1. Section 230523 Valves for HVAC Piping."
- P. Install unions in piping, NPS 2 and smaller, adjacent to valves, at final connections of equipment, and elsewhere as indicated.
- Q. Install flanges in piping, NPS 2-1/2 and larger, at final connections of equipment and elsewhere as indicated.
- R. Install shutoff valve immediately upstream of each dielectric fitting.

### **3.3 JOINT CONSTRUCTION**

- A. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.
- B. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.
- C. Soldered Joints: Apply ASTM B813, water-flushable flux, unless otherwise indicated, to tube end. Construct joints according to ASTM B828 or CDA's "Copper Tube Handbook," using lead-free solder alloy complying with ASTM B32.
- D. Brazed Joints: Construct joints according to AWS's "Brazing Handbook," "Pipe and Tube" Chapter, using copper-phosphorus brazing filler metal complying with AWS A5.8.
- E. Threaded Joints: Thread pipe with tapered pipe threads according to ASME B1.20.1. Cut threads full and clean using sharp dies. Ream threaded pipe ends to remove burrs and restore full ID. Join pipe fittings and valves as follows:
  - 1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is specified.
  - 2. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged. Do not use pipe sections that have cracked or open welds.
- F. Welded Joints: Construct joints according to AWS D10.12, using qualified processes and welding operators according to "Quality Assurance" Article.
- G. Flanged Joints: Select appropriate gasket material, size, type, and thickness for service application. Install gasket concentrically positioned. Use suitable lubricants on bolt threads.
- H. Grooved Joints: Assemble joints with coupling and gasket, lubricant, and bolts. Cut or roll grooves in ends of pipe based on pipe and coupling manufacturer's written instructions for pipe wall thickness. Use grooved-end fittings and rigid, grooved-end-pipe couplings.

### **3.4 INSTALLATION OF DIELECTRIC FITTINGS**

- A. Install dielectric fittings in piping at connections of dissimilar metal piping and tubing.

### **3.5 INSTALLATION OF HANGERS AND SUPPORTS**

- A. Comply with requirements in Section 220529 "Hangers and Supports for HVAC Piping and Equipment" for hangers, supports, and anchor devices.
- B. Install hangers for copper tubing and steel piping, with maximum horizontal spacing and minimum rod diameters, to comply with MSS-58, locally enforced codes, and authorities having jurisdiction requirements, whichever are most stringent.
- C. Install hangers for plastic piping, with maximum horizontal spacing and minimum rod diameters, to comply with manufacturer's written instructions, locally enforced codes, and authorities having jurisdiction requirements, whichever are most stringent.

- D. Install hangers for fiberglass piping, with maximum horizontal spacing and minimum rod diameters, to comply with manufacturer's written instructions, locally enforced codes, and authorities having jurisdiction requirements, whichever are most stringent.
- E. Support horizontal piping within 12 inches of each fitting and coupling.
- F. Support vertical runs of copper tubing and steel piping to comply with MSS-58, locally enforced codes, and authorities having jurisdiction requirements, whichever are most stringent.

### **3.6 TERMINAL EQUIPMENT CONNECTIONS**

- A. Sizes for supply and return piping connections shall be the same as or larger than equipment connections.
- B. Install control valves in accessible locations close to connected equipment.
- C. Install bypass piping with globe valve around control valve. If parallel control valves are installed, only one bypass is required.

### **3.7 CHEMICAL TREATMENT**

- A. Perform an analysis of makeup water to determine type and quantities of chemical treatment needed to keep system free of scale, corrosion, and fouling. Chemical treatment shall maintain chemistry levels within the closed loop at all times within the ranges required by equipment manufacturers for every component installed within the system. Consult with vendors water treatment requirements after shop drawings are approved to ensure proper chemistry is maintained.
- B. All chemicals used in closed loop shall be food grade compatible and ensure that the water within the system maintains water quality to potable standards
- C. Install chemical feeders in each closed loop system as required to ensure proper circulation and mixing.
  - 1. Install in upright position with top of funnel not more than 48 inches above the floor.
  - 2. Install feeder in minimum NPS 3/4 bypass line, from main with full-size, full-port, ball valve in the main between bypass connections.
  - 3. Install NPS 3/4 pipe from chemical feeder drain to nearest equipment drain and include a full-size, full-port, ball valve.
- D. Fill system with fresh water and add liquid alkaline compound with emulsifying agents and detergents to remove grease and petroleum products from piping. Circulate solution for a minimum of 24 hours, drain, clean strainer screens, and refill with fresh water.
- E. Add initial chemical treatment and maintain water quality in ranges noted above for the first year of operation.

### 3.8 IDENTIFICATION

- A. Identify system components. Comply with requirements for identification materials and installation in Section 230553 "Identification for HVAC Piping and Equipment."

### 3.9 FIELD QUALITY CONTROL

- A. Prepare hydronic piping according to ASME B31.9 and as follows:
  - 1. Leave joints, including welds, uninsulated and exposed for examination during test.
  - 2. Provide temporary restraints for expansion joints that cannot sustain reactions due to test pressure. If temporary restraints are impractical, isolate expansion joints from testing.
  - 3. Flush hydronic piping systems with clean water; then remove and clean or replace strainer screens.
  - 4. Isolate equipment from piping. If a valve is used to isolate equipment, its closure shall be capable of sealing against test pressure without damage to valve. Install blinds in flanged joints to isolate equipment.
  - 5. Install safety valve, set at a pressure no more than one-third higher than test pressure, to protect against damage by expanding liquid or other source of overpressure during test.
- B. Perform the following tests on hydronic piping:
  - 1. Use ambient temperature water as a testing medium unless there is risk of damage due to freezing. Another liquid that is safe for workers and compatible with piping may be used.
  - 2. While filling system, use vents installed at high points of system to release air. Use drains installed at low points for complete draining of test liquid.
  - 3. Isolate expansion tanks and determine that hydronic system is full of water.
  - 4. Subject piping system to hydrostatic test pressure that is not less than 1.5 times the system's working pressure. Test pressure shall not exceed maximum pressure for any vessel, pump, valve, or other component in system under test. Verify that stress due to pressure at bottom of vertical runs does not exceed 90 percent of specified minimum yield strength or 1.7 times the "SE" value in Appendix A in ASME B31.9, "Building Services Piping."
  - 5. After hydrostatic test pressure has been applied for at least 10 minutes, examine piping, joints, and connections for leakage. Eliminate leaks by tightening, repairing, or replacing components, and repeat hydrostatic test until there are no leaks.
  - 6. Prepare written report of testing.
- C. Perform the following before operating the system:
  - 1. Open manual valves fully.
  - 2. Inspect pumps for proper rotation.
  - 3. Set makeup pressure-reducing valves for required system pressure.
  - 4. Inspect air vents at high points of system and determine if all are installed and operating freely (automatic type), or bleed air completely (manual type).
  - 5. Set temperature controls so all coils are calling for full flow.
  - 6. Inspect and set operating temperatures of hydronic equipment, such as boilers, chillers, cooling towers, to specified values.
  - 7. Verify lubrication of motors and bearings.

**END OF SECTION 232113**

## **SECTION 232116 - HYDRONIC PIPING SPECIALTIES**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section Includes:
  - 1. Hydronic specialty valves.
  - 2. Air-control devices.
  - 3. Strainers.
  - 4. Connectors.

#### **1.3 ACTION SUBMITTALS**

- A. Product Data: For each type of product:
  - 1. Include construction details and material descriptions for hydronic piping specialties.
  - 2. Include rated capacities, operating characteristics, and furnished specialties and accessories.
  - 3. Include flow and pressure drop curves based on manufacturer's testing for calibrated-orifice balancing valves and automatic flow-control valves.

#### **1.4 CLOSEOUT SUBMITTALS**

- A. Operation and Maintenance Data: For hydronic piping specialties to include in emergency, operation, and maintenance manuals.

#### **1.5 QUALITY ASSURANCE**

- A. Pipe Welding: Qualify procedures and operators according to ASME Boiler and Pressure Vessel Code: Section IX.
- B. Safety Valves and Pressure Vessels: Shall bear the appropriate ASME label. Fabricate and stamp air separators and expansion tanks to comply with ASME Boiler and Pressure Vessel Code: Section VIII, Division 1.

## PART 2 - PRODUCTS

### 2.1 HYDRONIC SPECIALTY VALVES

#### A. Bronze, Calibrated-Orifice, Balancing Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Armstrong Fluid Technology.
  - b. Bell & Gossett; a Xylem brand.
  - c. Taco Comfort Solutions.
2. Body: Bronze, ball or plug type with calibrated orifice or venturi.
3. Ball: Brass or stainless steel.
4. Plug: Resin.
5. Seat: PTFE.
6. End Connections: Threaded or socket.
7. Pressure Gage Connections: Integral seals for portable differential pressure meter.
8. Handle Style: Lever, with memory stop to retain set position.
9. CWP Rating: Minimum 125 psig.
10. Maximum Operating Temperature: 250 deg F.

#### B. Cast-Iron or Steel, Calibrated-Orifice, Balancing Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Armstrong Fluid Technology.
  - b. Bell & Gossett; a Xylem brand.
  - c. Griswold Controls.
2. Body: Cast-iron or steel body, ball, plug, or globe pattern with calibrated orifice or venturi.
3. Ball: Brass or stainless steel.
4. Stem Seals: EPDM O-rings.
5. Disc: Glass and carbon-filled PTFE.
6. Seat: PTFE.
7. End Connections: Flanged or grooved.
8. Pressure Gage Connections: Integral seals for portable differential pressure meter.
9. Handle Style: Lever, with memory stop to retain set position.
10. CWP Rating: Minimum 125 psig.
11. Maximum Operating Temperature: 250 deg F.

#### C. Diaphragm-Operated Safety Valves: ASME labeled.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Apollo Valves; a part of Aalberts Integrated Piping Systems.
  - b. Bell & Gossett; a Xylem brand.
  - c. WATTS.

2. Body: Bronze or brass.
3. Disc: Glass and carbon-filled PTFE.
4. Seat: Brass.
5. Stem Seals: EPDM O-rings.
6. Diaphragm: EPT.
7. Wetted, Internal Work Parts: Brass and rubber.
8. Inlet Strainer: <Insert materials>, removable without system shutdown.
9. Valve Seat and Stem: Noncorrosive.
10. Valve Size, Capacity, and Operating Pressure: Comply with ASME Boiler and Pressure Vessel Code: Section IV, and selected to suit system in which installed, with operating pressure and capacity factory set and field adjustable.

D. Automatic Flow-Control Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Apollo Valves; a part of Aalberts Integrated Piping Systems.
  - b. Bell & Gossett; a Xylem brand.
  - c. WATTS.
2. Body: Brass or ferrous metal.
3. Flow Control Assembly, provide either of the following:
  - a. Piston and Spring Assembly: Stainless steel, tamper proof, self-cleaning, and removable.
  - b. Elastomeric Diaphragm and Polyphenylsulfone Orifice Plate: Operating ranges within 2- to 80-psig (14- to 550-kPa) differential pressure.
4. Combination Assemblies: Include bronze or brass-alloy ball valve.
5. Identification Tag: Marked with zone identification, valve number, and flow rate.
6. Size: Same as pipe in which installed.
7. Performance: Maintain constant flow within plus or minus 10 percent, regardless of system pressure fluctuations.
8. Minimum CWP Rating: 175 psig.
9. Maximum Operating Temperature: 250 deg F.

## 2.2 AIR-CONTROL DEVICES

A. Manual Air Vents:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Bell & Gossett; a Xylem brand.
  - b. Taco Comfort Solutions.
  - c. WATTS.



2. Body: Bronze.
3. Internal Parts: Nonferrous.
4. Operator: Screwdriver or thumbscrew.
5. Inlet Connection: NPS 1/2.
6. Discharge Connection: NPS 1/8.
7. CWP Rating: 150 psig.
8. Maximum Operating Temperature: 225 deg F.

B. Automatic Air Vents:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Bell & Gossett; a Xylem brand.
  - b. Taco Comfort Solutions.
  - c. WATTS.
2. Body: Bronze or cast iron.
3. Internal Parts: Nonferrous.
4. Operator: Noncorrosive metal float.
5. Inlet Connection: NPS 1/2.
6. Discharge Connection: NPS 1/4.
7. CWP Rating: 150 psig.
8. Maximum Operating Temperature: 240 deg F.

C. Bladder-Type ASME Expansion Tanks:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. AMTROL, Inc.
  - b. Bell & Gossett; a Xylem brand.
  - c. Taco Comfort Solutions.
2. Tank: Welded steel, rated for 125-psig working pressure and 375 deg F maximum operating temperature. Factory test after taps are fabricated and supports installed and are labeled according to ASME Boiler and Pressure Vessel Code: Section VIII, Division 1.
3. Bladder: Securely sealed into tank to separate air charge from system water to maintain required expansion capacity.
4. Air-Charge Fittings: Schrader valve, stainless steel with EPDM seats.

D. Air-Charge Fittings: Schrader valve, stainless steel with EPDM seats.

E. Tangential-Type Air Separators:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. AMTROL, Inc.
  - b. Bell & Gossett; a Xylem brand.
  - c. Taco Comfort Solutions.

2. Tank: Welded steel; ASME constructed and labeled for 125-psig minimum working pressure and 375 deg F maximum operating temperature.
3. Air Collector Tube: Perforated stainless steel, constructed to direct released air into expansion tank.
4. Tangential Inlet and Outlet Connections: Threaded for NPS 2 and smaller; flanged connections for NPS 2-1/2 and larger.
5. Blowdown Connection: Threaded.
6. Size: Match system flow capacity.

## 2.3 STRAINERS

### A. Y-Pattern Strainers:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Griswold Controls.
  - b. Hays Fluid Controls.
  - c. WATTS.
2. Body: ASTM A126, Class B, cast iron with bolted cover and bottom drain connection.
3. End Connections: Threaded ends for NPS 2 and smaller; flanged ends for NPS 2-1/2 and larger.
4. Strainer Screen: Stainless-steel, 20-mesh strainer, or perforated stainless-steel basket.
5. CWP Rating: 125 psig.

## 2.4 CONNECTORS

### A. Stainless-Steel Bellow, Flexible Connectors:

1. Body: Stainless-steel bellows with woven, flexible, bronze, wire-reinforcing protective jacket.
2. End Connections: Threaded or flanged to match equipment connected.
3. Performance: Capable of 3/4-inch misalignment.
4. CWP Rating: 150 psig.
5. Maximum Operating Temperature: 250 deg F.

## PART 3 - EXECUTION

### 3.1 VALVE APPLICATIONS

- A. Install shutoff-duty valves at each branch connection to supply mains and at supply connection to each piece of equipment.
- B. Install calibrated-orifice, balancing valves at each branch connection to return main.
- C. Install calibrated-orifice, balancing valves in the return pipe of each heating or cooling terminal.

- D. Install check valves at each pump discharge and elsewhere as required to control flow direction.
- E. Install safety valves at hot-water generators and elsewhere as required by ASME Boiler and Pressure Vessel Code. Install drip-pan elbow on safety-valve outlet and pipe without valves to the outdoors; pipe drain to nearest floor drain or as indicated on Drawings. Comply with ASME Boiler and Pressure Vessel Code: Section VIII, Division 1, for installation requirements.
- F. Install pressure-reducing valves at makeup-water connection to regulate system fill pressure.

### **3.2 HYDRONIC SPECIALTIES INSTALLATION**

- A. Install manual air vents at high points in piping, at heat-transfer coils, and elsewhere as required for system air venting.
- B. Install automatic air vents at high points of system piping in mechanical equipment rooms only. Install manual vents at heat-transfer coils and elsewhere as required for air venting.
- C. Install piping from boiler air outlet, air separator, or air purger to expansion tank with a 2 percent upward slope toward tank.
- D. Install tangential air separator in pump suction. Install blowdown piping with gate or full-port ball valve; extend full size to nearest floor drain.
- E. Install expansion tanks above the air separator. Install tank fitting in tank bottom and charge tank. Use manual vent for initial fill to establish proper water level in tank.
  - 1. Install tank fittings that are shipped loose.
  - 2. Support tank from floor or structure above with sufficient strength to carry weight of tank, piping connections, fittings, plus tank full of water. Do not overload building components and structural members.

**END OF SECTION 232116**

## **SECTION 232123 - HYDRONIC PUMPS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section Includes:
  - 1. Close-coupled, in-line centrifugal pumps.

#### **1.3 DEFINITIONS**

- A. ECM: Electronically commutated motor.
- B. EPDM: Ethylene propylene diene monomer.
- C. EPR: Ethylene propylene rubber.
- D. FKM: Fluoroelastomer polymer.
- E. HI: Hydraulic Institute.
- F. NBR: Nitrile rubber or Buna-N.

#### **1.4 ACTION SUBMITTALS**

- A. Product Data: For each type of pump.
  - 1. Include certified performance curves and rated capacities, operating characteristics, furnished specialties, final impeller dimensions, and accessories for each type of product indicated.
  - 2. Indicate pump's operating point on curves.
- B. Shop Drawings: For each pump.
  - 1. Show pump layout and connections.
  - 2. Include setting drawings with templates for installing foundation and anchor bolts and other anchorages.
  - 3. Include diagrams for power, signal, and control wiring.
- C. Delegated-Design Submittal: For each pump.

1. Design calculations and vibration isolation base details, signed and sealed by a qualified professional engineer.
  - a. Design Calculations: Calculate requirements for selecting vibration isolators and seismic restraints.

## 1.5 INFORMATIONAL SUBMITTALS

- A. Seismic Qualification Data: Certificates for pumps, accessories, and components, from manufacturer.
  1. Basis for Certification: Indicate whether withstand certification is based on actual test of assembled components or on calculation.
  2. Dimensioned Outline Drawings of Equipment Unit: Identify center of gravity and locate and describe mounting and anchorage provisions.
  3. Detailed description of equipment anchorage devices on which the certification is based and their installation requirements.

## 1.6 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For pumps to include in emergency, operation, and maintenance manuals.

## PART 2 - PRODUCTS

### 2.1 PERFORMANCE REQUIREMENTS

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Seismic Performance: Pumps shall withstand the effects of earthquake motions determined in accordance with ASCE/SEI 7.
  1. The term "withstand" means "the unit will remain in place without separation of any parts from the device when subjected to the seismic forces specified and the unit will be fully operational after the seismic event."

### 2.2 CLOSE-COUPLED, IN-LINE CENTRIFUGAL PUMPS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  1. ITT Corporation.
  2. PACO Pumps; Grundfos Pumps Corporation, USA.
  3. Taco Comfort Solutions.
- B. Source Limitations: Obtain pumps from single source from single manufacturer.

- C. Description: Factory-assembled and -tested, centrifugal, overhung-impeller, close-coupled, in-line pump as defined in HI 1.1-1.2 and HI 1.3; designed for installation with pump and motor shafts mounted horizontally or vertically.
- D. Pump Construction:
  - 1. Casing: Radially split, cast iron, with threaded gauge tappings at inlet and outlet, replaceable bronze wear rings, and threaded companion-flange connections.
  - 2. Impeller: ASTM B584, cast bronze; statically and dynamically balanced, keyed to shaft, and secured with a locking cap screw. For constant-speed pumps, trim impeller to match specified performance.
  - 3. Pump Stub Shaft: Type 316 stainless steel.
  - 4. Seal: Mechanical seal consisting of carbon rotating ring against a ceramic seat held by a stainless steel spring, and EPDM rubber bellows and gasket. Include water slinger on shaft between motor and seal.
- E. Motor: Comply with NEMA designation, temperature rating, service factor, and efficiency requirements for motors.
  - 1. Enclosure : Totally enclosed, fan cooled.
  - 2. NEMA Premium Efficient motors as defined in NEMA MG 1.
  - 3. Motor Sizes: Minimum size as indicated. If not indicated, large enough so driven load will not require motor to operate in service factor range above 1.0.
  - 4. Controllers, Electrical Devices, and Wiring: Comply with requirements for electrical devices and connections specified in electrical Sections.
  - 5. Variable-speed motor.
  - 6. Provide integral pump motor variable-speed controller.

### 2.3 INTEGRAL PUMP MOTOR VARIABLE-SPEED CONTROLLERS

- A. Where specified or scheduled, provide pumps with an integral pump motor speed controller.
  - 1. Motor: Operates as constant- or variable-speed pump with speed regulated by an integrated variable-speed drive.
  - 2. Integrated Pump Controller: Supports direct communication with the building management system (BMS) with built-in support for the following protocols: BACnet MS/TP.
  - 3. Commissioning and pump set up access to pump controls via the following:
    - a. A web interface (data exchange).
    - b. A user interface located on the face of speed controller to adjust modes and mode values.
    - c. An electronic display that reads real-time mode set values, flow, head, speed, and power and that locks out unauthorized adjustment of pump.
  - 4. Provide electronics with "Auto" as factory default but slope of the proportional curve will automatically match the required system curve, constant pressure control ( $\Delta p/c$ ), variable differential pressure control ( $\Delta p/v$ ), constant curve duty (uncontrolled pump), and rpm regulation. RPM (speed) regulation can be accomplished by the following:
    - a. Manual (via user interface or HTML).
    - b. Remote via 0 to 10 V dc.
    - c. Data protocol communications with the BMS.

5. Pump Electronics: Standard with multiple digital inputs and one external digital output to be available for additional mechanical room control and pump status monitoring.
6. Controller: Mounted on or adjacent to the motor. Provide enclosure rated to UL Type 12.
7. Electronically Protected Pumps: Rated for continuous duty and with built-in startup circuit. Provide overcurrent, line surge and current limit protection, thermal monitoring, heat sink status and over temperature protection.
8. Pump capable of being monitored continuously via integrated Internet link.
9. Integrated pump controller system to have the following features:
  - a. Controller software shall be capable of sensorless control in variable-volume systems without need for pump-mounted (internal/external) or remotely mounted differential pressure sensor.
  - b. Integrated Pump Controller Sensorless Control: Operates under Quadratic Pressure Control (QPC) to ensure that head reduction with reducing flow conforms to quadratic control curve.
  - c. Controller:
    - 1) Minimum head of 40 percent of design duty head.
    - 2) User-adjustable control mode settings and minimum/maximum head set points using built-in programming interface.
  - d. Controller Integrated Control Software:
    - 1) Capable of controlling pump performance for non-overloading power at every point of operation.
    - 2) Capable of maintaining flow rate data.

### **PART 3 - EXECUTION**

#### **3.1 EXAMINATION**

- A. Examine equipment foundations and anchor-bolt locations for compliance with requirements for installation tolerances and other conditions affecting performance of the Work.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

#### **3.2 PUMP INSTALLATION**

- A. Comply with HI 1.4.
- B. Install pumps to provide access for periodic maintenance including removing motors, impellers, couplings, and accessories.
- C. Independently support pumps and piping so weight of piping is not supported by pumps and weight of pumps is not supported by piping.
- D. Equipment Mounting: Install in-line pumps with continuous-thread hanger rods and spring hangers with vertical-limit stop of size required to support weight of in-line pumps.
  1. Comply with requirements for hangers, supports, and seismic-restraint devices as required.

### **3.3 PIPING CONNECTIONS**

- A. Where installing piping adjacent to pump, allow space for service and maintenance.
- B. Connect piping to pumps. Install valves that are same size as piping connected to pumps.
- C. Install suction and discharge pipe sizes equal to or greater than diameter of pump nozzles.
- D. Install check and shutoff valves on discharge side of pumps.
- E. Install Y-type strainer and shutoff valve on suction side of pumps.
  - 1. Use startup strainer for initial system startup. Install permanent strainer element before turnover of system to Owner.
- F. Install flexible connectors on suction and discharge sides of base-mounted pumps between pump casing and valves.
- G. Install pressure gauges on pump suction and discharge or at integral pressure-gauge tapping, or install single gauge with multiple-input selector valve.

### **3.4 ELECTRICAL CONNECTIONS**

- A. Connect wiring, ground equipment, install electrical devices in accordance with electrical drawings and specifications.
- B. Install nameplate for each electrical connection, indicating electrical equipment designation and circuit number feeding connection.
  - 1. Nameplate shall be laminated acrylic or melamine plastic signs with a black background and engraved white letters at least 1/2 inch high.

### **3.5 CONTROL CONNECTIONS**

- A. Install control and electrical power wiring to field-mounted control devices.
- B. Connect control wiring in accordance with electrical drawings and specifications.

### **3.6 STARTUP SERVICE**

- A. Perform startup service.
  - 1. Complete installation and startup checks in accordance with manufacturer's written instructions.
  - 2. Check piping connections for tightness.
  - 3. Clean strainers on suction piping. Use startup strainer for initial startup.
  - 4. Perform the following startup checks for each pump before starting:
    - a. Verify that pump is free to rotate by hand and that pump for handling hot liquid is free to rotate with pump hot and cold. If pump is bound or drags, do not operate until cause of trouble is determined and corrected.
    - b. Verify that pump is rotating in correct direction.



5. Prime pump by opening suction valves and closing drains, and prepare pump for operation.
6. Start motor.
7. Open discharge valve slowly.

### **3.7 FIELD QUALITY CONTROL**

- A. Testing Agency: Engage a qualified testing agency to perform tests and inspections.
- B. Perform tests and inspections with the assistance of a factory-authorized service representative.
- C. Hydronic pumps will be considered defective if they do not pass tests and inspections.
- D. Prepare test and inspection reports.

### **3.8 DEMONSTRATION**

- A. Train Owner's maintenance personnel to adjust, operate, and maintain hydronic pumps.

**END OF SECTION 232123**

## SECTION 235233 - FIRE-TUBE BOILERS

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. Section Includes:
1. Vertical fire-tube boilers.

#### 1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product, include the following:
1. Construction details, material descriptions, dimensions, and weights of individual components, profiles, and finishes for boilers.
  2. Rated capacities, operating characteristics, and furnished specialties and accessories.
  3. Predicted boiler efficiency while operating at design capacity and at varying part loads with basis indicated.
  4. Predicted emissions levels while operating at design capacity and at varying part loads with basis indicated. Indicate operation that produces worst-case emissions.
  5. Technical data for refractory and insulation, including temperature rating, thermal performance, attachment, and arrangement.
  6. Calculations showing predicted surface temperature of boiler jacket with basis indicated.
  7. Force and moment capacity of each piping and flue connection.
  8. Dimensioned location of low, high, and normal water level, showing operating set point and each alarm set point.
  9. Temperature and pressure rating, size, and materials of construction for boiler trim components, including piping, fittings, flanges, unions, and valves. Provide valve manufacturer's product data for each valve furnished. For safety valves, include trip and reset settings and flow capacity.
  10. Manufacturer's product data showing size, scale range, and accuracy of thermometers and pressure gages.
  11. Pressure rating, size, and materials of construction for boiler fuel train components including piping, fittings, flanges, unions, switches, and valves. Provide manufacturer's product data for each valve and switch furnished.
  12. Detailed information of controls, including product data with technical performance, operating characteristics, and sequence of operation.
  13. Product data for each motor, including performance, operating characteristics, and materials of construction.
- B. Shop Drawings: For boilers, boiler trim, and accessories.
1. Include plans, elevations, sections, and mounting details.
  2. Include details of equipment assemblies. Indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.

3. Design calculations and base details, signed and sealed by a qualified professional engineer.
  - a. Design Calculations: Calculate requirements for selecting **vibration isolators and** seismic restraints and for designing bases.
  - b. Base Details: Detail fabrication, including anchorages and attachments to structure and to supported equipment. Include adjustable motor bases, rails, and frames for equipment mounting.
4. Include diagrams for power, signal, and control wiring. Differentiate between factory and field installation.
5. Include piping diagrams of factory-furnished piping that indicate size and each piping component.

### 1.3 INFORMATIONAL SUBMITTALS

- A. Coordination Drawings: Plan and elevation views, drawn to <Insert scale> scale, indicating equipment manufacturers' service clearances, structure and base attachment, piping, power, controls, and flues. Each view shows a screened background with the following:
  1. Column grids, beams, columns, and concrete housekeeping pads.
  2. Room layout with walls, floors, and roofs, including each room name and number.
  3. Equipment and products of other trades that are located in vicinity of boilers and are part of final installation, such as lighting, fire-suppression systems, and plumbing systems.
- B. Installation instructions.
- C. Source quality-control reports.
- D. Field quality-control reports.
- E. Sample Warranty: For special warranty.
- F. Other Informational Submittals:
  1. ASME Stamp Certification and Report: Submit "A," "S," or "PP" stamp certificate of authorization, as required by authorities having jurisdiction, and document hydrostatic testing of piping external to boiler.
  2. Startup service reports.

### 1.4 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For boilers, components, and accessories to include in emergency, operation, and maintenance manuals.
- B. Spare Parts List: Recommended spare parts list with quantity for each.

- C. Touch-up Paint Description: Detailed description of paint used in application of finish coat to allow for procurement of a matching paint.
- D. Instructional Videos: Including those that are prerecorded and those that are recorded during training.

#### 1.5 MAINTENANCE MATERIAL SUBMITTALS

- A. Tool kit to include the following:
  - 1. A tool kit specially designed by boiler manufacturer for use in servicing boiler(s) furnished.
  - 2. Special tools required to service boiler components not readily available to Owner service personnel in performing routine maintenance.
  - 3. Lockable case with hinged cover, marked with large and permanent text to indicate the special purpose of tool kit, such as "Boiler Tool Kit." Text size shall be at least 1 inch high.
  - 4. A list of each tool furnished. Permanently attach the list to underside of case cover. Text size shall be at least 0.5 inch high.
- B. Touch-up Paint: **32-oz.** container of paint used for finish coat. Label on outside of container shall have a detailed description of paint to allow for procurement of a matching paint in the future.

#### 1.6 DELIVERY, STORAGE, AND HANDLING

- A. Ship boilers from the factory free of water. Drain water and blow dry with compressed air if required to remove all water before shipping.
- B. Cover and protect flue, electrical controls, and piping connections before shipping. Protect and seal openings and connections with blinds, caps, plugs, and other materials during delivery, storage, and handling.
- C. Protect boiler components with removable temporary enclosures to prevent damage during shipping, storage, and installation.

#### 1.7 WARRANTY

- A. Special Warranty: Manufacturer agrees to repair or replace front- and rear-door refractories and heat exchangers of boilers that fail in materials or workmanship within specified warranty period.
  - 1. Vertical Fire-Tube Boilers and Heat Exchanger: 20 years from date of Substantial Completion, if following water-treatment program recommended by manufacturer.

## PART 2 - PRODUCTS

### 2.1 PERFORMANCE REQUIREMENTS

- A. Fuel-to-**water** efficiency indicated shall be based on the following:
  - 1. ASME Performance Test Code (PTC) 4, **Input-Output** method.
- B. Gas-Fired Boiler Emissions: Not to exceed allowable ambient air quality standards in governing jurisdiction and indicated values.
- C. Multiple Boiler Operation: Equip individual boilers in multiple boiler applications with integral controls to provide multiple boiler operation for optimum system performance, energy efficiency, and the following:
  - 1. Equalize runtime of boilers in service.
  - 2. Operate multiple boilers hot to minimize disruption of service in the event of single boiler failure.
  - 3. Configure controls so any boiler can be taken out of service with power disconnected and not impact multiple boiler operation.
- D. Seismic Performance: Boiler shall withstand the effects of earthquake motions determined according to ASCE/SEI 7.
  - 1. The term "withstand" means "the boiler will remain in place without separation of any parts when subjected to the seismic forces specified and the boiler will be fully operational after the seismic event."
  - 2. Component Importance Factor: 1.5.
  - 3. See drawings for seismic data.
- E. Operation Following Loss of Normal Power:
  - 1. Equipment, associated factory- and field-installed controls, and associated electrical equipment and power supply connected to back-up power system shall automatically return equipment and associated controls to the operating state occurring immediately before loss of normal power without need for manual intervention by an operator when power is restored either through a back-up power source or through normal power if restored before back-up power is brought online.
  - 2. Refer to Drawings for equipment served by back-up power systems.
  - 3. Provide means and methods required to satisfy requirement even if not explicitly indicated.
- F. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- G. ASME Compliance: Fabricate and label boilers to comply with 2010 ASME Boiler and Pressure Vessel Code.

- H. ASHRAE/IES 90.1 Compliance: Boilers shall have minimum efficiency according to "Gas and Oil Fired Boilers - Minimum Efficiency Requirements."
- I. UL Compliance: Test Boilers for compliance with UL 726 and UL 795. Boilers shall be listed and labeled by a testing agency acceptable to authorities having jurisdiction.

## 2.2 VERTICAL FIRE-TUBE BOILERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Hurst Boiler.
  - 2. IBC Technologies; a Rheem brand.
  - 3. Raypak; a Rheem brand.
- B. Description: Factory-fabricated, -assembled, and -tested, vertical fire-tube boilers with heat exchanger sealed pressure tight, built on a steel base; including insulated jacket, flue-gas vent, water-supply and -return connections, and controls.
- C. Pressure Vessel Design: Straight, steel pipe welded in a concentric pattern to separate flue-gas and heating media with welded fins to improve heat transfer in secondary flue-gas passages. Include the following accessories:
  - 1. Handholes for waterside inspections.
  - 2. Lifting lugs on top of boiler.
  - 3. Minimum NPS 1 hose-end drain valves at water passage low point.
  - 4. Tappings or flanges for water-supply and -return piping.
  - 5. Built-in air separator.
- D. Combustion Chamber: Equipped with flame retainer to lengthen flame-residence time.
- E. Insulation: Minimum 4-inch- thick, mineral-fiber insulation surrounding the heat exchanger and combustion chamber.
- F. Flue: Top connection, constructed of stainless steel.
- G. Jacket:
  - 1. Mirror-finish stainless steel with screw-fastened closures.
  - 2. Galvanized sheet metal, with screw-fastened closures and baked-enamel or powder-coated protective finish.
  - 3. Mounting base to secure boiler to concrete base.
- H. Barometric Damper: Galvanized-steel assembly with flue-gas thermometer having a minimum 3-1/2-inch diameter dial.
- I. BURNER
  - 1. Burner Tubes and Orifices: Stainless steel, for natural gas.

- a. Sealed Combustion: Factory-mounted centrifugal fan to draw outside air into boiler and discharge into burner compartment.
  - b. Direct Vent: Factory-mounted centrifugal fan to draw flue gas out of boiler and discharge into boiler vent.
2. Vertical Burner:
- a. High-temperature stainless steel or Ceramic to fire in a 360-degree pattern.
  - b. Burner shall have a viewing port for observation of burner operation and a factory-mounted centrifugal fan to supply ducted outdoor air through a replaceable 99 percent efficient (1-micrometer particles) filter to boiler burner.
  - c. Fan shall be controlled to prepurge and postpurge the combustion chamber before firing.
3. Gas Train: Control devices and full-modulation control sequence shall comply with ASME CSD-1 and UL requirements. In addition to these requirements, include shutoff cock, pressure regulator, and control valve.
4. Gas Train: Combination gas valve with manual shutoff, pressure regulator, and pilot adjustment.
5. Pilot: Intermittent-electric-spark or Hot-surface pilot ignition with 100 percent main-valve and pilot-safety shutoff with electronic supervision of burner flame.
6. Flue-Gas Recirculation System: Centrifugal fans on burner assembly to recirculate flue gas to decrease emissions to requirements indicated. Complete package integrating burner, fan, damper, fuel train, and controls. Provide interconnecting external ducting if required by manufacturer's design.
7. Motors: Comply with requirements for motors specified in Section 230513 "Common Motor Requirements for HVAC Equipment."
- J. Hot-Water Boiler Trim:
1. Hot-Water Temperature Controllers: Operating, and high limit.
  2. Safety Relief Valve: ASME rated.
  3. Pressure and Temperature Gage: Minimum 3-1/2-inch-diameter, combination water-pressure and -temperature gage. Gages shall have operating-pressure and -temperature ranges, so normal operating range is about 50 percent of full range.
  4. Boiler Air Vent: Manual.
  5. Drain Valve: Minimum NPS 3/4 hose-end valve.
  6. Circulation Pump: Non-overloading, in-line pump with split-capacitor motor having thermal-overload protection and lubricated bearings; designed to operate at boiler flow rate, pressures, and temperatures.
- K. Controls:
1. Boiler operating controls shall include the following devices and features:
    - a. Control transformer.
    - b. Set-Point Adjust: Set points shall be adjustable.
    - c. Sequence of Operation: Electric, factory-fabricated and field-installed panel to control burner firing rate to set supply-water temperature at 190 deg F (adj).

- d. Include automatic, alternating-firing sequence for multiple boilers to ensure maximum system efficiency throughout the load range and to provide equal runtime for boilers.
2. Burner Operating Controls: To maintain safe operating conditions, burner safety controls limit burner operation.
    - a. High Cutoff: Automatic reset stops burner if operating conditions rise above maximum boiler design temperature.
    - b. Water Flow Switch: Automatic-reset paddle-switch shall prevent burner operation on low water flow.
    - c. Rollout Safety Switch: Factory mounted on boiler combustion chamber.
    - d. Audible Alarm: Factory mounted on control panel with silence switch; shall sound alarm for above conditions.

### 2.3 ELECTRICAL POWER

- A. Single-Point Field Power Connection: Factory-installed and -wired switches, motor controllers, transformers, and other electrical devices necessary shall provide a single-point field power connection to boiler.
  1. Enclosure: NEMA 250, Type 1.
    - a. Enclosure shall have integral vents, fans, heat, and air conditioner as required to automatically control temperature inside enclosure within safe operating limits of devices installed within the enclosure.
    - b. Mounted on boiler assembly at a location convenient to operator.
    - c. Enclosure shall have hinged full-size door with key lock with common key for all locks.
  2. Wiring shall be numbered and color-coded to match wiring diagram.
  3. Install factory wiring outside of an enclosure in a raceway. Make final connections to motors using flexible conduit. Provide watertight installation for applications exposed to moisture.
  4. Provide branch power circuit to each motor and to controls from circuit breaker.
  5. Provide each motor with NEMA-rated motor controller, hand-off-auto switch, and overcurrent protection. Provide variable-frequency controller with manual bypass and line reactors for each variable-speed motor indicated.

### 2.4 VENTING KITS

- A. Vent Damper: Motorized; UL listed for use on atmospheric burner boiler equipped with draft hood; motor to open and close damper; stainless-steel vent coupling and damper blade; keyed wiring harness connector plug; and dual-position switches to permit burner operation.
- B. Combustion-Air Intake: Stainless steel, pipe, vent terminal with screen, inlet air coupling, and sealant



## 2.5 SOURCE QUALITY CONTROL

- A. Test and inspect factory-assembled boilers, before shipping, according to 2010 ASME Boiler and Pressure Vessel Code.
  
- B. Burner and Hydrostatic Test:
  - 1. Factory adjust burner to eliminate excess oxygen, carbon dioxide, oxides of nitrogen emissions, and carbon monoxide in flue gas and to achieve performance requirements indicated.
  - 2. Perform hydrostatic test of pressure vessel, piping, and trim of assembled boiler.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Before boiler installation, examine roughing-in for concrete equipment bases, anchor-bolt sizes and locations, and flue; piping; controls; and electrical connections to verify actual locations, sizes, and other conditions affecting boiler performance, maintenance, and operations.
  - 1. Boiler locations indicated on Drawings are approximate. Determine exact locations before roughing-in for flue, piping, controls, and electrical connections.
- B. Examine areas where boilers will be installed for suitable conditions.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 BOILER INSTALLATION

- A. Coordinate size and location of bases. Cast anchor-bolt inserts into concrete bases. Concrete, reinforcement, and formwork requirements are specified with concrete.
- B. Equipment Mounting:
  - 1. Install boilers on cast-in-place concrete equipment base(s). Comply with requirements for equipment bases and foundations specified in Section 033000 "Cast-in-Place Concrete."
  - 2. Comply with requirements for vibration isolation and seismic-control devices specified in Section 230548 "Vibration and Seismic Controls for HVAC."
  - 3. Comply with requirements for vibration isolation devices specified in Section 230548.13 "Vibration Controls for HVAC."
- C. Install gas-fired boilers according to NFPA 54.
- D. Assemble and install boiler trim, components, and accessories that are not factory installed.
- E. Install control and electrical devices furnished with boiler that are not factory mounted.

- F. Install control and power wiring to field-mounted control and electrical devices furnished with boiler that are not factory installed.
- G. Perform boil-out and cleaning procedures according to manufacturer's written instructions after completion of hydrostatic testing and before performing other field tests. Following boil-out and cleaning procedures, boiler shall be washed and flushed until water leaving boiler is clear.
- H. Protect boiler fireside and waterside from corrosion.
  - 1. Before boiler is filled with water, protect by dry storage method recommended by boiler manufacturer.
  - 2. After boiler is filled with water, and left not fired for more than 2 days, protect by wet storage method recommended by boiler manufacturer.
  - 3. Chemical Treatment: Quality of water in boilers shall be maintained by a professional water-treatment organization that shall provide on-site supervision to maintain the required water quality during periods of boiler storage as well as during operating, standby, and test conditions.

### **3.3 PIPING CONNECTIONS**

- A. Piping installation requirements are specified in other Sections. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Where installing piping adjacent to boiler(s), allow space for service and maintenance.
- C. Connect gas piping to boiler gas-train inlet with dirt leg, shutoff valve, and union or flange. Piping shall be at least full size of gas-train connection. Provide a reducer if required.
- D. Connect hot-water piping to supply- and return-boiler connections with shutoff valve and union or flange at each connection.
- E. Install piping from safety relief valves to nearest floor drain.
- F. Install piping from equipment drain connection to nearest floor drain. Piping shall be at least full size of connection. Provide an isolation valve if required.
- G. Hot equipment drains connected to sanitary drainage system shall be cooled before discharging into the system if required to comply with more stringent of governing code requirements and requirements indicated.
  - 1. Provide a temperature-controlled nonpotable domestic cold water source to cool hot equipment drains to deliver a discharge temperature of 120°F.

### **3.4 FLUE CONNECTIONS**

- A. Boiler Flue Venting:
  - 1. Install venting kit and combustion-air intake.

2. Connect full size to boiler connections.

B. Connect breeching to full size of boiler outlet.

C. Install flue-gas recirculation duct from vent to burner if not factory furnished and installed. Comply with boiler manufacturer and code requirements for boiler flue requirements and materials. PVC is not acceptable.

D. Install easily accessible test ports for field testing of flue gas from each boiler.

### **3.5 CONTROLS CONNECTIONS**

A. Install control and electrical power wiring to field-mounted control devices.

B. Connect control wiring between boilers and other equipment to interlock operation as required, to provide a complete and functioning system.

### **3.6 FIELD QUALITY CONTROL**

A. Perform the following tests and inspections with the assistance of a factory-authorized service representative:

1. Perform installation and startup checks according to manufacturer's written instructions.

2. Hydrostatic Leak Test: Repair leaks and retest until no leaks exist.

3. Operational Test: Start units to confirm proper motor rotation and unit operation. Adjust air-fuel ratio and combustion.

4. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.

a. Check and adjust initial operating set points and high- and low-limit safety set points of fuel supply, water level, and water temperature steam pressure.

b. Set field-adjustable switches and circuit-breaker trip ranges as indicated.

B. Boiler will be considered defective if it does not pass tests and inspections.

C. Prepare test and inspection reports.

D. Occupancy Adjustments: When requested within 12 months of date of Substantial Completion, provide on-site assistance in adjusting system to suit actual occupied conditions. Provide up to two visits to Project during other-than-normal occupancy hours for this purpose.

### **3.7 DEMONSTRATION**

A. Train Owner's maintenance personnel to adjust, operate, and maintain boilers.

END OF SECTION 235239

## **SECTION 235700 – SHELL AND TUBE HEAT EXCHANGERS (DOMESTIC)**

### **PART 1 - GENERAL**

#### **1.1 SUMMARY**

- A. Section Includes:
1. Shell-and-tube, domestic-water heat exchangers.
  2. Accessories.

#### **1.2 ACTION SUBMITTALS**

- A. Product Data: For each type of product. Include rated capacities, operating characteristics, electrical characteristics, and furnished specialties and accessories.

#### **1.3 INFORMATIONAL SUBMITTALS**

- A. Coordination Drawings: Equipment room drawing or BIM model, drawn to scale, showing the items described in this Section, and coordinated with all building trades. Also indicate the following:
1. Tube removal space, both vertical and/or horizontal as applicable.
  2. Structural members to which heat exchangers will be attached.
- B. Seismic Qualification Data: Certificates, for domestic-water heat exchangers, water heaters, accessories, and components, from manufacturer.
1. Basis for Certification: Indicate whether withstand certification is based on actual test of assembled components or on calculation.
  2. Dimensioned Outline Drawings of Equipment Unit: Identify center of gravity and locate and describe mounting and anchorage provisions.
  3. Detailed description of equipment anchorage devices on which the certification is based and their installation requirements.
- C. Product Certificates: For each type of shell-and-tube heat exchanger from manufacturer.
1. Domestic-Water, Heat-Exchanger Labeling: Certified and labeled by testing agency acceptable to authorities having jurisdiction.
  2. Domestic-Water Heater Labeling: Certified and labeled by testing agency acceptable to authorities having jurisdiction.
- D. Source quality-control reports.
- E. Field quality-control reports.

- F. Sample Warranty: For special warranty.

#### **1.4 CLOSEOUT SUBMITTALS**

- A. Operation and Maintenance Data: For domestic-water heat exchangers and heaters to include in emergency, operation, and maintenance manuals.

#### **1.5 COORDINATION**

- A. Coordinate sizes and locations of concrete bases with actual equipment provided.

#### **1.6 WARRANTY**

- A. Special Warranty: Manufacturer agrees to repair or replace components of domestic-water heat exchangers and heaters that fail in materials or workmanship within specified warranty period.
  - 1. Failures include, but are not limited to, the following:
    - a. Structural failures, including domestic-water heat exchanger, water heater, storage tank, and supports.
    - b. Faulty operation of controls.
    - c. Deterioration of metals, metal finishes, and other materials beyond normal use.
  - 2. Warranty Periods: From date of Substantial Completion.
    - a. Shell-and-Tube, Domestic-Water Heat Exchangers:
      - 1) Tube Coil: 5 year(s).
      - 2) Controls and Other Components: 1 year.

### **PART 2 - PRODUCTS**

#### **2.1 PERFORMANCE REQUIREMENTS**

- A. ASHRAE/IES 90.1 Compliance: Applicable requirements in ASHRAE/IES 90.1.
- B. ASME Compliance: Where ASME-code construction is indicated, fabricate and label heat-exchanger storage tanks to comply with ASME Boiler and Pressure Vessel Code: Section VIII, Division 1.
- C. NSF Compliance: Fabricate and label equipment components that will be in contact with potable water to comply with NSF 61 and NSF 372.
- D. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by an NRTL, and marked for intended location and application.

1. The term "withstand" means "the unit will remain in place without separation of any parts from the device when subjected to the seismic forces specified and the unit will be fully operational after the seismic event."
2. Component Importance Factor: **1.5**.
3. See drawings for seismic design factors.

## **2.2 SHELL-AND-TUBE, DOMESTIC-WATER HEAT EXCHANGERS**

- A. Manufacturers:
  1. Bell & Gossett, a Xylem brand..
  2. Taco, Inc..
  3. Aerco, a Watts brand.
- B. Description: Factory-packaged assembly of shell, U-tube heat-exchanger coils, and specialties for heating domestic water with heating hot water in shells.
- C. Construction:
  1. Fabricate and label heat exchanger to comply with ASME Boiler and Pressure Vessel Code, Section VIII, "Pressure Vessels," Division 1.
- D. Configuration: U-tube with removable four-pass bundle.
- E. Shell Materials: Carbon-steel shell with 150-psig minimum working-pressure rating.
  1. Tappings: Factory fabricated of materials compatible with heat-exchanger shell. Attach tappings to shell before testing and labeling.
    - a. NPS 2 and Smaller: Threaded ends according to ASME B1.20.1.
    - b. NPS 2-1/2 and Larger: Flanged ends according to ASME B16.5 for steel and stainless-steel flanges and according to ASME B16.24 for copper and copper-alloy flanges.
- F. Head: Cast iron, flanged and bolted to shell.
- G. Heat-Exchanger Coil: Double-wall, copper or copper-nickel coils for domestic water. Include pressure rating equal to or greater than heating-fluid-supply pressure.
- H. Relief Valves: ASME rated and stamped for combination temperature- and pressure-relief valves. Include one or more relief valves with total relieving capacity at least as great as heat input, and include pressure setting of less than working-pressure rating of heat exchanger. Select one relief valve with sensing element that extends into storage tank.
- I. Miscellaneous Components for Heating Hot-Water Unit: Control valve, valves, and piping.
- J. Stand: Factory fabricated on skid for floor mounting.
- K. Insulation: Complying with ASHRAE/IES 90.1, unless otherwise indicated, and suitable for operating temperature. Surround entire shell and nozzle, except connections and controls.

- L. Required Connections: Domestic cold water in; domestic hot water out; heating hot-water supply in; heating hot water out.
- M. Capacity and Characteristics- see drawings.

### **2.3 ACCESSORIES**

- A. Combination Temperature- and Pressure-Relief Valves: ASME rated and stamped. Include relieving capacity at least as great as heat input, and include pressure setting less than heat-exchanger working-pressure rating. Select relief valves with sensing element that extends into storage tank.
- B. Pressure-Relief Valves: ASME rated and stamped. Include pressure setting less than heat-exchanger working pressure rating.
- C. Vacuum-Relief Valves: ANSI Z21.22/CSA 4.4.

### **2.4 SOURCE QUALITY CONTROL**

- A. Factory Tests: Test and inspect domestic-water heat exchangers and domestic-water heaters specified to ASME-code construction, according to ASME Boiler and Pressure Vessel Code.
- B. Hydrostatically test domestic-water heat exchangers and domestic-water heaters to minimum of one and one-half times pressure rating before shipment.
- C. Domestic-water heat exchangers and domestic-water heaters will be considered defective if they do not pass tests and inspections. Comply with requirements in Section 014000 "Quality Requirements" for retesting and reinspecting requirements and Section 017300 "Execution" for requirements for correcting the Work.
- D. Prepare test and inspection reports.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION OF DOMESTIC-WATER HEAT EXCHANGERS AND DOMESTIC-WATER HEATERS**

- A. Domestic-Water Heat Exchangers: Install domestic-water heat exchangers on concrete base.
  - 1. Install dowel rods to connect concrete base to concrete floor. Unless otherwise indicated, install dowel rods on 18-inch centers around the full perimeter of concrete base.
  - 2. For supported equipment, install epoxy-coated anchor bolts that extend through concrete base and anchor into structural concrete floor.
  - 3. Place and secure anchorage devices. Use setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
  - 4. Install anchor bolts to elevations required for proper attachment to supported equipment.

- B. Install domestic-water heat exchangers level and plumb, according to layout drawings, original design, and referenced standards. Maintain manufacturer's recommended clearances. Arrange units so controls and devices needing service are accessible.
  - 1. Install shutoff valves on domestic cold-water supply piping to domestic-water heat exchangers and on domestic-hot-water outlet piping.
  - 2. Install shutoff valves on heating hot-water piping to domestic-water heat exchangers.
- C. Install domestic-water heat exchangers with seismic-restraint devices. Comply with requirements for seismic-restraint devices specified in Section 220548 "Vibration and Seismic Controls for Plumbing Piping and Equipment."
- D. Install temperature- and pressure-relief valves in top portion of domestic-water storage tank shells. Use relief valves with sensing elements that extend into shells. Extend relief-valve outlet, with drain piping same as domestic water piping in continuous downward pitch, and discharge by positive air gap onto closest floor drain.
- E. Install combination temperature- and pressure-relief valves in water piping for domestic-water heat exchangers and domestic-water heaters without storage. Extend relief-valve outlet, with drain piping same as domestic-water piping in continuous downward pitch, and discharge by positive air gap onto closest floor drain.
- F. Install domestic-water heat exchangers and domestic-water heaters drain piping as indirect waste to spill by positive air gap into open drains or over floor drains. Install hose-end drain valves at low points in domestic-water piping for heat exchangers and heaters that do not have tank drains.
- G. Install thermometer on each domestic-water heat exchanger inlet and outlet piping, and install thermometer on each heat exchanger and heater heating-fluid inlet and outlet piping.
- H. Install pressure gauges on domestic-water heat exchanger heating-fluid piping.
- I. Fill domestic-water heat exchangers and domestic-water heaters with water.

### **3.2 PIPING CONNECTIONS**

- A. Comply with requirements for piping specified in Section 221116 "Domestic Water Piping."
- B. Drawings indicate general arrangement of piping, fittings, and specialties.
- C. Where installing piping adjacent to domestic-water heat exchangers, allow space for service and maintenance. Arrange piping for easy removal of heat exchangers and heaters.

### **3.3 IDENTIFICATION**

- A. Identify system components with proper Identification.



### **3.4 FIELD QUALITY CONTROL**

- A. Perform tests and inspections with the assistance of a factory-authorized service representative.
- B. Tests and Inspections:
  - 1. Leak Test: After installation, charge system and test for leaks. Repair leaks and retest until no leaks exist.
  - 2. Operational Test: After electrical circuitry has been energized, start units to confirm proper operation.
  - 3. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.
- C. Domestic-water heat exchangers and domestic-water heaters will be considered defective if they do not pass tests and inspections.
- D. Prepare test and inspection reports.

### **3.5 DEMONSTRATION**

- A. Train Owner's maintenance personnel to adjust, operate, and maintain domestic-water heat exchangers.

**END OF SECTION 235700**

## **SECTION 260533 - RACEWAYS AND BOXES FOR ELECTRICAL SYSTEMS**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section Includes:
  - 1. Metal conduits, tubing, and fittings.
  - 2. Nonmetal conduits, tubing, and fittings.
  - 3. Boxes, enclosures, and cabinets.
  - 4. Handholes and boxes for exterior.

### **PART 2 - PRODUCTS**

#### **2.1 METAL CONDUITS, TUBING, AND FITTINGS**

- A. Listing and Labeling: Metal conduits, tubing, and fittings shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. GRC: Comply with ANSI C80.1 and UL 6.
- C. ARC: Comply with ANSI C80.5 and UL 6A.
- D. IMC: Comply with ANSI C80.6 and UL 1242.
- E. PVC-Coated Steel Conduit: PVC-coated rigid steel conduit IMC.
  - 1. Comply with NEMA RN 1.
  - 2. Coating Thickness: 0.040 inch (1 mm), minimum.
- F. EMT: Comply with ANSI C80.3 and UL 797.
- G. FMC: Comply with UL 1; zinc-coated steel or aluminum.
- H. LFMC: Flexible steel conduit with PVC jacket and complying with UL 360.
- I. Fittings for Metal Conduit: Comply with NEMA FB 1 and UL 514B.
  - 1. Conduit Fittings for Hazardous (Classified) Locations: Comply with UL 886 and NFPA 70.

2. Fittings for EMT:
    - a. Material: Steel or die cast .
    - b. Type: Setscrew or compression .
  3. Expansion Fittings: PVC or steel to match conduit type, complying with UL 651, rated for environmental conditions where installed, and including flexible external bonding jumper.
  4. Coating for Fittings for PVC-Coated Conduit: Minimum thickness of 0.040 inch (1 mm), with overlapping sleeves protecting threaded joints.
- J. Joint Compound for IMC, GRC, or ARC: Approved, as defined in NFPA 70, by authorities having jurisdiction for use in conduit assemblies, and compounded for use to lubricate and protect threaded conduit joints from corrosion and to enhance their conductivity.

## **2.2 NONMETALLIC CONDUITS, TUBING, AND FITTINGS**

- A. Listing and Labeling: Nonmetallic conduits, tubing, and fittings shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. RNC: Type EPC-40-PVC, complying with NEMA TC 2 and UL 651 unless otherwise indicated.
- C. Fittings for RNC: Comply with NEMA TC 3; match to conduit or tubing type and material.
- D. Solvent cements and adhesive primers shall have a VOC content of 510 and 550 g/L or less, respectively, when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
- E. Solvent cements and adhesive primers shall comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."

## **2.3 METAL WIREWAYS AND AUXILIARY GUTTERS**

- A. Description: Sheet metal, complying with UL 870 and NEMA 250, Type 1, Type 3R unless otherwise indicated, and sized according to NFPA 70.
  1. Metal wireways installed outdoors shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Fittings and Accessories: Include covers, couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, and other fittings to match and mate with wireways as required for complete system.
- C. Wireway Covers: Hinged type unless otherwise indicated.
- D. Finish: Manufacturer's standard enamel finish.

## 2.4 BOXES, ENCLOSURES, AND CABINETS

- A. General Requirements for Boxes, Enclosures, and Cabinets: Boxes, enclosures, and cabinets installed in wet locations shall be listed for use in wet locations.
- B. Sheet Metal Outlet and Device Boxes: Comply with NEMA OS 1 and UL 514A.
- C. Cast-Metal Outlet and Device Boxes: Comply with NEMA FB 1, ferrous alloy, aluminum, Type FD, with gasketed cover.
- D. Luminaire Outlet Boxes: Nonadjustable, designed for attachment of luminaire weighing 50 lb (23 kg). Outlet boxes designed for attachment of luminaires weighing more than 50 lb (23 kg) shall be listed and marked for the maximum allowable weight.
- E. Small Sheet Metal Pull and Junction Boxes: NEMA OS 1.
- F. Device Box Dimensions: 4 inches square by 2-1/8 inches deep (100 mm square by 60 mm deep).
- G. Gangable boxes are allowed.
- H. Hinged-Cover Enclosures: Comply with UL 50 and NEMA 250, Type 1, Type 3R with continuous-hinge cover with flush latch unless otherwise indicated.
  - 1. Metal Enclosures: Steel, finished inside and out with manufacturer's standard enamel.

## PART 3 - EXECUTION

### 3.1 RACEWAY APPLICATION

- A. Outdoors: Apply raceway products as specified below unless otherwise indicated:
  - 1. Underground Conduit: RNC, Type EPC-40-PVC.
- B. Indoors: Apply raceway products as specified below unless otherwise indicated:
  - 1. Exposed, Not Subject to Physical Damage: EMT.
  - 2. Exposed, Subject to Physical Damage: IMC or rigid below 8' in mechanical work bays.
- C. Minimum Raceway Size: 3/4-inch trade size.
- D. Do not install aluminum conduits, boxes, or fittings in contact with concrete or earth.

### 3.2 INSTALLATION

- A. Comply with NECA 1 and NECA 101 for installation requirements except where requirements on Drawings or in this article are stricter. Comply with NECA 102 for aluminum conduits.

Comply with NFPA 70 limitations for types of raceways allowed in specific occupancies and number of floors.

- B. Complete raceway installation before starting conductor installation.
- C. Comply with requirements in Section 260529 "Hangers and Supports for Electrical Systems" for hangers and supports.
- D. Arrange stub-ups so curved portions of bends are not visible above finished slab.
- E. Install no more than the equivalent of three 90-degree bends in any conduit run except for control wiring conduits, for which fewer bends are allowed. Support within 12 inches (300 mm) of changes in direction.
- F. Support conduit within 12 inches (300 mm) of enclosures to which attached.
- G. Surface Raceways:
- H. Install devices to seal raceway interiors at accessible locations. Locate seals so no fittings or boxes are between the seal and the following changes of environments. Seal the interior of all raceways at the following points:
  - 1. Where conduits pass from warm to cold locations, such as boundaries of refrigerated spaces.
  - 2. Where an underground service raceway enters a building or structure.
  - 3. Where otherwise required by NFPA 70.
- I. Mount boxes at heights indicated on Drawings. If mounting heights of boxes are not individually indicated, give priority to ADA requirements. Install boxes with height measured to center of box unless otherwise indicated.

**END OF SECTION 260533**

## **SECTION 262726 - WIRING DEVICES**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. Section Includes:
  - 1. Receptacles with integral GFCI, and associated device plates. Scope of work includes replacement of explosive-proof devices in declassified areas as defined on plans.

#### **1.3 ACTION SUBMITTALS**

- A. Product Data: For each type of product.

### **PART 2 - PRODUCTS**

#### **2.1 MANUFACTURERS**

- A. Source Limitations: Obtain each type of wiring device and associated wall plate from single source from single manufacturer.

#### **2.2 GENERAL WIRING-DEVICE REQUIREMENTS**

- A. Wiring Devices, Components, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Comply with NFPA 70.

#### **2.3 GFCI RECEPTACLES**

- A. General Description:
  - 1. Straight blade, non-feed-through type.
  - 2. Comply with NEMA WD 1, NEMA WD 6, UL 498, UL 943 Class A, and FS W-C-596.
  - 3. Include indicator light that shows when the GFCI has malfunctioned and no longer provides proper GFCI protection.

## **2.4 TOGGLE SWITCHES**

- A. Comply with NEMA WD 1, UL 20, and FS W-S-896.
- B. Switches, 120/277 V, 20 A:
  - 1. Single Pole and three-way as indicted.
  - 2. Pilot light single pole, pilot on-light on.

## **2.5 WALL PLATES**

- A. Single and combination types shall match corresponding wiring devices.
  - 1. Plate-Securing Screws: Metal with head color to match plate finish.
  - 2. Material for Unfinished Spaces: Stainless steel.
- B. Wet-Location, Weatherproof Cover Plates: NEMA 250, complying with Type 3R, weather-resistant, die-cast aluminum with lockable cover.

## **2.6 FINISHES**

- A. Device colors and plates shall be as selected by Owner.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Comply with NECA 1, including mounting heights listed in that standard, unless otherwise indicated.
- B. Coordination with Other Trades:
  - 1. Protect installed devices and their boxes. Do not place wall finish materials over device boxes and do not cut holes for boxes with routers that are guided by riding against outside of boxes.
  - 2. Keep outlet boxes free of plaster, drywall joint compound, mortar, cement, concrete, dust, paint, and other material that may contaminate the raceway system, conductors, and cables.
  - 3. Install wiring devices after all wall preparation, including painting, is complete.
- C. Conductors:
  - 1. Do not strip insulation from conductors until right before they are spliced or terminated on devices.
  - 2. Strip insulation evenly around the conductor using tools designed for the purpose. Avoid scoring or nicking of solid wire or cutting strands from stranded wire.

3. The length of free conductors at outlets for devices shall meet provisions of NFPA 70, Article 300, without pigtails.

D. Device Installation:

1. Replace devices that have been in temporary use during construction and that were installed before building finishing operations were complete.
2. Keep each wiring device in its package or otherwise protected until it is time to connect conductors.
3. Do not remove surface protection, such as plastic film and smudge covers, until the last possible moment.
4. Connect devices to branch circuits using pigtails that are not less than 6 inches (152 mm) in length.
5. When there is a choice, use side wiring with binding-head screw terminals. Wrap solid conductor tightly clockwise, two-thirds to three-fourths of the way around terminal screw.
6. Use a torque screwdriver when a torque is recommended or required by manufacturer.
7. When conductors larger than No. 12 AWG are installed on 15- or 20-A circuits, splice No. 12 AWG pigtails for device connections.
8. Tighten unused terminal screws on the device.
9. When mounting into metal boxes, remove the fiber or plastic washers used to hold device-mounting screws in yokes, allowing metal-to-metal contact.

E. Receptacle Orientation:

1. Install ground pin of vertically mounted receptacles up.

**END OF SECTION 262726**



## **SECTION 262816 - ENCLOSED SWITCHES AND CIRCUIT BREAKERS**

### **PART 1 - GENERAL**

#### **1.1 SUMMARY**

- A. Section Includes:
  - 1. Fusible switches.
  - 2. Nonfusible switches.
  - 3. Molded-case circuit breakers (MCCBs).
  - 4. Enclosures.

#### **1.2 ACTION SUBMITTALS**

- A. Product Data: For each type of enclosed switch, circuit breaker, accessory, and component indicated. Include nameplate ratings, dimensioned elevations, sections, weights, and manufacturers' technical data on features, performance, electrical characteristics, ratings, accessories, and finishes.

### **PART 2 - PRODUCTS**

#### **2.1 GENERAL REQUIREMENTS**

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by an NRTL, and marked for intended location and application.
- B. Comply with NFPA 70.

#### **2.2 FUSIBLE SWITCHES**

- A. Manufacturers: Subject to compliance with requirements, provide products by the following:
  - 1. ABB Inc.
  - 2. Eaton.
  - 3. General Electric Company.
  - 4. SIEMENS Industry, Inc.; Energy Management Division.
  - 5. Square D; by Schneider Electric.
- B. Type HD, Heavy Duty:
  - 1. Single throw.
  - 2. Three poles.
  - 3. 1200 A and smaller.

4. UL 98 and NEMA KS 1, horsepower rated, with clips or bolt pads to accommodate specified fuses.
5. Lockable handle with capability to accept three padlocks, and interlocked with cover in closed position.

C. Accessories:

1. Equipment Ground Kit: Internally mounted and labeled for copper and aluminum ground conductors.
2. Class R Fuse Kit: Provides rejection of other fuse types when Class R fuses are specified.

### 2.3 NONFUSIBLE SWITCHES

A. Manufacturers: Subject to compliance with requirements, provide products by the following:

1. Eaton.
2. General Electric Company.
3. SIEMENS Industry, Inc.; Energy Management Division.
4. Square D; by Schneider Electric.

B. Type GD, General Duty, Three Pole, Single Throw, 240-V ac, 600 A and Smaller: UL 98 and NEMA KS 1, horsepower rated, lockable handle with capability to accept two padlocks, and interlocked with cover in closed position.

C. Type HD, Heavy Duty, Three Pole, Single Throw, 600-V ac, 1200 A and Smaller: UL 98 and NEMA KS 1, horsepower rated, lockable handle with capability to accept three padlocks, and interlocked with cover in closed position.

D. Accessories:

1. Equipment Ground Kit: Internally mounted and labeled for copper and aluminum ground conductors.

### 2.4 MOLDED-CASE CIRCUIT BREAKERS

A. Manufacturers: Subject to compliance with requirements, provide products by the following:

1. Eaton.
2. General Electric Company.
3. NOARK Electric North America.
4. SIEMENS Industry, Inc.; Energy Management Division.
5. Square D; by Schneider Electric.

B. Circuit breakers shall be constructed using glass-reinforced insulating material. Current carrying components shall be completely isolated from the handle and the accessory mounting area.

- C. The maximum ampere rating and UL, IEC, or other certification standards with applicable voltage systems and corresponding interrupting ratings shall be clearly marked on face of circuit breaker. Circuit breakers shall be 100 percent rated. Standards: Comply with UL 489 with interrupting capacity to comply with available fault currents.
- D. Thermal-Magnetic Circuit Breakers: Inverse time-current thermal element for low-level overloads and instantaneous magnetic trip element for short circuits. Adjustable magnetic trip setting for circuit-breaker frame sizes 250 A and larger.
- E. Adjustable, Instantaneous-Trip Circuit Breakers: Magnetic trip element with front-mounted, field-adjustable trip setting.
- F. Features and Accessories:
  - 1. Standard frame sizes, trip ratings, and number of poles.

## **2.5 ENCLOSURES**

- A. Enclosed Switches and Circuit Breakers: UL 489, NEMA KS 1, NEMA 250, and UL 50, to comply with environmental conditions at installed location.
- B. Enclosure Finish: The enclosure shall be finished with gray baked enamel paint, electrodeposited on cleaned, phosphatized steel (NEMA 250 Type 1).
- C. Operating Mechanism: The circuit-breaker operating handle shall be externally operable with the operating mechanism being an integral part of the box, not the cover directly operable through the dead front trim of the enclosure (NEMA 250 Type 3R). The cover interlock mechanism shall have an externally operated override. The override shall not permanently disable the interlock mechanism, which shall return to the locked position once the override is released. The tool used to override the cover interlock mechanism shall not be required to enter the enclosure in order to override the interlock.

## **PART 3 - EXECUTION**

### **3.1 ENCLOSURE ENVIRONMENTAL RATING APPLICATIONS**

- A. Enclosed Switches and Circuit Breakers: Provide enclosures at installed locations with the following environmental ratings.
  - 1. Indoor, Dry and Clean Locations: NEMA 250, Type 1.
  - 2. Outdoor Locations: NEMA 250, Type 3R.

### **3.2 INSTALLATION**

- A. Coordinate layout and installation of switches, circuit breakers, and components with equipment served and adjacent surfaces. Maintain required workspace clearances and required clearances for equipment access doors and panels.

- B. Install individual wall-mounted switches and circuit breakers with tops at uniform height unless otherwise indicated.
- C. Install fuses in fusible devices.
- D. Comply with NFPA 70 and NECA 1.
- E. Set field-adjustable circuit-breaker trip ranges to values indicated on the Drawings.

**END OF SECTION 262816**

Design & Install New Domestic Water Plant  
Veterans Home Building  
St. James, MO

U2409-01

Exhibit A

**Technical Data Bulletin**

## Cleaning Closed Loop Systems

New or existing closed loop heating or cooling systems contain mill scale, corrosion products metal chips weld spatter or other debris that need to be removed prior to be placed in operation. The presence of these contaminants can cause abrasions and subsequent failure of pump seals.

**New Systems:** A liquid, neutral pH dispersant sequesterant such as Walter Louis 96 Precleaner should be added to the system at a rate of 1 to 1.5 lbs. per 100 gallons of system water.

The system should be circulated at normal operating flows, for a minimum of 24 to 48 hours. After the initial cleaning period a continuous bleed off should be initiated, and continued with fresh water make-up until the conductivity of the system reaches 300 micromhos higher than the make-up water. At this point the circulation pumps should be shut off and the entire system drained from its lowest point. The system should then be refilled with fresh water and the specified corrosion inhibitor.

**Existing Systems:** A liquid, neutral pH dispersant-sequesterant such as Walter Louis 96 Precleaner should be added to the system at a rate of 1 to 5 lbs. per 100 gallons of system capacity. Dosage is determined by the condition of the piping. The system should be circulated at normal operating flows, for a minimum of 7 to 10 days. Less than 1 micron side stream filtration at 5 to 10% of circulation flow should be maintained until the water is clear. After the initial cleaning period a continuous bleed off should be initiated, and continued with fresh water make-up until the conductivity of the system reaches 300 micromhos higher than the make-up water. At this point the circulation pumps should be shut off and the entire system drained from its lowest point. The system should then be refilled with fresh water and the specified corrosion inhibitor.

### **Recommended Corrosion Inhibitors:**

**WLFT 839:** standard borate nitrite corrosion inhibitor. Provides excellent corrosion control for all metals found in most heating and cooling systems.

**WLFT 0225:** Molybdate based inhibitor for use in more critical applications or where bacterial contamination is likely.

**Technical Data Bulletin**

## PHOS-FLO POTABLE WATER CORROSION INHIBITOR

**PRODUCT USE:** *Walter Louis Phos-Flo* is a specialty blend of long-chain stabilized phosphates specifically designed to alleviate the three most common problems in drinking water and well water: 'red water', corrosion, and scale formation.

Phos-Flo is exceptionally stable with low reversion to orthophosphate. It has a very high iron sequestering ability that provides suspended red water and iron oxide deposit control, and inhibits calcium and magnesium scaling. It interferes with calcium and magnesium crystal formation and growth, and works to remove existing carbonate and sulfate scale deposits, and facilitates hydrogen sulfide removal. Phos-Flo can also reduce chlorine demand associated with metals.

Phos-Flo is acceptable for treating potable water. It contains no zinc, silicates, or organics.

Phos-Flo meets the Code of Federal Regulations (CFR) Chapter 21, Sections 182 & 184, as Generally Recognized As Safe (GRAS)

**APPLICATION:** Phos-Flo should be fed undiluted in proportion to the water flow. Normal feed rates for 'red water' control is 1-5 ppm of Phos-Flo per part of iron and magnesium.

**AVAILABILITY:** 5, 15, 55 gallon drums, bulk totes to 330 gallon. Direct pump-in service to a customer-owned bulk tank is available upon request.

**SUPPORT:** All users of Walter Louis products can make use of our in-house lab's analytical services, usually at no additional charge.

### PHYSICAL PROPERTIES:

<b>Appearance:</b>	<b>Clear Water-White Liquid</b>
<b>Odor:</b>	<b>Negligible</b>
<b>Specific Gravity:</b>	<b>1.388</b>
<b>pH of 1% solution:</b>	<b>6.80</b>
<b>Shipping Class:</b>	<b>Non-Hazardous</b>